NAVAJO GALLUP WATER SUPPLY PROJECT
REACH 21

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NGWSP REACH 22 TO ENWP PHASE 3

June 2017

PROJECT DESCRIPTION

THE PROJECT CONSISTS OF CONSTRUCTION OF
1.09 MILES OF 24" PVC & 2.69 MILES OF 20" WATERLINE
WITH 500K GALLON WATER STORAGE TANK

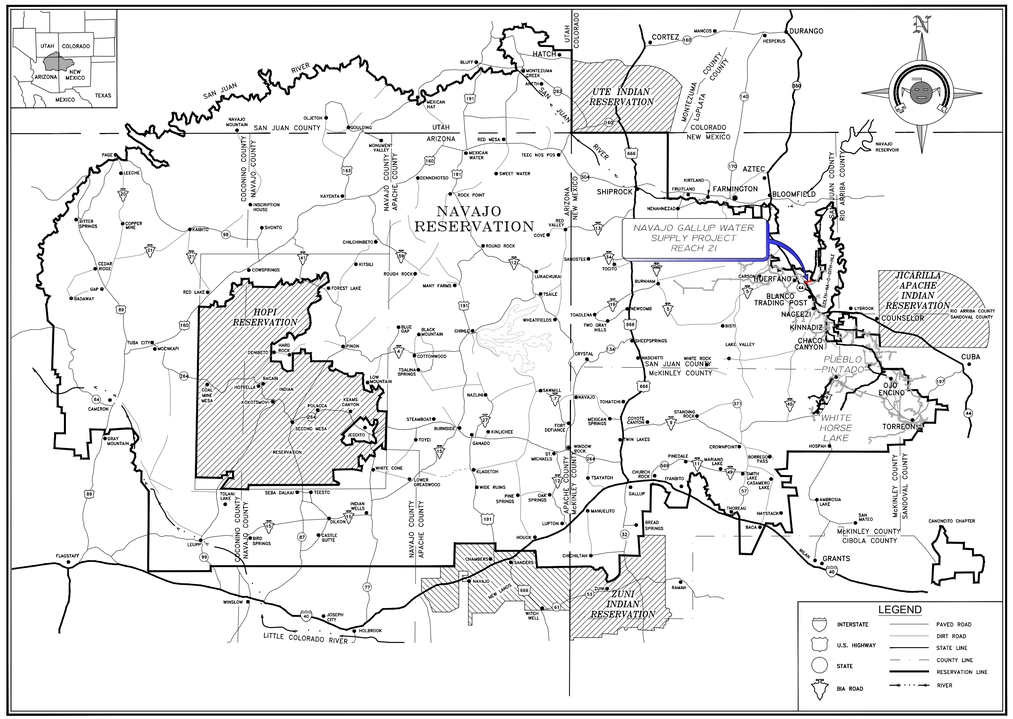

NAVAJO RESERVATION
PROJECT SITE MAP

30% REVISED DRAFT 6-19-17

NOTE: ALL NOTES IN RED ARE DESIGN NOTES ONLY AND WILL NOT BE INCLUDED IN THE FINAL PLAN SET. THESE ARE TO ASSIST IN INTERNAL DESIGN AND REVIEW ONLY.

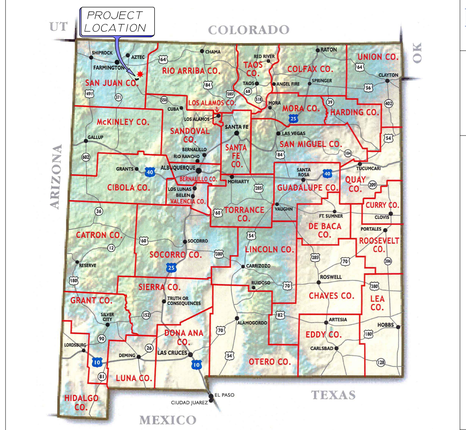

PROJECT VICINITY MAP

DRAWING LIST

GENERAL

G-1	COVER SHEET & DRAWING LIST
G-2	GENERAL NOTES & LEGEND
G-3	PROJECT SITE PLAN AND DRAWING KEY INDEX
G-4	SURVEY CONTROL PLAN (1 OF 2)
G-5	SURVEY CONTROL PLAN (2 OF 2)
G-6	HYDRAULIC PROFILE

REACH 21 PLAN AND PROFILES

C-1	PLAN & PROFILE STA -0+21.4 To 24+00
C-2	PLAN & PROFILE STA 24+00 To 48+00
C-3	PLAN & PROFILE STA 48+00 To 58+00
C-4	PLAN & PROFILE STA 58+00 To 82+00
C-5	PLAN & PROFILE STA 82+00 To 106+00
C-6	PLAN & PROFILE STA 106+00 To 127+00
C-7	PLAN & PROFILE STA 127+00 To 151+00
C-8	PLAN & PROFILE STA 151+00 To 173+00
C-9	PLAN & PROFILE STA 173+00 To 188+00
C-10	PLAN & PROFILE STA 188+00 To 199+76.3

SITEPLANS

C-11	REACH 22 TANK SITE NO. 2 TIE IN
C-12	REACH 21 TANK SITE NO. 3 SITE PLAN
C-13	REACH 21 TANK SITE NO. 3 GRADING PLAN
C-14	REACH 21 TANK SITE NO. 3 STORMWATER BMP PLAN
C-15	REACH 21 TANK SITE NO. 3 PIPING PLAN
C-16	REACH 21 TANK SITE NO. 3 SITE VALVE NUMBERS
C-17	ENWP PHASE 3 TIE IN

DETAILS

DT-1	PIPELINE TRENCH DETAILS
DT-2	MISCELLANEOUS CONSTRUCTION DETAILS
DT-3	THRUST BLOCK DETAILS
DT-4	WALL ANCHOR BLOCK & PIPE TRANSITION DETAILS
DT-5	GAS LINE CROSSING DETAILS
DT-6	ROAD CROSSING DETAILS
DT-7	PIPELINE BUTTERFLY VALVE DETAILS
DT-8	SITE BUTTERFLY & GATE VALVE DETAILS
DT-9	3-INCH VACUUM RELIEF WITH 1-INCH AIR RELEASE VALVE DETAIL
DT-10	4-INCH FLUSH VALVE WITH RISER DETAIL
DT-11	WASH CROSSING STA 42+02 PIPELINE HDD DETAIL
DT-12	WASH CROSSING STA 95+37 PIPELINE HDD DETAIL
DT-13	WASH CROSSING STA 129+92 PIPELINE HDD DETAIL
DT-14	TANK DETAILS (1 of 2)
DT-15	TANK DETAILS (2 of 2)
DT-16	TYPICAL WATER STORAGE TANK DETAILS (1 of 2)
DT-17	TYPICAL WATER STORAGE TANK DETAILS (2 of 2)
DT-18	STANDARD FENCE DETAILS
DT-19	EROSION CONTROL DETAILS (1 of 2)
DT-20	EROSION CONTROL DETAILS (2 of 2) AND R-O-W GRADING
DT-21	TRAFFIC CONTROL (GRAVEL AND DIRT ROAD)

ELECTRICAL

E-1	ELECTRICAL TANK SITE PLAN

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

Draft
Not For Distribution
Information Only

USA/DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO
CUTTER LATERAL - REACH 21
WATER PIPELINE

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

COVER SHEET & DRAWING LIST

USBR-DWG-NMBR
SHEET G-1

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atrv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Cover-Gen Notes.dwg

GENERAL NOTES

1. THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND IS NOT LIABLE FOR PROBLEMS THAT MAY ARISE FROM CONTRACTOR'S FAILURE TO FOLLOW THESE DRAWINGS, SPECIFICATIONS, AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS ARISING FROM FAILURE TO OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES, OR CONFLICTS.

2. IF THERE IS A CONFLICT BETWEEN THE PLANS, SPECIFICATIONS AND/OR MANUFACTURER'S RECOMMENDATIONS FOR ANY DEVICE, PART, OR MATERIAL USED IN THE PROJECT, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER, IN WRITING, FOR CLARIFICATION AT LEAST TWO WEEKS PRIOR TO CONSTRUCTION OF SAID DEVICE, PART, OR MATERIAL.

3. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO FAMILIARIZE HIMSELF WITH THE LOCATION OF ALL UTILITIES LOCATED WITHIN THE LIMITS OF CONSTRUCTION. THE GENERAL LOCATION OF KNOWN EXISTING UTILITIES HAS BEEN SHOWN ON THE CONSTRUCTION DRAWINGS TO INDICATE THAT CAUTION MUST BE EXERCISED WHEN WORKING IN THESE AREAS. IN MANY CASES THE EXACT LOCATION OF THE FACILITIES IS NOT KNOWN. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND PROTECTING ALL OVERHEAD AND UNDERGROUND UTILITIES WITHIN THE VICINITY OF THE NEW CONSTRUCTION. PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR, WORKING WITH THE RESPECTIVE UTILITY COMPANIES, SHALL ACCURATELY LOCATE AND MARK ALL BURIED FACILITIES, INCLUDING SERVICE LINES. ALL EQUIPMENT LABOR, ETC. NECESSARY TO PROPERLY LOCATE THE EXISTING UTILITIES SHALL BE FURNISHED BY THE CONTRACTOR, THE COST OF WHICH SHALL BE INCIDENTAL TO THE WORK.

4. CONTRACTOR SHALL REPAIR ANY EXISTING STRUCTURE OR UTILITY PIPELINE DAMAGED DURING THE EXECUTION OF THE PROJECT, AT NO ADDITIONAL COSTS TO THE OWNER.

5. CONTRACTOR IS SOLELY RESPONSIBLE FOR CONSTRUCTING THE PROJECT ACCORDING TO CURRENT NEW MEXICO STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (NMSSPWC) AWWA SPECS AND NAVAJO NATION / NTUA STANDARDS, INCLUDING WHERE PARTICULAR WORK ITEMS ARE NOT SPECIFIED HEREIN.

6. CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS AS SET FORTH IN THE TECHNICAL SPECIFICATIONS AND CONTRACT DOCUMENTS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO CONTACT THE ENGINEER REGARDING ANY QUESTION ARISING FROM ANY ASPECT OF THIS PROJECT NOT SPECIFICALLY COVERED IN THE PLANS AND TECHNICAL SPECIFICATIONS, OR ANY CHANGES OR CORRECTIONS TO THE PLANS AND SPECS.

7. THESE DRAWINGS DO NOT INCLUDE NECESSARY COMPONENTS FOR CONSTRUCTION SAFETY, WHICH SHALL REMAIN WHOLLY THE RESPONSIBILITY OF THE CONTRACTOR. ALL WORK ON THIS PROJECT SHALL BE PERFORMED IN ACCORDANCE WITH APPLICABLE FEDERAL (OSHA), STATE, TRIBAL AND LOCAL LAWS, RULES AND REGULATIONS CONCERNING SAFETY AND HEALTH. ALL EXCAVATION, TRENCHING AND SHORING ACTIVITIES MUST BE CARRIED OUT IN ACCORDANCE WITH OSHA 29 CFR 1926, SUBPART P - EXCAVATIONS.

8. CONTRACTOR SHALL PROVIDE INGRESS AND EGRESS TO ANY LOCAL BUSINESSES AND RESIDENTS AS REQUIRED FOR THE DURATION OF THE PROJECT. THE CONTRACTOR SHALL ADVISE OF AND SCHEDULE ACCESS CLOSURES AT LEAST 24 HOURS IN ADVANCE WITH PROPERTY OWNERS AND THE ENGINEER.

9. THE CONTRACTOR SHALL CONFINE HIS OPERATIONS TO THE CONSTRUCTION LIMITS OF THE PROJECT AND SHALL IN NO WAY ENCROACH ONTO ADJACENT PROPERTIES UNLESS LEGAL EASEMENTS ARE PROVIDED OR SECURED BY THE CONTRACTOR. THE CONTRACTOR WILL BE HELD RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONSTRUCTION ACTIVITIES TO PUBLIC OR PRIVATE PROPERTY, INCLUDING UTILITIES.

10. THE DRAWINGS CONTAIN SPECIFIC EROSION CONTROL FEATURES DESIGNED BY THE ENGINEER TO PROTECT PROJECT FACILITIES FROM EROSION. THESE FEATURES ARE NOT DESIGNED TO PREVENT POLLUTION OF WATERWAYS DUE TO SEDIMENT. THE CONTRACTOR IS WHOLLY RESPONSIBLE TO PROVIDE A STORM WATER POLLUTION PREVENTION PLAN (SWPPP) AND IMPLEMENT THE BEST MANAGEMENT PRACTICES (BMPs) REQUIRED THEREIN, IN ADDITION TO THE FEATURES SHOWN ON THE DRAWINGS. ALL BID ITEMS REFERRING TO SPECIFIC EROSION CONTROL FEATURES, SUCH AS RIPRAP OR ROCK DAMS, ARE APPLICABLE ONLY TO FEATURES DESIGNED BY THE ENGINEER. A SEPARATE BID ITEM(S) IS PROVIDED FOR PREPARATION AND IMPLEMENTATION OF THE CONTRACTOR'S SWPPP.

11. ALL RIPRAP, ROCK CHECK DAMS AND OTHER EROSION CONTROL FEATURES SHOWN ON THE DRAWINGS ARE APPROXIMATE WITH REGARD TO QUANTITY, LOCATION, DIMENSIONS, SPACING, AND ORIENTATION. EXACT PLACEMENT WILL BE DETERMINED IN FIELD BY ENGINEER AFTER FINAL GRADING IS COMPLETE.

12. ALL AREAS DISTURBED BY THE CONSTRUCTION ACTIVITIES OF THIS PROJECT SHALL BE RESTORED AND RE-GRADED IN A MANNER ACCEPTABLE TO THE OWNER, ENGINEER, AND LAND OWNER. ALL DISTURBED AREAS SHALL BE RE-SEEDED PER THE CONTRACT DOCUMENTS.

13. ALL SURVEY CONTROL MARKERS AND COORDINATES SHOWN ON PLANS ARE PROVIDED BY OWNER. ENGINEER MAKES NO REPRESENTATION AS TO THEIR ACCURACY.

14. ALL PRESSURE RATINGS GIVEN HEREIN FOR PIPES, VALVES, FITTINGS AND OTHER COMPONENTS REFER TO COLD WATER WORKING PRESSURE RATING, UNLESS OTHERWISE NOTED.

15. VERTICAL CLEARANCES AT WATERLINE CROSSINGS ON PLAN AND PROFILE SHEETS CALLED OUT AS "MIN CLR TO CL" REFER TO MINIMUM CLEARANCE FROM BOTTOM OF EXISTING WATERLINE TO VERTICAL CENTERLINE OF PROPOSED WATERLINE. VERTICAL CLEARANCES FOR CASINGS CALLED OUT AS "MIN CLR TO CASING" REFER TO MINIMUM CLEARANCE FROM BOTTOM OF EXISTING PIPELINE OR FINISHED GRADE TO TOP OF PROPOSED CASING. VERTICAL CLEARANCES AT WASH CROSSINGS CALLED OUT AS "MIN TO CL" REFER TO MINIMUM PIPE DEPTH, MEASURED FROM BOTTOM OF WASH TO VERTICAL CENTERLINE OF PROPOSED WATERLINE.

16. ALL SCALES ARE BASED ON 22" x 34" SHEET SIZE.

CONTACT INFORMATION:

SOUDER, MILLER & ASSOCIATES (ENGINEER):

ANDREW ROBERTSON, P.E (OFFICE) (505) 299-0942 (CELL) (505) 264-1488

ABBREVIATIONS

AASHTO	AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS
A.C.	ASPHALTIC CONCRETE
ACI	AMERICAN CONCRETE INSTITUTE
AC.	ACRE
AC-FT.	ACRE FEET
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
ALIGN.	ALIGNMENT
ALUM	ALUMINUM
AMSL	ABOVE MEAN SEA LEVEL
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
APPROX.	APPROXIMATE
ARV	AIR RELEASE VALVE
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS
AWG	AMERICAN WIRE GAUGE
AWWA	AMERICAN WATER WORKS ASSOCIATION
BFV	BUTTERFLY VALVE
BIA	BUREAU OF INDIAN AFFAIRS
BLDG	BUILDING
BLM	BUREAU OF LAND MANAGEMENT
BV	BALL VALVE
BVCE	BEGIN VERTICAL CURVE ELEVATION
BVCS	BEGIN VERTICAL CURVE STATION
CL	CENTERLINE
CFS	CUBIC FEET PER SECOND
CI	CAST IRON
CLR.	CLEARANCE
CMP	CORRUGATED METAL PIPE
COMM.	COMMUNICATION
CONC.	CONCRETE
CONST.	CONSTRUCTION
CONT.	CONTINUOUS
CONT.	CONTINUED
COR.	CORNER
COUP.	COUPLING
CP	CONTROL POINT
CTR	CENTER
CU	CUBIC
CY	CUBIC YARD
DI	DUCTILE IRON
DIA	DIAMETER
DIMS	DIMENSIONS
DR	DIMENSION RATIO
DW	DRIVEWAY
E	EAST
E	EASTING
EA.	EACH
ED.	EDITION
EG	EXISTING GRADE
ELEC.	ELECTRICAL
EL., ELEV.	ELEVATION
EOP	EDGE OF PAVEMENT
EQ.	EQUAL
ESMT.	EASEMENT
EVCE	END VERTICAL CURVE ELEVATION
EVCS	END VERTICAL CURVE STATION
EX, EXIST.	EXISTING
FBE	FUSION BONDED EPOXY
FF	FINISHED FLOOR
FFE	FINISHED FLOOR ELEVATION
FG	FINISHED GRADE
FIG.	FIGURE
FL	FLANGE
FND.	FOUND
FNPT	FEMALE NATIONAL PIPE THREAD
FRP	FIBER REINFORCED PLASTIC
FT.	FEET
FV	FLUSH VALVE
GA.	GAUGE
GALV.	GALVANIZED
GI	GALVANIZED IRON
GPM	GALLONS PER MINUTE
GV	GATE VALVE
HDD	HORIZONTAL DIRECTIONAL DRILLING
HDPE	HIGH DENSITY POLYETHYLENE
HORIZ.	HORIZONTAL
HP	HORSE POWER
HT	HEIGHT
HWY	HIGHWAY
I.A.	INDIAN ALLOTMENT
I.D.	INNER DIAMETER
I.E.	THAT IS, FOR EXAMPLE
IN.	INCH
INV	INVERT
IPS	IRON PIPE SIZE
KSI	KILO POUNDS PER SQUARE INCH

LAT	LATITUDE
L, LEN	LENGTH
LF	LINEAR FEET
LT	LEFT
LONG	LONGITUDE
LVC	LENGTH VERTICAL CURVE
MANUF	MANUFACTURER
MAX.	MAXIMUM
MIL	ONE THOUSANDTHS OF AN INCH
MIN.	MINIMUM
M.J.	MECHANICAL JOINT
MNPT	MALE NATIONAL PIPE THREAD
M.S.L.	MEAN SEA LEVEL
N	NORTH
N	NORTHING
NEC	NATIONAL ELECTRICAL CODE
NG	NATURAL GAS
NGWSP	NAVAJO GALLUP WATER SUPPLY PROJECT
NM	NEW MEXICO
NMDOT	NEW MEXICO DEPARTMENT OF TRANSPORTATION
NMED	NEW MEXICO ENVIRONMENT DEPARTMENT
NN	NAVAJO NATION
NO.	NUMBER
NPT	NATIONAL PIPE THREAD
NTS	NOT TO SCALE
OAE	OR APPROVED EQUAL
O.C.	ON CENTER
O.C.E.W.	ON CENTER EACH WAY
O.D.	OUTER DIAMETER
OHE	OVERHEAD ELECTRICAL
PE	PLAIN END
P.G.P.	PER GRADING PLAN
PI	POINT OF INFLECTION
PROP	PROPOSED
PRV	PRESSURE REDUCING VALVE
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PVC	POLY VINYL CHLORIDE
PVI	POINT VERTICAL INFLECTION
PVT	PRIVATE
Q	FLOW
QTY.	QUANTITY
R	RADIUS
R-	RANGE
REF	REFERENCE
RO	ROUGH OPENING
ROW	RIGHT OF WAY
RT	RIGHT
S	SOUTH
SCH	SCHEDULE
SDR	STANDARD DIMENSION RATIO
SEC.	SECTION
SF	SAFETY FACTOR
SHT	SHEET
SPECS.	SPECIFICATIONS
SS	STAINLESS STEEL
STA	STATION
STD.	STANDARD
SW	SIDEWALK
T	TOWNSHIP
TBD	TO BE DETERMINED
TBR	TO BE REMOVED
TCE	TEMPORARY CONSTRUCTION EASEMENT
TDH	TOTAL DYNAMIC HEAD
TELE.	TELEPHONE
TEMP.	TEMPORARY
THK	THICK
TNT	NAVAJO TRIBAL TRUST
T.O.	TOP OF
TRANS	TRANSFORMER
TW	TOP OF WALL
TYP	TYPICAL
UGE	UNDERGROUND ELECTRIC
USGS	UNITED STATES GEOLOGICAL SURVEY
V	VOLUME
VB	VACUUM BREAKER
VERT.	VERTICAL
VLV	VALVE
VR	VACUUM RELIEF
W	WATER
W	WEST
W/	WITH
WL	WATERLINE
WP	WORKING PRESSURE
WT	WALL THICKNESS
WV	WATER VALVE
YDS	YARDS
Z	ZENITH

LEGEND
EXISTING

- BUTTERFLY VALVE
- GATE VALVE
- WATER METER
- HYDRANT
- POWER POLE
- GUY ANCHOR
- ELECTRICAL J-BOX
- TELEPHONE PEDESTAL
- STORM DRAIN INLET / OUTLET
- BUILDING
- CATTLE GUARD
- ROAD SIGN
- EXISTING DRAINAGE WASH
- GUARD RAIL
- ROAD EDGE
- ROAD CENTER
- 6490 — CONTOUR MAJOR
- 6492 — CONTOUR MINOR
- SECTION CORNER
- CULTURALLY SENSITIVE AREA
- 12 — SECTION NUMBER
- Tribal Trust/I.A./BLM — CURRENT LAND STATUS (OWNER)
- SECTION LINE
- QUARTER SECTION LINE
- TOWNSHIP / RANGE LINE
- X — FENCE
- OHE — OVERHEAD POWER LINE
- UGE — UNDERGROUND POWER LINE
- TEL — OVERHEAD TELEPHONE LINE
- UGT — UNDERGROUND TELEPHONE LINE
- W — WATER LINE
- G — GAS LINE

LEGEND
PROPOSED

- W — WATER LINE
- X — FENCE
- PIPE CASING
- BUTTERFLY VALVE
- VACUUM BREAKER / AIR RELEASE VALVE COMBO
- FLUSH VALVE
- DOUBLE SWING GATE
- DRAIN PIPE
- SWALE
- DIRECTION OF FLOW
- MATCH LINE
- 6965 — CONTOUR MAJOR
- 6964 — CONTOUR MINOR
- WATERLINE EASEMENT
- TEMPORARY CONSTRUCTION EASEMENT
- ACCESS DRIVE / ROAD
- RIP RAP
- GRAVEL OVER BASE COURSE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

For Official Use Only
Draft
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — SIGN APPROVAL - TITLE

FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

GENERAL NOTES & LEGEND

USBR-DWG-NMBR

SHEET G-2

DATE AND TIME PLOTTED 6/9/17
PLOTTED BY jav

CAD SYSTEM AUTOCAD
CAD FILENAME Reach 21 Cover-Gen Notes.dwg

SAN JUAN COUNTY, NEW MEXICO

North 1977600
Lat 36°26'06"
East 2713900
Long -107°32'10"

North 1977600
Lat 36°26'06"
East 2741200
Long -107°46'18"

R-10-W
R-9-W

Huerfano Mountain

Hwy 44 / U.S. 550

BLM
TNT
I.A. 11155
I.A. 37799
I.A. 211164
I.A. 211166
Austin Land Dev. Co. Inc
Huerfano Trading Post
STATE

PROPOSED REACH 21 TANK SITE NO. 3
(SEE SITE PLAN C-12 THRU C-16)

REACH 22 TANK SITE NO. 2
(BY OTHERS. SEE SHEET C-11)

C-1 0+00
C-2
C-3 52+00
C-4
C-5
C-6 100+00
C-7
C-8 150+00
C-9
C-10 199+81

PROPOSED WATER TREATMENT PLANT
(BY OTHERS)

PROPOSED NAVAJO GALLUP WATER SUPPLY PROJECT REACH 21

ENWP PHASE 3 WATERLINE TIE IN
(SEE SHEET C-17)

EXISTING EASTERN NAVAJO WATER PIPELINE PHASE 3

PVT.

0' 1000' 2000'
GRAPHIC SCALE

CONTACT INFORMATION:
SOUDER, MILLER & ASSOCIATES
ENGINEER: ANDREW ROBERTSON, P.E.
(505) 299-0942 Office

SURVEY DATUM
New Mexico, USA
Vertical: NAVD 88
Horizontal: NAD83 New Mexico State Plane, West Zone, US Foot

North 1957600
Lat 36°22'48"
East 2713900
Long -107°32'10"

North 1957700
Lat 36°22'49"
East 2734833
Long -107°47'39"

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
atw

CAD SYSTEM
AUTOCAD
CAD FILENAME
Cutter Reach 21 SURVEY TOPO Base.dwg

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
For Distribution
Not For Construction
Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PROJECT SITE PLAN AND DRAWING KEY INDEX

USBR-DWG-NMBR
SHEET G-3

SAN JUAN COUNTY, NEW MEXICO

North 1974400
Lat 36°25'34"
East 2734700
Long -107°48'27"

North 1974400
Lat 36°25'34"
East 2742900
Long -107°46'09"

Bureau of Land Management

REACH 22
TANK SITE NO. 2
(BY OTHERS,
SEE SHEET C-11)

BEGIN REACH 21
PI STA -0+21.4
N=1973629.68
E=2735809.41

FOUND MONUMENT
MON USGLO BC 1/4 COR
N=1973267.06
E=2734572.65

FOUND MONUMENT
MON USGLO BC SC 4-3-9-10
N=1973235.10
E=2737190.90

PROPOSED
NAVAJO GALLUP WATER SUPPLY
PROJECT REACH 21

FOUND MONUMENT
MON USGLO BC 1/4 COR
N=1970584.33
E=2737148.23

AREA OF POTENTIAL EFFECT
20' TEMP. CONSTRUCTION ESMT.
60' WATERLINE ESMT.
20' TEMP. CONSTRUCTION ESMT.

PROPOSED
WATER TREATMENT
PLANT
(BY OTHERS)

MATCHLINE
SEE SHT. G-5 (2 of 2)

FOUND MONUMENT
MON USGLO BC SC 8-9-17-16
N=1968067.70
E=2731876.91

FOUND MONUMENT
MON USGLO BC SC 9-10-16-15
N=1967934.87
E=2737105.56

FOUND MONUMENT
MON USGLO BC 1/4 COR
N=1968000.63
E=2734491.24

State of New Mexico

North 1966600
Lat 36°24'17"
East 2730700
Long -107°48'27"

North 1966600
Lat 36°24'17"
East 2736861
Long -107°47'12"

0' 400' 800'
GRAPHIC SCALE

LEGEND

W W	PROPOSED WATERLINE	Tribal Trust	CURRENT LAND STATUS (OWNER)
W	EXISTING WATERLINE		PROPOSED 60' WATERLINE EASEMENT
G	EXISTING GAS LINE		TEMPORARY CONSTRUCTION EASEMENT
X	EXISTING FENCE		DIRT ROAD
OHE	EXISTING OVERHEAD POWER LINE	6	SECTION NUMBER
OHE	PROPOSED OVERHEAD POWER LINE		SEC COR / QTR COR
	TOWNSHIP AND RANGE LINE		SMA CONTROL POINT
	SECTION LINE		EXISTING UTILITY POLE
	QUARTER SECTION LINE	℄	PROPERTY LINE

ALL SURVEY CONTROL MARKERS AND COORDINATES SHOWN ON PLANS ARE PROVIDED BY OWNER. ENGINEER MAKES NO REPRESENTATIONS AS TO THEIR ACCURACY.

CONTACT INFORMATION:
SOUDER, MILLER & ASSOCIATES
ENGINEER: ANDREW ROBERTSON, P.E.
(505) 299-0942 Office

SURVEY DATUM
New Mexico, USA
Vertical: NAVD 88
Horizontal: NAD83 New Mexico State Plane, West Zone, US Foot

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — SIGNATURE MATERIAL — TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

SURVEY CONTROL PLAN (1 OF 2)

USBR-DWG-NMBR
SHEET G-4

DATE AND TIME PLOTTED 6/19/2017
PLOTTED BY aav
CAD SYSTEM AUTOCAD
CAD FILENAME Cutter Reach 21 SURVEY TOPO Base.dwg

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO

North 1970600
Lat 36°24'56"
East 2719100
Long -107°50'49"

North 1970600
Lat 36°24'56"
East 2730300
Long -107°48'32"

R-10-W
R-9-W

12
Bureau of Land Management

7
Navajo Tribal Trust

Bureau of Land Management

8
Indian Allotment 37799

FOUND MONUMENT
MON USGLO BC SC 12-7-13-18
N=1967988.44
E=2721378.90

FOUND MONUMENT
MON USGLO BC 1/4 COR
N=1967984.35
E=2724024.62

FOUND MONUMENT
MON USGLO BC SC 7-8-18-17
N=1967979.65
E=2726639.69

FOUND MONUMENT
MON USGLO BC 1/4 COR
N=1968023.81
E=2729257.91

PROPOSED
REACH 21
TANK SITE NO. 3
(SEE SITE PLAN C-12 THRU C-16)

PROPOSED
NAVAJO GALLUP WATER SUPPLY
PROJECT REACH 21

20' TEMP. CONSTRUCTION ESMT.

60' W. TEMP. CONSTRUCTION ESMT.

20' TEMP. CONSTRUCTION ESMT.

100' PERM. PIPELINE ESMT.

180+00
190+00
170+00
160+00
150+00
140+00
130+00
120+00
110+00
100+00
90+

Indian Allotment 37799

Navajo Tribal Trust

FOUND MONUMENT
MON USGLO BC 1/4 COR
N=1966880.26
E=2726644.22

MATCHLINE
SEE SHT. G-4 (1 of 2)

END REACH 21
PI STA 199+76.3
N=1965860.71
E=2721436.67

ENWP PHASE 3
WATERLINE TIE IN
(SEE SHEET C-17)

Austin Land Development Company Inc et al

13

18

17
Bureau of Land Management

FOUND MONUMENT
FD BC 1/4 18/17 USGLO 1947
N=1965335.87
E=2726650.46

EXISTING
EASTERN NAVAJO WATER
PIPELINE PHASE 3

Bureau of Land Management

0' 400' 800'
GRAPHIC SCALE

CONTACT INFORMATION:
SOUDER, MILLER & ASSOCIATES
ENGINEER: ANDREW ROBERTSON, P.E.
(505) 299-0942 Office

ALL SURVEY CONTROL MARKERS AND COORDINATES SHOWN ON PLANS ARE PROVIDED BY OWNER. ENGINEER MAKES NO REPRESENTATIONS AS TO THEIR ACCURACY.

SURVEY DATUM
New Mexico, USA
Vertical: NAVD 88
Horizontal: NAD83 New Mexico State Plane, West Zone, US Foot

LEGEND

PROPOSED WATERLINE	CURRENT LAND STATUS (OWNER)
EXISTING WATERLINE	PROPOSED 60' WATERLINE EASEMENT
EXISTING GAS LINE	TEMPORARY CONSTRUCTION EASEMENT
EXISTING FENCE	DIRT ROAD
EXISTING OVERHEAD POWER LINE	SECTION NUMBER
PROPOSED OVERHEAD POWER LINE	SEC COR / QTR COR
TOWNSHIP AND RANGE LINE	SMA CONTROL POINT
SECTION LINE	EXISTING UTILITY POLE
QUARTER SECTION LINE	PROPERTY LINE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21

WATER PIPELINE

Draft
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

SURVEY CONTROL PLAN (2 OF 2)

USBR-DWG-NMBR
SHEET G-5

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
dav

CAD SYSTEM
AUTOCAD
CAD FILENAME
Cutter Reach 21 SURVEY TOPO Base.dwg

North 1962900
Lat 36°23'40"
East 2719200
Long -107°50'48"

FOUND MONUMENT
FD BC 13/18/19/24 BLM 2008
N=1962722.75
E=2721369.07

North 1962900
Lat 36°23'40"
East 2732240
Long -107°49'34"

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

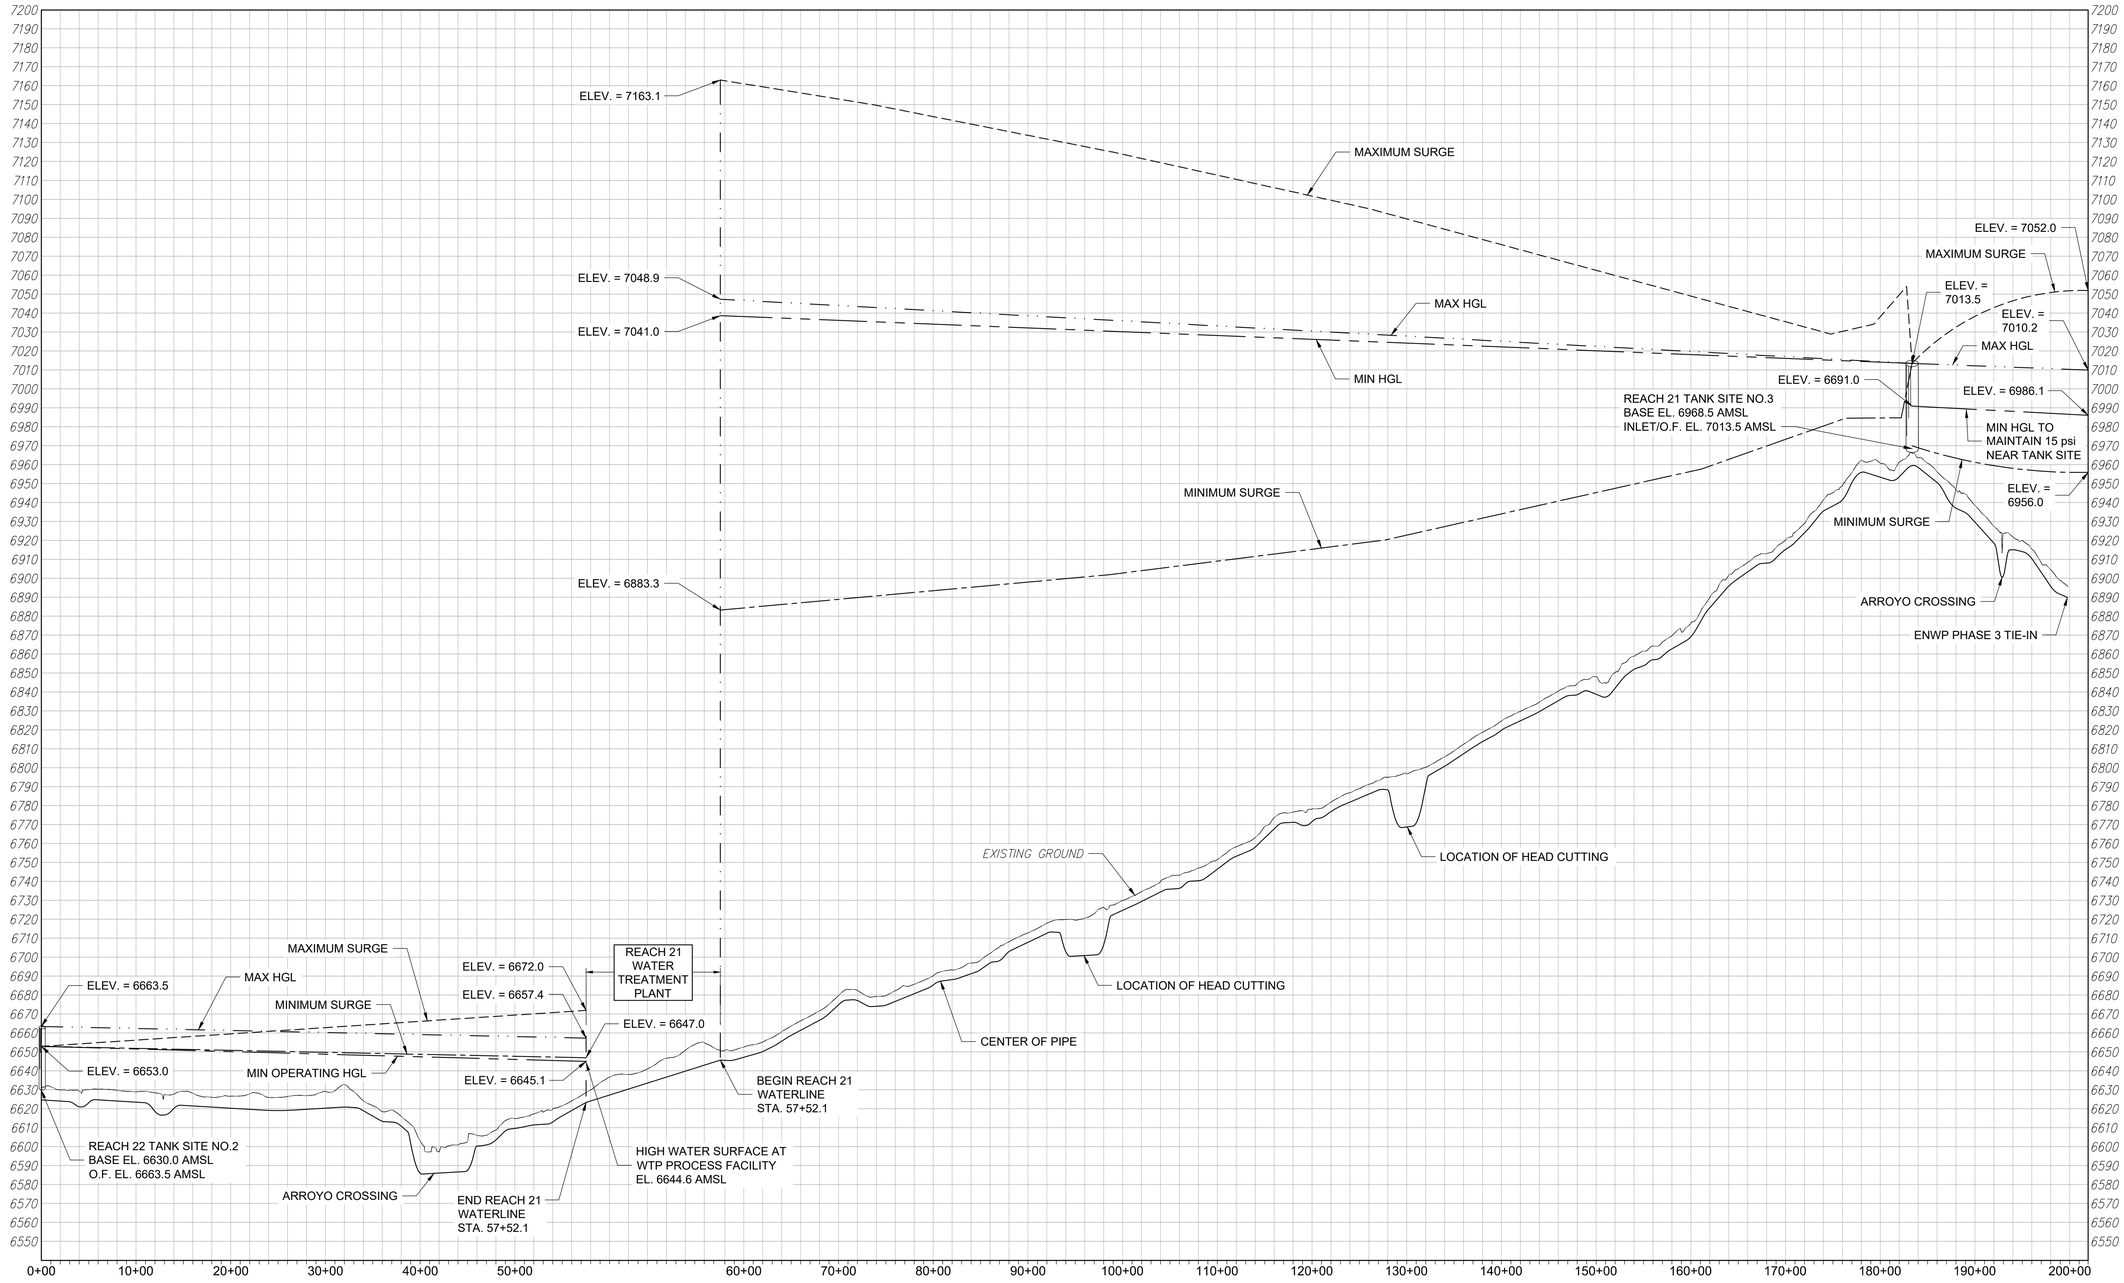

NAVAJO GALLUP WATER SUPPLY PROJECT
REACH 21 STA. -00+21 TO 199+76
PHASE 2 FLOW RATE 5.39 MGD

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Official Use Only
Information

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — BUREAU MANAGER - TITLE
FARMINGTON, NM — 2017-06-19

REACH 21 PIPELINE

HYDRAULIC PROFILE

USBR-DWG-NMBR
SHEET G-6

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atrr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Hydraulic Profile.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO

Bureau of Land Management

BEGIN NGWSP REACH 21
REACH 21 STA: -0+21.4 =
REACH 22 STA: 23093+06.5
TIE IN TO REACH 22 TANK SITE NO. 2
WITH 24" STEEL FLANGED FLANGE ADAPTOR
(SEE SHEET C-11)

STA. 2+05.5
WASH CROSSING

Sec. 4
Sec. 9

STA. 4+25.3
WASH CROSSING

STA. 5+63.3
3" VACUUM BREAKER W/ 1" ARV
ASSEMBLY (SEE SHEET D7-9)

20' TEMP. CONSTRUCTION ESMT.

STA. 12+88.2
WASH CROSSING

STA. 14+67.5
3" VACUUM BREAKER W/ 1" ARV
ASSEMBLY (SEE SHEET D7-9)

MATCHLINE STA 24+00
SEE SHT. C-2

REACH 22
TANK SITE NO. 2
(BY OTHERS)
(SEE SHT. C-11)

PI STA 3+56.6
< 0° 00' 00"
N=1973251.62
E=2735811.88

PROPOSED N.G.W.S.P. REACH 21

BEGIN NGWSP REACH 21
STA -0+21.4
N=1973629.68 (APPROX.)
E=2735809.41 (APPROX.)

60' WATERLINE ESMT.
20' TEMP. CONSTRUCTION ESMT.

AREA OF POTENTIAL EFFECT

0+00 5+00 10+00 15+00 20+00 25+00

6626 6628 6630 6632 6634 6636 6638 6640

0' 100' 200'
GRAPHIC SCALE

PLAN VIEW
24" WATERLINE

6670 6660 6650 6640 6630 6620 6610 6600 6590

EXIST. GRADE AT ALIGN. CL

−0.30% −3.67% 4.65% −0.30% −6.28% 0.30% 5.50% −0.30%

7.1' MIN. TO CL
8.1' MIN. TO CL

STA. 2+86.2 CL: 6623.9
STA. 3+46.2 CL: 6622.7
STA. 3+65.3 CL: 6622.0
STA. 4+85.3 CL: 6622.6
STA. 5+07.0 CL: 6623.6
STA. 5+67.0 CL: 6624.9
STA. 10+88.8 CL: 6623.3
STA. 11+68.8 CL: 6620.7
STA. 11+93.7 CL: 6619.1
STA. 12+23.7 CL: 6616.7
STA. 12+98.0 CL: 6616.8
STA. 13+78.0 CL: 6619.1
STA. 13+91.6 CL: 6619.8
STA. 14+67.4, CL: 6621.9
STA. 14+71.6 CL: 6621.9
STA. 23+19.1 CL: 6619.4

NOTES: 1. LOCATION OF EXISTING REACH 22 PIPING IS APPROXIMATE.
2. ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

−0+21.4 24" PVC, DR25 (2421 L.F.) 24+00

EG: 6631.1 CL: 6624.7
EG: 6631.7 CL: 6624.4
EG: 6630.0 CL: 6624.1
EG: 6629.9 CL: 6623.8
EG: 6629.3 CL: 6621.1
EG: 6630.2 CL: 6623.3
EG: 6630.4 CL: 6624.8
EG: 6630.3 CL: 6624.5
EG: 6629.8 CL: 6624.2
EG: 6629.2 CL: 6623.9
EG: 6629.0 CL: 6623.6
EG: 6629.3 CL: 6623.2
EG: 6628.5 CL: 6618.7
EG: 6627.7 CL: 6616.8
EG: 6627.9 CL: 6620.3
EG: 6629.3 CL: 6621.8
EG: 6628.2 CL: 6621.5
EG: 6626.4 CL: 6621.3
EG: 6626.1 CL: 6621.0
EG: 6626.5 CL: 6620.7
EG: 6626.7 CL: 6620.4
EG: 6626.8 CL: 6620.1
EG: 6628.0 CL: 6619.8
EG: 6628.1 CL: 6619.5
EG: 6626.0 CL: 6619.2

0+00 1+00 2+00 3+00 4+00 5+00 6+00 7+00 8+00 9+00 10+00 11+00 12+00 13+00 14+00 15+00 16+00 17+00 18+00 19+00 20+00 21+00 22+00 23+00 24+00

PROFILE VIEW 24" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE STA -0+21.4 To 24+00

USBR-DWG-NMBR

SHEET C-1

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
arv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnP's.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO

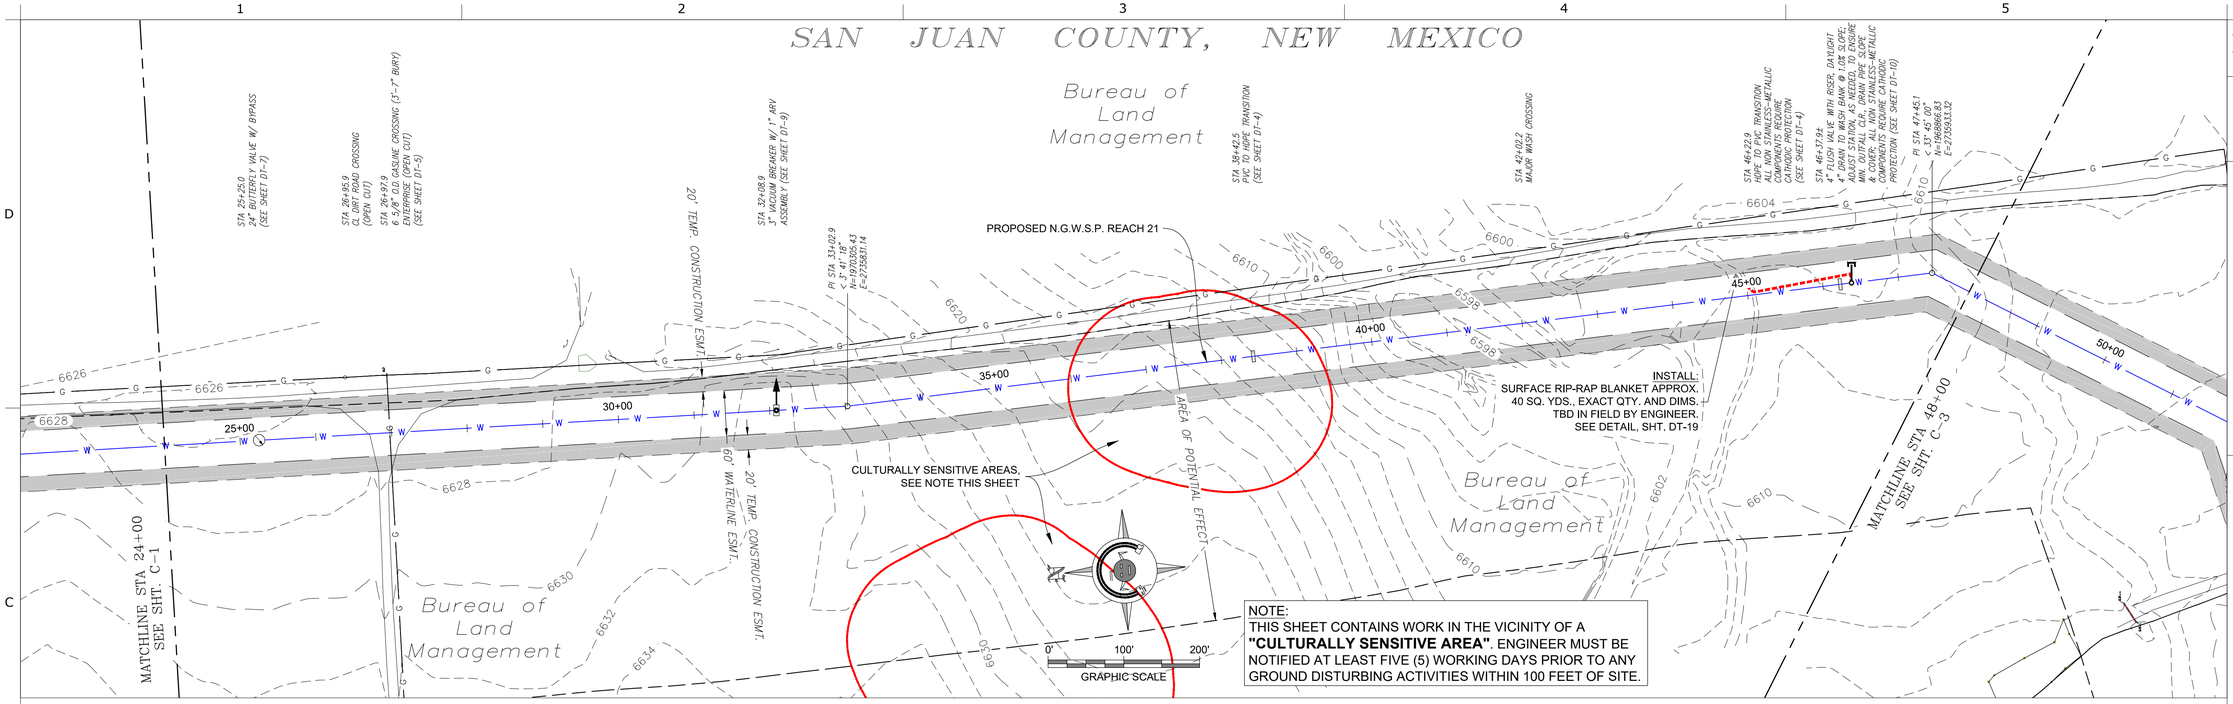

NOTE:
THIS SHEET CONTAINS WORK IN THE VICINITY OF A **"CULTURALLY SENSITIVE AREA"**. ENGINEER MUST BE NOTIFIED AT LEAST FIVE (5) WORKING DAYS PRIOR TO ANY GROUND DISTURBING ACTIVITIES WITHIN 100 FEET OF SITE.

PLAN VIEW
24" WATERLINE

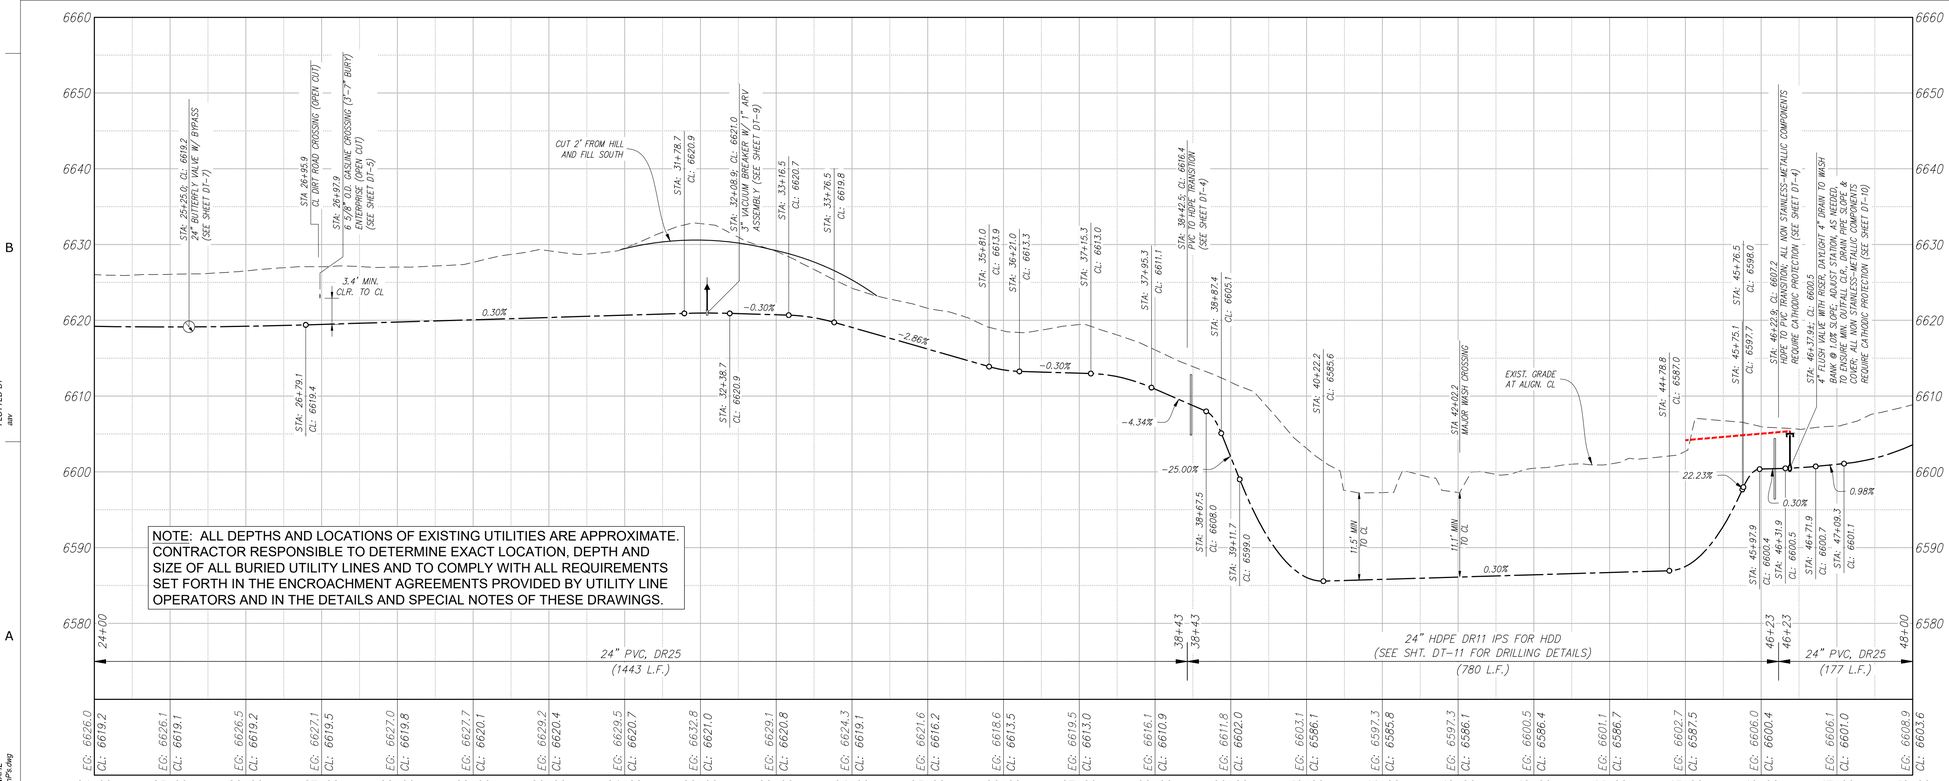

PROFILE VIEW 24" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental
Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
REGION DIRECTOR - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE
STA 24+00 To 48+00

USBR-DWG-NMBR
SHEET C-2

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
arv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnP's.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

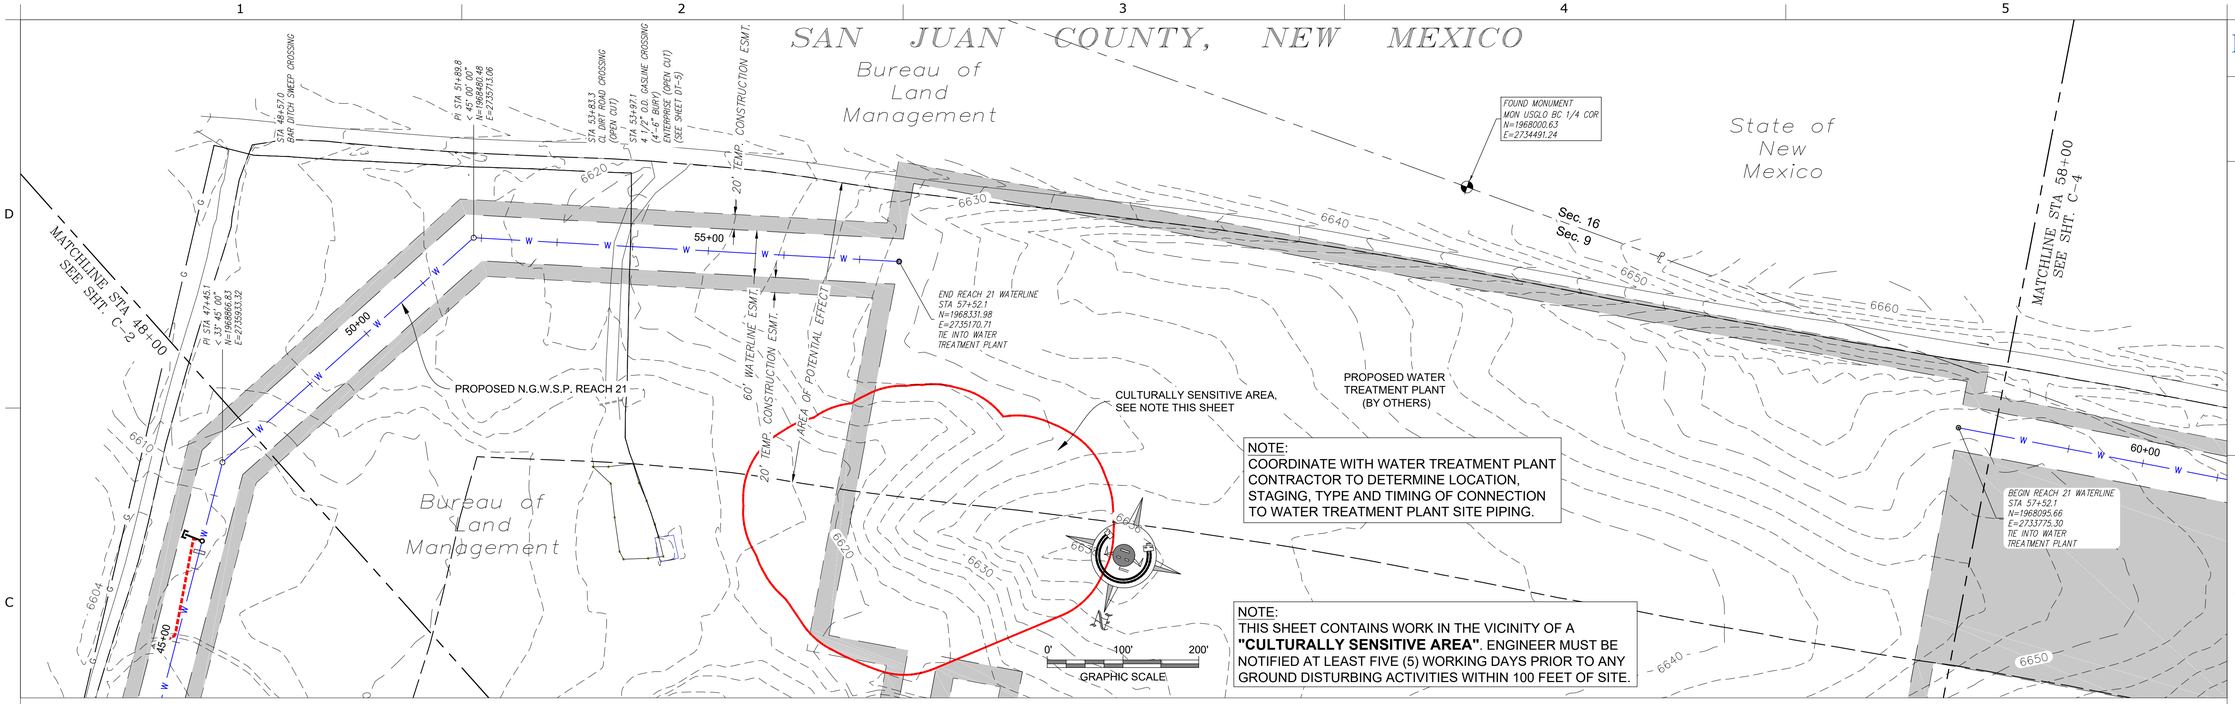

NOTE:
COORDINATE WITH WATER TREATMENT PLANT CONTRACTOR TO DETERMINE LOCATION, STAGING, TYPE AND TIMING OF CONNECTION TO WATER TREATMENT PLANT SITE PIPING.

NOTE:
THIS SHEET CONTAINS WORK IN THE VICINITY OF A **"CULTURALLY SENSITIVE AREA"**. ENGINEER MUST BE NOTIFIED AT LEAST FIVE (5) WORKING DAYS PRIOR TO ANY GROUND DISTURBING ACTIVITIES WITHIN 100 FEET OF SITE.

PLAN VIEW
24" & 20" WATERLINE

NOTE: ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

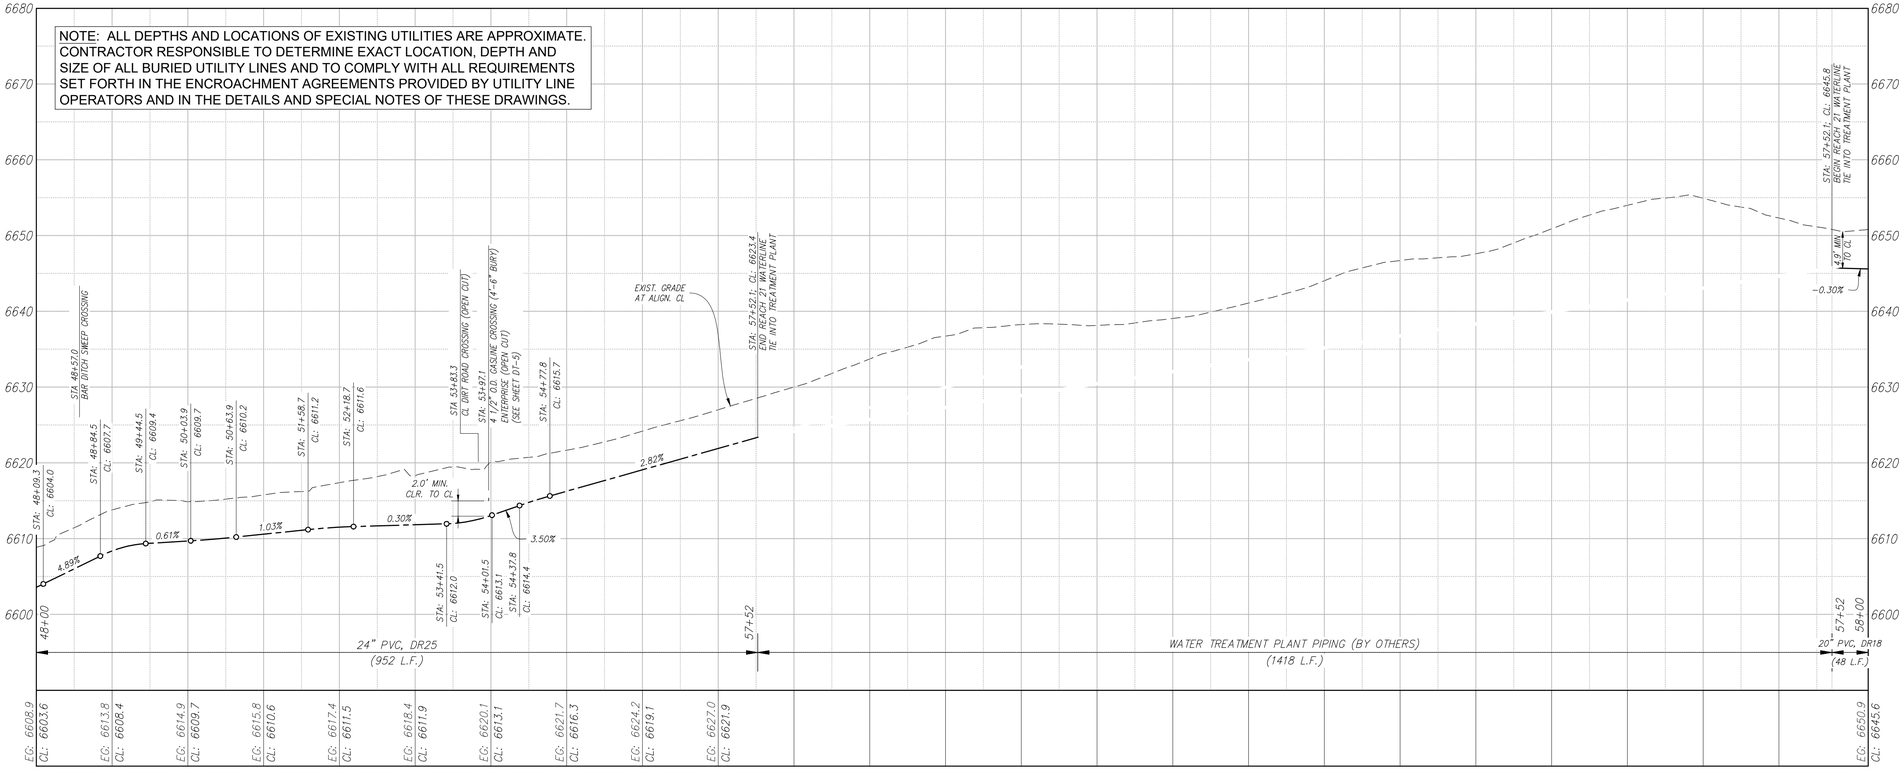

PROFILE VIEW 24" & 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

DATE AND TIME PLOTTED 6/18/17
PLOTTED BY aw
CAD SYSTEM AUTOCAD
CAD FILENAME Reach 21 PnP's.dwg

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE (ORIGINAL) - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE
STA 48+00 To 58+00

USBR-DWG-NMBR
SHEET C-3

Alternate Use Only
Draft
Not For Distribution

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO

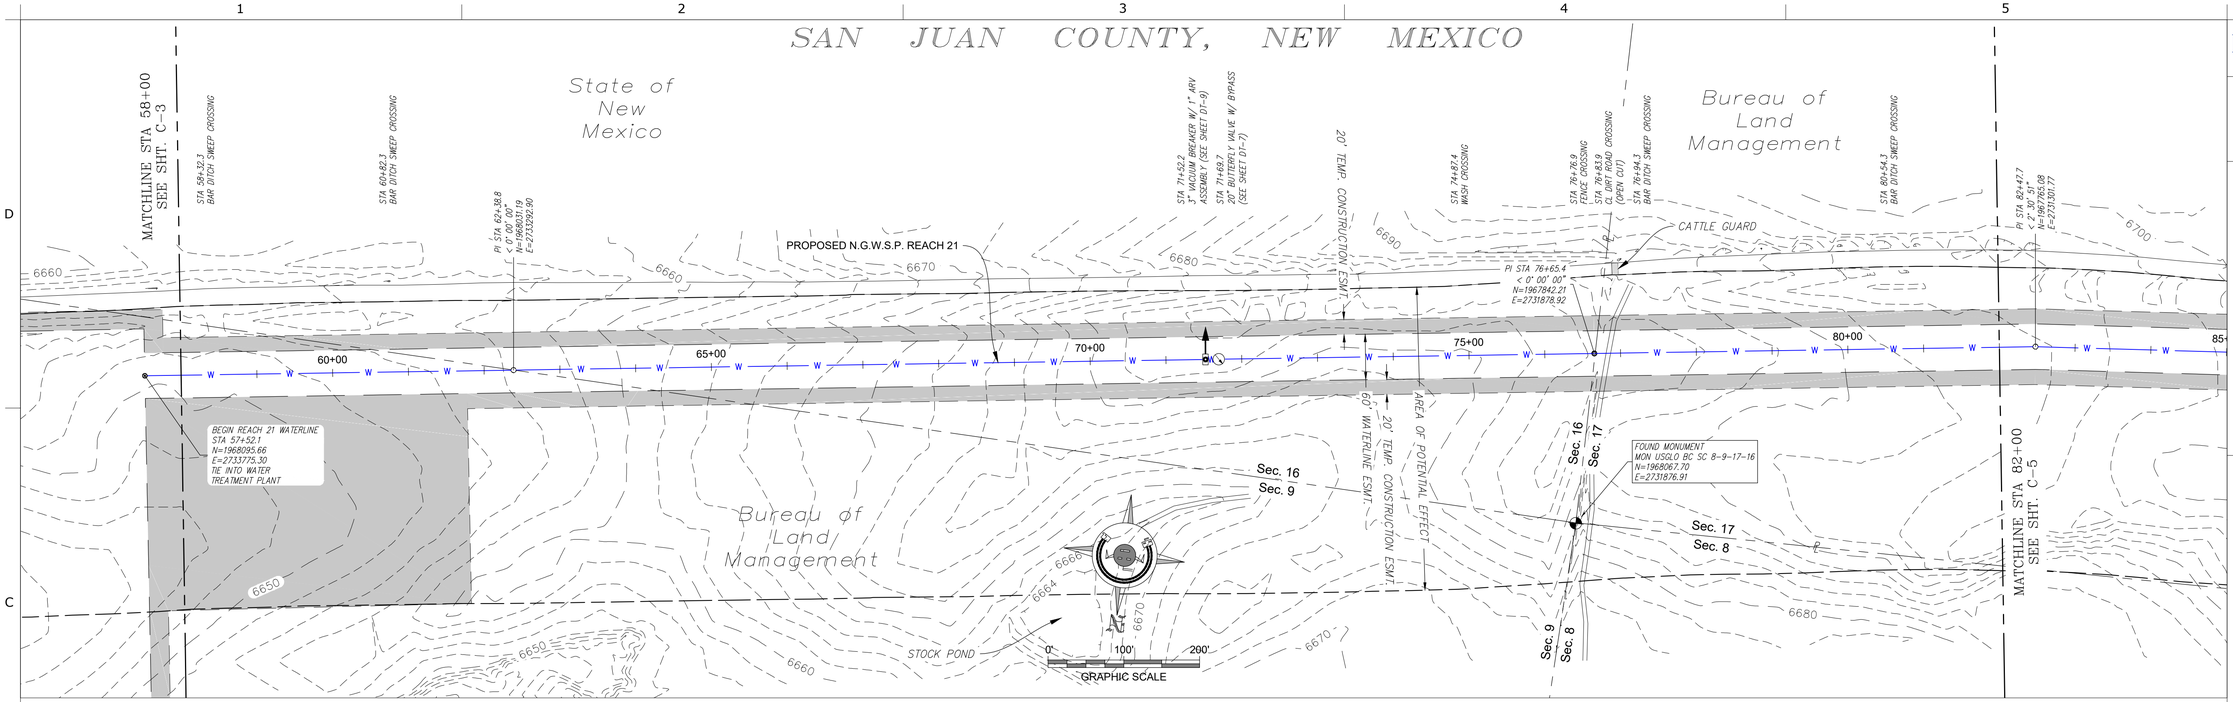

PLAN VIEW
20" WATERLINE

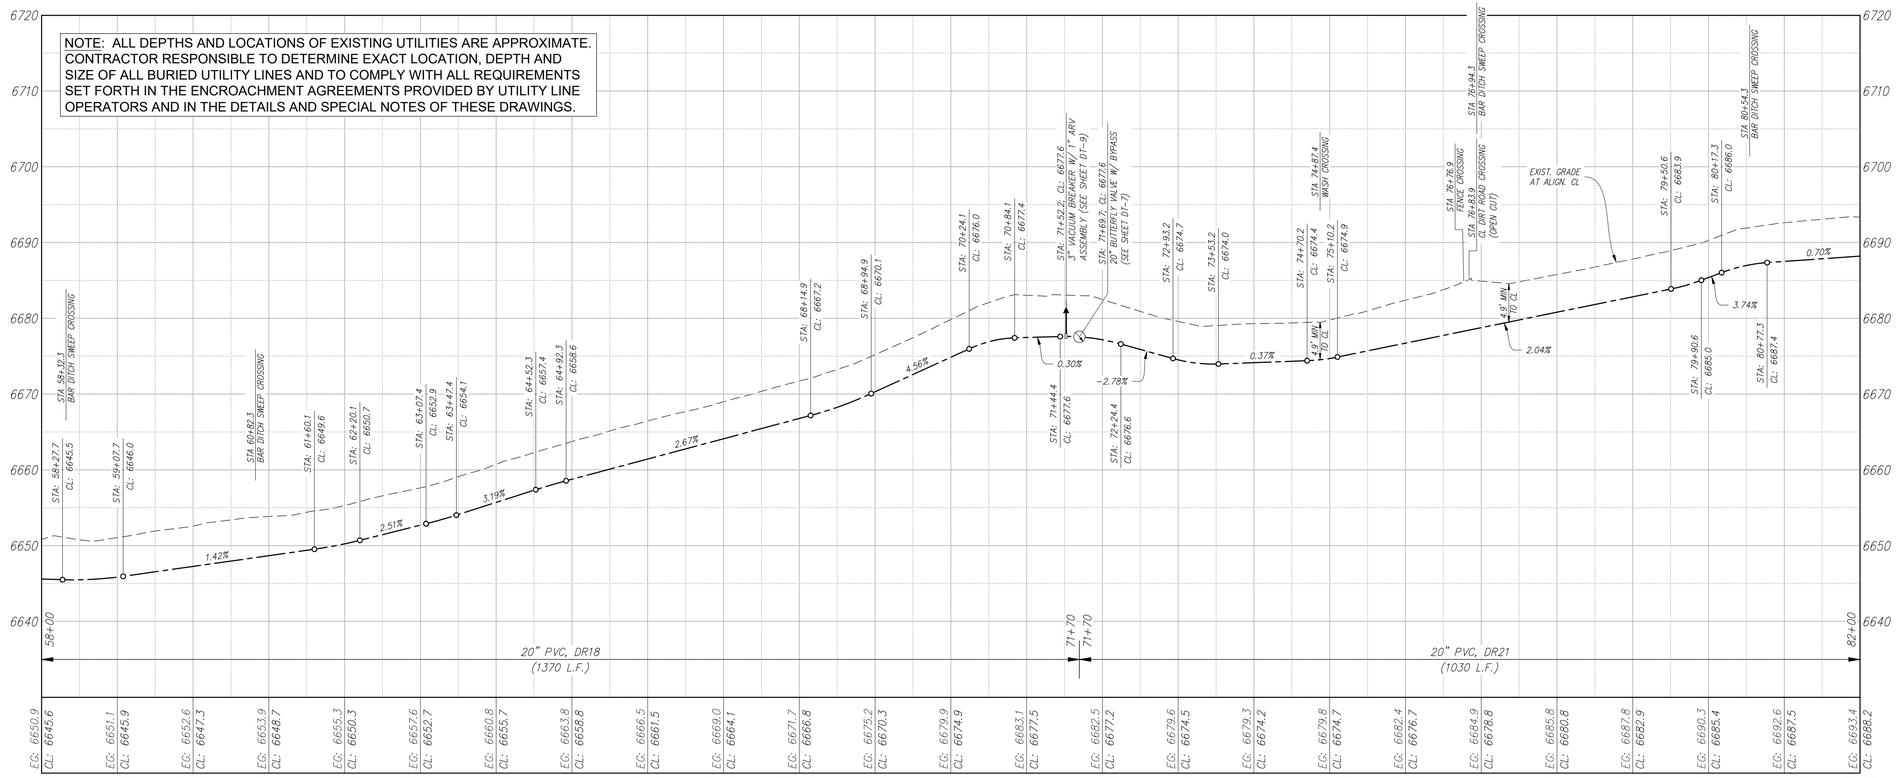

PROFILE VIEW 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
For Distribution

Preliminary
Not For Construction

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE
STA 58+00 To 82+00

USBR-DWG-NMBR
SHEET C-4

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atvr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnPs.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO

Bureau of Land Management

PROPOSED N.G.W.S.P. REACH 21

MATCHLINE STA 82+00
SEE SHT. C-4

MATCHLINE STA 106+00
SEE SHT. C-6

INSTALL:
ROCK CHECK DAMS, STA 95+37,
SPACING AND DIMS. TBD IN
FIELD BY ENGINEER.
(SEE DETAIL DT-20)

20' TEMP. CONSTRUCTION ESMT.

AREA OF POTENTIAL EFFECT

60' WATERLINE ESMT.

20' TEMP. CONSTRUCTION ESMT.

FOUND MONUMENT
MON USGLO BC 1/4 COR
N=1960123.81
E=2729257.91

Sec. 17
Sec. 8

0' 100' 200'
GRAPHIC SCALE

PLAN VIEW
20" WATERLINE

NOTE: ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

EXIST. GRADE AT ALIGN. CL

20" PVC, DR21
(1105 L.F.)

20" HDPE DR11 IPS FOR HDD
(SEE SHT. DT-12 FOR DRILLING DETAILS)
(599 L.F.)

20" PVC, DR25
(696 L.F.)

PROFILE VIEW 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution

Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SUPERINTENDENT - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE STA
82+00 To 106+00

USBR-DWG-NMBR
SHEET C-5

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnPs.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

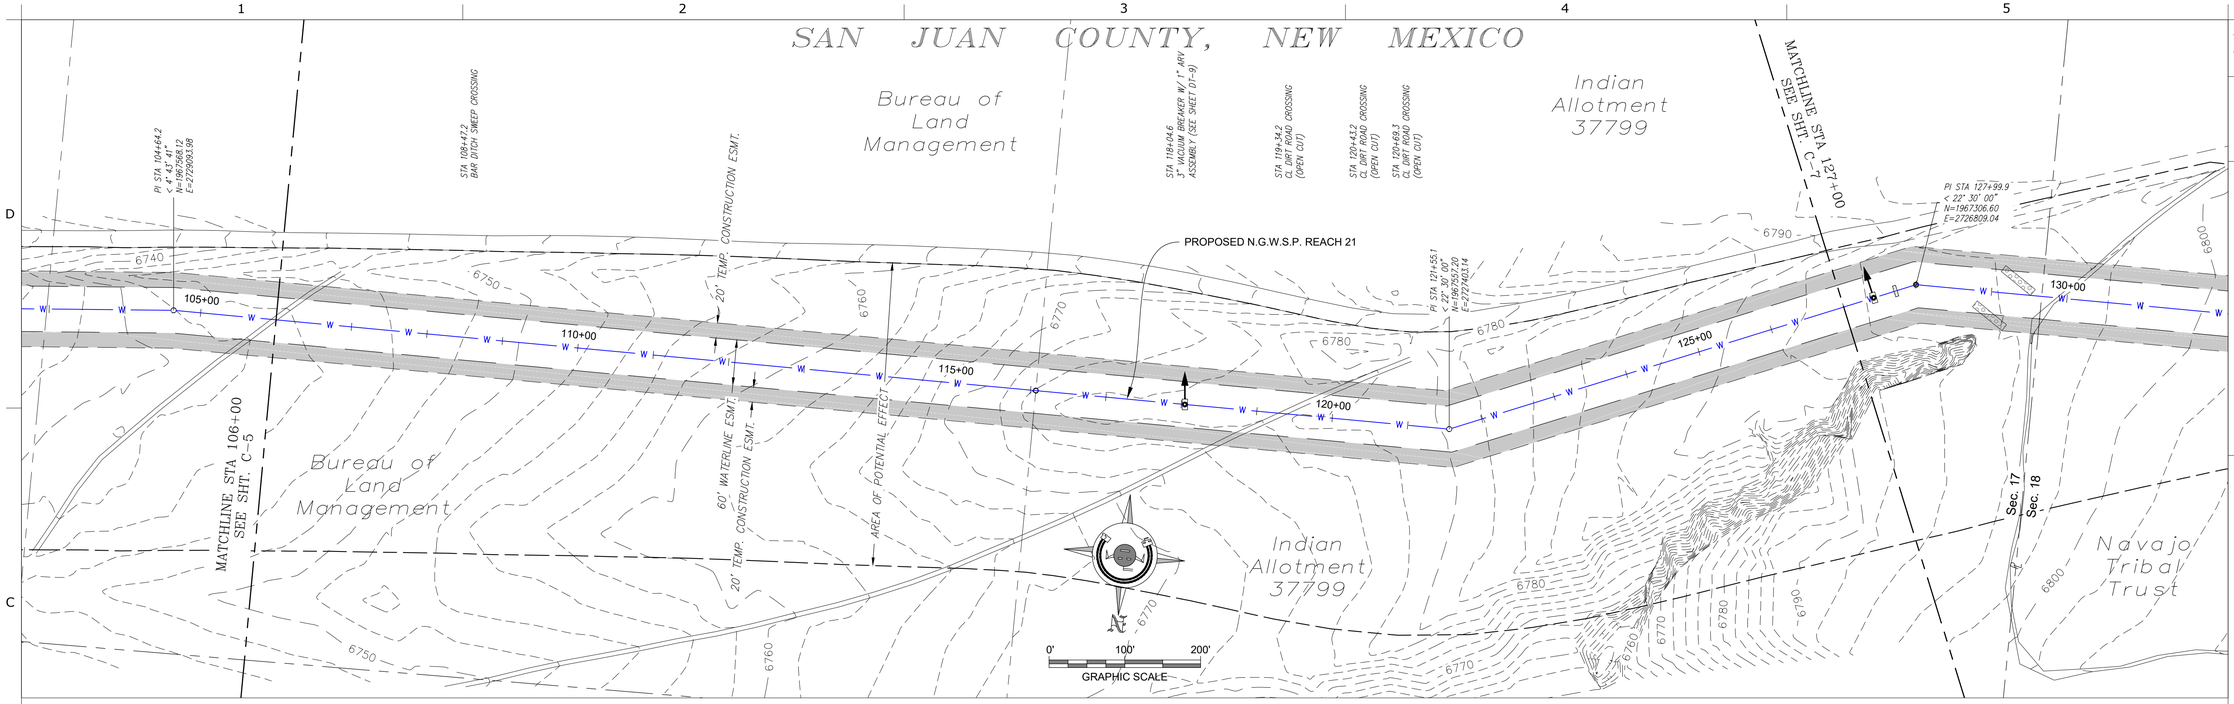

PLAN VIEW
20" WATERLINE

NOTE: ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

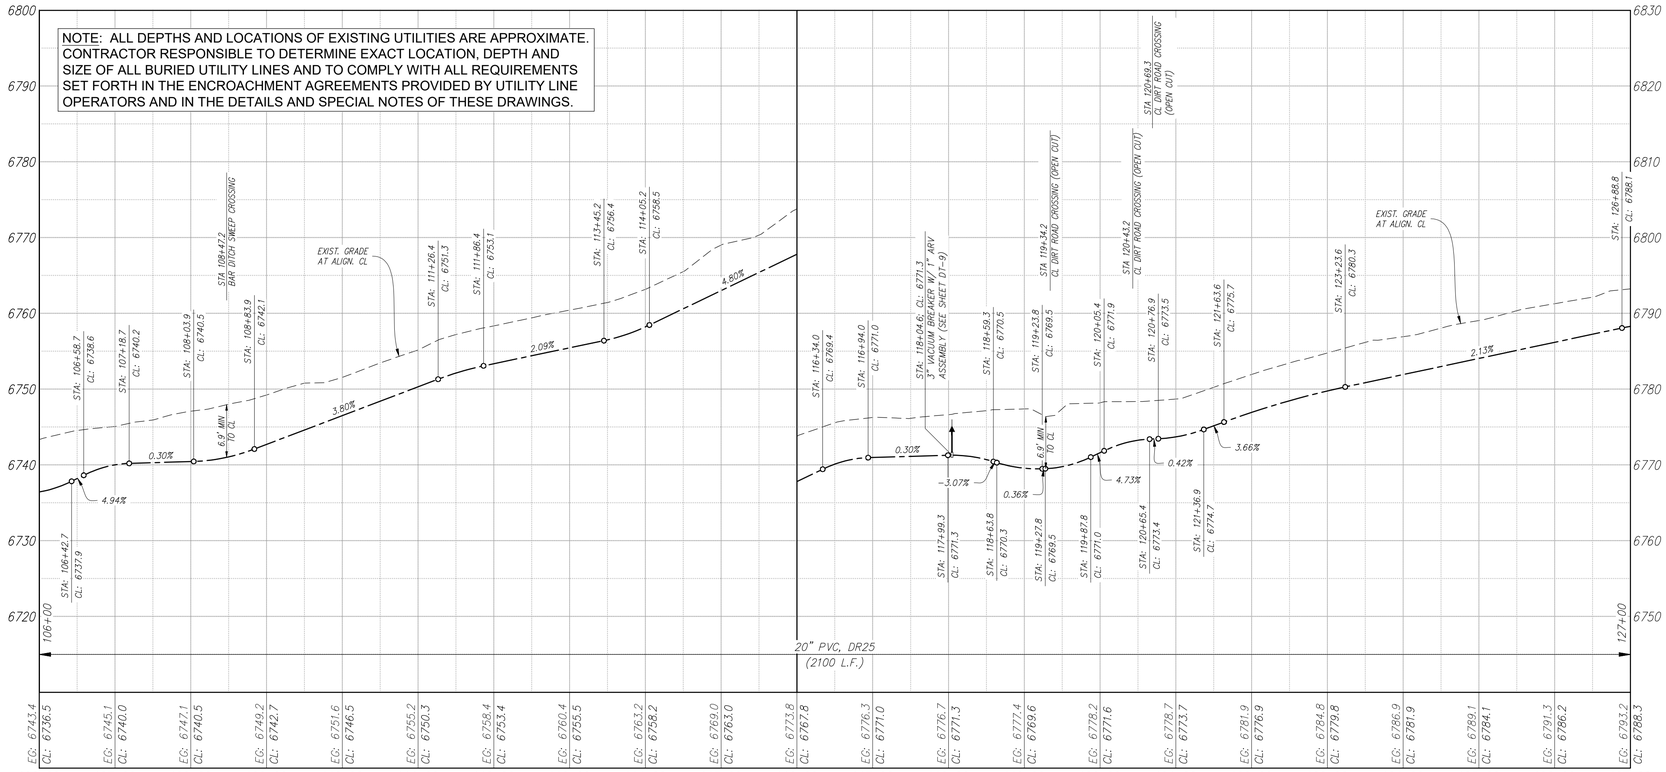



PROFILE VIEW 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21 WATER PIPELINE

Draft
Not For Distribution

For Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE APPROVAL TITLE

FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE STA 106+00 To 127+00

USBR-DWG-NMBR

SHEET C-6

DATE AND TIME PLOTTED 6/19/17
PLOTTED BY atw

CAD SYSTEM AUTOCAD
CAD FILENAME Reach 21 PnPs.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO

Indian Allotment 37799

Navajo Tribal Trust

STA 127+41.4
3" VACUUM BREAKER W/ 1" ARV ASSEMBLY (SEE SHEET DT-9)

STA 127+71.7
PVC TO HDPE TRANSITION (SEE SHEET DT-4)

STA 129+92.2
HEAD CUTTING

STA 132+57.9
HDPE TO PVC TRANSITION (SEE SHEET DT-4)

20' TEMP. CONSTRUCTION ESMT.

PROPOSED N.G.W.S.P. REACH 21

PI STA 127+99.9
< 22° 30' 00"
N=1967306.60
E=2726809.04

STA 146+02.7
CL DIRT ROAD CROSSING (OPEN CUT)

STA 146+64.3
CL DIRT ROAD CROSSING (OPEN CUT)

PI STA 147+46.4
< 3° 23' 37"
N=1967294.03
E=2726662.61

STA 147+74.3
4 1/2" O.D. GASLINE CROSSING (2"-4" BORY) ENTERPRISE (OPEN CUT) (SEE SHEET DT-5)

STA 148+92.5
3" VACUUM BREAKER W/ 1" ARV ASSEMBLY (SEE SHEET DT-9)

STA 149+10.0
20" BUTTERFLY VALVE W/ BYPASS (SEE SHEET DT-7)

STA 150+66.4
WASH CROSSING

PI STA 153+31.3
< 44° 16' 47"
N=1967255.63
E=2726427.91

INSTALL:
ROCK CHECK DAMS, STA 129+92, SPACING AND DIMS. TBD IN FIELD BY ENGINEER.
(SEE DETAIL DT-20)

MATCHLINE STA 127+00
SEE SHT. C-6

MATCHLINE STA 151+00
SEE SHT. C-9

Sec. 17 | Sec. 18

AREA OF POTENTIAL EFFECT

60' WATERLINE ESMT.

20' TEMP. CONSTRUCTION ESMT.

CULTURALLY SENSITIVE AREA, SEE NOTE THIS SHEET

NOTE:
THIS SHEET CONTAINS WORK IN THE VICINITY OF A **"CULTURALLY SENSITIVE AREA"**. ENGINEER MUST BE NOTIFIED AT LEAST FIVE (5) WORKING DAYS PRIOR TO ANY GROUND DISTURBING ACTIVITIES WITHIN 100 FEET OF SITE.

GRAPHIC SCALE
0' 100' 200'

PLAN VIEW
20" WATERLINE

NOTE: ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

EXIST. GRADE AT ALIGN. CL

20" PVC, DR25 (72 L.F.)

20" HDPE DR11 IPS FOR HDD (SEE SHT. DT-13 FOR DRILLING DETAILS) (486 L.F.)

20" PVC, DR25 (1842 L.F.)

PROFILE VIEW 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution

Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SUPERVISORY TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE STA 127+00 To 151+00

USBR-DWG-NMBR

SHEET C-7

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnPs.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO

Navajo Tribal Trust

PROPOSED N.G.W.S.P. REACH 21

PI STA 147+46.4
< 3° 23' 37"
N=1967294.03
E=2724862.61

STA 151+67.1
OVERHEAD ELECTRIC CROSSING

STA 152+30.1
WASH CROSSING

PI STA 153+31.3
< 13° 45' 00"
N=1967045.63
E=2724278.91

STA 156+41.2
WASH CROSSING

PI STA 156+75.7
< 13° 45' 00"
N=1967045.90
E=2724005.12

STA 158+21.9
OVERHEAD ELECTRIC CROSSING

20' TEMP. CONST. ESMT.

STA 159+01.2
CL CR 7574 DIRT ROAD
CROSSING (OPEN CUT)

STA 159+46.3
CL DIRT ROAD CROSSING
(OPEN CUT)

STA 169+54.2
14" OD CASLINE CROSSING
(2'-8" BURY)
ENTERPRISE (OPEN CUT)
(SEE SHEET DT-5)

STA 168+67.7
(2x) 1/2" DIA. UNDERGROUND
ELECTRIC CROSSING (2'-0" BURY)
(CONOCO PHILLIPS)

STA 168+67.7
CL DIRT ROAD CROSSING
(OPEN CUT)

PI STA 172+67.5
< 23° 30' 00"
N=1966944.44
E=2723417.35

150+00 155+00 160+00 165+00 170+00 175+00

STA: 158+87 TO STA: 159+27
40' ROAD CROSSING (OPEN CUT)
36" Ø, 0.25" WALL STEEL CASING
ALL NON STAINLESS-METTALIC
COMPONENTS REQUIRE
CATHODIC PROTECTION
(SEE SHEET DT-6)

60' WATERLINE ESMT.

80' WATERLINE ESMT.

AREA OF POTENTIAL EFFECT

CULTURALLY SENSITIVE AREA, SEE NOTE THIS SHEET

CULTURALLY SENSITIVE AREAS, SEE NOTE THIS SHEET

MATCHLINE STA 151+00 SEE SHT. C-7

MATCHLINE STA 173+00 SEE SHT. C-9

0' 100' 200'
GRAPHIC SCALE

NOTE:
THIS SHEET CONTAINS WORK IN THE VICINITY OF A **"CULTURALLY SENSITIVE AREA"**. ENGINEER MUST BE NOTIFIED AT LEAST FIVE (5) WORKING DAYS PRIOR TO ANY GROUND DISTURBING ACTIVITIES WITHIN 100 FEET OF SITE.

PLAN VIEW
20" WATERLINE

NOTE: ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

STA: 151+62.4 CL: 6839.7
STA 152+30.1 WASH CROSSING
STA: 152+81.5 CL: 6847.2
STA: 153+21.5 CL: 6849.2
STA: 153+82.0 CL: 6851.4
STA: 154+22.0 CL: 6852.6
STA: 155+03.4 CL: 6854.0
STA: 155+43.4 CL: 6855.4
STA: 155+47.5 CL: 6855.6
STA: 156+07.5 CL: 6857.1
STA: 156+31.0 CL: 6857.2
STA: 156+47.2 WASH CROSSING
STA: 156+91.0 CL: 6858.6
STA: 157+29.7 CL: 6860.3
STA: 157+89.7 CL: 6862.5
EXIST. GRADE AT ALIGN. CL
STA 159+01.2 CL CR 7574 DIRT ROAD CROSSING (OPEN CUT)
STA: 159+53.9 CL: 6867.3
STA 160+46.3 CL DIRT ROAD CROSSING (OPEN CUT)
STA: 160+53.9 CL: 6873.1
STA: 161+40.1 CL: 6880.5
STA: 161+80.1 CL: 6883.4
STA: 163+64.6 CL: 6894.1
STA: 164+64.6 CL: 6898.7
STA: 167+01.0 CL: 6907.1
STA: 167+41.0 CL: 6907.9
STA: 168+54.2 14" OD CASLINE CROSSING (2'-8" BURY) ENTERPRISE (OPEN CUT) (SEE SHEET DT-5)
STA: 168+67.7 CL DIRT ROAD CROSSING (OPEN CUT)
STA: 168+67.7 (2x) 1/2" DIA. UNDERGROUND ELECTRIC CROSSING (2'-0" BURY) (CONOCO PHILLIPS)
STA: 169+97.1 CL: 6915.2
STA: 170+53.2 CL: 6917.1
STA: 170+93.2 CL: 6918.7
STA: 172+06.5 CL: 6924.4
STA: 172+86.5 CL: 6929.0
4.0' MIN. CLR. TO CASING
6.0' MIN. TO CL
2.0' MIN. CLR. TO CL
6.28% 3.74% 1.80% 4.95% 0.30% 4.43% 2.89% 8.66% 5.71% 0.46% 3.53% 4.97% 1.35% 5.03%
158+87 159+27
36"ø, 0.25" WALL STEEL CASING
ALL NON STAINLESS-METTALIC COMPONENTS
REQUIRE CATHODIC PROTECTION
(SEE SHEET DT-6)
(40 L.F.)
STA: 168+19.7 CL: 6908.2
STA: 168+79.7 CL: 6909.8
STA: 169+37.1 CL: 6912.7
151+00
20" PVC, DR25
(2200 L.F.)
173+00

EG: 6844.7 CL: 6837.4 | EG: 6850.4 CL: 6842.1 | EG: 6855.5 CL: 6848.2 | EG: 6859.0 CL: 6852.0 | EG: 6861.6 CL: 6854.0 | EG: 6864.3 CL: 6857.1 | EG: 6866.5 CL: 6859.0 | EG: 6869.8 CL: 6862.8 | EG: 6871.8 CL: 6865.7 | EG: 6876.4 CL: 6869.2 | EG: 6882.3 CL: 6877.0 | EG: 6890.1 CL: 6884.6 | EG: 6896.7 CL: 6890.3 | EG: 6901.7 CL: 6896.0 | EG: 6905.1 CL: 6900.0 | EG: 6908.6 CL: 6903.5 | EG: 6912.1 CL: 6907.0 | EG: 6913.1 CL: 6908.1 | EG: 6916.4 CL: 6910.9 | EG: 6920.3 CL: 6915.3 | EG: 6924.4 CL: 6919.1 | EG: 6929.1 CL: 6924.1 | EG: 6935.4 CL: 6929.8

151+00 152+00 153+00 154+00 155+00 156+00 157+00 158+00 159+00 160+00 161+00 162+00 163+00 164+00 165+00 166+00 167+00 168+00 169+00 170+00 171+00 172+00 173+00

PROFILE VIEW 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

NAVAJO-GALLUP WATER SUPPLY PROJECT
U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Preliminary Draft Not For Construction
For Information Only
For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE STA 151+00 To 173+00

USBR-DWG-NMBR

SHEET C-8

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnPs.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

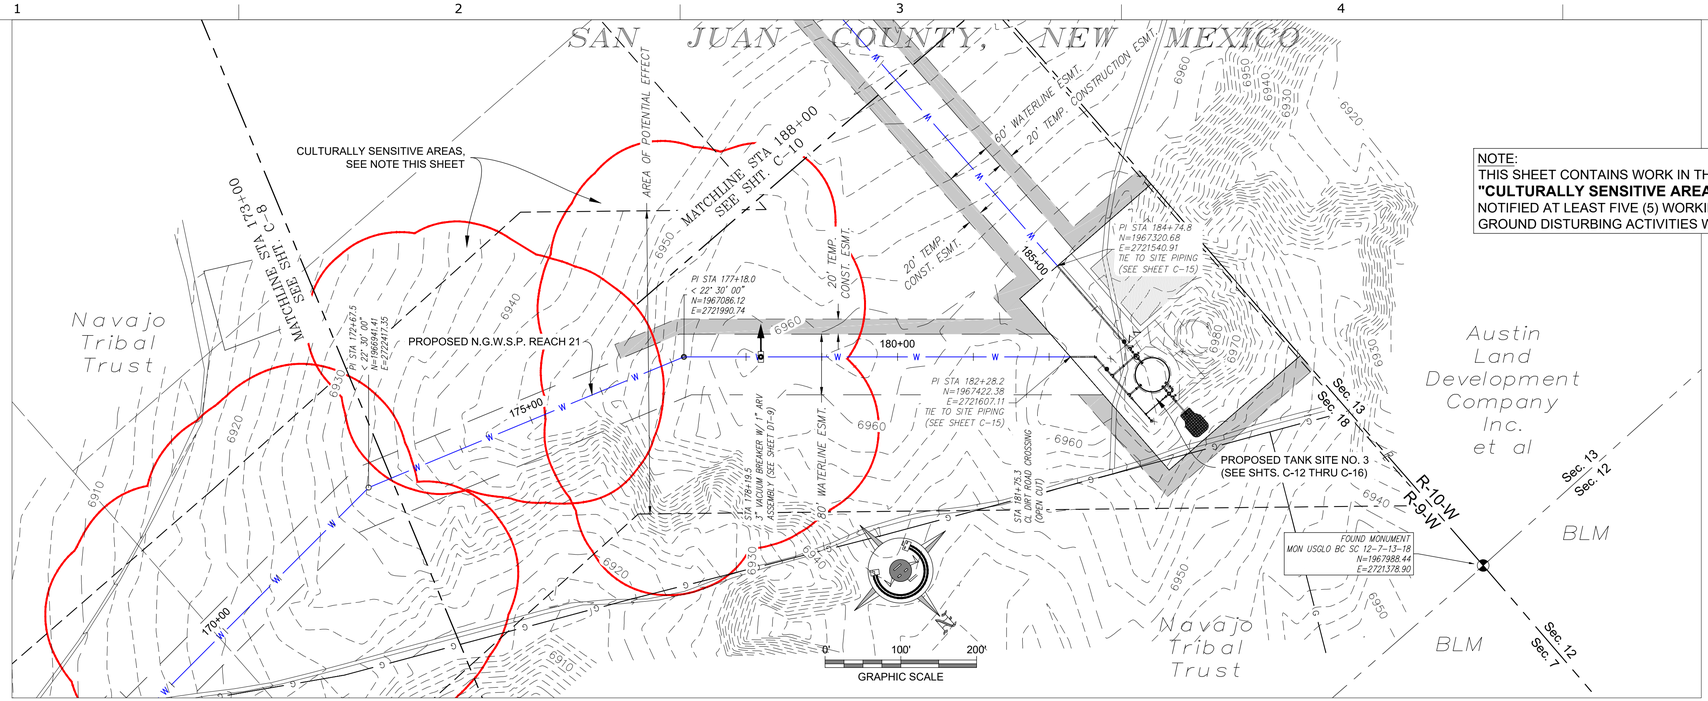

NOTE:
THIS SHEET CONTAINS WORK IN THE VICINITY OF A **"CULTURALLY SENSITIVE AREA"**. ENGINEER MUST BE NOTIFIED AT LEAST FIVE (5) WORKING DAYS PRIOR TO ANY GROUND DISTURBING ACTIVITIES WITHIN 100 FEET OF SITE.

PLAN VIEW
20" WATERLINE

NOTE: ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

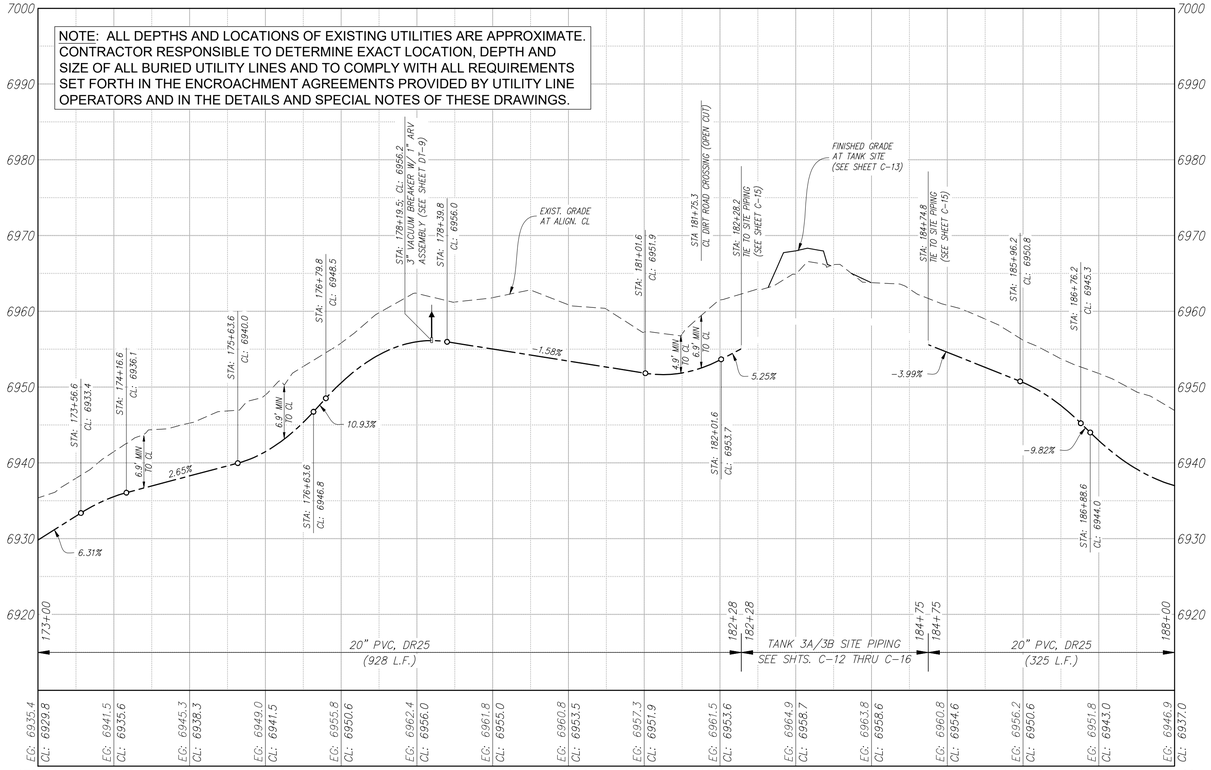

PROFILE VIEW 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Not For Distribution
Draft
Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SUPV'S INITIAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE STA 173+00 To 188+00

USBR-DWG-NMBR

SHEET C-9

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
arv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnP's.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

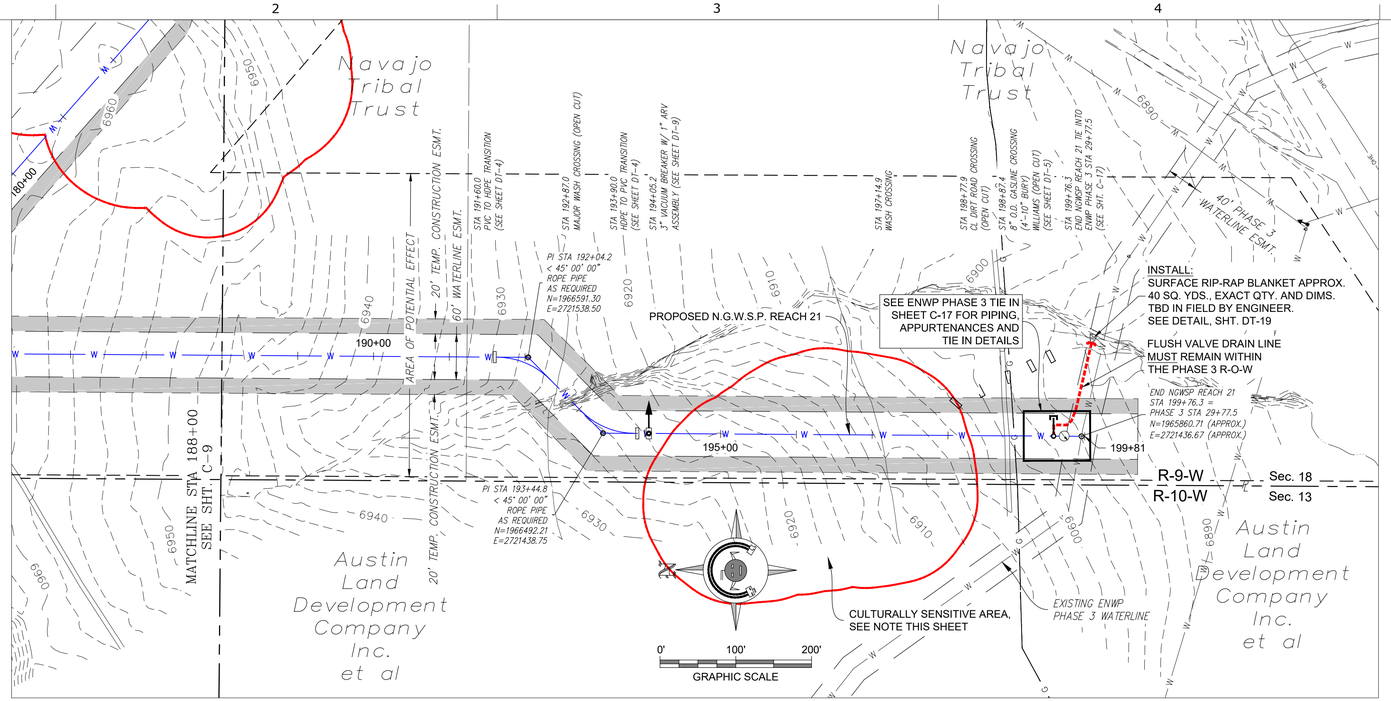

PLAN VIEW
20" WATERLINE

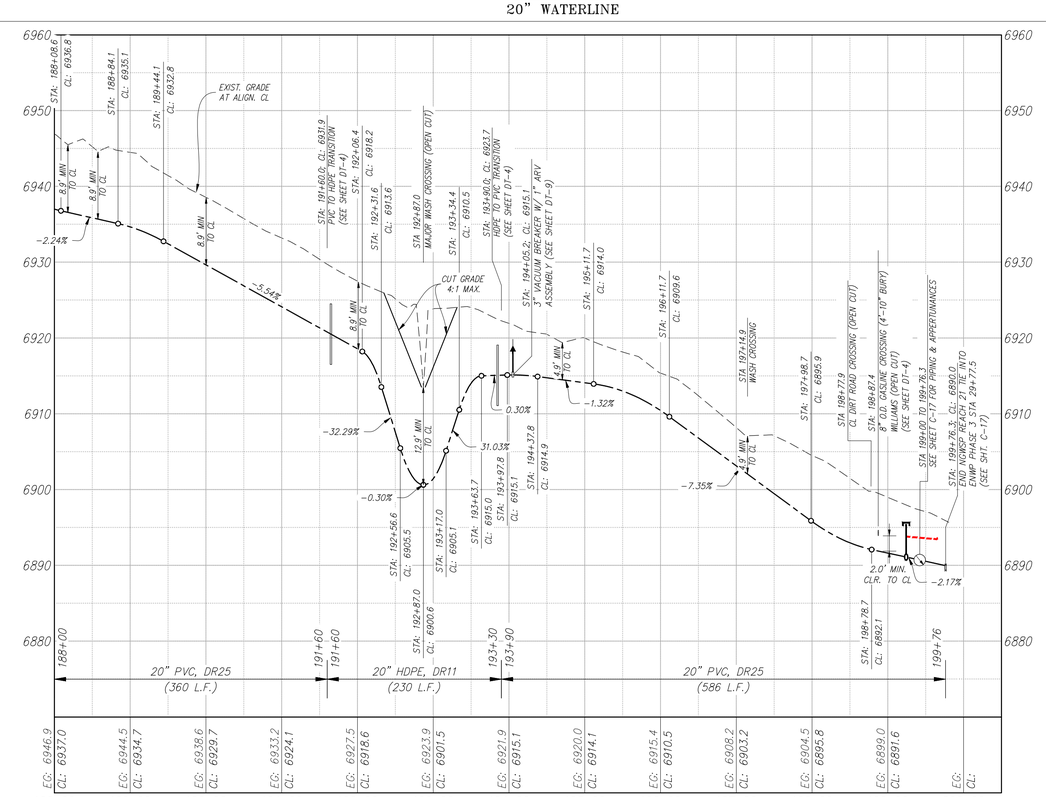

PROFILE VIEW 20" WATERLINE
SCALE: HORIZ. 1" = 100' ; VERT. 1" = 10'

NOTE:
THIS SHEET CONTAINS WORK IN THE VICINITY OF A **"CULTURALLY SENSITIVE AREA"**. ENGINEER MUST BE NOTIFIED AT LEAST FIVE (5) WORKING DAYS PRIOR TO ANY GROUND DISTURBING ACTIVITIES WITHIN 100 FEET OF SITE.

NOTES: 1. LOCATION OF EXISTING ENWP PHASE 3 PIPING IS APPROXIMATE.
2. ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21 WATER PIPELINE

Draft
Not For Distribution
Intended Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SUPERVISORY TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PLAN & PROFILE STA 188+00 To 199+76.3

USBR-DWG-NMBR
SHEET C-10

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 PnPs.dwg

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO
SEC-4, T-25-N, R-9-W
BUREAU OF LAND MANAGEMENT

Bureau Of Land Management

N.G.W.S.P. REACH 22
TANK SITE NO.2
(BY OTHERS)

FLOW

NOTES: 1. LOCATION OF EXISTING REACH 22 PIPING IS APPROXIMATE.
2. ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

BEGIN N.G.W.S.P. REACH 21 WATERLINE, TIE INTO REACH 22 PIPING WITH 24" RESTRAINED FLANGE ADAPTOR. ALL NON STAINLESS-METALLIC COMPONENTS REQUIRE CATHODIC PROTECTION.
STATION EQUATION
REACH 21 STA: -0+21.4 =
REACH 22 STA: 23093+06.5
N=1973629.68 (APPROX.)
E=2735809.41 (APPROX.)

23093+00

0+00

FLOW

20' TEMP. CONST. ESMT.

60' WATERLINE EASEMENT

20' TEMP. CONST. ESMT.

PROPOSED N.G.W.S.P. REACH 21 WATERLINE - 24" PVC DR25

6634 6635 6633 6632 6631 6630 6629 6628

N

0' 10' 20'

GRAPHIC SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

VAVA - GALLUP WATER SUPPLY PROJECT
U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NEW MEXICO

CUTTER LATERAL - REACH 21 WATER PIPELINE

Draft
For Internal Use Only
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED
SUPV. ARCHEAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

REACH 22 TANK
SITE NO. 2 TIE IN

USBR-DWG-NMBR
SHEET C-11

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
ahr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Tank Site Plan.dwg

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO
SEC-18, T-25-N, R-9-W
NAVAJO TRIBAL TRUST

Navajo Tribal Trust

CORNER OF ESMT.
N=1967621.17
E=2721377.71

CORNER OF ESMT.
N=1967620.48
E=2721607.71

LIMITS OF SITE EASEMENT

WIRE CAGED RIP-RAP BLANKET, 12" THICK, APPROX. 90 SQ. YDS., EXACT QUANTITY AND DIMS. TO BE DETERMINED IN FIELD BY ENGINEER. (SEE DETAIL, SHT. DT-19)

20" FLAP VALVE (SEE DETAIL DT-2)

20" DRAIN LINE (SLOPE @ 0.86% MIN. TO DAYLIGHT)

PROPOSED FENCE CORNER N=1967559.06 E=2721491.26

PROPOSED FENCE CORNER N=1967559.06 E=2721591.26

100'

APPROX. 1245 SQ. YDS. 2" GRAVEL OVER 3" NMDOT SPECIFICATION BASE COURSE. MIN. 95% STANDARD PROCTOR REQUIRED FOR ENTIRE FENCED AREA AND DRIVING SURFACES.

FUTURE TANK B

PROPOSED TANK A
N = 1967511.41
E = 2721541.34
(SEE DT-14 TO DT-17 FOR DETAILS)

100'

PROPOSED 8' HIGH FENCE, 400 L.F. (SEE DETAIL, SHT. DT-18)

PROPOSED FENCE CORNER N=1967459.06 E=2721536.33

25'

55'

PROPOSED FENCE CORNER N=1967459.06 E=2721491.26

PROPOSED FENCE CORNER N=1967459.06 E=2721516.33

PROPOSED FENCE CORNER N=1967459.06 E=2721591.26

20' DOUBLE SWING GATE (SEE FENCE DETAIL DT-18)

BEGIN SITE PIPING AT EASEMENT
STA: 182+28.2
N=1967422.38
E=2721607.11

PROPOSED 20' WIDE ACCESS DRIVE

20'

FLOW

PROPOSED N.G.W.S.P. REACH 21 WATERLINE - 20" PVC DR25

182+00

FLOW

80' WATERLINE EASEMENT

181+00

PROPOSED N.G.W.S.P. REACH 21 WATERLINE - 20" PVC DR25

CORNER OF ESMT.
N=1967320.48
E=2721606.81

LIMITS OF SITE EASEMENT

CORNER OF ESMT.
N=1967321.17
E=2721376.81

END SITE PIPING AT EASEMENT
STA: 184+74.8
N=1967320.68
E=2721540.91

185+00

20' TEMP. CONST. ESMT.

60' WATERLINE EASEMENT

20' TEMP. CONST. ESMT.

20' TEMP. CONST. ESMT.

Navajo Tribal Trust

N

0' 20' 40'

GRAPHIC SCALE

LEGEND

- 2" GRAVEL OVER 3" NMDOT SPECIFICATION BASE COURSE
- TEMPORARY CONSTRUCTION EASEMENT

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21

WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL - TITLE

FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

REACH 21 TANK SITE
NO. 3 SITE PLAN

USBR-DWG-NMBR
SHEET C-12

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
atsv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Tank Site Plan.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO
SEC–18, T–25–N, R–9–W
NAVAJO TRIBAL TRUST

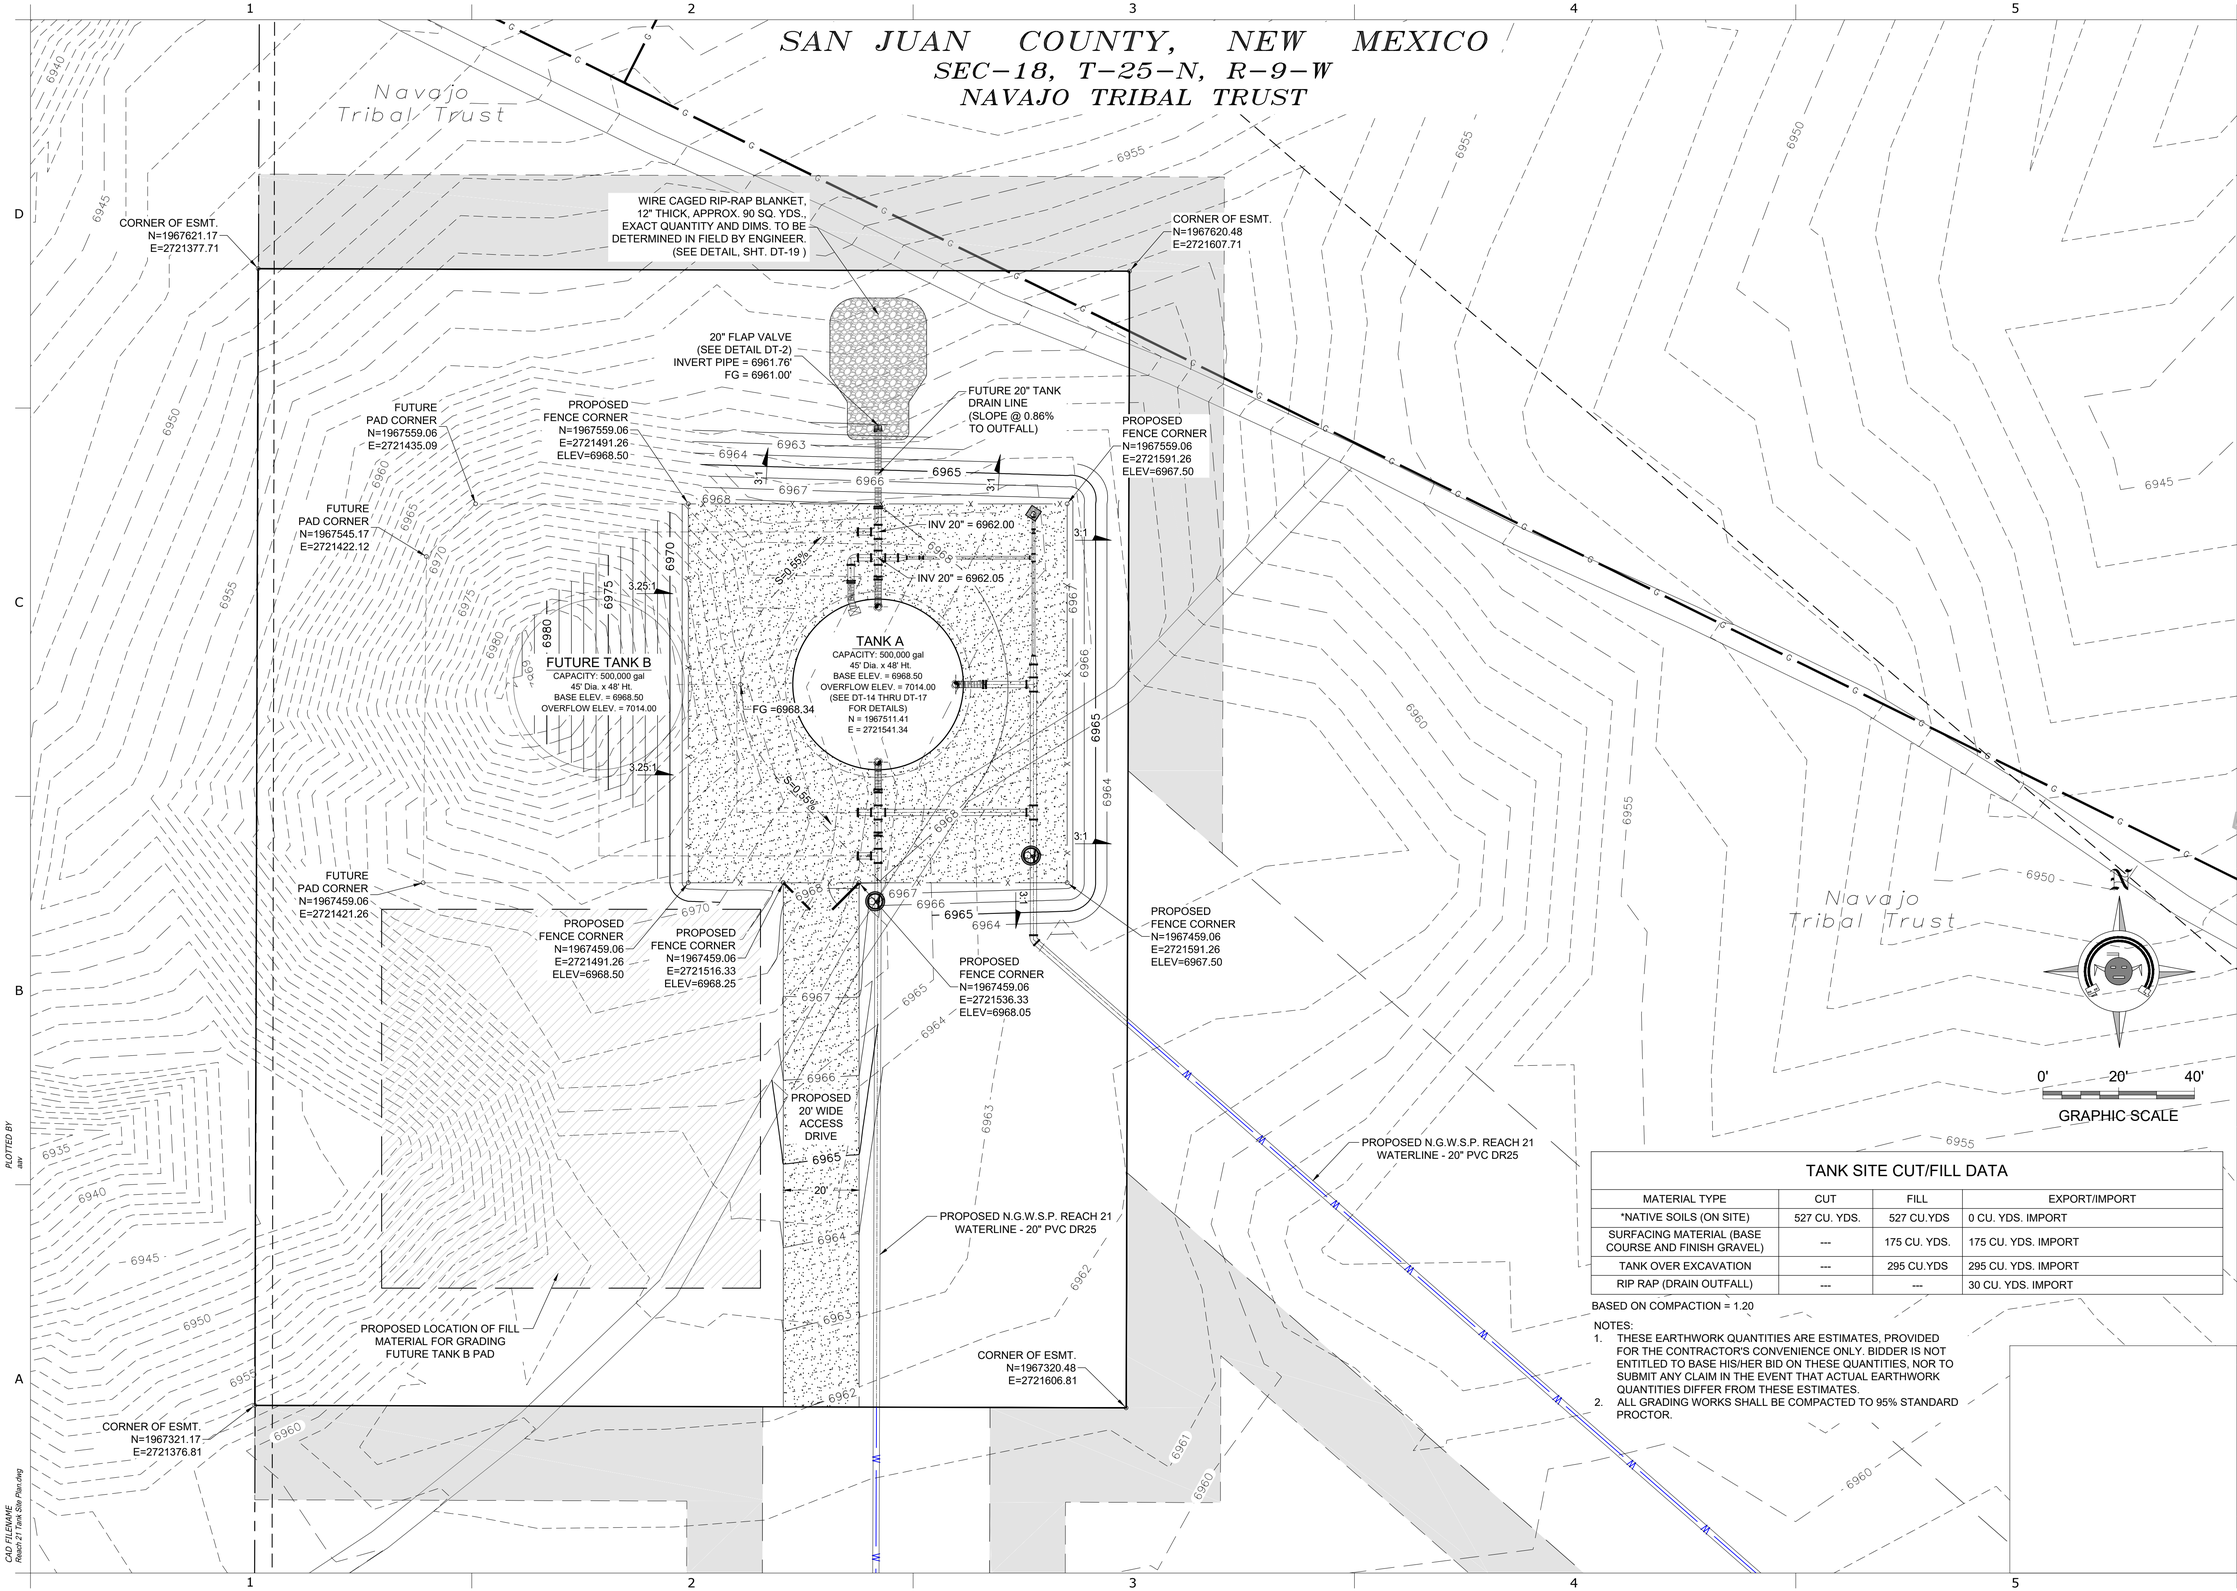

TANK SITE CUT/FILL DATA

MATERIAL TYPE	CUT	FILL	EXPORT/IMPORT
*NATIVE SOILS (ON SITE)	527 CU. YDS.	527 CU.YDS	0 CU. YDS. IMPORT
SURFACING MATERIAL (BASE COURSE AND FINISH GRAVEL)	---	175 CU. YDS.	175 CU. YDS. IMPORT
TANK OVER EXCAVATION	---	295 CU.YDS	295 CU. YDS. IMPORT
RIP RAP (DRAIN OUTFALL)	---	---	30 CU. YDS. IMPORT

BASED ON COMPACTION = 1.20

NOTES:
1. THESE EARTHWORK QUANTITIES ARE ESTIMATES, PROVIDED FOR THE CONTRACTOR'S CONVENIENCE ONLY. BIDDER IS NOT ENTITLED TO BASE HIS/HER BID ON THESE QUANTITIES, NOR TO SUBMIT ANY CLAIM IN THE EVENT THAT ACTUAL EARTHWORK QUANTITIES DIFFER FROM THESE ESTIMATES.
2. ALL GRADING WORKS SHALL BE COMPACTED TO 95% STANDARD PROCTOR.

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21

WATER PIPELINE

Draft
Not For Distribution
For Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — SIGN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

REACH 21 TANK
SITE NO. 3
GRADING PLAN

USBR-DWG-NMBR

SHEET C-13

DATE AND TIME PLOTTED 6/19/17
PLOTTED BY aw
CAD SYSTEM AUTOCAD
CAD FILENAME Reach 21 Tank Site Plan.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO
SEC-18, T-25-N, R-9-W
NAVAJO TRIBAL TRUST

Navajo Tribal Trust

INSTALL:
3 - FIBER ROLLS, EXACT QUANTITY AND SPACING TO BE DETERMINED IN FIELD BY ENGINEER. (APPROX. 200 L.F.)
(SEE DETAIL, SHT. DT-20)

FUTURE TANK B

TANK A

S=0.55%

S=0.55%

INSTALL:
3 - FIBER ROLLS, EXACT QUANTITY AND SPACING TO BE DETERMINED IN FIELD BY ENGINEER. (APPROX. 675 L.F.)
(SEE DETAIL, SHT. DT-20)

PROPOSED 20' WIDE ACCESS DRIVE

20'

PROPOSED N.G.W.S.P. REACH 21 WATERLINE - 20" PVC DR25

PROPOSED N.G.W.S.P. REACH 21 WATERLINE - 20" PVC DR25

INSTALL:
4 - FIBER ROLLS, EXACT QUANTITY AND SPACING TO BE DETERMINED IN FIELD BY ENGINEER. (APPROX. 750 L.F.)
(SEE DETAIL, SHT. DT-20)

Navajo Tribal Trust

N

0' 20' 40'

GRAPHIC SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Official Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — ADMIN APPROVAL — TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

REACH 21 TANK SITE
NO. 3 STORMWATER
BMP PLAN

USBR-DWG-NMBR

SHEET C-14

DATE AND TIME PLOTTED
6/9/17
PLOTTED BY
atvr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Tank Site Plan.dwg

FOR OFFICIAL USE ONLY

KEYED NOTES - REACH 21 TANK SITE	
Item No.	Description
1	3" VACUUM BREAKER W/ 1" AIR RELEASE VALVE (SEE DETAIL DT-9)
2	20" PVC DR25 PIPE
3	20" MJ x MJ TEE, D.I. 350 psi
4	20" MJ x MJ CROSS, D.I. 350 psi
5	20" MJ x MJ BUTTERFLY VALVE, 150 psi (SEE DETAIL DT-8)
6	20" FL x FL BUTTERFLY VALVE, 150 psi (SEE DETAIL DT-8)
7	20" x 8" MJ x MJ CONCENTRIC REDUCER, D.I. 350 psi
8	20" MJ x MJ 45° ELL, D.I. 350 psi
9	20" MJ x MJ 90° ELL, D.I. 350 psi
10	20" MJ END CAP, D.I. 350 psi
11	20" STEEL PIPE, STANDARD WALL (SEE NOTES 9A & 9B, THIS SHEET)
12	20" FLANGE ADAPTOR, 165 psi
13	8" PVC DR25 PIPE
14	8" MJ x MJ GATE VALVE, 350 psi (SEE DETAIL DT-8)
15	8" MJ x MJ TEE, D.I. 350 psi
16	20" FLAP VALVE (SEE DETAIL DT-2)

NOTES:

1. CONTRACTOR SHALL FIELD SURVEY ELEVATION OF OVERFLOW WEIR OF TANK A AND ENSURE OVERFLOW WEIR ELEVATION MATCHES ENWP PHASE 3 DZ REGULATING (SE) TANK OVERFLOW ELEVATION (WITHIN A TOLERANCE OF ±1/2" INCH).
2. PROVIDE TANK SUB-FOUNDATIONS, OVER-EXCAVATION, AND SITE GRADING IN ACCORDANCE WITH GEOTECHNICAL REPORT AND DT-14.
3. PROVIDE TANK FOUNDATION IN ACCORDANCE WITH GEOTECHNICAL REPORT AND TANK MANUFACTURER'S PE-SEALED FOUNDATION DESIGN.
4. NO HIGH SPOTS PERMITTED ON SITE PIPING. ALL SITE PIPING (INCLUDING SENSOR LINES) SHALL SLOPE UP TOWARDS TANKS OR ARVS (MIN. 1%).
5. ALL MATERIALS, FITTINGS AND APPURTENANCES SHALL BE RATED TO AT LEAST 165 psi, UNLESS OTHERWISE NOTED.
6. ALL PIPE AND FITTINGS UNDERNEATH AND WITHIN 5' OF TANK FOUNDATIONS SHALL BE STEEL, AND SHALL BE SHOP WELDED, SHOP COATED, X-RAY TESTED AND PRESSURE TESTED PRIOR TO PLACING FOUNDATIONS. SHOP COATINGS SHALL BE APPLIED AFTER WELDING.
7. ALL VALVES AND STEEL-TO-PVC COUPLINGS AT TANKS SHALL BE LOCATED AT LEAST 5' FROM EDGES OF FOUNDATIONS.
8. ALL BURIED NON-STAINLESS STEEL PIPE AND FITTINGS SHALL BE COLD-APPLIED TAPE-WRAPPED, PER SPECIFICATIONS.
9. GLASS-FUSED STEEL TANKS: ALL 20-INCH STEEL PIPE AND FITTINGS SHALL BE FBE-COATED, INTERIOR AND EXTERIOR.
10. ALL DUCTILE IRON FITTINGS SHALL BE DOUBLE WRAPPED POLYETHYLENE PER SPECIFICATIONS. INNER JACKET SHALL BE V-BIO ENHANCED, MIN. 8-MIL. OUTER JACKET SHALL BE STANDARD PE, MIN. 8-MIL.
11. ALL BURIED DUCTILE IRON FITTINGS SHALL BE MJ.
12. ALL PRESSURE BEARING PIPES WITHIN SITE SHALL BE FULLY RESTRAINED. REFER TO DETAIL, SHEET DT-3.
14. FIELD LOCATE CONDUITS PER REVIEW WITH ELECTRICIAN.
15. TANK SITE NON-STAINLESS METALLIC COMPONENTS REQUIRE CATHODIC PROTECTION.

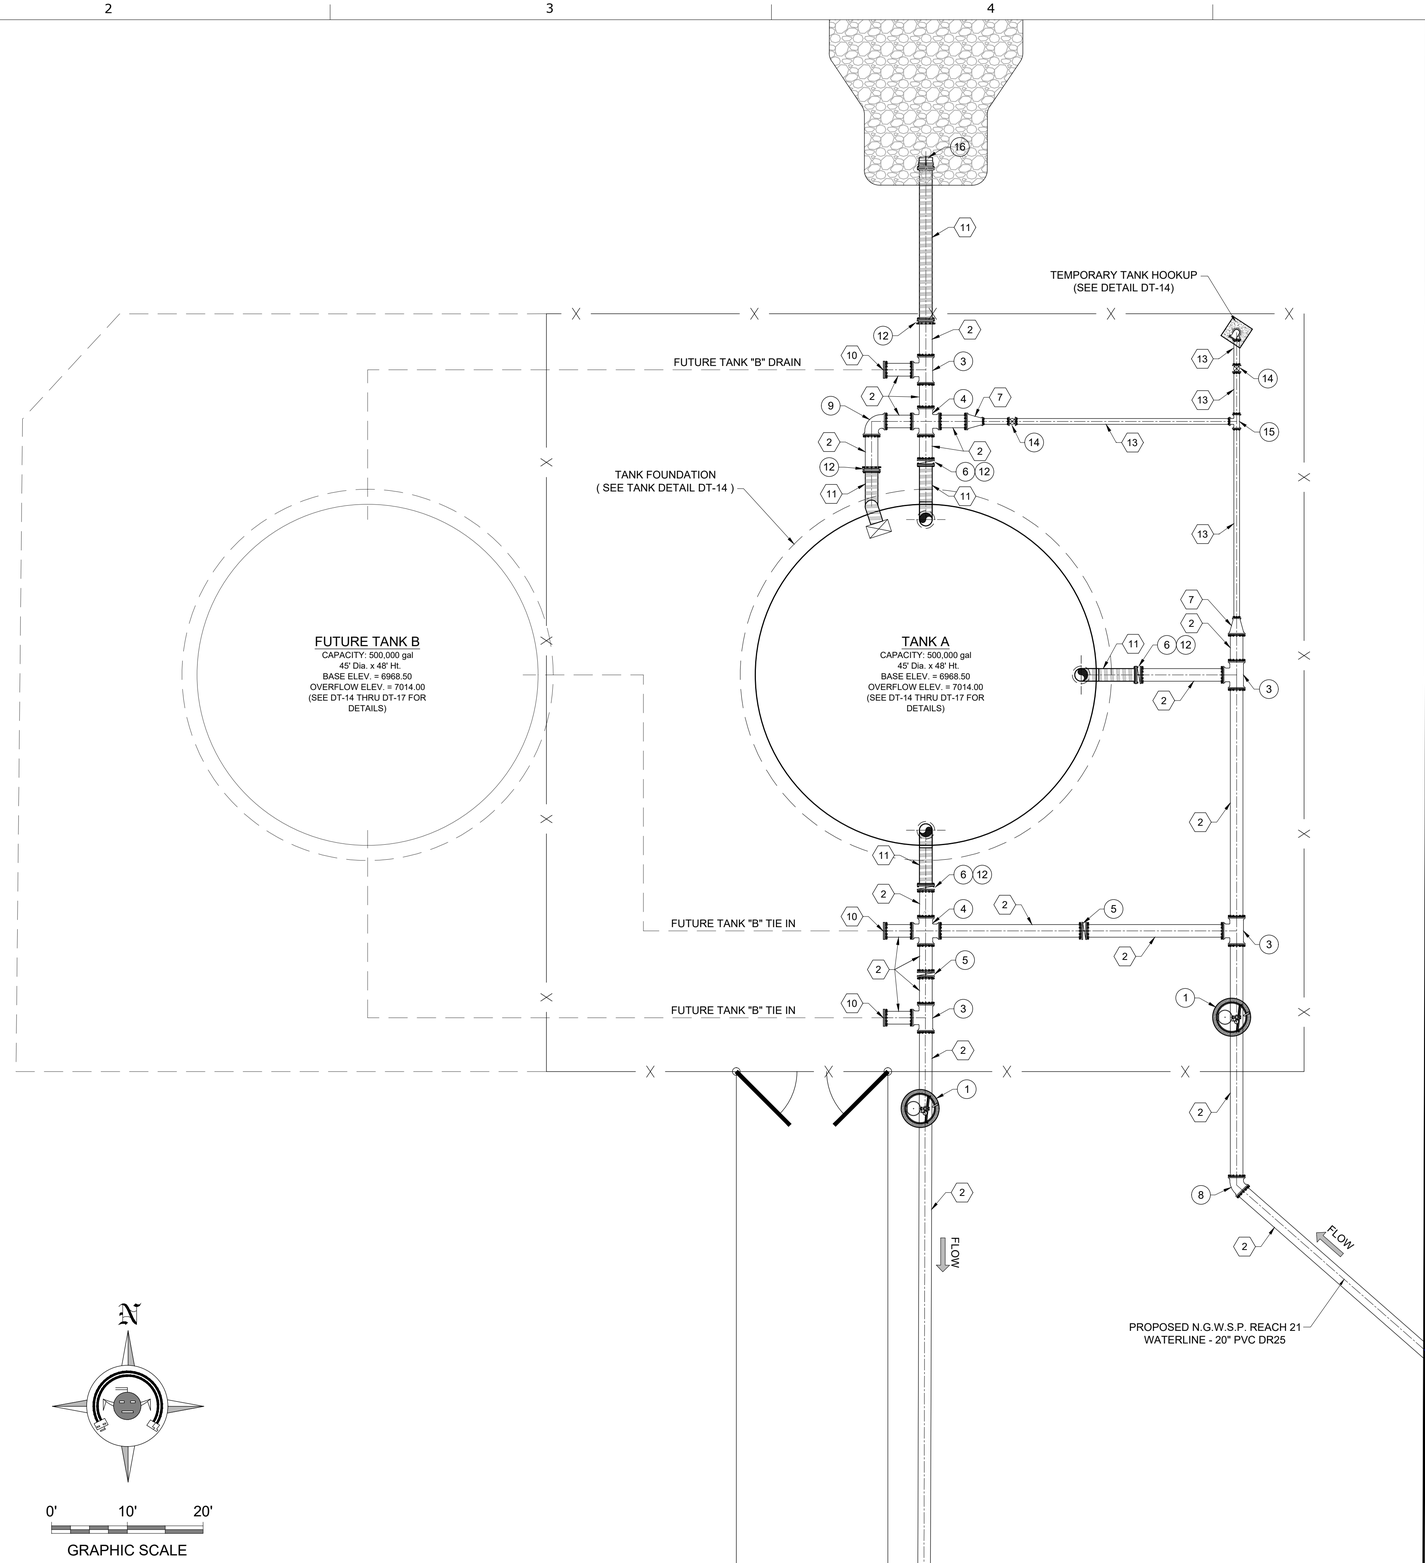

0' 10' 20'

GRAPHIC SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL — TITLE

FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

REACH 21 TANK
SITE NO. 3
PIPING PLAN

USBR-DWG-NMBR

SHEET C-15

DATE AND TIME PLOTTED
6/9/17
PLOTTED BY
atrr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Tank Site Plan.dwg

TANK SITE NUMBER 3 - VALVE NUMBERING					
Valve No.	Valve Size	Valve Type	Pipe Type	Description	Warning Placard (Requires lockable valve box lid inside meter can) (See Sheet DT-8)
1	20"	BFV	STEEL / PVC	TANK A FLOOR DRAIN	NO
2	20"	BFV	STEEL / PVC	TANK A INLET	YES
3	20"	BFV	STEEL / PVC	TANK A OUTLET	YES
4	20"	BFV	PVC	TANK A BYPASS	YES
5	20"	BFV	PVC	TANK B BYPASS	YES
6	8"	GV	PVC	TEMPORARY TANK HOOK UP	NO
7	8"	GV	PVC	MAIN LINE FLUSH VALVE	NO

NOTES:
1. REFERENCE SHEET DT-8 FOR SITE VALVE IDENTIFICATION AND WARNING PLACARD DETAILS.

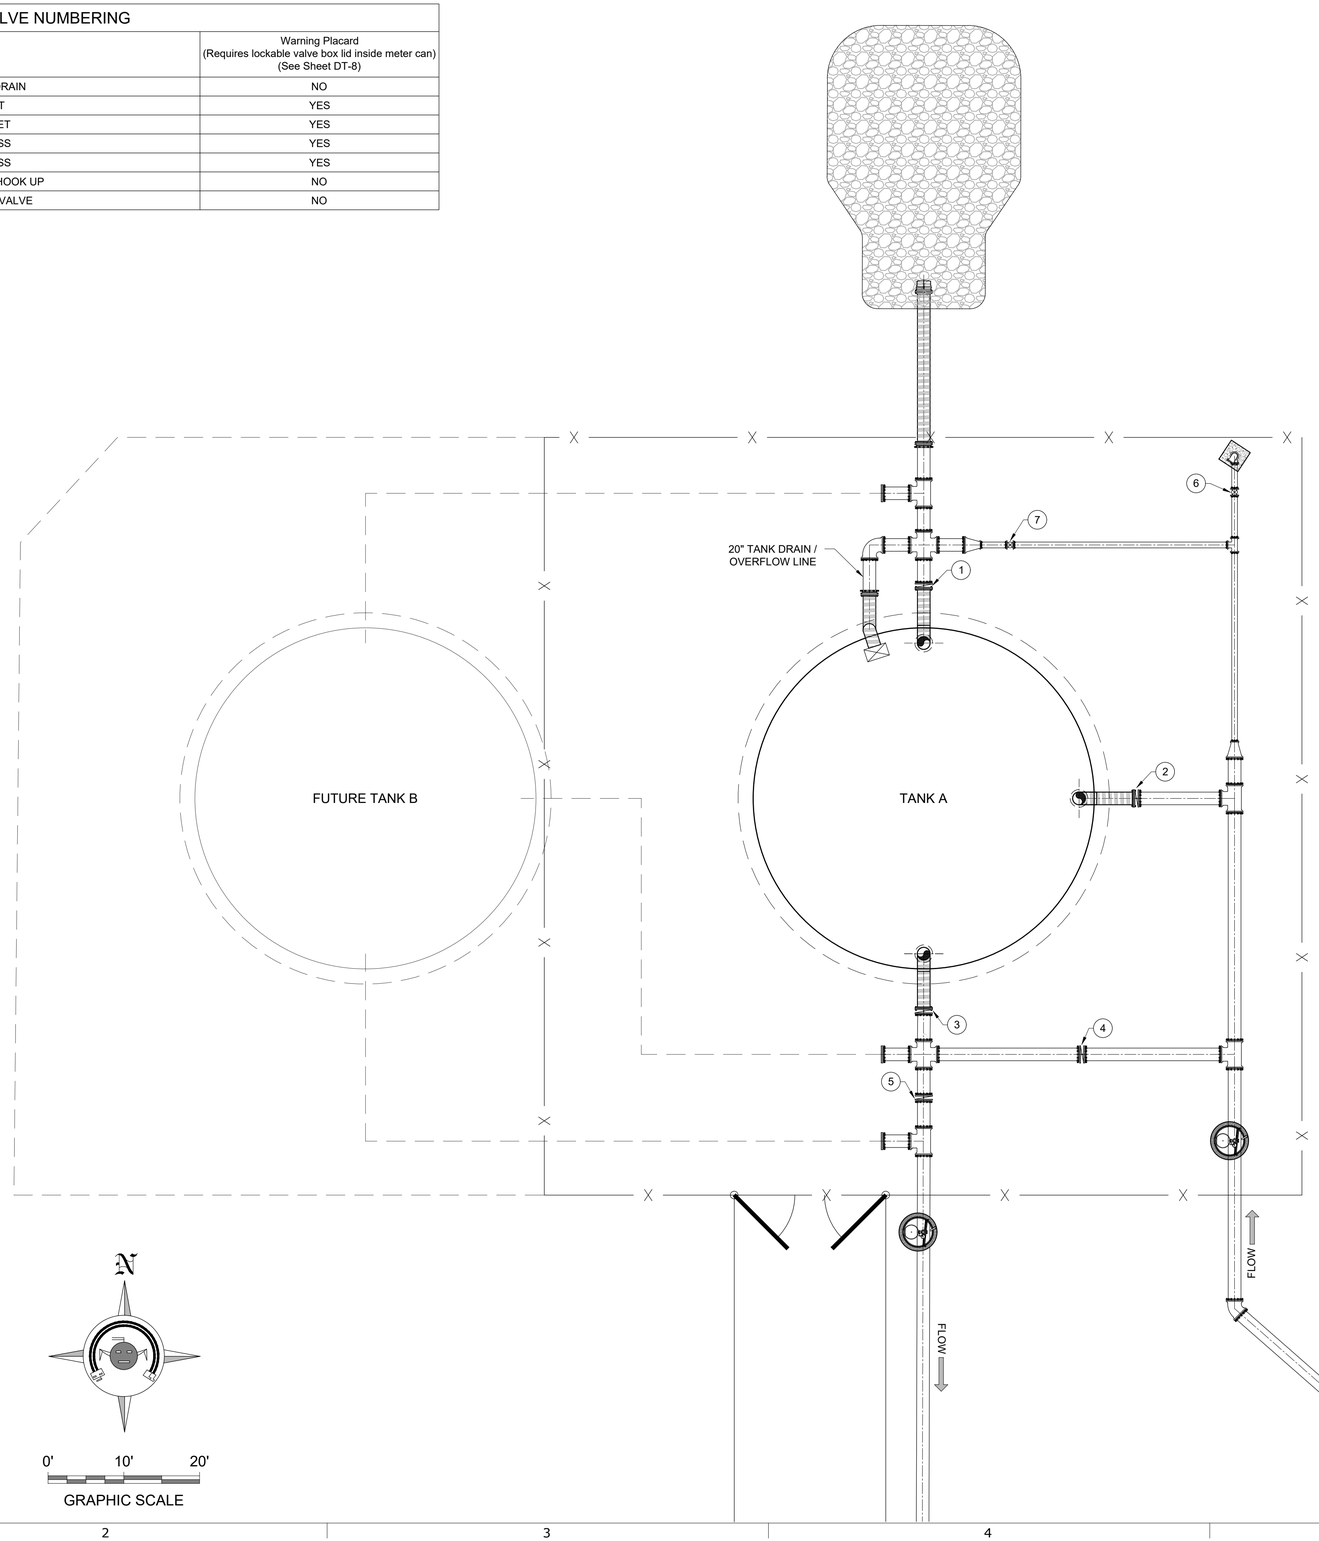

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21

WATER PIPELINE

Draft
Not For Distribution
Attorney Use Only
Fax

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGN ORIGINAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

REACH 21 TANK
SITE NO. 3 SITE
VALVE NUMBERS

USBR-DWG-NMBR
SHEET C-16

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Tank Site Plan.dwg

FOR OFFICIAL USE ONLY

SAN JUAN COUNTY, NEW MEXICO
SEC-18, T-25-N, R-9-W
NAVAJO TRIBAL TRUST

REACH 21 WATERLINE EASEMENT

SEE SHT. C-10 FOR CONTINUATION

4" DR18 PVC

4" FLUSH DRAIN LINE MUST REMAIN WITHIN REACH 21 AND PHASE 3 R-O-W'S

4" 22.5° MJ BEND, DI

EXISTING PHASE 3 ISOLATION VALVE STA. 41+20, 1142 FT.

EXISTING 22" HDPE DR17 IPS

40' ENWP PHASE 3 WATERLINE EASEMENT

22" ELECTROFUSION COUPLING

22" HDPE DR17 IPS

10.0'

4" 45° MJ BEND, DI

4" DR18 PVC

4" 45° MJ BEND, DI

4" DR18 PVC

4" 90° MJ BEND, DI

4" DR18 PVC

6" BLIND FLANGE

4" FLUSH VALVE ASSEMBLY (SEE DETAIL DT-10)

20" BUTTERFLY VALVE W/ BYPASS (SEE DETAIL DT-7)

DR25 PVC HDPE

20" DI MJ SPOOL

PROPOSED REACH 21 STA 199+76.3= EXISTING PHASE 3 STA 29+77.5 N=1965860.71 (APPROX.) E=2721436.67 (APPROX.)

22" HDPE DR17 IPS

60' REACH 21 WATERLINE EASEMENT

20" DR25 PVC

20" DR25 PVC

20" DR25 PVC

22" DR15.5 HDPE TEE

PROPOSED N.G.W.S.P. REACH 21 WATERLINE

14.0'

8.0'

3.0'

PVC TO HDPE TRANSITION

HDPE MJ ADAPTOR WITH STAINLESS BACKUP RING

20" x 22" REDUCER, HDPE DR17

22" HDPE DR17 IPS

10.0'

NOTES: 1. LOCATION OF EXISTING ENWP PHASE 3 PIPING IS APPROXIMATE.
2. ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

ENWP PHASE 3 WATERLINE EASEMENT

22" ELECTROFUSION COUPLING

EXISTING ENWP PHASE 3 WATERLINE

EXISTING 22" HDPE DR17 IPS

EXISTING PHASE 3 ISOLATION VALVE STA. 25+78, 400 FT.

REACH 21 WATERLINE EASEMENT

Navajo Tribal Trust

6896 6897 6898 6899 6895 6896 6898 6887

0' 3' 6'

GRAPHIC SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

ENWP PHASE 3 TIE IN

USBR-DWG-NMBR

SHEET C-17

DATE AND TIME PLOTTED
6/8/17
PLOTTED BY
atw

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Tank Site Plan.dwg

FOR OFFICIAL USE ONLY

NOTES:

1. SOIL CEMENT SLURRY MAY BE USED IN LIEU OF COMPACTED SELECT MATERIAL AT CONTRACTOR'S OPTION AND EXPENSE.
2. ANY SECTION OF PIPE EMBEDDED IN COMPACTED SELECT MATERIAL THAT FAILS TO MEET SOIL CLASSIFICATION AND/OR COMPACTION REQUIREMENTS SHALL BE DUG UP, RE-BURIED, RE-COMPACTED AND RE-TESTED AT CONTRACTOR'S SOLE EXPENSE.
3. MINIMUM CLEARANCES BETWEEN PIPE AND TRENCH WALL MUST BE MET PRIOR TO PLACING EMBEDMENT (WHETHER COMPACTED SELECT MATERIAL OR SOIL CEMENT SLURRY). INCREASE CLEARANCES AND/OR TRENCH WIDTH AS NEEDED TO ALLOW FOR COMPACTION AND/OR TO ENSURE ADEQUATE SOIL CEMENT SLURRY LAYER THICKNESS IN HAUNCH AREAS AND PIPE SPRING LINE. DO NOT ALLOW PIPE TO REST AGAINST TRENCH WALL.
4. ROUNDED TRENCH BOTTOMS MAY BE USED IN CONJUNCTION WITH SOIL CEMENT SLURRY, PROVIDED THE THICKNESS OF SOIL CEMENT AROUND THE PIPE IS AT NO POINT LESS THAN 3".

SIDE CLEARANCE TABLE FOR SOIL TRENCH AND SELECT MATERIAL OR CLSM EMBEDMENT

		DUCTILE IRON		PVC		HDPE	
HEIGHT OF COVER	CMP	MATERIAL TYPE 2*	MATERIAL TYPE 3*	MATERIAL TYPE 2	MATERIAL TYPE 3	MATERIAL TYPE 2	MATERIAL TYPE 3
<= 10'	12"	12"	12"	12"	12"	24"	24"
<= 15'	NA	12"	12"	12"	12"	24"	24"
<= 20'	NA	NA	NA	12"	12"	24"	24"

NA - NOT APPLICABLE
* WHEN BACKFILL IS COMPACTED, PROVIDE AN ADDITIONAL 6" OF SIDE CLEARANCE.
1. BACKFILL CANNOT EXCEED 5' UNTIL EMBEDMENT OBTAINS AN UNCONFINED COMPRESSIVE STRENGTH OF 30 PSI.
2. DUCTILE IRON PIPE INCLUDES STANDARD WATER PRESSURES OF 250 AND 300 PSI.
3. PVC PIPE INCLUDES DR RATIOS OF 18, 21, AND 25.
4. HDPE PIPE IS FOR DR11 ONLY.

TRENCH SELECTION PROPERTIES FOR SOIL CEMENT SLURRY

		MAXIMUM COVER DEPTH* (FEET)	
PIPE MATERIAL	PIPE SIZE/ CLASS	MATERIAL TYPE 2	MATERIAL TYPE 3
PVC	24" DR25	16	12
PVC	24" DR21	20	15
PVC	20" DR25	17	13
PVC	20" DR21	20	16
PVC	20" DR18	25	20
HDPE	20" DR11	20	20
STEEL	ALL DIAMETERS	NA	NA
DUCTILE IRON	ALL DIAMETERS	NA	NA

NA - NOT ALLOWED - NATIVE MATERIAL EMBEDMENT NOT ALLOWED.
* THE MAXIMUM COVER ALLOWED MAY BE INCREASED BASED ON THE TRENCH SIDE WALL STRENGTH AS APPROVED BY THE COR AND BASED ON INPUT FROM THE DESIGN ENGINEER.

MINIMUM PERCENT COMPACTION FOR EMBEDMENT IN NON-TRAFFICKED AREAS

CLEAN COARSE-GRAINED SOILS

Cover Depth	Minimum Compaction
4' to 15'	85%
15' to 20'	95%

Coarse-grained soils (sand or gravel), GW, GP, SW, SP, with less than 12% fines

SANDY OR GRAVELLY FINE-GRAINED SOILS & COARSE-GRAINED SOILS WITH FINES

Cover Depth	Minimum Compaction
4' to 10'	85%
10' to 12'	95%

Fine-grained soils (LL<50) Soils with medium to no plasticity, CL, ML, ML-CL, with more than 30% coarse-grained particles, or Coarse-grained soils (sand or gravel), GM, GC, SM, SC, with more than 12% fines

NOTES ON COMPACTION:
1. ALL COMPACTION VALUES BASED ON STD. PROCTOR, ASTM D698. SOIL CLASSIFICATIONS BASED ON ASTM D2487.
2. EMBEDMENT WITHIN DRIVING SURFACES OF ALL ROADS, DRIVEWAYS AND PARKING AREAS SHALL BE COMPACTED TO AT LEAST 95% STD. PROCTOR, REGARDLESS OF SOIL TYPE. SOIL CEMENT MAY BE USED IN LIEU OF COMPACTED SELECT MATERIAL.

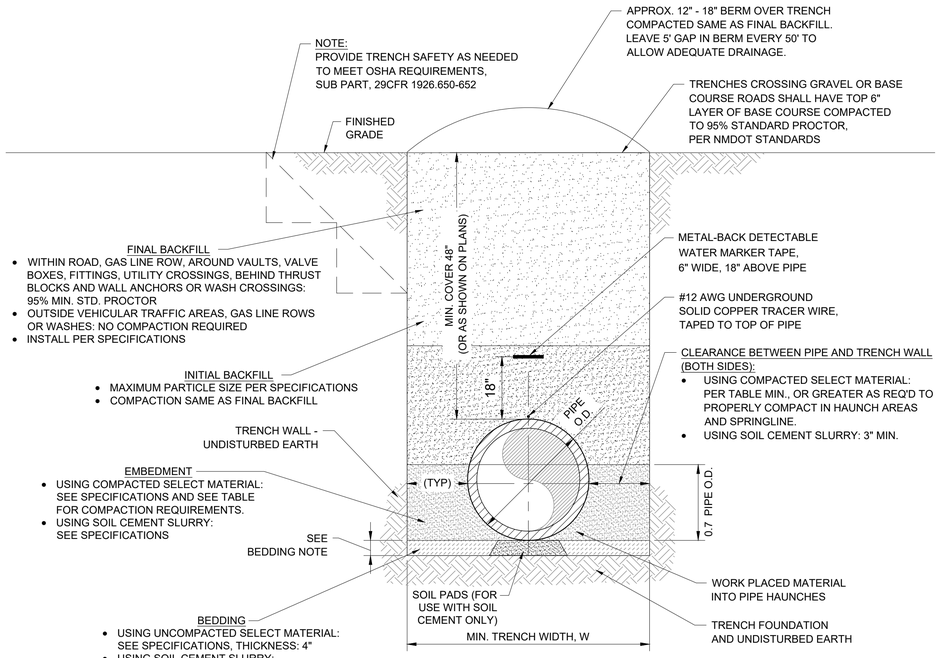

TYPICAL TRENCH DETAIL

NOT TO SCALE

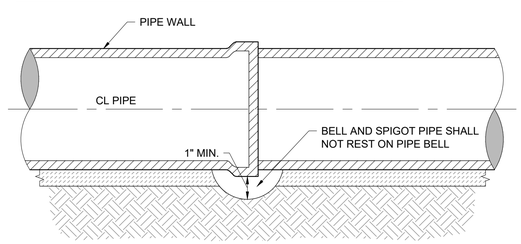

TYPICAL BELL HOLE DETAIL

NOT TO SCALE

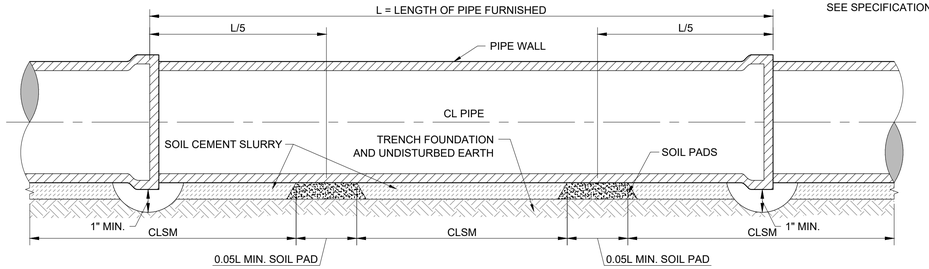

SOIL CEMENT INSTALLATION WITH SOIL PADS

NOT TO SCALE

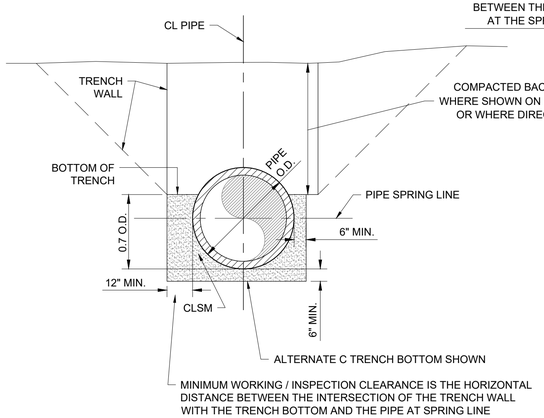

ROCK TRENCH - MATERIAL TYPE 1

NOT TO SCALE

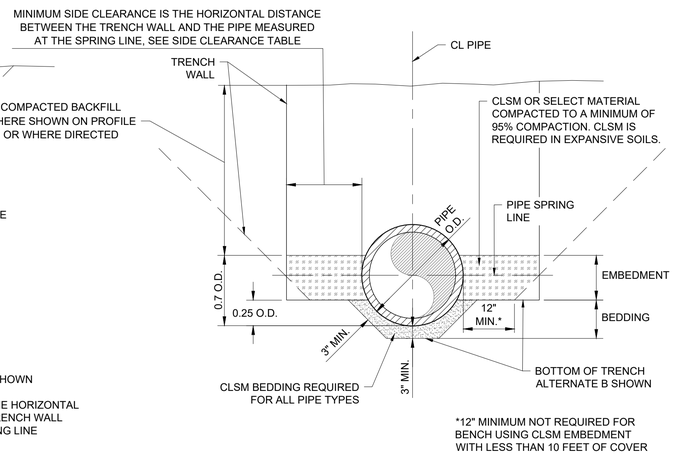

SOIL TRENCH - MATERIAL TYPE 2 & 3

NOT TO SCALE

NATIVE MATERIAL PROPERTIES

MATERIAL TYPE 1 - TYPICAL TRENCH WALL MATERIALS WOULD BE ROCK MATERIALS CLASSIFIED AS SANDSTONE, CLAYSTONE, MUDSTONE, OR SILTSTONE; CEMENTED SOILS; AND CLAYEY MATERIAL WITH IN-PLACE DENSITIES OF 95% STANDARD PROCTOR OR HIGHER.

MATERIAL TYPE 2 - TYPICAL TRENCH WALL MATERIALS WOULD INCLUDE SILTY OR CLAYEY MATERIAL WITH IN-PLACE DENSITIES BETWEEN 85% AND 95% STANDARD PROCTOR; OR COHESIVE SOILS WITH IN-PLACE RELATIVE DENSITIES 40% OR GREATER.

MATERIAL TYPE 3 - TYPICAL TRENCH WALL MATERIALS WOULD INCLUDE LOW-DENSITY COHESIONLESS SOILS (CLEAN SANDS AND / OR LOOSE CLEAN GRAVELS) WITH AN IN-PLACE RELATIVE DENSITY BELOW 40%; ELASTIC SILT; LOW DENSITY SILTY OR CLAYEY SOILS WITH A DENSITY BELOW 85% STANDARD PROCTOR.

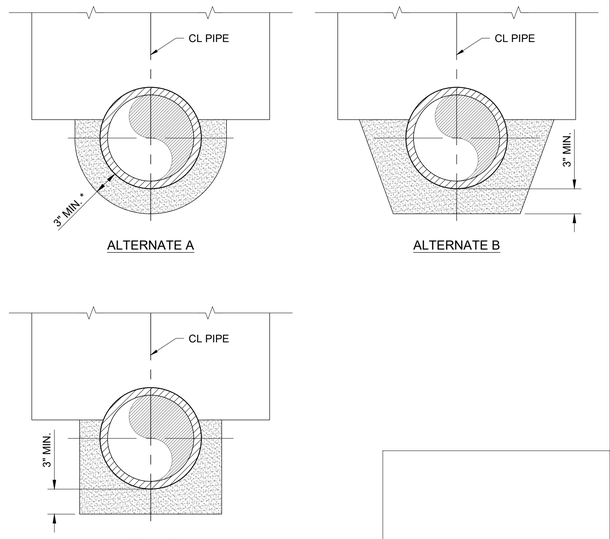

*6" MINIMUM REQUIRED BETWEEN BOTTOM OF PIPE AND ROCK SURFACES

ACCEPTABLE TRENCH BOTTOMS FOR CLSM

NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21 WATER PIPELINE

Draft
For Official Use Only
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

PIPELINE TRENCH DETAILS

USBR-DWG-NMBR

SHEET DT-1

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
aav

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Trench Details.dwg

NOTES:
1. EXISTING FENCE SHALL NOT BE CUT UNTIL SECURED TO H-BRACE ASSEMBLY.
2. INSTALL RANCHER STYLE GATE AT ALL FENCE CROSSINGS UNLESS SPECIFICALLY NOTED OTHERWISE ON PLANS.

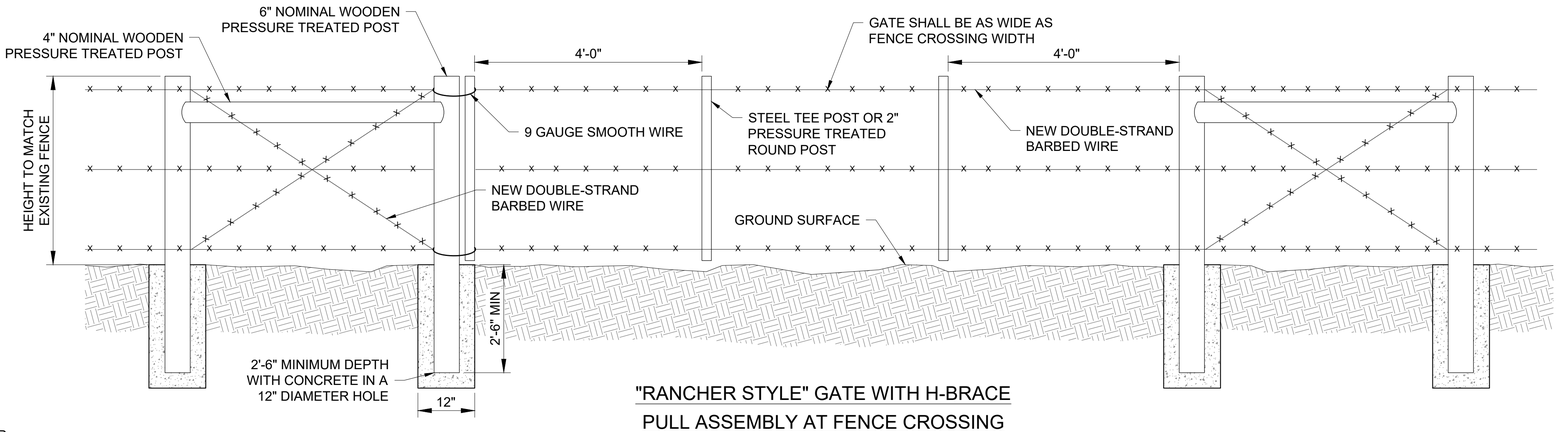

"RANCHER STYLE" GATE WITH H-BRACE PULL ASSEMBLY AT FENCE CROSSING

NOT TO SCALE

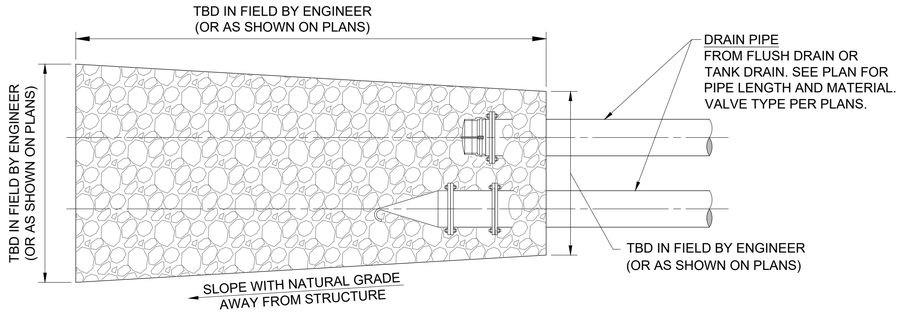

PLAN VIEW

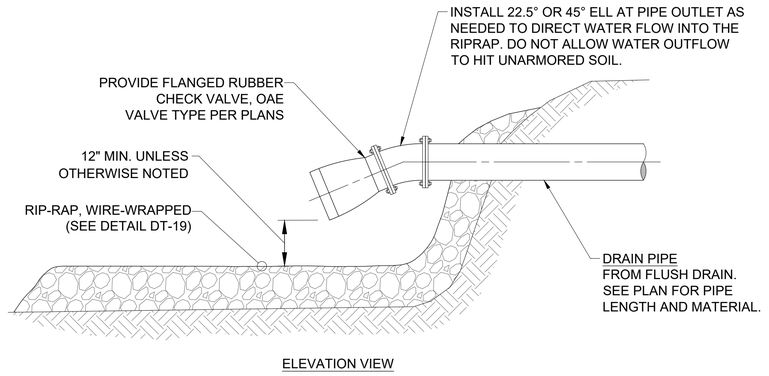

ELEVATION VIEW

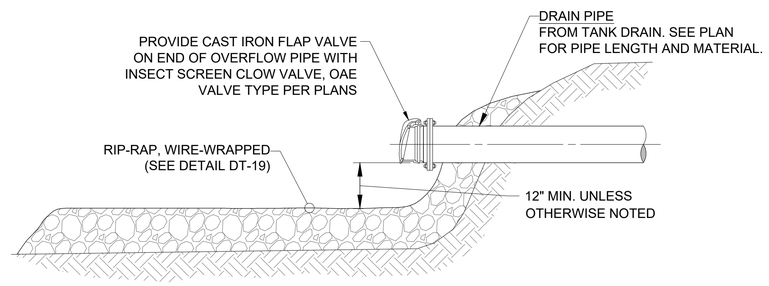

ELEVATION VIEW

TYPICAL SPLASH PAD DETAIL

NOT TO SCALE

NOTE:
1. CARSONITE UTILITY MARKER ON ALL P.I.'S AND GRADE CHANGES.
2. MAXIMUM DISTANCE BETWEEN CARSONITE UTILITY MARKERS SHALL BE 1500 LF.

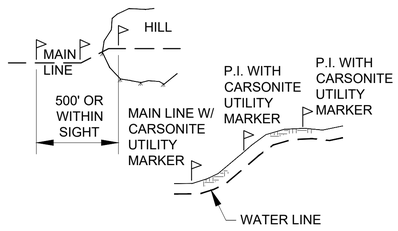

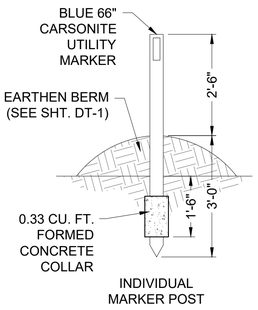

INDIVIDUAL MARKER POST

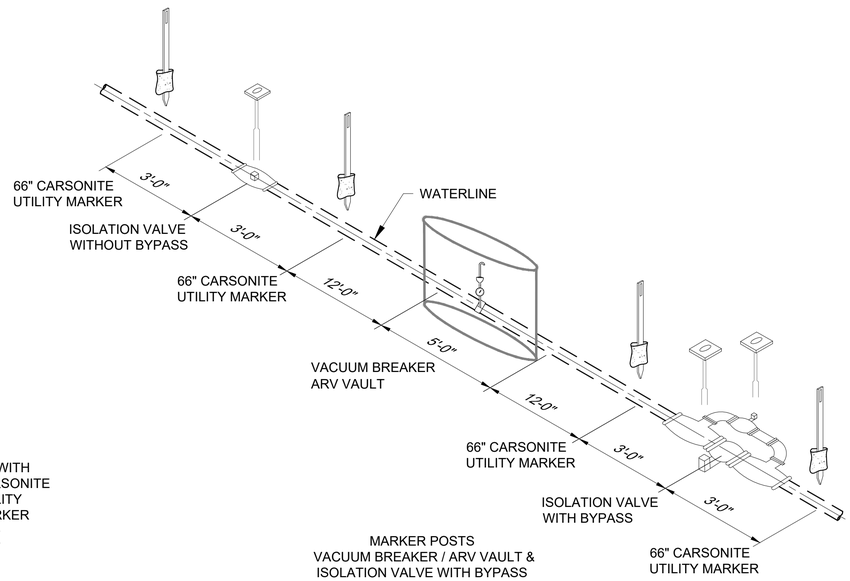

MARKER POSTS
VACUUM BREAKER / ARV VAULT & ISOLATION VALVE WITH BYPASS

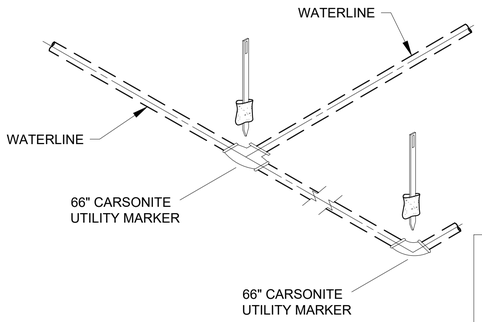

MARKER POSTS
TEE & ELL

TYPICAL MARKER POSTS

NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
For Internal Use Only
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL — TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

MISCELLANEOUS CONSTRUCTION DETAILS

USBR-DWG-NMBR
SHEET DT-2

DATE AND TIME PLOTTED
6/8/2017
PLOTTED BY
atv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Splash Pad Details.dwg

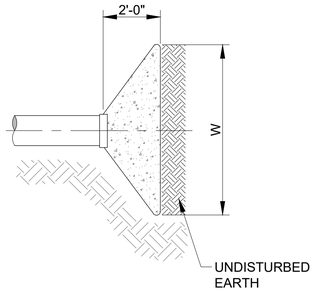

PLAN VIEW
CONCRETE BLOCKING
FOR PLUG OR CAP

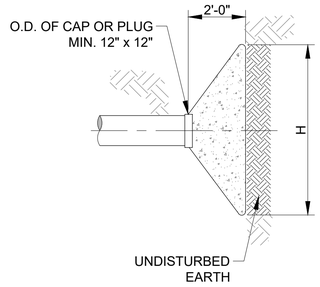

ELEVATION VIEW
CONCRETE BLOCKING
FOR PLUG OR CAP

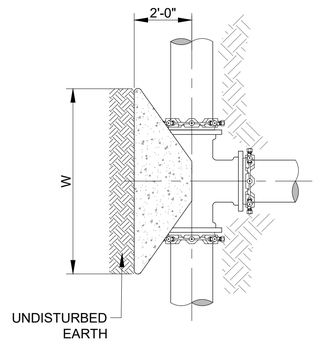

PLAN VIEW
CONCRETE BLOCKING
FOR TEE

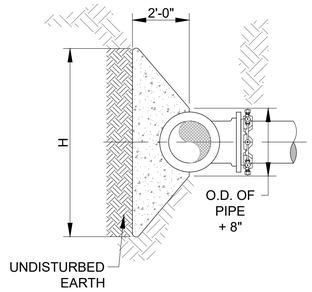

ELEVATION VIEW
CONCRETE BLOCKING
FOR TEE

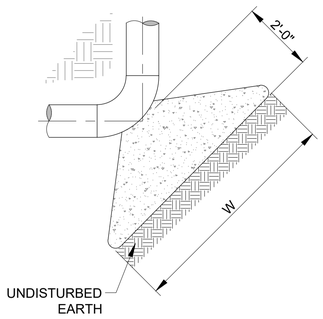

PLAN VIEW
CONCRETE BLOCKING
FOR ELBOW

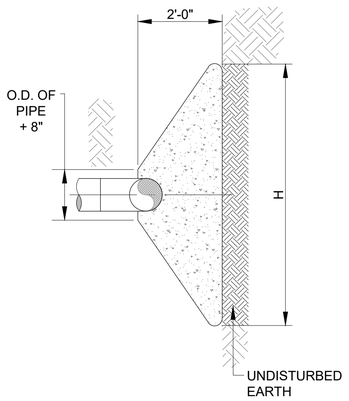

ELEVATION VIEW
CONCRETE BLOCKING
FOR ELBOW

THRUST BLOCK DETAIL
NOT TO SCALE

Wall Anchor Dimension Schedule

Pipe	Fitting	Design Wall Anchor Size in Feet (HxWxT)	Reinforcing Bar
24" DR11 HDPE Pipe	HDD Drilling Wall Anchor	7.5' x 7.5' x 2'	11-#6 EACH WAY, EACH FACE
20" DR11 HDPE Pipe	HDD Drilling Wall Anchor	6.5' x 6.5' x 2'	8-#6 EACH WAY, EACH FACE
24" DR25 PVC Pipe	Isolation Valve	8' x 8' x 2'	11-#6 EACH WAY, EACH FACE
20" DR25 PVC Pipe	Isolation Valve	6.5' x 6.5' x 2'	8-#6 EACH WAY, EACH FACE
20" DR25 PVC Pipe	Casing Wall Anchor	6.5' x 6.5' x 2'	9-#6 EACH WAY, EACH FACE
20" DR21 PVC Pipe	Isolation Valve	7' x 7' x 2'	9-#6 EACH WAY, EACH FACE
20" DR18 PVC Pipe	Isolation Valve	8' x 8' x 2'	11-#6 EACH WAY, EACH FACE

GENERAL NOTES:
1. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 psi. REBAR SHALL BE 60 psi.
2. CONCRETE WALL ANCHOR SHALL BEAR ON UNDISTURBED SOIL ON HDPE SIDE.

Thrust Block Dimension Schedule

Pipe	Fitting	Design Thrust Block Size in Feet (HxW)*
24" DR25 PVC	Flush Valve (4" Tee)	2' x 2'
24" DR25 PVC	90° ell	9' x 9'
24" DR25 PVC	45° ell	7' x 7'
24" DR25 PVC	22.5° ell	5' x 5'
24" DR25 PVC	11.25° ell	3.5' x 3.5'
20" DR25 PVC Fittings	Flush Valve (4" Tee)	2' x 2'
20" DR25 PVC Fittings	90° ell	8' x 8'
20" DR25 PVC Fittings	45° ell	6' x 6'
20" DR25 PVC Fittings	22.5° ell	4' x 4'
20" DR25 PVC Fittings	11.25° ell	3' x 3'
20" DR21 PVC Fittings	Flush Valve (4" Tee)	2' x 2'
20" DR21 PVC Fittings	90° ell	8.5' x 8.5'
20" DR21 PVC Fittings	45° ell	6' x 6'
20" DR21 PVC Fittings	22.5° ell	4.5' x 4.5'
20" DR21 PVC Fittings	11.25° ell	3' x 3'

*See detail drawings for thickness of thrust blocks.

GENERAL NOTE:
1. ALL CONCRETE SHALL BE 3000 psi, MINIMUM COMPRESSIVE STRENGTH IN 28 DAYS

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

For Internal Use Only
Draft
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
AREA MANAGER - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

THRUST BLOCK DETAILS

USBR-DWG-NMBR
SHEET DT-3

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atrv

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Block and Anchor Details.dwg

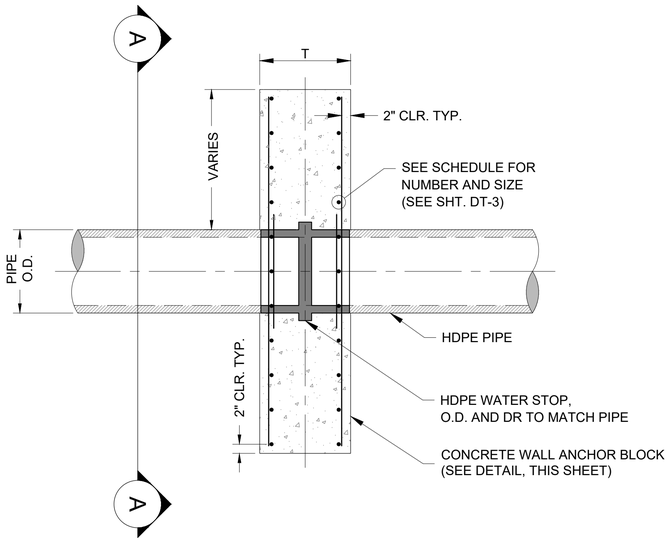

PLAN VIEW FOR HDPE

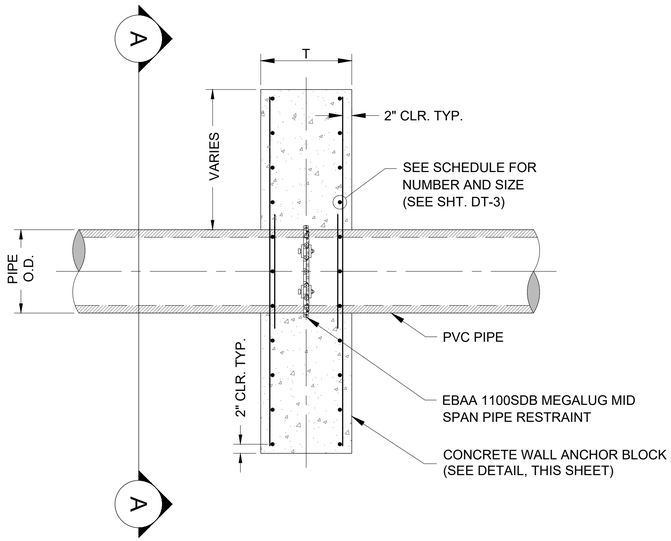

PLAN VIEW FOR PVC

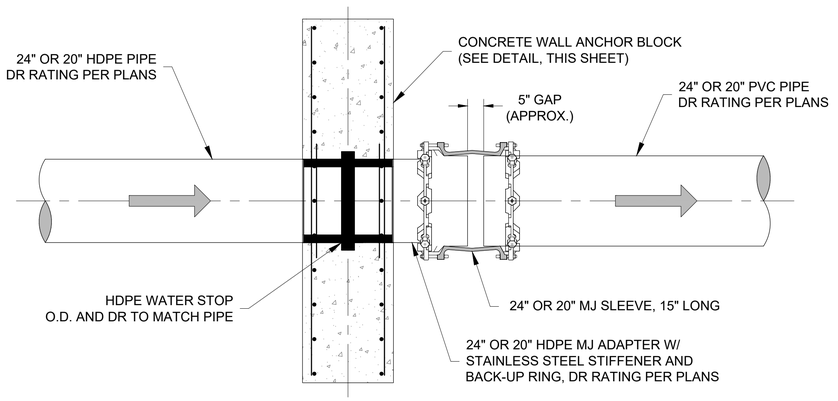

PLAN VIEW

HDPE TO PVC PIPE TRANSITION W/ ANCHOR BLOCK & ANCHOR RING

NOT TO SCALE

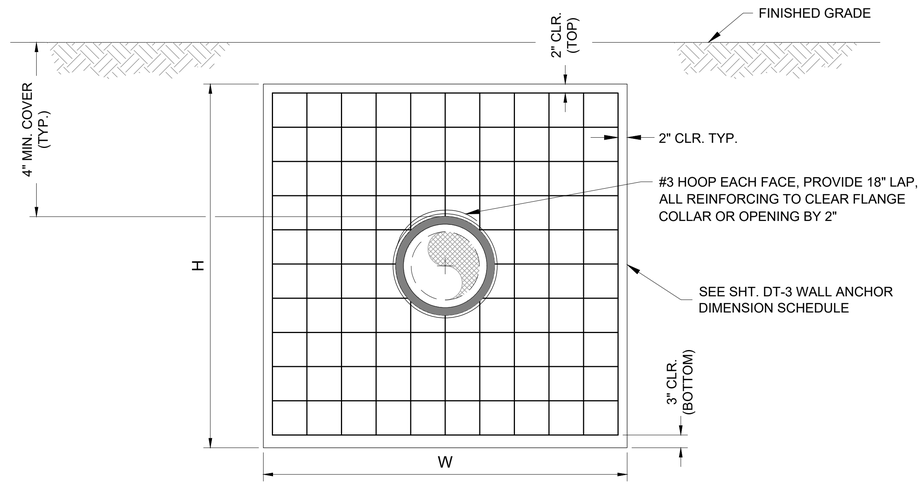

SECTION "A-A"

CONCRETE WALL ANCHOR BLOCK FOR USE W/ BUTTERFLY VALVE, CASING & HDPE TRANSITION RESTRAINT

NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — SIGN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

WALL ANCHOR BLOCK & PIPE TRANSITION DETAILS

USBR-DWG-NMBR

SHEET DT-4

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
alw

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Block and Anchor Details.dwg

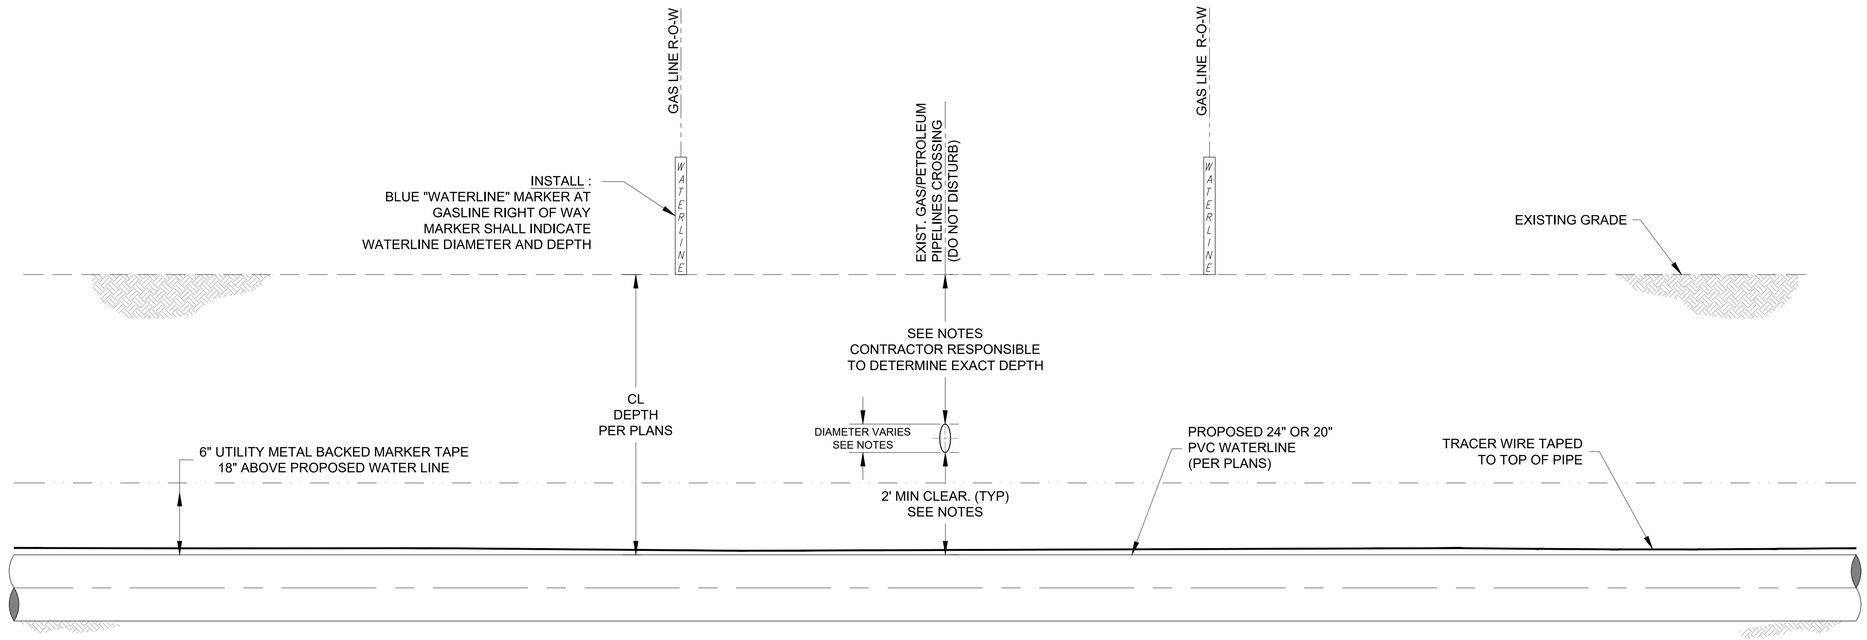

TYPICAL SINGLE GAS PIPELINE CROSSING DETAIL

NOT TO SCALE

SPECIAL NOTES AND CONTACTS-UTILITY PIPELINE CROSSINGS

NOTES:

1. ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.
2. NOTIFY GAS LINE COMPANIES (LISTED BELOW) 30 WORKING DAYS AND CALL NM ONE-CALL AT LEAST 3 WORKING DAYS PRIOR TO GRADING, CROSSING, MATERIAL STORAGE OR EQUIPMENT MOVING ACROSS GAS LINE RIGHT-OF-WAY OR ADJACENT ACCESS ROADS.
3. GAS LINE COMPANY REPRESENTATIVE MUST BE PRESENT DURING ALL CONSTRUCTION ACTIVITIES WITHIN GAS LINE RIGHT-OF-WAY, INCLUDING GRADING, EXCAVATION AND CLEANUP.
4. CONTRACTOR RESPONSIBLE TO LOCATE AND EXPOSE ALL EXISTING GAS / PETROLEUM LINES, IN ACCORDANCE WITH GAS COMPANY REQUIREMENTS.
5. EXCAVATE BY HAND OR VACUUM DRILL WITHIN 2 FEET OF GAS LINE, OR MORE IF GAS LINE COMPANY REQUIRES, WHICHEVER IS STRICTER.
6. CROSS UNDER ALL GAS LINES. 2' MIN. CLEARANCE FROM TOP OF CASING TO BOTTOM OF GAS LINE.
7. CONTRACTOR SHALL NOT SUSPEND EXISTING GAS LINE PIPE MORE THAN 12 FEET WITHOUT SOIL BEDDING OR OTHER SUPPORT APPROVED BY GAS LINE COMPANY.
8. COMPLETE ANY AND ALL ENCROACHMENT AGREEMENTS REQUIRED BY GAS LINE COMPANIES. ABIDE BY ALL CONDITIONS STIPULATED BY GAS LINE COMPANIES.
9. HEAVY EQUIPMENT MUST CROSS PIPELINE ONLY AT CROSSING LOCATIONS APPROVED BY GAS LINE COMPANIES.
10. CARRIER PIPE WITHIN A 200 FT. RADIUS OF GAS LINE SHALL BE BELL-AND-SPIGOT PVC WITH PETROLEUM RESISTANT GASKETS.
11. TRACER WIRE CONTINUITY SHALL BE MAINTAINED ACROSS THE GAS LINE XING.
12. APPROXIMATE DEPTH CALL OUTS ARE MEASURED FROM THE EXISTING GROUND TO THE TOP OF PIPE.
13. ENCASE PIPE JOINTS WITH POLYETHYLENE FOR 100 FEET EACH SIDE OF EXISTING GASOLINE, NATURAL GAS OR OIL LINE. INSTALL PETROLEUM RESISTANT GASKETS, IF APPROPRIATE, IN JOINTS FOR GASOLINE AND OIL LINE CROSSINGS.

PIPELINE CROSSINGS

(1) = STA: 26+98 (APPROX.)
ENTERPRISE MID AMERICA PIPELINE CO. 1-800-203-1347
JOHNNY SANDOVAL - FIELD CONTACT 505-320-1629
GAS PIPELINE (6 5/8" O.D., 3'-7" BURY DEPTH)
SEC-9, T-25-N, R-8-W

(2) = STA: 53+97 (APPROX.)
ENTERPRISE MID AMERICA PIPELINE CO. 1-800-203-1347
JOHNNY SANDOVAL - FIELD CONTACT 505-320-1629
GAS PIPELINE (4 1/2" O.D., 4'-6" BURY DEPTH)
SEC-9, T-25-N, R-8-W

(3) = STA: 147+74 (APPROX.)
ENTERPRISE MID AMERICA PIPELINE CO. 1-800-203-1347
JOHNNY SANDOVAL - FIELD CONTACT 505-320-1629
GAS PIPELINE (4 1/2" O.D., 2'-4" BURY DEPTH)
SEC-18, T-25-N, R-8-W

(4) = STA: 168+54 (APPROX.)
ENTERPRISE MID AMERICA PIPELINE CO. 1-800-203-1347
JOHNNY SANDOVAL - FIELD CONTACT 505-320-1629
GAS PIPELINE (4 1/2" O.D., 2'-8" BURY DEPTH)
SEC-18, T-25-N, R-8-W

(5) = STA: 198+66 (APPROX.)
WILLIAMS SERVICES 505-632-4632
CHRISTOPHER LUCERO - FIELD CONTACT 505-632-4463
GAS PIPELINE (8" O.D. STEEL, 4'-10" BURY DEPTH)
SEC-18, T-25-N, R-8-W

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL — TITLE

FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

GAS LINE CROSSING DETAILS

USBR-DWG-NMBR
SHEET DT-5

Draft
Not For Distribution
For Internal Use Only

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
atw

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Pipeline X-ings.dwg

FOR OFFICIAL USE ONLY

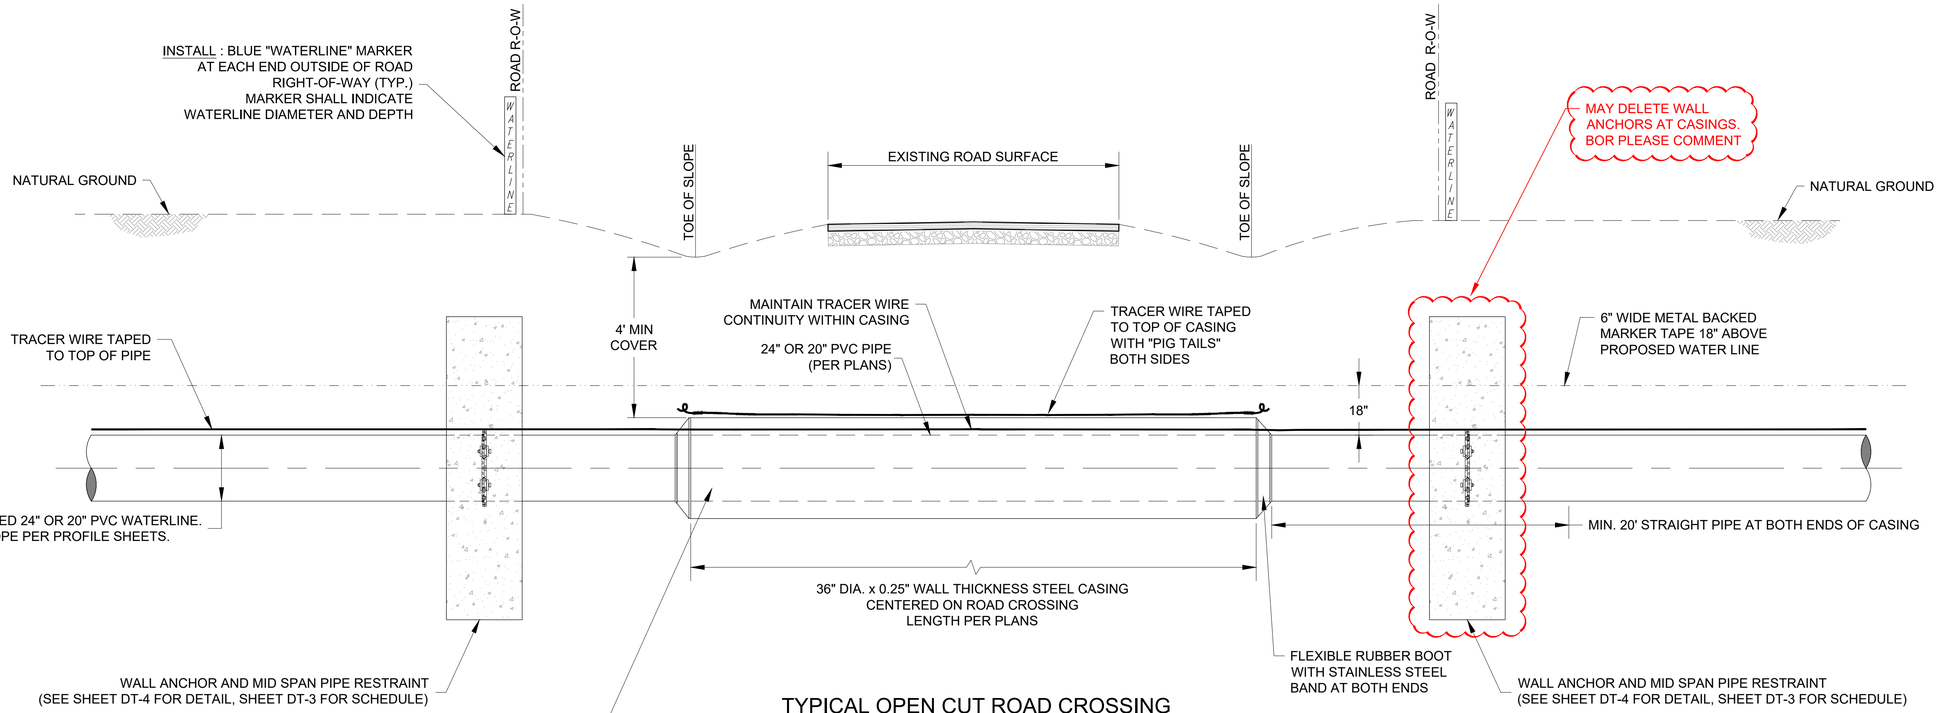

TYPICAL OPEN CUT ROAD CROSSING

NOT TO SCALE

CONSTRUCTION NOTES:

1. EXCAVATIONS OUTSIDE THE ROADWAY FORESLOPES SHALL BE COMPACTED AS SPECIFIED IN THE CONSTRUCTION DOCUMENTS. EXCAVATION WITHIN THE TOE OF THE FORESLOPES SHALL BE COMPACTED TO 95% MAXIMUM DRY DENSITY (STANDARD PROCTOR).
2. APPLY CATHODIC PROTECTION TO ALL BURIED METALLIC CASINGS LOCATED WITHIN CORROSIVE SOIL ZONES, AS DESIGNATED IN THE PLANS AND/OR SPECIFICATIONS.
3. ALL METALLIC PIPE, WHETHER CATHODICALLY PROTECTED OR NOT, SHALL BE PROVIDED WITH CORROSION MONITORING SYSTEMS.
4. TRACER WIRE CONTINUITY SHALL BE MAINTAINED ACROSS THE ROAD XING.
5. FOR MINIMUM PVC PIPE THRUST BLOCKING REQUIREMENTS ON EACH SIDE OF CASING, SEE SCHEDULE SHEET DT-4.
6. FOR SAN JUAN COUNTY ROADS, ADHERE TO ANY ADDITIONAL CROSSING PERMIT REQUIREMENTS.

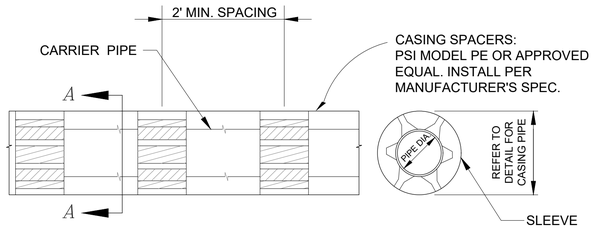

PIPE CASING DETAIL

NOT TO SCALE

SECTION A-A

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — ADMIN APPROVAL — TITLE
FARMINGTON, NM — 2017-06-19

REACH 21 PIPELINE

ROAD CROSSING DETAILS

USBR-DWG-NMBR

SHEET DT-6

For Internal Use Only
Draft
Not For Distribution

DATE AND TIME PLOTTED 6/19/17
PLOTTED BY atrv

CAD SYSTEM AUTOCAD
CAD FILENAME Reach 21 Pipeline X-ings.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

KEYED NOTES - PIPELINE BUTTERFLY VALVE

Item No.	Description
1	24" (SHOWN) OR 20" FL x FL BUTTERFLY VALVE W/ MANUAL BURIED SERVICE ACTUATOR AWWA C504, CLASS 150
2	4" FL x MJ GATE VALVE, 250 psi
3	24" x 6" (SHOWN) OR 20" x 6" D.I. REDUCING TEE, FLANGED, 250 psi
4	24" (SHOWN) OR 20" MJ FLANGE ADAPTER, FBE COATED, W/ SS 304 BOLTS, MEGAFLANGE SERIES 2100, OAE, 235 psi
5	CAST IRON SLIP TYPE VALVE BOX WITH LOCKABLE COVER
6	9" O.D. STAINLESS STEEL ORIFICE PLATE TO MATCH 4" FLANGE (SEE DETAIL / TABLE THIS SHEET)
7	4" D.I. 90° ELL, FLANGED, 250 psi
8	4" D.I. SPOOL, FL x PLAIN END, 250 psi
9	18" DIA. HEAVY DUTY, TRAFFIC-RATED METER CAN (PAINTED BLUE) W/ LOCKING COVER AND FORMED CONCRETE COLLAR, (W/ #4 REBAR)
10	2' x 2' x 1' CONCRETE BLOCK, W/ #4 REBAR 10" O.C.E.W. 2", CLR.
11	1' x 1' x 1' CONCRETE BLOCK, W/ #4 REBAR 8" O.C.E.W. 2", CLR.
12	12" x 6" x 6" CONCRETE BLOCK
13	CAST IRON SLIP TYPE VALVE BOX WITH NON LOCKABLE COVER, PAINTED BLUE
14	6" x 4" D.I. REDUCING TEE, FLANGED, 250 psi

NOTES:
1. ALL BURIED METALLIC PIPE, VALVES AND FITTINGS SHALL BE COATED WITH FUSION BONDED EPOXY, INTERIOR AND EXTERIOR. ALL BURIED METALLIC PIPE SHALL ALSO BE COLD-APPLIED TAPE-COATED, PER SPECIFICATIONS.
2. APPLY CATHODIC PROTECTION TO ALL BURIED METALLIC PRESSURE-BEARING COMPONENTS LOCATED WITHIN CORROSIVE SOIL ZONES, AS DESIGNATED IN THE PLANS AND/OR SPECIFICATIONS.
3. FLANGES SHALL BE ANSI CLASS 125 (IRON).
4. CONTRACTOR SHALL SCRIBE ALL CONCRETE COLLARS PER DETAIL THIS SHEET. CONCRETE SHALL BE SCRIBED PRIOR TO CURING, OR ETCHED AFTER CURING WITH 4" GRINDER.
5. CONTRACTOR SHALL LEAVE A 3/4" MIN. TO 1" MAX. GAP BETWEEN PVC PIPE END AND FLANGE FACE INSIDE MJ FLANGE ADAPTER, TO FACILITATE FUTURE DISASSEMBLY.
6. ALL MATERIALS RATED TO AT LEAST 235 psi UNLESS OTHERWISE NOTED.
7. WRAP BOTTOM OF BOX IN PLASTIC TO PREVENT DIRT FROM ENTERING.

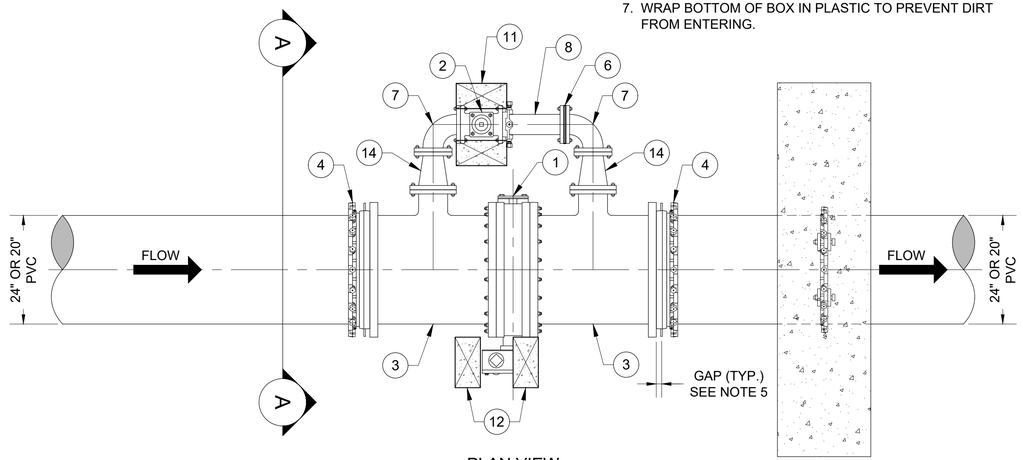

PLAN VIEW

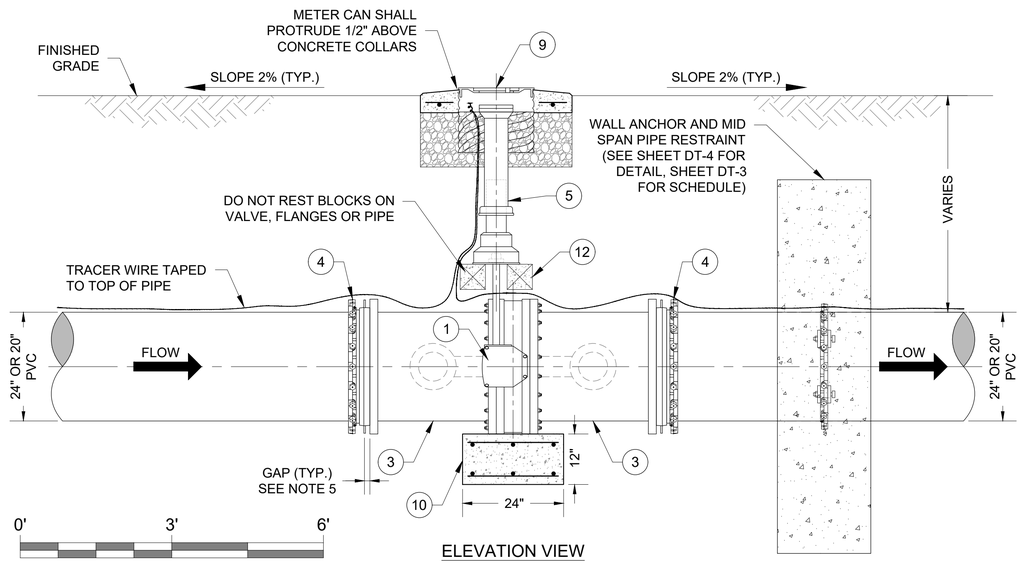

ELEVATION VIEW

TYPICAL 24" (SHOWN) OR 20" PIPELINE BUTTERFLY VALVE ASSEMBLY WITH BYPASS

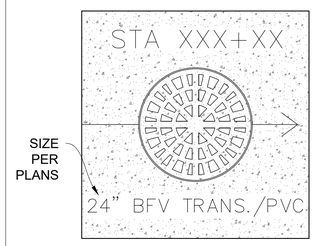

CONCRETE COLLAR ETCHING DETAIL
NOT TO SCALE

SUMMARY OF BUTTERFLY VALVE ORIFICE PLATE DRILLING

Station	Elevation	Orifice Plate # of Holes
25+25	6619	TBD
99+19	6723	TBD
149+55	6840	TBD
199+14	6891	TBD

NOTE:
ALL HOLES TO BE DRILLED INSIDE 4" FLOW AREA OF PLATE.



THE DOWNSTREAM EDGES OF THE 1/2" DIA. HOLES SHALL BE BEVELED AS SHOWN



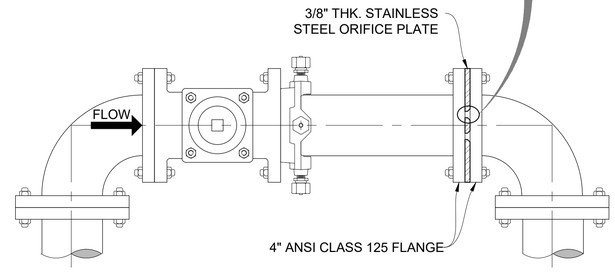

ORIFICE PLATE ASSEMBLY
NOT TO SCALE

NOTE:
BRING TRACER WIRE INTO METER CAN NEXT TO VALVE BOX, COIL 18" OF TRACER WIRE INSIDE CAN

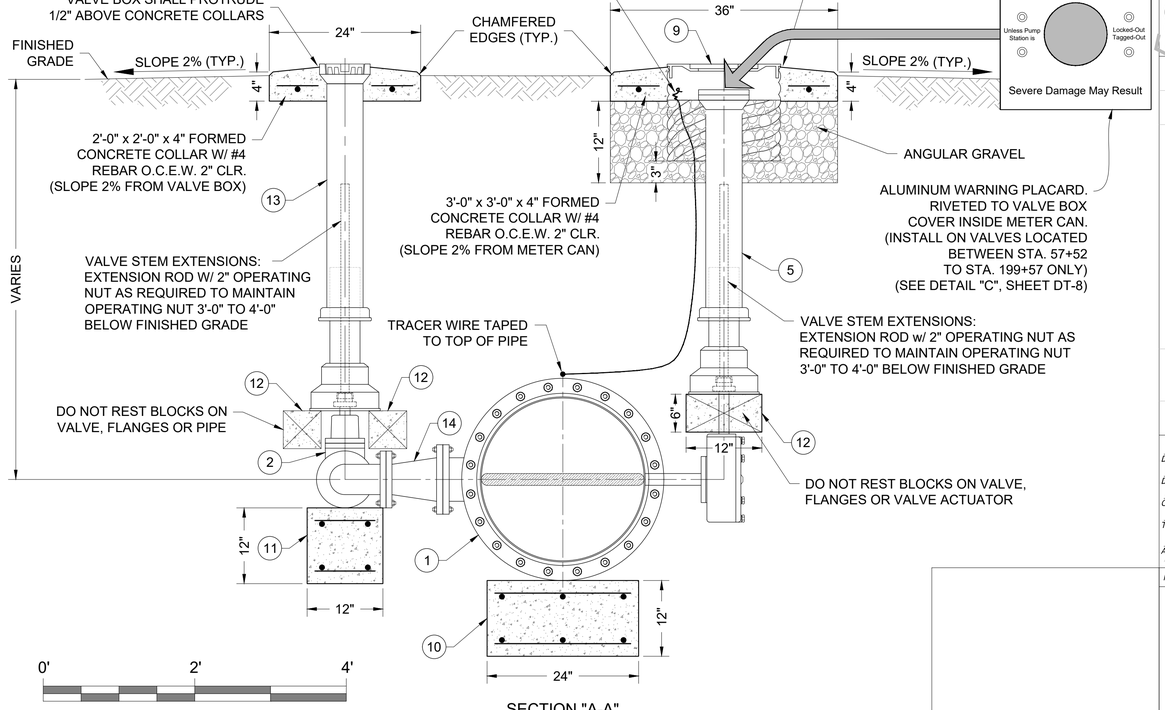

SECTION "A-A"

TYPICAL 24" (SHOWN) OR 20" PIPELINE BUTTERFLY VALVE ASSEMBLY WITH BY-PASS

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Informational Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED
FORM APPROVAL — TITLE
FARMINGTON, NM — 2017-06-19

REACH 21 PIPELINE

PIPELINE BUTTERFLY VALVE DETAILS

USBR-DWG-NMBR
SHEET DT-7

DATE AND TIME PLOTTED
6/8/2017
PLOTTED BY
atrr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 BV Detail.dwg

FOR OFFICIAL USE ONLY

NOTES:

1. CONTRACTOR SHALL SCRIBE ALL CONCRETE VALVE COLLARS, PER DETAILS "A" & "B" THIS SHEET. CONCRETE SHALL BE SCRIBED PRIOR TO CURING OR ETCHED AFTER CURING WITH 4" GRINDER.
2. AFFIX WARNING PLACARD TO VALVE BOX COVER INSIDE METER CAN FOR ALL MAINLINE VALVES.
3. AFFIX ALUMINUM VALVE IDENTIFICATION PLATES TO ALL SITE VALVE COLLARS, PER DETAILS "B" & "C" THIS SHEET. REFER TO SHEET C-16 FOR VALVE-SPECIFIC LABELING.
4. ALL MATERIALS SHALL BE WORKING PRESSURE RATED TO AT LEAST THE PRESSURE RATING OF THE PIPE, UNLESS OTHERWISE NOTED.
5. ALL BURIED VALVES SHALL BE COATED WITH FUSION BONDED EPOXY, INTERIOR AND EXTERIOR.
6. NOTE VALVE ENDS SHALL BE FL x FL, MJ x MJ, OR FL x MJ AS INDICATED ON PLANS.
7. APPLY CATHODIC PROTECTION TO ALL BURIED METALLIC PRESSURE-BEARING COMPONENTS LOCATED WITHIN CORROSIVE SOIL ZONES, AS DESIGNATED IN THE PLANS AND/OR SPECIFICATIONS.
8. FLANGES SHALL BE ANSI CLASS 125 (IRON).

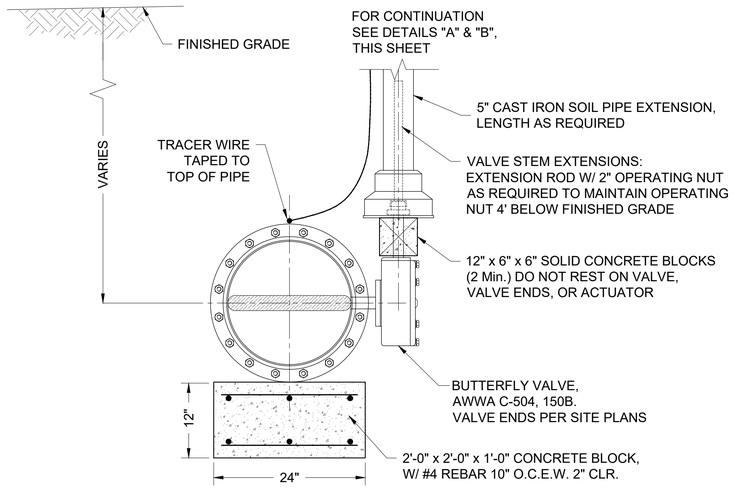

END VIEW

TYPICAL SITE BUTTERFLY VALVE DETAIL WITHOUT BYPASS

NOT TO SCALE

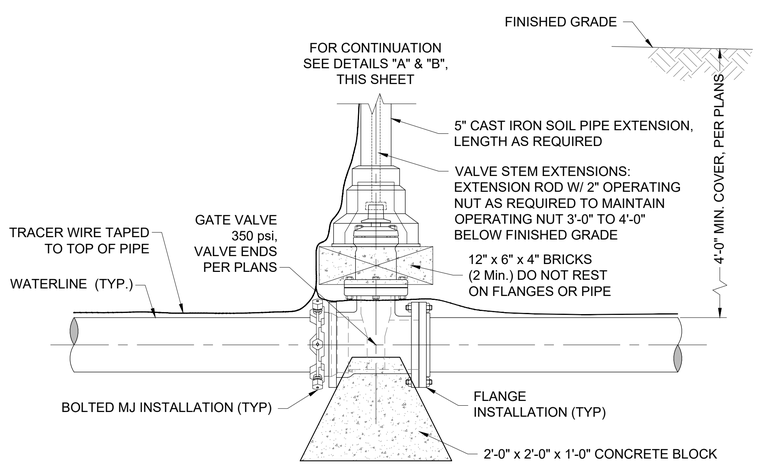

ELEVATION VIEW

TYPICAL GATE VALVE DETAIL

NOT TO SCALE

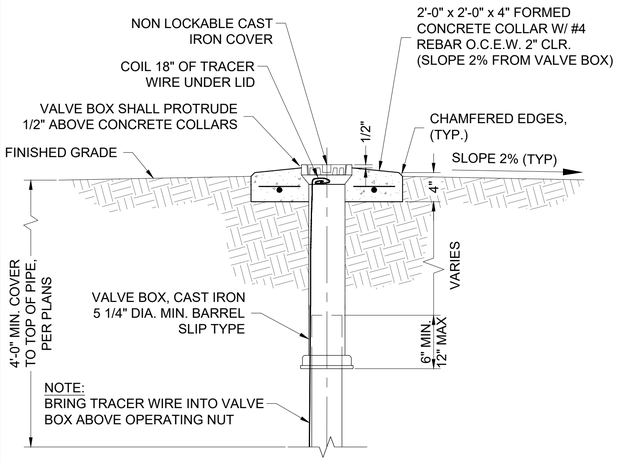

ELEVATION VIEW

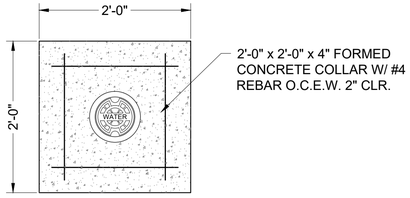

PLAN VIEW - REBAR

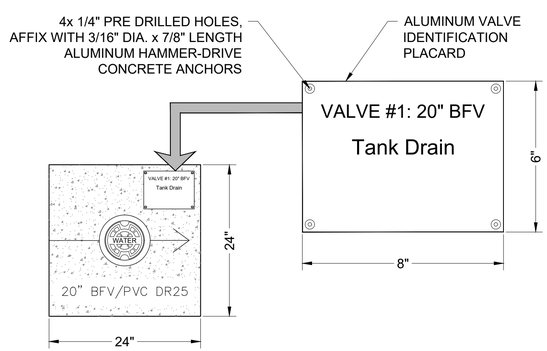

PLAN VIEW - SURFACE

DETAIL "A" TYPICAL SITE VALVE BOX, COLLAR AND VALVE ID PLACARD DETAIL, USE WITHOUT WARNING PLACARD

NOT TO SCALE

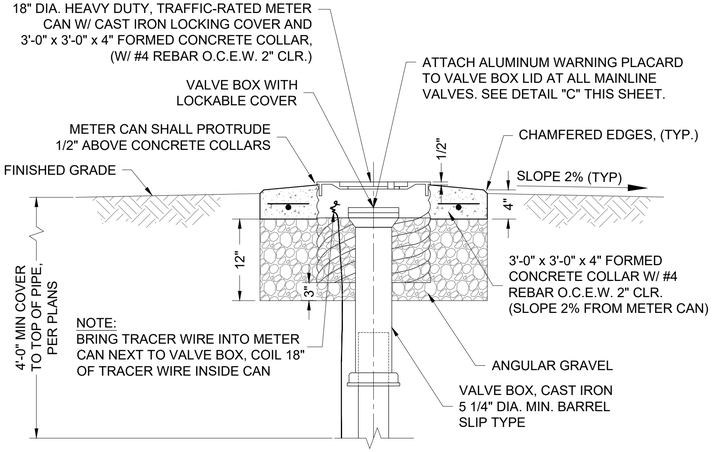

ELEVATION VIEW



PLAN VIEW - REBAR



PLAN VIEW - SURFACE SITE VALVE COLLAR

DETAIL "B" TYPICAL SITE VALVE BOX, COLLAR AND VALVE ID PLACARD DETAIL - USE WITH WARNING PLACARD

NOT TO SCALE



WARNING PLACARD FOR MAINLINE VALVES

NOTE:
INSTALL ON VALVES LOCATED BETWEEN STA. 57+52 TO STA. 199+57 ONLY



PLAN VIEW

DETAIL "C" TYPICAL WARNING PLACARD DETAIL

NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — ADMIN APPROVAL — TITLE
FARMINGTON, NM — 2017-06-19

REACH 21 PIPELINE

SITE BUTTERFLY & GATE VALVE DETAILS

USBR-DWG-NMBR
SHEET DT-8

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
atav

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 BV Detail.dwg

FOR OFFICIAL USE ONLY

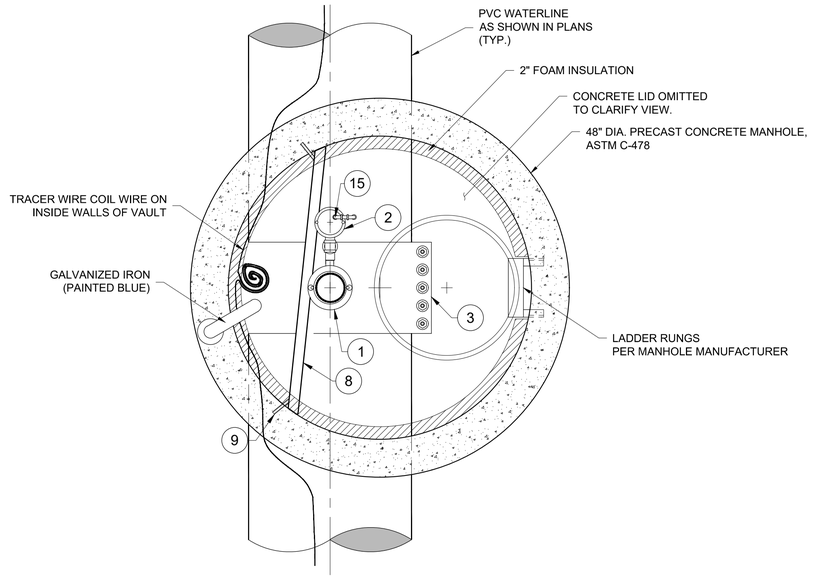

PLAN VIEW

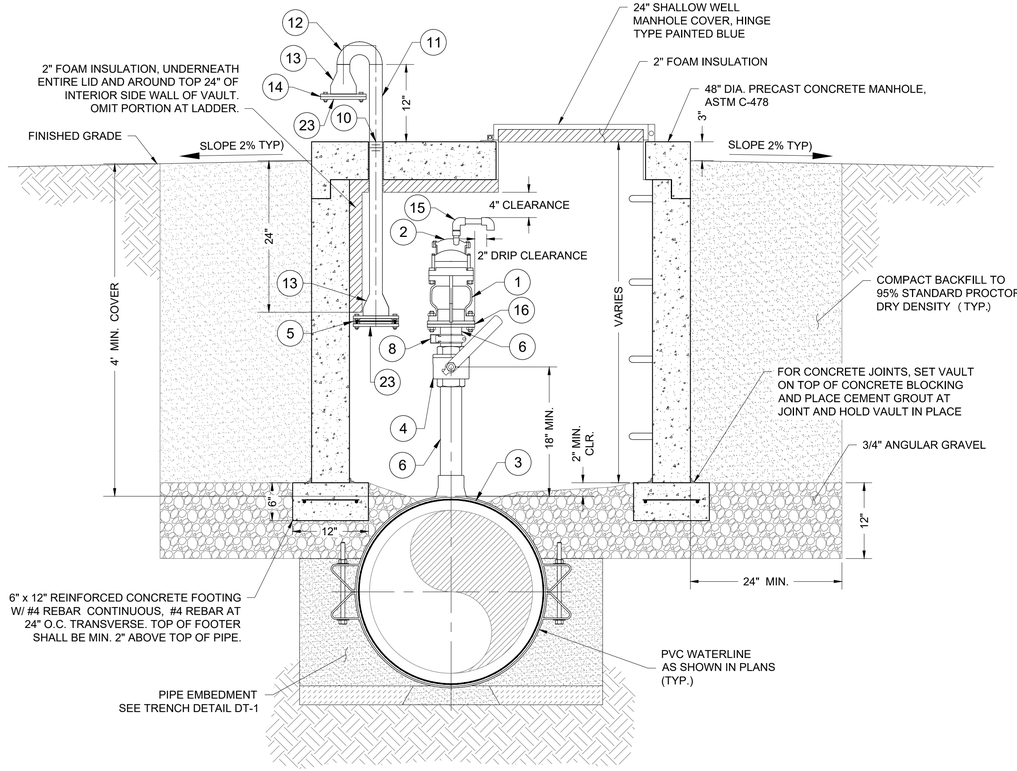

ELEVATION VIEW

VACUUM RELIEF VALVE DETAIL

0' 1' 2'

KEYED NOTES - 3" VACUUM RELIEF WITH 1" AIR RELEASE VALVE

Item No.	Description
1	3" VALMATIC MODEL NO. 1803VB.3XF VACUUM RELIEF VALVE, WITH SCREENED HOOD, 200 psi
2	1" VALMATIC MODEL NO. 25.6 SV, 300 psi (SHOWN) OR 38 SV, 150 psi AIR RELEASE VALVE
3	24" x 3" (SHOWN) OR 20" x 3" TAPPING SLEEVE, FNPT, 250 psi.
4	3" BALL VALVE, STAINLESS STEEL, NPT, 250 psi
5	4" FREEZE PREVENTION DRAFT DAMPENER. VALMATIC FROSTSAFE MODEL # 1504, OAE
6	3" NIPPLE, SS 304, NPT
7	GALVANIZED PERFORATED METAL HANGER STRAP
8	1 5/8" STAINLESS STEEL UNI-STRUT
9	2" ANCHOR BOLTS IN EPOXY
10	VENT PIPE W/ EMBEDDED 2" GALVANIZED IRON THREADED COUPLING (PIPE EXTERIOR PAINTED BLUE)
11	2" STD. GALVANIZED IRON PIPE THREADED AT ONE END (PIPE EXTERIOR PAINTED BLUE)
12	2" GALVANIZED IRON LONG RADIUS WELDED RETURN (PIPE EXTERIOR PAINTED BLUE)
13	4" x 2" GALVANIZED IRON WELDED REDUCER (PIPE EXTERIOR PAINTED BLUE)
14	VARMINT SCREEN
15	1/2" DOWN SPOUT W/ SCREEN, SCHEDULE 80 PVC
16	3" FLANGE (THREADED), SS 304
17	1" NIPPLE, SS 304, NPT
18	1" BALL VALVE, SS 304, NPT, 250 psi
19	1" TEE, SS 304, NPT, SCHEDULE 40
20	1" x 1/2" REDUCING BUSHING, SS 304, NPT
21	1/2" BALL VALVE, SS 304, NPT, 250 psi
22	1/2" PIPE, SS 304, NPT
23	4" GALVANIZED IRON COMPANION FLANGE, DRILLED/TAPPED TO FIT

NOTES:

1. ALL FLANGES SHALL BE ANSI CLASS 150 (STEEL) OR ANSI CLASS 125 (IRON).
2. ALL NON-STAINLESS METALLIC PIPE, VALVES AND FITTINGS SHALL BE FBE-COATED, INTERIOR AND EXTERIOR. ALL NON-STAINLESS METALLIC PIPE IN CONTACT WITH SOIL SHALL ALSO BE COLD APPLIED TAPE-COATED PER AWWA C209.
3. AIR VALVE TO BE LOCATED IN FIELD BY ENGINEER.
4. COIL TRACER WIRE ON INSIDE WALLS OF VAULT.
5. ALL STAINLESS STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL.
6. REMOVE ALL PVC CUTTINGS FROM INSIDE MAIN LINE AFTER TAPPING.
7. CONTRACTOR SHALL ETCH ALL VACUUM RELIEF VAULT LIDS WITH 4" GRINDER AS FOLLOWS: PIPE STATION, VALVE SIZE, "ARV, VB", PIPE SIZE AND MATERIAL, WITH DIRECTIONAL ARROWS.
8. DO NOT TAP RESTRAINED PIPE.
9. APPLY CATHODIC PROTECTION TO ALL BURIED NON-STAINLESS METALLIC COMPONENTS LOCATED WITHIN CORROSIVE SOIL ZONES, AS DESIGNATED IN THE PLANS AND/OR SPECIFICATIONS.
10. ALL MATERIALS RATED TO AT LEAST 150 psi UNLESS OTHERWISE NOTED.

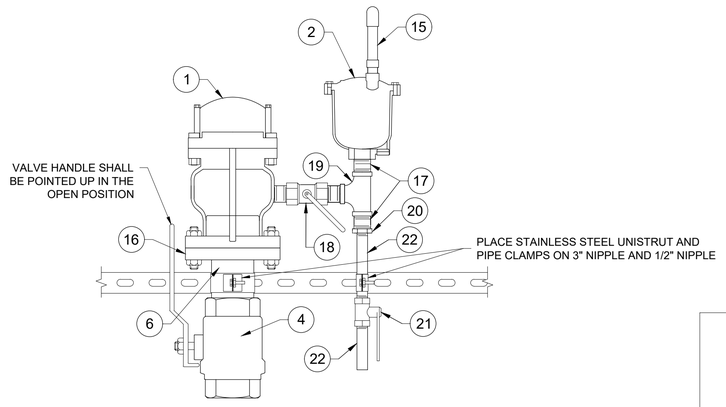

FRONT ELEVATION VIEW

VACUUM RELIEF VALVE DETAIL

N.T.S.

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

SAFETY ALWAYS THINK

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — SIGN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

3-INCH VACUUM RELIEF
WITH 1-INCH AIR
RELEASE VALVE DETAIL

USBR-DWG-NMBR
SHEET DT-9

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
aav

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Air Valve Details.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY



NOTE:
CONCRETE SHALL BE SCRIBED PRIOR TO CURING OR ETCHED AFTER CURING WITH A 4" GRINDER.

COLLAR SCRIBING DETAIL
NOT TO SCALE

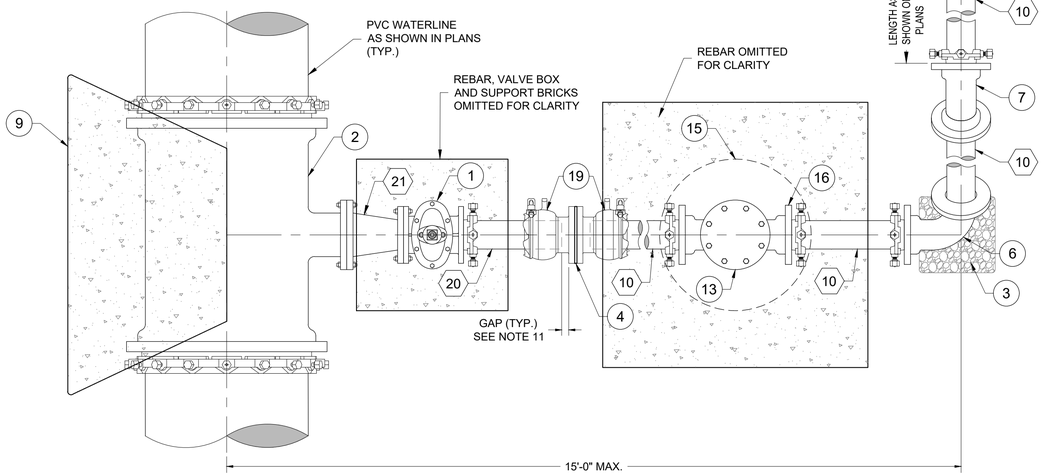

PLAN VIEW

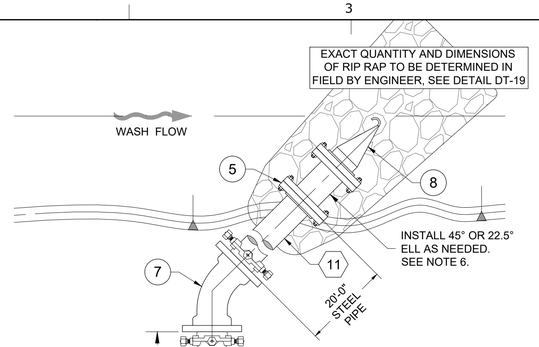

KEYED NOTES - 4" FLUSH VALVE WITH RISER

Item No.	Description
1	4" GATE VALVE, FL x MJ, 350 psi (SEE TYPICAL GATE VALVE DETAIL, SHEET DT-8)
2	24" x 6" (SHOWN) OR 20" x 6" MJ x FL REDUCING TEE, D.I., 250 psi
3	ROUNDED ROCK (2 CU. YD.)
4	3/8" THK. STAINLESS STEEL ORIFICE PLATE, ANSI CLASS 150 DRILLING PATTERN (SEE DETAIL THIS SHEET FOR ORIFICE SIZE)
5	4" STEEL FLANGE, FLAT FACED, ANSI CLASS 150
6	4" 90° MJ ELL, D.I., 350 psi (ROTATED 45° TOWARDS FINISHED GRADE)
7	4" 45° MJ ELL, D.I., 350 psi
8	4" FLANGED RUBBER CHECK VALVE, ANSI CLASS 150
9	2'-0" x 2'-0" THRUST BLOCK
10	4" PVC PIPE, DR18
11	4" STEEL PIPE, STANDARD WALL
12	VALVE BOX SLIP TYPE WITH NON LOCKABLE CAST IRON COVER (SEE TYPICAL GATE VALVE DETAIL, SHEET DT-8)
13	6" BLIND FLANGE, FLAT FACED, ANSI CLASS 150
14	CONCRETE BLOCK SUPPORT, (SEE TYPICAL GATE VALVE DETAIL, SHEET DT-8)
15	24" DIA. HEAVY DUTY, TRAFFIC-RATED METER CAN W/ 20 3/8" Ø OPENING WITH CAST IRON LOCKING COVER AND FORMED CONCRETE COLLAR, (W/ #4 REBAR), DASHED FOR CLARITY
16	4" x 4" x 6" MJ BULLHEAD TEE OR 4" x 4" x 4" MJ TEE W/ 6" x 4" MJ REDUCER, D.I., 350 psi
17	6" PVC PIPE, DR18
18	6" ANSI CLASS 125 FLANGE ADAPTER, MEGAFLANGE SERIES 2100 W/ TEE BOLTS POINTED UP, OAE, 235 psi
19	4" RESTRAINED ANSI CLASS 125 FLANGE COUPLING, ROMAC ALPHA SERIES, OAE, RATED TO PRESSURE RATING OF PIPE
20	4" x 1'-6" LENGTH FL x PLAIN END SPOOL, D.I., ANSI CLASS 250 FLANGE, 350 psi WP
21	6" x 4" FL x FL REDUCER, D.I., 250 psi

NOTES:
1. ALL NON STAINLESS METALLIC PIPE, VALVES AND FITTINGS SHALL BE FBE-COATED, INTERIOR AND EXTERIOR. ALL NON STAINLESS METALLIC PIPE IN CONTACT WITH SOIL SHALL ALSO BE COLD APPLIED TAPE-COATED PER SPECIFICATIONS.
2. ORIENTATION AND LOCATION OF OUTLET TO BE DETERMINED IN FIELD BY ENGINEER.
3. APPLY CATHODIC PROTECTION TO ALL BURIED METALLIC WATER-CARRYING COMPONENTS LOCATED WITHIN CORROSIVE SOIL ZONES, AS DESIGNATED IN THE PLANS AND/OR SPECIFICATIONS.
4. ALL NON STAINLESS STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL. ALL STAINLESS STEEL PIPE AND FITTINGS SHALL HAVE A WORKING PRESSURE OF AT LEAST 350 psi, UNLESS OTHERWISE NOTED.
5. ALL COMPONENTS SHALL REMAIN WITHIN THE PERMANENT RIGHT-OF-WAY. 4" PVC PIPING PARALLEL TO MAIN LINE SHALL BE ANGLED SLIGHTLY TOWARD MAIN LINE, AS NEEDED, SO THAT RUBBER CHECK VALVE REMAINS WITHIN PERMANENT RIGHT-OF-WAY.
6. INSTALL 22.5° OR 45° ELL AT PIPE OUTLET AS NEEDED TO DIRECT WATER FLOW INTO THE RIPRAP. DO NOT ALLOW WATER OUTFLOW TO HIT UNARMORED SOIL.
7. ALL MATERIALS RATED TO AT LEAST MAINLINE PIPE PRESSURE RATING, UNLESS OTHERWISE NOTED.
8. SEE TABLE THIS SHEET FOR ORIFICE PLATE DRILLING.
9. MECHANICAL JOINTS OMITTED FROM ISOMETRIC VIEWS FOR CLARITY.
10. STATIONS OF TEES AND HEIGHT OF RISERS FOR FLUSH VALVES SHOWN ON PLAN AND PROFILE SHEETS ARE APPROXIMATE. CONTRACTOR SHALL ENSURE FLUSH DRAIN LINE OUTFALLS HAVE MINIMUM REQUIRED CLEARANCE TO RIPRAP AT WASH BOTTOMS. CONTRACTOR MAY ADJUST TEE LOCATIONS AND/OR RISER HEIGHTS AS NEEDED TO PROVIDE ADEQUATE OUTFALL HEIGHT, DRAIN PIPE SLOPE, AND COVER.
11. CONTRACTOR SHALL LEAVE A 3/4" MIN. TO 1" MAX. GAP BETWEEN PIPE END AND FLANGE FACE INSIDE MJ FLANGE COUPLING, TO FACILITATE FUTURE DISASSEMBLY.

SUMMARY OF FLUSH VALVE ORIFICE PLATE DRILLING

Station	Elevation	Orifice Plate Ø of Hole (Inches)
46+38±	6601	TBD
199+00±	6891	TBD

NOTES:
HOLE TO BE DRILLED CENTERED ON THE ORIFICE PLATE.



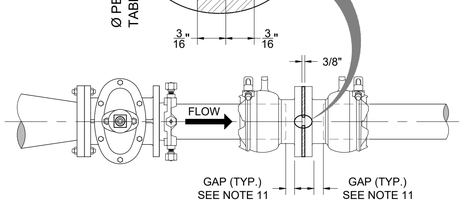

ORIFICE PLATE ASSEMBLY
NOT TO SCALE

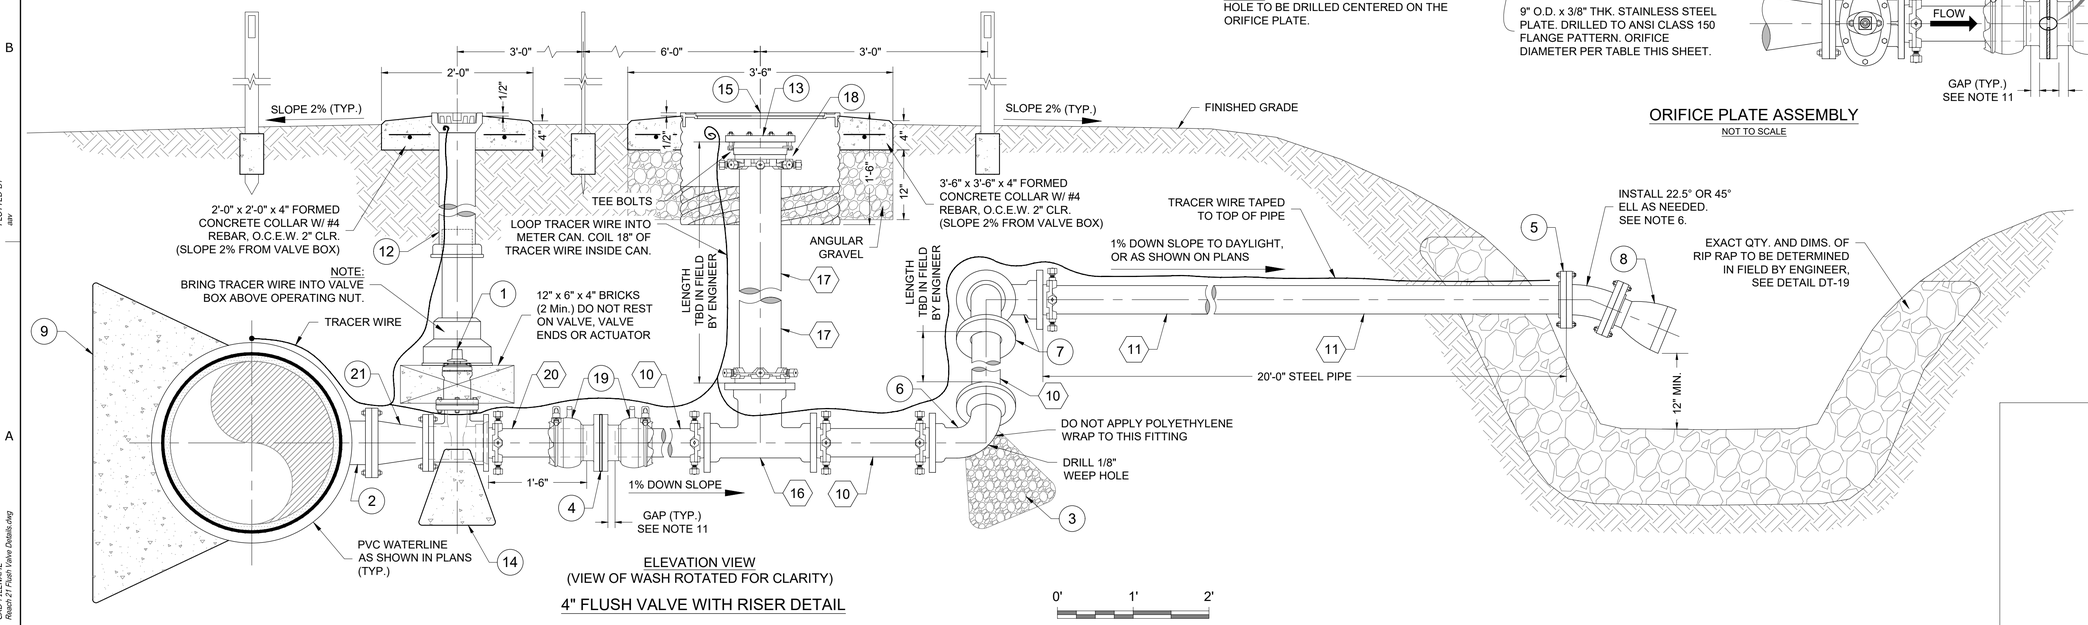

ELEVATION VIEW
(VIEW OF WASH ROTATED FOR CLARITY)

4" FLUSH VALVE WITH RISER DETAIL

0' 1' 2'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

USBR
U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

4-INCH FLUSH VALVE WITH RISER DETAIL

USBR-DWG-NMBR
SHEET DT-10

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
aav

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Flush Valve Details.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

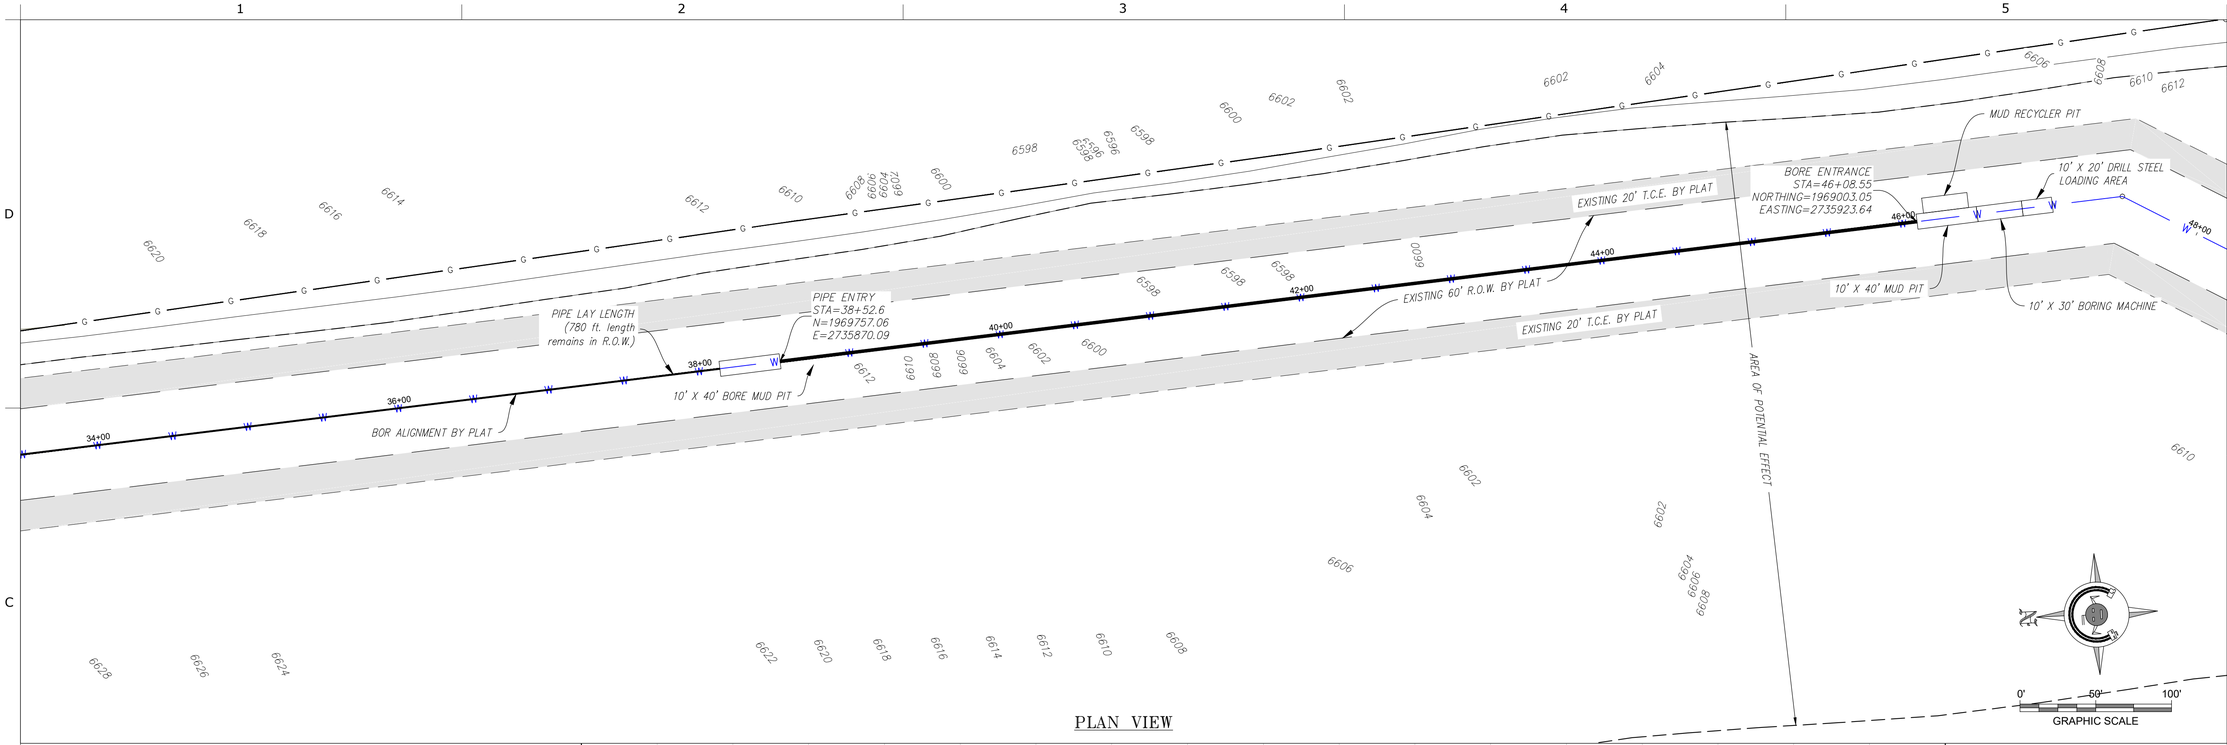

PLAN VIEW

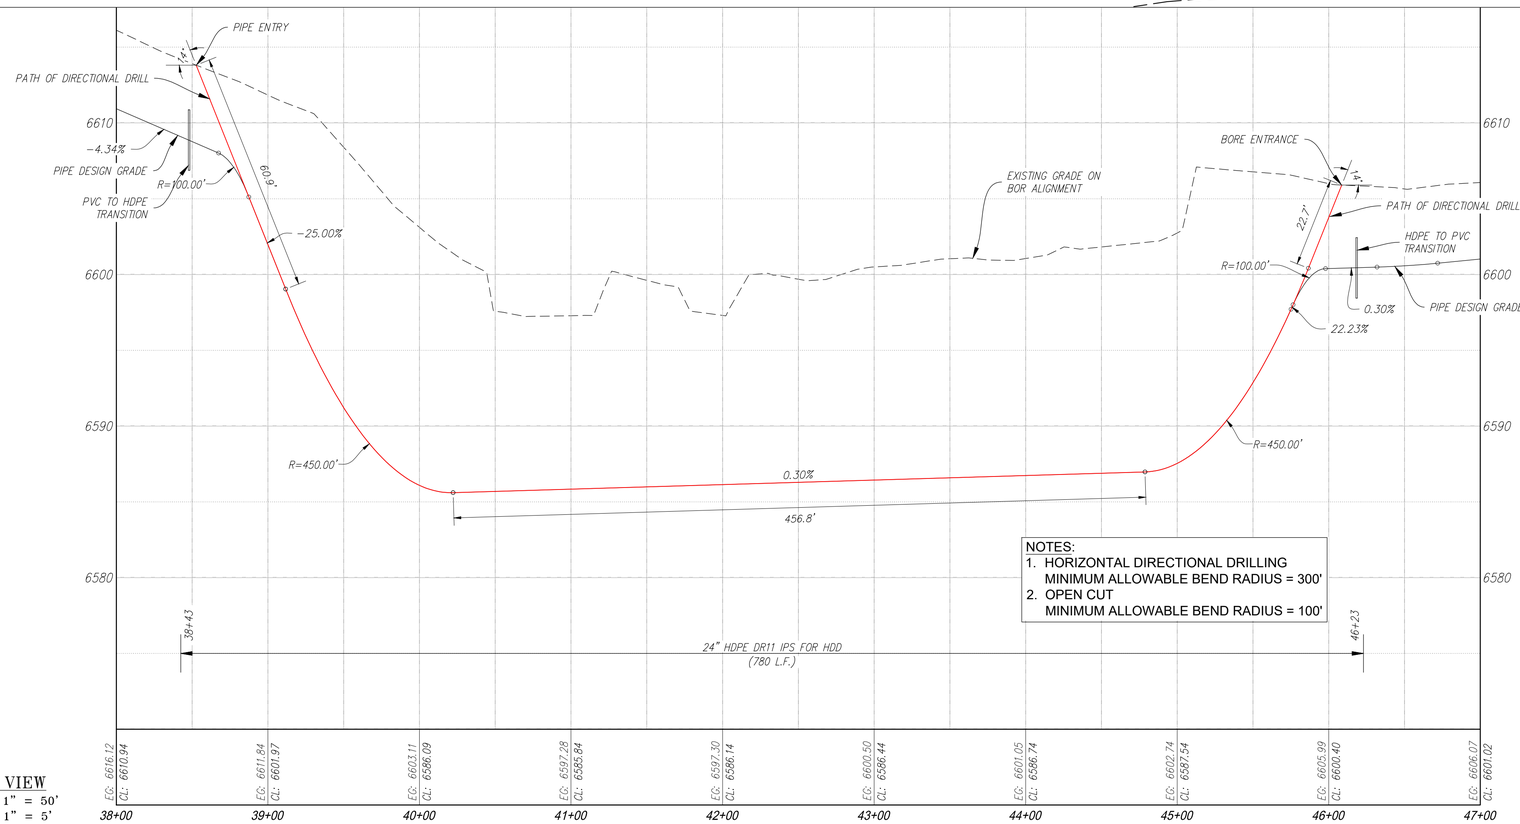

PROFILE VIEW
SCALE: HORIZ. 1" = 50'
SCALE: VERT. 1" = 5'

NOTES:
1. HORIZONTAL DIRECTIONAL DRILLING
   MINIMUM ALLOWABLE BEND RADIUS = 300'
2. OPEN CUT
   MINIMUM ALLOWABLE BEND RADIUS = 100'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental
Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Information Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

WASH CROSSING STA
42+02 PIPELINE HDD
DETAIL

USBR-DWG-NMBR
SHEET DT-11

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atw

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Bore Details.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

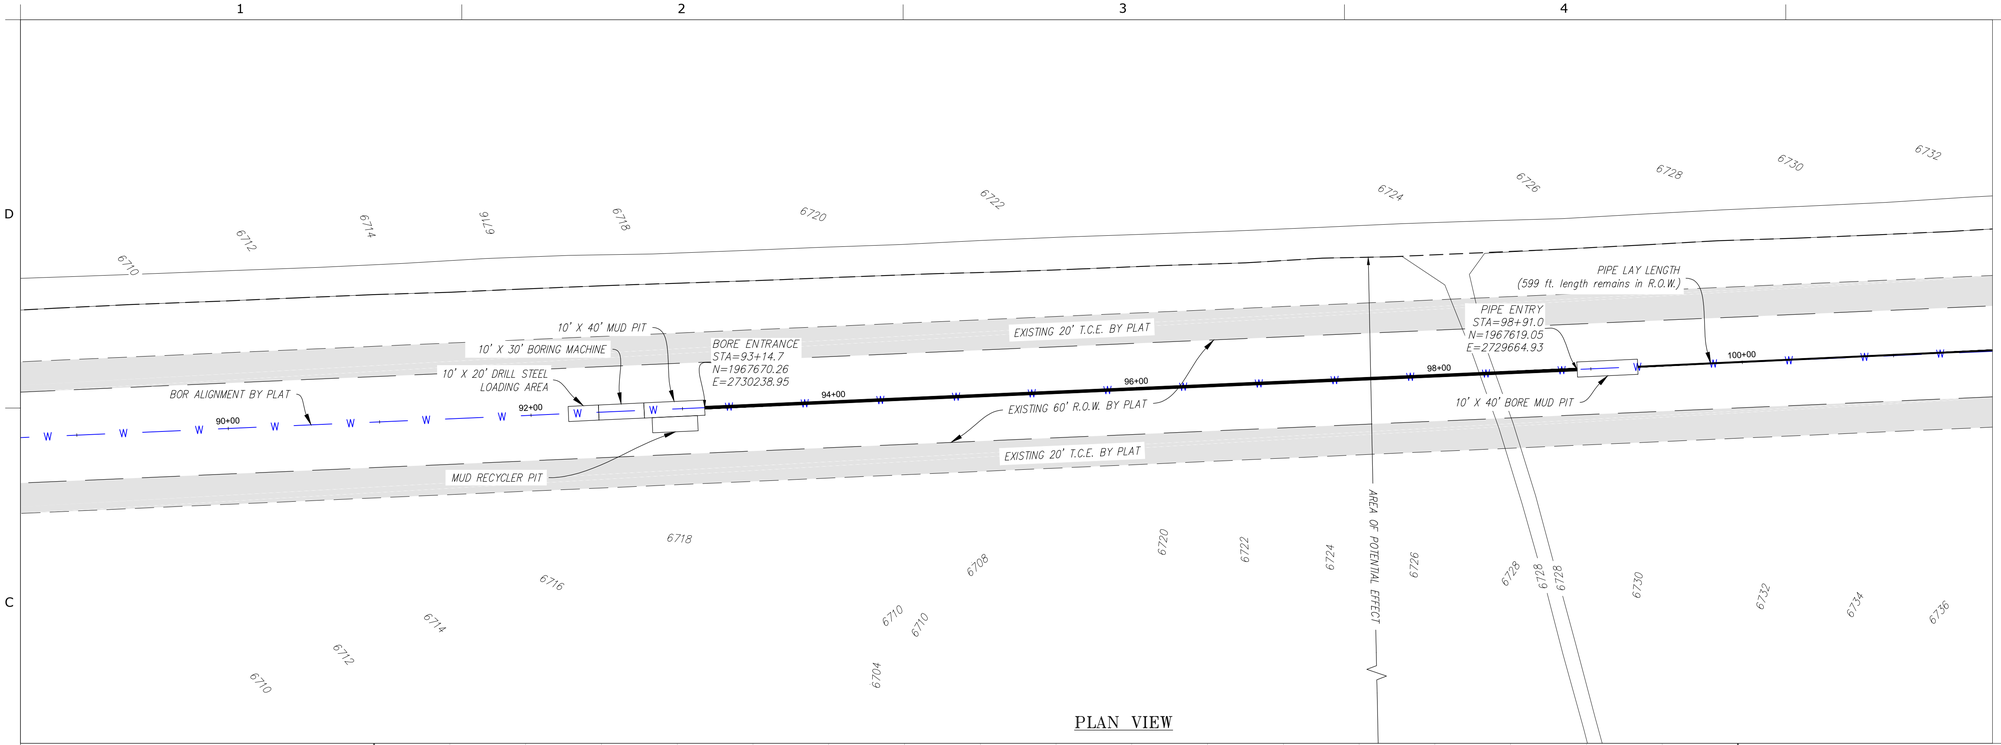

PLAN VIEW

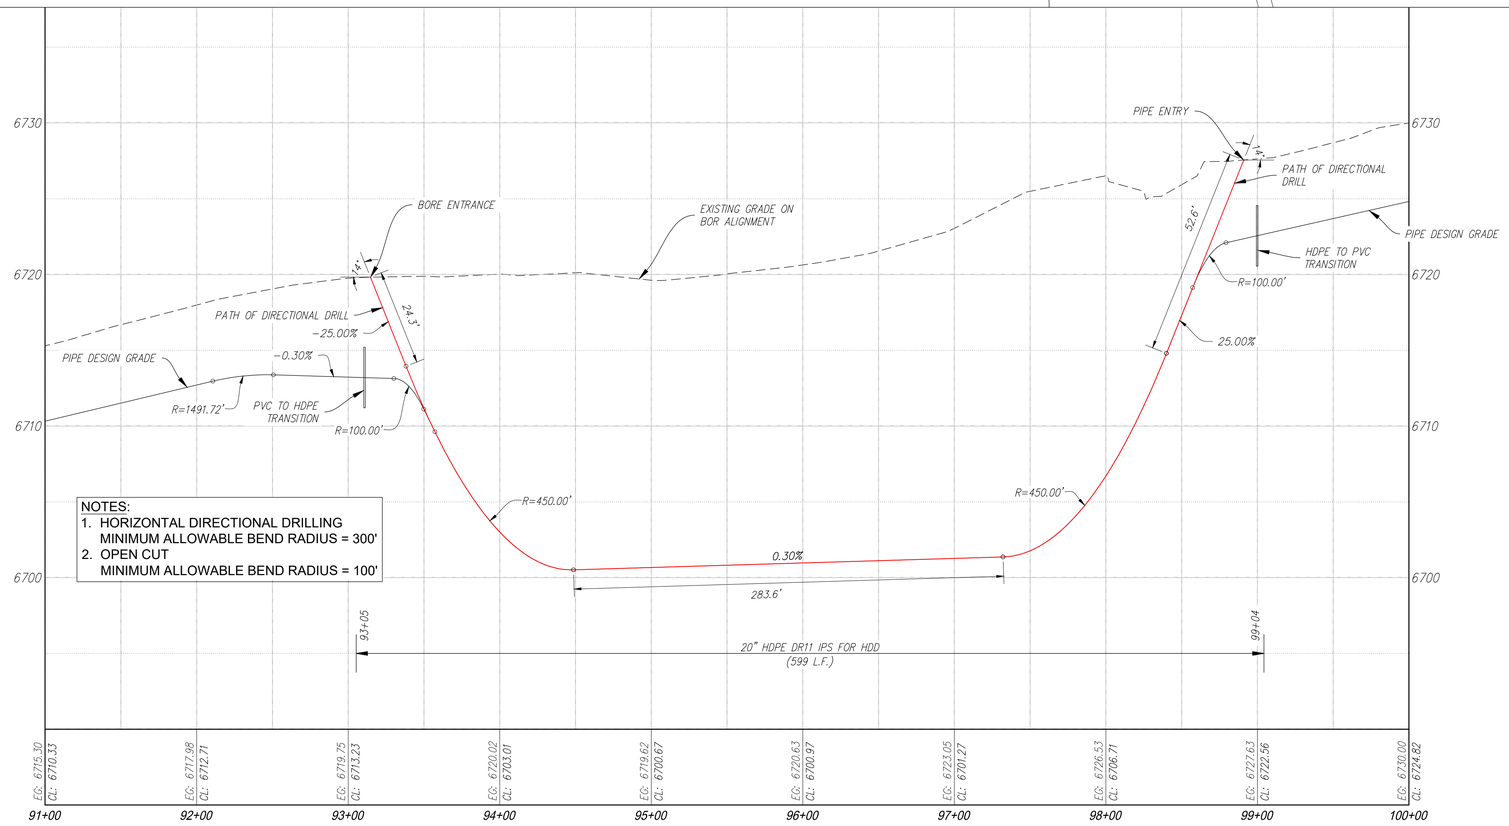

PROFILE VIEW
SCALE: HORIZ. 1" = 50'
SCALE: VERT. 1" = 5'

NOTES:
1. HORIZONTAL DIRECTIONAL DRILLING
   MINIMUM ALLOWABLE BEND RADIUS = 300'
2. OPEN CUT
   MINIMUM ALLOWABLE BEND RADIUS = 100'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

NAVAJO-GALLUP WATER SUPPLY PROJECT
U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NEW MEXICO

CUTTER LATERAL - REACH 21

WATER PIPELINE

Draft
Not For Distribution
For Official Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

WASH CROSSING STA 95+37 PIPELINE HDD DETAIL

USBR-DWG-NMBR
SHEET DT-12

DATE AND TIME PLOTTED
6/19/2017
PLOTTED BY
atm

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Bore Details.dwg

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY

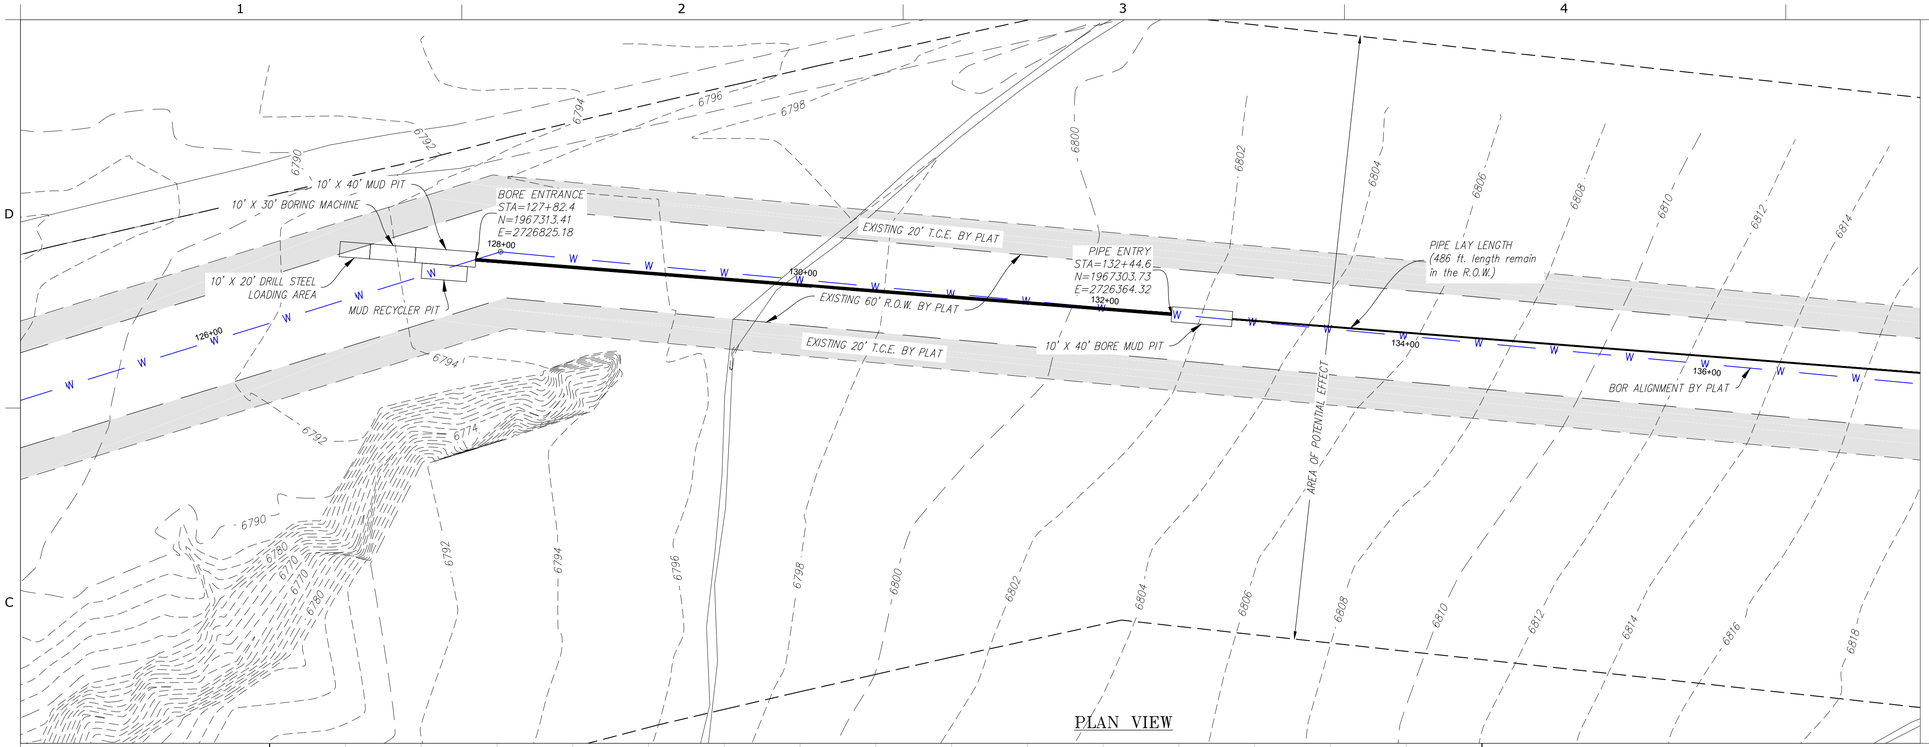

PLAN VIEW



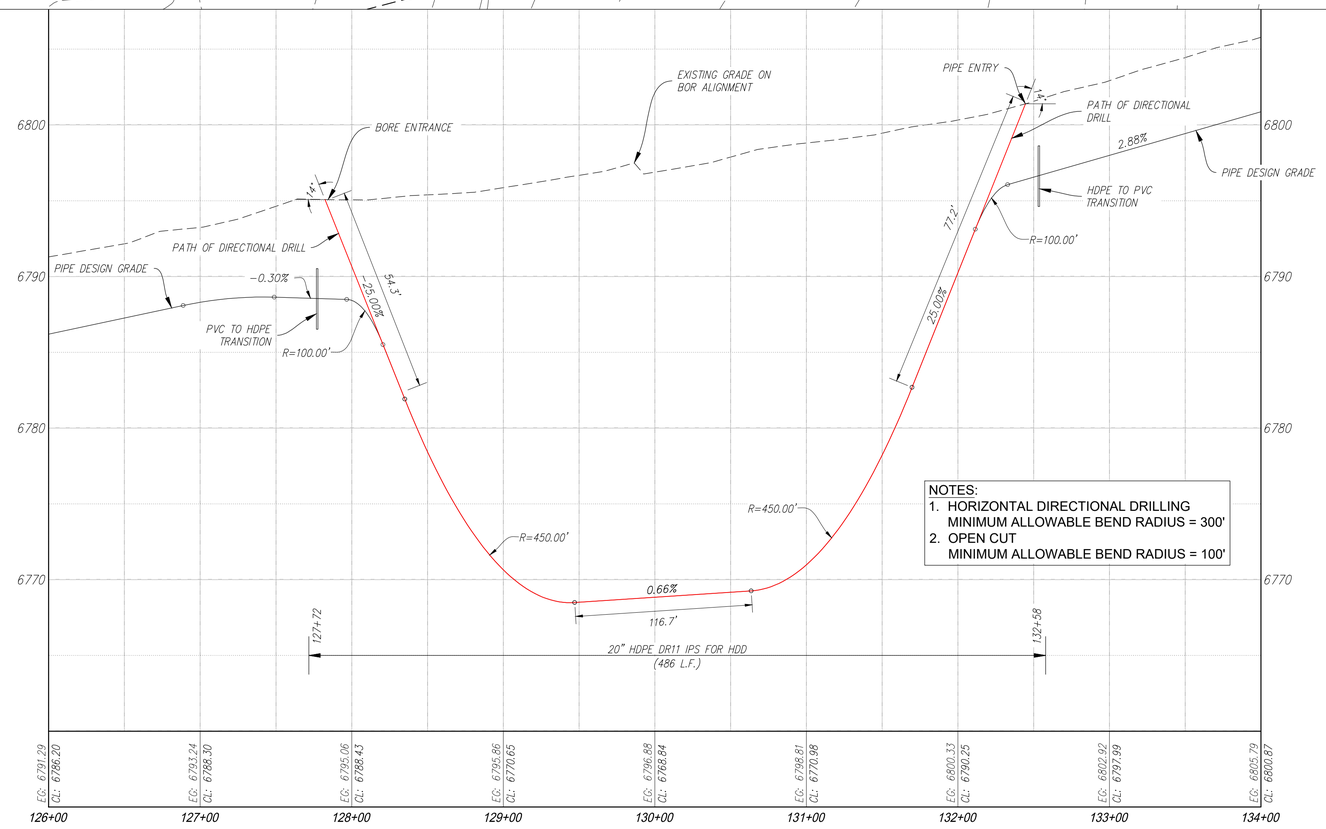

NOTES:
1. HORIZONTAL DIRECTIONAL DRILLING
   MINIMUM ALLOWABLE BEND RADIUS = 300'
2. OPEN CUT
   MINIMUM ALLOWABLE BEND RADIUS = 100'

PROFILE VIEW
SCALE: HORIZ. 1" = 50'
SCALE: VERT. 1" = 5'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Preliminary Draft
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
NAVAJO REGIONAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

WASH CROSSING STA
129+92 PIPELINE HDD
DETAIL

USBR-DWG-NMBR
SHEET DT-13

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
atrr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Bore Details.dwg

FOR OFFICIAL USE ONLY

NOTES:

1. FOUNDATION AND TANK STRUCTURAL DESIGN DRAWINGS AND CALCULATIONS (SEALED BY NEW MEXICO-LICENSED PROFESSIONAL ENGINEER) TO BE PROVIDED BY TANK MANUFACTURER. FOUNDATION SHALL BE EITHER CONCRETE RING OR CONCRETE MAT, BASED ON LICENSED P.E.'s DESIGN AND THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT BY NV5 #444317-2360000.02 DATED JANUARY 9, 2017.
2. IF RINGWALL FOUNDATION IS USED, TANK SHALL BEAR ON A MINIMUM OF 3 FEET OF ENGINEERED FILL, 3 FEET BEYOND RINGWALL, AND RINGWALL FOOTING SHALL BEAR ON A MINIMUM OF 1 FOOT OF ENGINEERED FILL MEASURED AT BOTTOM OF OVER-EXCAVATION. INCREASE DEPTH OF OVER-EXCAVATION, IF NECESSARY, TO ENSURE ENGINEERED FILL BEARS UNIFORMLY ON CUT; DO NOT ALLOW TRANSITION FROM CUT TO FILL TO PASS UNDERNEATH OR WITHIN 5 HORIZONTAL FEET OF TANK. REFER TO GEOTECHNICAL REPORT BY NV5 #444317-2360000.02 DATED JANUARY 9, 2017 FOR SUBSURFACE INFORMATION, OVER EXCAVATION REQUIREMENTS, SUBGRADE PREPARATION, AND STRUCTURAL FILL & COMPACTION. ENGINEERED FILL SHALL BE COMPACTED TO 95% MIN. MODIFIED PROCTOR.
3. IF CONCRETE MAT FOUNDATION IS USED, TANK SHALL BEAR ON A MINIMUM OF 18 INCHES OF ENGINEERED FILL, 3 FEET BEYOND MAT, MEASURED AT BOTTOM OF OVER-EXCAVATION. INCREASE DEPTH OF OVER-EXCAVATION, IF NECESSARY, TO ENSURE ENGINEERED FILL BEARS UNIFORMLY ON CUT; DO NOT ALLOW TRANSITION FROM CUT TO FILL TO PASS UNDERNEATH OR WITHIN 5 HORIZONTAL FEET OF TANK. REFER TO GEOTECHNICAL REPORT BY NV5 #444317-2360000.02 DATED JANUARY 9, 2017 FOR SUBSURFACE INFORMATION, OVER EXCAVATION REQUIREMENTS, SUBGRADE PREPARATION, AND STRUCTURAL FILL & COMPACTION. ENGINEERED FILL SHALL BE COMPACTED TO 95% MIN. MODIFIED PROCTOR.
4. STATED TANK VOLUMES ARE NOMINAL. ACTUAL TANK VOLUMES SHALL BE WITHIN 2% OF THE STATED NOMINAL VALUE.
5. TANK COLOR TO BE TAN.
6. TANK APPURTENANCES SHOWN IN ELEVATION VIEW HAVE BEEN ROTATED INTO VIEW FOR DEPICTION PURPOSES.
7. FOR GLASSED FUSED TO BOLTED STEEL TANKS, ALL STEEL PIPE AND FITTINGS SHALL BE FBE COATED, INTERIOR AND EXTERIOR.
8. ALL STEEL PIPE AND FITTINGS UNDERNEATH AND WITHIN 5' OF TANKS OR BUILDINGS SHALL BE SHOP WELDED AND COATED, X-RAY TESTED AND PRESSURE TESTED PRIOR TO POURING FOUNDATIONS.
9. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL UNLESS OTHERWISE NOTED.
10. SANDBLASTING WASTE SHALL BE DISPOSED OF OFF-SITE AT AN APPROVED SOLID WASTE FACILITY AT THE CONTRACTOR'S EXPENSE.
11. ALL BASE AND OVERFLOW ELEVATIONS PROVIDED IN THESE DRAWINGS ARE APPROXIMATE. CONTRACTOR SHALL FIELD SURVEY ELEVATION OF ENWP PHASE 3 DZ REGULATING (SE) TANK OVERFLOW WEIR AND ENSURE BOTH TANK'S WEIR ELEVATIONS MATCH WITHIN A TOLERANCE OF ±1/2 INCHES.
12. ALL STEEL PIPE FLANGES SHALL BE ANSI CLASS 150.
13. EXACT ORIENTATION OF ALL TANK FEATURES AND PIPE PENETRATIONS TO BE DETERMINED IN THE FIELD BY THE ENGINEER. TANK MANUFACTURER SHALL CONFIRM ALL LOCATIONS W/ ENGINEER PRIOR TO FABRICATION. SOME FEATURES MAY BE ROTATED IN ELEVATION VIEW FOR CLARITY.
14. FOUNDATION AND FLOOR SLOPE UPWARDS 1% TOWARD CENTER TO PREVENT "OILCANNING".
15. PASSIVE CATHODIC PROTECTION REQUIRED.

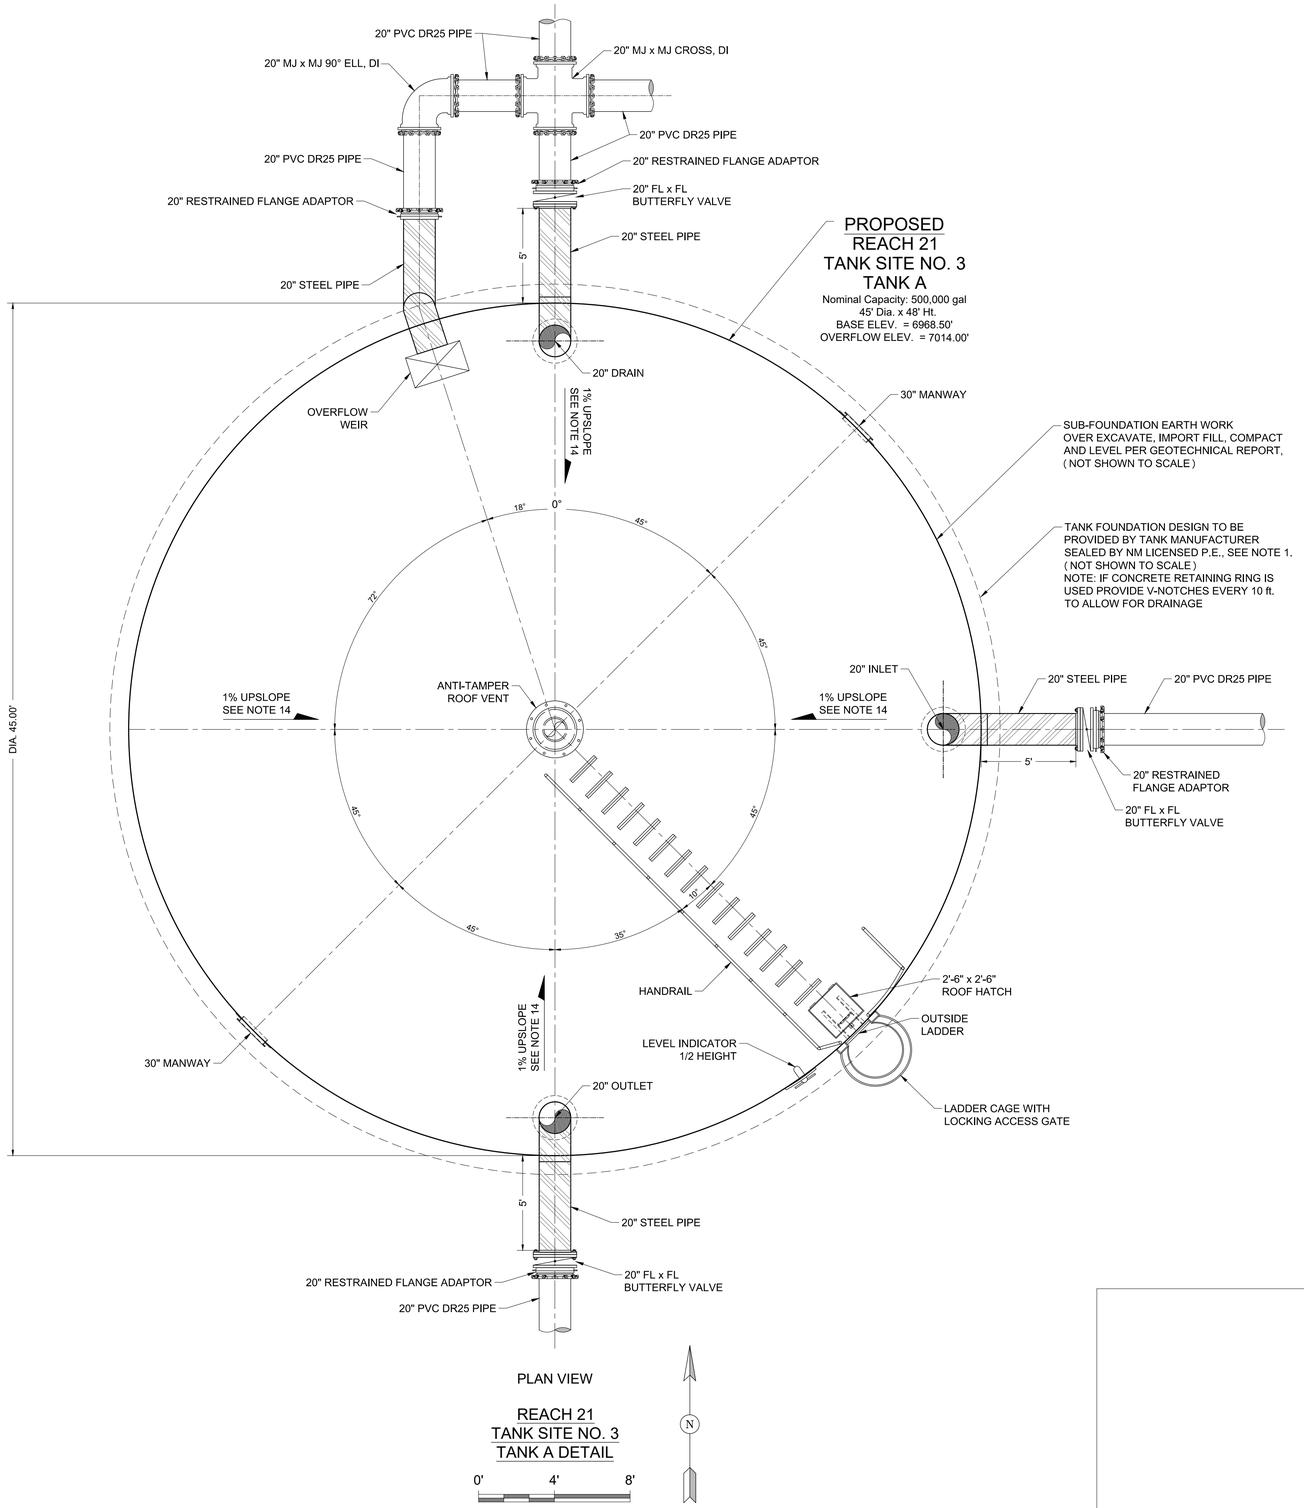

PLAN VIEW

REACH 21
TANK SITE NO. 3
TANK A DETAIL

0' 4' 8'

N

KEYED NOTES
8" TEMPORARY TANK HOOK-UP

Item No.	Description
1	8" MJ x MJ GATE VALVE, 250 psi
2	8" PVC PIPE, DR18
3	8" STEEL PIPE, STANDARD WALL
4	8" MJ x MJ 90° ELL, D.I., 350 psi
5	8" STEEL FLANGE, WELDED
6	8" BLIND FLANGE WITH GASKET
7	8" 90° ELL, STEEL, WELDED (ORIENTATION PER SITE PLANS)

NOTES:
1. ALL MATERIALS SHALL BE RATED TO AT LEAST 150 psi, UNLESS OTHERWISE NOTED.
2. ALL METALLIC PIPE, VALVES AND FITTINGS SHALL BE FBE-COATED, INTERIOR AND EXTERIOR. ALL METALLIC PIPE IN CONTACT WITH SOIL SHALL ALSO BE COLD APPLIED TAPE-COATED, PER SPECIFICATIONS.
3. FLANGES SHALL BE ANSI CLASS 150 (STEEL) OR ANSI CLASS 125 (IRON).
4. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL.
5. VALVE BOX LID AND ALL ABOVE GROUND STEEL COMPONENTS SHALL BE COATED BLUE.

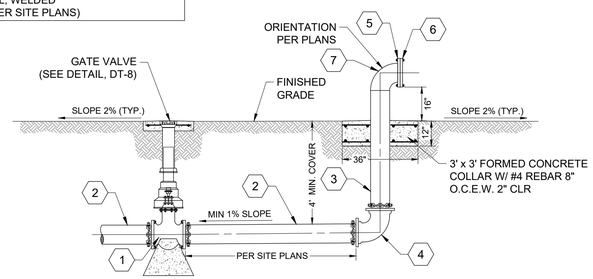

TEMPORARY TANK HOOK-UP DETAIL
NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

SAFETY ALWAYS THINK

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Official Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED (BUREAU APPROVAL) - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

TANK DETAILS (1 of 2)

USBR-DWG-NMBR
SHEET DT-14

DATE AND TIME PLOTTED 6/19/17
PLOTTED BY atw

CAD SYSTEM AUTOCAD
CAD FILENAME Reach 21Tank Details.dwg

NOTES:

1. FOUNDATION AND TANK STRUCTURAL DESIGN DRAWINGS AND CALCULATIONS (SEALED BY NEW MEXICO-LICENSED PROFESSIONAL ENGINEER) TO BE PROVIDED BY TANK MANUFACTURER. FOUNDATION SHALL BE EITHER CONCRETE RING OR CONCRETE MAT, BASED ON LICENSED P.E.'s DESIGN AND THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT BY NV5 #444317-2360000.02 DATED JANUARY 9, 2017.
2. IF RINGWALL FOUNDATION IS USED, TANK SHALL BEAR ON A MINIMUM OF 3 FEET OF ENGINEERED FILL, 3 FEET BEYOND RINGWALL, AND RINGWALL FOOTING SHALL BEAR ON A MINIMUM OF 1 FOOT OF ENGINEERED FILL MEASURED AT BOTTOM OF OVER-EXCAVATION. INCREASE DEPTH OF OVER-EXCAVATION, IF NECESSARY, TO ENSURE ENGINEERED FILL BEARS UNIFORMLY ON CUT; DO NOT ALLOW TRANSITION FROM CUT TO FILL TO PASS UNDERNEATH OR WITHIN 5 HORIZONTAL FEET OF TANK. REFER TO GEOTECHNICAL REPORT BY NV5 #444317-2360000.02 DATED JANUARY 9, 2017 FOR SUBSURFACE INFORMATION, OVER EXCAVATION REQUIREMENTS, SUBGRADE PREPARATION, AND STRUCTURAL FILL & COMPACTION. ENGINEERED FILL SHALL BE COMPACTED TO 95% MIN. MODIFIED PROCTOR.
3. IF CONCRETE MAT FOUNDATION IS USED, TANK SHALL BEAR ON A MINIMUM OF 18 INCHES OF ENGINEERED FILL, 3 FEET BEYOND MAT, MEASURED AT BOTTOM OF OVER-EXCAVATION. INCREASE DEPTH OF OVER-EXCAVATION, IF NECESSARY, TO ENSURE ENGINEERED FILL BEARS UNIFORMLY ON CUT; DO NOT ALLOW TRANSITION FROM CUT TO FILL TO PASS UNDERNEATH OR WITHIN 5 HORIZONTAL FEET OF TANK. REFER TO GEOTECHNICAL REPORT BY NV5 #444317-2360000.02 DATED JANUARY 9, 2017 FOR SUBSURFACE INFORMATION, OVER EXCAVATION REQUIREMENTS, SUBGRADE PREPARATION, AND STRUCTURAL FILL & COMPACTION. ENGINEERED FILL SHALL BE COMPACTED TO 95% MIN. MODIFIED PROCTOR.
4. STATED TANK VOLUMES ARE NOMINAL. ACTUAL TANK VOLUMES SHALL BE WITHIN 2% OF THE STATED NOMINAL VALUE.
5. TANK COLOR TO BE TAN.
6. TANK APPURTENANCES SHOWN IN ELEVATION VIEW HAVE BEEN ROTATED INTO VIEW FOR DEPICTION PURPOSES.
7. FOR GLASSED FUSED TO BOLTED STEEL TANKS, ALL STEEL PIPE AND FITTINGS SHALL BE FBE COATED, INTERIOR AND EXTERIOR.
8. ALL STEEL PIPE AND FITTINGS UNDERNEATH AND WITHIN 5' OF TANKS OR BUILDINGS SHALL BE SHOP WELDED AND COATED, X-RAY TESTED AND PRESSURE TESTED PRIOR TO POURING FOUNDATIONS.
9. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL UNLESS OTHERWISE NOTED.
10. SANDBLASTING WASTE SHALL BE DISPOSED OF OFF-SITE AT AN APPROVED SOLID WASTE FACILITY AT THE CONTRACTOR'S EXPENSE.
11. ALL BASE AND OVERFLOW ELEVATIONS PROVIDED IN THESE DRAWINGS ARE APPROXIMATE. CONTRACTOR SHALL FIELD SURVEY ELEVATION OF ENWP PHASE 3 DZ REGULATING (SE) TANK OVERFLOW WEIR AND ENSURE BOTH TANK'S WEIR ELEVATIONS MATCH WITHIN A TOLERANCE OF ±1/2 INCHES.
12. ALL STEEL PIPE FLANGES SHALL BE ANSI CLASS 150.
13. EXACT ORIENTATION OF ALL TANK FEATURES AND PIPE PENETRATIONS TO BE DETERMINED IN THE FIELD BY THE ENGINEER. TANK MANUFACTURER SHALL CONFIRM ALL LOCATIONS W/ ENGINEER PRIOR TO FABRICATION. SOME FEATURES MAY BE ROTATED IN ELEVATION VIEW FOR CLARITY.
14. FOUNDATION AND FLOOR SLOPE UPWARDS 1% TOWARD CENTER TO PREVENT "OILCANNING".
15. PASSIVE CATHODIC PROTECTION REQUIRED.

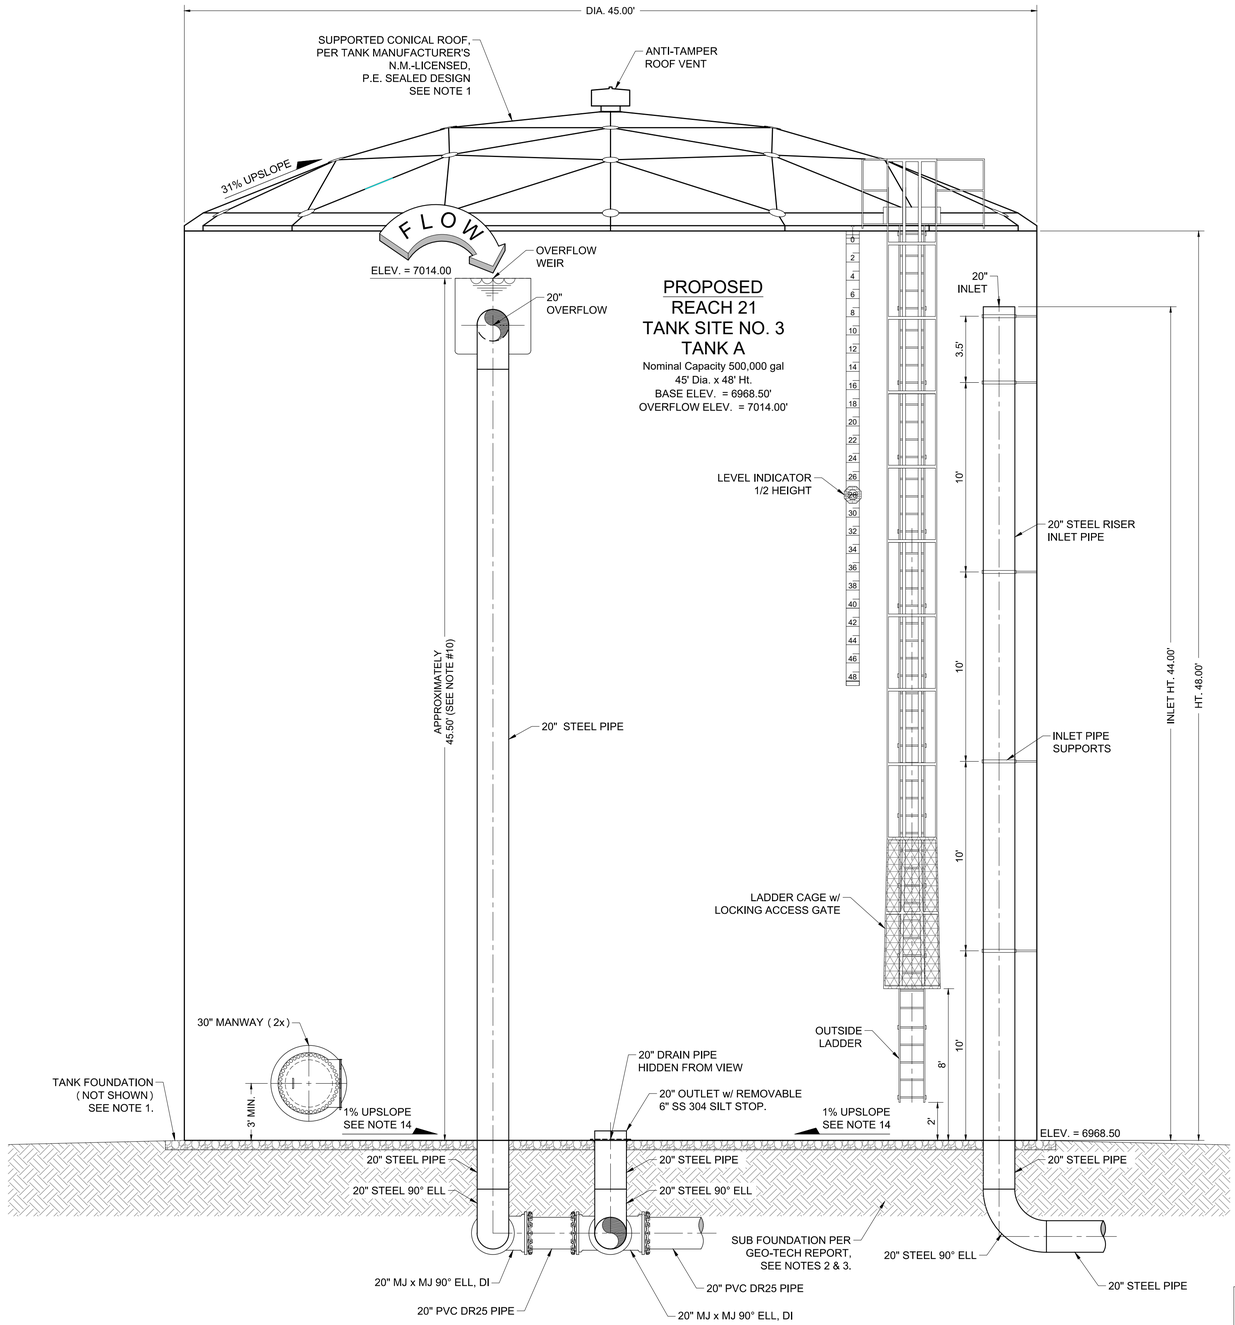

ELEVATION VIEW

REACH 21
TANK SITE NO. 3
TANK A DETAIL

0' 4' 8'

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL — TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

TANK DETAILS
(2 of 2)

USBR-DWG-NMBR
SHEET DT-15

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
atrr

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21Tank Details.dwg

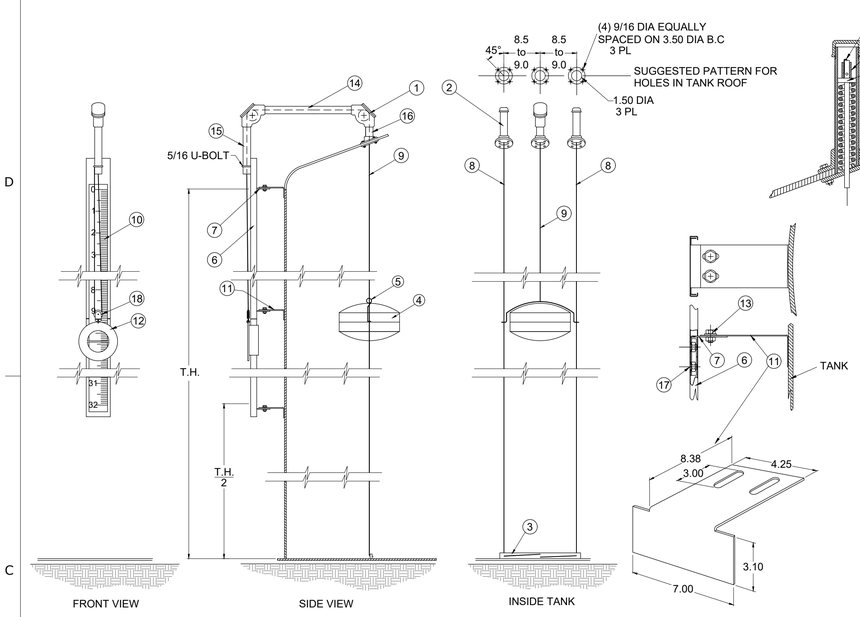

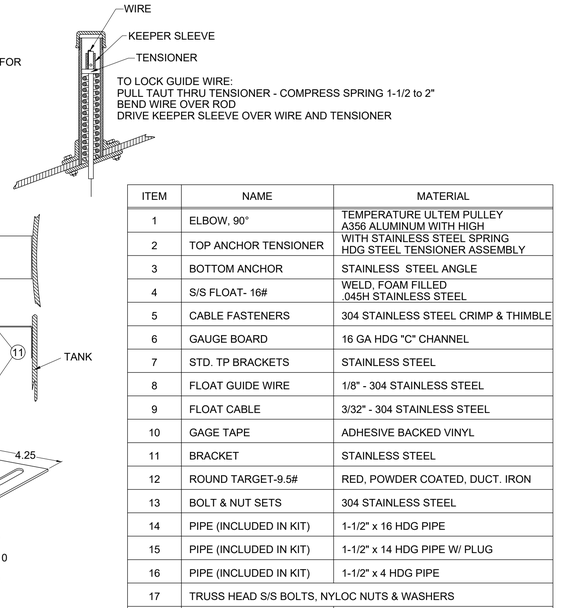

ITEM	NAME	MATERIAL
1	ELBOW, 90°	TEMPERATURE ULTEM PULLEY A356 ALUMINUM WITH HIGH
2	TOP ANCHOR TENSIONER	WITH STAINLESS STEEL SPRING HDG STEEL TENSIONER ASSEMBLY
3	BOTTOM ANCHOR	STAINLESS STEEL ANGLE
4	S/S FLOAT- 16#	WELD, FOAM FILLED .045H STAINLESS STEEL
5	CABLE FASTENERS	304 STAINLESS STEEL CRIMP & THIMBLE
6	GAUGE BOARD	16 GA HDG "C" CHANNEL
7	STD. TP BRACKETS	STAINLESS STEEL
8	FLOAT GUIDE WIRE	1/8" - 304 STAINLESS STEEL
9	FLOAT CABLE	3/32" - 304 STAINLESS STEEL
10	GAGE TAPE	ADHESIVE BACKED VINYL
11	BRACKET	STAINLESS STEEL
12	ROUND TARGET-9.5#	RED, POWDER COATED, DUCT. IRON
13	BOLT & NUT SETS	304 STAINLESS STEEL
14	PIPE (INCLUDED IN KIT)	1-1/2" x 16 HDG PIPE
15	PIPE (INCLUDED IN KIT)	1-1/2" x 14 HDG PIPE W/ PLUG
16	PIPE (INCLUDED IN KIT)	1-1/2" x 4 HDG PIPE
17	TRUSS HEAD S/S BOLTS, NYLOC NUTS & WASHERS	
18	1/2 TRAVEL PULLEY	STAINLESS STEEL

TYPICAL HALF HEIGHT LIQUID INDICATOR DETAILS
NOT TO SCALE

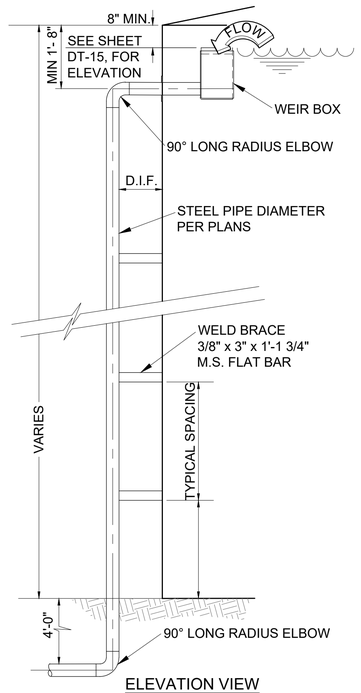

ELEVATION VIEW

TYPICAL TANK OVERFLOW DETAIL
NOT TO SCALE

SEE TANK PLAN AND ELEVATION SHEETS DT-14 & DT-15, FOR PIPE SIZE, HEIGHT AND ELEVATION.

NOTE:
1. DIMENSIONS INDICATING SEPARATION BETWEEN WEIR FROM ROOF ARE MINIMUMS ONLY. ACTUAL DIMENSIONS MAY BE GREATER TO ACCOMMODATE SLOSH WAVE, AS CALCULATED BY TANK MANUFACTURER.
2. TANK MANUFACTURER SHALL PROVIDE DESIGN CALCULATIONS AND FABRICATION DRAWINGS SEALED BY A NEW MEXICO LICENSED PROFESSIONAL ENGINEER.

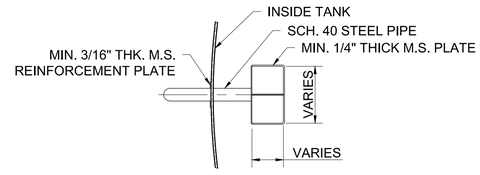

PLAN VIEW

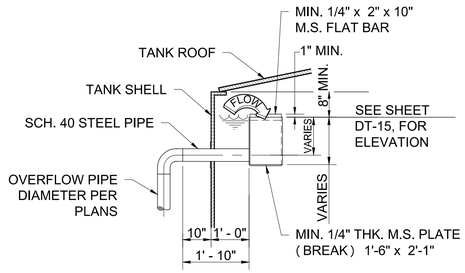

ELEVATION VIEW

TYPICAL OVERFLOW WEIR DETAIL
NOT TO SCALE

NOTE:
DIMENSIONS OF WEIR AND APPURTENANCES PROVIDED ARE MINIMUMS. ACTUAL DIMENSIONS MAY BE LARGER TO PROVIDE FOR DESIGN FLOW RATES SPECIFIED IN THE TECHNICAL SPECIFICATIONS. ACTUAL WEIR DIMENSIONS SHALL BE PROVIDED AS PART OF THE TANK MANUFACTURER'S PROFESSIONAL ENGINEER SEALED DESIGN.

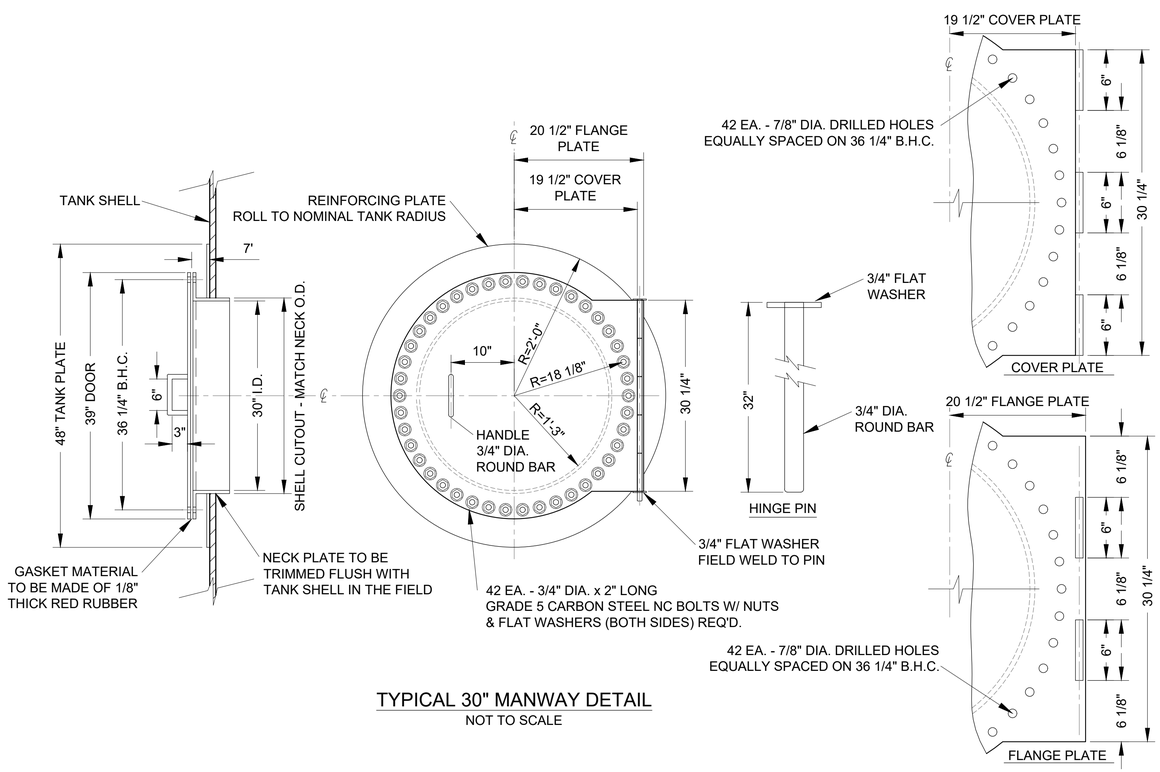

TYPICAL 30" MANWAY DETAIL
NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Informational Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL — TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

TYPICAL WATER STORAGE TANK DETAILS (1 of 2)

USBR-DWG-NMBR
SHEET DT-16

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
atw

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21Tank Details.dwg

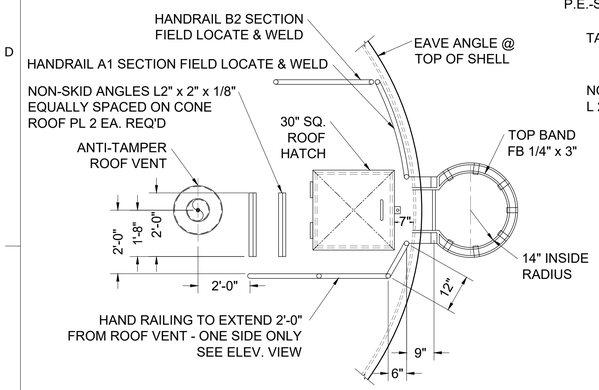

PLAN VIEW
NOT TO SCALE

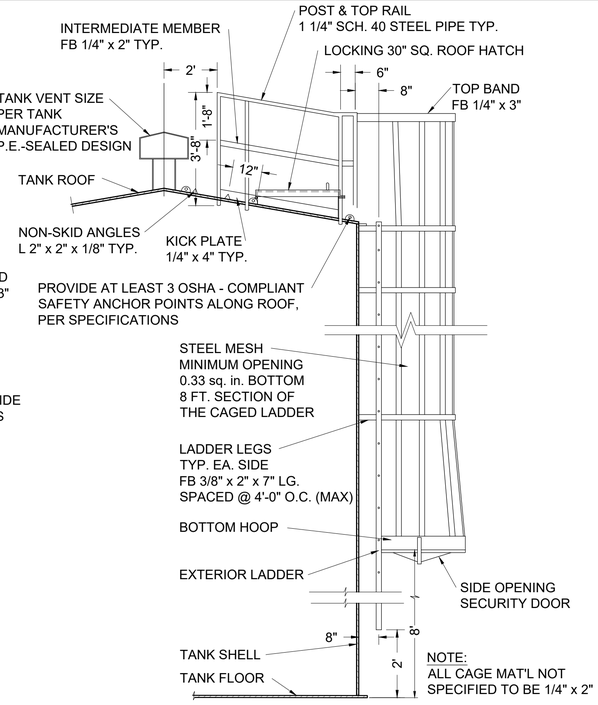

TANK CUTAWAY ELEVATION VIEW

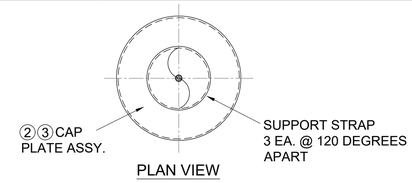

PLAN VIEW

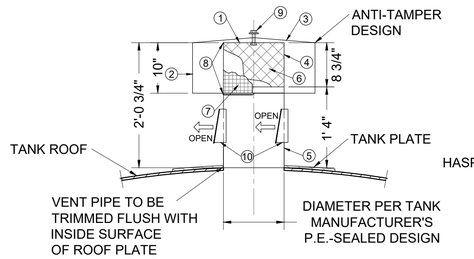

VERTICAL C/L OF TANK AND VENT WITH FROST PROOF DOORS



HINGE DETAIL - 2 EA. REQ'D

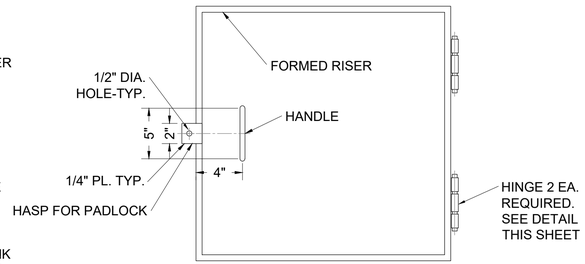

PLAN VIEW

BILL OF MATERIALS		
ITEM	QTY.	DESCRIPTION
①	1	3/16" THK. M.S. PLATE (CUT) 1' - 0" 3/4" Ø
②	1	10 GA. H.R. SHEET (ROLL) 10" x 6' - 3 3/8"
③	1	12 GA. H.R. SHEET (CUT) 2' - 0" Ø
④	3	3/16" x 1" M.S. FLAT BAR x 8 9/16"
⑤	1	1/4" THK. M.S. PLATE (ROLL) 16" x 3' - 2 1/2"
⑥	1	3/4 - #9 FLAT EXP. METAL (ROLL) 8 3/4" x 3' - 4"
⑦	1	14 - 16 MESH SCREEN (SST) 12" x 3' - 7"
⑧	2	STAINLESS STEEL WORM CLAMP (SST) 3/4" x 3' - 7"
⑨	1	1/2" x 3" HEX BOLT WITH (GRADE 2) NUT, & FLAT WASHER
⑩	4	6" x 8" FREEZE PROTECTION DOOR

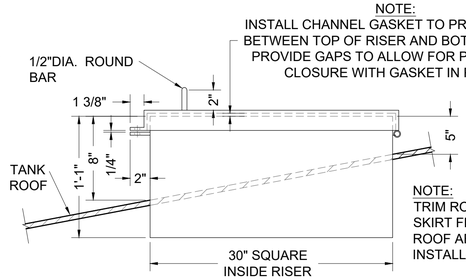

ELEVATION VIEW

12" VERTICAL ROOF DETAIL
NOT TO SCALE

30" SQUARE ROOF HATCH DETAIL
NOT TO SCALE

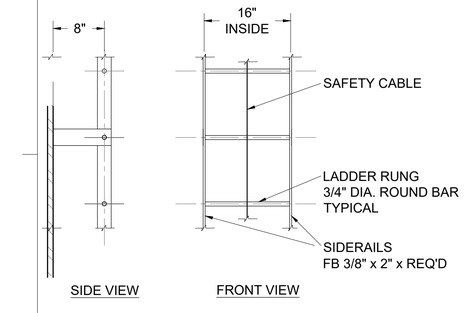

LADDER DETAILS
NOT TO SCALE

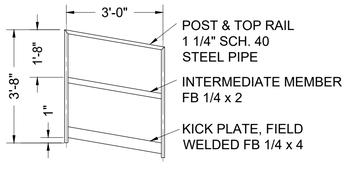

HANDRAIL B2 DETAIL
NOT TO SCALE

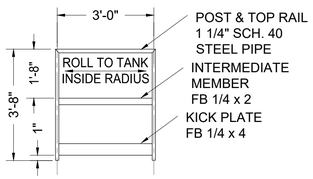

HANDRAIL A1 DETAIL - ONE REQ'D
NOT TO SCALE

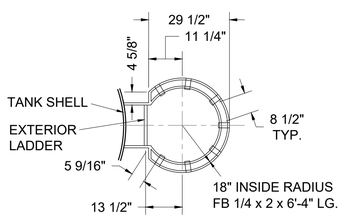

VIEW - LOOKING UP
NOT TO SCALE



ROTATED 90 DEGREES



SECTION DETAIL
NOT TO SCALE

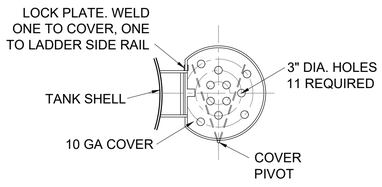

SIDE OPENING SECURITY DOOR DETAIL
NOT TO SCALE

EXTERIOR CAGED LADDER DETAILS
NOT TO SCALE

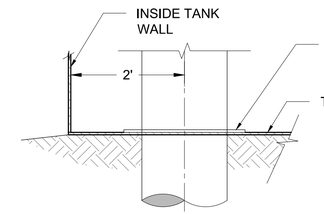

ELEVATION VIEW

20" INLET DETAIL
NOT TO SCALE

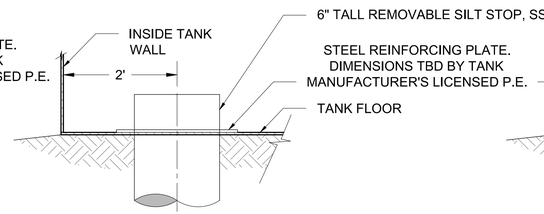

ELEVATION VIEW

20" OUTLET DETAIL
NOT TO SCALE

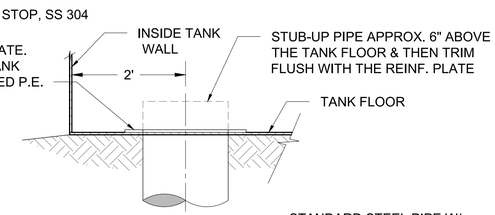

ELEVATION VIEW

20" TANK FLOOR DRAIN DETAIL
NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Preliminary Draft Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED
SIGNATURE - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

TYPICAL WATER STORAGE TANK DETAILS (2 of 2)

USBR-DWG-NMBR

SHEET DT-17

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
alw

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21Tank Details.dwg

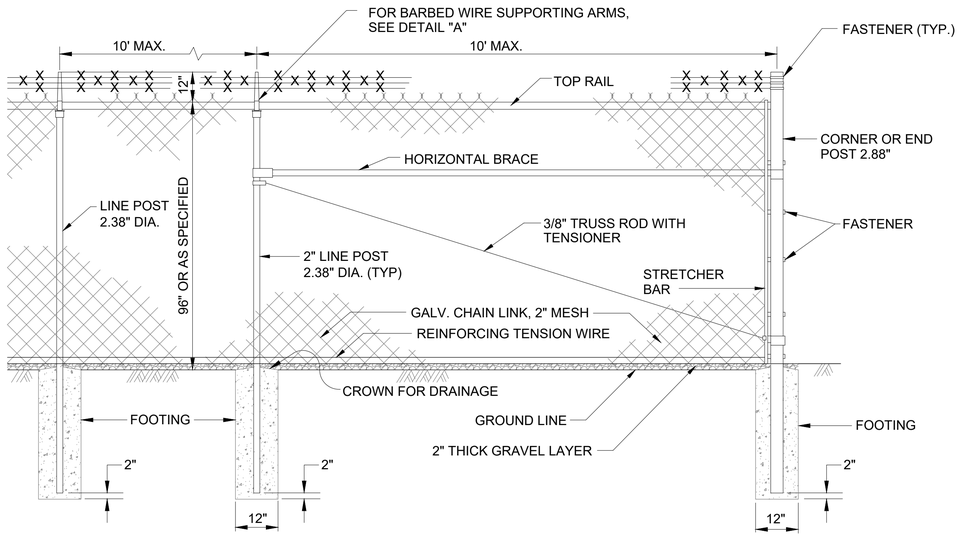

CHAIN LINK FENCE

NOT TO SCALE

NOTES:

1. AT BROW CROSSING, EMBED ON 6" CENTERS, 4-11/2" x 24" GALVANIZED RODS WITH 2" HOOKED END INTO BROW DITCH CONCRETE. EXPOSED END OF ROD SHALL BE WOVEN INTO FENCE FABRIC.
2. IMBED BOTTOM OF FABRIC MIN. 1" INTO THE 2" THICK GRAVEL LAYER.

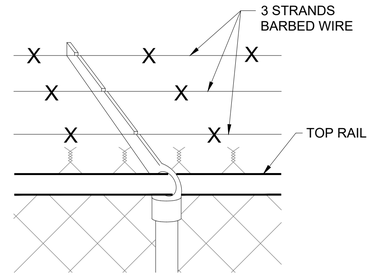

DETAIL "A" SUPPORTING ARM & BARBED WIRE

NOT TO SCALE

GATE POST

GATE LEAF WIDTH	GATE POST (OD)	FABRIC HEIGHT	"A" DIAM	"B" DEPTH	"C" POST EMBED.
10'	4"	8'	16"	56"	54"

LINE AND TERMINAL POSTS

FABRIC HEIGHT	TYPE POST	"A" DIAM	"B" DEPTH	"C" POST EMBED.
8'-0"	LINE	12"	38"	36"
	TERMINAL	12"	38"	36"

NOTES:

1. COMMON LOCKS SHALL BE PROVIDED FOR ALL FENCE GATES
2. TERMINAL POSTS INCLUDE END, CORNER, AND PULL POSTS

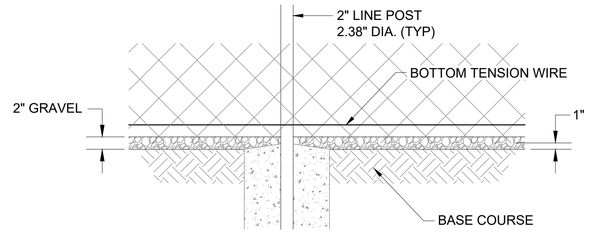

BASE COURSE AND GRAVEL DETAIL

NOT TO SCALE

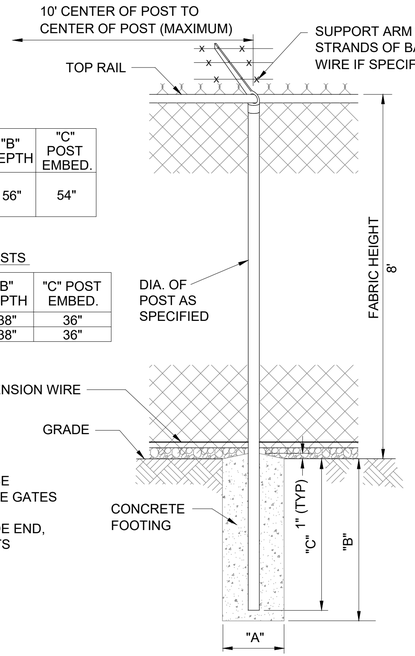

CHAIN LINK FENCE FOUNDATION

NOT TO SCALE

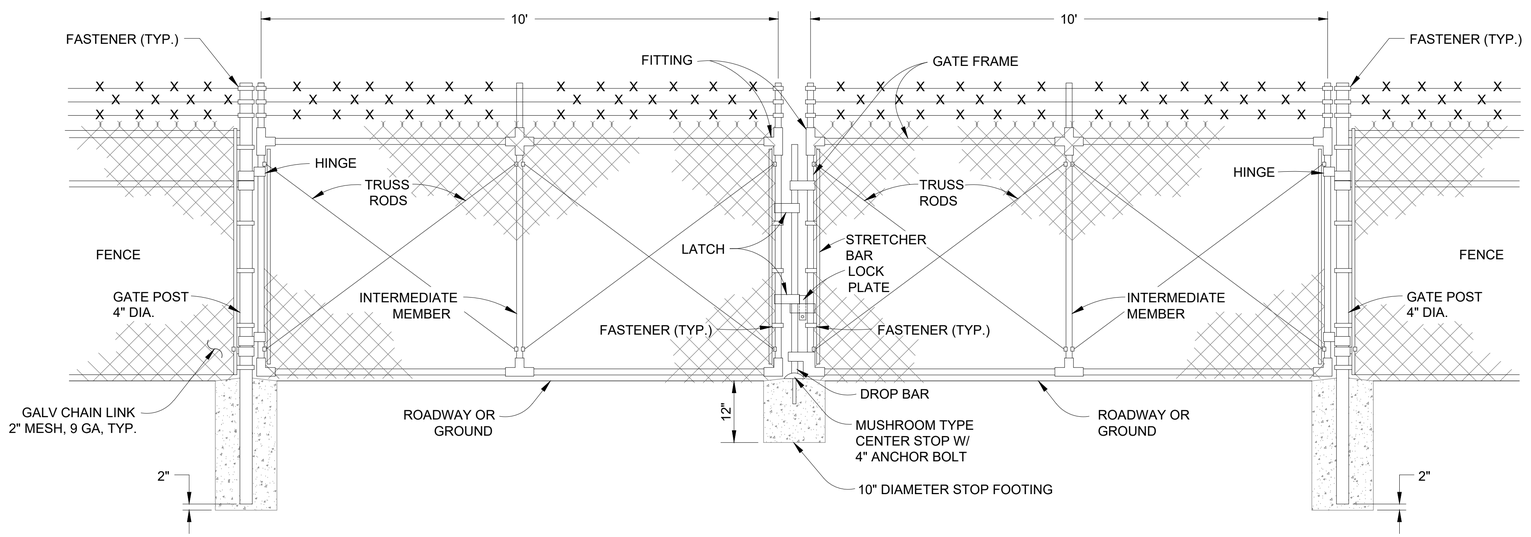

20' DOUBLE SWINGING VEHICLE GATE

NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APV'D

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

STANDARD FENCE DETAILS

USBR-DWG-NMBR
SHEET DT-18

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
mrh

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Fence Details.dwg

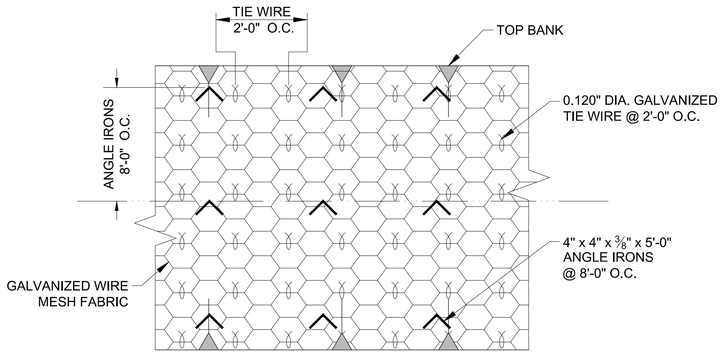

TYP. 12" RIP-RAP CAGE & ANCHORING

NOT TO SCALE

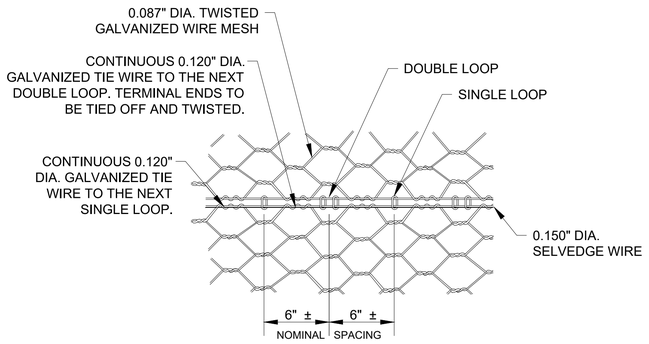

STANDARD JOINT CONNECTION DETAIL

NOT TO SCALE



TWISTED MESH MATTRESS

NOT TO SCALE

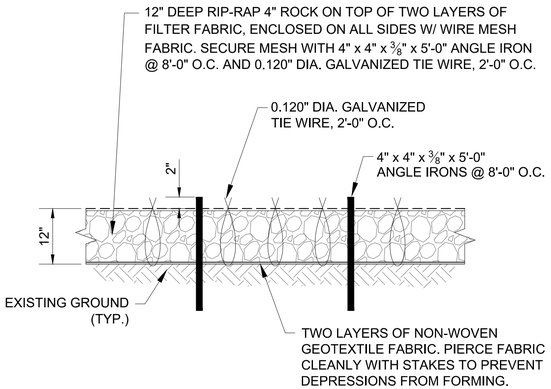

CROSS SECTION

TYPICAL 12" RIP-RAP DETAIL

NOT TO SCALE

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental
Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION

NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

Alternate Use Only
Draft
Not For Distribution

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
SIGNATURE/INITIAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

EROSION
CONTROL DETAILS
(1 of 2)

USBR-DWG-NMBR
SHEET DT-19

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
mvh

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 SWPPP-BMP Details.dwg

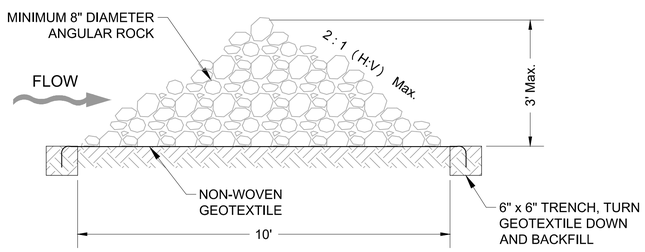

TYPICAL ROCK DAM SECTION

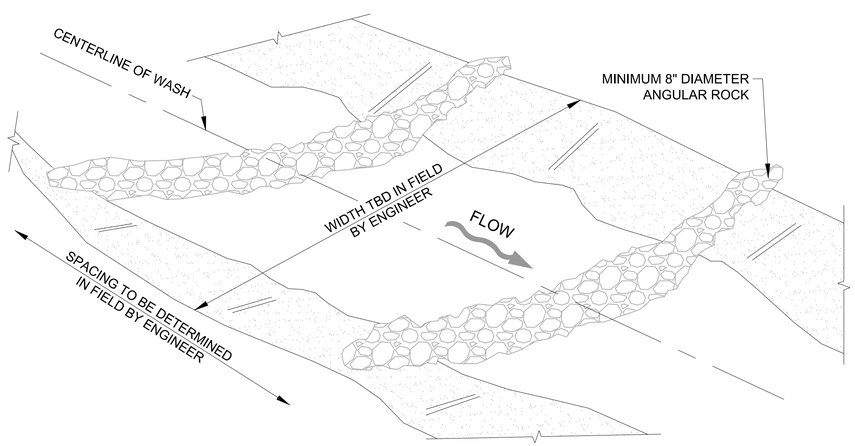

ISOMETRIC VIEW

ROCK CHECK DAM DETAIL
NOT TO SCALE

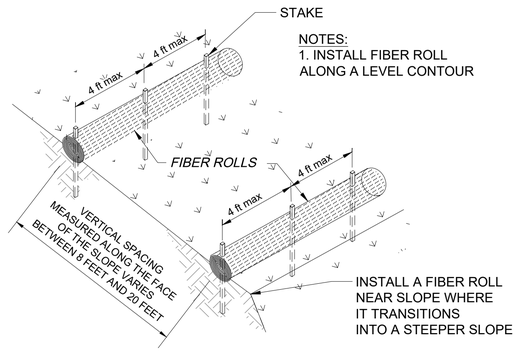

TYPICAL FIBER ROLL INSTALLATION
NOT TO SCALE

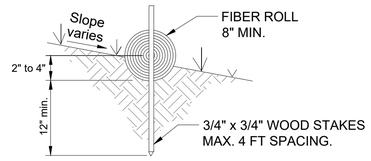

ENTRENCHMENT DETAIL
NOT TO SCALE

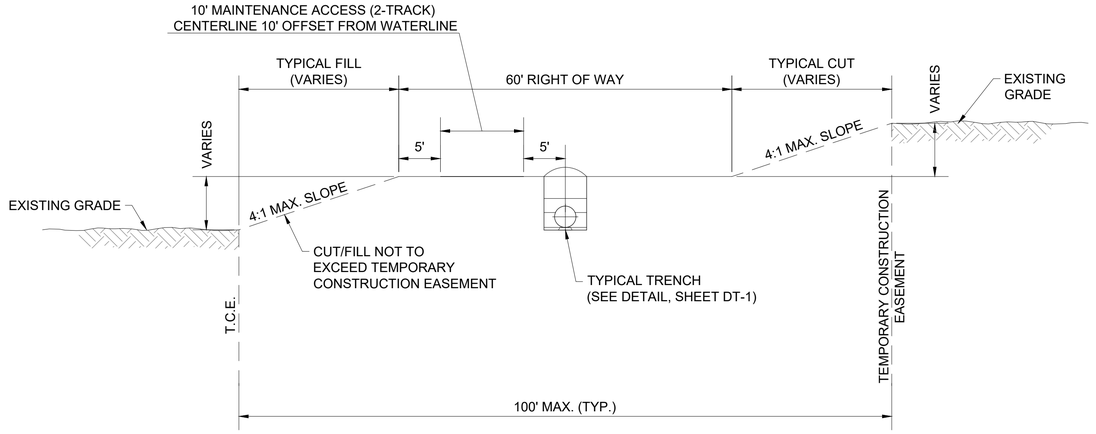

TYPICAL PIPELINE ROW FINISHED GRADING DETAIL
NOT TO SCALE

NOTES:

1. ALL DISTURBED EARTH SHALL BE COMPACTED AND RESEEDED AS REQUIRED PER DT-1 AND SPECIFICATIONS.
2. TOTAL WIDTH REDUCED IN AREAS WHERE TEMPORARY CONSTRUCTION EASEMENT IS TRUNCATED DUE TO ADJACENT CULTURALLY SENSITIVE AREAS, ROADWAYS, PRIVATE PROPERTIES, ETC.
3. FINAL GRADING AND SLOPE STABILIZATION MUST BE APPROVED BY ENGINEER AND BLM.

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21 WATER PIPELINE

Draft
Not For Distribution
For Internal Use Only

NO.	DATE	REVISION	BY	APVD

T Tadano — DESIGNED
M Howard / A Vogenthaler — DRAWN
A Robertson — CHECKED
TECH. APPR.
APPROVED — SIGN APPROVAL - TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

EROSION CONTROL
DETAILS (2 of 2)
AND R-O-W GRADING

USBR-DWG-NMBR
SHEET DT-20

DATE AND TIME PLOTTED
6/19/17
PLOTTED BY
mrh

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 SWPPP-BMP Details.dwg

FOR OFFICIAL USE ONLY

ALL SIGNS ARE BLACK ON ORANGE
UNLESS OTHERWISE SPECIFIED

EACH SIGN FACE SHOWN ON PLANS SHALL MEET THE SPECIFICATIONS IN THE STANDARD HIGHWAY SIGNS MANUAL (CURRENT EDITION) FOR PROPER ARRANGEMENT AND SPACING OF LETTERS, LETTER HEIGHT, LETTER SERIES, SYMBOLS, AND BORDERS FOR THE SPECIFIED SIZE AND MESSAGE AS SHOWN ON THE PLANS.

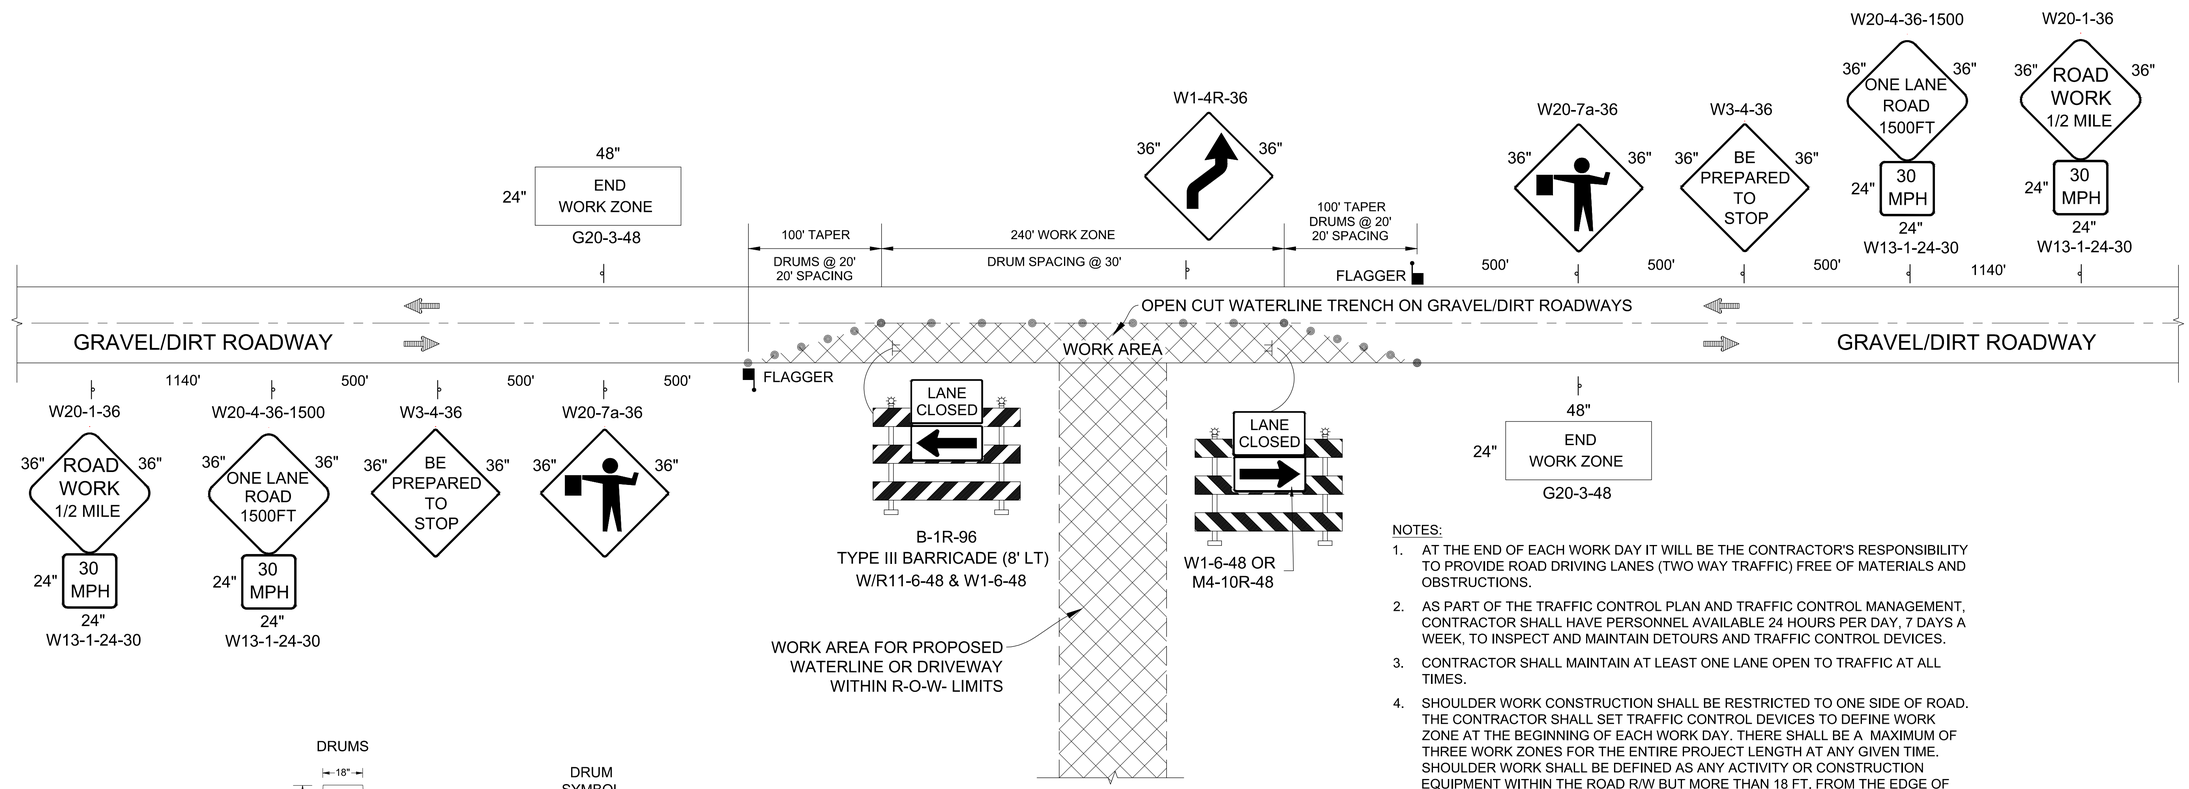

DRUMS



DRUM SYMBOL

ALL DRUMS SHALL COMPLY WITH THE SPECIFICATIONS OF SECTION 702-TRAFFIC CONTROL DEVICES FOR CONSTRUCTION, NMSHTD STANDARD SPECIFICATIONS FOR HIGHWAY AND BRIDGE CONSTRUCTION, CURRENT EDITION

TRAFFIC CONTROL LAYOUT - LANE CLOSURE OF GRAVEL/DIRT ROADWAY FOR CONSTRUCTION OF WATERLINE CROSSING OR CONSTRUCTION OF DRIVEWAY

NOT TO SCALE

LANE CLOSURE (LEFT AND RIGHT)
OPEN CUT GRAVEL/DIRT ROADWAYS

NMDOT CHANNELIZATION DEVICES, TYPE: DRUM, NO. 702525.
TOTAL OF 19 DRUMS REQUIRED.

NOTES:

1. AT THE END OF EACH WORK DAY IT WILL BE THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ROAD DRIVING LANES (TWO WAY TRAFFIC) FREE OF MATERIALS AND OBSTRUCTIONS.
2. AS PART OF THE TRAFFIC CONTROL PLAN AND TRAFFIC CONTROL MANAGEMENT, CONTRACTOR SHALL HAVE PERSONNEL AVAILABLE 24 HOURS PER DAY, 7 DAYS A WEEK, TO INSPECT AND MAINTAIN DETOURS AND TRAFFIC CONTROL DEVICES.
3. CONTRACTOR SHALL MAINTAIN AT LEAST ONE LANE OPEN TO TRAFFIC AT ALL TIMES.
4. SHOULDER WORK CONSTRUCTION SHALL BE RESTRICTED TO ONE SIDE OF ROAD. THE CONTRACTOR SHALL SET TRAFFIC CONTROL DEVICES TO DEFINE WORK ZONE AT THE BEGINNING OF EACH WORK DAY. THERE SHALL BE A MAXIMUM OF THREE WORK ZONES FOR THE ENTIRE PROJECT LENGTH AT ANY GIVEN TIME. SHOULDER WORK SHALL BE DEFINED AS ANY ACTIVITY OR CONSTRUCTION EQUIPMENT WITHIN THE ROAD R/W BUT MORE THAN 18 FT. FROM THE EDGE OF THE DRIVING LANE.
5. DURING NON-WORKING HOURS, THE CONTRACTOR SHALL MOVE DRUMS, SIGNS, AND OTHER TRAFFIC CONTROL DEVICES TO R/W FENCE AND LAY SIGNING DOWN AWAY FROM TRAFFIC.
6. NIGHT-TIME CONDITIONS: THE CONTRACTOR SHALL NOT PARK CONSTRUCTION EQUIPMENT, OR LEAVE MATERIALS WITHIN 24 FT. OF THE EDGE OF DRIVING LANE.
7. THE CONTRACTOR SHALL PROVIDE ACCESS TO ALL DRIVEWAYS AND TURNOUTS AT ALL TIMES.
8. LANE CLOSURE SHALL BE USED WHEN ANY CONSTRUCTION EQUIPMENT, CONSTRUCTION MATERIAL, OR CONSTRUCTION OBJECTS ARE WITHIN 18 FT. FROM EDGE OF DRIVING LANE.
9. ALL CONSTRUCTION TRAFFIC CONTROL DEVICES SHALL COMPLY WITH BIA-NAVAJO REGIONAL OFFICE DEPARTMENT OF TRANSPORTATION REQUIREMENTS, SANDOVAL COUNTY ROAD DEPARTMENT / PUBLIC WORKS REQUIREMENTS, THE NEW MEXICO STATE DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR HIGHWAY AND BRIDGE CONSTRUCTION, LATEST EDITION, AND THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES, LATEST EDITION.
10. EXCEPT DURING AN EMERGENCY, NO NIGHT-TIME WORK TO BE PERFORMED.
11. ALL STAGING AREAS AND MATERIAL AND EQUIPMENT STORAGE SHALL BE CONFINED TO PROJECT R/W AND ARE SUBJECT TO THE SAME RESTRICTIONS AS THE WORK AREAS AS SET FORTH ABOVE.
12. FOLLOW ALL ROAD CROSSING PERMITS FOR GRAVEL/DIRT ROADS.

RECLAMATION
Managing Water in the West

SMA
Engineering • Environmental Surveying

ALWAYS THINK SAFETY

NAVAJO-GALLUP WATER SUPPLY PROJECT
U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NEW MEXICO

CUTTER LATERAL - REACH 21
WATER PIPELINE

NO.	DATE	REVISION	BY	APVD

T Tadano
DESIGNED
M Howard / A Vogenthaler
DRAWN
A Robertson
CHECKED
TECH. APPR.
APPROVED
ADMIN APPROVAL — TITLE
FARMINGTON, NM 2017-06-19

REACH 21 PIPELINE

TRAFFIC CONTROL
(GRAVEL AND DIRT ROAD)

USBR-DWG-NMBR
SHEET DT-21

For Official Use Only
Draft
Not For Distribution

DATE AND TIME PLOTTED
6/8/2017
PLOTTED BY
mvh

CAD SYSTEM
AUTOCAD
CAD FILENAME
Reach 21 Traffic Control.dwg

FOR OFFICIAL USE ONLY

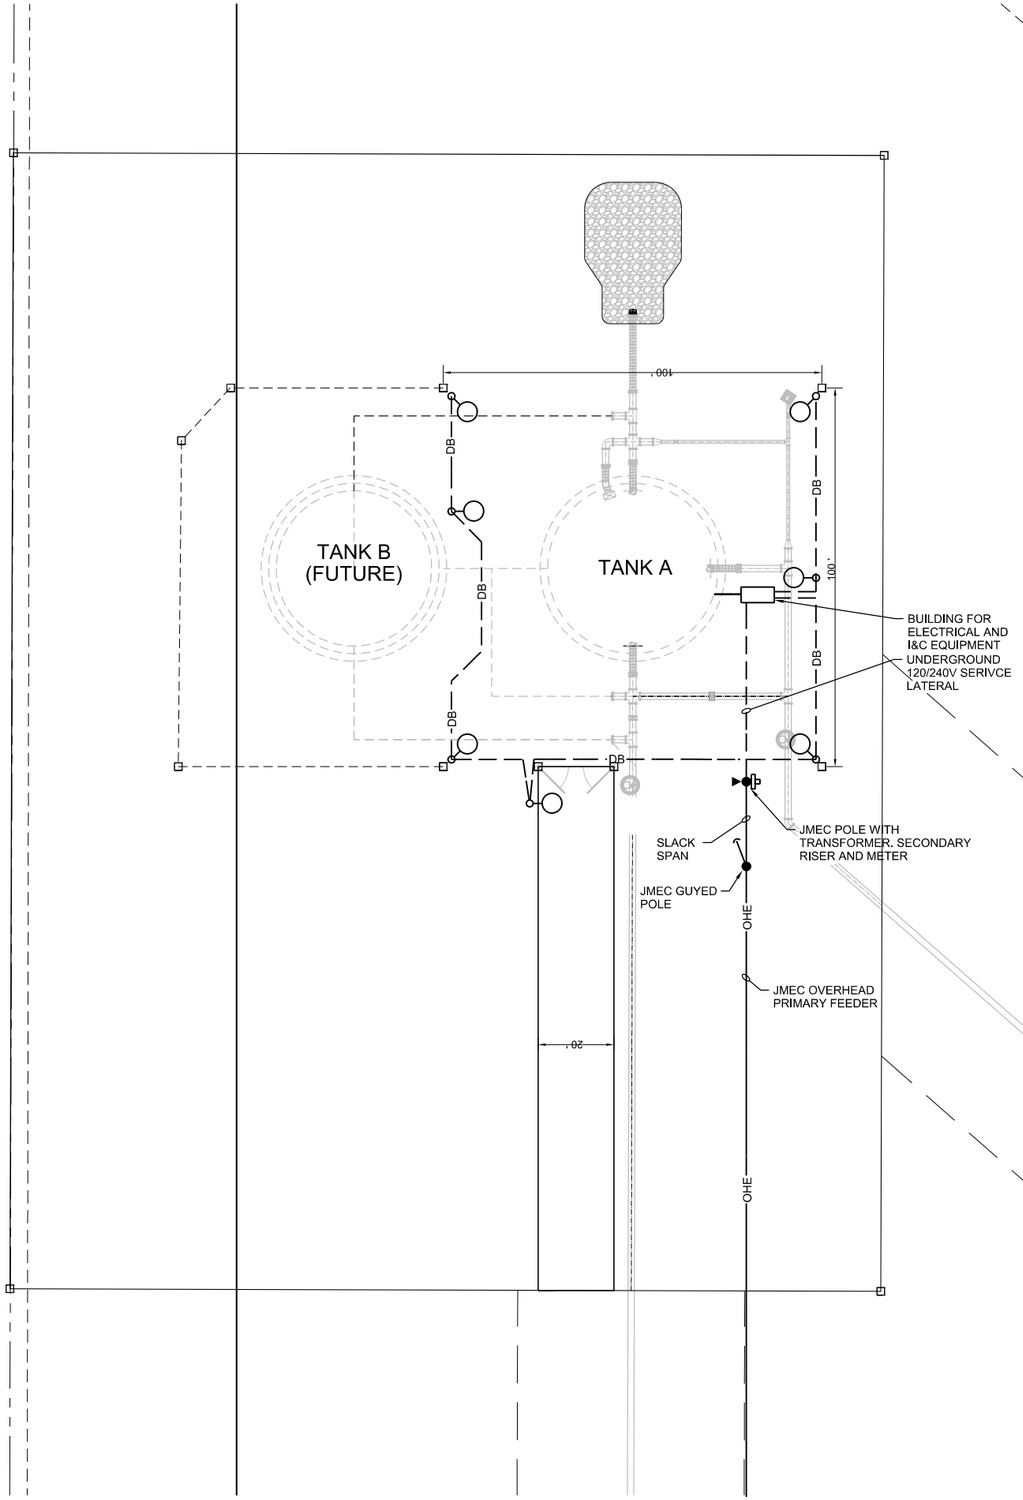



PRELIMINARY
NOT FOR CONSTRUCTION

RECLAMATION
Managing Water in the West

ch2m

VERIFY SCALE
BAR IS ONE INCH ON ORIGINAL DRAWING,
0 1"

ALWAYS THINK SAFETY

U.S. DEPARTMENT OF THE INTERIOR
BUREAU OF RECLAMATION
NAVAJO-GALLUP WATER SUPPLY PROJECT
NEW MEXICO

CUTTER LATERAL - REACH 21

WATER TREATMENT PLANT

NO.	DATE	REVISION	BY	APV'D

J HONEA
DESIGNED
E ARMIJO
DRAWN
D PETERSON
CHECKED
J HONEA
TECH. APPR.
APPROVED
ADMIN APPROVAL -

FARMINGTON, NM APRIL 2017

ELETRICAL

TANK SITE
PLAN

USBR-DWG-NMBR
SHEET ID: E-1
SHEET OF

DATE PLOTTED
2017/06/20
TIME PLOTTED
1:58:06 PM

CAD SYSTEM
CAD FILENAME

Draft
Not For Construction
For Purchase Only