
NAVAJO GALLUP WATER SUPPLY PROJECT REACH 26.3

90% DESIGN
DATE: September, 2018



PROJECT VICINITY MAP



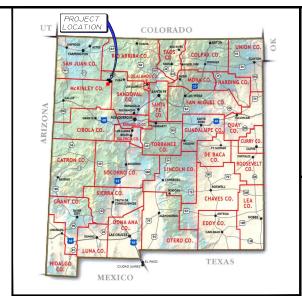




Reach 26.3 To Torreon, NM September 2018

PROJECT DESCRIPTION

THE PROJECT CONSISTS OF CONSTRUCTION OF
3.06 MILES OF 10" PVC WATERLINE, 6.26 MILES OF 12" PVC WATERLINE,
(2x) 250K GALLON WATER STORAGE TANKS WITH CHLORINATOR

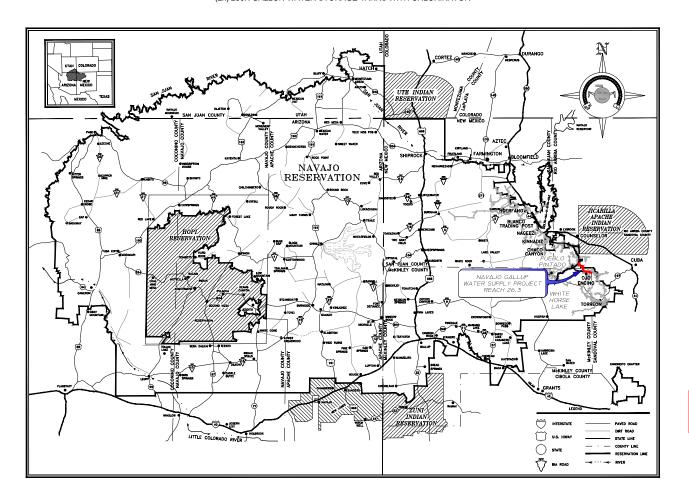

DRAWING LIST

	DRAWING LIST				
SHEET #	DESCRIPTION	SHEET #	DESCRIPTION		
G-1	COVER SHEET AND DRAWING LIST	DT-1	PIPELINE TRENCH DETAILS		
G-2	GENERAL NOTES AND LEGEND	DT-2	MISCELLANEOUS CONSTRUCTION DETAILS		
C-1	PROJECT SITE PLAN AND DRAWING KEY INDEX	DT-3	THRUST BLOCK AND MECHANICAL JOINT RESTRAINT DETAILS		
C-2	SURVEY CONTROL PLAN (1 of 4)	DT-4	GAS LINE CROSSING DETAILS		
C-3	SURVEY CONTROL PLAN (2 of 4)	DT-5	CASED ROAD CROSSING DETAIL		
C-4	SURVEY CONTROL PLAN (3 of 4)	DT-6	PIPELINE AND SITE GATE VALVE DETAILS		
C-5	SURVEY CONTROL PLAN (4 of 4)	DT-7	2 INCH VACUUM BREAKER WITH 1-INCH AIR RELEASE VALVE DETAIL		
C-6	PLAN & PROFILE STA 0+00 To STA 28+00	DT-8	2 INCH FLUSH WITH ORIFICE AND ABOVE-GRADE DISCHARGE DETAIL		
C-7	PLAN & PROFILE STA 28+00 To STA 56+00	DT-9	4 INCH FLUSH VALVE ABOVE-GRADE DISCHARGE DETAIL		
C-8	PLAN & PROFILE STA 56+00 To STA 84+00	DT-10	6 INCH CONTROL VALVE WITH PRESSURE RELIEF VAULT DETAIL (1 of 2)		
C-9	PLAN & PROFILE STA 84+00 To STA 112+00	DT-11	6 INCH CONTROL VALVE WITH PRESSURE RELIEF VAULT DETAIL (2 of 2)		
C-10	PLAN & PROFILE STA 112+00 To STA 140+00	DT-12	WASH CROSSING STA 49+00 PIPELINE HDD DETAIL		
C-11	PLAN & PROFILE STA 140+00 To STA 165+00	DT-13	WASH CROSSING STA 115+55 PIPELINE HDD DETAIL		
C-12	PLAN & PROFILE STA 165+00 To STA 193+00	DT-14	WASH CROSSING STA 435+97 PIPELINE HDD DETAIL		
C-13	PLAN & PROFILE STA 193+00 To STA 221+00	DT-15	TRANSDUCER VAULT DETAIL		
C-14	PLAN & PROFILE STA 221+00 To STA 249+00	DT-16	SENSOR LINE & YARD HYDRANT DETAILS		
C-15	PLAN & PROFILE STA 249+00 To STA 277+00	DT-17	NORTH TANK DETAILS (1 of 2)		
C-16	PLAN & PROFILE STA 277+00 To STA 302+00	DT-18	NORTH TANK DETAILS (2 of 2)		
C-17	PLAN & PROFILE STA 302+00 To STA 323+00	DT-19	SOUTH TANK DETAILS (1 of 2)		
C-18	PLAN & PROFILE STA 323+00 To STA 350+00	DT-20	SOUTH TANK DETAILS (2 of 2)		
C-19	PLAN & PROFILE STA 350+00 To STA 374+00	DT-21	TYPICAL WATER STORAGE TANK DETAILS (1 of 2)		
C-20	PLAN & PROFILE STA 374+00 To STA 402+00	DT-22	TYPICAL WATER STORAGE TANK DETAILS (2 of 2)		
C-21	PLAN & PROFILE STA 402+00 To STA 430+00	DT-23	CHLORINATION SYSTEM DETAILS (1 of 2)		
C-22	PLAN & PROFILE STA 430+00 To STA 458+00	DT-24	CHLORINATION SYSTEM DETAILS (2 of 2)		
C-23	PLAN & PROFILE STA 458+00 To STA 486+00	DT-25	PRECAST 2-ROOM CHLORINATION BUILDING AND PIPING		
C-24	PLAN & PROFILE STA 486+00 To STA 493+12.9	DT-26	PRECAST 2-ROOM CHLORINATION BUILDING DETAILS		
C-25	REACH 26.3 TANK SITE OVERALL PLAN	DT-27	STANDARD FENCE DETAILS		
C-26	REACH 26.3 TANK SITE PLAN	DT-28	EROSION CONTROL DETAILS (1 of 3)		
C-27	REACH 26.3 TANK SITE GRADING	DT-29	EROSION CONTROL DETAILS (2 of 3)		
C-28	REACH 26.3 TANK SITE DRAIN PIPING AND ACCESS ROAD GRADING PLAN	DT-30	EROSION CONTROL DETAILS (3 of 3)		
C-29	REACH 26.3 TANK SITE PIPING PLAN	DT-31	TRAFFIC CONTROL (PAVED ROAD)		
C-30	REACH 26.3 TANK SITE VALVE NUMBERING PLAN	DT-32	TRAFFIC CONTROL (GRAVEL AND DIRT ROAD)		
C-31	REACH 26.3 CONTROL VALVE SITE PLAN	E001	GENERAL NOTES		
C-32	REACH 26.3 CONTROL VALVE SITE PIPING AND CONNECTION PLAN	E101 ELECTRICAL SITE PLAN			
		E102	CHLORINATION BUILDING ELECTRICAL PLANS		
		E103	CHLORINATION BUILDING SCADA SYSTEM AND CONTROL PLAN		
		E201	ELECTRICAL SCHEDULES AND DETAILS		
		E202	ELECTRICAL DIAGRAMS AND DETAILS		
		=	ELECTRICAL DETAILS		

FLECTRICAL DETAILS

ELECTRICAL DETAILS
ELECTRICAL DETAILS
ELECTRICAL DETAILS

NOTE: ALL NOTES IN RED ARE DESIGN NOTES ONLY AND WILL NOT BE

INCLUDED IN THE FINAL PLAN SET. THESE ARE TO ASSIST IN INTERNAL DESIGN AND REVIEW ONLY.

NOTICE OF EXTEND PAYMENT PROVISION THIS CONTRACT ALLOWS OWNER TO MAKE PAYM WITHIN 45 DAYS AFTE SUBMISSION OF AN UNDISPUTED REQUIFED REQUIFED PAYMENT.

PRELIMINAR'

Know who below Call betayou di

Date: September 27, 201
Scale: Horiz: NONE

Vert: N/A
Project No: 692130

NAVAJO RESERVATION

O JECT SITE MAP

GENERAL NOTES

- THE ENGINEER WAIVES ANY AND ALL RESPONSIBILITY AND IS NOT LIABLE FOR PROBLEMS THAT MAY ARISE FROM CONTRACTOR'S FAILURE
 TO FOLLOW THESE DRAWINGS, SPECIFICATIONS, AND THE DESIGN INTENT THEY CONVEY, OR FOR PROBLEMS ARISING FROM FAILURE TO
 OBTAIN AND/OR FOLLOW THE ENGINEER'S GUIDANCE WITH RESPECT TO ANY ERRORS, OMISSIONS, INCONSISTENCIES, AMBIGUITIES, OR
 CONFLICTS.
- IF THERE IS A CONFLICT BETWEEN THE PLANS, SPECIFICATIONS AND/OR MANUFACTURER'S RECOMMENDATIONS FOR ANY DEVICE, PART,
 OR MATERIAL USED IN THE PROJECT, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER, IN WRITING, FOR CLARIFICATION AT
 LEAST TWO WEEKS PRIOR TO CONSTRUCTION OF SAID DEVICE. PART. OR MATERIAL.
- 3. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO FAMILIARIZE HIMSELF WITH THE LOCATION OF ALL UTILITIES LOCATED WITHIN THE LIMITS OF CONSTRUCTION. THE GENERAL LOCATION OF KNOWN EXISTING UTILITIES HAS BEEN SHOWN ON THE CONSTRUCTION DRAWINGS TO INDICATE THAT CAUTION MUST BE EXERCISED WHEN WORKING IN THESE AREAS. IN MANY CASES THE EXACT LOCATION OF THE FACILITIES IS NOT KNOWN. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND PROTECTING ALL OVERHEAD AND UNDERGROUND UTILITIES WITHIN THE VICINITY OF THE NEW CONSTRUCTION. PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR, WORKING WITH THE RESPECTIVE UTILITY COMPANIES, SHALL ACCURATELY LOCATE AND MARK ALL BURIED FACILITIES, INCLUDING SERVICE LINES. ALL EQUIPMENT LABOR, ETC. NECESSARY TO PROPERLY LOCATE THE EXISTING UTILITIES SHALL BE FURNISHED BY THE CONTRACTOR, THE COST OF WHICH SHALL BE INCIDENTAL TO THE WORK.
- CONTRACTOR SHALL REPAIR ANY EXISTING STRUCTURE OR UTILITY PIPELINE DAMAGED DURING THE EXECUTION OF THE PROJECT, AT NO
 ADDITIONAL COSTS TO THE OWNER.
- CONTRACTOR IS SOLELY RESPONSIBLE FOR CONSTRUCTING THE PROJECT ACCORDING TO CURRENT NEW MEXICO STANDARD
 SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (NMSSPWC) AWWA SPECS AND NAVAJO NATION / NTUA STANDARDS, INCLUDING
 WHERE PARTICULAR WORK ITEMS ARE NOT SPECIFIED HEREIN.
- 6. CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS AS SET FORTH IN THE TECHNICAL SPECIFICATIONS AND CONTRACT DOCUMENTS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO CONTACT THE ENGINEER REGARDING ANY QUESTION ARISING FROM ANY ASPECT OF THIS PROJECT NOT SPECIFICALLY COVERED IN THE PLANS AND TECHNICAL SPECIFICATIONS, OR ANY CHANGES OR CORRECTIONS TO THE PLANS AND SPECS.
- 7. THESE DRAWINGS DO NOT INCLUDE NECESSARY COMPONENTS FOR CONSTRUCTION SAFETY, WHICH SHALL REMAIN WHOLLY THE RESPONSIBILITY OF THE CONTRACTOR. ALL WORK ON THIS PROJECT SHALL BE PERFORMED IN ACCORDANCE WITH APPLICABLE FEDERAL (OSHA), STATE, TRIBAL AND LOCAL LAWS, RULES AND REGULATIONS CONCERNING SAFETY AND HEALTH. ALL EXCAVATION, TRENCHING AND SHORING ACTIVITIES MUST BE CARRIED OUT IN ACCORDANCE WITH OSHA 29 CFR 1926, SUBPART P - EXCAVATIONS.
- CONTRACTOR SHALL PROVIDE INGRESS AND EGRESS TO ANY LOCAL BUSINESSES AND RESIDENTS AS REQUIRED FOR THE DURATION OF
 THE PROJECT. THE CONTRACTOR SHALL ADVISE OF AND SCHEDULE ACCESS CLOSURES AT LEAST 24 HOURS IN ADVANCE WITH PROPERTY
 OWNERS AND THE ENGINEER.
- THE CONTRACTOR SHALL CONFINE HIS OPERATIONS TO THE CONSTRUCTION LIMITS OF THE PROJECT AND SHALL IN NO WAY ENCROACH
 ONTO ADJACENT PROPERTIES UNLESS LEGAL EASEMENTS ARE PROVIDED OR SECURED BY THE CONTRACTOR. THE CONTRACTOR WILL BE
 HELD RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONSTRUCTION ACTIVITIES TO PUBLIC OR PRIVATE PROPERTY. INCLUDING UTILITIES.
- 10. THE DRAWINGS CONTAIN SPECIFIC EROSION CONTROL FEATURES DESIGNED BY THE ENGINEER TO PROTECT PROJECT FACILITIES FROM EROSION. THESE FEATURES ARE NOT DESIGNED TO PREVENT POLLUTION OF WATERWAYS DUE TO SEDIMENT. THE CONTRACTOR IS WHOLLY RESPONSIBLE TO PROVIDE A STORM WATER POLLUTION PREVENTION PLAN (SWPPP) AND IMPLEMENT THE BEST MANAGEMENT PRACTICES (BMPs) REQUIRED THEREIN, IN ADDITION TO THE FEATURES SHOWN ON THE DRAWINGS. ALL BID ITEMS REFERRING TO SPECIFIC EROSION CONTROL FEATURES, SUCH AS RIPRAP OR ROCK DAMS, ARE APPLICABLE ONLY TO FEATURES DESIGNED BY THE ENGINEER. A SEPARATE BID ITEM(S) IS PROVIDED FOR PREPARATION AND IMPLEMENTATION OF THE CONTRACTOR'S SWPPP.
- 11. ALL RIPRAP, ROCK CHECK DAMS AND OTHER EROSION CONTROL FEATURES SHOWN ON THE DRAWINGS ARE APPROXIMATE WITH REGARD TO QUANTITY, LOCATION, DIMENSIONS, SPACING, AND ORIENTATION. EXACT PLACEMENT WILL BE DETERMINED IN FIELD BY ENGINEER AFTER FINAL GRADING IS COMPLETE.
- 12. ALL AREAS DISTURBED BY THE CONSTRUCTION ACTIVITIES OF THIS PROJECT SHALL BE RESTORED AND RE-GRADED IN A MANNER ACCEPTABLE TO THE OWNER, ENGINEER, AND LAND OWNER. ALL DISTURBED AREAS SHALL BE RE-SEEDED PER THE CONTRACT DOCUMENTS.
- 13. FUSIBLE PVC PIPE SHALL BE USED IN LIEU OF ALL RESTRAINED JOINTS AND SHALL BE USED ON BOTH SIDES OF ALL ISOLATION VALVES, CASINGS, TEES, AND BENDS. REFER TO SPECIFICATIONS AND DETAIL, SHEET DT-3. IN ADDITION, THE PLAN AND PROFILE SHEETS INDICATE SPECIFIC ADDITIONAL LOCATIONS WHERE FUSIBLE PVC PIPE MUST BE USED IN LIEU OF BELL-AND-SPIGOT PIPE. IN THE ABSENCE OF ANY REQUIREMENT TO USE FUSIBLE PVC PIPE, CONTRACTOR HAS THE OPTION TO USE EITHER FUSIBLE OR BELL-AND-SPIGOT PIPE. IN THESE DRAWINGS, THE TERMS "BELL-AND-SPIGOT PIPE" AND "JOINTED PIPE" ARE USED SYNONYMOUSLY.
- 14. AT MOST LOCATIONS, THE PLAN AND PROFILE SHEETS SHOW HORIZONTAL BENDS WITHOUT SPECIFYING WHETHER THE HORIZONTAL BEND IS TO BE ACCOMPLISHED BY DI ELLS, FUSIBLE PVC SWEEPS, BENDING OF FUSIBLE PVC PIPE, OR JOINT DEFLECTION OF JOINTED PVC PIPE. AT SUCH LOCATIONS, THE METHOD OF BENDING IS AT CONTRACTOR'S OPTION, PROVIDED ALL DESIGN REQUIREMENTS SET FORTH IN THE DRAWINGS AND SPECIFICATIONS ARE MET. AT LOCATIONS WHERE FUSIBLE PVC SWEEPS ARE SHOWN, THEY MUST BE USED.
- 15. ALL PRESSURE RATINGS GIVEN HEREIN FOR PIPES, VALVES, FITTINGS AND OTHER COMPONENTS REFER TO COLD WATER WORKING PRESSURE RATING, UNLESS OTHERWISE NOTED.
- 16. VERTICAL CLEARANCES AT WATERLINE CROSSINGS ON PLAN AND PROFILE SHEETS CALLED OUT AS "MIN CLR TO CL" REFER TO MINIMUM CLEARANCE FROM BOTTOM OF EXISTING WATERLINE TO VERTICAL CENTERLINE OF PROPOSED WATERLINE. VERTICAL CLEARANCES FOR CASINGS CALLED OUT AS "MIN CLR TO CASING" REFER TO MINIMUM CLEARANCE FROM BOTTOM OF EXISTING PIPELINE OR FINISHED GRADE TO TOP OF PROPOSED CASING. VERTICAL CLEARANCES AT WASH CROSSINGS CALLED OUT AS "MIN TO CL" REFER TO MINIMUM PIPE DEPTH, MEASURED FROM BOTTOM OF WASH TO VERTICAL CENTERLINE OF PROPOSED WATERLINE.

- 17. REFER TO PROFESSIONAL REGISTRANTS IDENTIFIED ON INDIVIDUAL PLAN SHEETS AS THE RESPONSIBLE PARTY FOR THOSE DISCIPLINES.

 THE SEAL AND SIGNATURE OF THE PROFESSIONAL REGISTRANT IDENTIFIED ON THIS COVER SHEET DOES NOT INDICATE RESPONSIBLE
 CHARGE FOR ALL SHEETS CONTAINED WITHIN THIS PACKAGE OR ANY PLAN SHEETS NOT SIGNED AND SEALED.
- 18. ALL SCALES ARE BASED ON 11" x 17" SHEET SIZE.

CONTACT INFORMATION:

NAVAJO NATION WATER MANAGEMENT BRANCH (OWNER):

JASON JOHN (928) 729-4004

SOUDER, MILLER & ASSOCIATES (ENGINEER):

TORY TADANO, P.E (OFFICE) (505) 299-0942

NAVAJO TRIBAL UTILITY AUTHORITY (NTUA):

IRON PIPE SIZE

KILO POUNDS PER SQUARE INCH

CROWNPOINT SUB-OFFICE (800) 528-5011 (ext. 4758)

ABBREVIATIONS

						EXISTING DRAINAGE WASH	
AASHTO	AMERICAN ASSOCIATION OF STATE HIGHWAY	LF	LINEAR FEET			EXISTING DIVAINAGE WASH	
	AND TRANSPORTATION OFFICIALS	LT	LEFT				
A.C.	ASPHALTIC CONCRETE	LONG	LONGITUDE			GUARD RAIL	
ACI	AMERICAN CONCRETE INSTITUTE	LVC	LENGTH VERTICAL CURVE				
AC.	ACRE	MANUF	MANUFACTURER			ROAD EDGE	
AC-FT.	ACRE FEET	MAX.	MAXIMUM				
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION	MIL	ONE THOUSANDTHS OF AN INCH			DOAD OFFITED	
ALIGN.	ALIGNMENT	MIN.	MINIMUM			ROAD CENTER	
ALUM	ALUMINUM	M.J.	MECHANICAL JOINT		2402		
AMSL	ABOVE MEAN SEA LEVEL	MNPT	MALE NATIONAL PIPE THREAD		6490	CONTOUR MAJOR	
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE	M.S.L.	MEAN SEA LEVEL				
APPROX.	APPROXIMATE	N.O.L.	NORTH		6492	CONTOUR MINOR	
ARV	AIR RELEASE VALVE	N	NORTHING			CONTOUR MINUR	
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS	N.C.	NATIONAL ELECTRICAL CODE		^		
AWG	AMERICAN WIRE GAUGE	NEC.	NORMALLY CLOSED		•	SECTION CORNER	
AWWA	AMERICAN WATER WORKS ASSOCIATION	NG	NATURAL GAS		_		
BFV	BUTTERFLY VALVE	NGWSP	NAVAJO GALLUP WATER SUPPLY PROJECT			CULTURALLY / BIOLOGICALLY SENSITI	/E AREA
BIA	BUREAU OF INDIAN AFFAIRS	NM	NEW MEXICO		EXXXXX	DO NOT ENCROACH	
BLDG	BUILDING	NMDOT	NEW MEXICO DEPARTMENT OF TRANSPORTATION		4.0		
BLM	BUREAU OF LAND MANAGEMENT	NMED	NEW MEXICO DEPARTMENT OF TRANSPORTATION NEW MEXICO ENVIRONMENT DEPARTMENT		12	SECTION NUMBER	
	BALL VALVE	NN	NAVAJO NATION				
BV					Tribal Trust/LA./BLM	CURRENT LAND STATUS (OWNER)	
BVCE BVCS	BEGIN VERTICAL CURVE ELEVATION	NO. N.O.	NUMBER NORMALLY OPEN			,	
	BEGIN VERTICAL CURVE STATION				D.	OFOTION LINE	
CL	CENTERLINE	NPT	NATIONAL PIPE THREAD		——————————————————————————————————————	SECTION LINE	
CFS	CUBIC FEET PER SECOND	NTS	NOT TO SCALE				
CI	CAST IRON	OAE	OR APPROVED EQUAL			QUARTER SECTION LINE	
CLR.	CLEARANCE	O.C.	ON CENTER		-		
CMP	CORRUGATED METAL PIPE	O.C.E.W.	ON CENTER EACH WAY			TOWNSHIP / RANGE LINE	
COMM.	COMMUNICATION	O.D.	OUTER DIAMETER			TOWNSHIP / RANGE LINE	
CONC.	CONCRETE	OHE	OVERHEAD ELECTRICAL				
CONST.	CONSTRUCTION	PE	PLAIN END		X	FENCE	
CONT.	CONTINUOUS	P.G.P.	PER GRADING PLAN				
CONT.	CONTINUED	PI	POINT OF INFLECTION		OHE	OVERHEAD POWER LINE	
COR.	CORNER	PROP	PROPOSED		OHL	OVERTICAD FOWER LINE	
COUP.	COUPLING	PRV	PRESSURE REDUCING VALVE				
CP	CONTROL POINT	PSF	POUNDS PER SQUARE FOOT		UGE	UNDERGROUND POWER LINE	
CTR	CENTER	PSI	POUNDS PER SQUARE INCH				
CU	CUBIC	PVC	POLY VINYL CHLORIDE		TEL	OVERHEAD TELEPHONE LINE	
CY	CUBIC YARD	PVI	POINT VERTICAL INFLECTION		122	OVERTIEND TELEFITIONE BINE	
DI	DUCTILE IRON	PVT	PRIVATE				
DIA	DIAMETER	Q	FLOW		UGT	UNDERGROUND TELEPHONE LINE	
DIMS	DIMENSIONS	QTY.	QUANTITY				
DR	DIMENSION RATIO	R	RADIUS		w	WATER LINE	
DW	DRIVEWAY	R-	RANGE		**		
E	EAST	REF	REFERENCE		—— G ——	04011115	
E	EASTING	RO	ROUGH OPENING		—— G ——	GAS LINE	
EA.	EACH	ROW	RIGHT OF WAY				
ED.	EDITION	RT	RIGHT				
EG	EXISTING GRADE	S	SOUTH				
ELEC.	ELECTRICAL	SCH	SCHEDULE			LEGEND	
EL., ELEV.	ELEVATION	SCO	SANDOVAL COUNTY		ı	LEGEND	
EOP	EDGE OF PAVEMENT	SDR	STANDARD DIMENSION RATIO			PROPOSED	
EQ.	EQUAL	SEC.	SECTION				
ESMT.	EASEMENT	SF	SAFETY FACTOR				
EVCE	END VERTICAL CURVE ELEVATION	SHT	SHEET —	— w —	 WATER LINE 	6965	CONTOUR MAJOR
EVCS	END VERTICAL CURVE STATION	SPECS.	SPECIFICATIONS	**			
	EXISTING	SS	STAINLESS STEEL	0.115		6964 —	
FBÉ	FUSION BONDED EPOXY	STA	STATION	OHE	 POWER LINE 		CONTOUR MINOR
FF	FINISHED FLOOR	STD.	STANDARD				
FFE	FINISHED FLOOR ELEVATION	SW	SIDEWALK	X	FENCE		40' WATERLINE EASEMENT
FG	FINISHED GRADE	Т	TOWNSHIP				
FIG.	FIGURE	TBD	TO BE DETERMINED	0 0	 CABLE BARRIER 		TEMPORARY CONSTRUCTION
FL	FLANGE	TBR	TO BE REMOVED	0	- CABLE BARRIER		EASEMENT
FND.	FOUND	TCE	TEMPORARY CONSTRUCTION EASEMENT				
FNPT	FEMALE NATIONAL PIPE THREAD	TDH	TOTAL DYNAMIC HEAD		PIPE CASING	7///////	ACCESS DRIVE / ROAD
FRP	FIBER REINFORCED PLASTIC	TELE.	TELEPHONE	•			
FT.	FEET	TEMP.	TEMPORARY	\otimes	GATE VALVE		RIP RAP OR CABLE CRETE
FV	FLUSH VALVE	THK	THICK	\bigcirc	ONTE VILVE	190X44	THE TOTAL OF CONDEE ONE IE
GA.	GAUGE	TNT	NAVAJO TRIBAL TRUST			विकासचे ।	
GALV.	GALVANIZED	T.O.	TOP OF	\otimes	BALL VALVE	2094	GRAVEL OVER BASE COURSE
GI	GALVANIZED IRON	TRANS	TRANSFORMER	ī			
GPM	GALLONS PER MINUTE	TW	TOP OF WALL	Ť	VACUUM BREAKER		BERM
GV	GATE VALVE	TYP	TYPICAL		AIR RELEASE VALVE	COMBO	
HDD	HORIZONTAL DIRECTIONAL DRILLING	UGE	UNDERGROUND ELECTRIC	ጥ	ELUCIDADAE		DRAIN PIPE
HDPE	HIGH DENSITY POLYETHYLENE	USGS	UNITED STATES GEOLOGICAL SURVEY	Ţ	FLUSH VALVE		DRAIN PIPE
HORIZ.	HORIZONTAL	V	VOLUME	•			
HP	HORSE POWER	V VB	VACUUM BREAKER	•	POWER POLE		SWALE
HT	HEIGHT	VERT.	VERTICAL	_			
HWY	HIGHWAY	VLV	VALVE		GUY ANCHOR		DIRECTION OF FLOW
I.A.	INDIAN ALLOTMENT	VR	VACUUM RELIEF	—)	GUT ANCHUR	_	22011011 01 12011
I.D.	INNER DIAMETER	W	WATER	▶			
I.E.	THAT IS, FOR EXAMPLE	W	WEST	\Box	STORM DRAIN INLET	/OUTLET — — — —	MATCH LINE

ハト

0

DOUBLE SWING GATE

BOULDER

W/ WL WP WT WV YDS

WATERLINE

YARDS ZENITH

WORKING PRESSURE

WALL THICKNESS

WATER VALVE



LEGEND

EXISTING

GATE VALVE

HYDRANT

WATER METER

POWER POLE

GUY ANCHOR

BUILDING

CATTLE GUARD

ROAD SIGN

ELECTRICAL J-BOX

TELEPHONE PEDESTAL

STORM DRAIN INLET / OUTLET

EXISTING DRAINAGE WASH

 \bowtie

(W)

X

Ф

—)

E

BUTTERFLY VALVE

GENERAL NOTES AND LEGEND
NAVAJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
ANDOVAL & MCKINLEY COUNTES. NEW MEXICO

esigned Drawn Chec

PRELIMINARY

OT FOR CONSTRUCTION

HIS DRAWING IS INCOMPLETE

AND NOT TO BE USED FOR

STAMPED, SIGNED AND DATE


NOTICE OF EXTENDED


PAYMENT PROVISION:
THIS CONTRACT ALLOWS THE
OWNER TO MAKE PAYMENT
WITHIN 45 DAYS AFTER
SUBMISSION OF
AN LINDISPLITED REQUIEST





Date: September 27, 2018


Scale: Horiz:
Vert:
Project No: 6921307

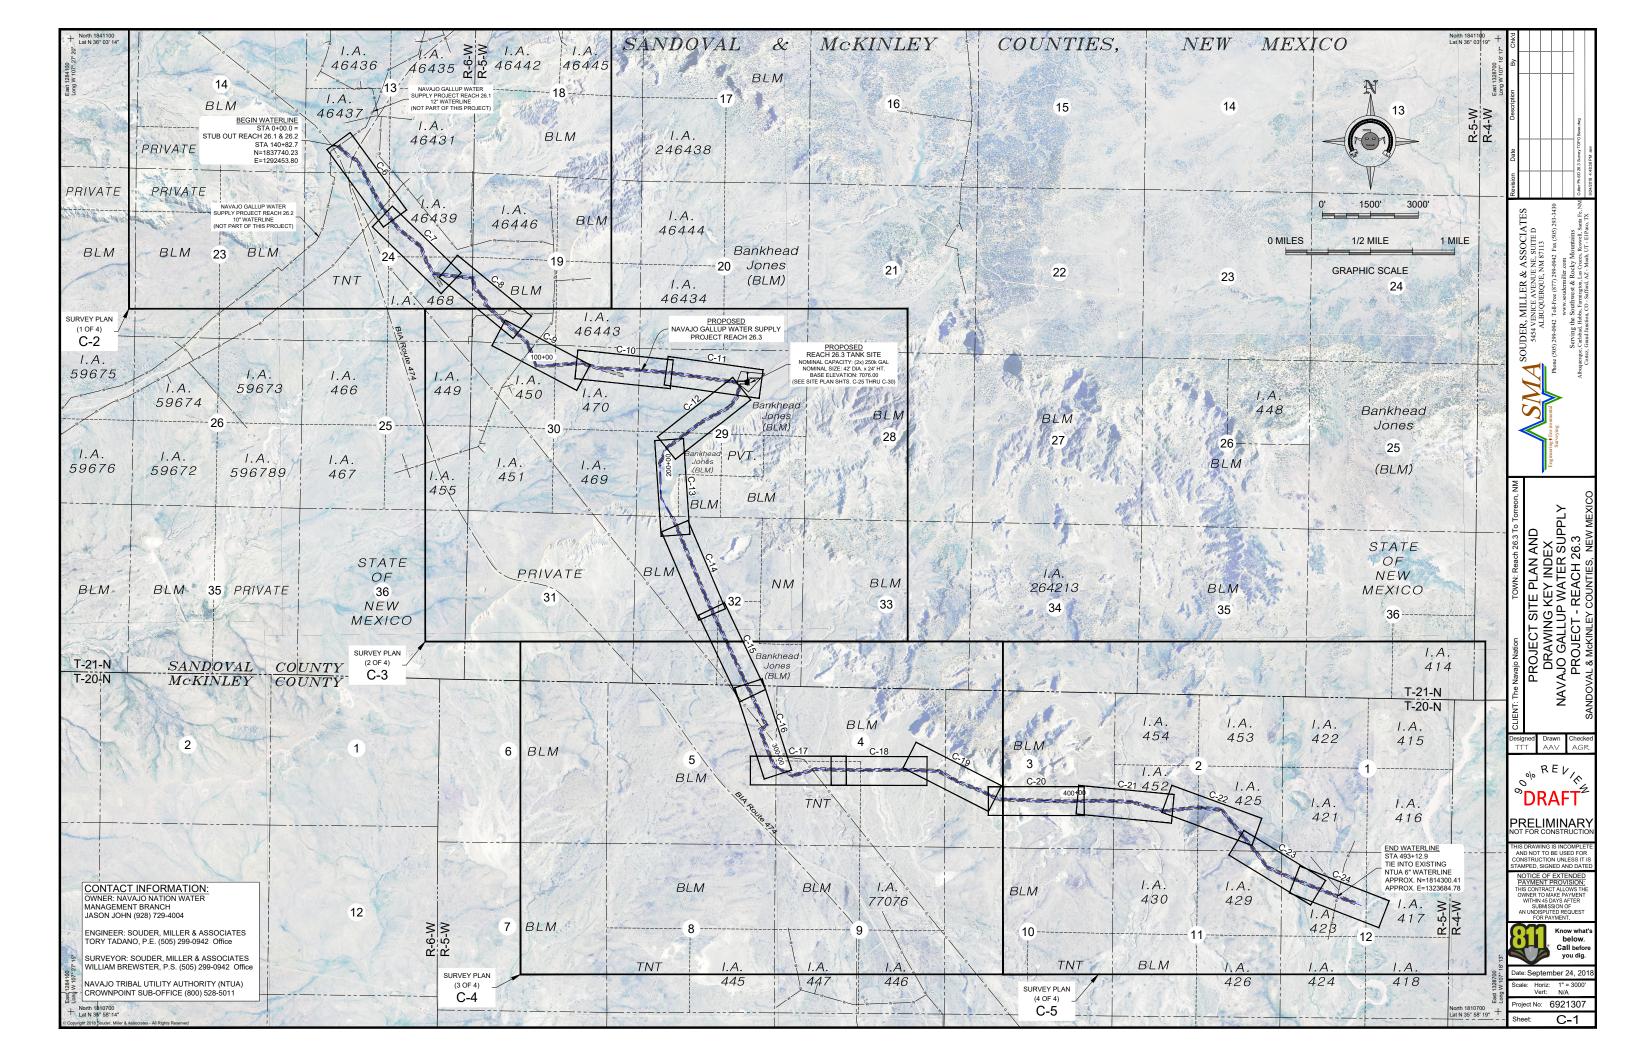


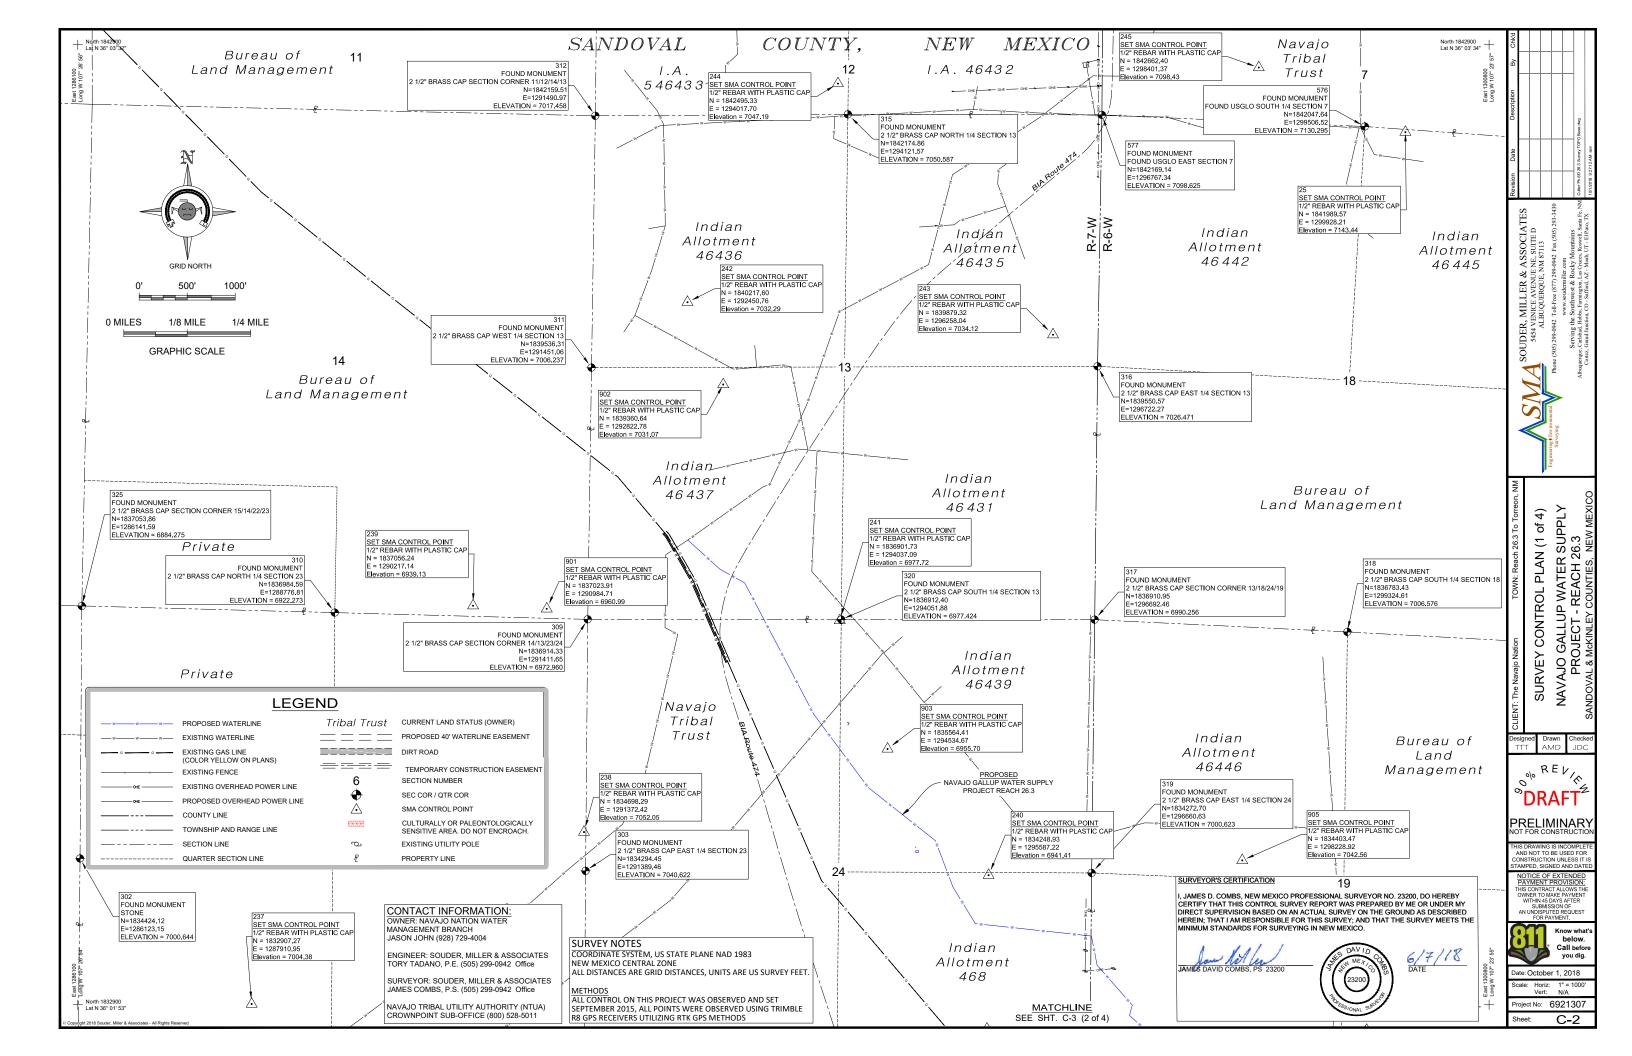


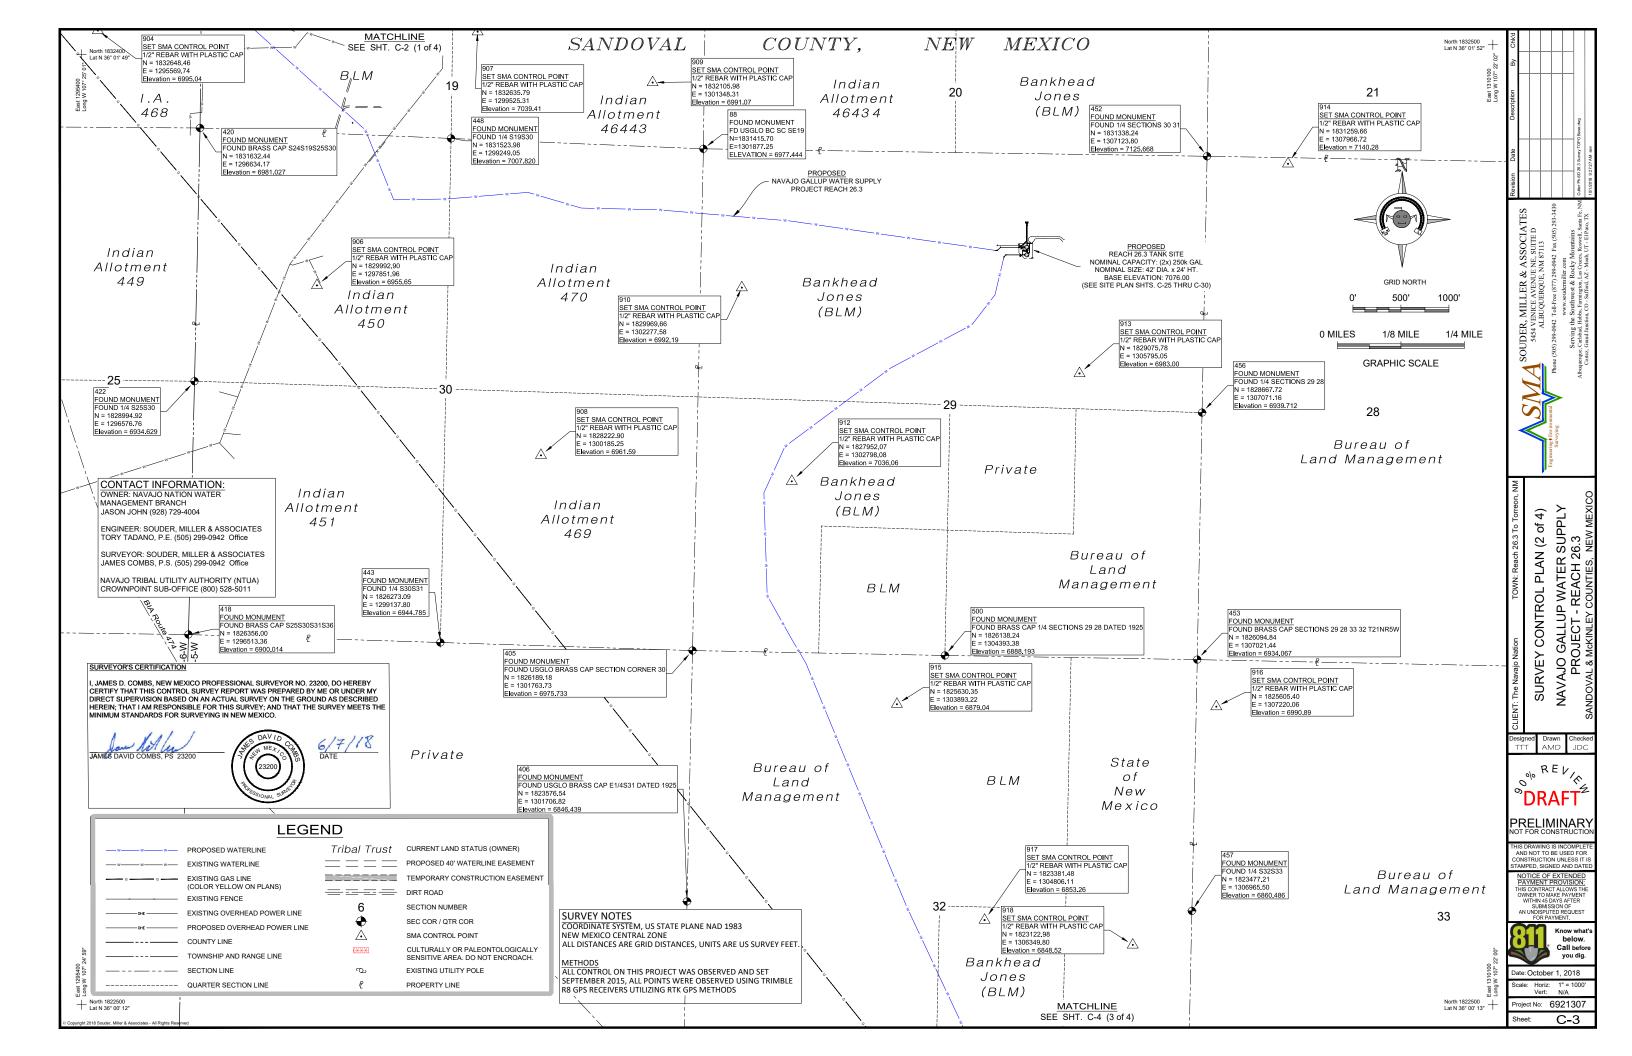


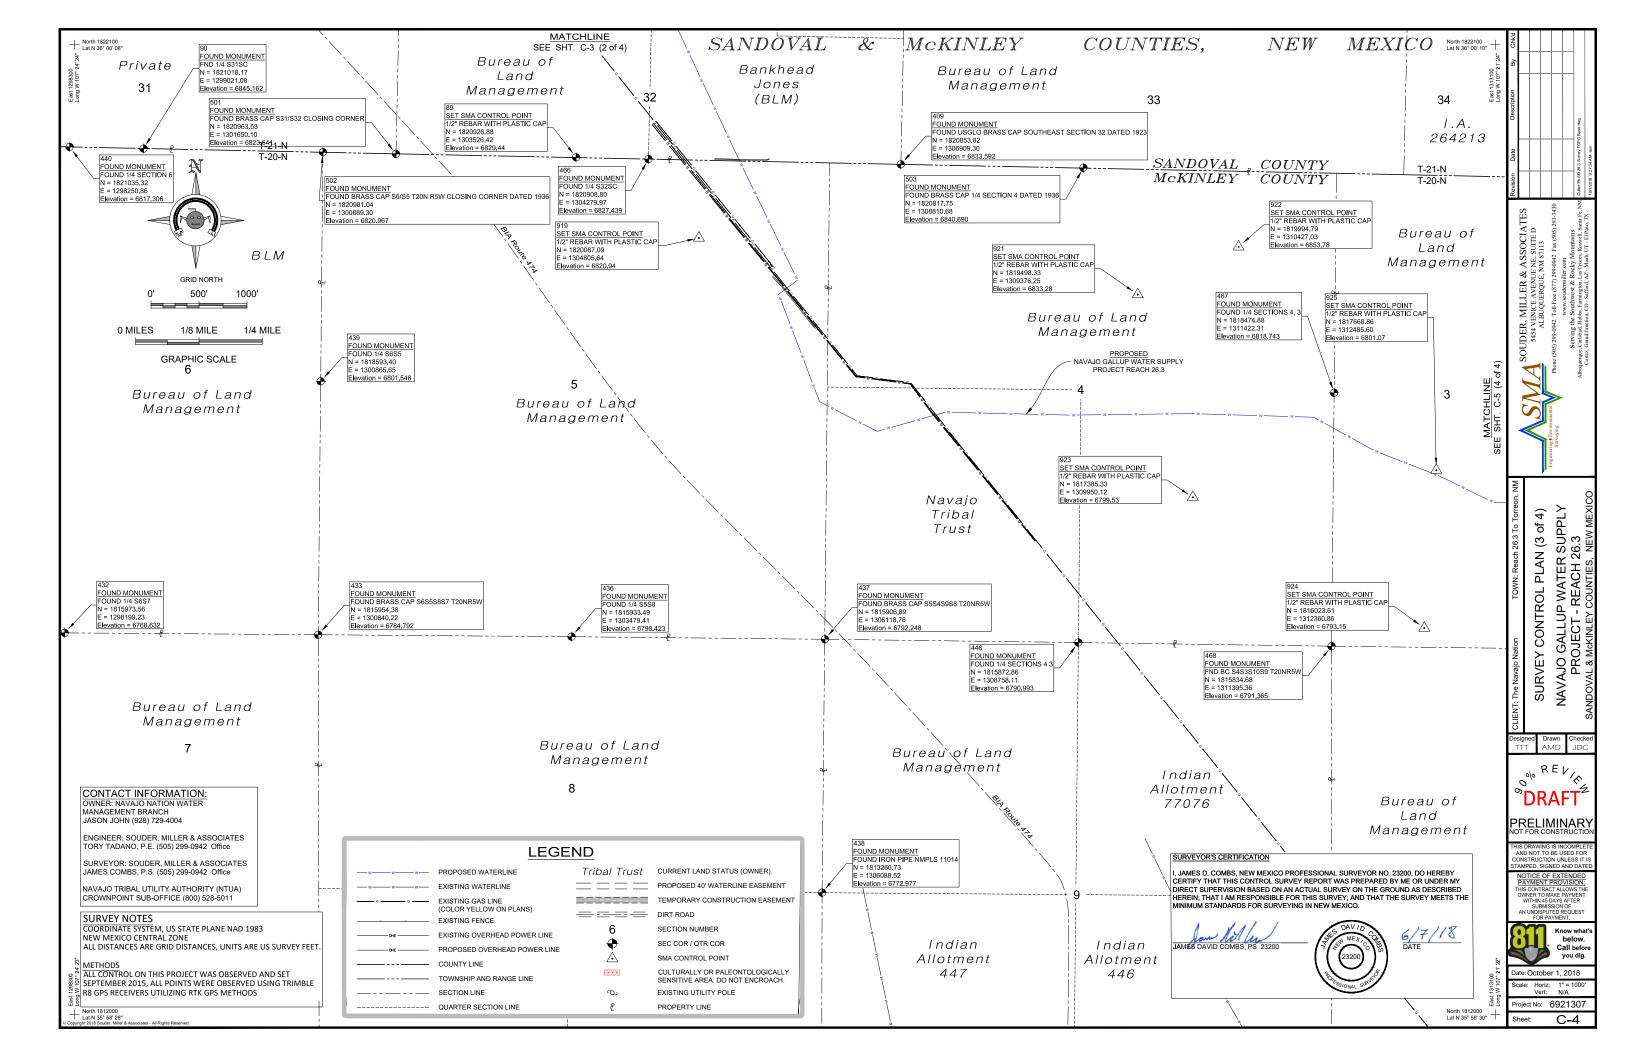


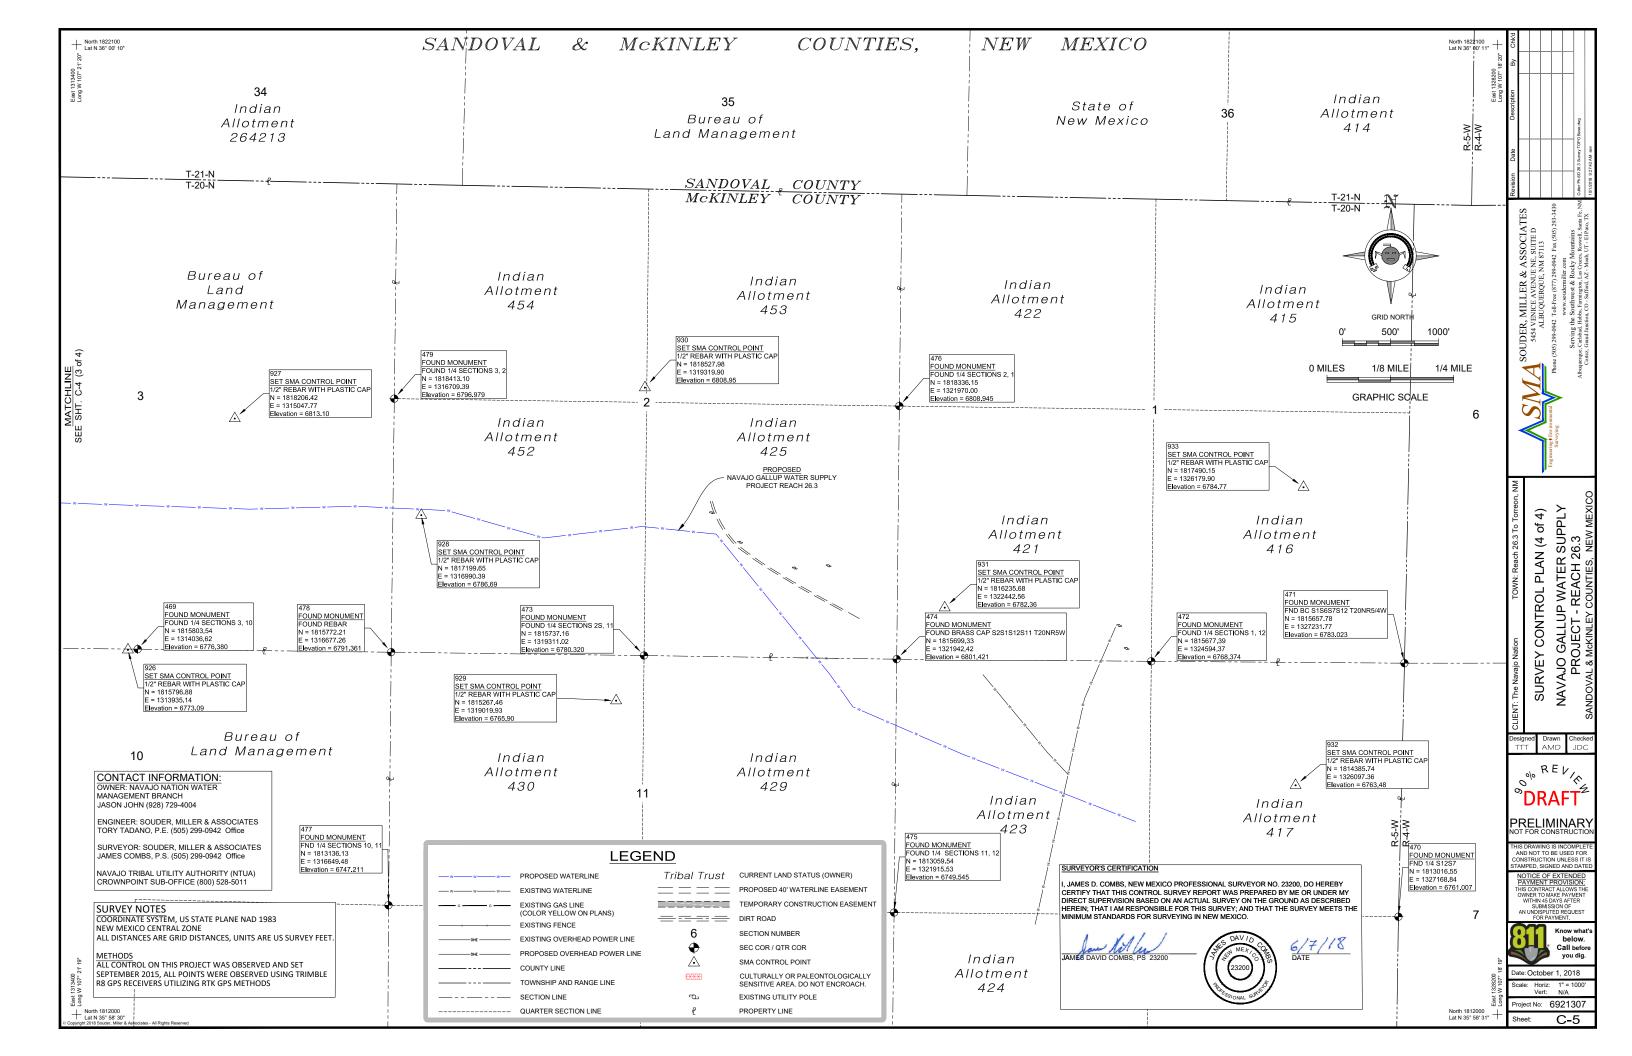


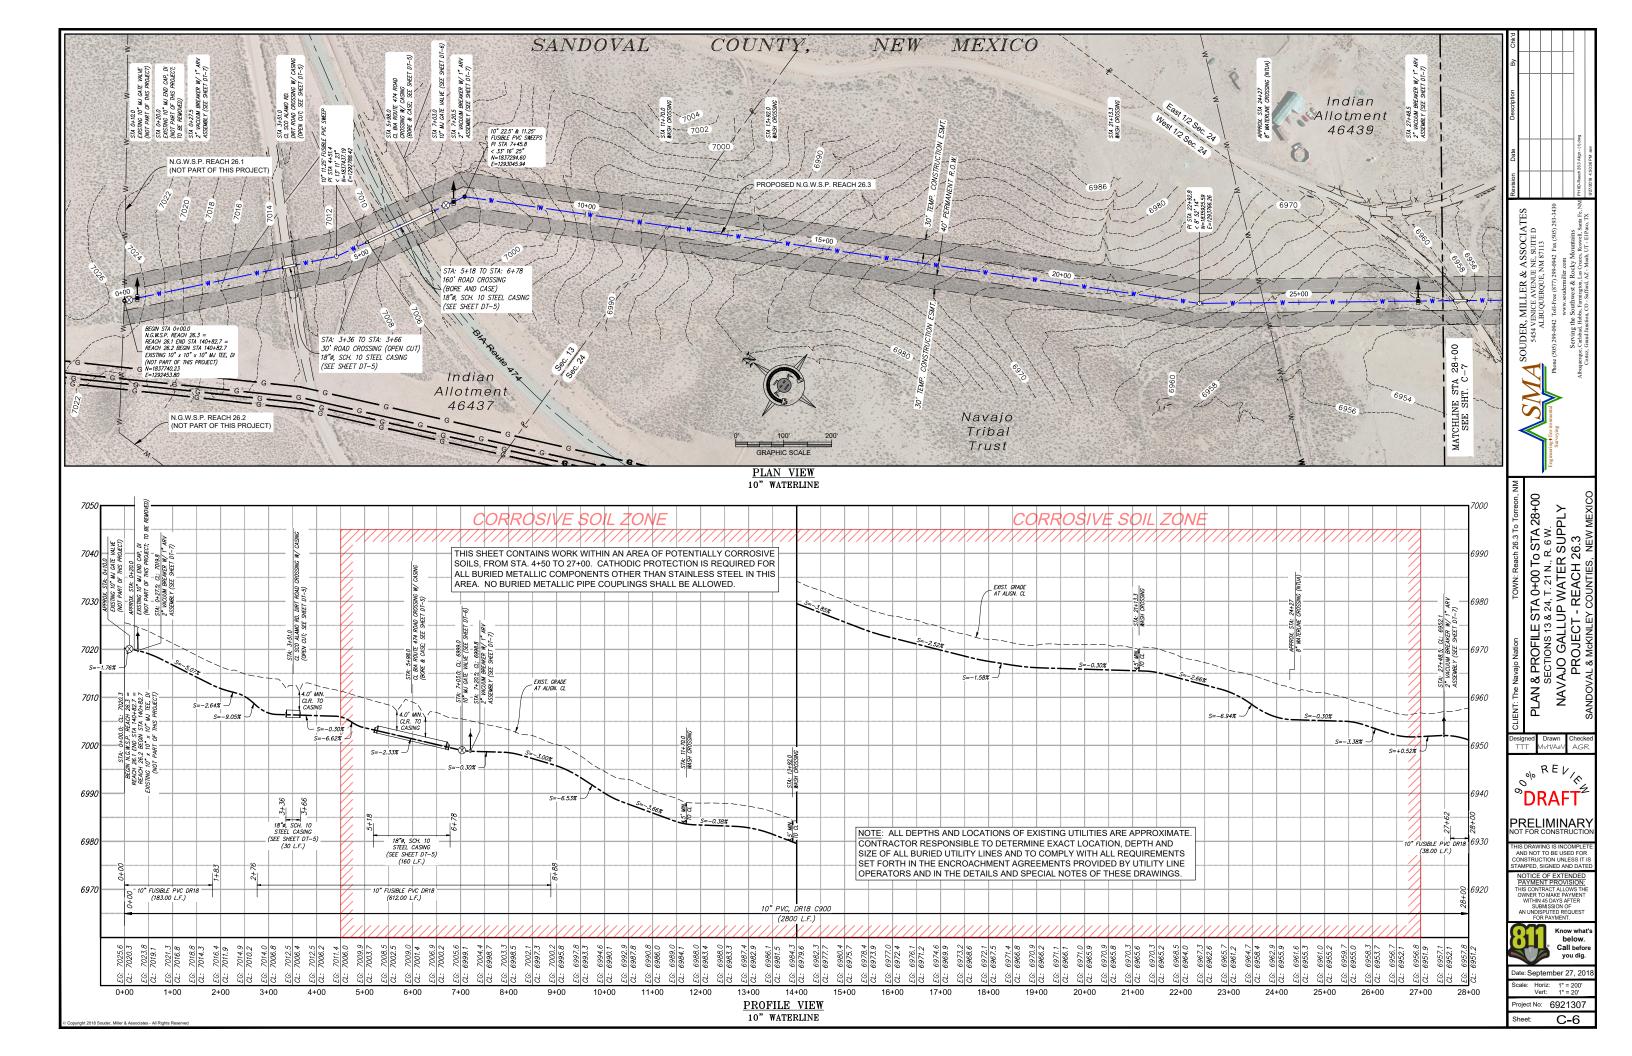


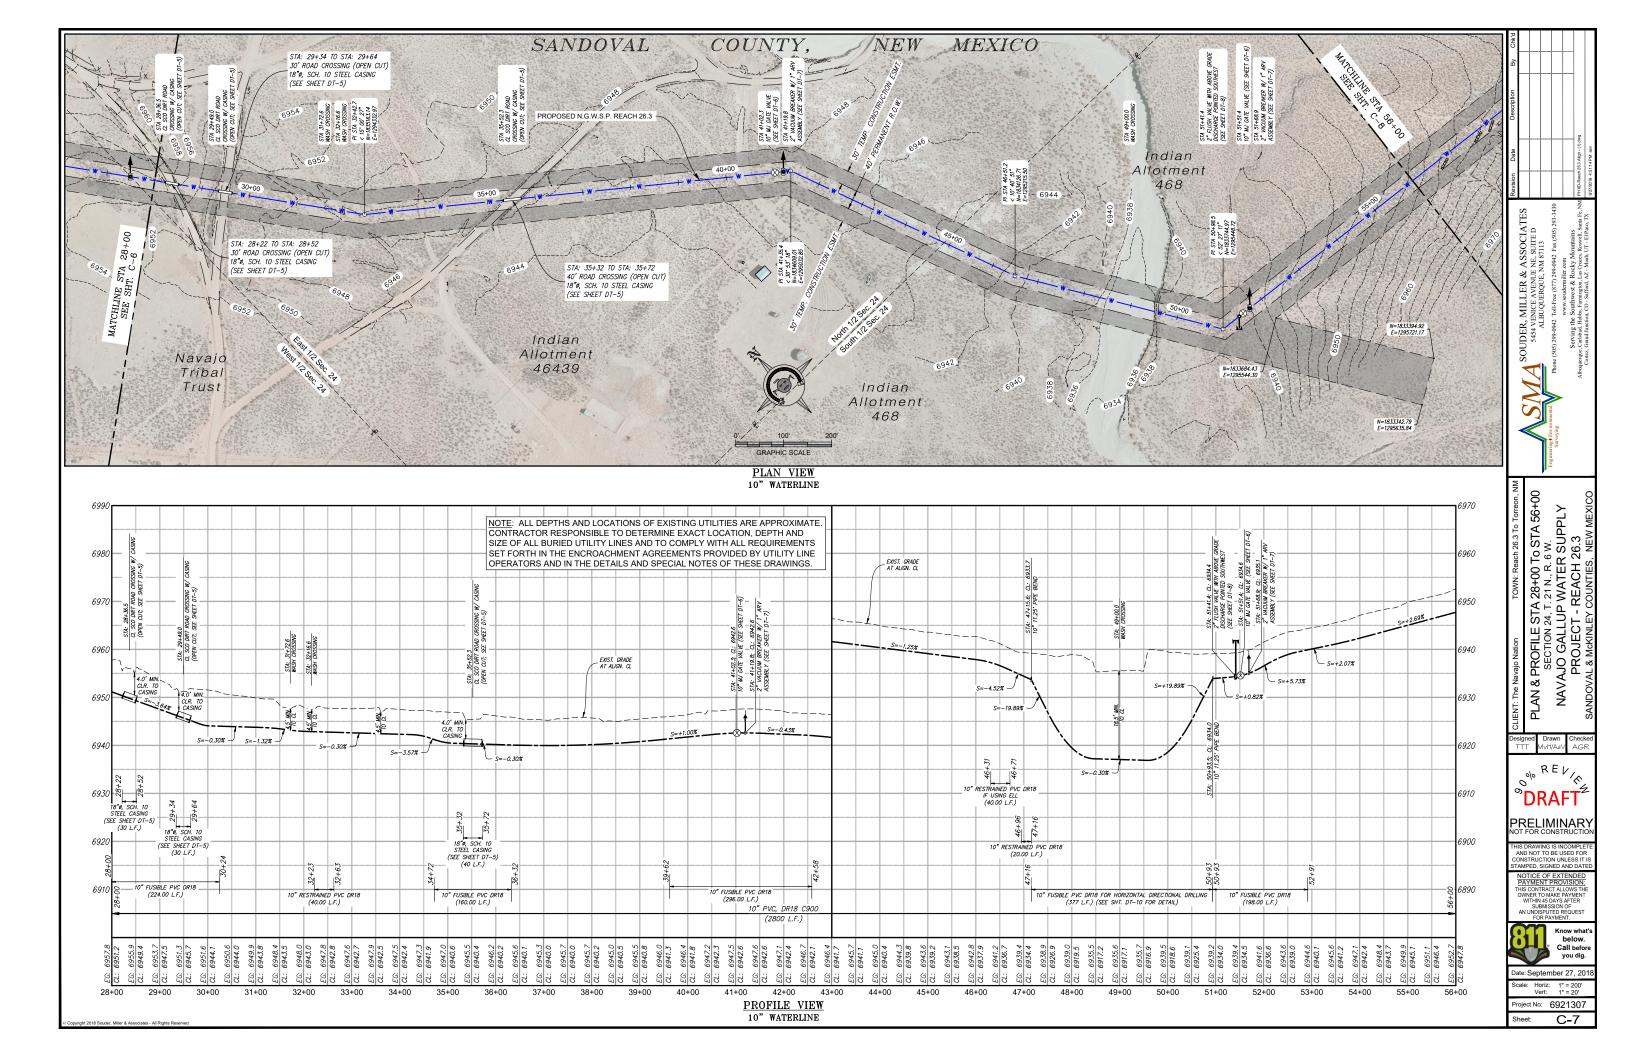


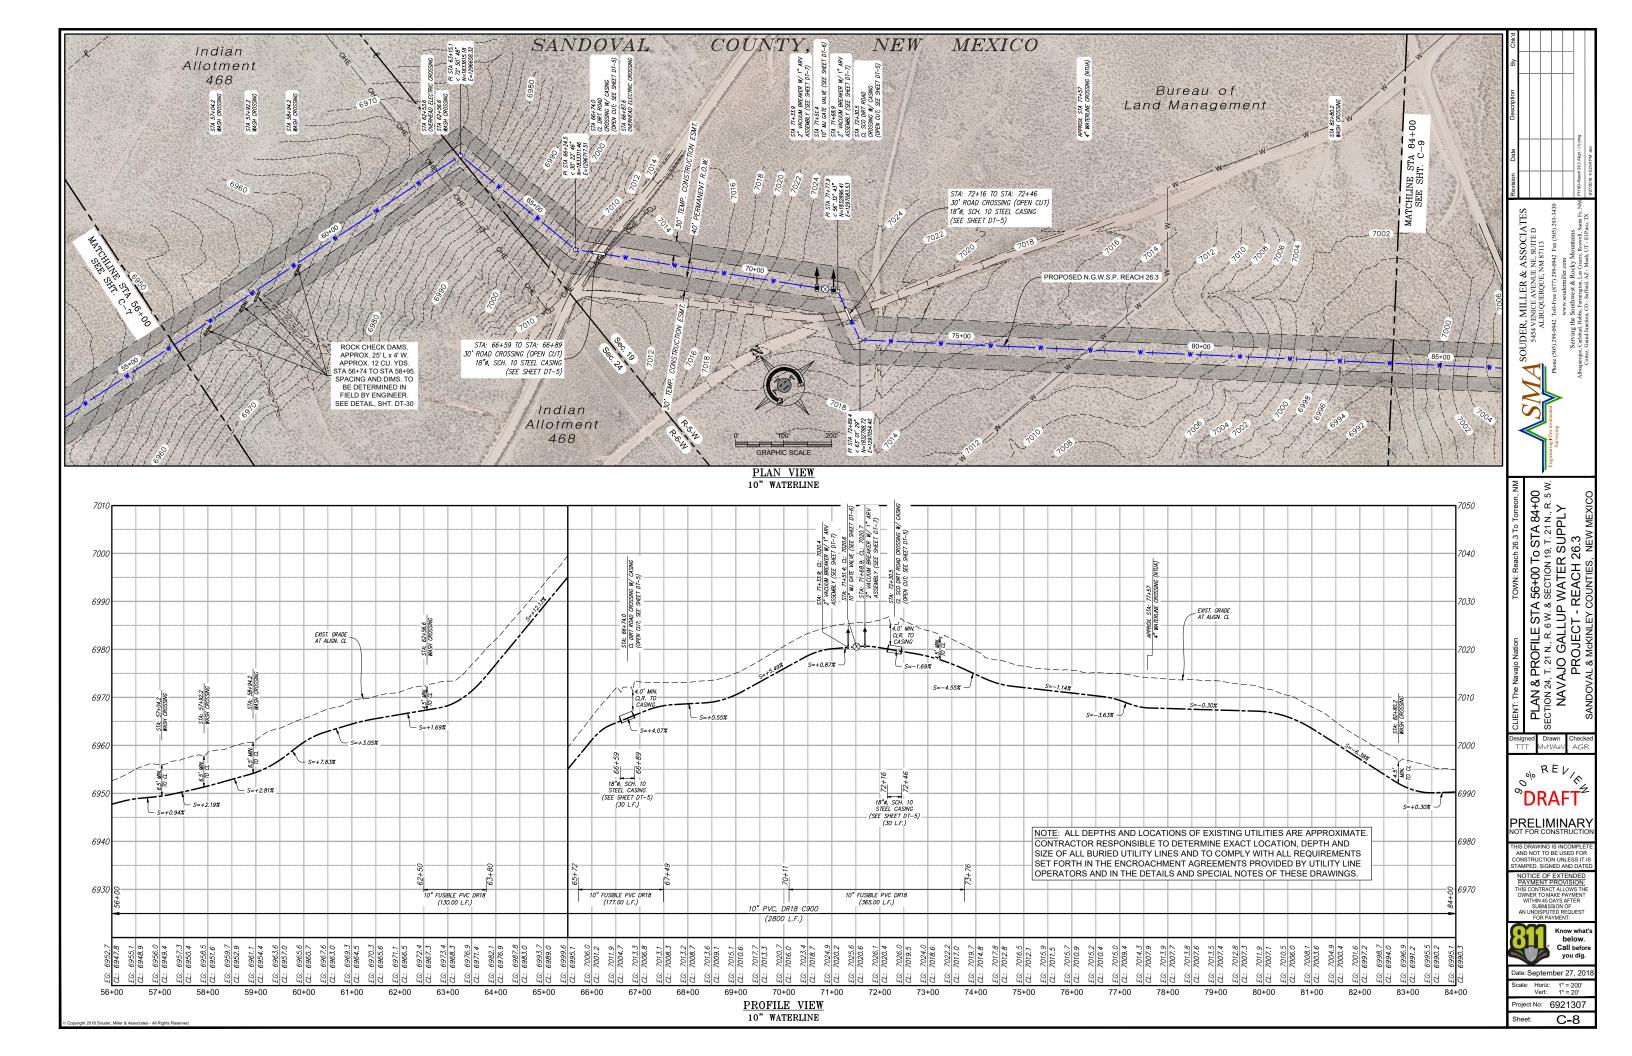


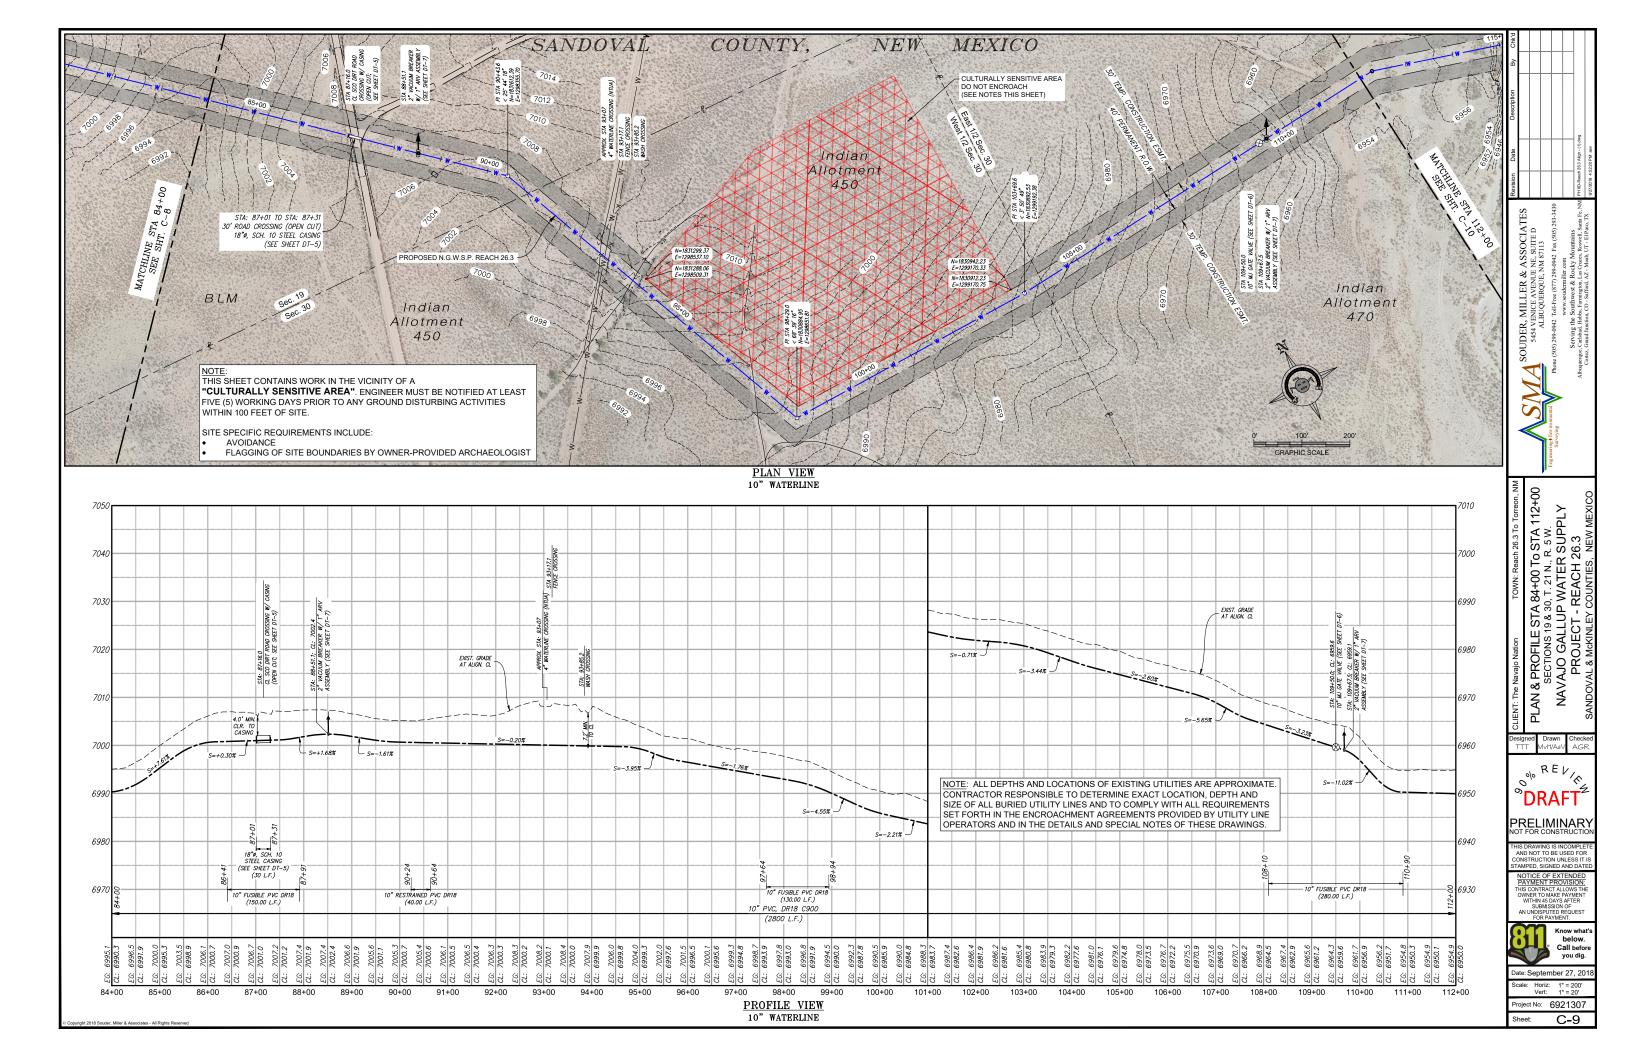


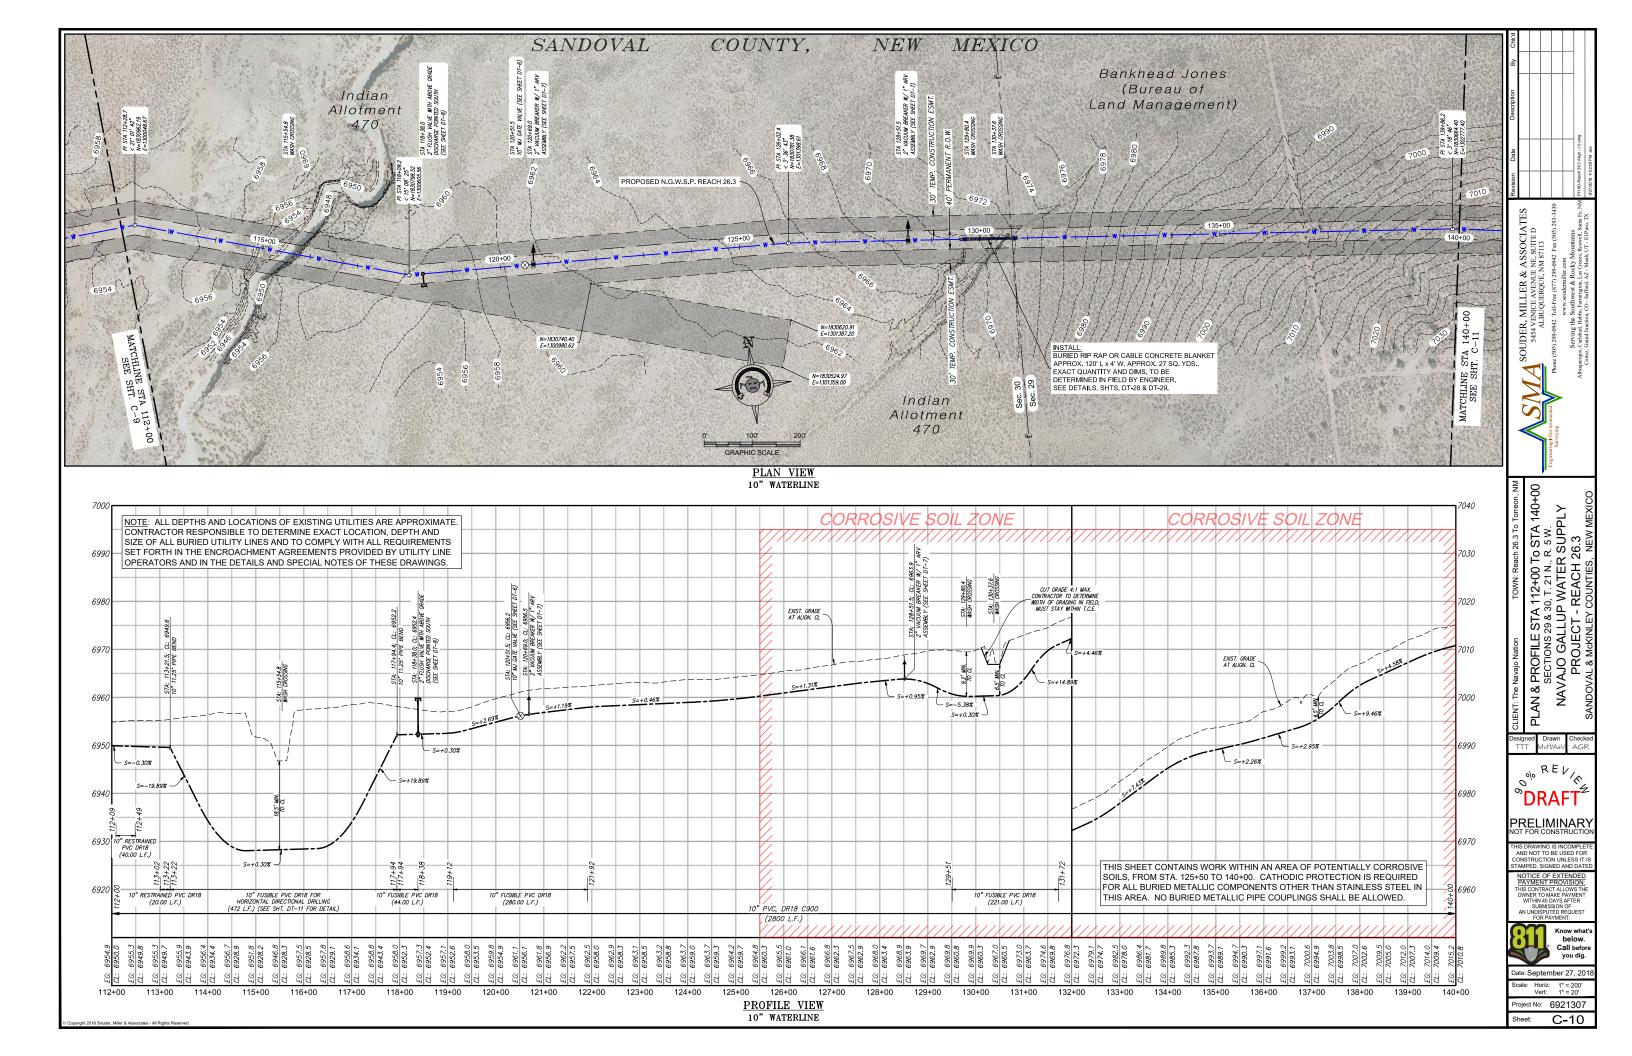


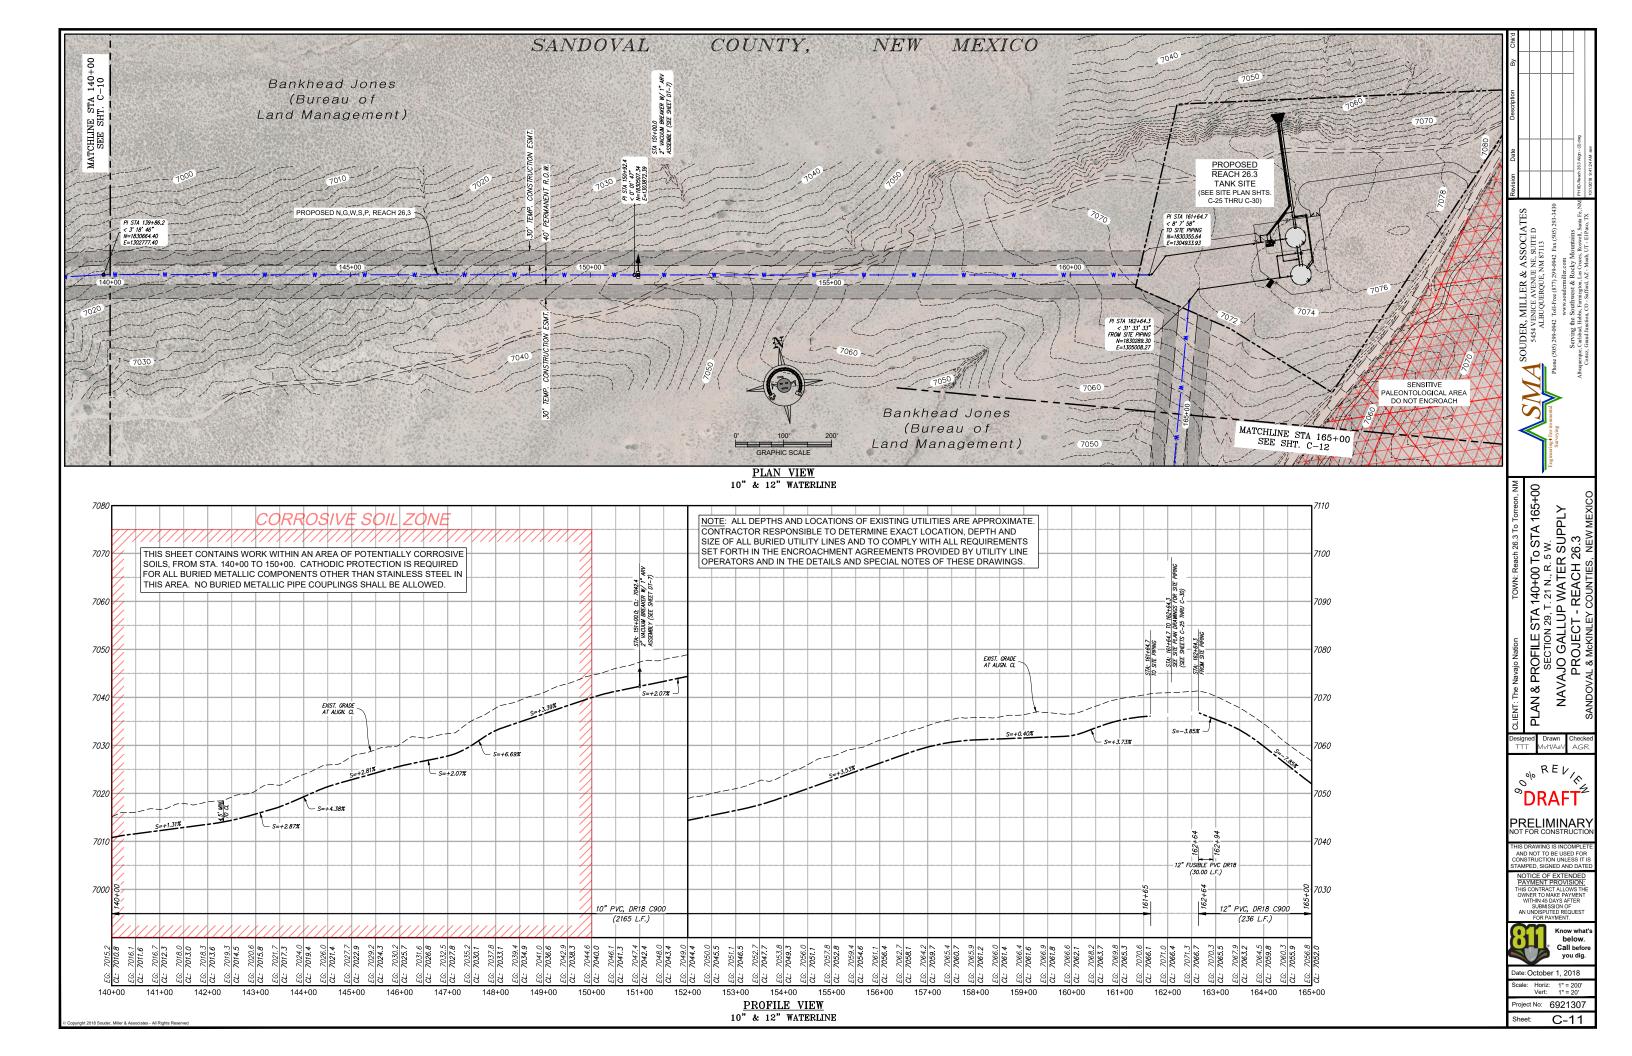


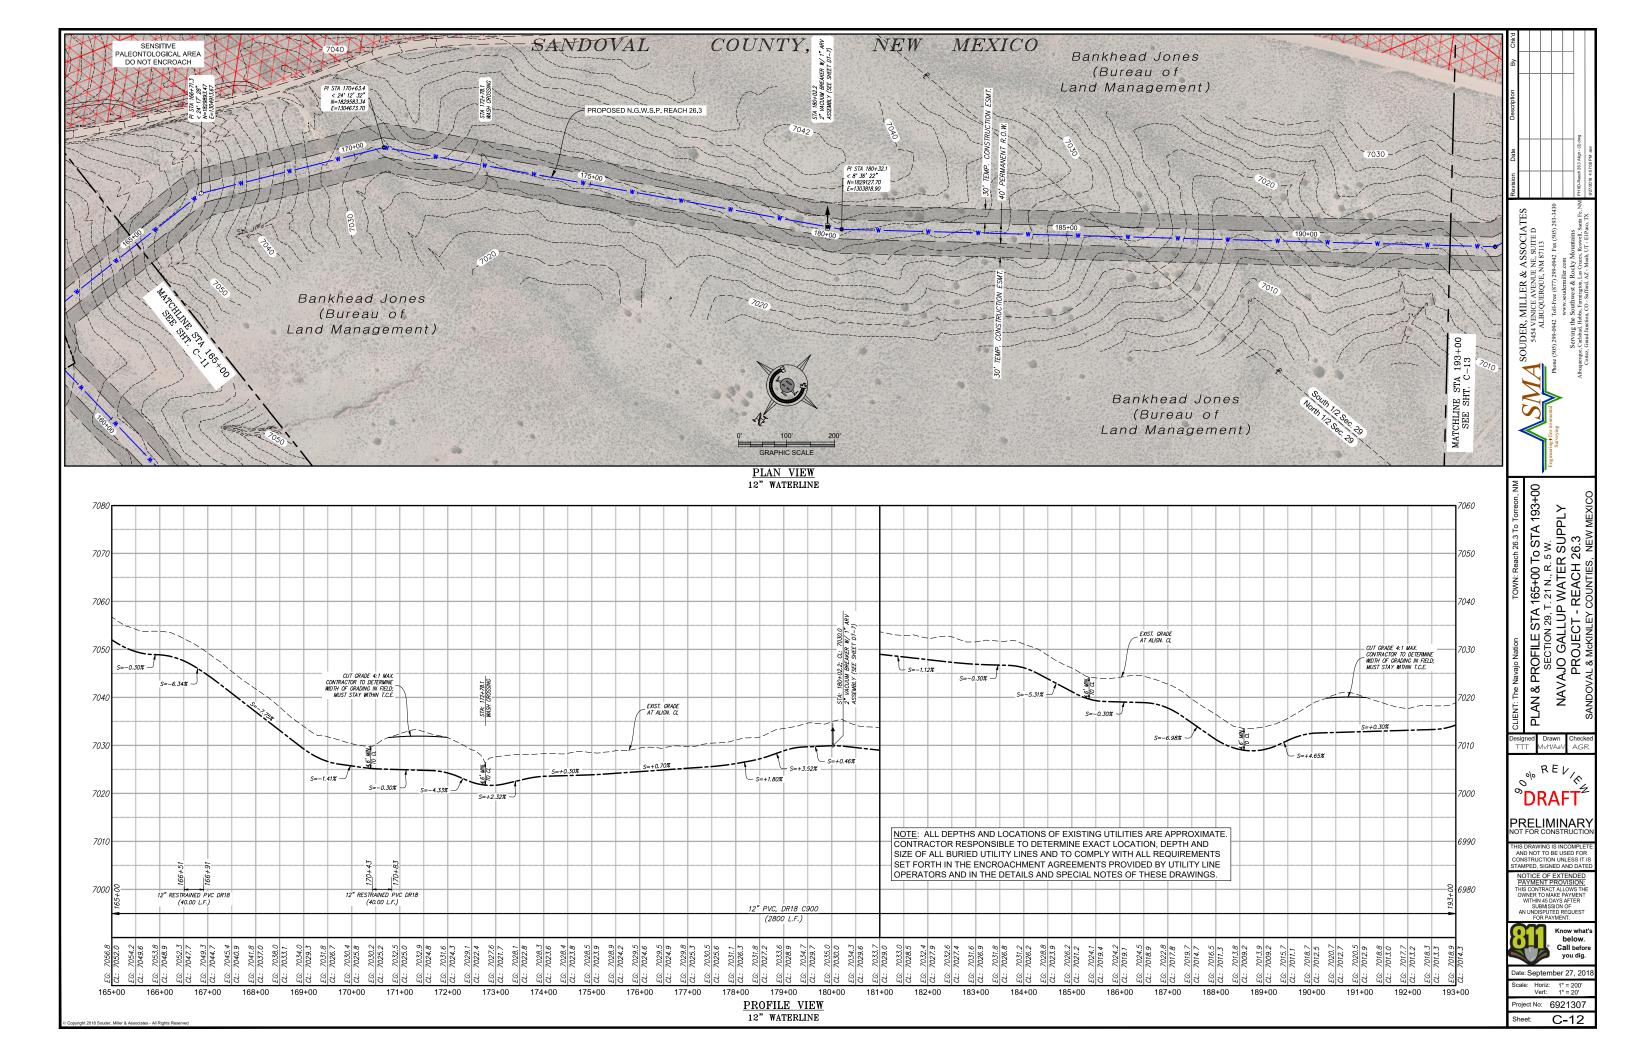


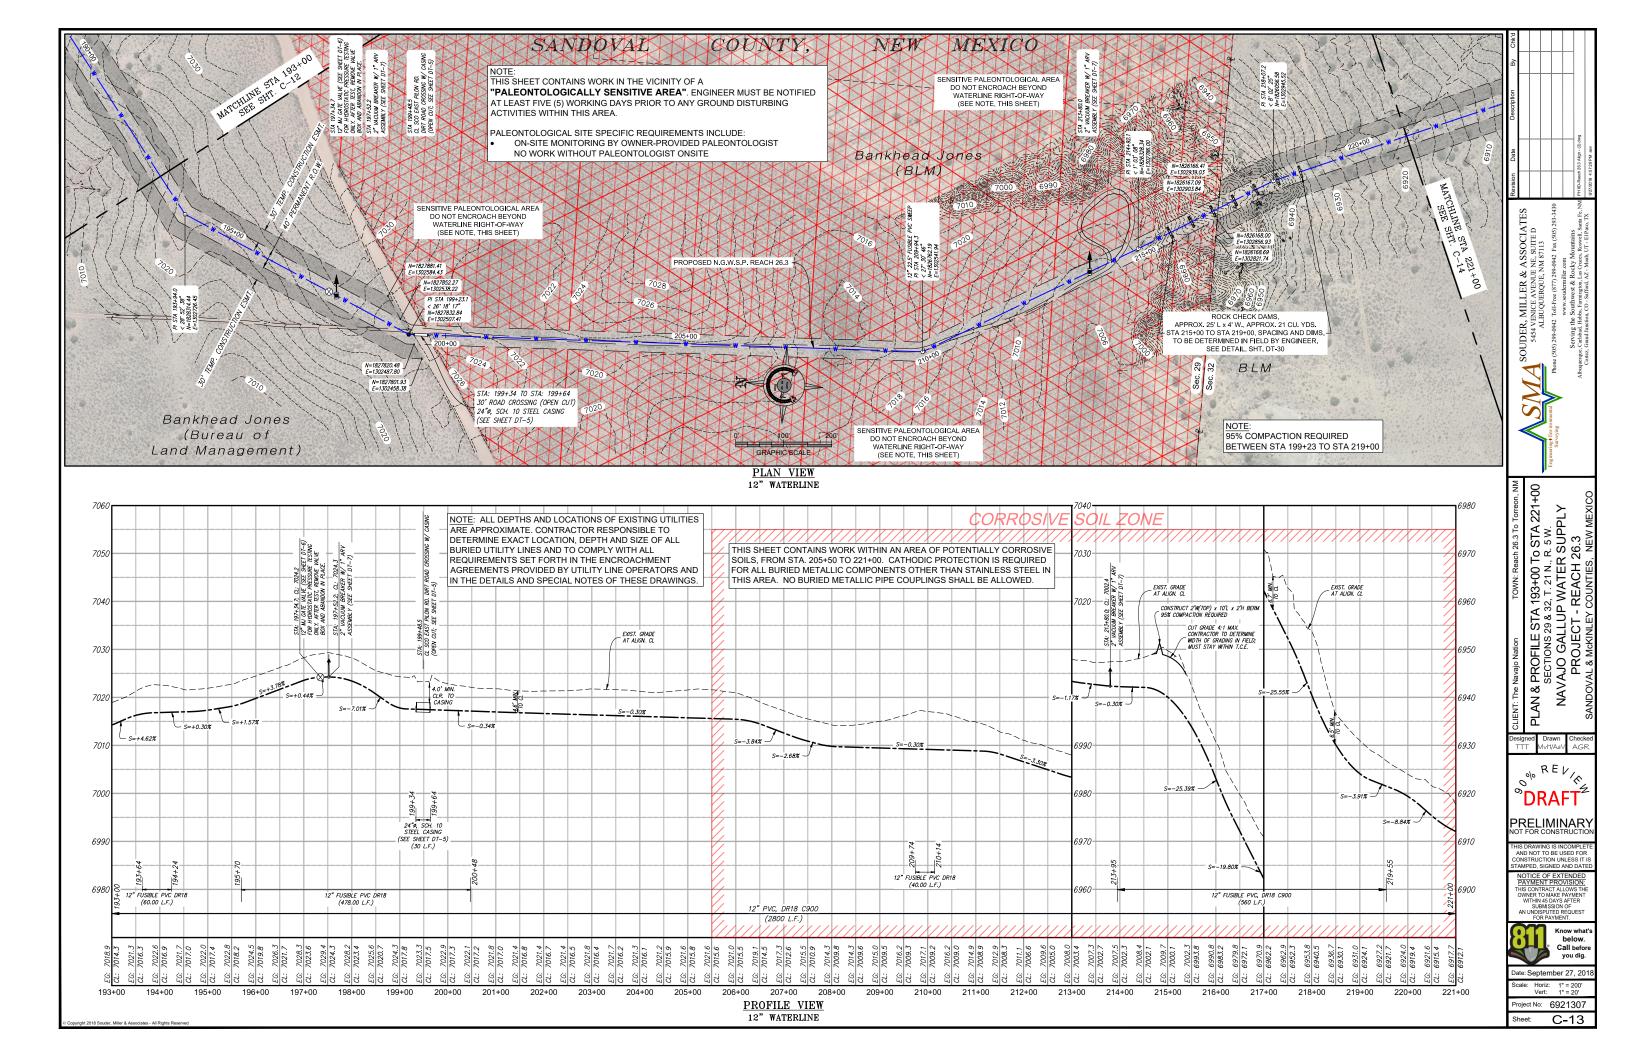


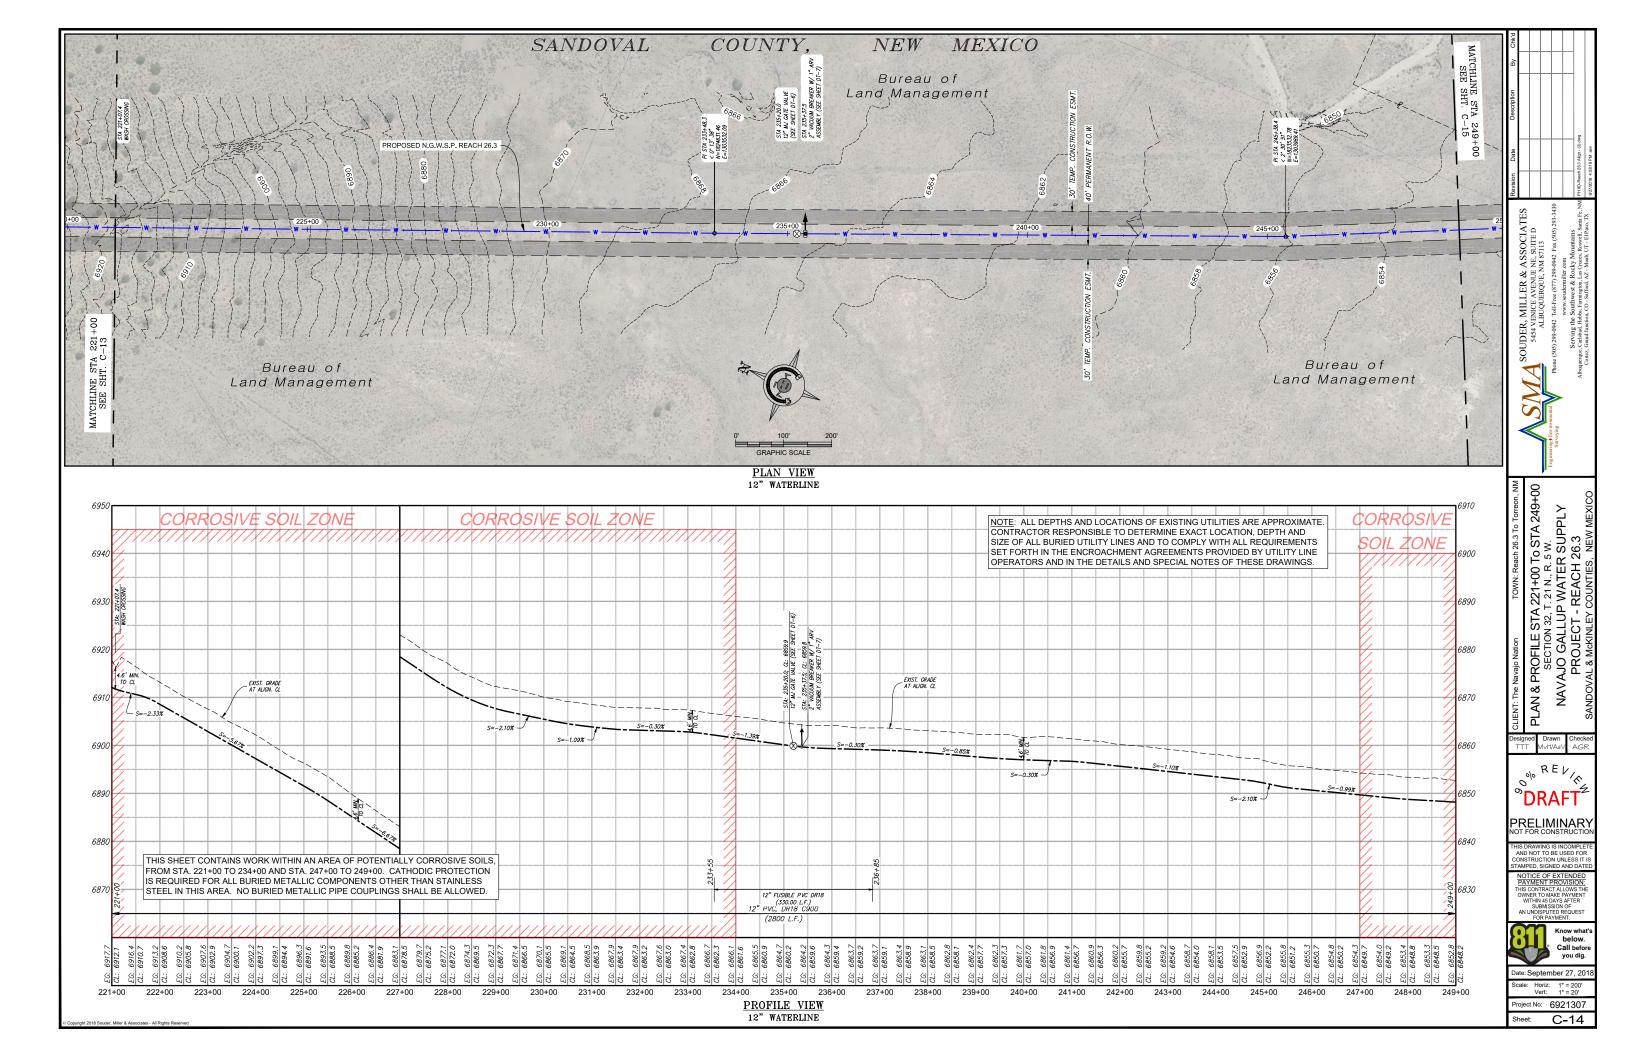


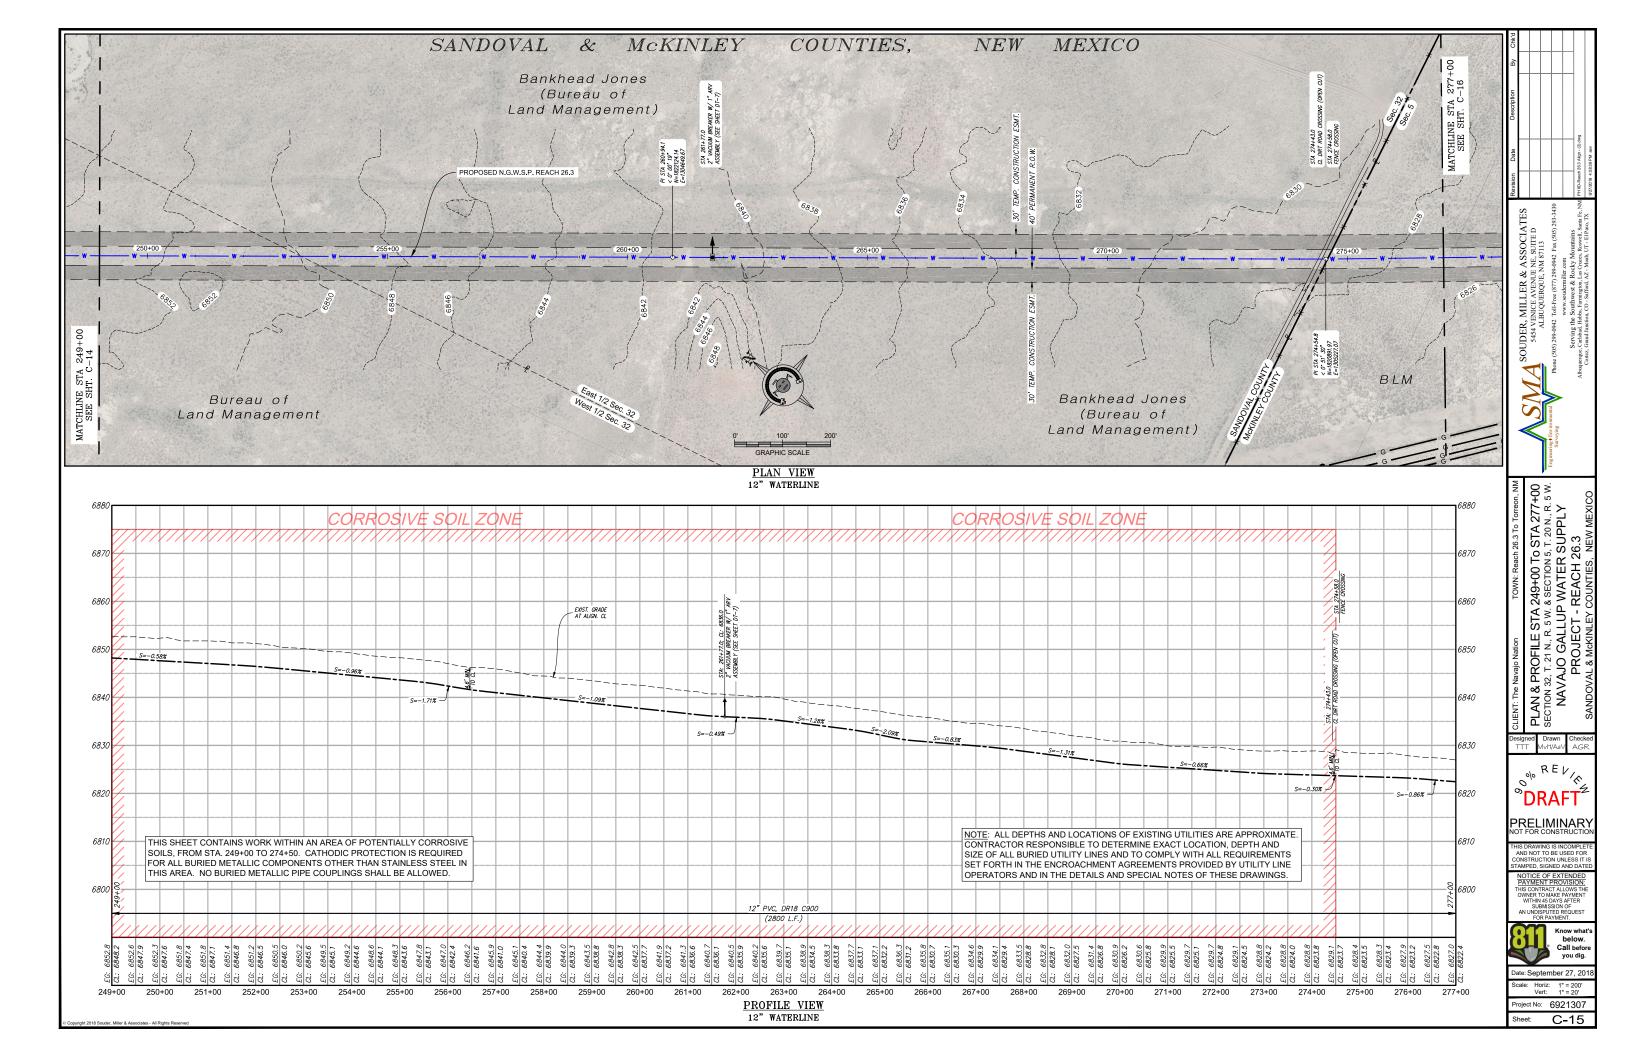


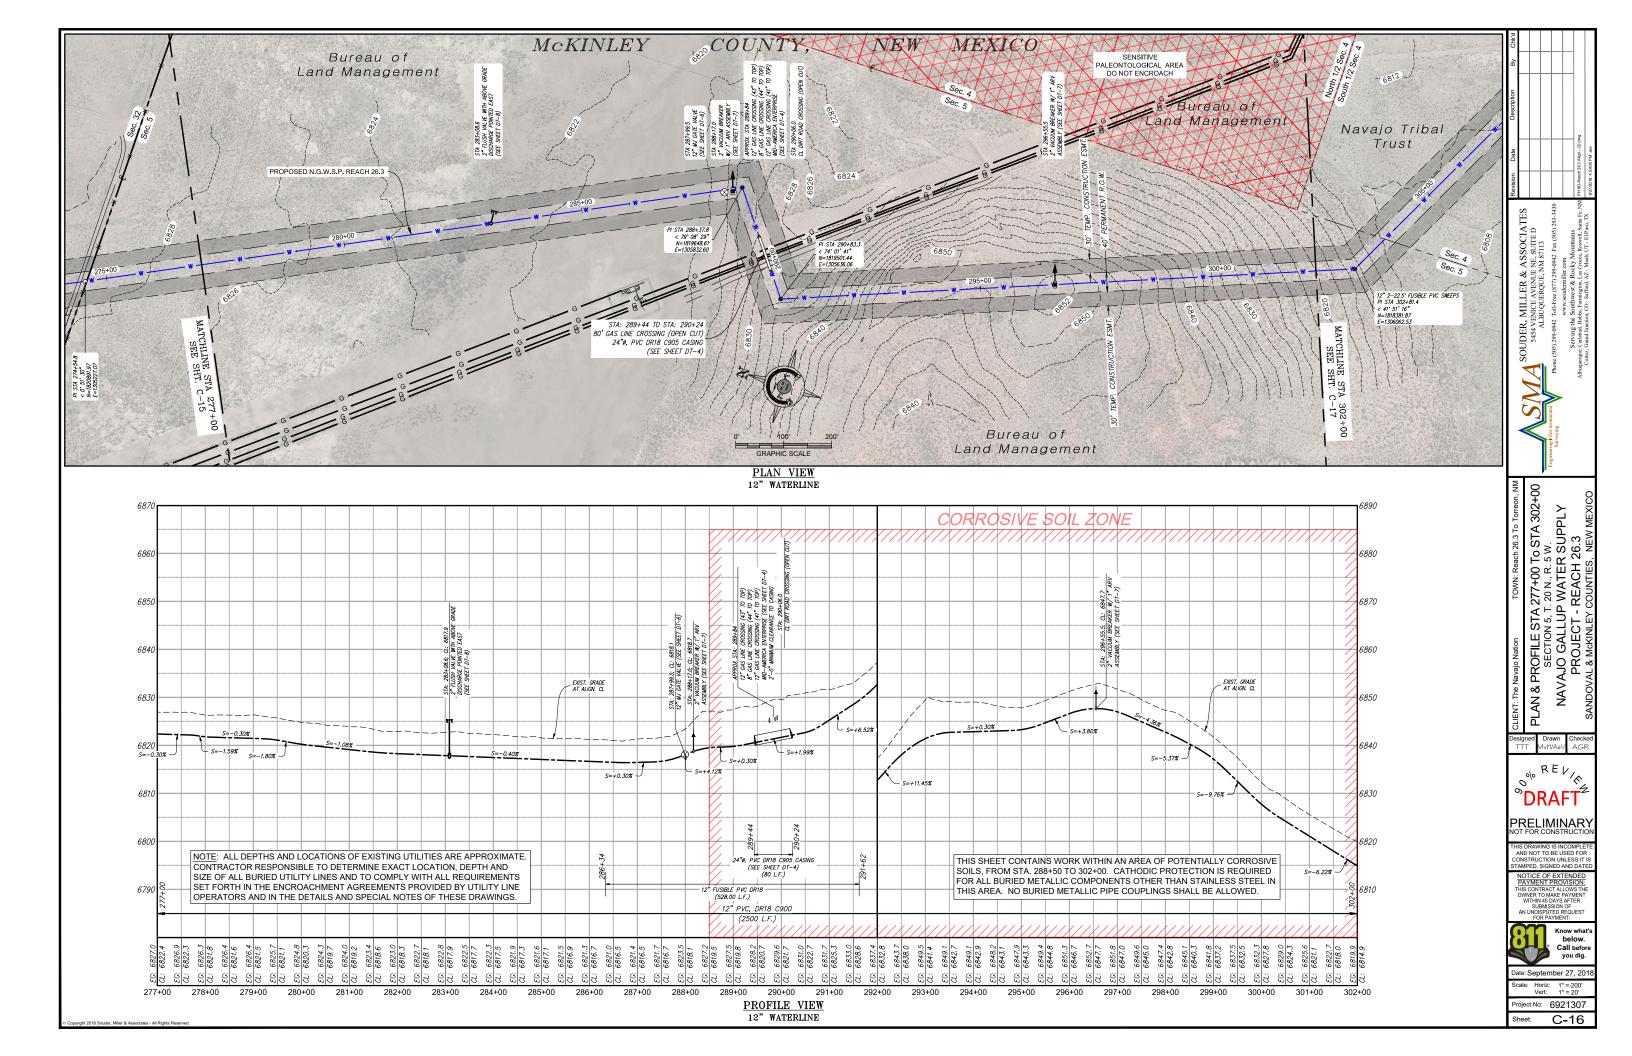


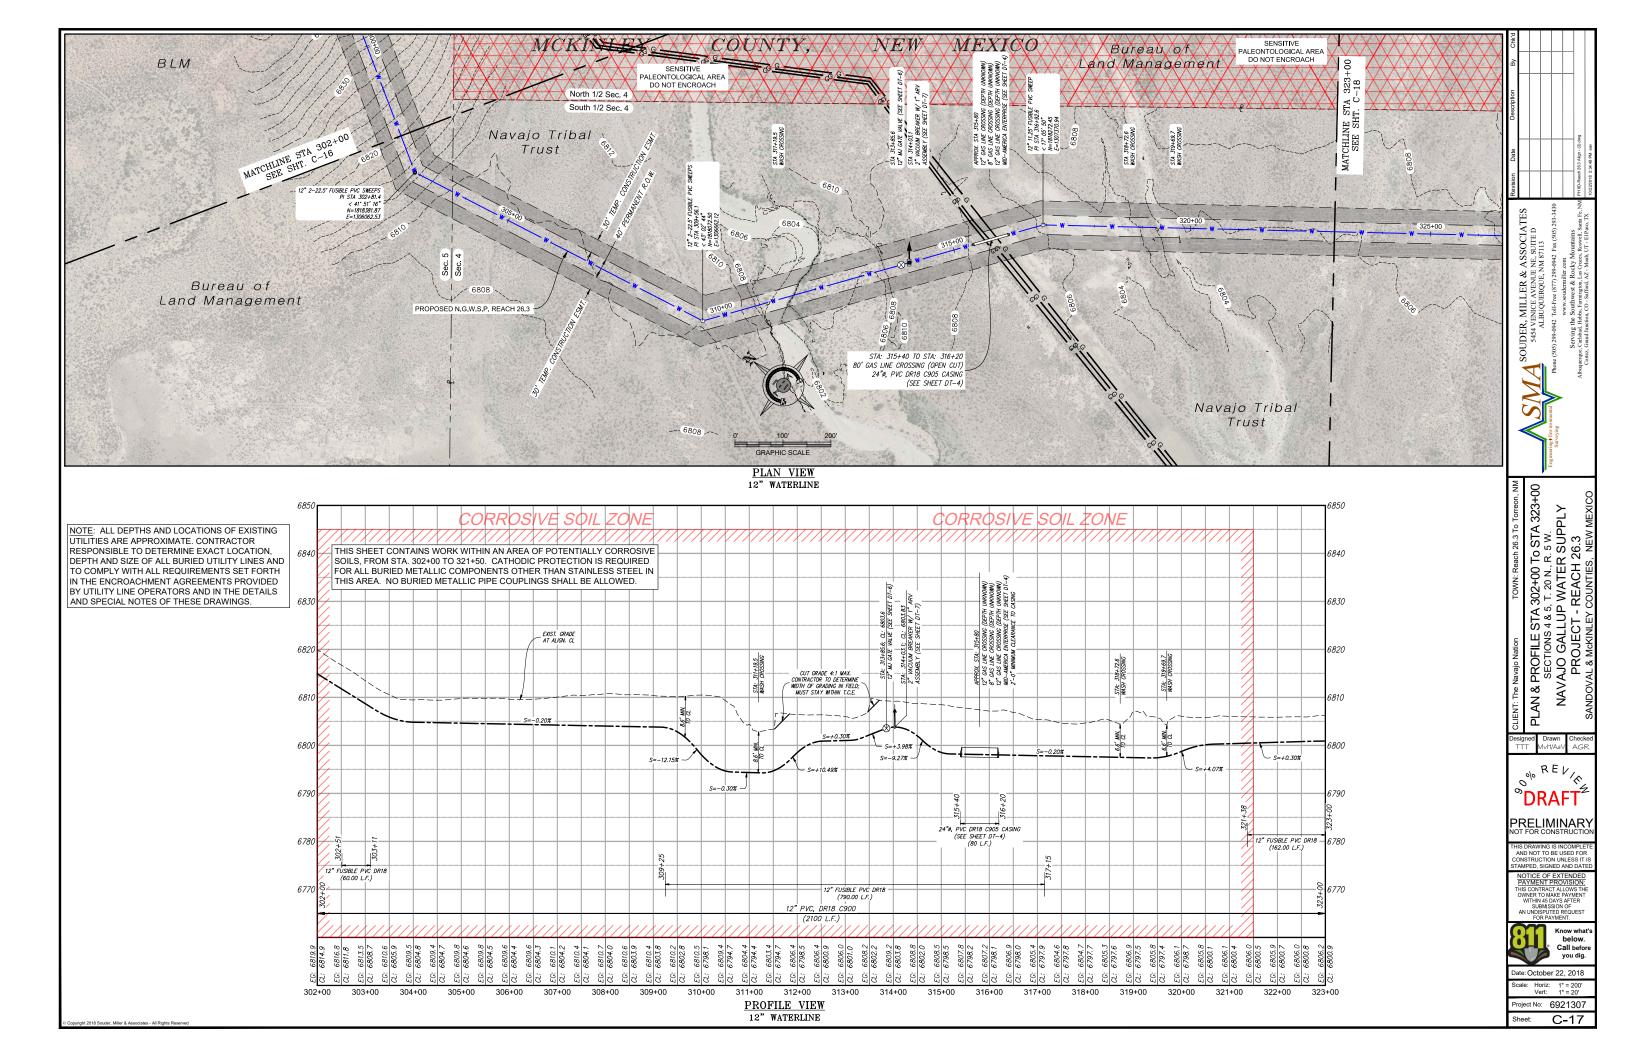


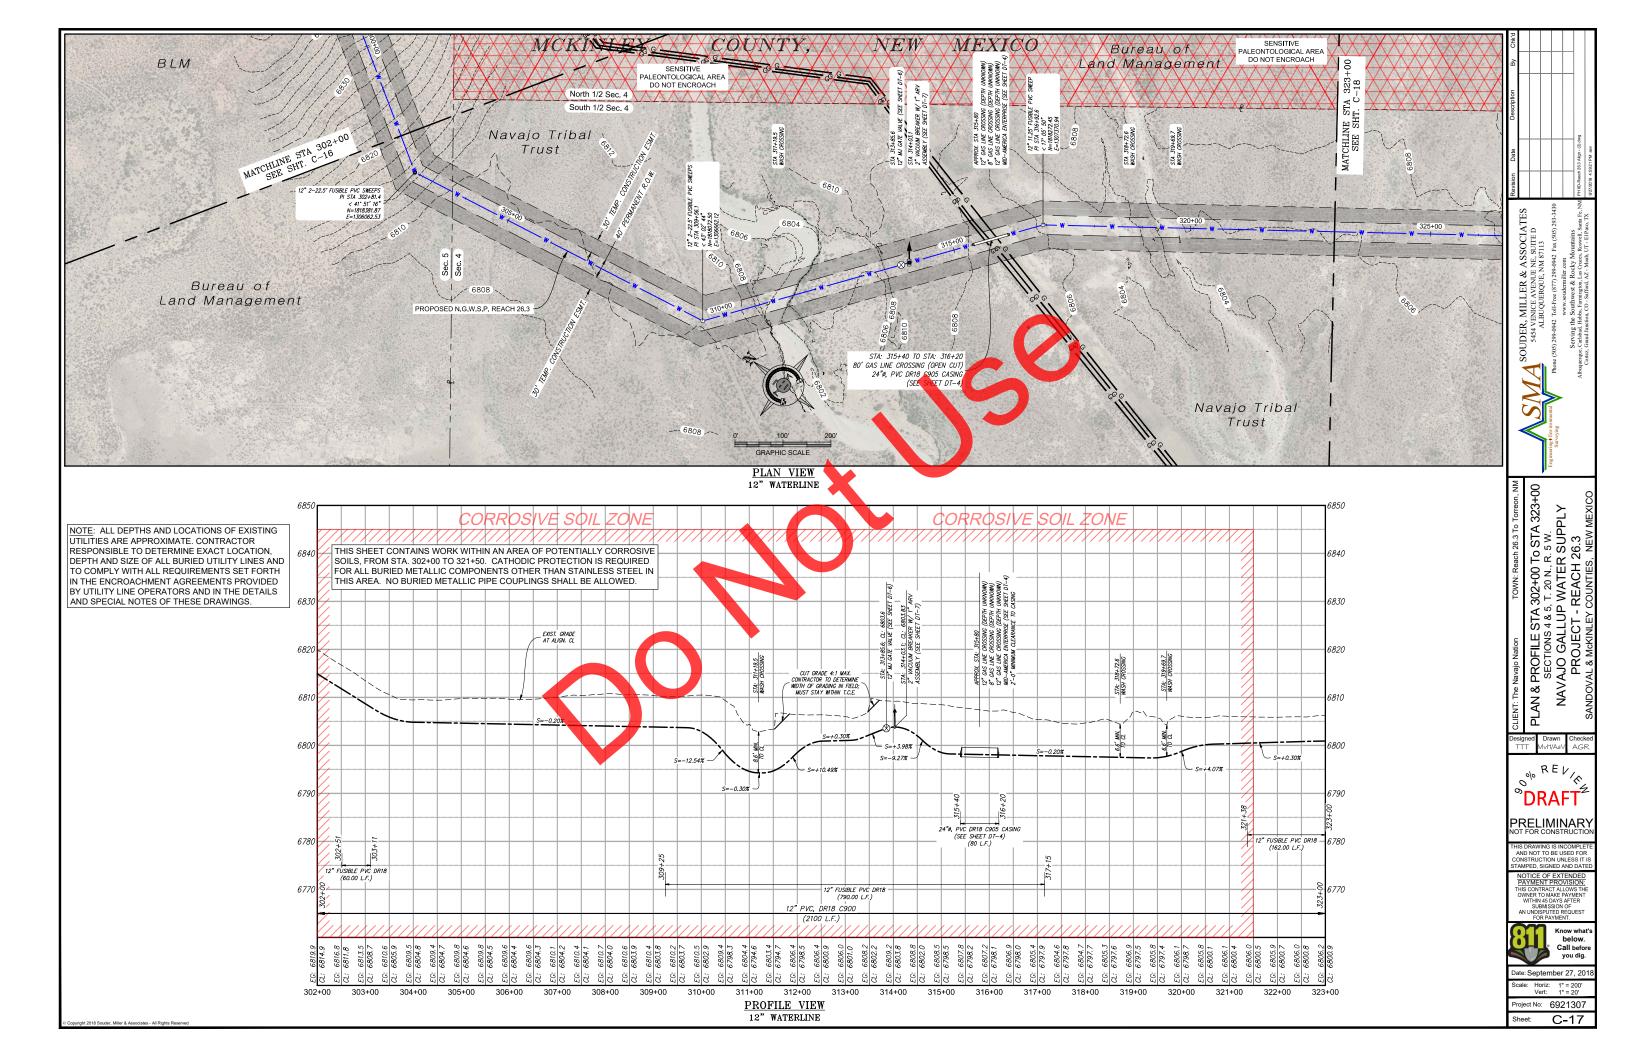


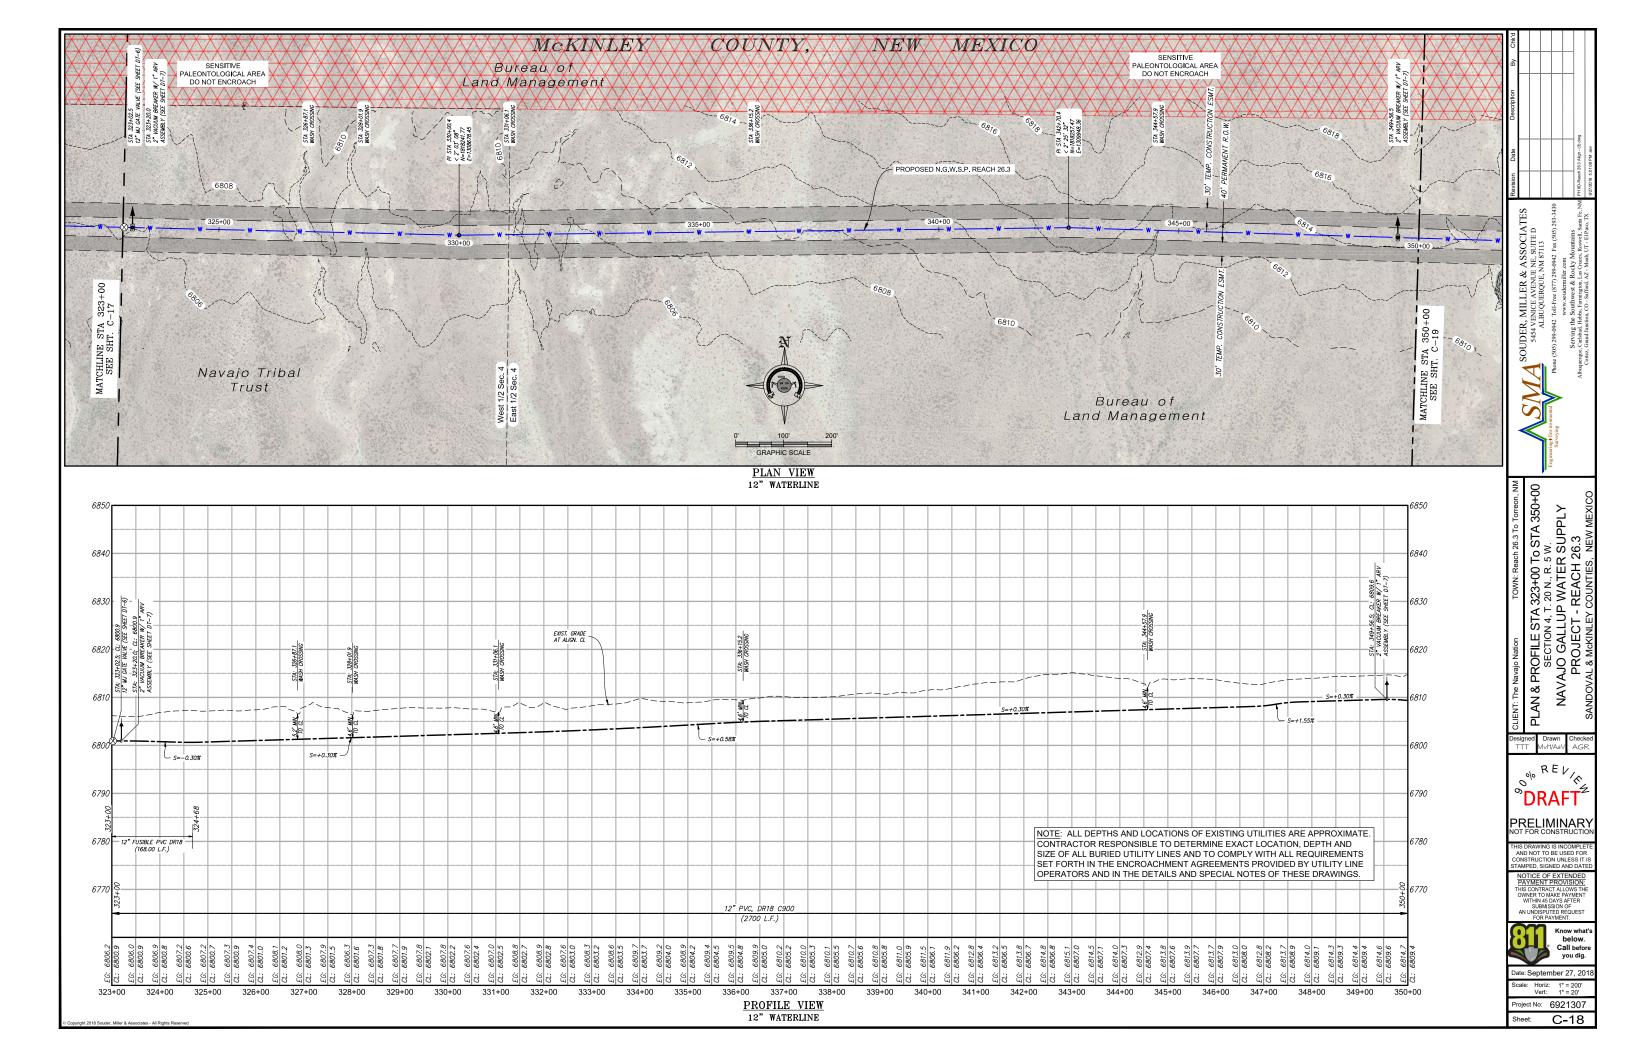


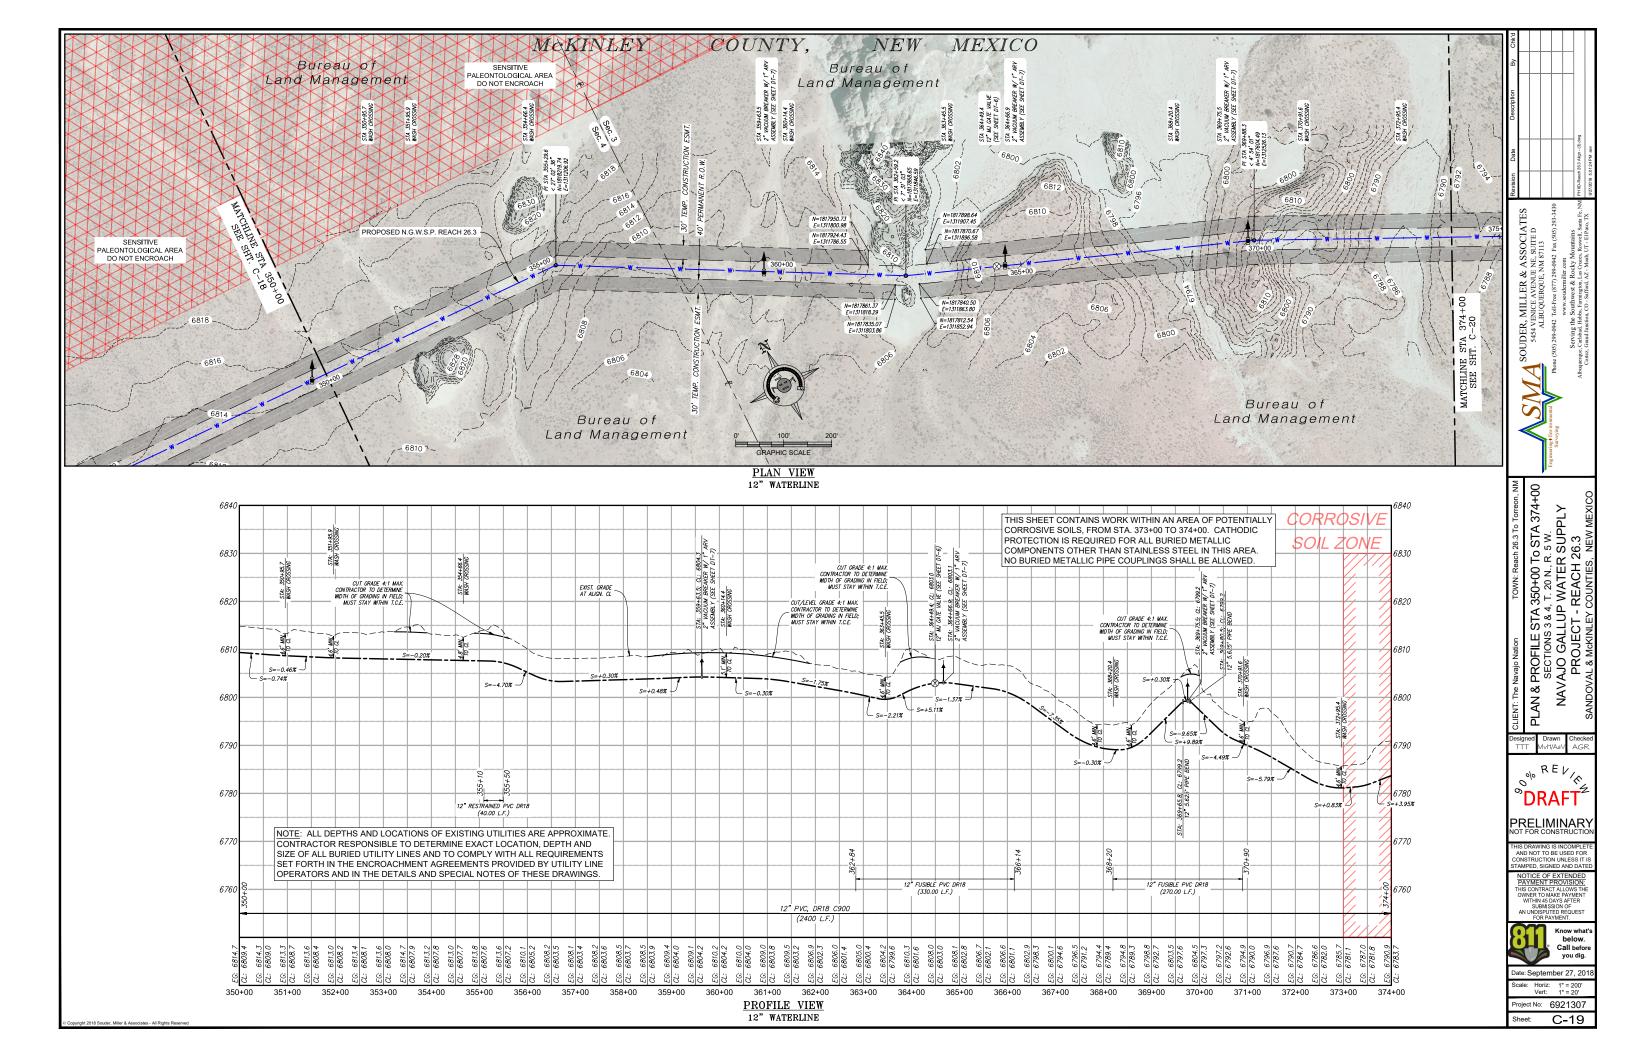


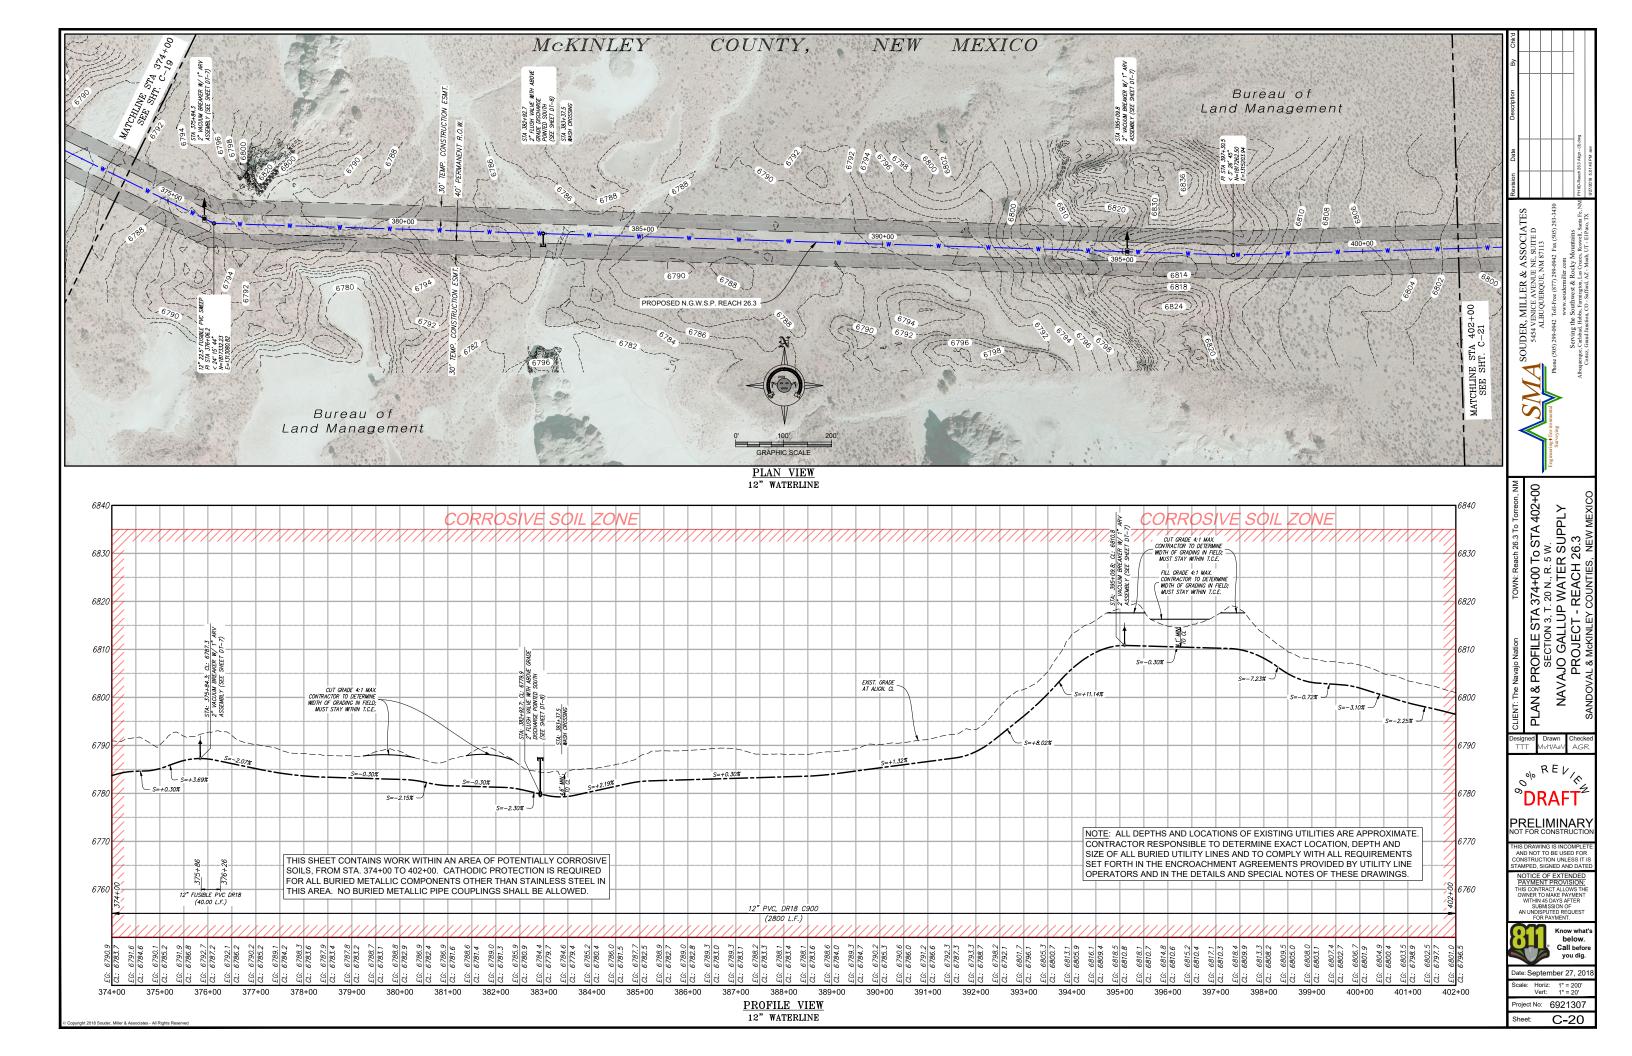


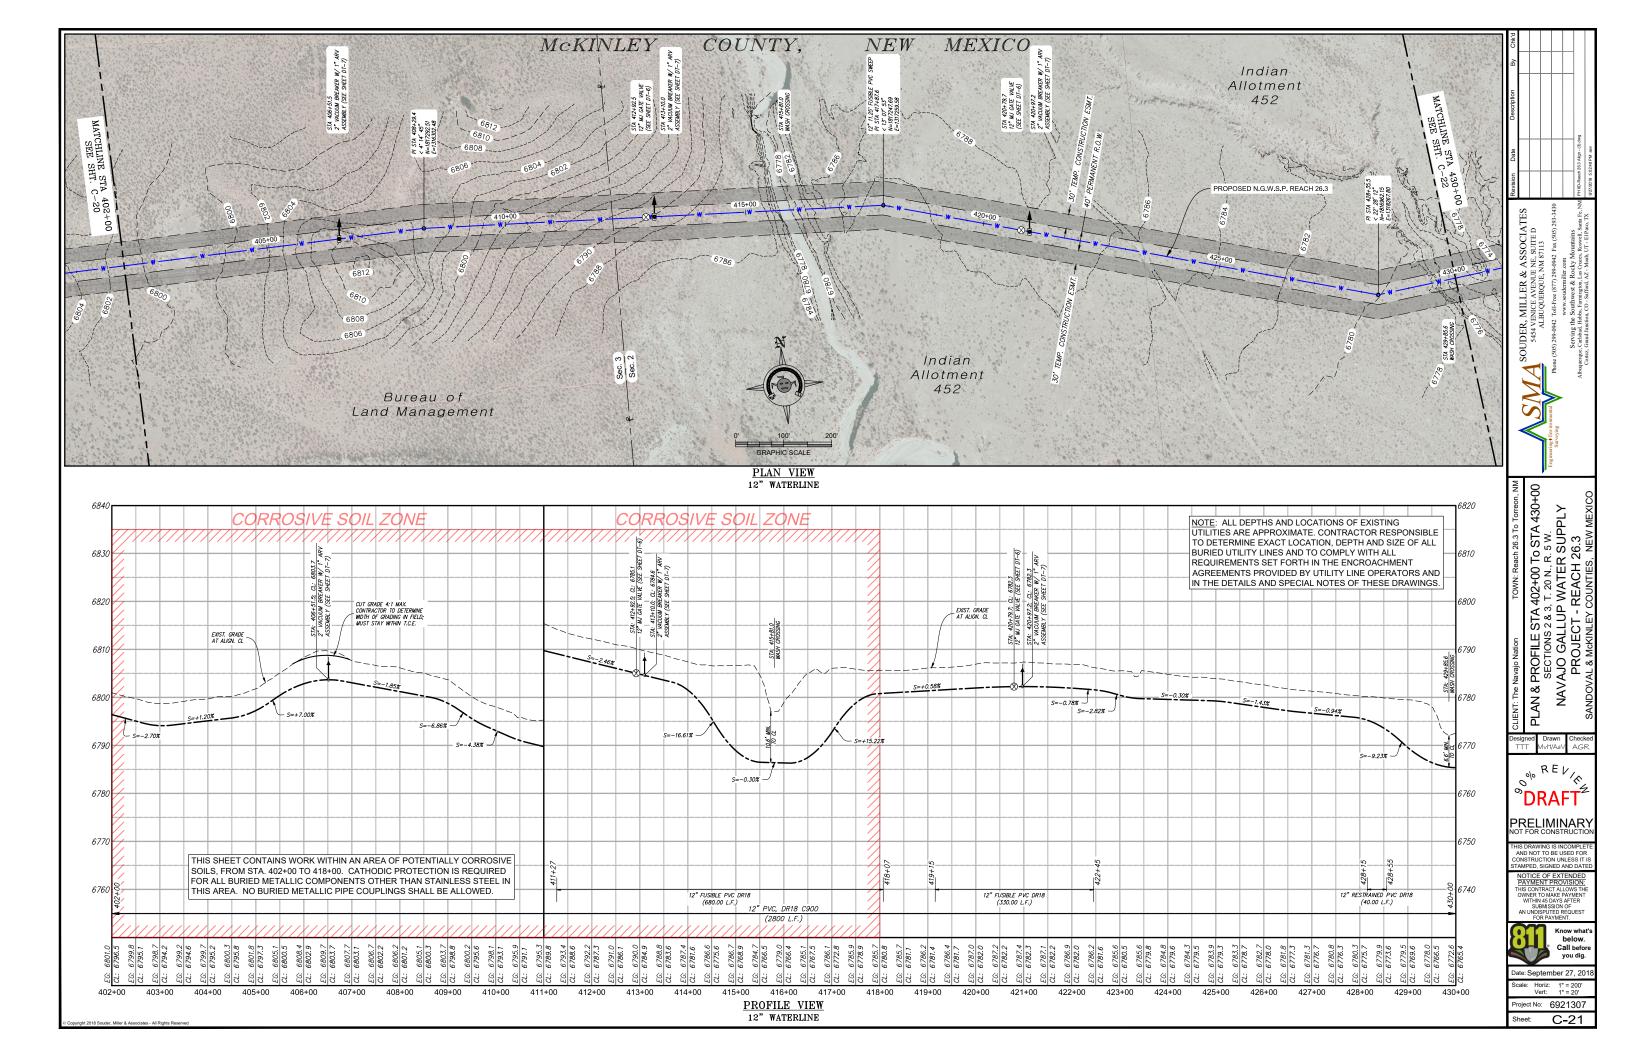

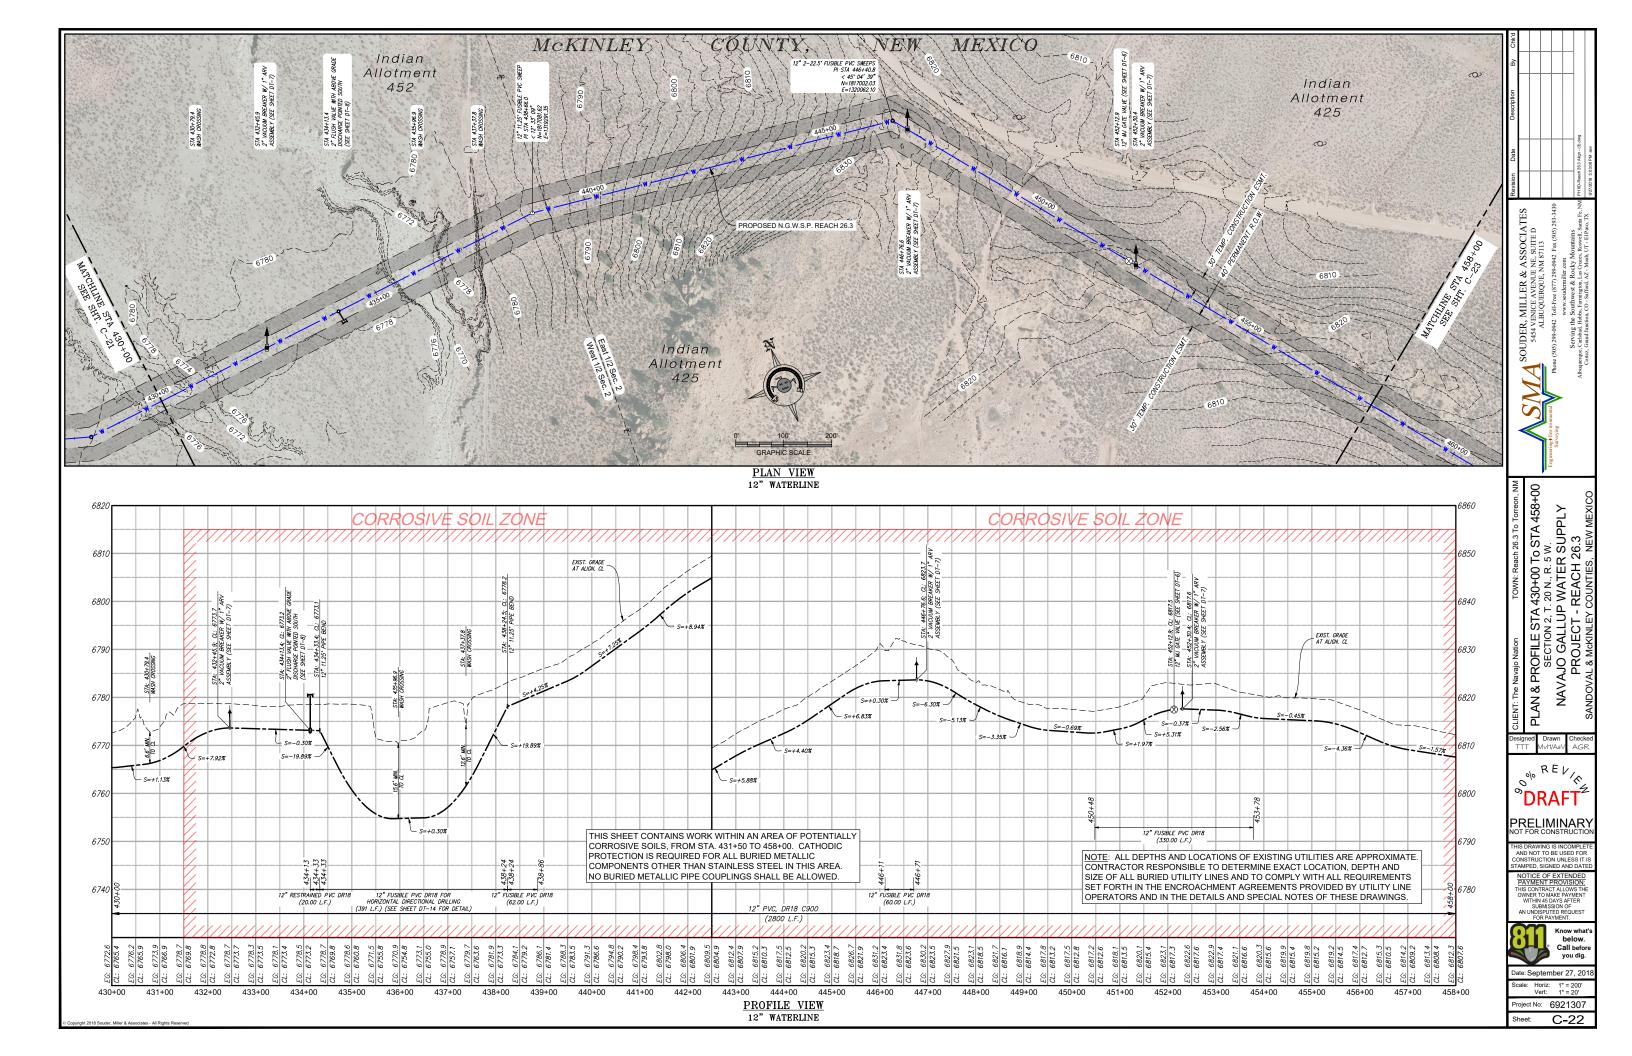

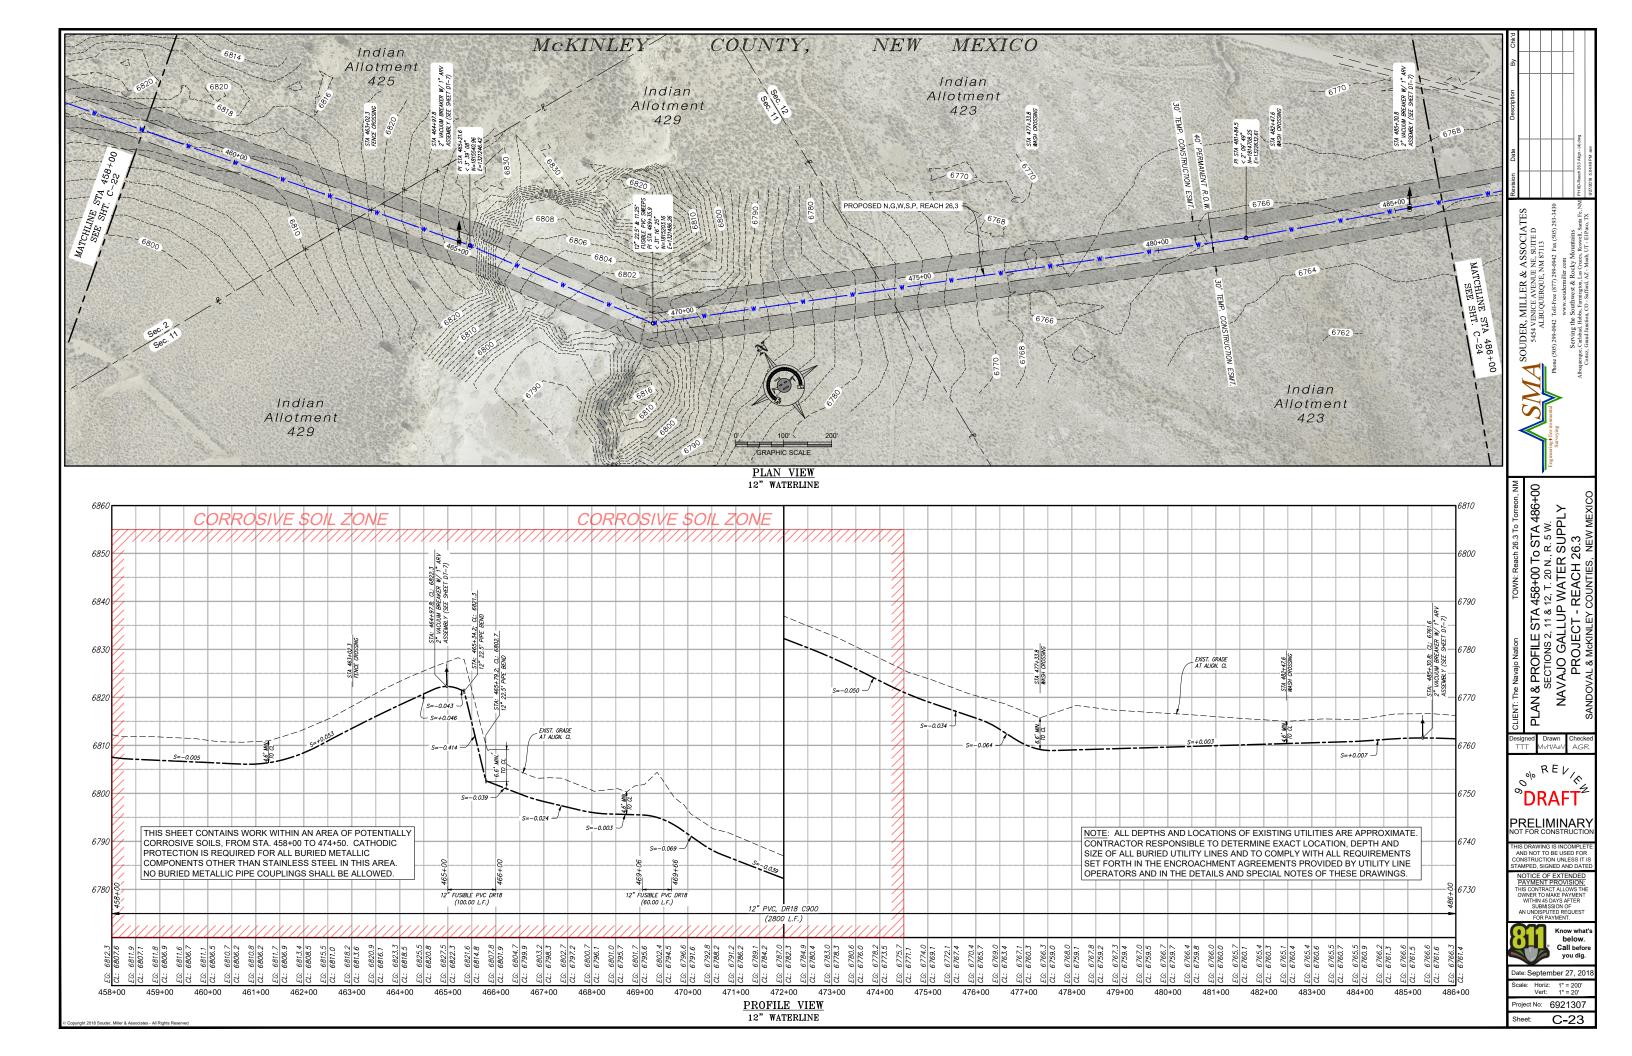

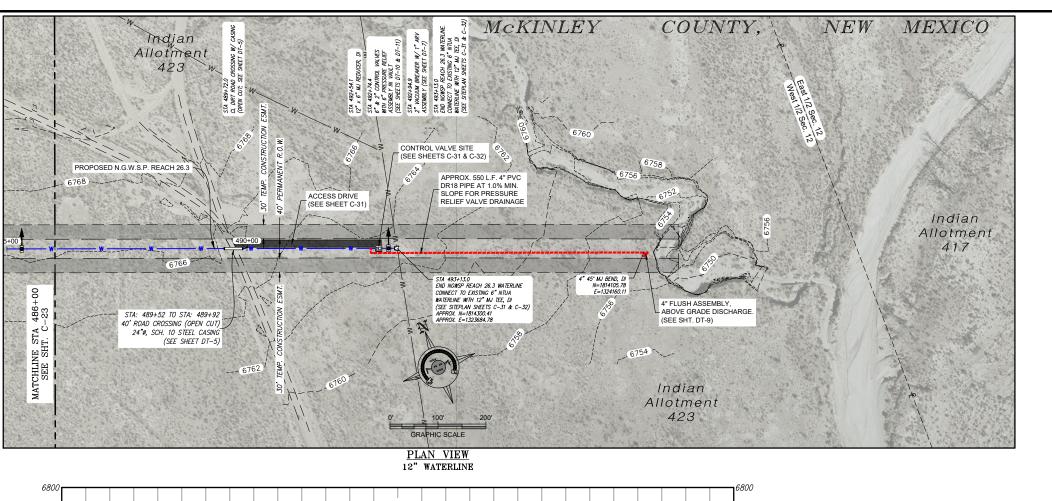

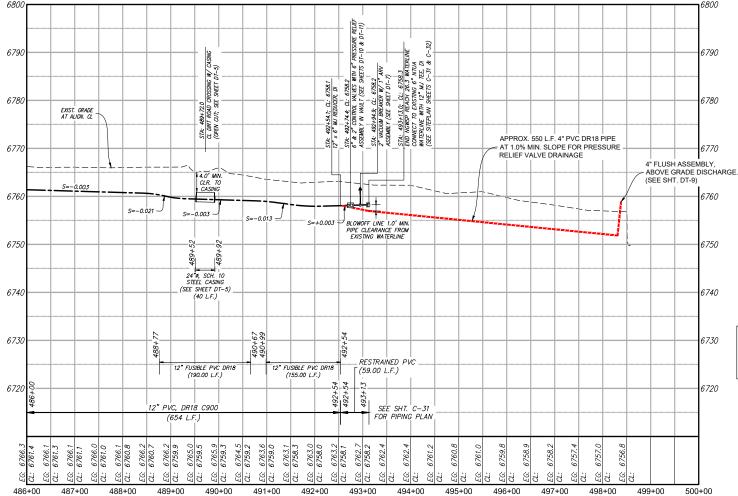

NOTE: ALL DEPTHS AND LOCATIONS OF EXISTING UTILITIES ARE APPROXIMATE. CONTRACTOR RESPONSIBLE TO DETERMINE EXACT LOCATION, DEPTH AND SIZE OF ALL BURIED UTILITY LINES AND TO COMPLY WITH ALL REQUIREMENTS SET FORTH IN THE ENCROACHMENT AGREEMENTS PROVIDED BY UTILITY LINE OPERATORS AND IN THE DETAILS AND SPECIAL NOTES OF THESE DRAWINGS.

Know what's below.
Call before you dig.

Date: September 27, 2018

ON REV

PRELIMINARY NOT FOR CONSTRUCTIO

PLAN & PROFILE STA 486+00 To STA 493+12.9
SECTION 12, T. 20 N., R. 5 W.
NAVAJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
SANDOVAL & MAKINI FY COLINTIES. NEW MEXICO


Vert: 1" = 20'


Project No: 6921307


Sheet: C-24


Copyright 2018 Souder, Miller & Associates - All Rights Reserved


PROFILE VIEW 12" WATERLINE

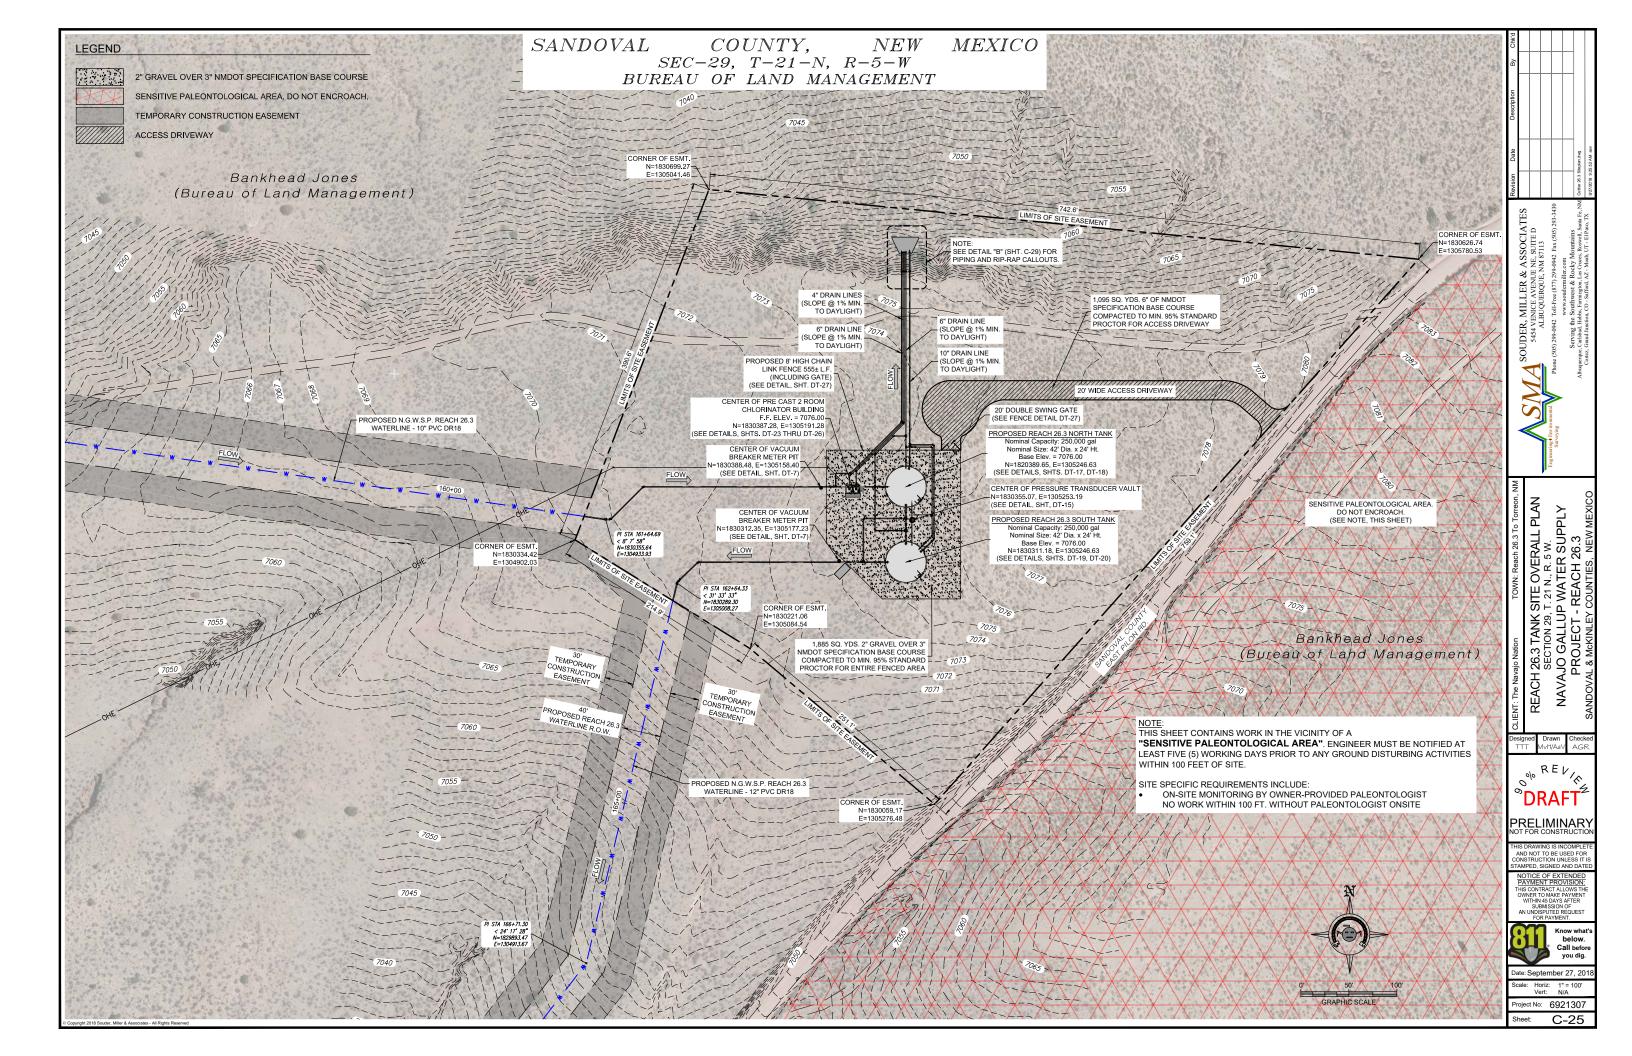


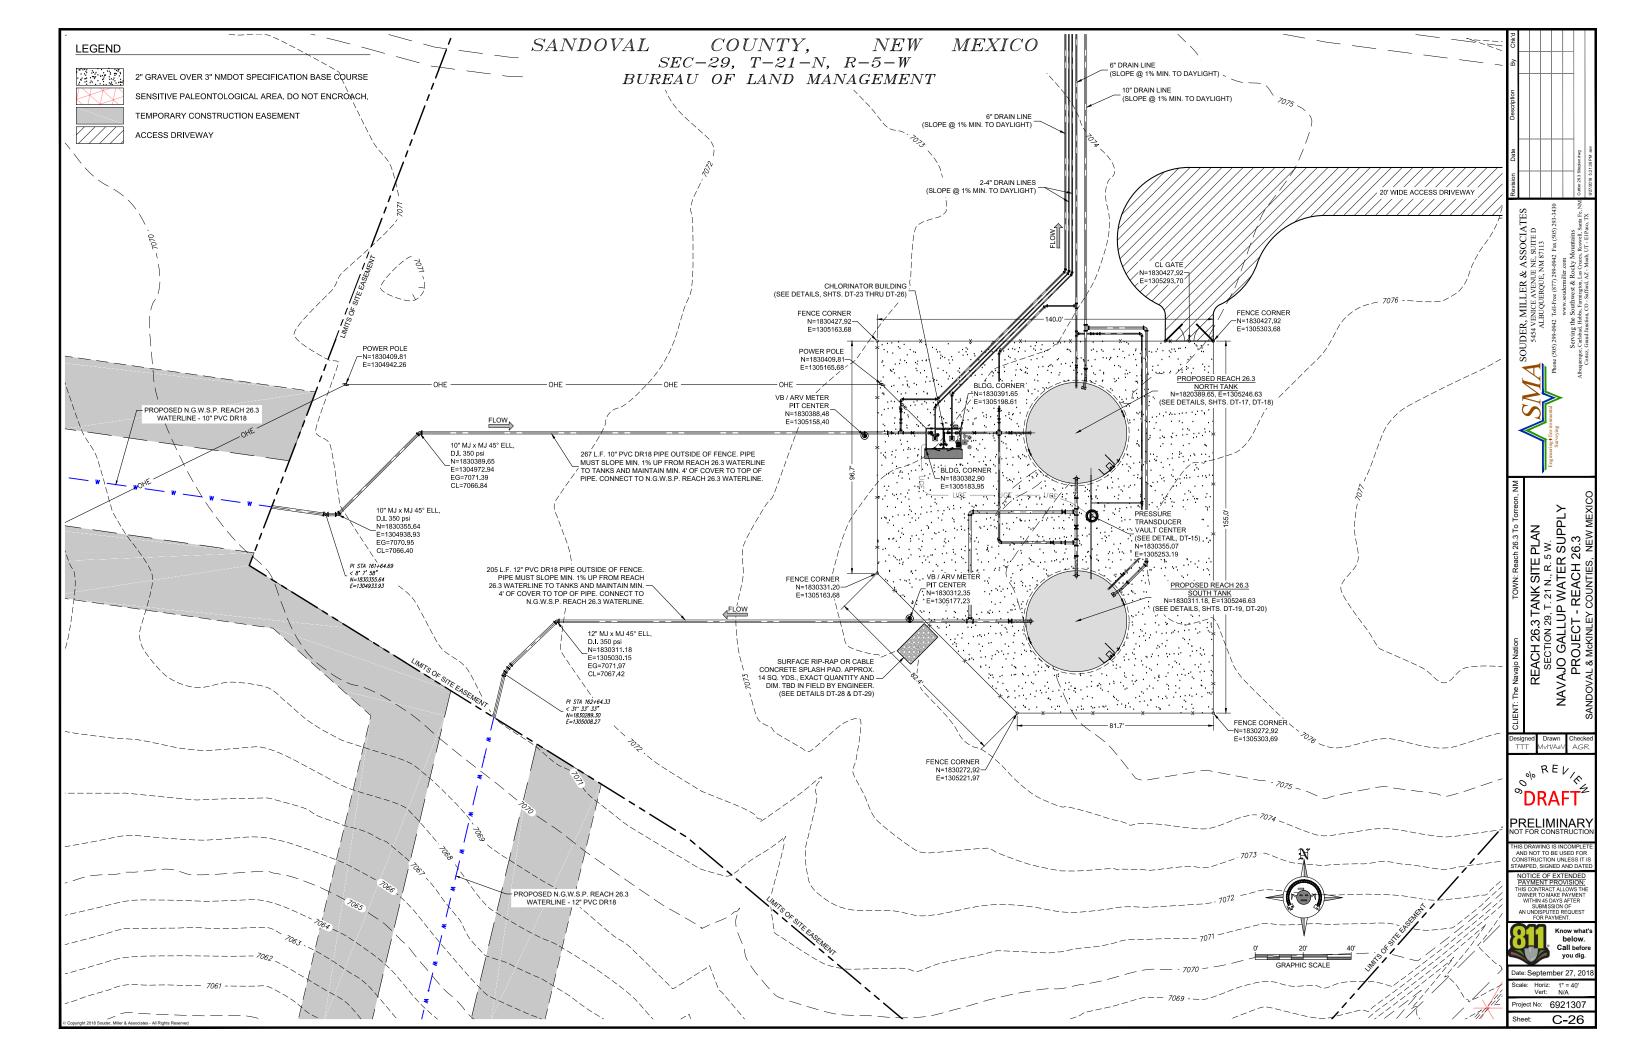


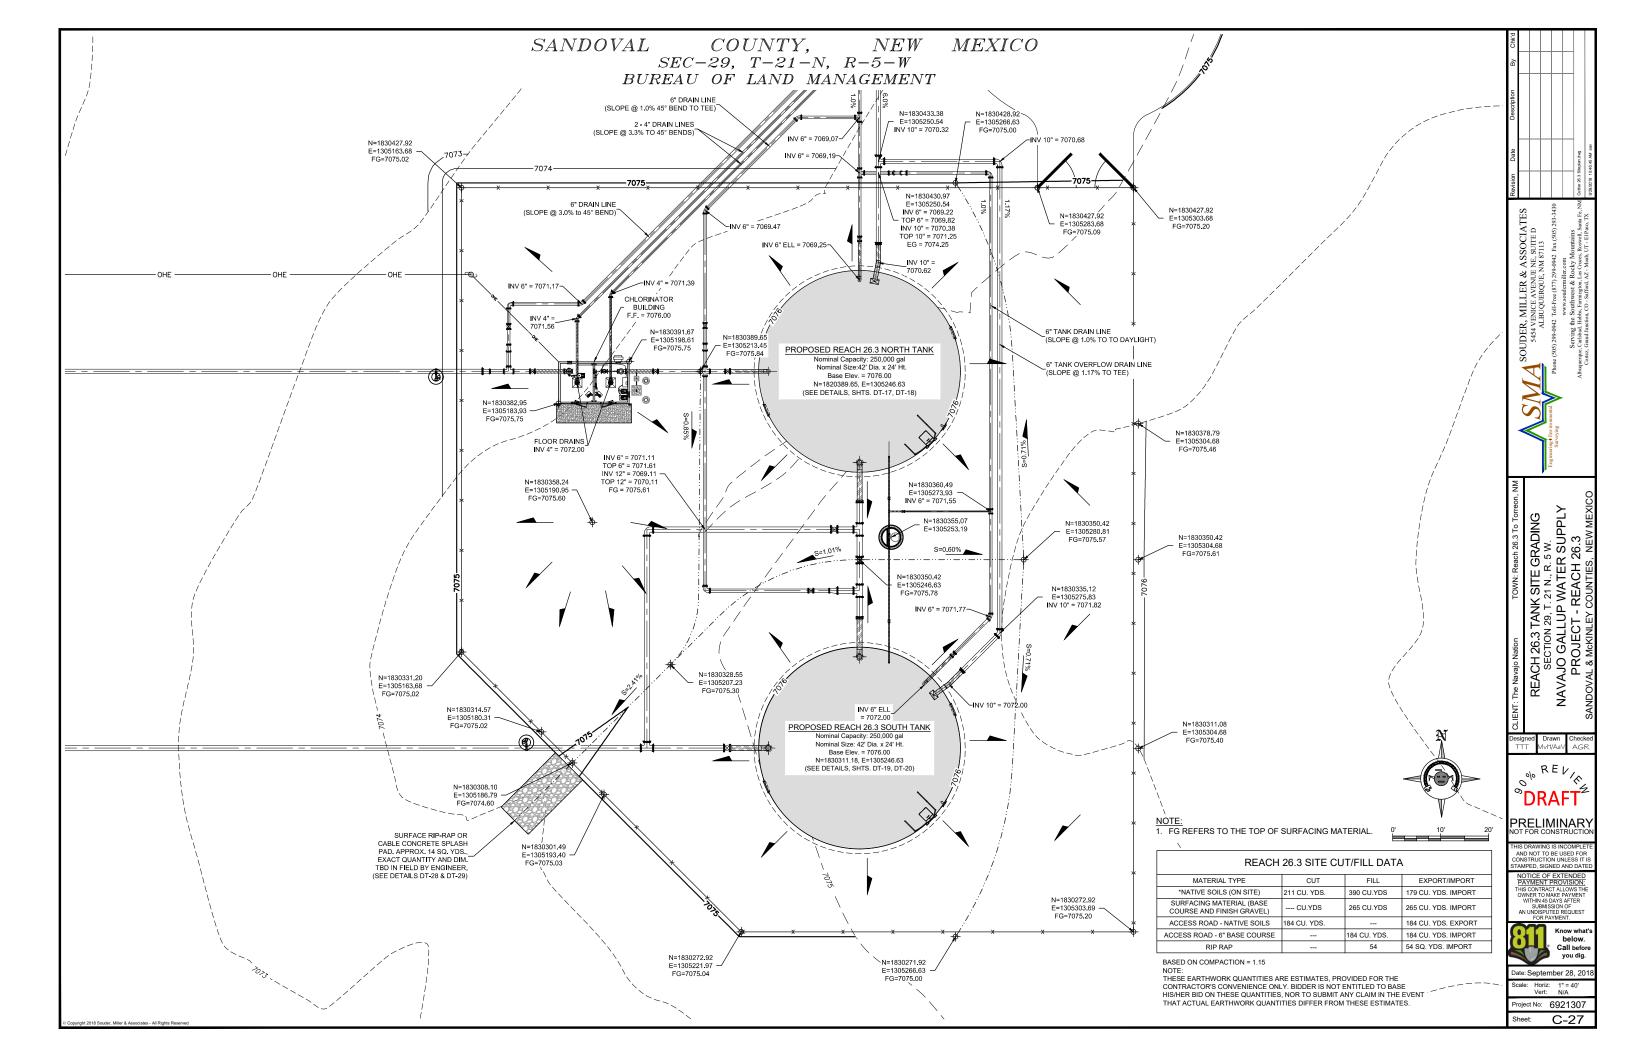


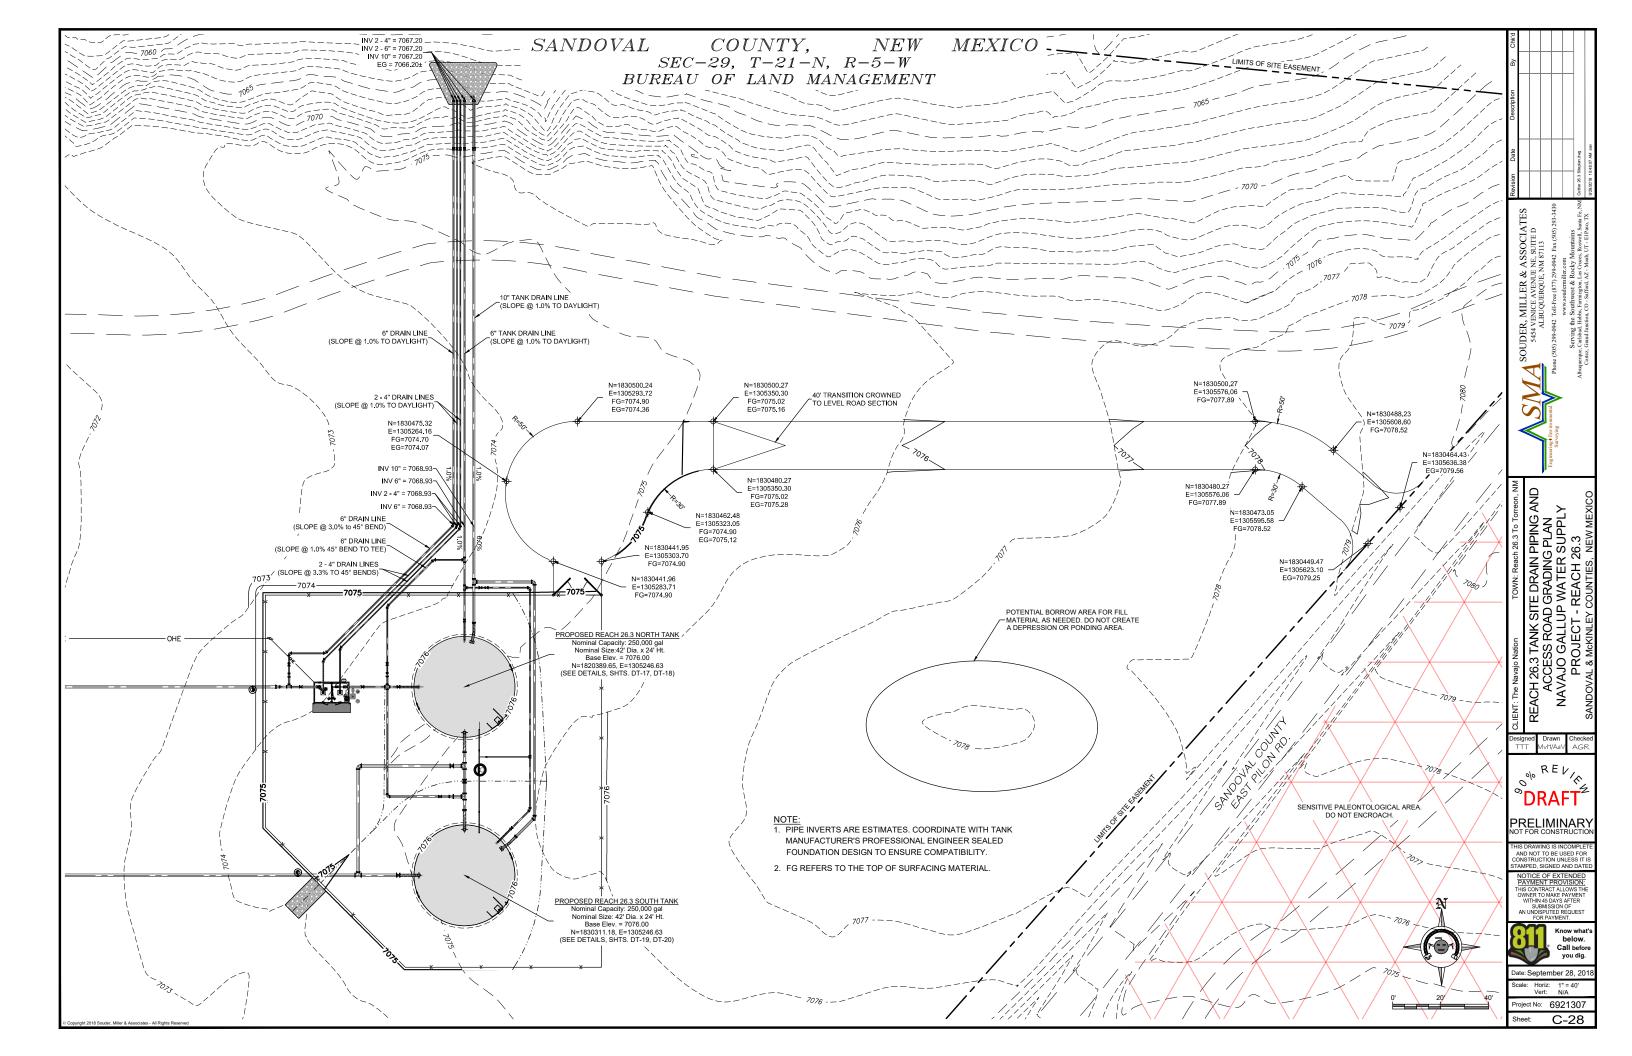

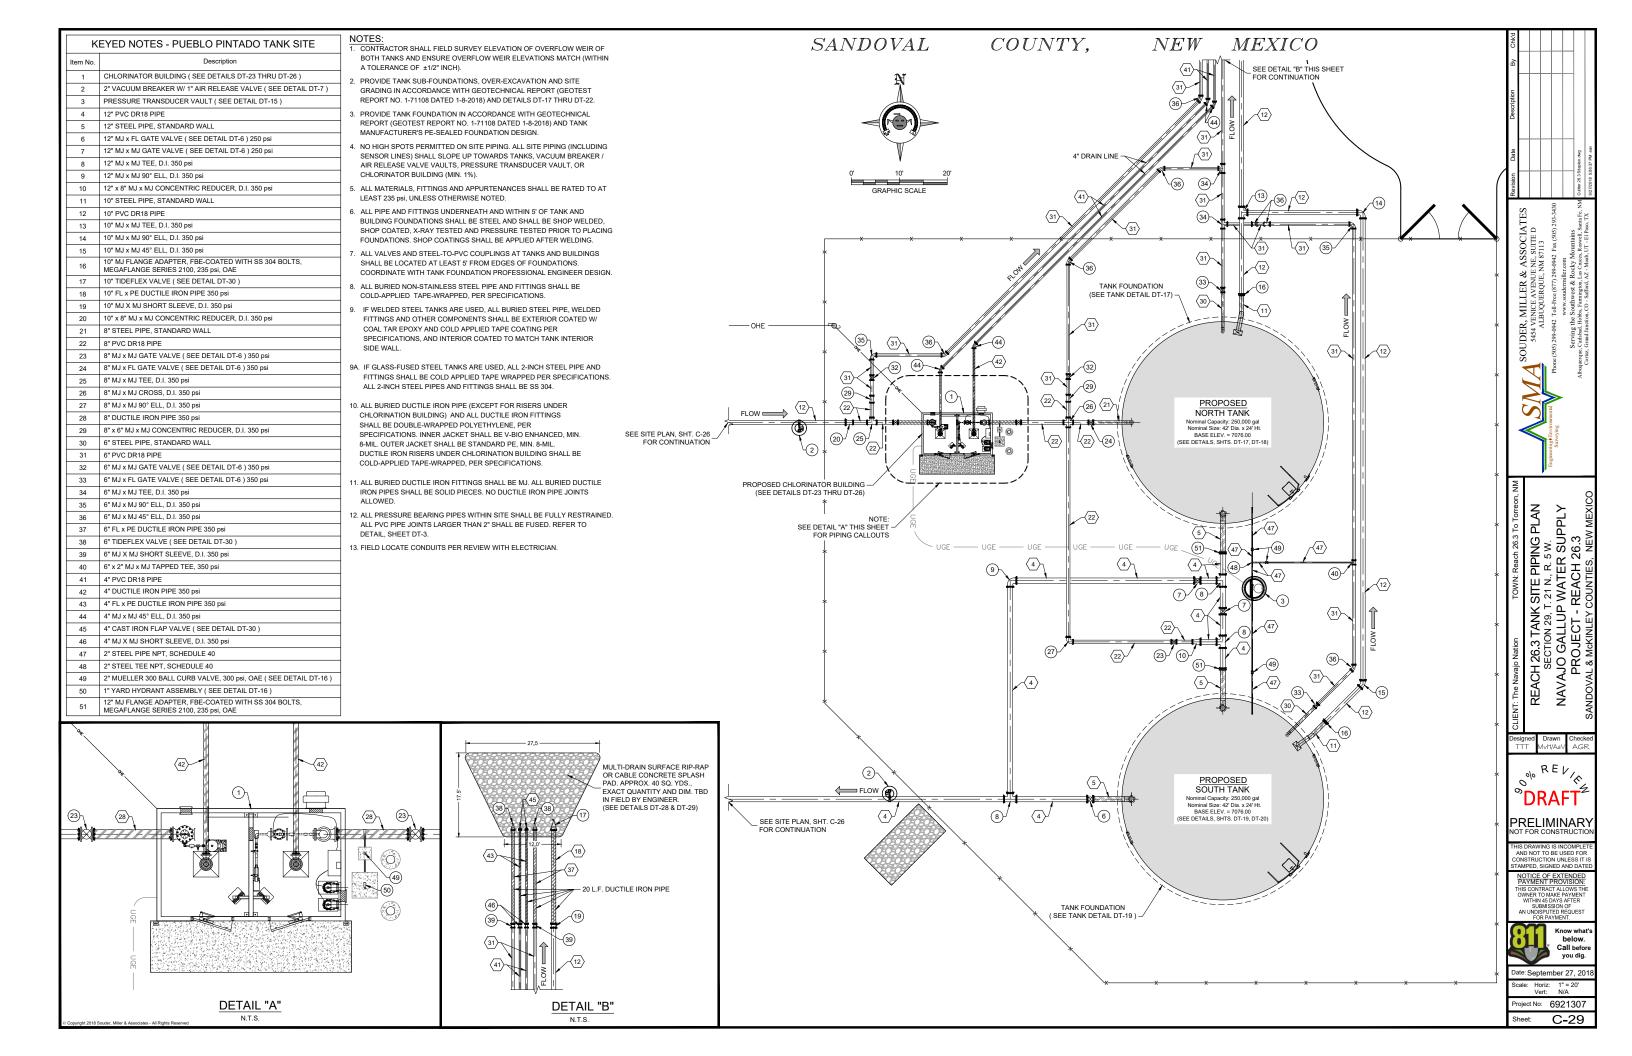

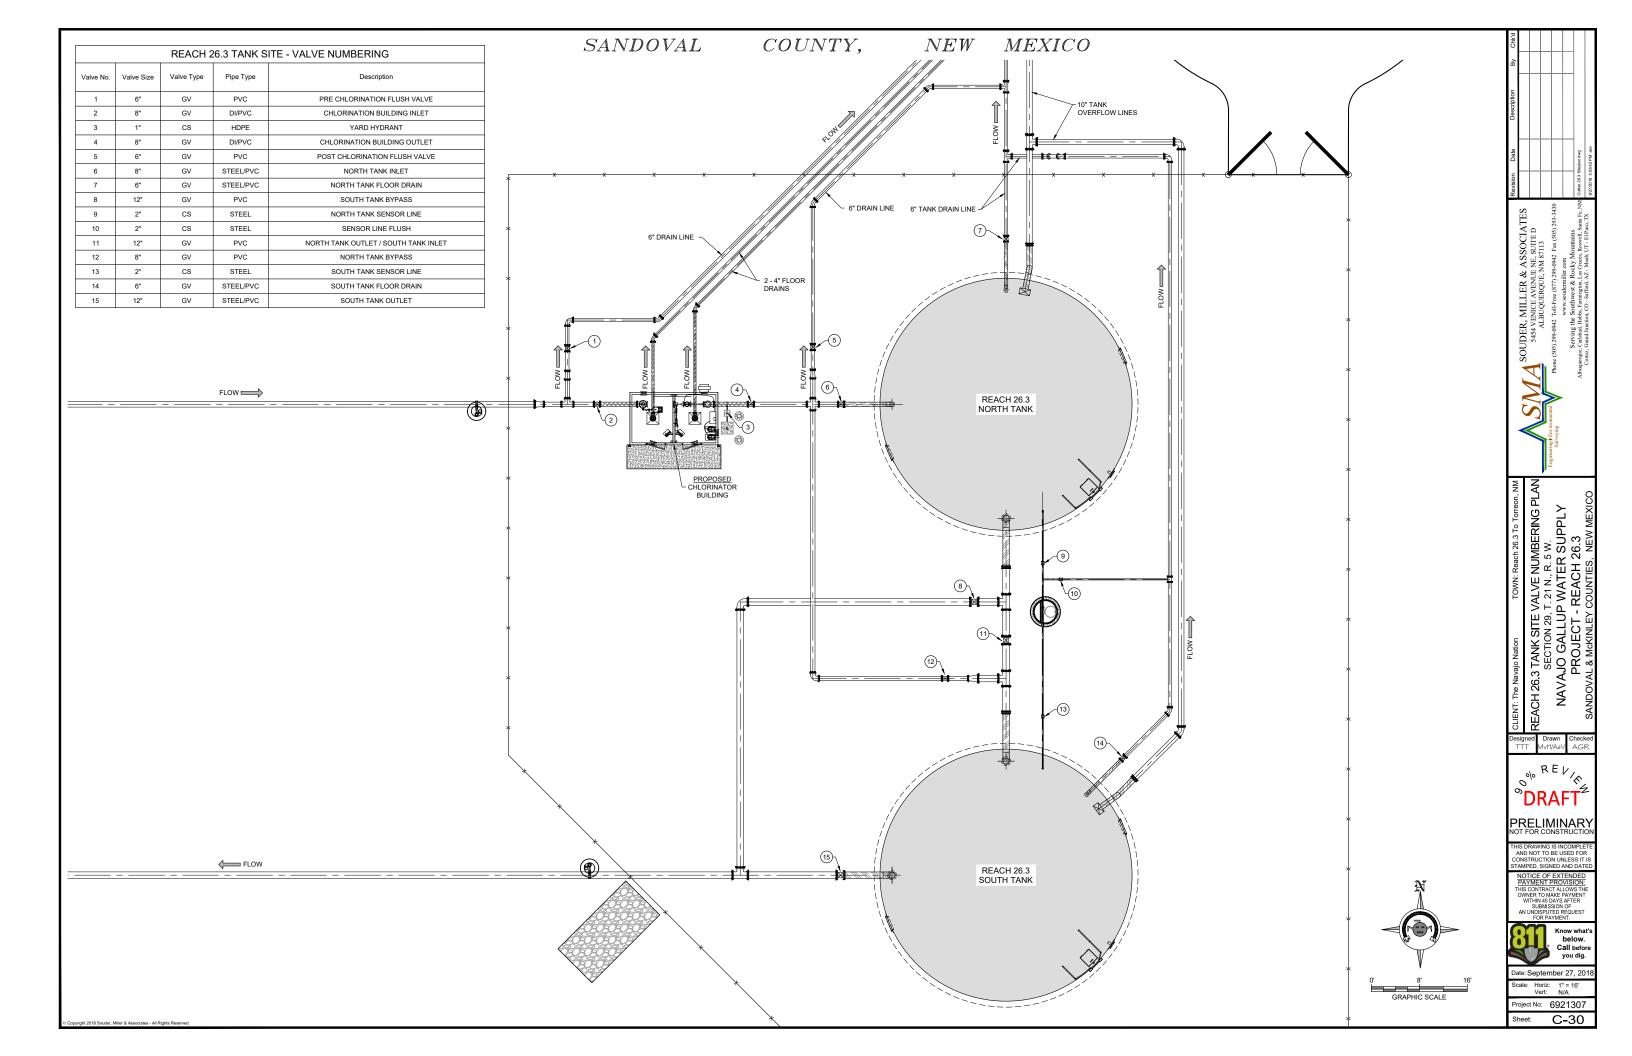


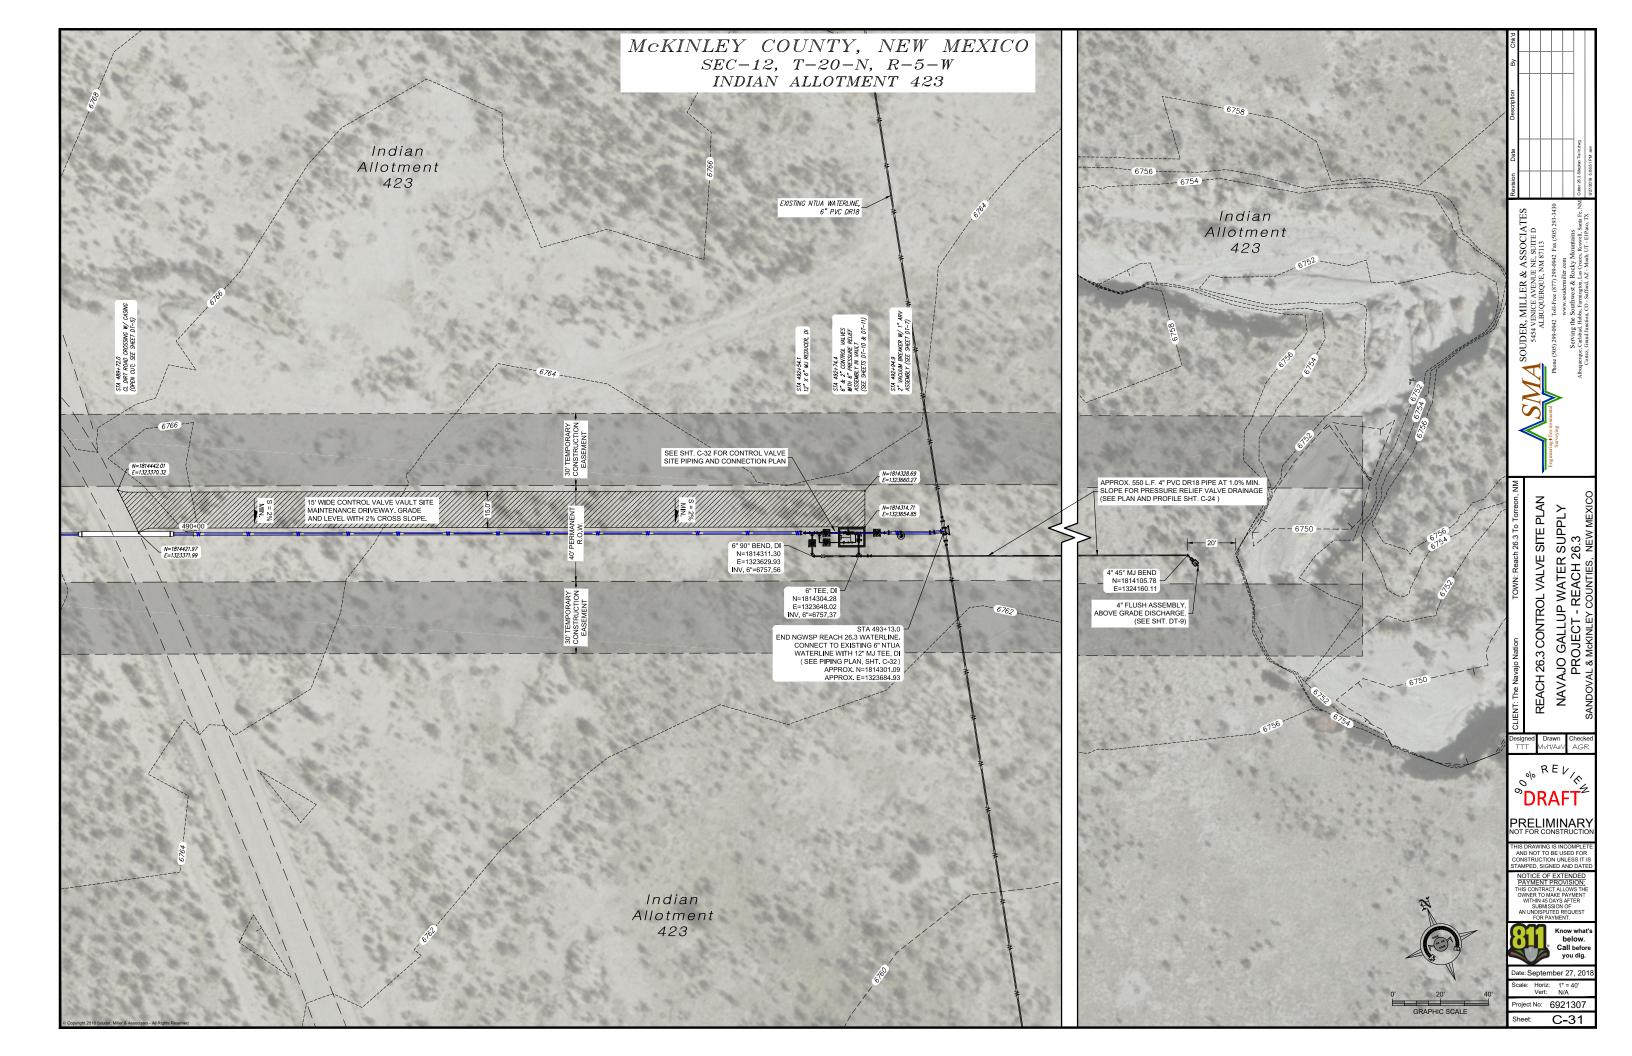

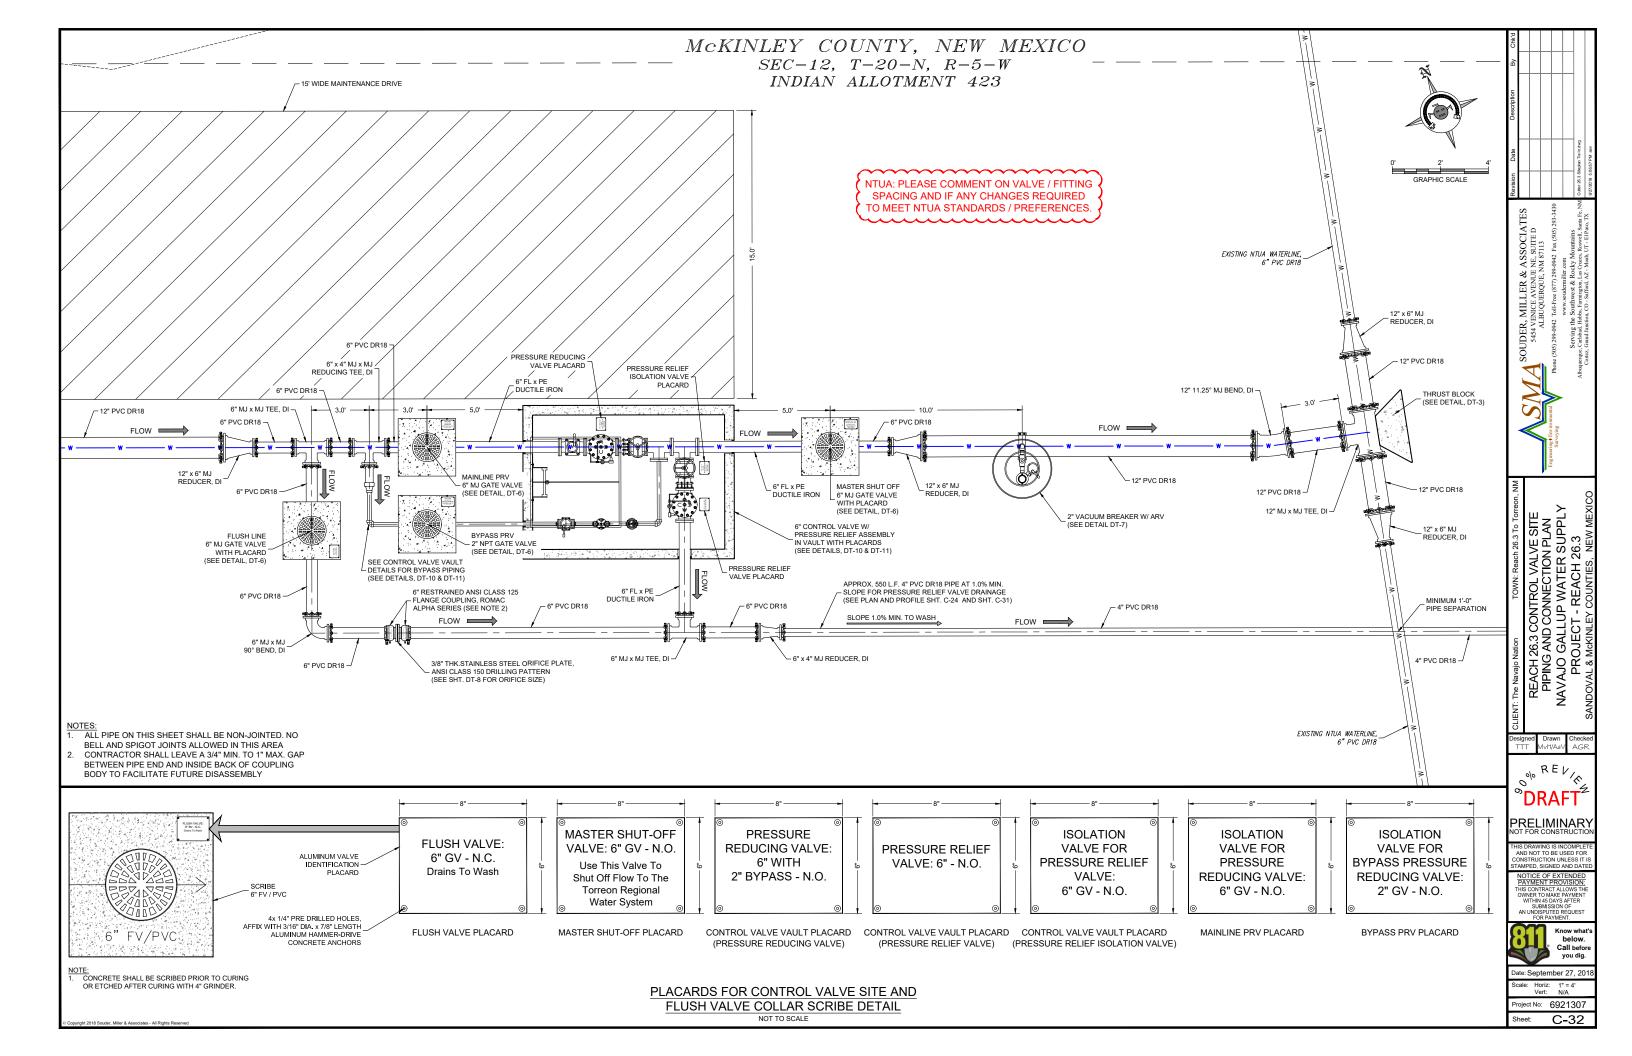

NOTES:

- 1. SOIL CEMENT SLURRY MAY BE USED IN LIEU OF COMPACTED SELECT MATERIAL AT CONTRACTOR'S OPTION AND EXPENSE.
- 2. ANY SECTION OF PIPE EMBEDDED IN COMPACTED SELECT MATERIAL THAT FAILS TO MEET SOIL CLASSIFICATION AND/OR COMPACTION REQUIREMENTS SHALL BE DUG UP, RE-BURIED, RE-COMPACTED AND RE-TESTED AT CONTRACTOR'S SOLE EXPENSE.
- 3. MINIMUM CLEARANCES BETWEEN PIPE AND TRENCH WALL MUST BE MET PRIOR TO PLACING EMBEDMENT (WHETHER COMPACTED SELECT MATERIAL OR SOIL CEMENT SLURRY). INCREASE CLEARANCES AND/OR TRENCH WIDTH AS NEEDED TO ALLOW FOR COMPACTION AND/OR TO ENSURE ADEQUATÉ SOIL CEMENT SLURRY LAYER THICKNESS IN HAUNCH AREAS AND PIPE SPRING LINE. DO NOT ALLOW PIPE TO REST AGAINST TRENCH WALL.
- 4. ROUNDED TRENCH BOTTOMS MAY BE USED IN CONJUNCTION WITH SOIL CEMENT SLURRY, PROVIDED THE THICKNESS OF SOIL CEMENT AROUND THE PIPE IS AT NO POINT LESS THAN 3".

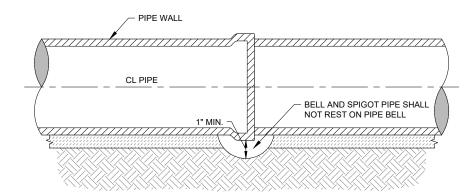


TYPICAL BELL HOLE DETAIL


MINIMUM PERCENT COMPACTION FOR EMBEDMENT OUTSIDE TRAFFIC AREAS, GAS LINES ROW, WASH CROSSINGS **CLEAN COARSE-GRAINED SOILS** 12" Pipe 10" Pipe Minimum Minimum Depth Compaction Compaction None Required 4' to 20' 85% Coarse-grained soils (sand or gravel), GW, GP, SW, SP, with less than 12% fines SANDY OR GRAVELLY FINE-GRAINED SOILS & **COARSE-GRAINED SOILS WITH FINES** 10" Pipe Minimum Minimum Depth Compaction Compaction 4' to 14' 85% None Required 90% Fine-grained soils (LL<50) Soils with medium to no plasticity, CL, ML, ML-CL, with more than 30% coarse-grained particles, or Coarse-grained soils (sand or gravel), GM, GC, SM, SC, with more than 12% fines

NOTES ON COMPACTION

- ALL COMPACTION VALUES BASED ON STD. PROCTOR, ASTM D698. SOIL CLASSIFICATIONS BASED ON ASTM D2487.
- EMBEDMENT WITHIN DRIVING SURFACES OF ALL ROADS, DRIVEWAYS AND PARKING AREAS AS WELL AS GAS LINES ROW, WASH CROSSINGS, AROUND VAULTS AND METER CANS SHALL BE COMPACTED TO AT LEAST 95% STD. PROCTOR, REGARDLESS OF SOIL TYPE. SOIL CEMENT MAY BE USED IN LIEU OF COMPACTED SELECT MATERIAL
- 3. COMPACTION REQUIRED WHERE SHOWN ON DRAWINGS.

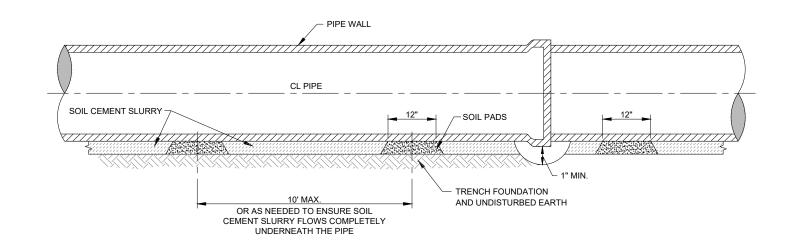

SOIL CEMENT INSTALLATION WITH SOIL PADS

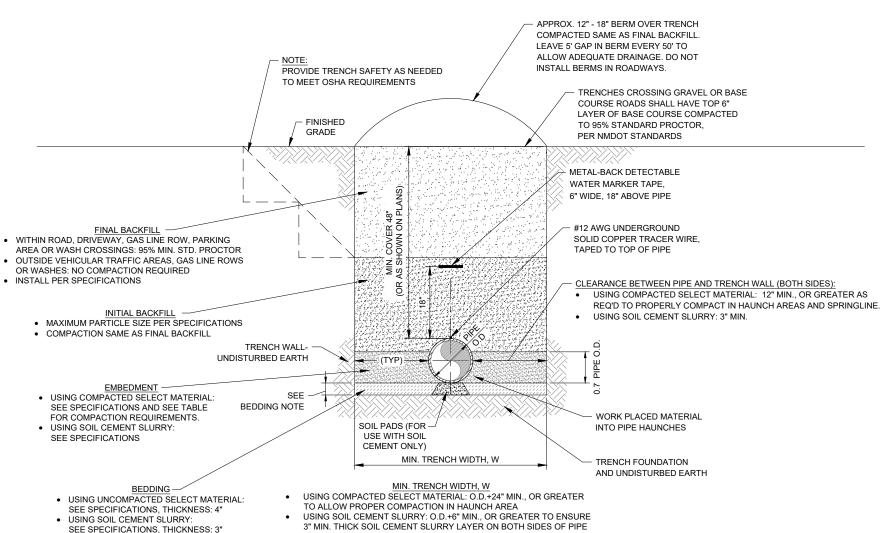

TYPICAL TRENCH DETAIL



NAVAJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
NDOVAL & MCKINI FY COLINTIES NEW MEXI PIPELINE TRENCH DETAILS

DRAFT

PRELIMINAR'


OWNER TO MAKE PAYMENT WITHIN 45 DAYS AFTER SUBMISSION OF AN UNDISPUTED REQUEST FOR PAYMENT,

Know what


Date: September 18, 201

Project No: 6921307 DT-1

BLUE 66" CARSONITE UTILITY CARSONITE UTILITY MARKER ON ALL P.I.'S AND GRADE CHANGES. MAXIMUM DISTANCE BETWEEN CARSONITE UTILITY MARKERS SHALL BE 1500 LF. MARKER EARTHEN BERM (SEE SHT. DT-1) P.I. WITH CARSONITE UTILITY 0.33 CU. FT. MAIN LINE W/ MARKER > MARKER WITHIN FORMED SIGHT CARSOLL UTILITY CARSONITE CONCRETE MARKER INDIVIDUAL MARKER POST - WATER LINE

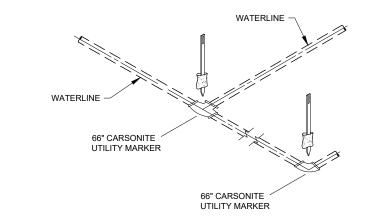


MARKER POSTS TEE & ELL

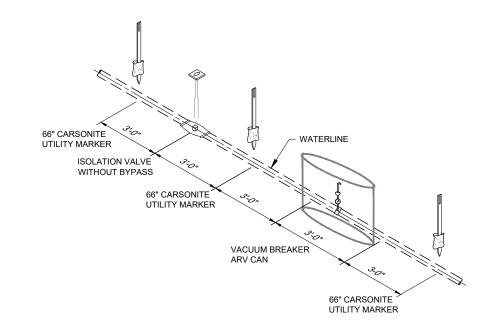

MARKER POSTS GATE VALVE & VACUUM BREAKER / ARV VAULT

 $\frac{\text{TYPICAL MARKER POSTS}}{\text{\tiny NOT TO SCALE}}$

NOT TO SCALE

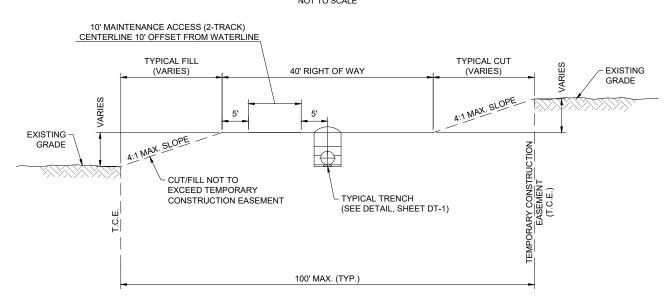

TYPICAL PIPELINE ROW FINISHED GRADING DETAIL NOT TO SCALE

NOTES

- ALL DISTURBED EARTH SHALL BE COMPACTED AND RESEEDED AS REQUIRED PER DT-1

 AND SPECIFICATIONS
- 2. TOTAL WIDTH REDUCED IN AREAS WHERE TEMPORARY CONSTRUCTION EASEMENT IS TRUNCATED DUE TO ADJACENT CULTURALLY SENSITIVE AREAS, ROADWAYS, PRIVATE PROPERTIES, ETC.
- 3. FINAL GRADING AND SLOPE STABILIZATION MUST BE APPROVED BY ENGINEER AND BLM.

SOUDER, MILLER & ASSOCIATES

5454 VENUE AVENUE RE, SUITE D

ALBUQUERQUE, NM 87113

none (505) 294-042 Toll-Free (877) 299-042 Face (505) 293-3430

www.soudermildr.com

Serving the Schaffwest Rocky Mountains

Serving the Schaffwest Act Schaff Rowell, Sama Fe, NM

Cortez, Gand-Junction, CO - Suifred, AZ - Moub, UT - El Paso, TX

surgons 50724549 asv

CELLANEOUS CONSTRUCTION
DETAILS
AJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
AL & MOKINLEY COUNTIES NEW MEY COUNTIES

igned Drawn Ch

igned Drawn Character AAV A



PRELIMINARY NOT FOR CONSTRUCTION

THIS DRAWING IS INCOMPLET AND NOT TO BE USED FOR CONSTRUCTION UNLESS IT IS STAMPED, SIGNED AND DATE

NOTICE OF EXTENDE
PAYMENT PROVISIOI
THIS CONTRACT ALLOWS I
OWNER TO MAKE PAYMEN
WITHIN 45 DAYS AFTER
SUBMISSION OF
AN UNDISPUTED REQUES



eptember 18, 201

Scale: Horiz: NONE Vert: N/A


Project No: 6921307


Sheet: DT-2

THRUST BLOCK DIMENSION SCHEDULE			
Pipe Location	Pipe Size (Inches)	90° Bend H x W	Tee H x W
Reach 26.3 Chlorinator, Inlet & Outlet	8"	4'-0" x 4'-0"	N/A
Flush Valve with Above-Grade Discharge	2"	N/A	1'-0" x 1'-0"
Tee for Torreon Regional Water System Tie-in	6"	N/A	2'-6" x 2'-6"

GENERAL NOTES

- 1. SOIL BEARING FROM GEO-TEST REPORT NO. 1-71180 DATED JANUARY 8, 2018
- 2. ALL CONCRETE SHALL BE 3000 psi, MINIMUM COMPRESSIVE STRENGTH IN 28 DAYS

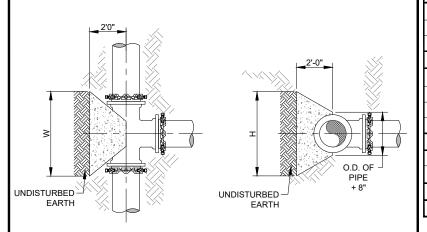

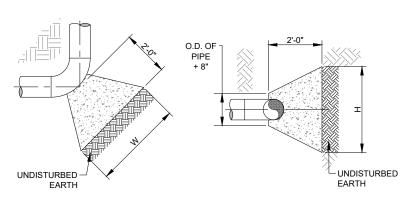

PLAN VIEW CONCRETE BLOCKING FOR ELBOW

PLAN VIEW

CONCRETE BLOCKING

ELEVATION VIEW CONCRETE BLOCKING FOR ELBOW

ELEVATION VIEW

CONCRETE BLOCKING

FOR TEE


THRUST BLOCK DETAIL

Fitting	Pipe Size	(psi)	Length (ft)	
Tee	10"	235	4	0
Isolation Valve / Dead End	10"	235	14	10
From End of Casing	10"	235	60	
Horizontal Bend or Sweep			·	
90°	10"	235	65	
45°	10"	235	30	
22.5°	10"	235	20	
11.25°	10"	235	20	
Vertical Offset or Sweep		·	Upper Bend	Lower Bend
22.5°	10"	235	30	20
11.25°	10"	235	20 20	

Minimum Required Restraint Lengths Reach 26.3 - 12" DR18 PVC				
Fitting	Pipe Size	Test Pressure (psi)		Restraint th (ft)
Tee	12"	235	6	5
Isolation Valve / Dead End	12"	235	16	35
From End of Casing	12"	235	7	5
Horizontal Bend or Sweep				
90°	12"	235	75	
45°	12"	235	30	
22.5°	12"	235	20	
11.25°	12"	235	20	
Vertical Offset or Sweep Upper Bend Lo		Lower Bend		
22.5°	12"	235	35	20
11.25°	12"	235	20	20
Transition				
Reducer 12" x 6" 235 120		20		

NOTES:

- 1. MECHANICAL JOINT RESTRAINTS SHALL BE RATED TO PIPE PRESSURE RATINGS.
- MECHANICAL JOINT RESTRAINTS INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. FITTINGS WITHIN TANK SITE AND CONTROL VALVE VAULT SHALL BE MORTAR LINED, BITUMINOUS-COATED AND PE WRAPPED PER SPECIFICATIONS. ALL BURIED METALLIC WATER BEARING COMPONENTS OUTSIDE THESE SITES SHALL BE COATED WITH FUSION BONDED EPOXY, INTERIOR AND EXTERIOR.
- APPLY CATHODIC PROTECTION TO ALL BURIED METALLIC COMPONENTS LOCATED WITHIN CORROSIVE SOILS ZONES, AS DESIGNATED IN PLANS AND/OR SPECIFICATIONS.
- ALL RESTRAINED PIPE JOINTS SHALL BE FUSIBLE PVC. NO BELL HARNESS RESTRAINTS SHALL BE ALLOWED.
- ALL SITE PIPING SHALL BE FULLY RESTRAINED.
- WHERE MULTIPLE FITTING / VALVE RESTRAINT LENGTHS OVERLAP, THE RESTRAINT LENGTHS FOR EACH APPURTENANCE SHALL BE ADDED TOGETHER, UNLESS OTHERWISE SHOWN ON PLANS.
- FOR ANY FITTING OR APPURTENANCE NOT EXPRESSLY CALLED OUT IN PLANS, REFER TO THIS SHEET FOR RESTRAINT LENGTH REQUIREMENTS.
- NO VERTICAL BENDS SHALL BE ALLOWED THAT ARE NOT SHOWN ON DRAWINGS WITHOUT ENGINEER'S PRIOR APPROVAL. IN THE EVENT VERTICAL BENDS ARE ADDED, ADDITIONAL JOINT RESTRAINT SHALL BE REQUIRED AT CONTRACTOR'S EXPENSE.
- 10. FOR RESTRAINED LENGTHS 20 LF OR LESS, JOINTED PVC PIPE MAY BE USED IN LIEU OF FUSIBLE PVC, PROVIDED THE ENTIRE PIPE IS A SINGLE STICK.

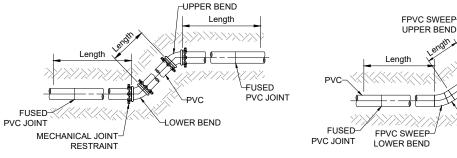


ELEVATION VIEW MECHANICAL JOINT RESTRAINT FOR VERTICAL OFFSET

ELEVATION VIEW FUSED JOINT RESTRAINT FOR VERTICAL SWEEP

MECHANICAL JOINT: RESTRAINT


LOWER BEND

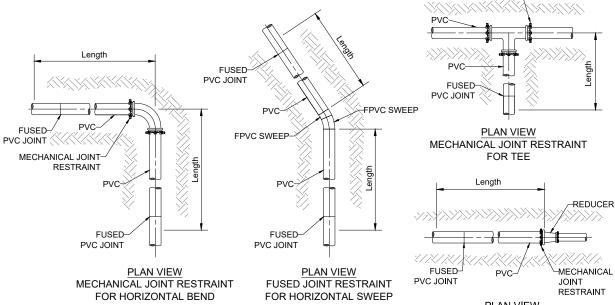

PLAN VIEW MECHANICAL JOINT RESTRAINT FOR REDUCERS

FUSED-

Length

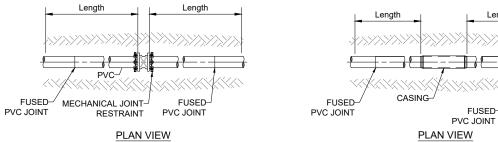


MECHANICAL JOINT RESTRAINT FOR GATE VALVE

FUSED JOINT RESTRAINT FOR CASING

MECHANICAL / FUSED JOINT RESTRAINTS

NOT TO SCALE












ate: September 6, 2018

Project No: 6921307

DT-3

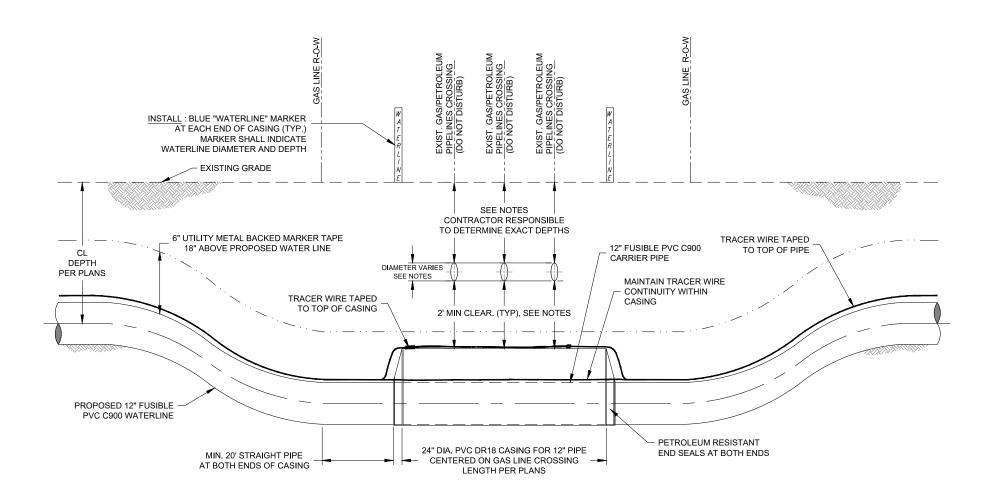

TYPICAL GAS PIPELINE CROSSING DETAIL

NOT TO SCALE


SPECIAL NOTES AND CONTACTS-UTILITY PIPELINE CROSSINGS

- NOTES:

 1. NOTIFY GAS LINE COMPANIES (LISTED BELOW) 30 WORKING DAYS AND CALL NM ONE-CALL AT LEAST 3 WORKING DAYS PRIOR TO GRADING, CROSSING, MATERIAL STORAGE OR EQUIPMENT MOVING ACROSS GAS LINE RIGHT-OF-WAY OR ADJACENT ACCESS ROADS.
- 2. GAS LINE COMPANY REPRESENTATIVE MUST BE PRESENT DURING ALL CONSTRUCTION ACTIVITIES WITHIN GAS LINE RIGHT-OF-WAY, INCLUDING GRADING, EXCAVATION AND CLEANUP.
- 3. CONTRACTOR RESPONSIBLE TO LOCATE AND EXPOSE ALL EXISTING GAS / PETROLEUM LINES, IN ACCORDANCE WITH GAS COMPANY REQUIREMENTS.
- EXCAVATE BY HAND OR VACUUM DRILL WITHIN 2 FEET OF GAS LINE. IF GAS LINE COMPANY APPROVES, CONTRACTOR MAY INSTALL CASING BY BORING, USING FUSIBLE PVC CASING WITH INTERIOR WELD BEAD REMOVED.
- CROSS UNDER ALL GAS LINES. CROSSINGS REQUIRE 2' MIN. CLEARANCE FROM TOP OF CASING TO BOTTOM OF GAS LINE. WHERE MULTIPLE GAS LINES ARE CROSSED IN THE SAME ROW, MAINTAIN MIN. CLEARANCE UNDER THE LOWEST GAS LINE.
- 6. CONTRACTOR SHALL NOT SUSPEND EXISTING GAS LINE PIPE MORE THAN 12 FEET WITHOUT SOIL BEDDING OR OTHER SUPPORT APPROVED BY GAS LINE COMPANY.
- COMPLETE ANY AND ALL ENCROACHMENT AGREEMENTS REQUIRED BY GAS LINE COMPANIES. ABIDE BY ALL CONDITIONS STIPULATED BY GAS LINE COMPANIES.
- 8. HEAVY EQUIPMENT MUST CROSS PIPELINE ONLY AT CROSSING LOCATIONS APPROVED BY GAS
- 9. FOR MINIMUM FUSIBLE PVC PIPE RESTRAINT REQUIREMENTS ON EACH SIDE OF CASING, SEE TABLE SHEET DT-3. ALL REMAINING CARRIER PIPE WITHIN A 200 FT. RADIUS OF LIQUID PETROLEUM LINE SHALL EITHER BE FUSIBLE PVC OR BELL-AND-SPIGOT PVC WITH PETROLEUM RESISTANT GASKETS. CASING SHALL EITHER BE FUSIBLE PVC WITH INTERIOR WELD BEAD REMOVED OR BELL AND SPIGOT PVC.
- 10. TRACER WIRE CONTINUITY SHALL BE MAINTAINED ACROSS THE GAS LINE XING.
- 11. THE INSIDE OF THE CASING AND THE OUTSIDE OF THE CARRIER PIPE MUST BE FREE OF ANY IRREGULARITIES THAT WOULD CAUSE A POINT LOAD ON CARRIER PIPE. ENGINEER RESERVES THE RIGHT TO REQUIRE SPACERS (MAX. 10' APART) IF CASING OR CARRIER PIPE ARE NOT SUFFICIENTLY SMOOTH AND REGULAR. EXTERIOR WELD BEADS SHALL BE REMOVED FROM FUSIBLE PVC CARRIER PIPE.
- 12. APPROXIMATE DEPTH CALL OUTS ARE MEASURED FROM THE EXISTING GROUND TO THE TOP

(1) = STA: 289+83.5 (APPROX.) ENTERPRISE MID AMERICA PIPELINE CO. 281-887-2612 DUSTIN HANSCOM - FIELD CONTACT 505-215-2229 ROBERT NORTH - AREA MANAGER 505-486-0713 3 GAS PIPELINES (12" DIA. STEEL, 43" TO TOP) (8" DIA. STEEL, 44" TO TOP) (12" DIA. STEEL, 41" TO TOP) SEC-5, T-20-N, R-5-W

(2) = STA: 315+79.9 (APPROX.) ENTERPRISE MID AMERICA PIPELINE CO. 281-887-2612 DUSTIN HANSCOM - FIELD CONTACT 505-215-2229 ROBERT NORTH - AREA MANAGER 505-486-0713 3 GAS PIPELINES (12" DIA. STEEL, DEPTH UNKNOWN) (8" DIA. STEEL, DEPTH UNKNOWN) (12" DIA. STEEL, DEPTH UNKNOWN) SEC-4, T-20-N, R-5-W





GAS LINE CROSSING DETAILS

NAVAJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
NDOVAL & MAKINI FY COLINITIES NEW MEV.


PRELIMINAR\



Date: September 27, 201

DT-4

Project No: 6921307

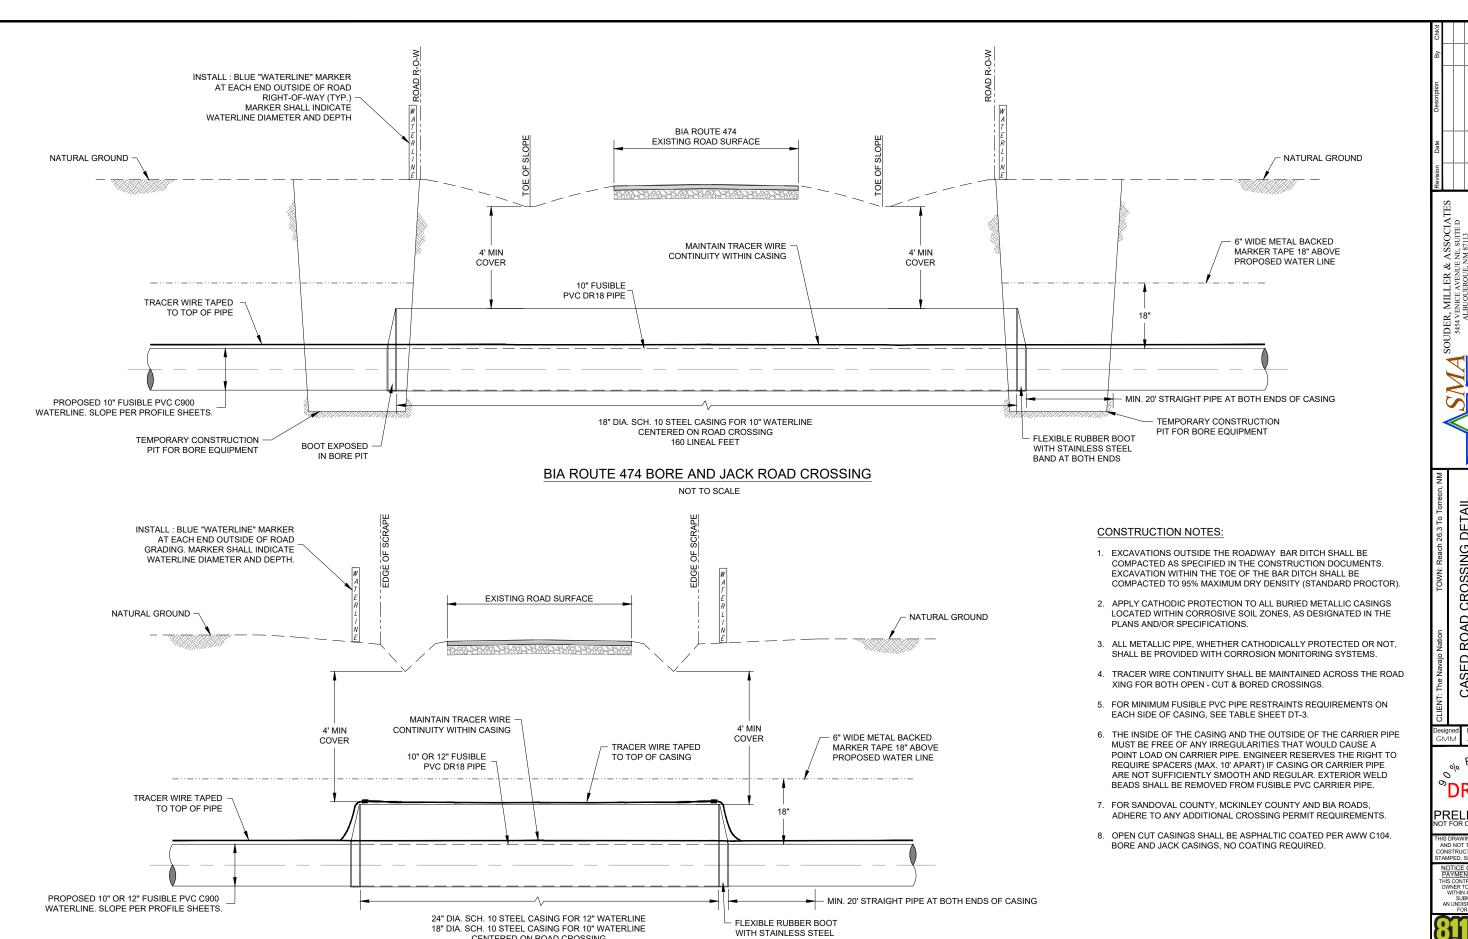

BAND AT BOTH ENDS

SOUDER, MILLER & ASSOCIATES 5454 VENICE AVENUE AVENTE D ALBUQUERQUE, NM 87113

CASED ROAD CROSSING DETAIL

NAVAJO GALLUP WATER SUPPLY PROJECT - REACH 26.3 NDOVAL & MCKINLEY COUNTIES. NEW MEY

REV DRAFT

PRELIMINARY
NOT FOR CONSTRUCTIO

OWNER TO MAKE PAYMENT WITHIN 45 DAYS AFTER SUBMISSION OF AN UNDISPUTED REQUEST FOR PAYMENT.

Know what

Date: September 27, 201


Project No: 6921307 DT-5


TYPICAL OPEN CUT ROAD CROSSING


CENTERED ON ROAD CROSSING

LENGTH PER PLANS

NOT TO SCALE

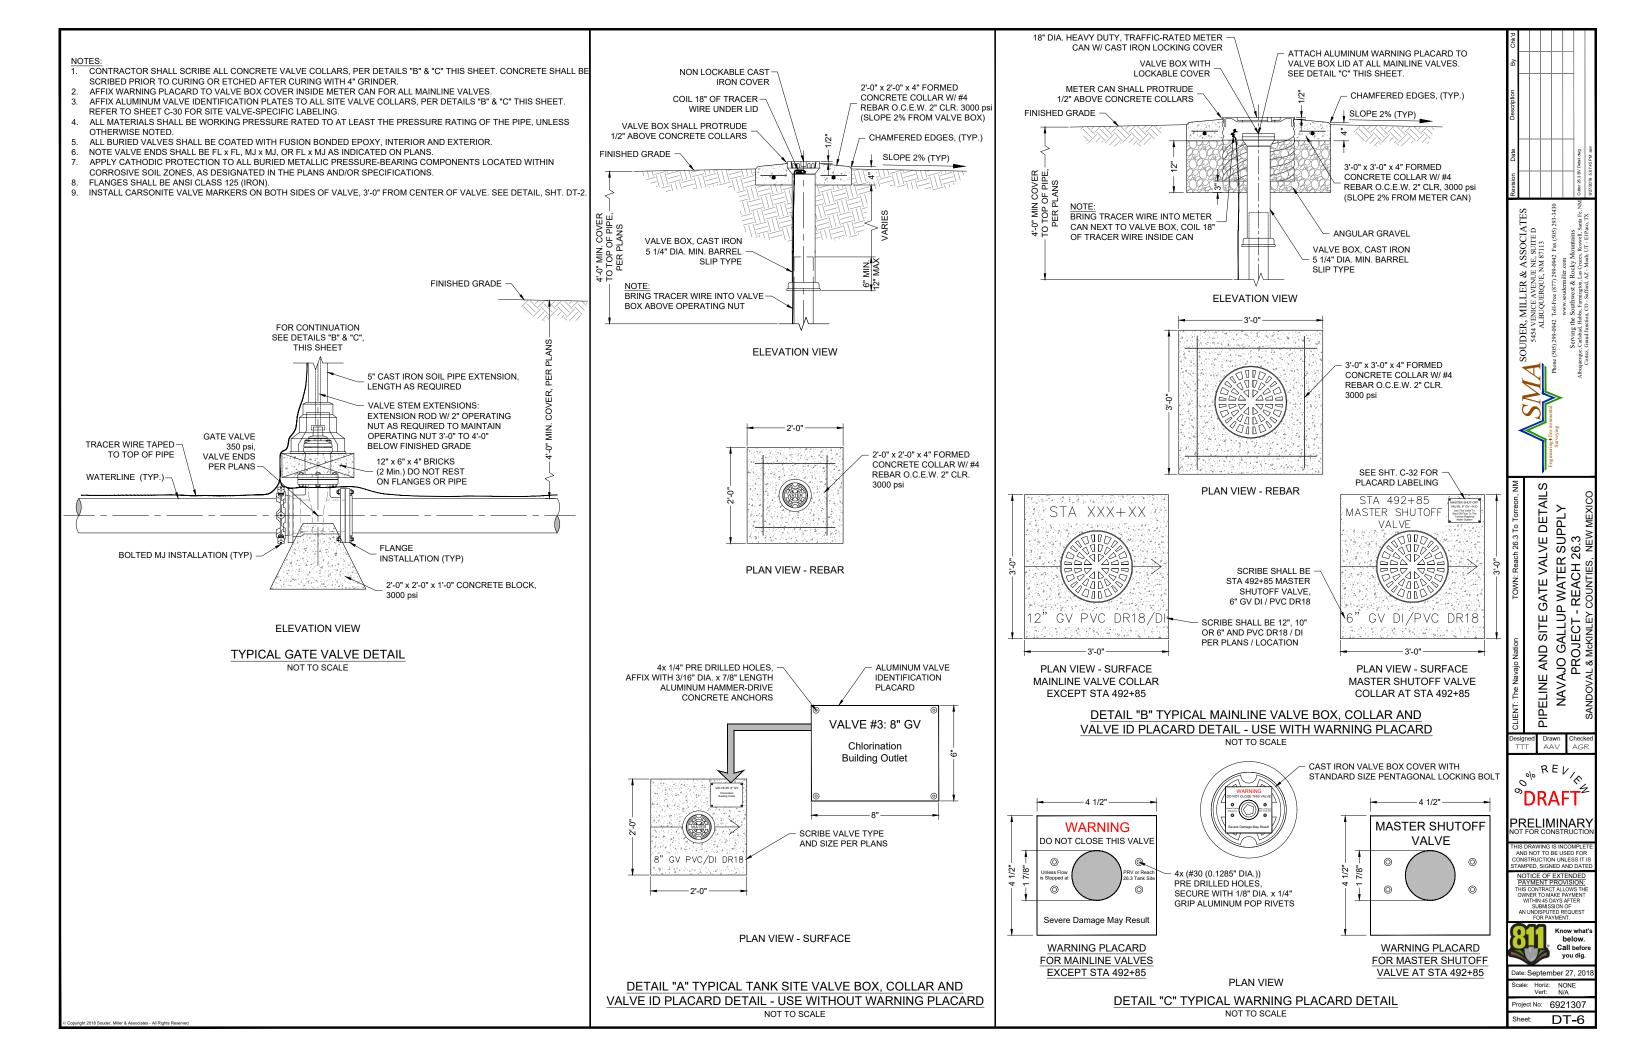

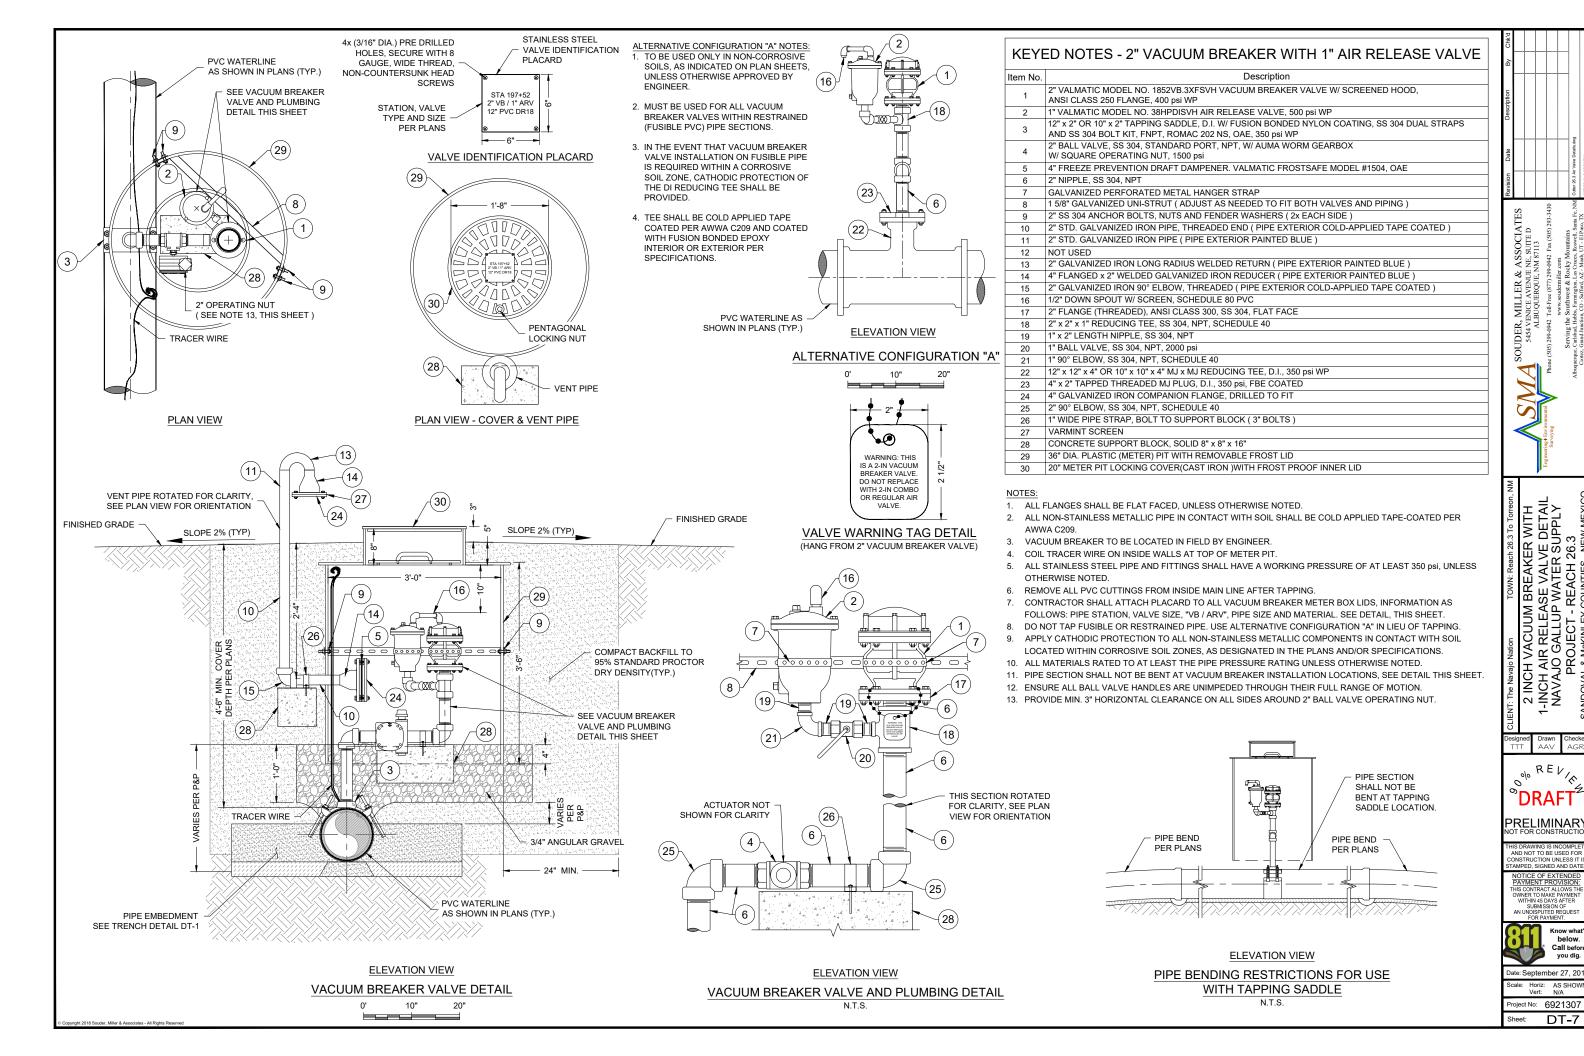





PRIOR TO CURING OR ETCHED AFTER CURING WITH A 4" GRINDER

COLLAR SCRIBING DETAIL

NOT TO SCALE

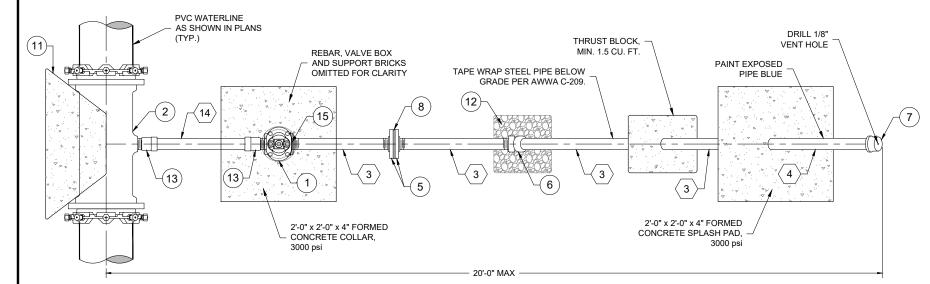

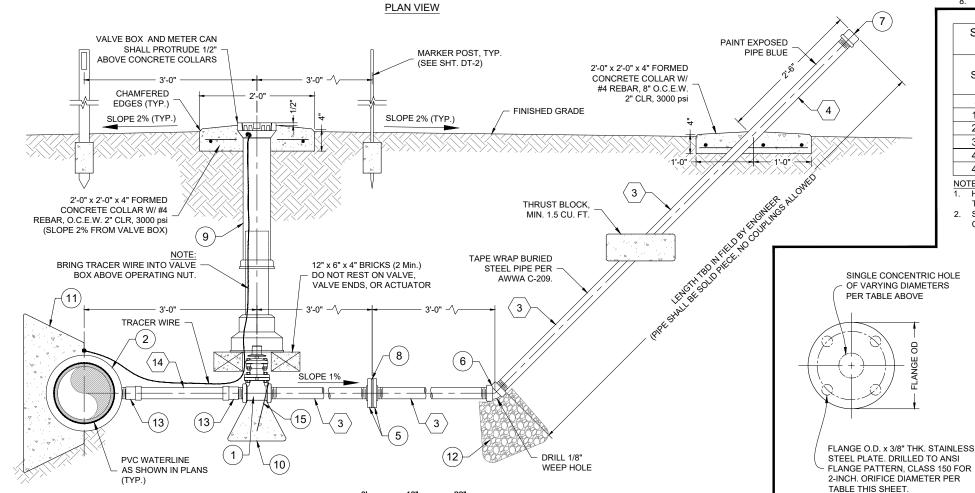

ELEVATION VIEW


2" FLUSH VALVE WITH ABOVE-GRADE DISCHARGE DETAIL

KEYED NOTES - 2" FLUSH VALVE WITH ABOVE GRADE DISCHARGE

Item No.	DESCRIPTION	
1	2" GATE VALVE, FBE COATED, NPT, W/ 2" OPERATING NUT, 250 psi	
2	10" x 2" MJ TAPPED TEE, D.I., 350 psi	
3	2" G.I. PIPE, STANDARD WALL, NPT, TAPE COATED BELOW GRADE	
4	2" G.I. PIPE, STANDARD WALL, NPT, PAINTED BLUE ABOVE GRADE	
5	2" G.IHUB, FLAT FACED, COMPANION FLANGE, NPT, SS 304, ANSI CLASS 300	
6	2" G.I. 45° ELL, NPT, 300 psi	
7	2" G.I. CAP, NPT, 300 psi, W/ 1/8" VENT HOLE	
8	3/8" THK. STAINLESS STEEL ORIFICE PLATE, ANSI CLASS 300 DRILLING PATTERN (SEE TABLE THIS SHEET FOR ORIFICE SIZE)	
9	VALVE BOX SLIP TYPE WITH LOCKING CAST IRON COVER (SEE DETAIL DT-6)	
10	1'-0" x 1'-0" x 1'-0" CONCRETE BLOCK, 3000 psi	
11	THRUST BLOCK (SEE DETAIL DT-3)	
12	ROUNDED ROCK (1.5 CU. YD.)	
13	2" ADAPTER, PVC, SLIP-GASKET x NPT, SDR-21, 200 psi	
14	2" PVC, SDR-21, 200 psi	
15	#4 REBAR RESTRAINT	

ALL FLANGES SHALL BE ANSI CLASS 300 (STEEL).


- 2. ALL NON STAINLESS STEEL PIPE AND FITTINGS SHALL BE TWO-PART EPOXY COATED, INTERIOR AND EXTERIOR. ALL NON STAINLESS METALLIC PIPE IN CONTACT WITH SOIL SHALL ALSO BE COLD APPLIED TAPE-COATED PER AWWA C-209 AND SPECIFICATIONS.
- 3. ORIENTATION AND LOCATION OF OUTLET TO BE DETERMINED IN FIELD BY ENGINEER.
- APPLY CATHODIC PROTECTION TO ALL BURIED METALLIC WATER-CARRYING COMPONENTS LOCATED WITHIN CORROSIVE SOIL ZONES, AS DESIGNATED IN THE PLANS AND/OR SPECIFICATIONS.
- 5. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL.
- 6. ALL COMPONENTS SHALL REMAIN WITHIN THE 40' PERMANENT RIGHT-OF-WAY.
- 7. ALL MATERIALS RATED TO AT LEAST MAINLINE PIPE PRESSURE RATING, UNLESS OTHERWISE NOTED.
- 8. SEE TABLE THIS SHEET FOR ORIFICE PLATE DRILLING AND FLUSH VALVE TYPE REQUIREMENTS.



HOLE TO BE DRILLED CENTERED ON THE ORIFICE PLATE.

2. SEE SHT. C-32 FOR 6" ORIFICE PLATE CONNECTION DETAILS.

ORIFICE PLATE

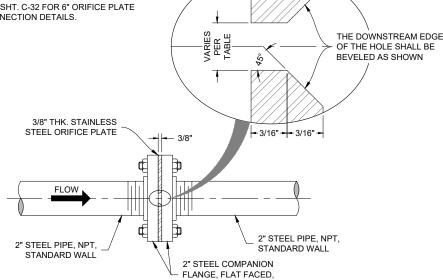

NPT, ANSI CLASS 150

2" FLUSH VALVE

ORIFICE PLATE ASSEMBLY

NOT TO SCALE


CH FLUSH WITH ORIFICE AND //E-GRADE DISCHARGE DETAIL AJO GALLUP WATER SUPPLY PROJECT - REACH 26.3


REV DRAFT

PRELIMINARY NOT FOR CONSTRUCTION

ate: September 27, 201

Project No: 6921307 DT-8

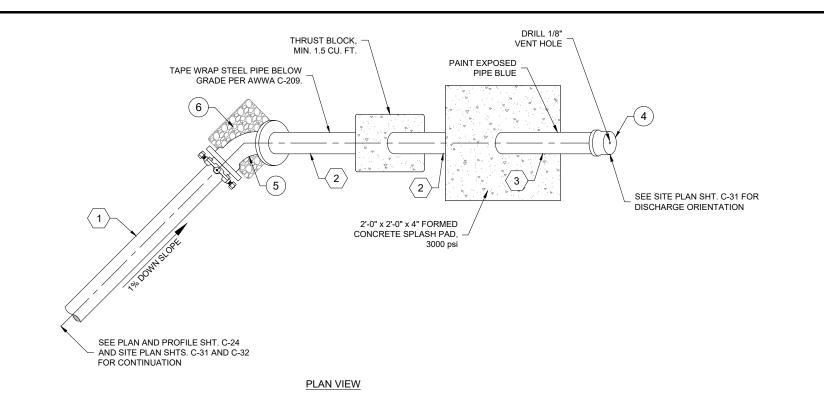

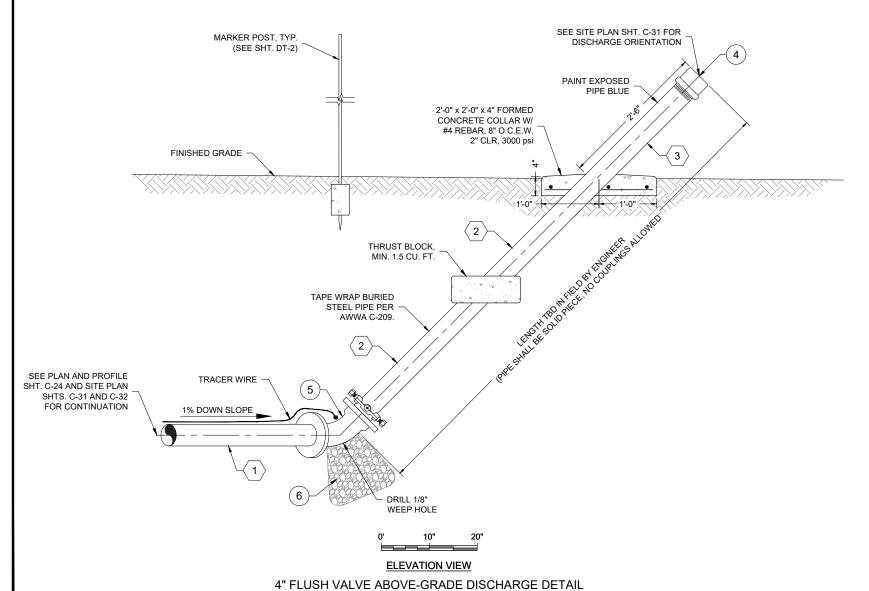


KEYED NOTES - 4" FLUSH VALVE ABOVE GRADE DISCHARGE

Ite	em No.	DESCRIPTION
	1	4" PVC, DR-18
	2	4" G.I. PIPE, STANDARD WALL, PE x NPT, TAPE COATED BELOW GRADE
	3	4" G.I. PIPE, STANDARD WALL, PE x NPT, PAINTED BLUE ABOVE GRADE
	4	4" G.I. CAP, NPT, 300 psi, W/ 1/8" VENT HOLE
	5	4" 45° MJ ELL, D.I., 350 psi (ROTATED 45° TOWARDS FINISHED GRADE)
	6	ROUNDED ROCK (1.5 CU. YD.)

NOTES

- APPLY CATHODIC PROTECTION TO ALL BURIED METALLIC WATER-CARRYING COMPONENTS LOCATED WITHIN CORROSIVE SOIL ZONES, AS DESIGNATED IN THE PLANS AND/OR SPECIFICATIONS.
- 2. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL.
- 3. ALL COMPONENTS SHALL REMAIN WITHIN THE 40' PERMANENT RIGHT-OF-WAY.
- 4. ALL MATERIALS RATED TO AT LEAST MAINLINE PIPE PRESSURE RATING, UNLESS OTHERWISE NOTED.
- 5. MECHANICAL JOINTS OMITTED FROM ISOMETRIC VIEWS FOR CLARITY.



SOUDER, MILLER & ASSOCIATIES
5454 VENICE AVENUE NE. SUITED
ALBUQUERQUE, NM 87113
none (505) 299-0942. Toil-Free (877) 299-0942. Fax (505) 293-3430
www.soudemiller.com
Serving the Southwest & Recky Mountains
squerque, careback Hobs, Famingen, Les Crees, Rowell, Same F. MA
Conez, Gand Juncion, CO. Saffred, AZ. Moth, UT. EPISen, TX



TOWN: Reach 26.3 To Torreon, NM
VALVE ABOVE-GRADE
HARGE DETAIL
I I IP WATER SI IPPI Y

4 INCH FLUSH VALVE DISCHARGE NAVAJO GALLUP W PROJECT - RE

igned Drawn

ON REV

PRELIMINARY NOT FOR CONSTRUCTION

THIS DRAWING IS INCOMPLET AND NOT TO BE USED FOR CONSTRUCTION UNLESS IT IS STAMPED, SIGNED AND DATE

NOTICE OF EXTENDED
PAYMENT PROVISION:
THIS CONTRACT ALLOWS TH
OWNER TO MAKE PAYMENT
WITHIN 45 DAY'S AFTER
SUBMISSION OF
AN UNDISPUTED REQUEST



Date: September 27, 2018

Scale: Horiz: AS SHOW Vert: N/A

Project No: 6921307

Sheet: DT-9


© Copyright 2018 Souder, Miller & Associates - All Rights Reserved

KEYED NOTES - 6" CONTROL VALVE W/ PRESSURE RELIEF ASSEMBLY VAULT		
Item No.	Description	
1	6" FL x FL PRESSURE REDUCING VALVE, CLASS 150, 250 psi	
2	6" FL x FL H-STYLE STRAINER, CLA-VAL MODEL X43H, CLASS 150, 250 psi	
3	6" DISMANTLING JOINT, FBE COATED W/ 304 SS BOLTS, ROMAC MODEL DJ400, CLASS E FLANGE, 275 psi	
4	6" FL x FL PRESSURE RELIEF VALVE, CLASS 150, 250 psi	
5	6" FL x FL TEE, DI, 350 psi	
6	6" FL x PE DUCTILE IRON PIPE, 350 psi	
7	6" PVC DR 18 PIPE	
8	6" MJ x MJ GATE VALVE, 350 psi (SEE DETAIL, DT-6)	
9	6" FL x FL GATE VALVE, 350 psi, HAND WHEEL ACTUATOR	
10	6" x 4" MJ REDUCING TEE, DI, 350 psi	
11	6" x 2" TAPPED BLIND FLANGE, DI	

12	4" PE x NPT G.I. PIPE STANDARD WALL
13	4" x 2" G.I. REDUCER, NPT, 350 psi
14	2" PRESSURE REDUCING VALVE, NPT, 400 psi
15	2" FL x FL H-STYLE STRAINER, CLA-VAL MODEL X43H, CLASS 150, 250 psi
16	2" GATE VALVE, NPT, 350 psi (SEE DETAIL, DT-6)
17	2" GATE VALVE, NPT, 350 psi, HAND WHEEL ACTUATOR
18	2" G.I. PIPE, STANDARD WALL, NPT
19	2" G.I HUB, FLAT FACED, COMPANION FLANGE, NPT, SS 304, ANSI CLASS 150
20	2" G.I. 90° ELL, NPT, 350 psi
21	1/2" VALMATIC MODEL NO. 22 AIR RELEASE VALVE, 300 psi WP
22	1/2" DOWN SPOUT W/ SCREEN, SCHEDULE 80 PVC
23	ADJUSTABLE PIPE SUPPORT W/ U-SHAPED CRADLE
24	ALUMINUM LADDER W/ SAFETY POST ANCHORED TO VAULT OPENING AND FLOOR (SHIPPED LOOSE)

- 1. ALL MATERIALS RATED TO AT LEAST MAINLINE PIPE PRESSURE RATING, UNLESS OTHERWISE NOTED.
- FLANGES SHALL BE ANSI CLASS 125 (IRON). COIL TRACER WIRE ON INSIDE WALLS OF VAULT.
- SOME PIPE SUPPORTS NOT SHOWN FOR CLARITY. ENSURE ALL BALL VALVE HANDLES ARE UNIMPEDED THROUGH THEIR FULL RANGE OF MOTION.
- ALL NON-STAINLESS METALLIC PIPE AND FITTINGS IN CONTACT WITH SOIL SHALL BE COLD APPLIED TAPE WRAPPED PER AWWA C209.
- 7. SEE SHEET C-32 FOR PLACARD DETAILS



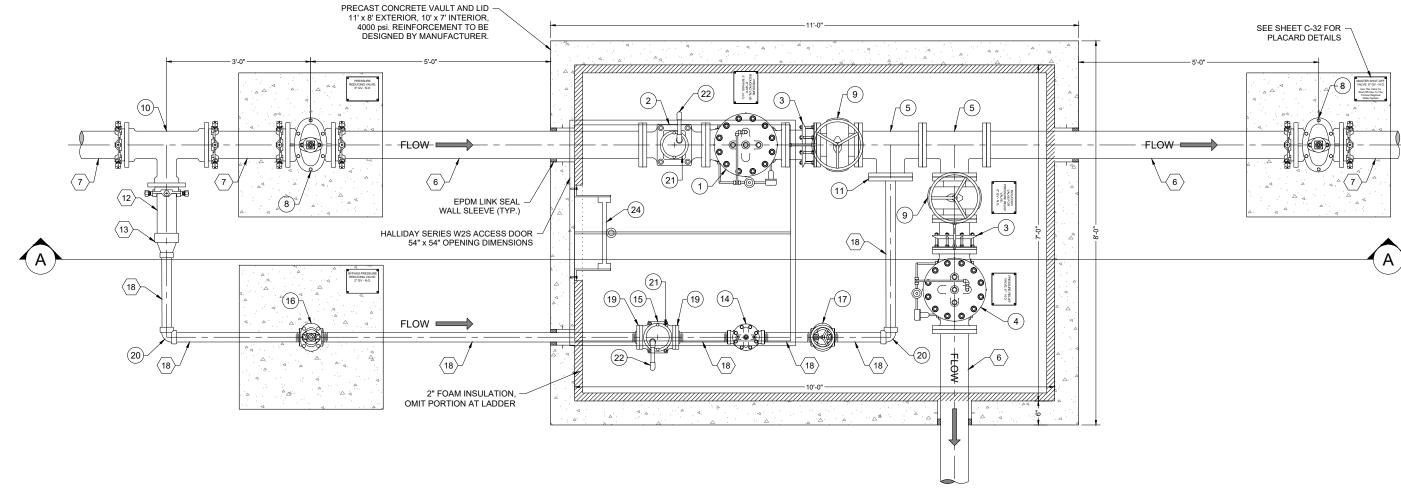

PLAN VIEW

6" CONTROL VALVE W/ PRESSURE RELIEF ASSEMBLY VAULT DETAIL

ODRAFT ODRAFT

INCH CONTROL VALVE WITH PRESSURE RELIEF VAULT DETAIL (1 of 2)
NAVAJO GALLUP WATER SUPPLY PROJECT - REACH 26.3

PRELIMINARY NOT FOR CONSTRUCTION

Date: September 27, 2018


Project No: 6921307

DT-10

KEYED NOTES - 6" CONTROL VALVE W/ PRESSURE RELIEF ASSEMBLY VAULT		
Item No.	Description	
1	6" FL x FL PRESSURE REDUCING VALVE, CLASS 150, 250 psi	
2	6" FL x FL H-STYLE STRAINER, CLA-VAL MODEL X43H, CLASS 150, 250 psi	
3	6" DISMANTLING JOINT, FBE COATED W/ 304 SS BOLTS, ROMAC MODEL DJ400, CLASS E FLANGE, 275 psi	
4	6" FL x FL PRESSURE RELIEF VALVE, CLASS 150, 250 psi	
5	6" FL x FL TEE, DI, 350 psi	
6	6" FL x PE DUCTILE IRON PIPE, 350 psi	
7	6" PVC DR 18 PIPE	
8	6" MJ x MJ GATE VALVE, 350 psi (SEE DETAIL, DT-6)	
9	6" FL x FL GATE VALVE, 350 psi, HAND WHEEL ACTUATOR	
10	6" x 4" MJ REDUCING TEE, DI, 350 psi	
11	6" x 2" TAPPED BLIND FLANGE, DI	

12	4" PE x NPT G.I. PIPE STANDARD WALL
13	4" x 2" G.I. REDUCER, NPT, 350 psi
14	2" PRESSURE REDUCING VALVE, NPT, 400 psi
15	2" FL x FL H-STYLE STRAINER, CLA-VAL MODEL X43H, CLASS 150, 250 psi
16	2" GATE VALVE, NPT, 350 psi (SEE DETAIL, DT-6)
17	2" GATE VALVE, NPT, 350 psi, HAND WHEEL ACTUATOR
18	2" G.I. PIPE, STANDARD WALL, NPT
19	2" G.I HUB, FLAT FACED, COMPANION FLANGE, NPT, SS 304, ANSI CLASS 150
20	2" G.I. 90° ELL, NPT, 350 psi
21	1/2" VALMATIC MODEL NO. 22 AIR RELEASE VALVE, 300 psi WP
22	1/2" DOWN SPOUT W/ SCREEN, SCHEDULE 80 PVC
23	ADJUSTABLE PIPE SUPPORT W/ U-SHAPED CRADLE
24	ALUMINUM LADDER W/ SAFETY POST ANCHORED TO VAULT OPENING AND FLOOR (SHIPPED LOOSE)

- ALL MATERIALS RATED TO AT LEAST MAINLINE PIPE PRESSURE RATING, UNLESS OTHERWISE NOTED.
- FLANGES SHALL BE ANSI CLASS 125 (IRON). COIL TRACER WIRE ON INSIDE WALLS OF VAULT.
- SOME PIPE SUPPORTS NOT SHOWN FOR CLARITY. ENSURE ALL BALL VALVE HANDLES ARE UNIMPEDED THROUGH THEIR FULL RANGE OF MOTION.
- ALL NON-STAINLESS METALLIC PIPE AND FITTINGS IN CONTACT WITH SOIL SHALL BE COLD APPLIED TAPE WRAPPED PER AWWA C209.
- 7. SEE SHEET C-32 FOR PLACARD DETAILS

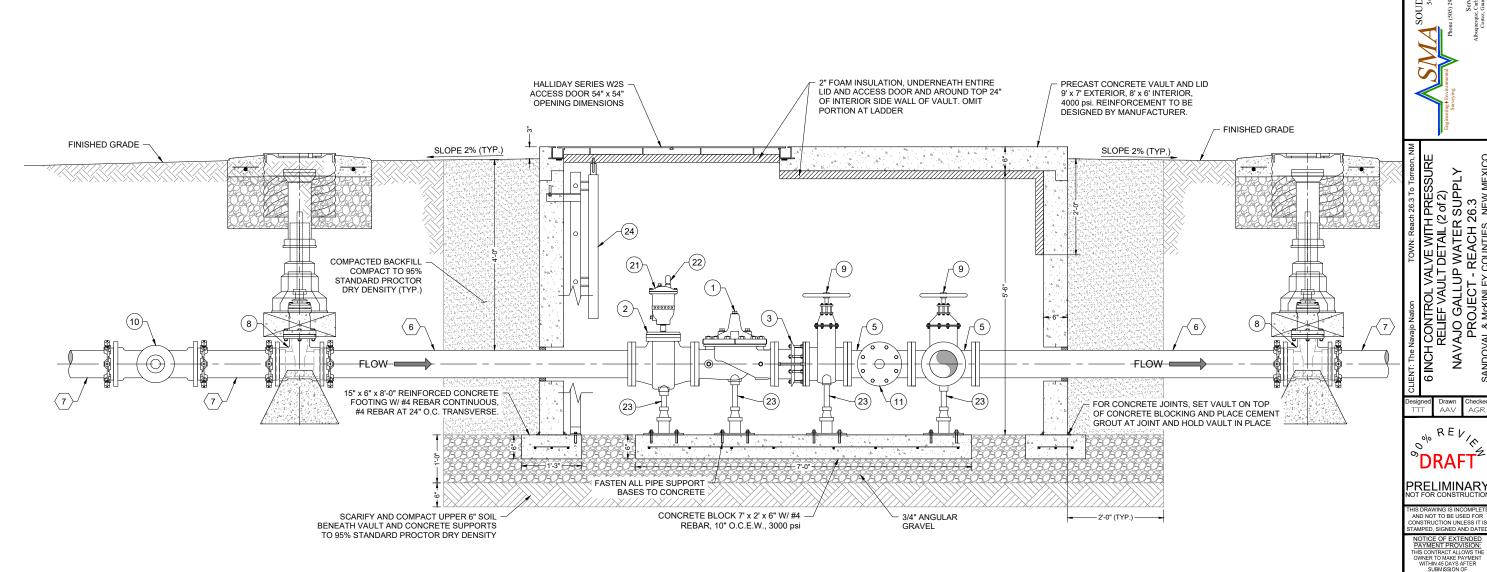



ELEVATION VIEW


6" CONTROL VALVE W/ PRESSURE RELIEF ASSEMBLY VAULT DETAIL

Date: September 27, 201

Project No: 6921307 DT-11

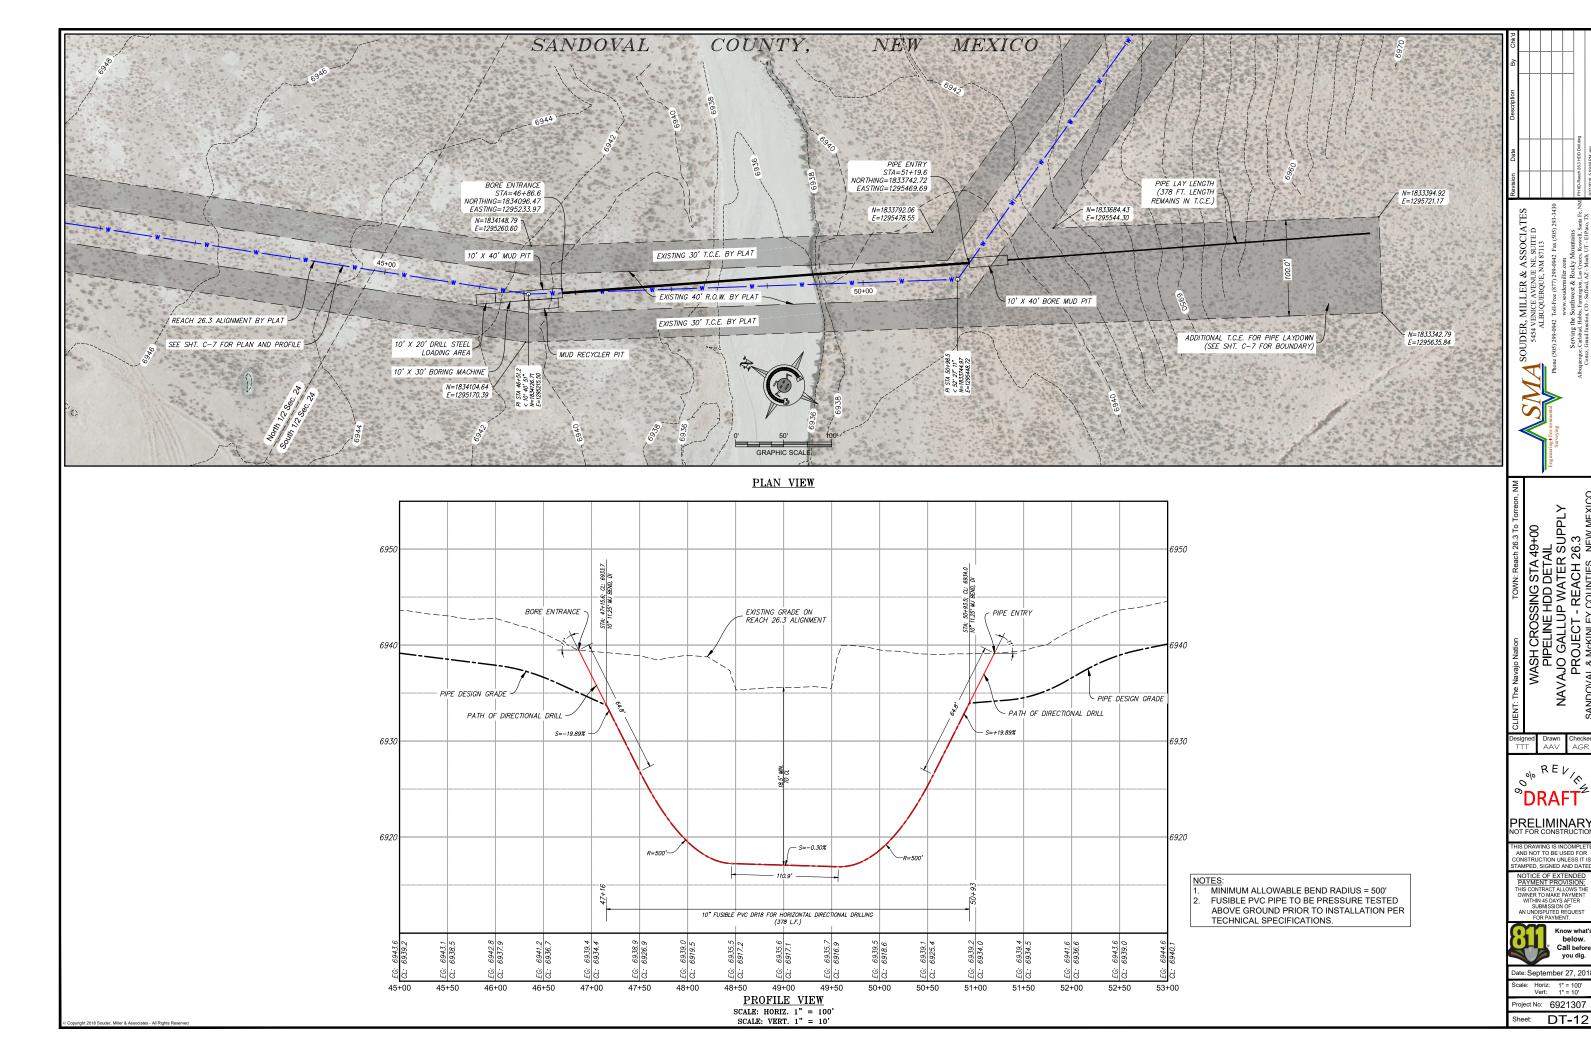

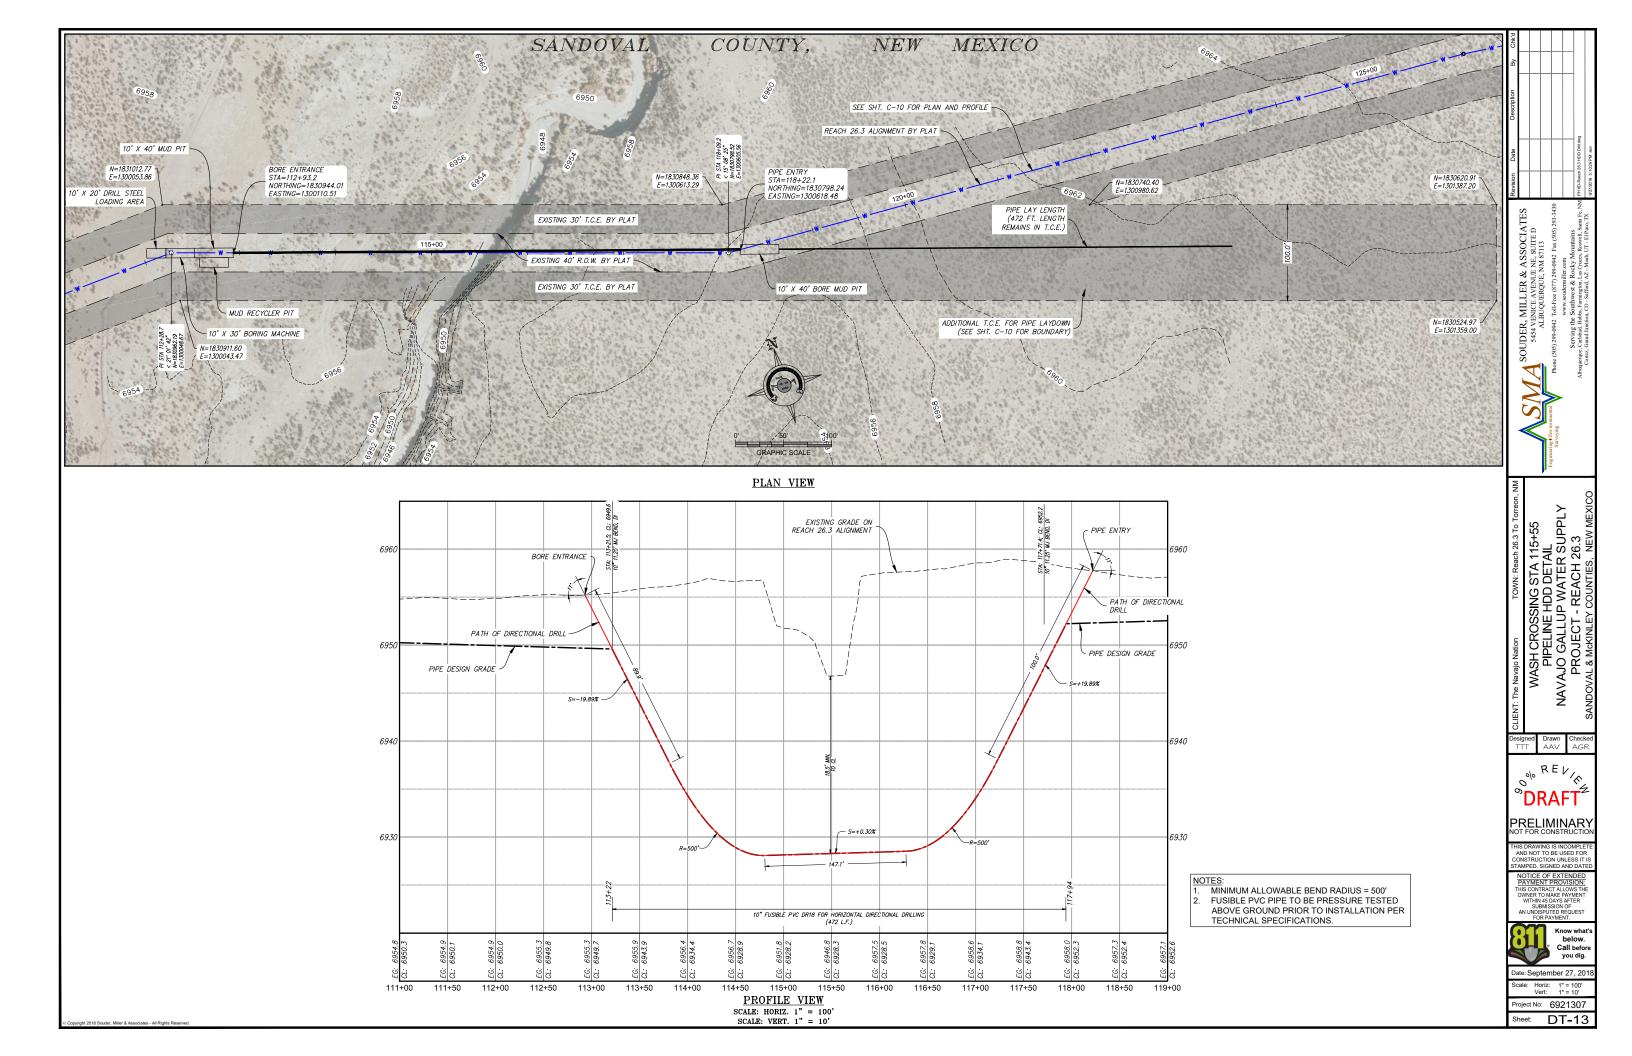


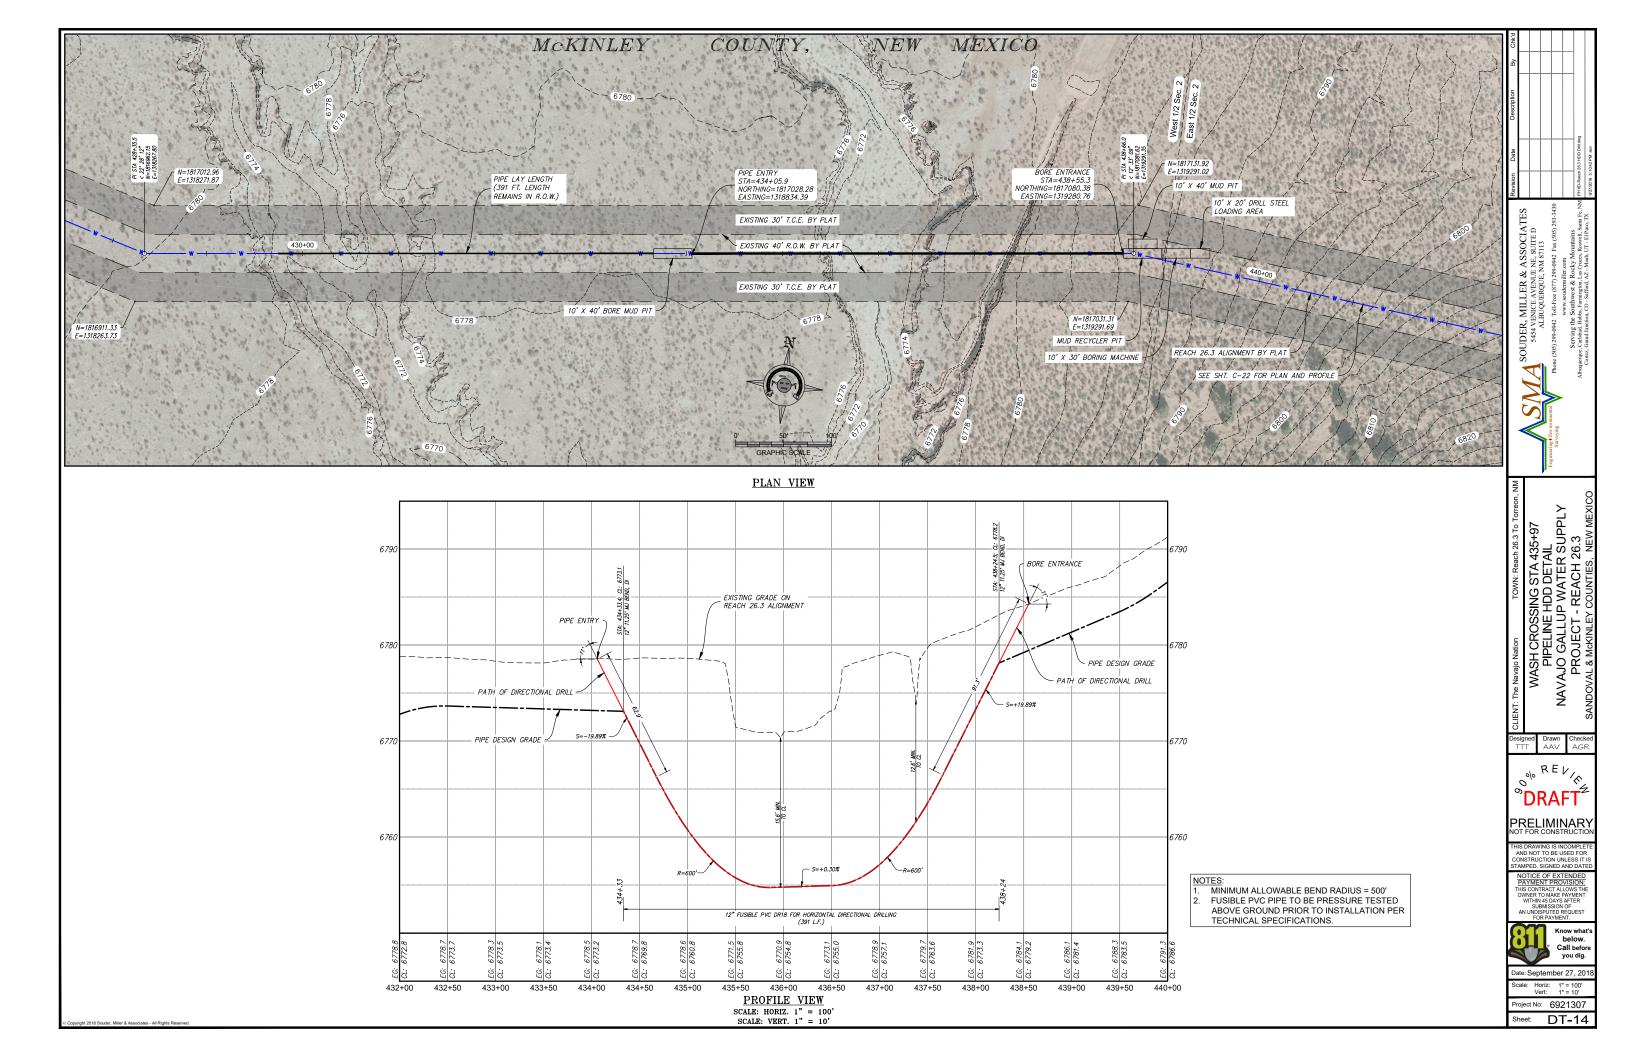



KI	EYED NOTES - PRESSURE TRANSDUCER VAULT
Item No.	Description
1	2" STEEL PIPE, NPT, SCHEDULE 40
2	2" TEE, SS 304, NPT, SCHEDULE 40
3	2" x 1" REDUCING BUSHING, SS 304, NPT, SCHEDULE 40
4	1" SS 304 PIPE, NPT, SCHEDULE 40
5	1" CROSS, SS 304, NPT, SCHEDULE 40
6	1" 90° ELL, SS 304, NPT, SCHEDULE 40
7	1" x 1/2" REDUCING BUSHING, SS 304, NPT, SCHEDULE 40
8	1/2" SS 304 PIPE, NPT, SCHEDULE 40
9	AIR RELEASE VALVE, 1/2" VALMATIC 15ASV, 175 psi W/ 1/2" SS 304 BALL VALVE, 1500 psi & 1/2" SCHEDULE 80 PVC RETURN (SECURED TO UNISTRUT SUPPORT)
10	VERTICAL MOUNT PRESSURE TRANSDUCER 0-30 psi, AMETEK 88C, W/ 1/2" SS 304 BALL VALVE, 2000 psi (SECURED TO UNISTRUT SUPPORT)
11	PRESSURE GAUGE 0-25 psi W/ 1/4" SS 304 BALL VALVE, 2000 psi, 1" x 1/4" SS 304 REDUCING BUSHING & 1/4" SS 304 PIPE, NPT
12	ADJUSTABLE PIPE SUPPORT W/ U-SHAPED CRADLE

NOTE:

1. ALL STAINLESS STEEL PIPE AND FITTINGS SHALL HAVE A WORKING PRESSURE OF AT LEAST 350 psi, UNLESS OTHERWISE NOTED.

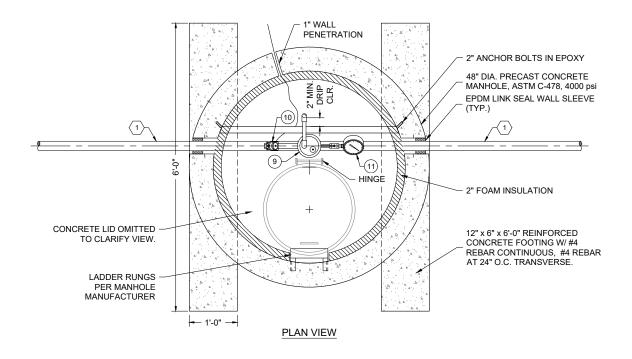

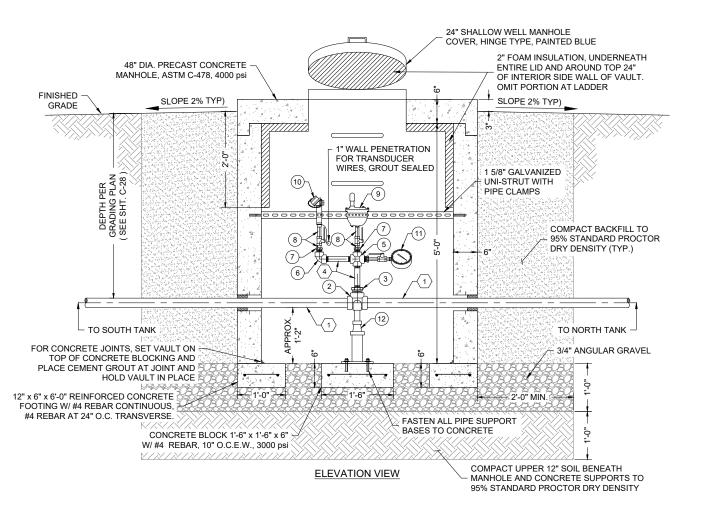





NAVAJO GALLUP WATER SUPPLY PROJECT - REACH 26.3 INDOVAL & MCKINLEY COUNTIES NEW MFXI. TRANSDUCER VAULT DETAIL

O DRAFT

PRELIMINARY NOT FOR CONSTRUCTION



Date: September 27, 201


Project No: 6921307

DT-15

KEYED NOTES - 2" SENSOR LINE CONNECTION


Item No.	Description
1	2" BALL CURB VALVE, FNPT, MINNEAPOLIS PATTERN, MUELLER B-20287, OAE WP 300 psi, OAE (COVER PAINTED BLUE)
2	2" STEEL PIPE, NPT, SCHEDULE 40 (SEE NOTE #2, THIS SHEET)
3	2" 90° ELL, WELDED STEEL (SEE NOTE #2, THIS SHEET)
4	CURB STOP BOX, EXTENSION TYPE MUELLER H-10302, OAE W/ MUELLER STATIONARY ROD WHICH EXTENDS 2"-4" BELOW CURB BOX LID, TOP PAINTED BLUE

- 1. ALL MATERIALS, FITTINGS, AND APPURTENANCES SHALL BE RATED TO AT LEAST 150 psi, UNLESS OTHERWISE NOTED.
- 2. FOR USE WITH WELDED TANKS, STEEL PIPES AND FITTINGS SHALL BE INTERIOR COATED SAME AS TANK INTERIOR AND EXTERIOR COATED WITH COAL TAR EPOXY. FOR USE WITH GLASS FUSED TANKS, STEEL PIPES AND FITTINGS SHALL BE SS 304. ALL NON-STAINLESS METALLIC PIPE AND WELDED FITTINGS SHALL BE COLD-APPLIED TAPE-COATED, PER SPECIFICATIONS.
- 3. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL, UNLESS OTHERWISE NOTED.

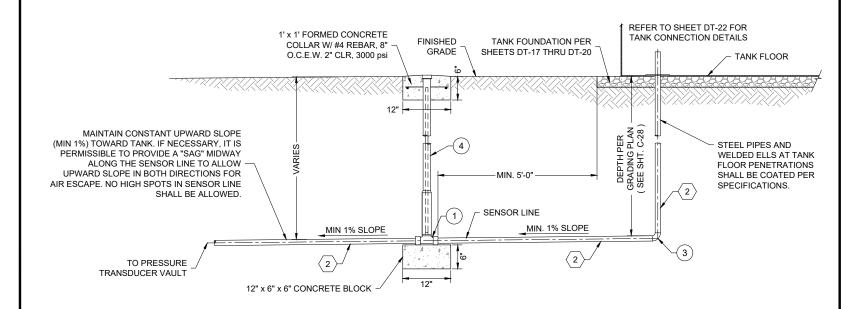


2" TYPICAL SENSOR LINE CONNECTION TO TANK

NOT TO SCALE

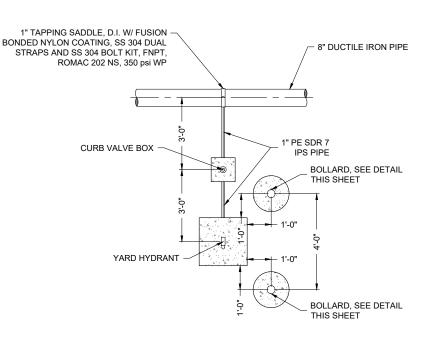

YARD HYDRANT AND ASSEMBLY PLAN VIEW DETAIL

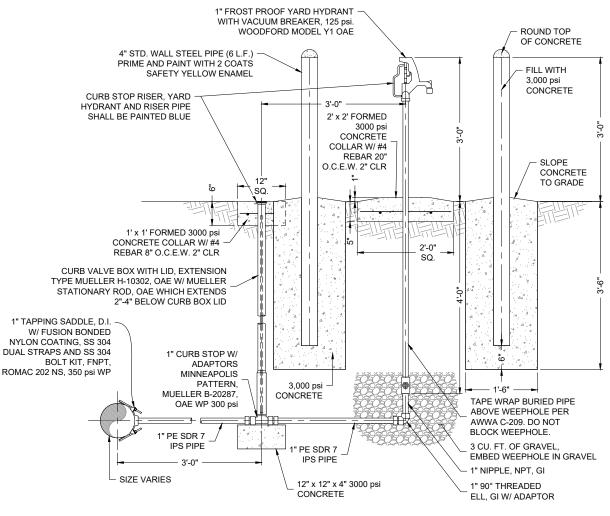

YARD HYDRANT AND ASSEMBLY DETAIL

NOT TO SCALE



you dig.

REV

°DRAFT²

PRELIMINARY


Date: September 27, 201 Scale: Horiz: AS SHOW Vert: N/A

Project No: 6921307 DT-16

SOUDER, MILLER & ASSOCIATES
5454 VENICE AVENUE IN. SUITE D
ALBUQUERQUE, NM 87113


NAVAJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
NDOVAL & MOKINLEY COUNTIES NEW MEXIN

YARD HYDRANT AILS

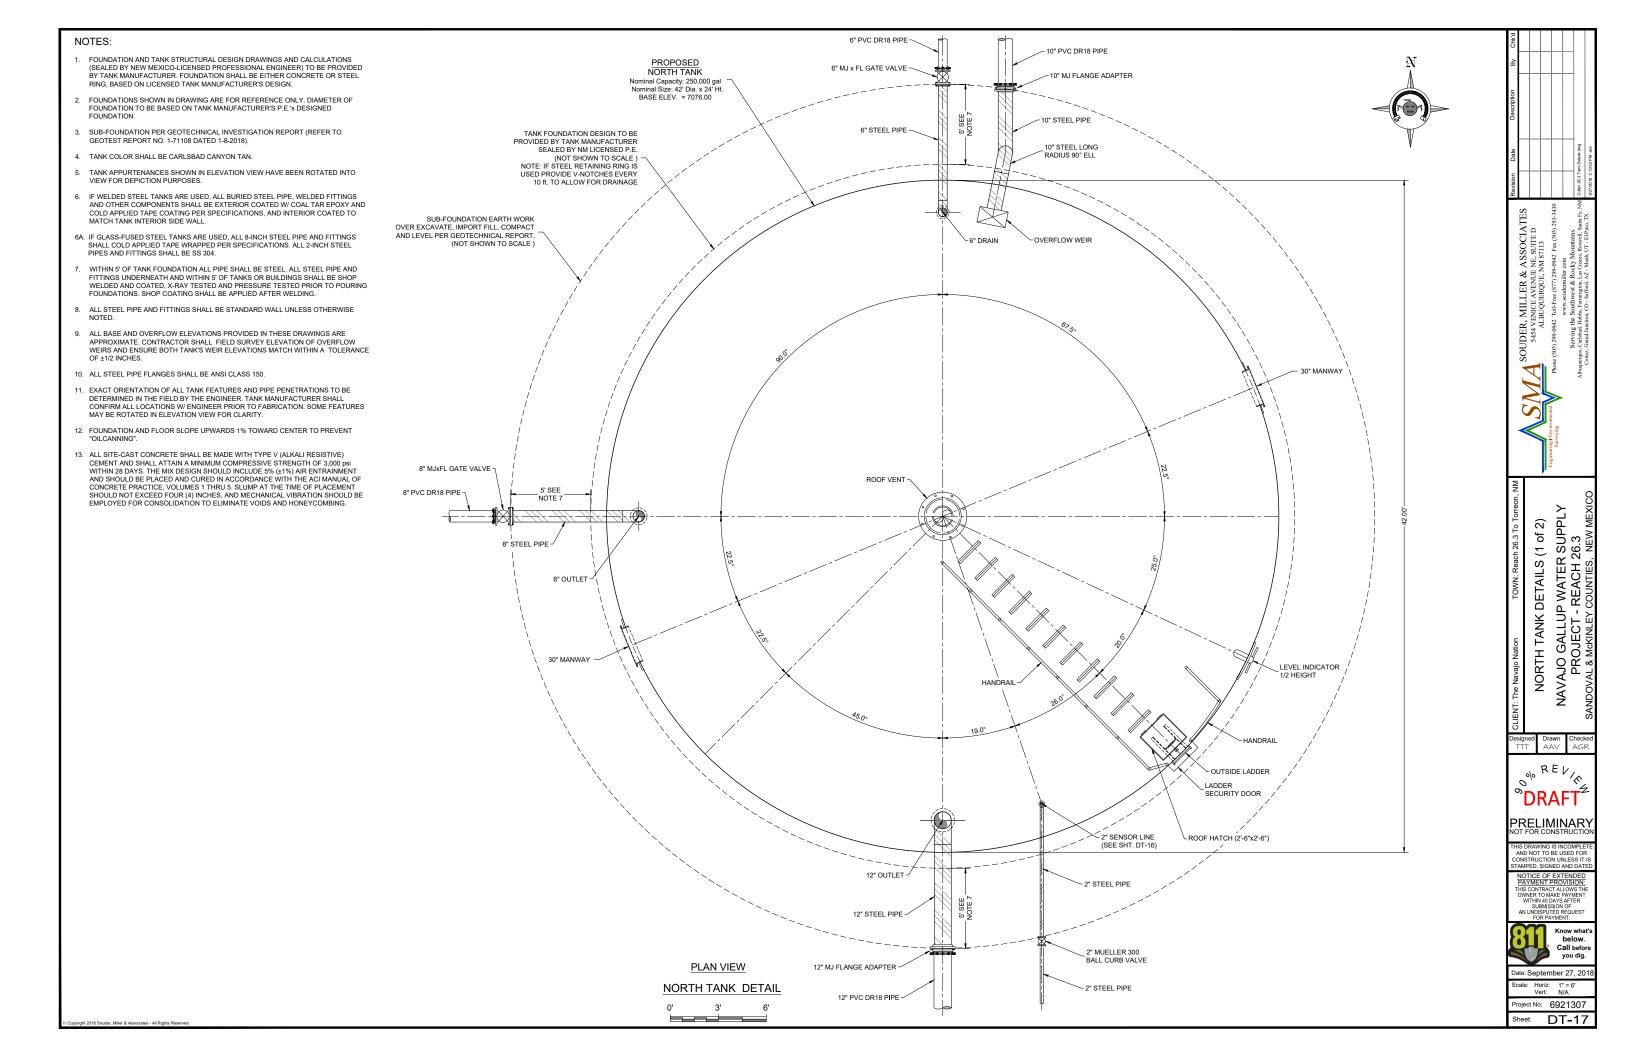

NOTES:

- FOUNDATION AND TANK STRUCTURAL DESIGN DRAWINGS AND CALCULATIONS (SEALED BY NEW MEXICO-LICENSED PROFESSIONAL ENGINEER) TO BE PROVIDED BY TANK MANUFACTURER. FOUNDATION SHALL BE LITHER CONCRETE OR STEEL RING, BASED ON LICENSED TANK MANUFACTURER'S DESIGN.
- FOUNDATIONS SHOWN IN DRAWING ARE FOR REFERENCE ONLY. DIAMETER OF FOUNDATION TO BE BASED ON TANK MANUFACTURER'S P.E.'S DESIGNED FOUNDATION.
- 3. SUB-FOUNDATION PER GEOTECHNICAL INVESTIGATION REPORT (REFER TO GEOTEST REPORT NO. 1-71108 DATED 1-8-2018).
- 4. TANK COLOR SHALL BE CARLSBAD CANYON TAN.
- 5. TANK APPURTENANCES SHOWN IN ELEVATION VIEW HAVE BEEN ROTATED INTO VIEW FOR DEPICTION PURPOSES.
- 6. IF WELDED STEEL TANKS ARE USED, ALL BURIED STEEL PIPE, WELDED FITTINGS AND OTHER COMPONENTS SHALL BE EXTERIOR COATED W. COAL TAR EPOXY AND COLD APPLIED TAPE COATING PER SPECIFICATIONS, AND INTERIOR COATED TO MATCH TANK INTERIOR SIDE WALL.
- 6A. IF GLASS-FUSED STEEL TANKS ARE USED, ALL 8-INCH STEEL PIPE AND FITTINGS SHALL COLD APPLIED TAPE WRAPPED PER SPECIFICATIONS. ALL 2-INCH STEEL PIPES AND FITTINGS SHALL BE SS 304.
- WITHIN 5' OF TANK FOUNDATION ALL PIPE SHALL BE STEEL. ALL STEEL PIPE AND
 FITTINGS UNDERNEATH AND WITHIN 5' OF TANKS OR BUILDINGS SHALL BE SHOP
 WELDED AND COATED, X-RAY TESTED AND PRESSURE TESTED PRIOR TO POURING
 FOUNDATIONS. SHOP COATING SHALL BE APPLIED AFTER WELDING.
- 8. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL UNLESS OTHERWISE
- ALL BASE AND OVERFLOW ELEVATIONS PROVIDED IN THESE DRAWINGS ARE APPROXIMATE. CONTRACTOR SHALL FIELD SURVEY ELEVATION OF OVERFLOW WEIRS AND ENSURE BOTH TANK'S WEIR ELEVATIONS MATCH WITHIN A TOLERANCE OF ±12 INCHES.
- 10. ALL STEEL PIPE FLANGES SHALL BE ANSI CLASS 150.
- 11. EXACT ORIENTATION OF ALL TANK FEATURES AND PIPE PENETRATIONS TO BE DETERMINED IN THE FIELD BY THE ENGINEER. TANK MANUFACTURER SHALL CONFIRM ALL LOCATIONS W/ ENGINEER PRIOR TO FABRICATION. SOME FEATURES MAY BE ROTATED IN ELEVATION VIEW FOR CLARITY.
- 12. FOUNDATION AND FLOOR SLOPE UPWARDS 1% TOWARD CENTER TO PREVENT
- 13. ALL SITE-CAST CONCRETE SHALL BE MADE WITH TYPE V (ALKALI RESISTIVE)
 CEMENT AND SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3,000 psi
 WITHIN 28 DAYS. THE MIX DESIGN SHOULD INCLUDE 5% (±1%) AIR ENTRAINMENT
 AND SHOULD BE PLACED AND CURED IN ACCORDANCE WITH THE ACI MANUAL OF
 CONCRETE PRACTICE, VOLUMES 1 THRU 5. SLUMP AT THE TIME OF PLACEMENT
 SHOULD NOT EXCEED FOUR (4) INCHES, AND MECHANICAL VIBRATION SHOULD BE
 EMPLOYED FOR CONSOLIDATION TO ELIMINATE VOIDS AND HONEYCOMBING.

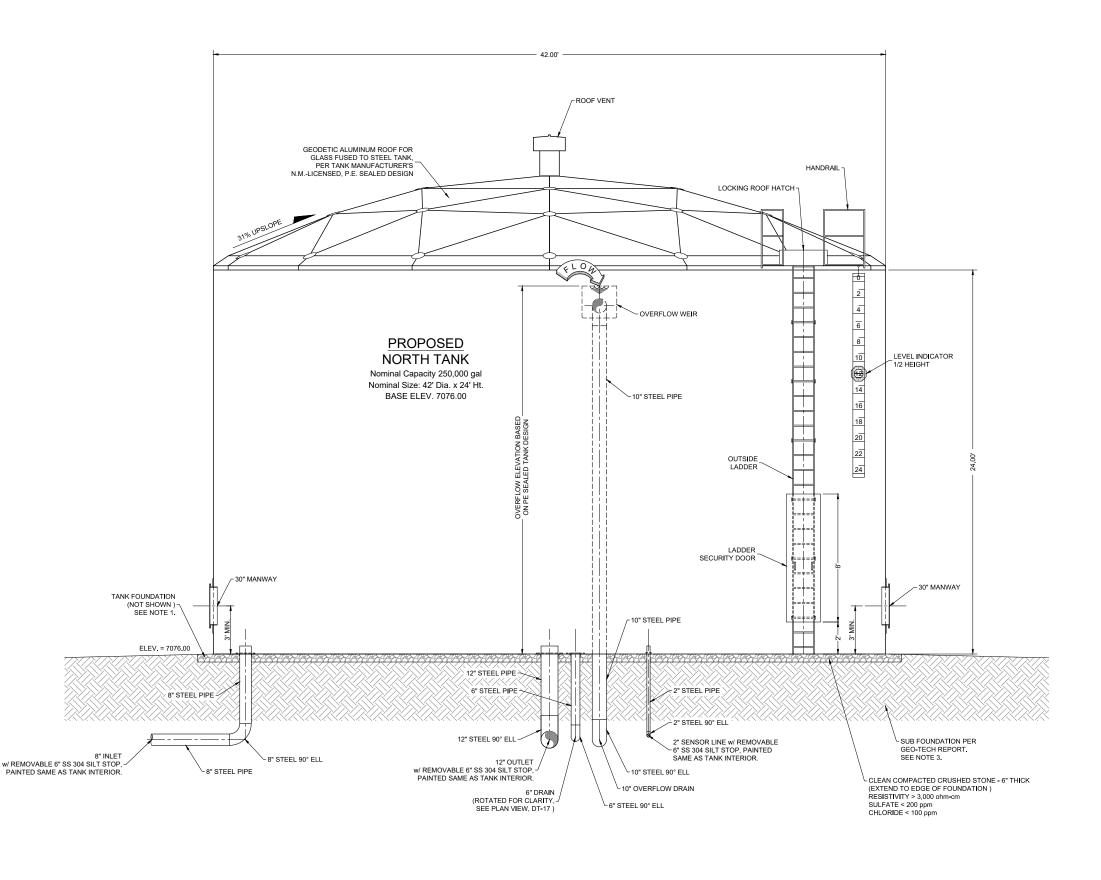

ELEVATION VIEW

NORTH TANK DETAIL

0' 3' 6'

you dig.

DETAILS (2 of 2)
P WATER SUPPLY
- REACH 26.3

NAVAJO GALLUP V PROJECT - RI ANDOVAL & MCKINI EY CO

REV

PRELIMINAR\


NORTH TANK DETAILS

Sheet: DT-18

Copyright 2018 Souder, Miller & Associates - All Rights Reserved


NOTES: FOUNDATION AND TANK STRUCTURAL DESIGN DRAWINGS AND CALCULATIONS (SEALED BY NEW MEXICO-LICENSED PROFESSIONAL ENGINEER) TO BE PROVIDED BY TANK MANUFACTURER. FOUNDATION SHALL BE EITHER CONCRETE OR STEEL RING, BASED ON LICENSED TANK MANUFACTURER'S DESIGN. 2. FOUNDATIONS SHOWN IN DRAWING ARE FOR REFERENCE ONLY. DIAMETER OF FOUNDATION TO BE BASED ON TANK MANUFACTURER'S P.E.'S DESIGNED FOUNDATION. 3. SUB-FOUNDATION PER GEOTECHNICAL INVESTIGATION REPORT (REFER TO GEOTEST REPORT NO. 1-71108 DATED 1-8-2018). 4. TANK COLOR SHALL BE CARLSBAD CANYON TAN. 5. TANK APPURTENANCES SHOWN IN ELEVATION VIEW HAVE BEEN ROTATED INTO VIEW FOR DEPICTION PURPOSES. MATCH TANK INTERIOR SIDE WALL. 6A. IF GLASS-FUSED STEEL TANKS ARE USED, ALL 8-INCH STEEL PIPE AND FITTINGS

- 6. IF WELDED STEEL TANKS ARE USED, ALL BURIED STEEL PIPE, WELDED FITTINGS AND OTHER COMPONENTS SHALL BE EXTERIOR COATED W/ COAL TAR EPOXY AND COLD APPLIED TAPE COATING PER SPECIFICATIONS. AND INTERIOR COATED TO
- SHALL COLD APPLIED TAPE WRAPPED PER SPECIFICATIONS. ALL 2-INCH STEEL PIPES AND FITTINGS SHALL BE SS 304.
- WITHIN 5' OF TANK FOUNDATION ALL PIPE SHALL BE STEEL. ALL STEEL PIPE AND FITTINGS UNDERNEATH AND WITHIN 5' OF TANKS OR BUILDINGS SHALL BE SHOP WELDED AND COATED, X-RAY TESTED AND PRESSURE TESTED PRIOR TO POURING FOUNDATIONS, SHOP COATING SHALL BE APPLIED AFTER WELDING.
- 8. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL UNLESS OTHERWISE
- ALL BASE AND OVERFLOW ELEVATIONS PROVIDED IN THESE DRAWINGS ARE APPROXIMATE. CONTRACTOR SHALL FIELD SURVEY ELEVATION OF OVERFLOW WEIRS AND ENSURE BOTH TANK'S WEIR ELEVATIONS MATCH WITHIN A TOLERANCE
- 10. ALL STEEL PIPE FLANGES SHALL BE ANSI CLASS 150.
- 11. EXACT ORIENTATION OF ALL TANK FEATURES AND PIPE PENETRATIONS TO BE DETERMINED IN THE FIELD BY THE ENGINEER. TANK MANUFACTURER SHALL CONFIRM ALL LOCATIONS W/ ENGINEER PRIOR TO FABRICATION. SOME FEATURES MAY BE ROTATED IN ELEVATION VIEW FOR CLARITY.
- 12. FOUNDATION AND FLOOR SLOPE UPWARDS 1% TOWARD CENTER TO PREVENT
- 13. ALL SITE-CAST CONCRETE SHALL BE MADE WITH TYPE V (ALKALI RESISTIVE) CEMENT AND SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3,000 ps WITHIN 28 DAYS. THE MIX DESIGN SHOULD INCLUDE 5% (±1%) AIR ENTRAINMENT AND SHOULD BE PLACED AND CURED IN ACCORDANCE WITH THE ACI MANUAL OF CONCRETE PRACTICE, VOLUMES 1 THRU 5. SLUMP AT THE TIME OF PLACEMENT SHOULD NOT EXCEED FOUR (4) INCHES, AND MECHANICAL VIBRATION SHOULD BE EMPLOYED FOR CONSOLIDATION TO ELIMINATE VOIDS AND HONEYCOMBING.

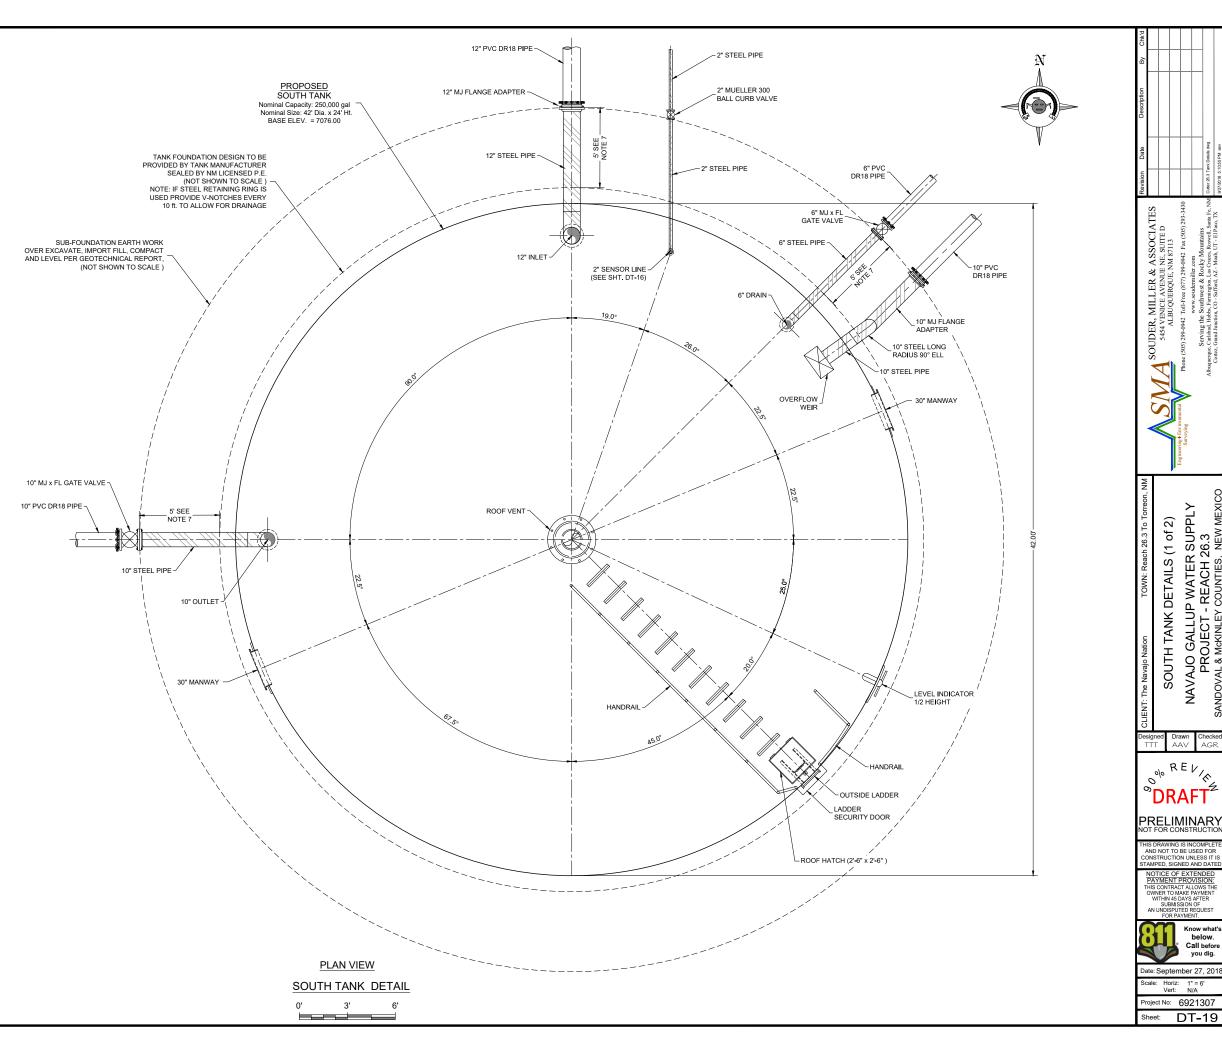

NOTES:

- FOUNDATION AND TANK STRUCTURAL DESIGN DRAWINGS AND CALCULATIONS (SEALED BY NEW MEXICO-LICENSED PROFESSIONAL ENGINEER) TO BE PROVIDED BY TANK MANUFACTURER. FOUNDATION SHALL BE EITHER CONCRETE OR STEEL RING, BASED ON LICENSED TANK MANUFACTURER'S DESIGN.
- FOUNDATIONS SHOWN IN DRAWING ARE FOR REFERENCE ONLY. DIAMETER OF FOUNDATION TO BE BASED ON TANK MANUFACTURER'S P.E.'S DESIGNED FOUNDATION.
- 3. SUB-FOUNDATION PER GEOTECHNICAL INVESTIGATION REPORT (REFER TO GEOTEST REPORT NO. 1-71108 DATED 1-8-2018).
- 4. TANK COLOR SHALL BE CARLSBAD CANYON TAN.
- 5. TANK APPURTENANCES SHOWN IN ELEVATION VIEW HAVE BEEN ROTATED INTO VIEW FOR DEPICTION PURPOSES.
- IF WELDED STEEL TANKS ARE USED, ALL BURIED STEEL PIPE, WELDED FITTINGS AND OTHER COMPONENTS SHALL BE EXTERIOR COATED W. COAL TAR EPOXY AND COLD APPLIED TAPE COATING PER SPECIFICATIONS, AND INTERIOR COATED TO MATCH TANK INTERIOR SIDE WALL.
- 6A. IF GLASS-FUSED STEEL TANKS ARE USED, ALL 8-INCH STEEL PIPE AND FITTINGS SHALL COLD APPLIED TAPE WRAPPED PER SPECIFICATIONS. ALL 2-INCH STEEL PIPES AND FITTINGS SHALL BE SS 304.
- WITHIN 5' OF TANK FOUNDATION ALL PIPE SHALL BE STEEL. ALL STEEL PIPE AND
 FITTINGS UNDERNEATH AND WITHIN 5' OF TANKS OR BUILDINGS SHALL BE SHOP
 WELDED AND COATED, X-RAY TESTED AND PRESSURE TESTED PRIOR TO POURING
 FOUNDATIONS. SHOP COATING SHALL BE APPLIED AFTER WELDING.
- 8. ALL STEEL PIPE AND FITTINGS SHALL BE STANDARD WALL UNLESS OTHERWISE NOTED.
- ALL BASE AND OVERFLOW ELEVATIONS PROVIDED IN THESE DRAWINGS ARE APPROXIMATE. CONTRACTOR SHALL FIELD SURVEY ELEVATION OF OVERFLOW WEIRS AND ENSURE BOTH TANK'S WEIR ELEVATIONS MATCH WITHIN A TOLERANCE OF 1/2 INCHES
- 10. ALL STEEL PIPE FLANGES SHALL BE ANSI CLASS 150.
- 11. EXACT ORIENTATION OF ALL TANK FEATURES AND PIPE PENETRATIONS TO BE DETERMINED IN THE FIELD BY THE ENGINEER. TANK MANUFACTURER SHALL CONFIRM ALL LOCATIONS W/ ENGINEER PRIOR TO FABRICATION. SOME FEATURES MAY BE ROTATED IN ELEVATION VIEW FOR CLARITY.
- 12. FOUNDATION AND FLOOR SLOPE UPWARDS 1% TOWARD CENTER TO PREVENT
- 13. ALL SITE-CAST CONCRETE SHALL BE MADE WITH TYPE V (ALKALI RESISTIVE) CEMENT AND SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3,000 psi WITHIN 28 DAYS. THE MIX DESIGN SHOULD INCLUDE 5% (±1%) AIR ENTRAINMENT AND SHOULD BE PLACED AND CURED IN ACCORDANCE WITH THE ACI MANUAL OF CONCRETE PRACTICE, VOLUMES 1 THRU 5. SLUMP AT THE TIME OF PLACEMENT SHOULD NOT EXCEED FOUR (4) INCHES, AND MECHANICAL VIBRATION SHOULD BE EMPLOYED FOR CONSOLIDATION TO ELIMINATE VOIDS AND HONEYCOMBING.

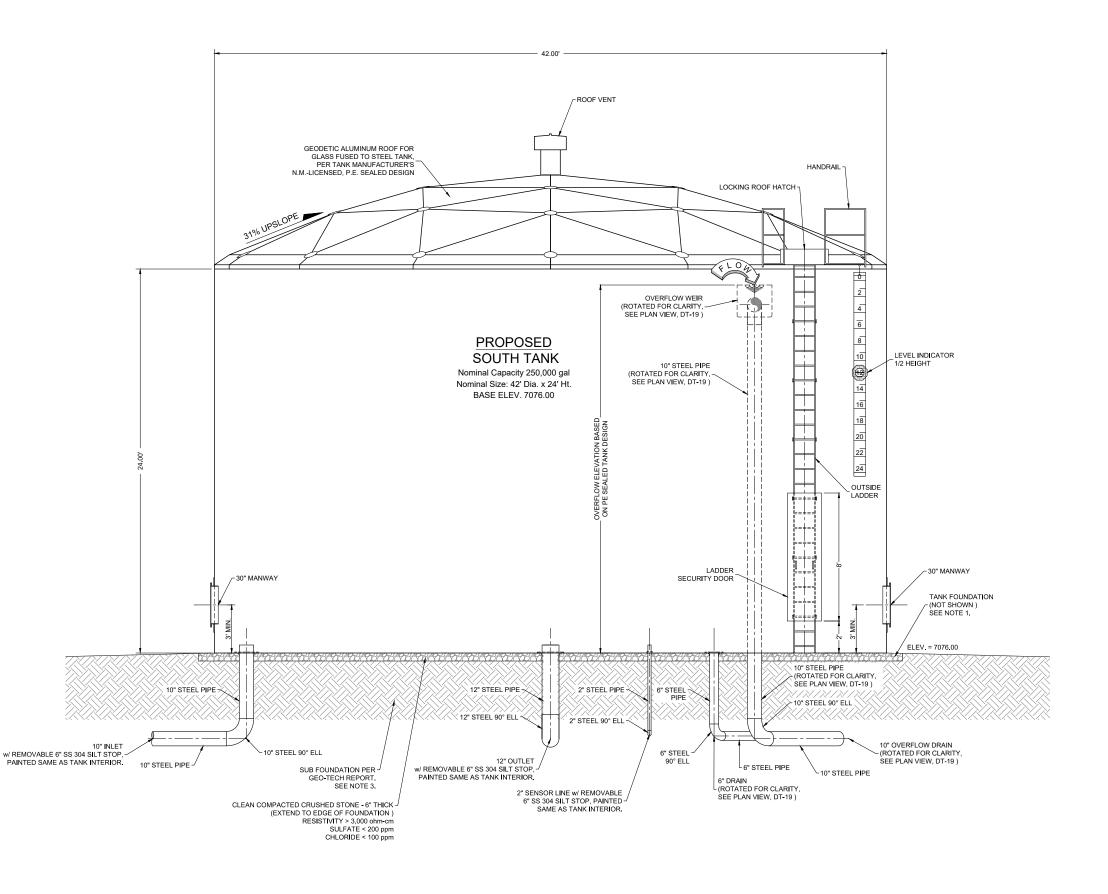

ELEVATION VIEW

SOUTH TANK DETAIL

0' 3' 6'

beld Call by

SOUDER, MILLER & ASSOCIATES 5454 VENICE AVENUE IN SUITED ALBUQUERQUE, IMM 87113

(DETAILS (2 of 2)

JP WATER SUPPLY

- REACH 26.3

NAVAJO GALLUP V PROJECT - RI ANDOVAL & MCKINI EY CO

REV


PRELIMINAR\

SOUTH TANK


Date: September 27, 2018 Scale: Horiz: 1" = 6'


Project No: 6921307
Sheet: DT-20

onvright 2018 Souder Miller & Associates - All Rights Reserved

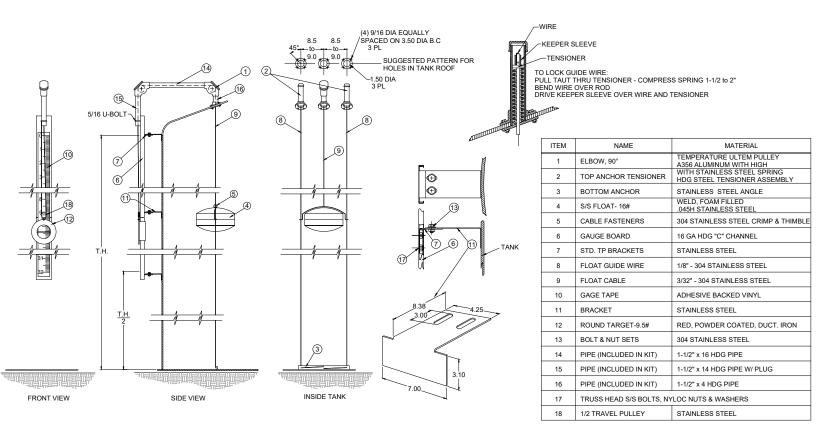

TYPICAL HALF HEIGHT LIQUID INDICATOR DETAILS NOT TO SCALE

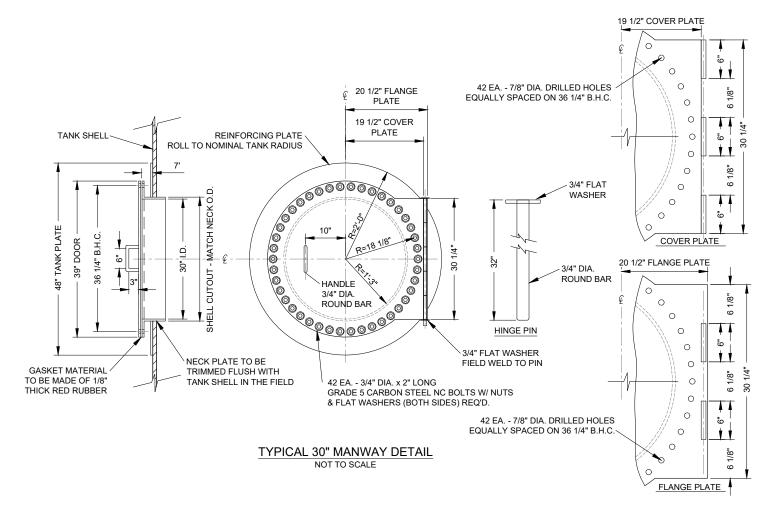


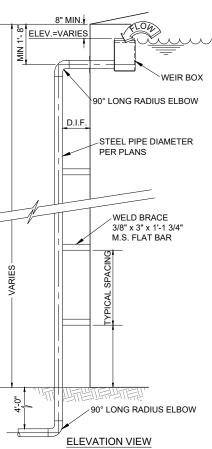

TYPICAL TANK OVERFLOW DETAIL NOT TO SCALE


DT-17 THRU DT-20, FOR PIPE SIZE, HEIGHT AND ELEVATION

- DIMENSIONS INDICATING SEPARATION
 BETWEEN WEIR FROM ROOF ARE MINIMUMS ONLY, ACTUAL DIMENSIONS MAY BE GREATER TO ACCOMMODATE SLOSH WAVE, AS CALCULATED BY TANK MANUFACTURER
- DRAWINGS SEALED BY A NEW MEXICO LICENSED PROFESSIONAL ENGINEER.

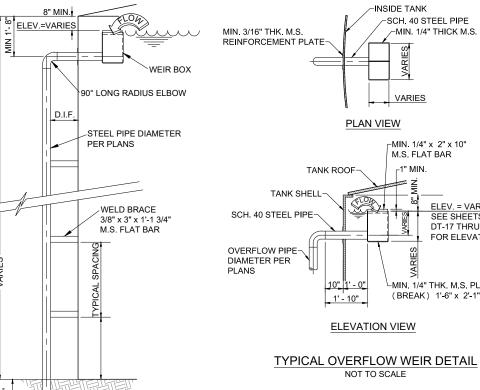

SEE TANK PLAN AND ELEVATION SHEETS

- SHOP PAINT ALL RAFTER'S, SEE PAINT SCHEDULE FOR INTERIOR PRIME AND FINISH COATINGS.
- TANK MANUFACTURER SHALL PROVIDE DESIGN CALCULATIONS AND FABRICATION

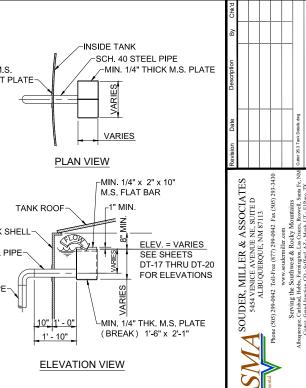

DIMENSIONS OF WEIR AND APPURTENANCES PROVIDED

PROVIDE FOR DESIGN FLOW RATES SPECIFIED IN THE

SHALL BE PROVIDED AS PART OF THE TANK MANUFACTURER'S PROFESSIONAL ENGINEER SEALED

DESIGN.

ARE MINIMUMS. ACTUAL DIMENSIONS MAY BE LARGER TO

TECHNICAL SPECIFICATIONS. ACTUAL WEIR DIMENSIONS

TYPICAL WATER STORAGE TANK DETAILS (1 of 2) NAVAJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
NDOVAL & MAKINI FY COLINTIES NEW MEXIC


REVA


PRELIMINARY



Date: September 27, 201

Project No: 6921307 DT-21

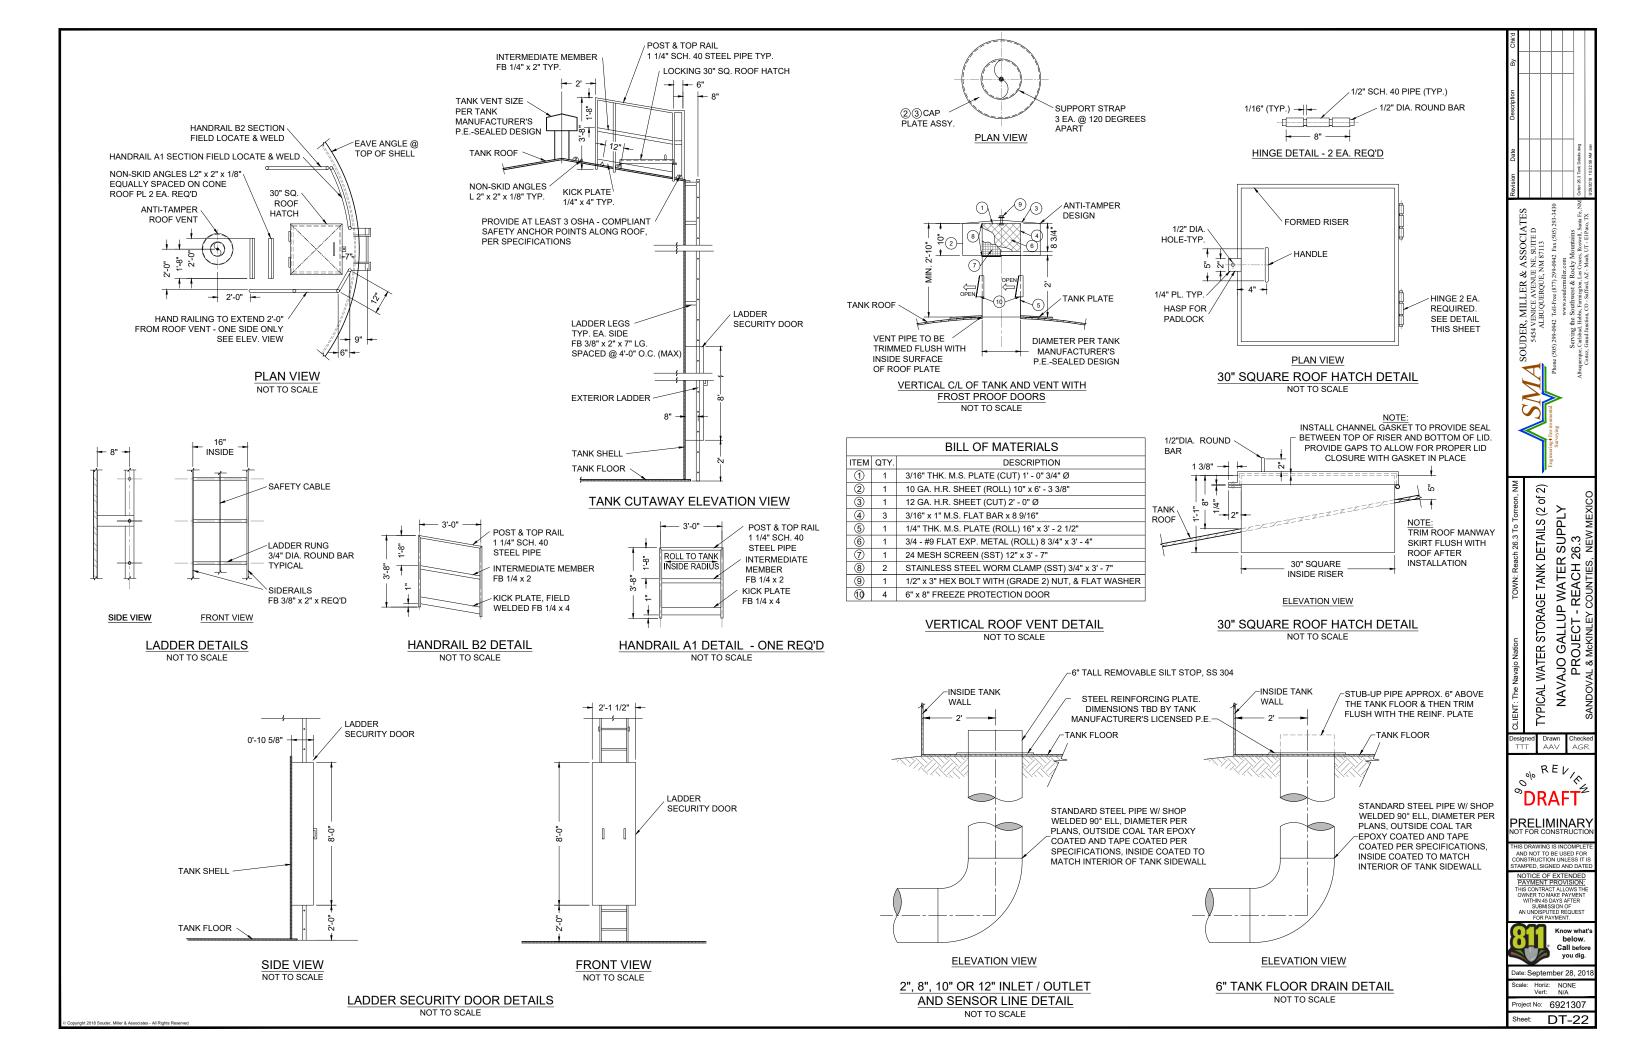

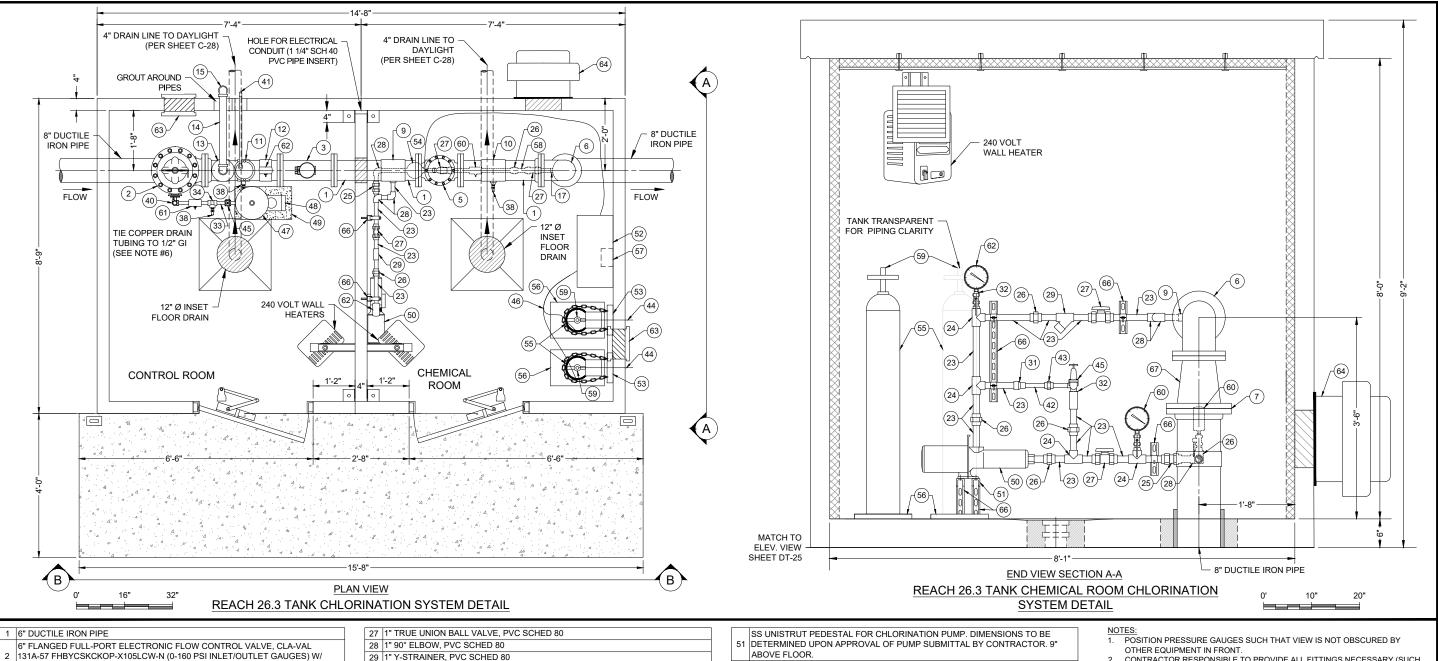

131A-57 FHBYCSKCKOP-X105LCW-N (0-160 PSI INLET/OUTLET GAUGES) W/ CLA-VAL VC-22D CONTROLLER 6" FLANGED ELECTRONIC ELOW METER EL STER EVOQ4 MAINTAIN STRAIGHT PIPE >30" IN FRONT AND >12" BEHIND CENTER OF METER 6" BALL VALVE, FL x FL WITH GEARED ACTUATOR. DI WITH FLANGE ISOLATION 5 4" CHECK VALVE, SURGE BUSTER SERIES 7200 (O.A.E.) 6 6" 90° FL x FL ELBOW, DI 7 8" FLANGE ISOLATION KIT 8 6" x 2" TAPPING SADDLE, D 9 6" x 1" TAPPING SADDLE, SS 304 10 6" x 3/4" TAPPING SADDLE, SS 304 11 6" x 3/4" TAPPING SADDLE, DI 12 6" x 1/4" TAPPING SADDLE, DI 2" VACUUM BREAKER WITH 1" ARV ASSEMBLY, SEE DETAIL "A" (SHT. DT-24). VENT VACUUM BREAKER AND ARV OUTSIDE BUILDING 14 2" GALVANIZED STEEL PIPE, NPT 15 2" 90° ELBOW, GALVANIZED STEEL 16 1" GALVANIZED STEEL PIPE, NPT 17 8" x 1" TAPPING SADDLE, SS 316 18 1" 90° ELBOW, GALVANIZED STEEL 19 1" 45° ELBOW, GALVANIZED STEEL 20 1" CHECK VALVE, GALVANIZED STEE 21 1" UNION, GALVANIZED STEEL 22 1" BALL VALVE, STAINLESS STEEL 23 1" PVC SCHED 80 PIPE 24 1" TEE, PVC SCHED 80 25 1" TRUE UNION CHECK VALVE, PVC SCHED 80

26 1" UNION, PVC SCHED 80

- 30 NOT USED
- 31 1" x 1/2" REDUCER, PVC SCHED 80
- 32 1" x 1/2" PVC BUSHING
- 33 3/4" GALVANIZED STEEL PIPE, NPT
- 34 3/4" TEE, GALVANIZED STEEL
- 35 3/4" 90° ELBOW, GALVANIZED STEEL
- 36 3/4" UNION, GALVANIZED STEEL
- 37 3/4" BALL VALVE, STAINLESS STEEL38 3/4" HOSE BIB WITH VACUUM BREAKER
- 39 3/4" x 1/2" GALVANIZED STEEL BUSHING
- 39 3/4" x 1/2" GALVANIZED STEEL BUSHING
 40 3/4" GALVANIZED x 3/8" COPPER BUSHING, WITH 3/8" COPPER TUBING TO
- 40 CONTROL VALVE PILOT TUBING
 41 1/2" 90° ELL & 1/2" GALVANIZED STEEL PIPE (PAINTED BLUE) WITH
- 41 DOWNSPOUT
- 42 1/2" PVC SCHED 80 PIPE
- 43 1/2" UNION, PVC SCHED 80
- 44 1/2" PE VENT TUBING (WALL PENETRATION MUST BE BELOW REGULATORS)
- 45 1/2" PRESSURE RELIEF VALVE, WATTS BP 30 (O.A.E.) PRESSURE SET TO 90 PSI
- 46 3/8" PE VACUUM TUBING
- 7.6 GALLON PRESSURE TANK, WELL-X-TROL WX-103 (O.A.E.), INSTALL PIPE CLAMPS/SUPPORT UNDER TANK AND ANCHOR TO WALL
- BOOSTER PUMP WITH INTEGRATED PRESSURE SWITCH (30-50 psi)
 DISCHARGE PRESSURE GAUGE AND DISCHARGE CHECK VALVE, 1" NPT INLET,
 3/4" NPT OUTLET, 1/4" 100 PSI PE TUBING, TP PUMP MODEL #TPA-CM1-4-AUTO,
- CONCRETE PEDESTAL FOR BOOSTER PUMP, 19"L x 11"W x 12"H, (OR PER PUMP DIMENSIONS) 4000 PSI CONCRETE W! #4 REBAR / ANCHOR BOLTS
- 50 BOOSTER PUMP, FRANKLIN BT4 5JBT03S4 (O.A.E.)

- 52 CHLORINE GAS CONTROL PANEL, WALLACE & TIERNAN S10K (O.A.E.)
- 53 WALL MOUNTED CHAIN BRACKET, INSTALL 40" ABOVE FLOOR, WITH SAFETY CHAIN
- CHLORINE INJECTOR, WALLACE & TIERNAN S10K W/ 99D THROAT/TAIL PIECE (O.A.E.) W/ PVC/TEFLON DIAPHRAM VALVE ON VACUUM LINE WITH PEDESTAL. SUPPORT WITH UNISTRUTS.
- 55 CHLORINE GAS CYLINDER, 150 LB (DO NOT INSTALL)
- 56 ELECTRONIC CHLORINE CYLINDER SCALE, FORCE FLOW GR150-2 W/ FORCE FLOW SOLO G2 DIGITAL INDICATOR (O.A.E.), BOLTED TO FLOOR
- CHLORINE GAS DETECTOR SENSOR/TRANSMITTER, WALLACE & TIERNAN
 ACUTEC 35 WI AUTOTEST (O.A.E.), MOUNTED 6" ABOVE FLOOR, LOCATION TBD
 57
 BY ENGINEER IN FIELD. CHLORINE GAS DETECTOR RECEIVER, WALLACE &
 TIERNAN ACUTEC 35 (O.A.E.) LOCATION AS INDICATED IN ELECTRICAL PLANS
- OR TBD BY ENGINEER IN FIELD.

 58 INSERTION DIFFUSER, MTE (O.A.E.)
- 59 VACUUM REGULATOR, WALLACE & TIERNAN 210S (O.A.E.)
- 60 PRESSURE GAUGE, 0-100 PSI, WITH PVC/TEFLON DIAPHRAM SEAL AND 1/2"
 BALL VALVE. STAINLESS STEEL
- 61 PRESSURE GAUGE, 0-100 PSI, WITH ISOLATION 1/4" SS BALL VALVE
- 62 PRESSURE GUAGE, 0-25 PSI WITH ISOLATION 1/4" SS BALL VALVE
- 63 LOUVERED VENT W/ BACKDRAFT DAMPER McMASTER CARR #2039 KI, W/ EPOXY GREY PAINT
- 64 19 1/2" 430 CFM EXHAUST FAN WITH BACKDRAFT DAMPER
- 65 1 5/8" UNISTRUT, GALVANIZED STEEL, WITH PIPE SUPPORTS
- 66 1 5/8" UNISTRUT, STAINLESS STEEL, WITH PIPE SUPPORTS
- 67 8" x 6" REDUCER, FL x FL D.I., WP 250 PSI

- CONTRACTOR RESPONSIBLE TO PROVIDE ALL FITTINGS NECESSARY (SUCH AS BUSHINGS, FLANGES, ADAPTERS, NIPPLES, ETC.), WHETHER EXPLICITLY SHOWN OR NOT, TO COMPLETE THE INSTALLATION AS INDICATED.
- 3. ALL 1" AND SMALLER PIPE TO BE SECURED WITH PIPE CLAMPS AND 1 5/8"
 UNISTRUTS MOUNTED TO THE WALL. ALL UNISTRUTS ATTACHED TO WALL
 SHALL BE IN VERTICAL POSITION. SOME PIPE SUPPORTS NOT SHOWN FOR
- 6" MINIMUM SPACING BETWEEN SCHED 80 PVC GLUED FITTINGS, UNLESS UNION IS PRESENT.
- ALL BOLTS, NUTS AND WASHERS IN CHEMICAL ROOM SHALL BE 316 SS.

 ALL VALVES WHICH MAY DISCHARGE WATER (CONTROL VALVE AND PRESSURE RELEASE VALVE) SHALL HAVE 1/2" GI DISCHARGE PIPE FROM VALVE OUTLET TO FLOOR DRAIN. DISCHARGE PIPING SHALL BE ROUTED ALONG WALL TO AVOID BLOCKING ACCESS TO OTHER COMPONENTS AND SHALL BE ATTACHED TO WALL WITH PIPE CLAMPS AND 1 5/8" UNISTRUTS FOR SUPPORT. PAINT GI PIPE BLUE. DISCHARGE PIPING NOT SHOWN FOR CLARITY.
- ALL MATERIALS SHALL BE RATED TO AT LEAST 125 psi, UNLESS OTHERWISE NOTED
- 3. ALL FLANGES SHALL BE ANSI CLASS 150 (STEEL) OR ANSI CLASS 125 (IRON).
- ALL BURIED PIPE WITHIN 5 FT OF BUILDING SHALL BE DUCTILE IRON, 350 psi
 WP, SOLID PIPE PIECES ONLY. NO DUCTILE IRON PIPE JOINTS ALLOWED.
- 10. BURIED DUCTILE IRON PIPE FOR DRAINS AND PIPE PENETRATIONS SHALL BE AWWA C-209 COLD-APPLIED TAPE-COATED PER SPECIFICATIONS ABOVE THE BURIED ELL. ALL OTHER BURIED DUCTILE IRON PIPE AND FITTINGS SHALL BE ENCASED IN TWO LAYERS OF POLYETHYLENE, PER SPECIFICATIONS. ALL DUCTILE IRON PIPE AND FITTINGS SHALL BE TWO-PART EPOXY-COATED. PER SPECIFICATIONS.
- 11. ALL STEEL COMPONENTS IN THE CHEMICAL ROOM SHALL BE SS 316, UNLESS OTHERWISE NOTED.
- 12. ALL STAINLESS STEEL PIPE AND FITTINGS SHALL HAVE A WORKING PRESSURE OF AT LEAST 350 psi, UNLESS OTHERWISE NOTED.



DETAILOR

NAJO GALLUF

ed Drawn Che

AAV AGR



PRELIMINARY

THIS DRAWING IS INCOMPLETE AND NOT TO BE USED FOR CONSTRUCTION UNLESS IT IS

AMPED, SIGNED AND DATED

NOTICE OF EXTENDED

PAYMENT PROVISION:
THIS CONTRACT ALLOWS THE
OWNER TO MAKE PAYMENT
WITHIN 45 DAYS AFTER

WITHIN 40 JANUARY SUBMISSION OF AN UNDISPUTED REQUEST FOR PAYMENT.

Know what's below.


Call before you dig.


ate: September 24, 2018


Scale: Horiz: AS SHOW Vert: N/A

Project No: 6921307

heet: DT-23

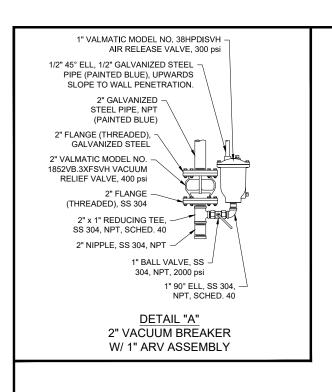

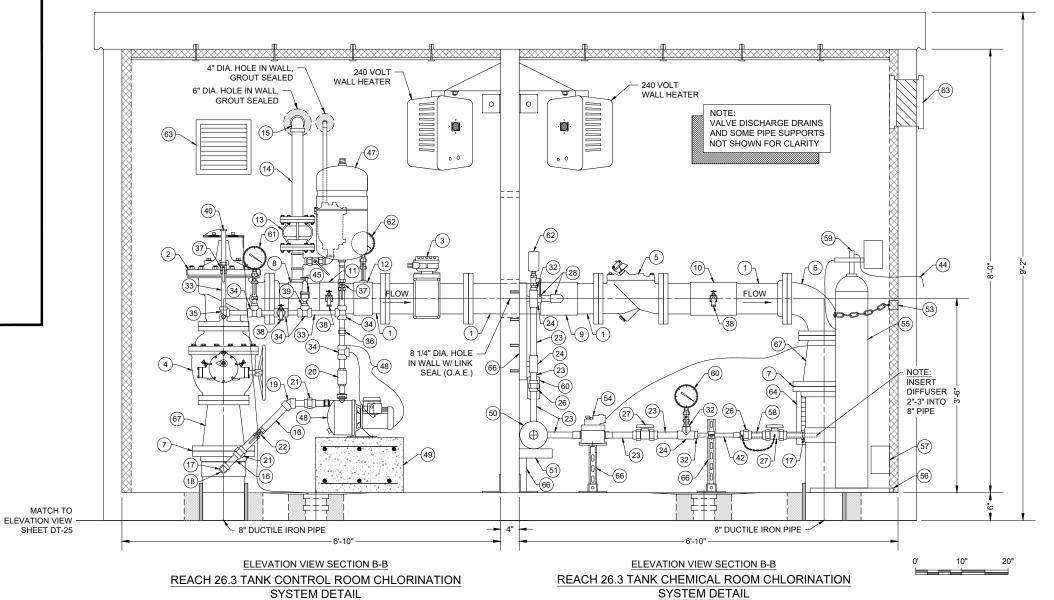

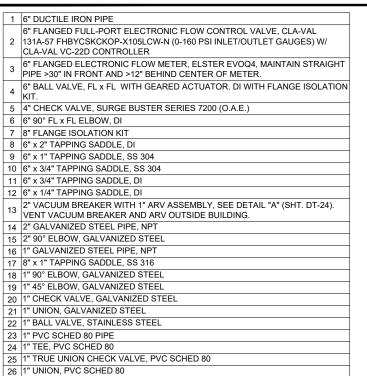

- 27 1" TRUE UNION BALL VALVE, PVC SCHED 80 28 1" 90° ELBOW, PVC SCHED 80 29 1" Y-STRAINER, PVC SCHED 80 30 NOT USED 31 1" x 1/2" REDUCER, PVC SCHED 80 32 1" x 1/2" PVC BUSHING 33 3/4" GALVANIZED STEEL PIPE, NPT 34 3/4" TEE, GALVANIZED STEEL 35 3/4" 90° ELBOW, GALVANIZED STEEL 36 3/4" UNION, GALVANIZED STEEL 37 3/4" BALL VALVE, STAINLESS STEEL
- 39 3/4" x 1/2" GALVANIZED STEEL BUSHING 3/4" GALVANIZED x 3/8" COPPER BUSHING, WITH 3/8" COPPER TUBING TO CONTROL VALVE PILOT TUBING
- 1/2" 90° ELL & 1/2" GALVANIZED STEEL PIPE (PAINTED BLUE) WITH DOWNSPOUT
- 42 1/2" PVC SCHED 80 PIPE
- 43 1/2" UNION, PVC SCHED 80

38 3/4" HOSE BIB WITH VACUUM BREAKER

- 44 1/2" PE VENT TUBING (WALL PENETRATION MUST BE BELOW REGULATORS)
- 45 1/2" PRESSURE RELIEF VALVE, WATTS BP 30 (O.A.E.) PRESSURE SET TO 90 PSI
- 46 3/8" PE VACUUM TUBING
- 7.6 GALLON PRESSURE TANK, WELL-X-TROL WX-103 (O.A.E.), INSTALL PIPE CLAMPS/SUPPORT UNDER TANK AND ANCHOR TO WALL
- BOOSTER PUMP WITH INTEGRATED PRESSURE SWITCH (30-50 psi) DISCHARGE PRESSURE GAUGE AND DISCHARGE CHECK VALVE, 1" NPT INLET, 3/4" NPT OUTLET, 1/4" 100 PSI PE TUBING, TP PUMP MODEL #TPA-CM1-4-AUTO,
- CONCRETE PEDESTAL FOR BOOSTER PUMP. 19"L x 11"W x 12"H. (OR PER PUMP DIMENSIONS) 4000 PSI CONCRETE W/ #4 REBAR / ANCHOR BOLTS
- 50 BOOSTER PUMP, FRANKLIN BT4 5JBT03S4 (O.A.E.)

SS UNISTRUT PEDESTAL FOR CHLORINATION PUMP. DIMENSIONS TO BE 51 DETERMINED UPON APPROVAL OF PUMP SUBMITTAL BY CONTRACTOR. 9" ABOVE FLOOR

- 52 CHLORINE GAS CONTROL PANEL, WALLACE & TIERNAN S10K (O.A.E.)
- WALL MOUNTED CHAIN BRACKET, INSTALL 40" ABOVE FLOOR, WITH SAFETY CHAIN
- CHLORINE INJECTOR, WALLACE & TIERNAN S10K W/ 99D THROAT/TAIL PIECE 54 (O.A.E.) W/ PVC/TEFLON DIAPHRAM VALVE ON VACUUM LINE WITH PEDESTAL. SUPPORT WITH UNISTRUTS.
- 55 CHLORINE GAS CYLINDER, 150 LB (DO NOT INSTALL)
- ELECTRONIC CHLORINE CYLINDER SCALE, FORCE FLOW GR150-2 W/ FORCE
- 56 FLOW SOLO G2 DIGITAL INDICATOR (O.A.E.), BOLTED TO FLOOR CHLORINE GAS DETECTOR SENSOR/TRANSMITTER, WALLACE & TIERNAN
- ACUTEC 35 W/ AUTOTEST (O.A.E.), MOUNTED 6" ABOVE FLOOR, LOCATION TBD 57 BY ENGINEER IN FIELD. CHLORINE GAS DETECTOR RECEIVER, WALLACE & TIERNAN ACUTEC 35 (O.A.E.) LOCATION AS INDICATED IN ELECTRICAL PLANS OR TBD BY ENGINEER IN FIELD.
- 58 INSERTION DIFFUSER, MTE (O.A.E.
- 59 VACUUM REGULATOR, WALLACE & TIERNAN 210S (O.A.E.)
- PRESSURE GAUGE, 0-100 PSI, WITH PVC/TEFLON DIAPHRAM SEAL AND 1/2" BALL VALVE, STAINLESS STEEL
- 61 PRESSURE GAUGE, 0-100 PSI, WITH ISOLATION 1/4" SS BALL VALVE
- 62 PRESSURE GUAGE, 0-25 PSI WITH ISOLATION 1/4" SS BALL VALVE
- LOUVERED VENT W/ BACKDRAFT DAMPER McMASTER CARR #2039 KI, W/ **EPOXY GREY PAINT**
- 64 19 1/2" 430 CFM EXHAUST FAN WITH BACKDRAFT DAMPER
- 65 1 5/8" UNISTRUT, GALVANIZED STEEL, WITH PIPE SUPPORTS 66 1 5/8" UNISTRUT, STAINLESS STEEL, WITH PIPE SUPPORTS
- 67 8" x 6" REDUCER, FL x FL D.I., WP 250 PSI

- 1. POSITION PRESSURE GAUGES SUCH THAT VIEW IS NOT OBSCURED BY OTHER EQUIPMENT IN FRONT.
- CONTRACTOR RESPONSIBLE TO PROVIDE ALL FITTINGS NECESSARY (SUCH AS BUSHINGS, FLANGES, ADAPTERS, NIPPLES, ETC.), WHETHER EXPLICITLY SHOWN OR NOT, TO COMPLETE THE INSTALLATION AS INDICATED.
- ALL 1" AND SMALLER PIPE TO BE SECURED WITH PIPE CLAMPS AND 1.5/8" UNISTRUTS MOUNTED TO THE WALL. ALL UNISTRUTS ATTACHED TO WALL SHALL BE IN VERTICAL POSITION. SOME PIPE SUPPORTS NOT SHOWN FOR
- 6" MINIMUM SPACING BETWEEN SCHED 80 PVC GLUED FITTINGS, UNLESS UNION IS PRESENT.
- ALL BOLTS, NUTS AND WASHERS IN CHEMICAL ROOM SHALL BE 316 SS. ALL VALVES WHICH MAY DISCHARGE WATER (CONTROL VALVE AND PRESSURE RELEASE VALVE) SHALL HAVE 1/2" GI DISCHARGE PIPE FROM VALVE OUTLET TO FLOOR DRAIN. DISCHARGE PIPING SHALL BE ROUTED ALONG WALL TO AVOID BLOCKING ACCESS TO OTHER COMPONENTS AND SHALL BE ATTACHED TO WALL WITH PIPE CLAMPS AND 1.5/8" UNISTRUTS FOR SUPPORT. PAINT GI PIPE BLUE. DISCHARGE PIPING NOT SHOWN FOR CLARITY
- ALL MATERIALS SHALL BE RATED TO AT LEAST 125 psi, UNLESS OTHERWISE
- ALL FLANGES SHALL BE ANSI CLASS 150 (STEEL) OR ANSI CLASS 125 (IRON).
- ALL BURIED PIPE WITHIN 5 FT OF BUILDING SHALL BE DUCTILE IRON, 350 psi WP. SOLID PIPE PIECES ONLY, NO DUCTILE IRON PIPE JOINTS ALLOWED.
- 10. BURIED DUCTILE IRON PIPE FOR DRAINS AND PIPE PENETRATIONS SHALL BE AWWA C-209 COLD-APPLIED TAPE-COATED PER SPECIFICATIONS ABOVE THE BURIED ELL. ALL OTHER BURIED DUCTILE IRON PIPE AND FITTINGS SHALL BE ENCASED IN TWO LAYERS OF POLYETHYLENE, PER SPECIFICATIONS. ALL DUCTILE IRON PIPE AND FITTINGS SHALL BE TWO-PART EPOXY-COATED, PER SPECIFICATIONS.
- 11. ALL STEEL COMPONENTS IN THE CHEMICAL ROOM SHALL BE SS 316, UNLESS OTHERWISE NOTED
- 12. ALL STAINLESS STEEL PIPE AND FITTINGS SHALL HAVE A WORKING PRESSURE OF AT LEAST 350 psi, UNLESS OTHERWISE NOTED.



ALS (2 of 2)
UP WATER SUPPLY
T - REACH 26.3 o o VATION 'AILS (2 O D

NAVAJO GALLI PROJECT

REVA

RELIMINAR'


SUBMISSION OF INDISPUTED REQUEST





ate: September 24, 201


Scale: Horiz: AS SHOV Vert: N/A


roject No: 6921307 DT-24

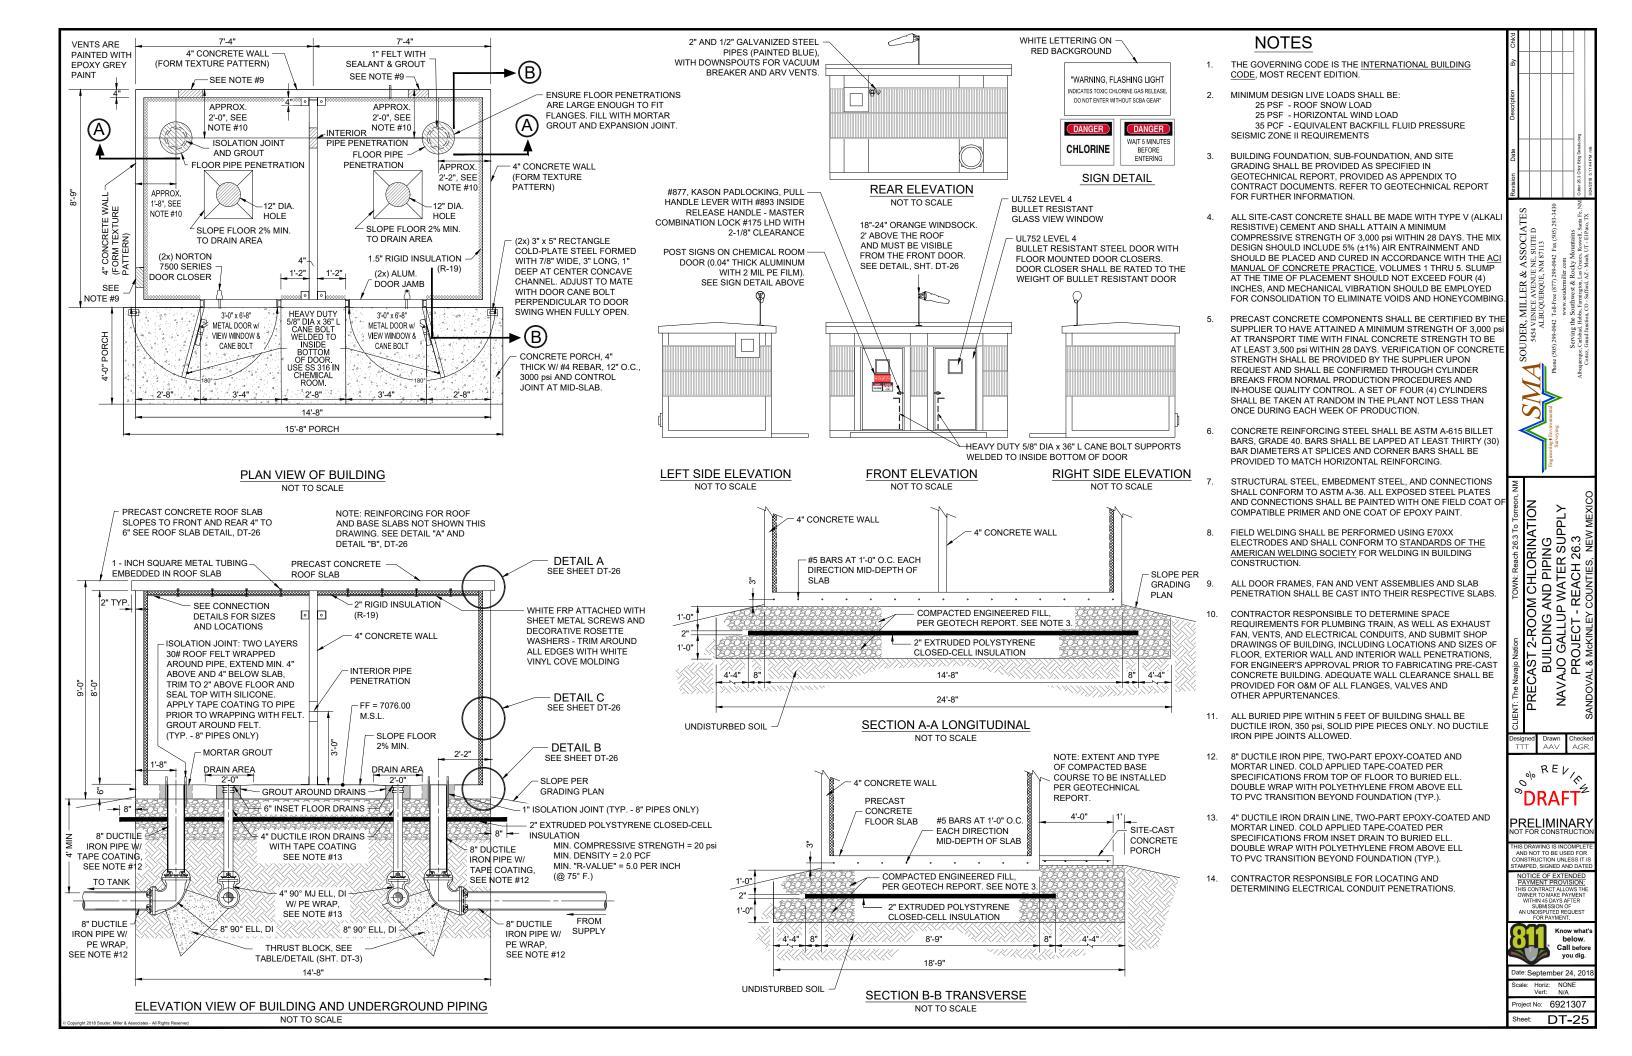

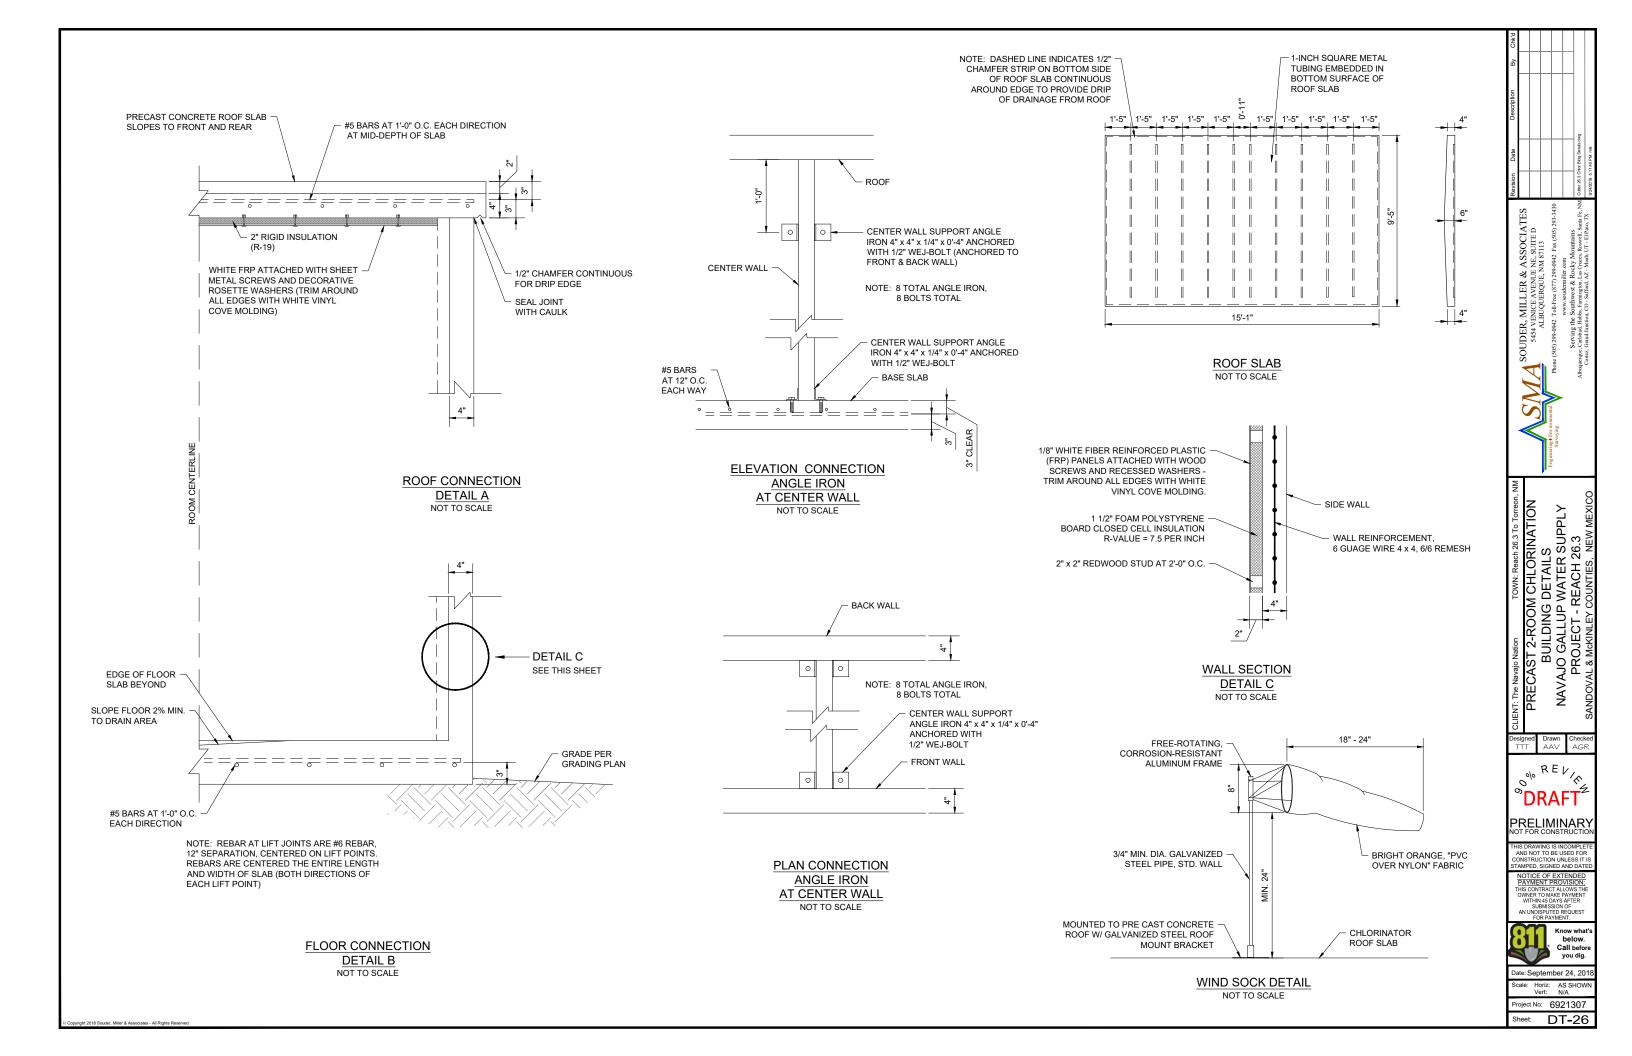

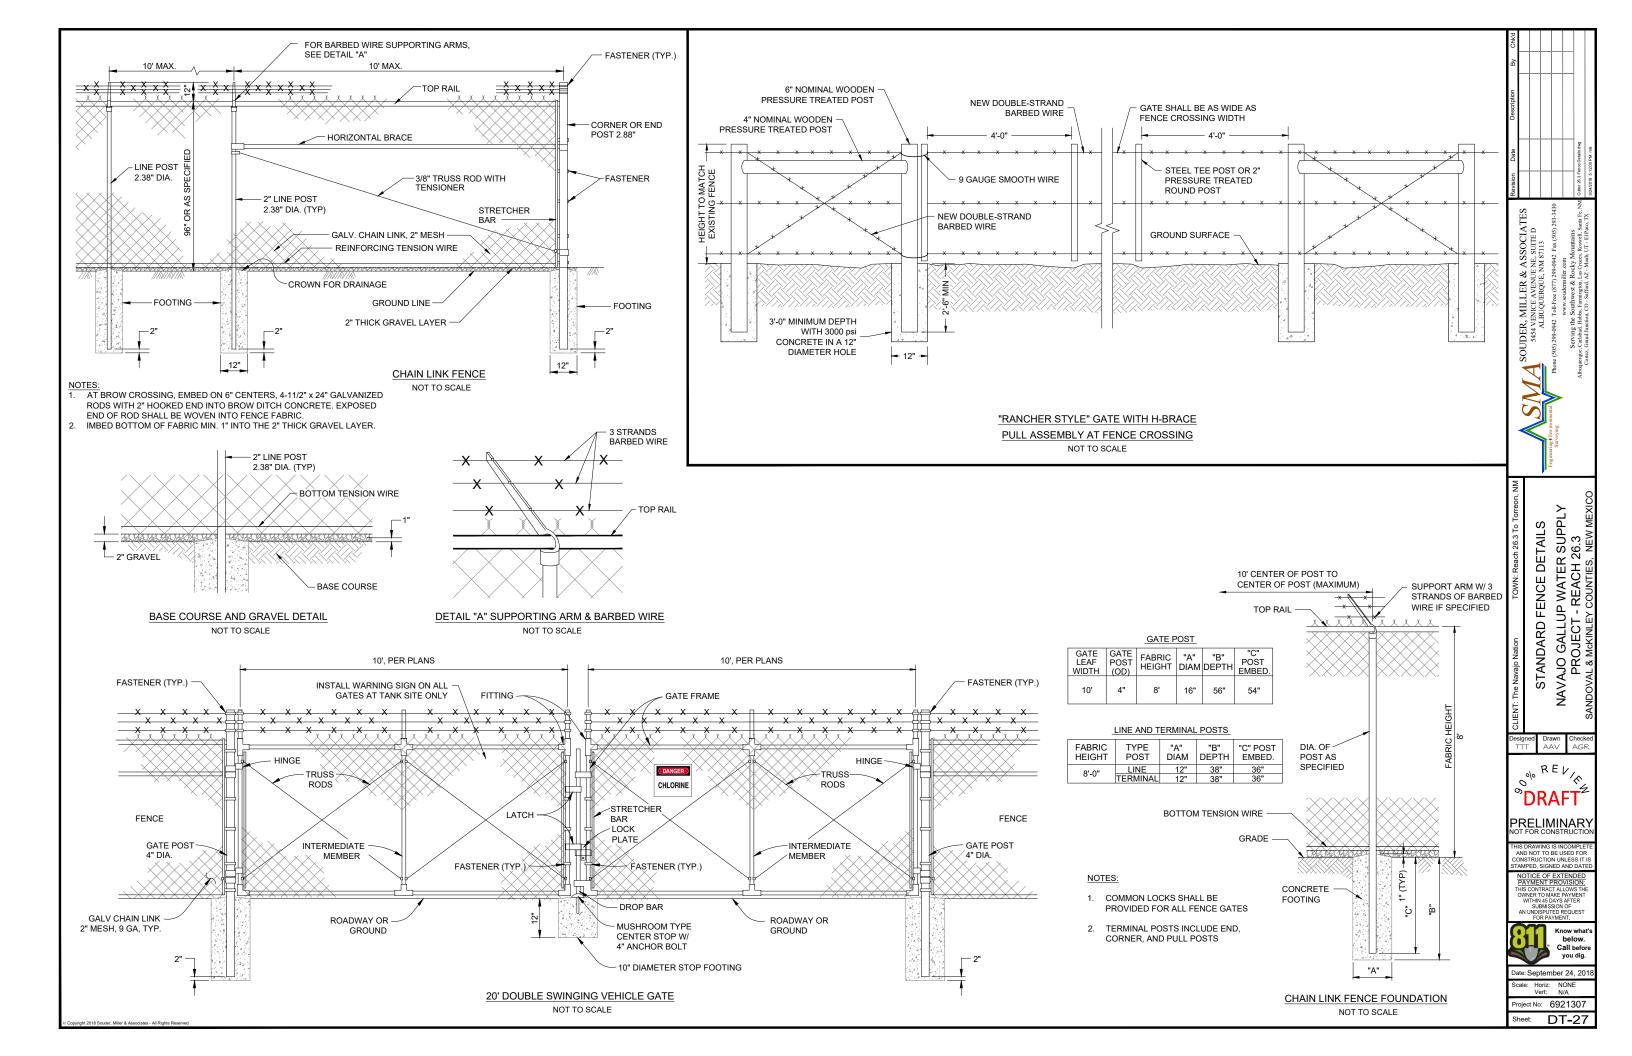

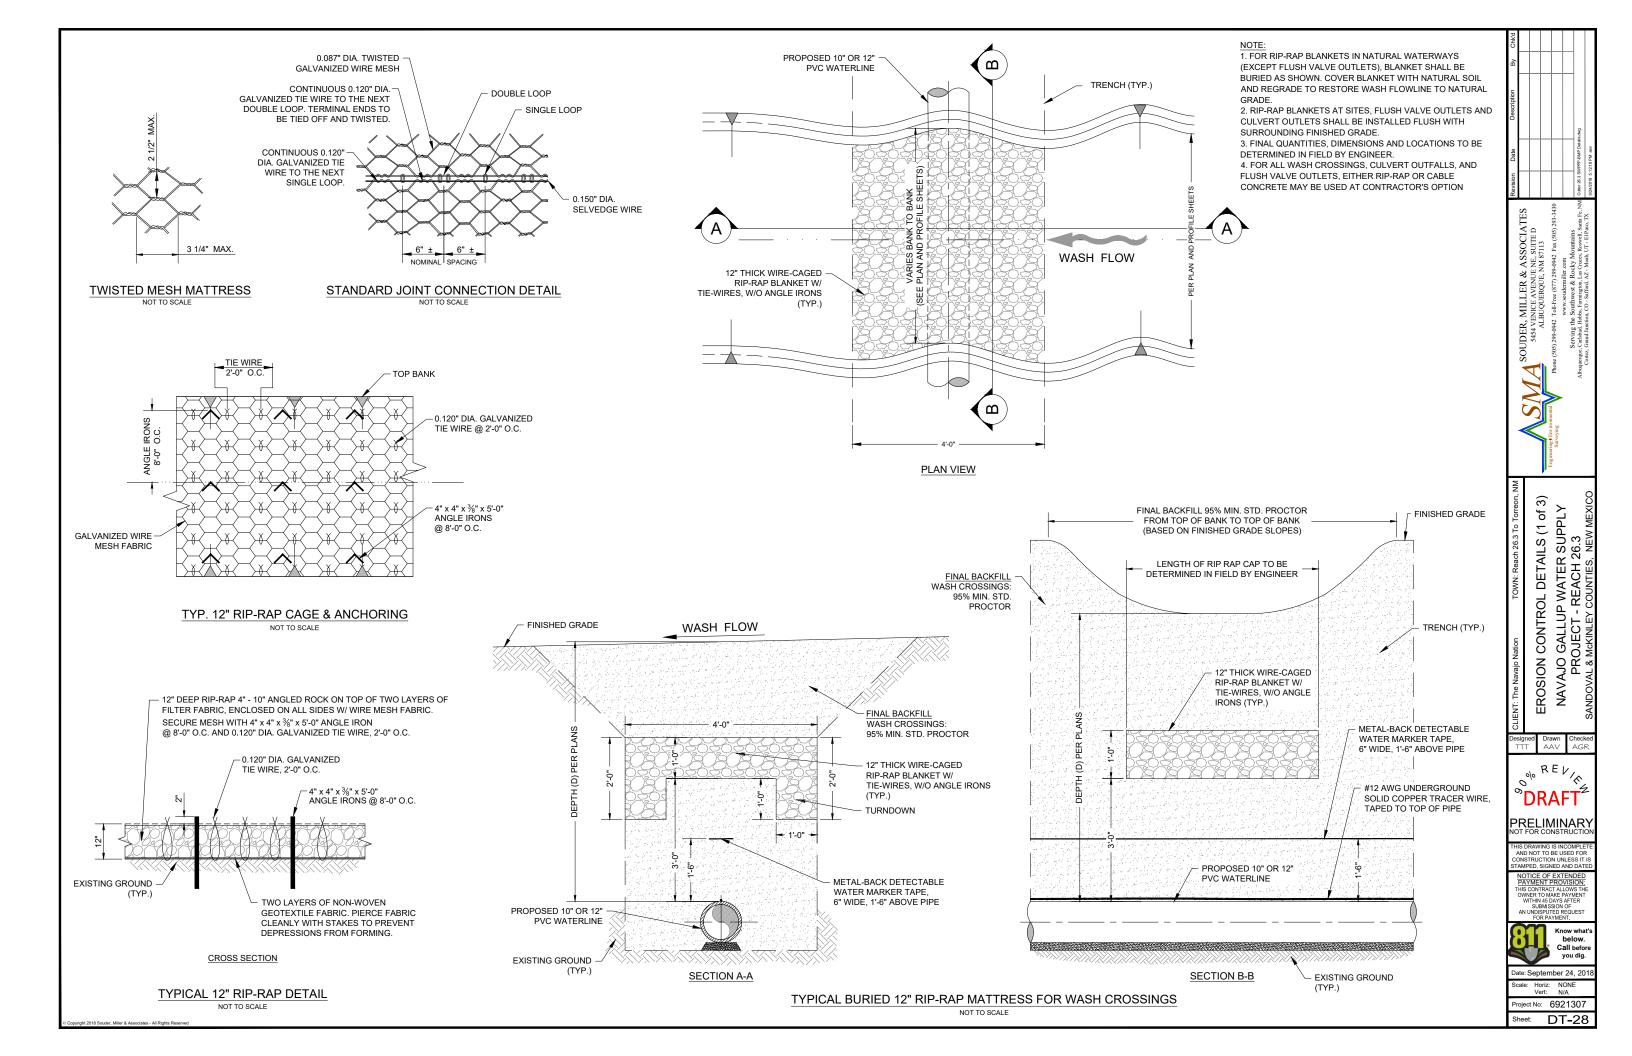

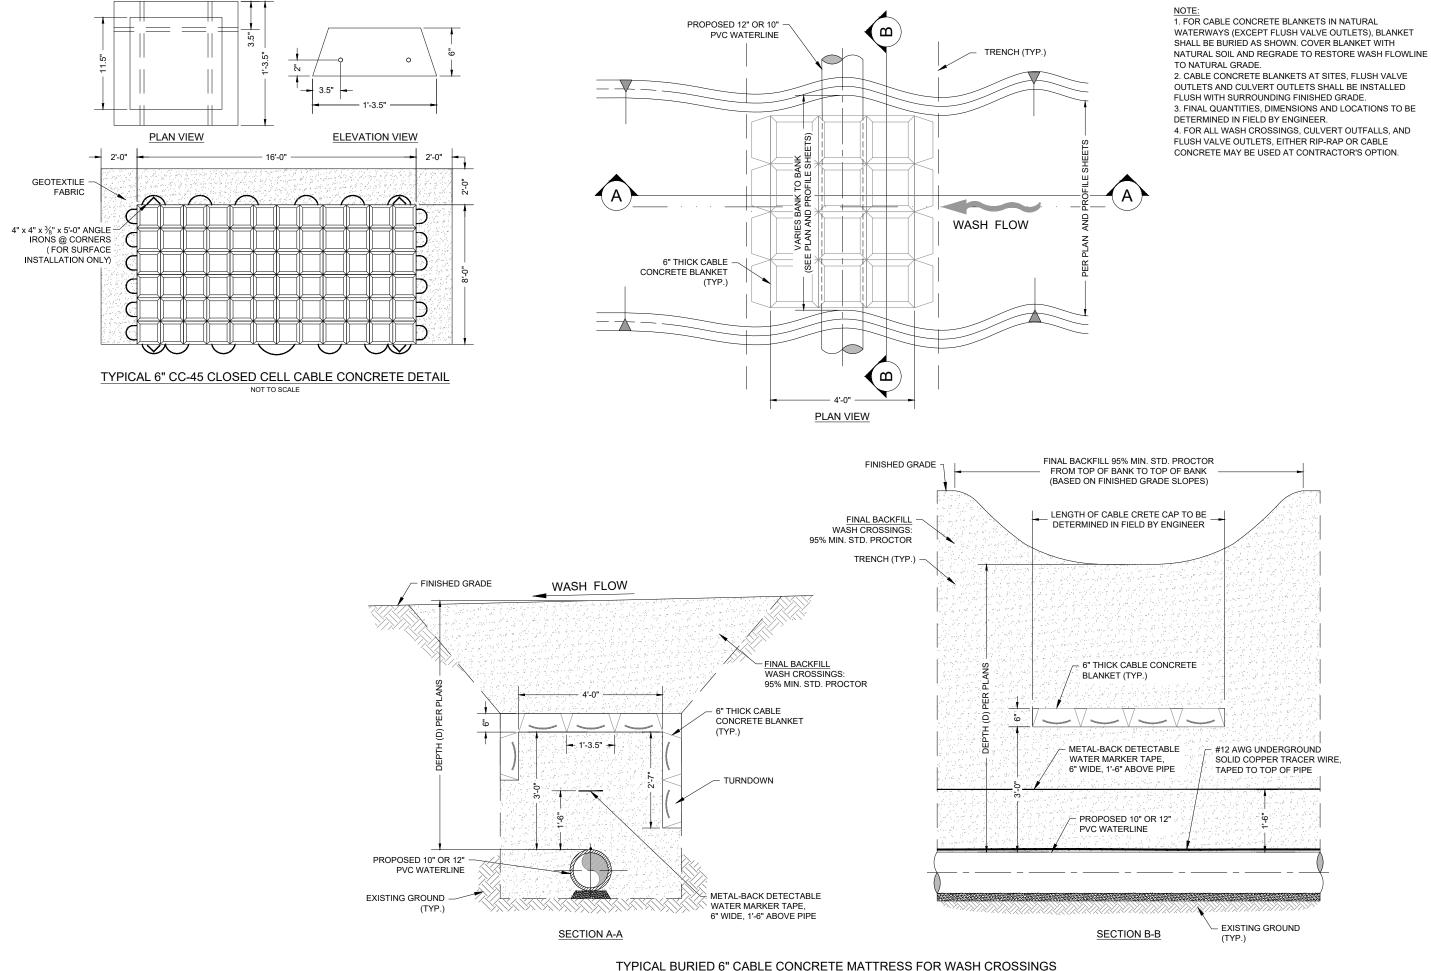

SOUDER, MILLER & ASSOCIATES 5454 VENICE AVENUE IN SUITED ALBUQUERQUE, IMM 87113

EROSION CONTROL DETAILS (2 of 3)
NAVAJO GALLUP WATER SUPPLY
PROJECT - REACH 26.3
SANDOVAL & MCKINLEY COUNTIES. NEW MEXICO

OOO REVA

DRAFT

PRELIMINARY NOT FOR CONSTRUCTION

NOTICE OF EXTENDED
PAYMENT PROVISION
THIS CONTRACT ALLOWS THOWNER TO MAKE PAYMENT
WITHIN 45 DAYS AFTER
SUBMISSION OF
AN UNDISPUTED REQUEST
FOR PAYMENT.


Date: September 24, 201 Scale: Horiz: NONE Vert: N/A


Project No: 6921307


Know what below.

Call befo

DT-29

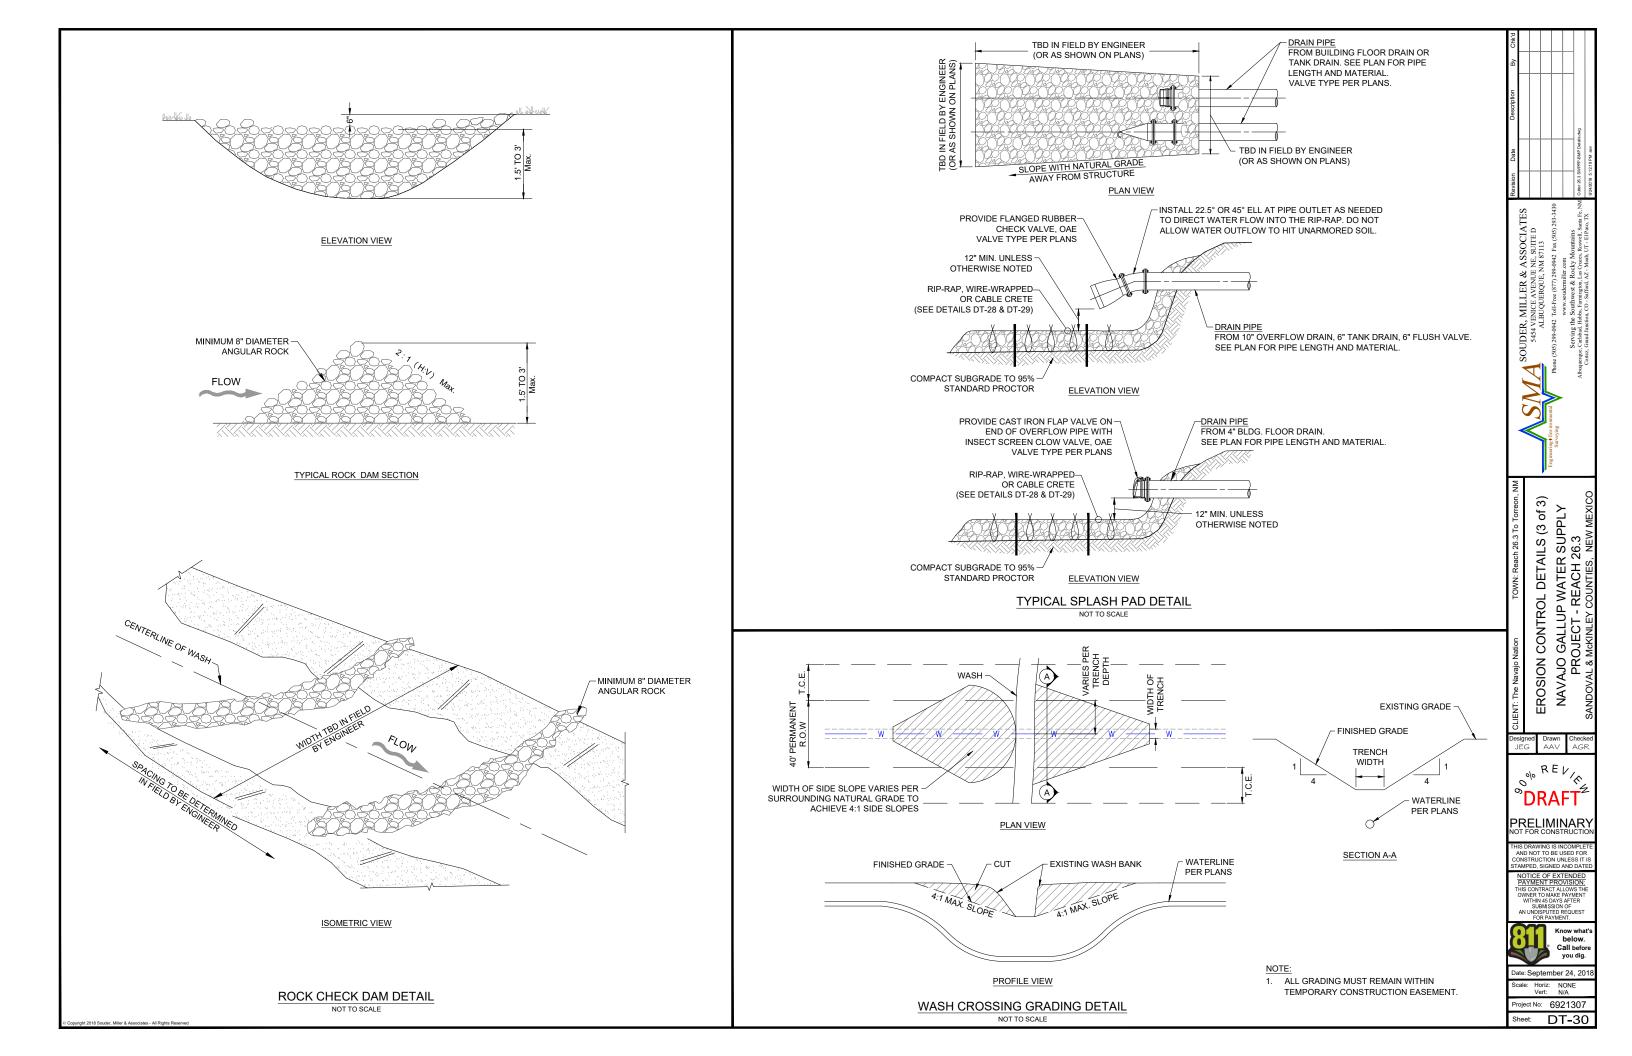

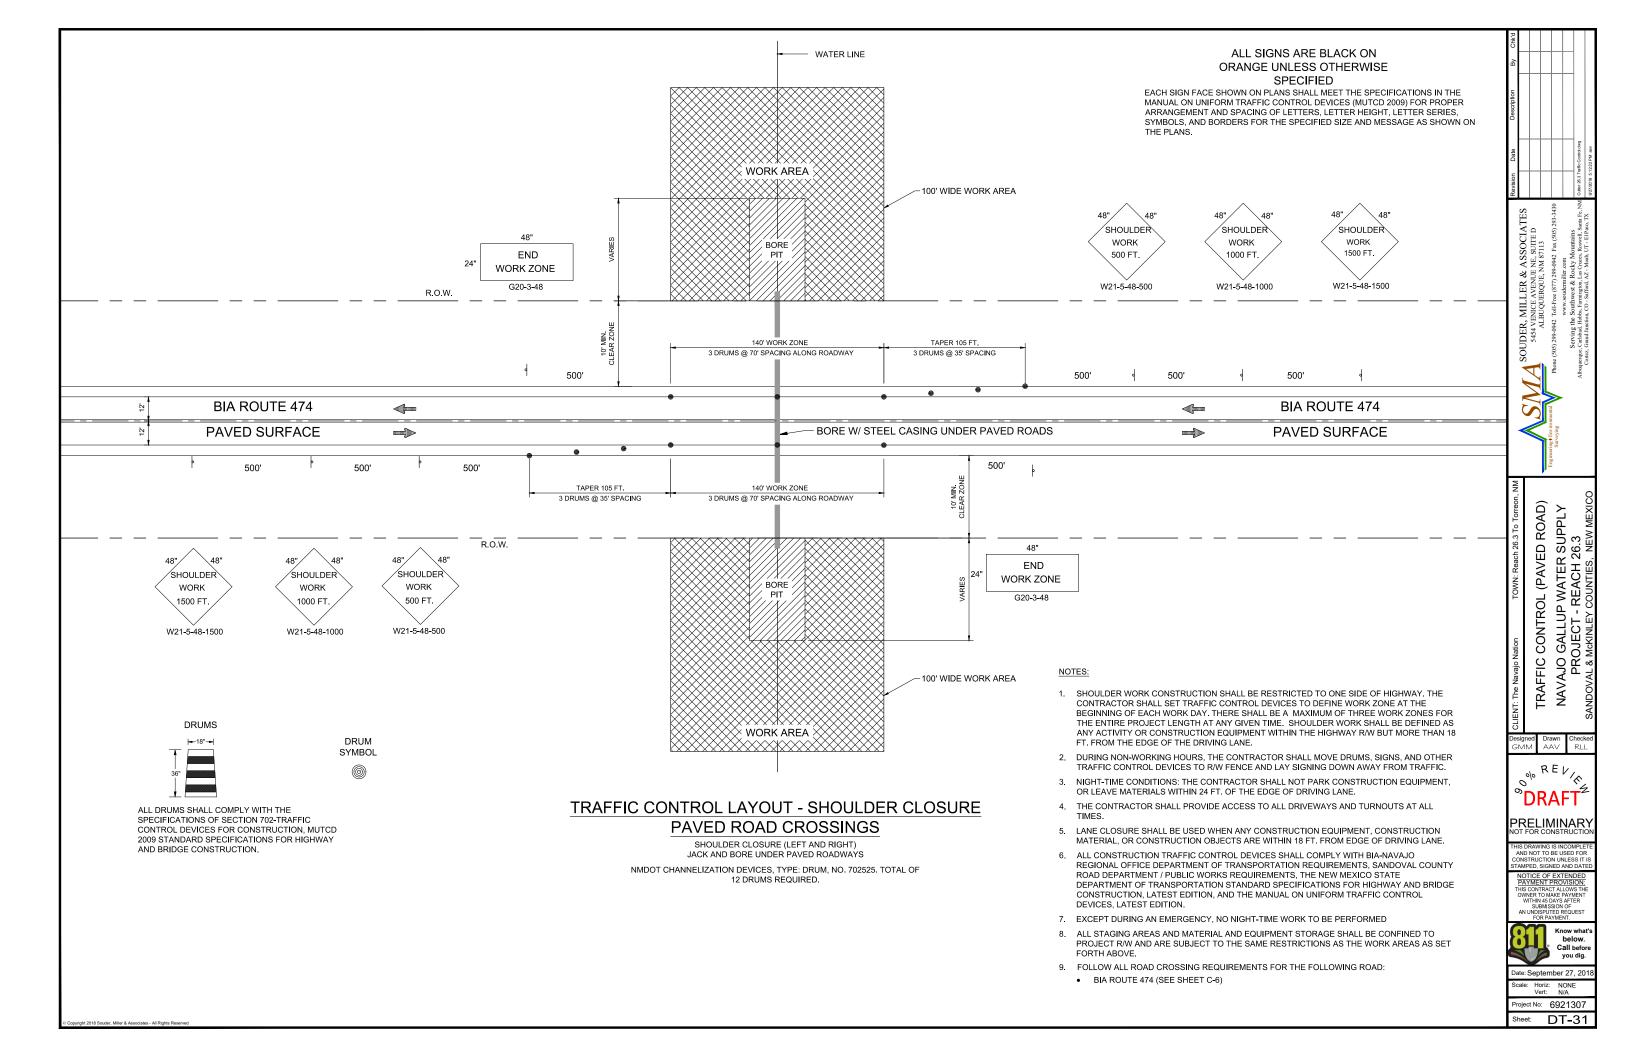

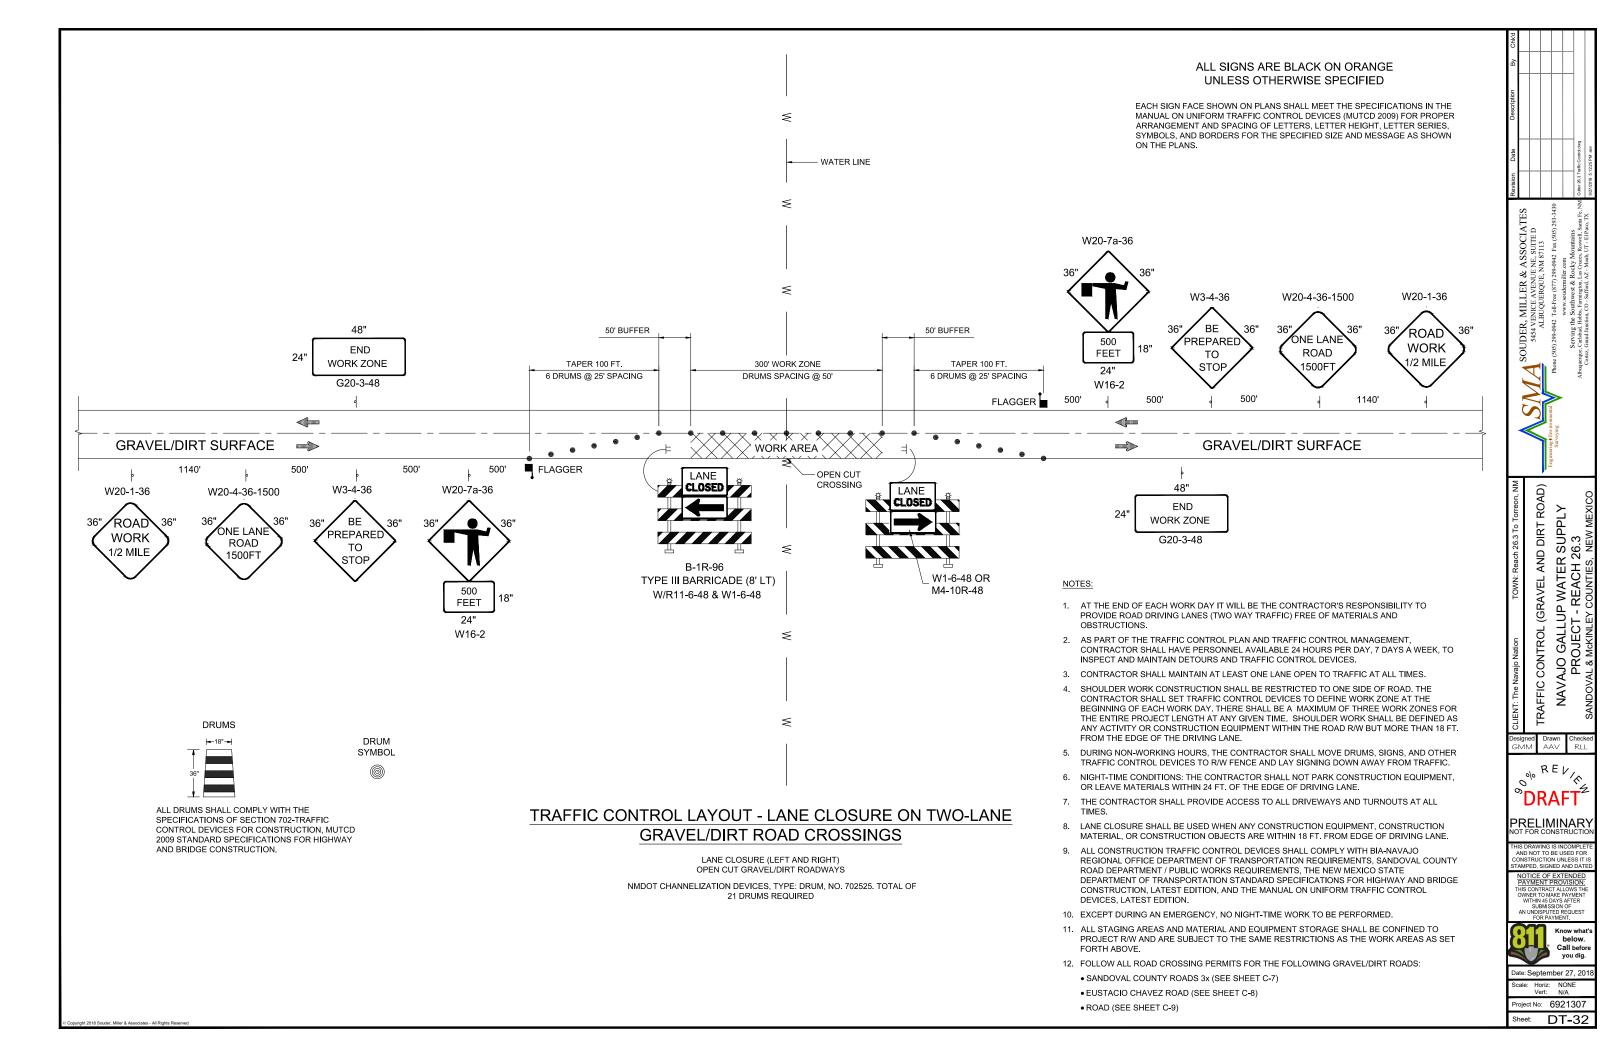

	ELECTRICAL SYMBOL LEGEND
SYMBOL	DESCRIPTION
на	WALL OUTLET AND SURFACE MOUNTED FIXTURE
	FLUORESCENT OUTLET AND FIXTURE
₩	SINGLE POLE SWITCH, FLUSH MOUNTED 48" A.F.F.
=	DUPLEX CONVENIENCE OUTLET, 18" A.F.F.
⇒ ^{WP}	WEATHERPROOF DUPLEX CONVENIENCE OUTLET, 18" A.F.F.
⇒GFCI	DUPLEX CONVENIENCE OUTLET, GROUND FAULT CIRCUIT INTERRUPTER, 18" A.F.F.
	JUNCTION BOX INSTALLED ABOVE LAY-IN CEILING WITH FLEXIBLE CONDUIT CONNECTION TO LAY-IN FIXTURES. MAXIMUM 4'-0' LENGTH OF CONDUIT, WITH REQUIRED CONDUCTORS ALONG WITH GREEN GROUND CONDUCTOR
ю	JUNCTION BOX FLUSH IN WALL, HEIGHT AS INDICATED ON DRAWINGS, WITH CONNECTION TO EQUIPMENT
	CONCEALED BRANCH CIRCUIT WITH CONDUCTORS AS INDICATED. NEUTRAL, HOT, SWITCH LEG AND GROUND RESPECTIVELY
	BRANCH CIRCUIT OR CONDUIT INSTALLED UNDERGROUND OR UNDER FLOOR
P2-2,4	HOMERUN TO PANELBOARD WITH BRANCH CIRCUIT NUMBERS INDICATED
(SV)	SOLENOID VALVE
(IS)	LIMIT SWITCH
6	PRESSURE TRANSMITTER
0	FIRE ALARM SMOKE AND HEAT DETECTOR, PHOTOELECTRIC TYPE, 120V AUX CONTACTS
ø	MOTOR CONNECTION FOR FRACTIONAL HP MOTOR (1/3 HP OR LESS). PROVIDE THERMAL, OVERLOAD SWITCH (WEATHERPROOF) E OUTSIDE) ADJACENT TO MOTOR UNLESS SWITCH IS SHOWN ELSEWHERE ON PLANS
#	MOTOR CONNECTION FOR MOTOR WITH HP INDICATED
4	DISCONNECT SWITCH, POLES AND RATING AS INDICATED OR AS REQUIRED, NEMA 3R IF INSTALLED OUTSIDE
Y F	FUSED DISCONNECT SWITCH, FUSE, POLES AND RATING AS INDICATED OR AS REQUIRED, NEMA 3R IF INSTALLED OUTSIDE
4⊠	COMBINATION MAGNETIC MOTOR CONTROLLER/DISCONNECT SWITCH. SIZE, POLES, FUSES AND OVERLOADS PER MOTOR SERVED
\boxtimes	MAGNETIC MOTOR CONTROLLER, SIZE AND POLES PER MOTOR SERVED
Т	TRANSFORMER, DRY TYPE, SIZE AS INDICATED
ю	THERMOSTAT(M), 48" A.F.F.
_	120V PANELBOARD, REFER TO PANEL SCHEDULE
2222	277V PANELBOARD, REFER TO PANEL SCHEDULE
	SPECIAL PURPOSE CABINET, AS INDICATED ON DRAWINGS
©	INTRUSION ALARM DOOR CONTACT MAGNETIC
	NORMALLY OPEN CONTACT
	NORMALLY CLOSED CONTACT
© VI JU JU	CONTACTOR
∦∦∦ ors	MOTOR OVERLOADS
Ø	RED PILOT LIGHT
)	GREEN PILOT LIGHT
- #E	TRANSFORMER
®	RELAY
	SWITCH
<u>—</u>	FUSE(S)
	CIRCUIT BREAKER PROGRAMMABLE LOGIC CONTROLLER
PLC RTU	REMOTE TERMINAL UNIT
ю	THERMOSTAT
WP	WEATHERPROOF (NEMA 3R)
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
A.F.F.	ABOVE FINISHED FLOOR
A.F.G.	ABOVE FINISHED GRADE
NOTES: • LIG	HTING FIXTURES ARE OF TYPE AS INDICATED ON LIGHT FIXTURE SCHEDULE U.N.O.
	INTING HEIGHTS FOR DEVICES CALLED OUT AT 18" A F. F. ARE TO THE BOTTOM OF THE

- MOUNTING HEIGHTS FOR DEVICES CALLED OUT AT 18" A.F.F. ARE TO THE BOTTOM OF THE DEVICE UNLESS OTHERWISE NOTED.
- MOUNTING HEIGHTS FOR DEVICES CALLED OUT AT 48" A.F.F. ARE TO THE TOP OF THE DEVICE
- ANY SPECIFIC DETAILS ABOVE (MOUNTING HEIGHTS, PART NUMBERS, CONNECTION METHODS, ETC.) MAY BE MODIFIED OR REPLACED BY INFORMATION ON PLANS, SCHEDULES, DETAILS, RISERS, ETC. DETAILS NOT SPECIFICALLY MODIFIED REMAIN AS GIVEN ABOVE.

GENERAL NOTES

SPECIFICATIONS

G1) IF THERE IS A CONFLICT BETWEEN PLANS/SPECIFICATIONS AND MANUFACTURER'S RECOMMENDATIONS FOR ANY DEVICE, PART, OR MATERIAL USED IN THE PROJECT, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY IN WRITING THE ENGINEER FOR

G2) THE CONTRACTOR SHALL FAMILIARIZE HIM/HERSELF WITH THE PLANS, AND THE SITE CONDITIONS PRIOR TO BID OPENING AND SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING OF ANY AMBIGUITIES, CONTRADICTIONS OR IRREGULARITIES IN THE PLANS.

G3) IF, DURING BIDDING OR CONSTRUCTION, THE CONTRACTOR IS IN DOUBT AS TO THE TRUE MEANING OF ANY PART OF THE PLANS, SPECIFICATIONS, OR OTHER CONTRACT, DOCUMENTS, OR DISCREPANCIES IN OR POSSIBLE OMISSIONS FROM THE DRAWINGS OR SPECIFICATIONS, THEY SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING AND REQUEST AN INTERPRETATION OF CORRECTION THEREOF. DURING THE BIDDING PROCESS AN ADDENDUM (IF NEEDED) WILL BE ISSUED.

G3.1) THE CONTRACT, IF AWARDED, WILL BE ON THE BASIS OF MATERIAL AND EQUIPMENT SPECIFIED OR DESCRIBED IN THE BIDDING DOCUMENTS WITHOUT CONSIDERATION OF POSSIBLE SUBSTITUTE OR "OR EQUAL" ITEMS. WHEREVER A BRAND NAME IS SPECIFIED OR DESCRIBED IN THE BIDDING DOCUMENTS A SUBSTITUTE OR "OR EQUAL" ITEM OF MATERIAL OR EQUIPMENT MAY BE FURNISHED OR USED BY CONTRACTOR IF ACCEPTABLE TO ENGINEER. APPLICATION FOR SUCH ACCEPTANCE WILL NOT BE CONSIDERED BY ENGINEER UNTIL AFTER THE EFFECTIVE DATE OF AGREEMENT. THE PROCEDURE FOR SUBMISSION OF ANY SUCH APPLICATION BY CONTRACTOR AND CONSIDERATION BY ENGINEER IS SET FORTH IN THE GENERAL CONDITIONS.

EXISTING UTILITIES & OBSTACLES TO WORK

G4) THE CONTRACTOR IS RESPONSIBLE TO INSTALL ALL ITEMS DESCRIBED IN THESE PLANS IN A MANNER THAT PROTECTS G4) THE CONTRACTOR IS RESPONSIBLE TO INSTALL ALL ITEMS DESCRIBED IN THESE PLANS IN A MANNER THAT PROTECTS THE EXISTING FACILITY. THE CONTRACTOR MUST CONTRACT HE REGISTER INMEDIATELY IF HE IS UNABLE TO PERFORM THIS WORK WITHOUT DAMAGE TO THE EXISTING FACILITY. THE CONTRACTOR MUST FIELD VERIFY ALL EXISTING INFORMATION SHOWN ON THESE PLANS. DESIGN ELEMENTS OF THIS PROJECT WILL NOT CHANGE WITHOUT CHANGE ORDER UNLESS THE CONTRACTOR NOTIFIES THE ENGINEER IN A TIMELY MANNER REGARDING ITEMS DESCRIBED IN HIS NOTE. CHANGES IN ALIGNMENT CAUSED BY UNKNOWN OR UNANTICIPATED SITE CONDITIONS SHALL BE ACCOUNTED FOR BY THE APPROPRIATE UNIT PRICES, AS RECOMMENDED BY THE ENGINEER AND APPROVED BY THE OWNER.

G5) THE EXISTENCE CONDITION AND LOCATION OF ANY UNDERGROUND LITH ITIES OR STRUCTURES SHOWN IN THESE PLANS GS) THE EXISTENCE, CONDITION AND CLOCKHOLON FROM TONDERGROUND OTHER THE CONTRACTOR IS REQUIRED TO TAKE ALL PRECAUTIONARY MEASURES TO PROTECT THE UTILITIES SHOWN, AND ANY OTHER LINES OR STRUCTURES NOT SHOWN ON THESE PLANS, AND IS RESPONSIBLE FOR THEIR LOCATING, PROTECTION OF, OR ANY DAMAGE TO THESE PLANS THE SPENDING OF THE UTILITIES OF THEIR LOCATING, PROTECTION OF, OR ANY DAMAGE TO THESE LINES OR STRUCTURES. THIS DOES NOT RELIEVE THE CONTRACTOR FROM HIS RESPONSIBILITY TO NOTIFY ALL UTILITY COMPANIES AND OBTAIN LINE SPOTS.

G6) THE FOLLOWING IS A LIST OF POSSIBLE OBSTRUCTIONS AND SHALL NOT BE CONSIDERED A COMPLETE LIST OF POSSIBLE GB) THE POLLOWING IS A LIST OF POSSIBLE OBSTRUCTIONS AND SHALL NOT BE CONSIDERED A COMPLETE LIST OF POSSIBLE OBSTRUCTIONS: EXISTING UTILITIES, STRUCTURE, GEOTECHNICAL FEATURES, ALL CONDUIT, CABLES, PIPES, WATERLINES, SEWER LINES, GAS LINES, POWER LINES, TELEPHONE AND TELEGRAPH LINES, TREES, MONUMENTS, TRAFFIC CONTROL DEVICES AND OTHER STRUCTURES, BOTH BELOW AND ABOVE GROUND.

G7) CONTRACTOR SHALL BE HELD RESPONSIBLE FOR COSTS OF REPAIR OF ANY AND ALL DAMAGE TO ANY UTILITY (WHICH IS PREVIOUSLY KNOWN AND DISCLOSED TO HIM BY THE UTILITY OR SHOWN ON THESE PLANS) AS MAY BE CAUSED BY HIS

G8) FIVE (5) WORKING DAYS PRIOR TO ANY EXCAVATION, CONTRACTOR MUST CONTACT NEW MEXICO ONE-CALL SYSTEM, INC.

G9) CONTRACTOR SHALL GIVE ALL PUBLIC AND PRIVATE UTILITY COMPANIES NOTICE AS SOON AS POSSIBLE, IN NO EVENT LESS THAN FORTY EIGHT (48) HOURS, FOR ANY WORK THAT IS UNDERSTOOD TO INTERFERE WITH THE SERVICE OF ANY EXISTING PUBLIC OR PRIVATE UTILITY. IF SUCH PUBLIC OR PRIVATE UTILITY DOES NOT COOPERATE FOR THE PROTECTION OF ITS SERVICES, CONTRACTOR SHALL NOTIFY ENGINEER.

G10) CONTRACTOR SHALL IMMEDIATELY REPORT ANY DAMAGES TO PUBLIC OR PRIVATE PROPERTY TO THE OWNER OF THE PROPERTY INVOLVED AND TO THE ENGINEER. CONTRACTOR SHALL REPAIR OR RESTORE AT HIS OWN EXPENSE ANY DAMAGE TO PUBLIC OR PRIVATE PROPERTY, FOR WHICH THEY ARE DIRECTLY OR INDIRECTLY RESPONSIBLE, TO A CONDITION EQUAL TO THAT EXISTING BEFORE DAMAGE. CONTRACTOR SHALL PROMPTLY NOTIFY HIS INSURANCE CARRIER OF SUCH DAMAGE. IF CONTRACTOR FAILS TO GIVE SUCH NOTICE TO HIS INSURANCE CARRIER OR REFUSES TO EFFECT SUCH REPAIRS OR RESTORATION UPON RECEIPT OF NOTICE, THE ENGINEER MAY CAUSE SUCH REPAIRS OR RESTORATION AND DEDUCT THE COST THEREOF FROM MONEYS DUE, OR WHICH MAY BECOME DUE, TO THE CONTRACTOR.

G11) CONTRACTOR IS RESPONSIBLE FOR RECORDING EXISTING CONDITIONS IN ACCORDANCE WITH THE SUPPLEMENTARY CONDITIONS OF THE CONTRACT BEFORE CONSTRUCTION BEGINS. THE RECORD OF EXISTING CONDITIONS SHALL BE USED AS THE "FOUAL CONDITION BEFORE DAMAGE" IN THE EVENT OF DAMAGE TO PUBLIC OR PRIVATE PROPERTY, CONTRACTOR THE EUGNAL CONTINUO BEFORE DAMAGE IN THE EVENT OF DAMAGE TO POBLIC OF PROVINE PROPERTY. CONTINUO BEFORE DAMAGE THE STANDARD THE CONTRACTOR SHALL BE RESPONSIBLE FOR MEETING AND THE ENGINEER WILL BE IN THE POSITION OF NOT BEING ABLE TO SUPPORT THE CONTRACTOR IN THE MEDIATION OF ANY DISPUTE.

G12) UTILITY LOCATION CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFICATION OF LOCATION OF ALL EXISTING UTILITIES.

SITE CONDITIONS

G13) CONTRACTOR SHALL MAINTAIN ACCESS TO ALL FACILITIES ADJACENT TO THE CONSTRUCTION AREA.

G14) EPA STORM WATER DISCHARGE REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR COMPLIANCE TO APPLICABLE PORTIONS OF THE EPA STORM WATER DISCHARGE REGULATIONS.

G15) <u>DUST ABATEMENT.</u> THE CONTRACTOR SHALL USE WATERING EQUIPMENT FOR DUST POLLUTION ABATEMENT AS REQUIRED OR AS DIRECTED BY THE ENGINEER. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND SUPPLYING WATER. THIS WORK SHALL BE CONSIDERED INCIDENTAL TO CONSTRUCTION.

SITE DESIGN

G16) SUBGRADE ALL ELECTRICAL SUBGRADE AND TRENCH BACKFILL SHALL BE COMPACTED TO 95 % OF STANDARD GTO) <u>SUBGRADUE</u> ALL ELECTRICAL SUBGRADUE AND THENCH BACKFILL SHALL BE COMPACTION OF 50° SOF STANDARD PROCTOR. ALL SUBGRADE AND BACKFILL SHALL BE COMPACTOR IN MAXIMUM 6" LOOSE LIFTS, MOISTURE CONTENT AT THE TIME OF COMPACTION SHALL NOT EXCEED OPTIMUM OR BE LESS THAN 5 PERCENTAGE POINTS BELOW OPTIMUM.

DRIVEWAYS, APRONS, FILLETS, CURB AND GUTTER, AND OTHER CONCRETE PAVEMENT SHALL BE PLACED ON 6" OF

G17) RESTORE SURFACE AT TRENCH TO EXISTING CONDITIONS.

COMMUNICATION

G18) CONTRACTOR SHALL KEEP THE OWNER AND THE ENGINEER UPDATED WEEKLY ON THE CONSTRUCTION SCHEDULE AND/OR PHASE SCHEDULE, AND PROGRESS TO DATE.

STAGING STORAGE & DEBRIS DISPOSAL

G19) DEBRIS GENERATED BY CONSTRUCTION ACTIVITIES SHALL BE DISPOSED OF AT A PERMITTED LANDFILL OR OTHER DULY CERTIFIED REFUSE FACILITY. THE DISPOSAL OF DEBRIS IS NOT A PAY ITEM.

RECORD DRAWINGS

G20) THE CONTRACTOR SHALL PROVIDE A RECORD SKETCH ON THESE PLANS FOR THE AS-CONSTRUCTED CONDITIONS.

PHASE AND SCHEDULE

G21) CONTRACTOR SHALL PHASE AND SCHEDULE WORK IN SUCH A WAY AS TO PROVIDE MINIMAL POWER OUTAGES AT THE FACILITY. A PROJECT SCHEDULE SHALL BE SUBMITTED TO THE OWNER FOR REVIEW PRIOR TO ISSUANCE OF NOTICE-TO-PROCEED. CHANGES IN SCHEDULE SHALL BE PRESENTED TO OWNER AND ENGINEER AT LEAST 7 DAYS PRIOR TO PROPOSED IMPLEMENTATION. THESE SCHEDULES, SCHEMATICS AND DIAGRAMS SHALL BE UPDATED WEEKLY AS THE WORK PROGRESSES. MOST CHANGE OVER SHALL BE DONE ON WEEKENDS OR AFTER HOURS

G22) CONTRACTOR SHALL PROVIDE SUBMITTALS FOR ALL EQUIPMENT, MATERIALS. PROCESSES AND SCHEDULES AND AS

PROGRAMMING OF PLC + SCADA SYSTEMS

G23) CONTRACTOR RESPONSIBLE FOR PROVIDING. INSTALLING, AND PROGRAMMING A COMPLETE AND WORKING SYSTEM

G24) CONTRACTOR SHALL COORDINATE ALL PROGRAMMING REQUIREMENTS WITH OWNER AND SHALL REFER TO PLANS AND SPECIFICATIONS FOR SEQUENCE OF OPERATIONS. REFER TO CONTROL WIRING SCHEDULE, DISCRETE & ANALOG I/O LIST, CONTROL AND WIRING DIAGRAMS, AND SPECIFICATIONS FOR ADDITIONAL INFORMATION



E ASSOCIAT E NE, SUITE D NM 87113 SOUDER, MILLER & A
5454 VENICE AVENUE N
ALBUQUEROUE, NA

R SUPPLY 26.3 S. NEW MEXIC NOTES NATER S

GENERAL OJECT - R 26 REACH NAVAJO (PRC

ONSTRUCTION UNLESS IT


NOTICE OF EXTENDE PAYMENT PROVISION



Date: March 14, 2018

Project No: 6921307

E001

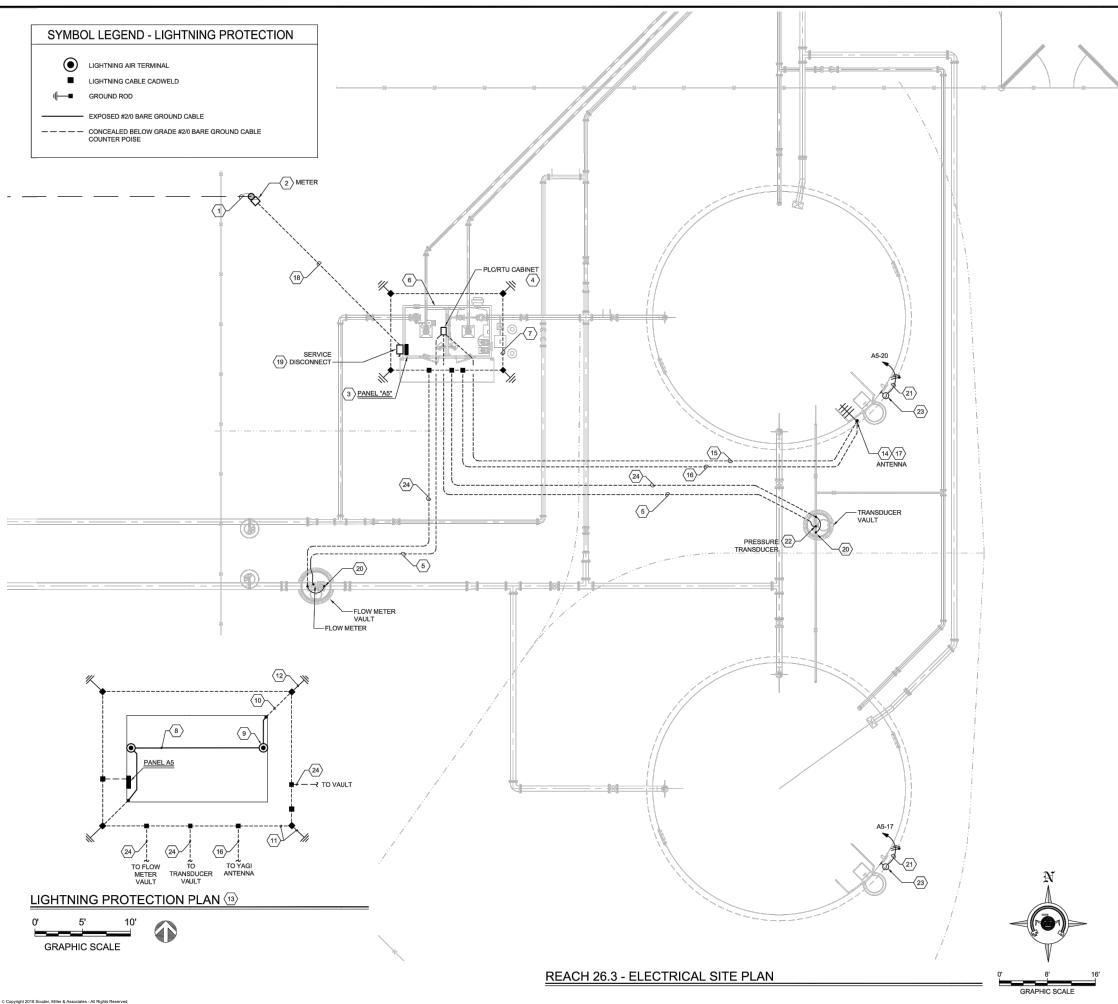

GENERAL NOTES

- REFER TO LIGHTNING PROTECTION SPECIFICATION SECTION 26 60 10 FOR ADDITIONAL INFORMATION.
 - CONTRACTOR SHALL PROVIDE LIGHTNING PROTECTION SYSTEM DRAWING BEFORE INSTALLATION, INCLUDING GROUND RODS AND GROUNDING CABLES (BELOW GROUND AND ABOVE ROOF)
 - C. AFTER THE SYSTEM HAS BEEN INSTALLED. THE UL LISTED INSTALLER SHALL COMPLETE AND SUBMIT THE CERTIFICATION APPLICATION.
 - THE ULLISTED INSTALLER SHALL FORWARD THE CERTIFICATION TO THE OWNER AND PROVIDE PROOF THAT THE LIGHTNING PROTECTION SYSTEM IS IN COMPLIANCE WITH UL, NFPA, OR U.S. GOVERNMENT STANDARDS.
 - GROUND ROD AND BUILDING COUNTER POISE DEPTH SHALL BE 24" BELOW GRADE.
 - ALL GROUNDING WIRING SHALL BE PROPERLY CONNECTED PER SPECS SECTION 26 45
 - G. THE CONTRACTOR SHALL SELECT AN ADHESIVE FOR THE AIR TERMINALS THAT MANUFACTURED RECOMMENDED AND IS COMPATIBLE FOR USE WITH THE ROOFING SYSTEM
 - H. ALL WIRING CONNECTIONS, AIR TERMINAL BASES, CLAMPS, AND PLATES THAT COME ALL WINING COUNCE CITIONS, AIR LEXINING ASSACS, CLAWING, AND PEAT STAIL OF THAT COUNCING MATERIAL SHALL BE INSTALLED USING AN APPROVED ADHESIVE. THE LIGHTNING PROTECTION SYSTEM INSTALLER SHALL NOT CREATE ANY PENETRATION IN THE ROOF WHEN INSTALLING THEIR EQUIPMENT.
 - ALL WIRING CONNECTORS, AIR TERMINALS, CLAMPS, ETC SHALL BE UL APPROVED FOR A LIGHTNING PROTECTION SYSTEM.

KEYED NOTES

- NEW OVERHEAD 240 VOLT, SINGLE PHASE LINE OF OVERHEAD CONDUCTORS TO POLE BY JEMEZ UTILITY COMPANY, POLE INSTALLED BY CONTRACTOR PER JEMEZ ELECTRIC COOP SPECIFICATION. VERIFY POWER POLE LOCATION WITH ENGINEER AND UTILITY PRIOR TO FINAL PLACEMENT. MAINTAIN 3-0" CLEARANCE BETWEEN METER AND
- CONTRACTOR SHALL PROVIDE A METER ENCLOSURE MOUNTED ON POLE. REFER TO POWER RISER DIAGRAM FOR ADDITIONAL REQUIREMENTS. METER SHALL FACE TOWARDS FENCE. 25'-0" POLE PROVIDED AND INSTALLED BY THE CONTRACTOR. PROVIDE A MINIMUM WORKING CLEARANCE OF 3'-0" BETWEEN METER AND FENCE PER N.E.C. REQUIREMENTS.
- 3. BUILDING PANEL "A5". REFER TO POWER RISER DIAGRAM, BUILDING PLAN AND PANEL SCHEDULE FOR ADDITIONAL REQUIREMENTS ON SHEET E102.
- 4. PLC CABINET. REFER TO FLOOR PLAN FOR LOCATION ON SHEET E201
- 5. UNDERGROUND CONDUIT RUN FROM THE VAULT INSTRUMENATION TO THE PLC CABINET. REFER TO BUILDING CONTROL PLAN AND WIRING SCHEDULE ON SHEET E103 FOR CABLE AND CONDUIT REQUIREMENTS.
- NEW CHLORINATION BUILDING. REFER TO BUILDING PLAN ON SHEET E102 & E103 FOR EQUIPMENT LOCATIONS.
- REFER TO LIGHTNING PROTECTION PLAN ON THIS SHEET FOR ADDITIONAL
- LIGHTNING PROTECTION CLASS 1 ROOF-MOUNTED LATERAL CONDUCTOR AND MOUNTING HARDWARE.
- 9. LIGHTNING PROTECTION AERIAL TERMINAL. 1/2" x 18" TUBULAR COPPER AERIAL FERMINAL AND MOUNTING HARDWARE, MOUNTED AT ROOF PARAPET, PENTHOUSE AND ROOFTOP UNITS AS INDICATED.
- 10. LIGHTNING PROTECTION 2/0 BARE COPPER DOWN-CONDUCTOR. 11. LIGHTNING PROTECTION COUNTERPOISE SYSTEM. ALL CONNECTIONS SHALL BE EXO-THERMIC WELDS.
- 12. GROUND ROD. 3/4" X 10'-0" GROUND ROD
- 13. LIGHTNING PROTECTION SYSTEM LAYOUT ON THIS PLAN IS FOR BIDDING PURPOSES ONLY. INSTALLATION TO BE PER NFPA-780, U.S. GOVERNMENT STANDARDS AND SPECIFICATIONS SECTION 26 60 10. SYSTEM SHALL BE PROVIDED WITH A MASTER
- 14. INSTALL A YAGI ANTENNA ON TOP OF A 2" RGS CONDUIT MAST AND MOUNT TO THE SIDE OF THE TANK LADDER CAGE. EXTEND CONDUIT TO 10' ABOVE TOP OF TANK ADJUST ANTENNA FOR MAXIMUM SIGNAL STRENGTH FROM COUNSELOR SITE. REFER TO SHEET E103 FOR COAXIAL ANTENNA CABLE REQUIREMENT.
- 15 1" CONDUIT WITH CABLES FROM PLC TO ANTENNA MAST
- 16. BOND ANTENNA CABLE CONDUIT AND ANTENNA MAST TO A 8' X 5/8" COPPER-CLAD STEEL GROUND ROD AND TO BUILDING COUNTER POISE WITH #4 COPPER GROUND CONDUCTORS.
- 17. REFER TO ANTENNA INSTALLATION DETAIL ON SHEET E203 FOR ADDITIONAL REQUIREMENTS.
- REFER TO POWER RISER DIAGRAM FOR UNDERGROUND CONDUIT AND CONDUCTOR SIZES FOR SECONDARY SERVICE.
- 19. PROVIDE AND INSTALL A BUILDING MOUNTED SERVICE DISCONNECT SWITCH. REFER TO POWER RISER ON SHEET E201 FOR ADDITIONAL REQUIREMENTS.
- 20. PROVIDE A 5/8" x 8' COPPER-CLAD STEEL GROUND ROD IN VAULT. CONNECT BOTH PIPE FLANGES AND ENCLOSURE TO THE GROUND ROD WITH #4 COPPER CONDUCTORS FROM VAULT GROUND ROD EXTEND A #4 COPPER CONDUCTOR IN A 3/4" CONDUIT, UP TO THE GROUNDING SYSTEM.
- 21. HOMERUN 3 #12 1" CONDUIT FROM THE J-BOX TO PANEL "A4" LOCATED IN THE CHLORINATION BUILDING. ALL CONDUIT RISERS OUT OF THE GROUND SHALL BE RGS.
- 22. TANK PRESSURE TRANSDUCER INSTALLED IN VAULT. REFER TO PRESSURE TRANSDUCER VAULT DETAIL ON SHEET E201.
- 23. THE CONTRACTOR SHALL PROVIDE AND INSTALL A WEATHERPROOF J-BOX ADJACENT TO THE CATHODIC PROTECTION RECTIFIER, RECTIFIER WILL BE MOUNTED NEXT TO THE TANK LADDER. COORDINATE FINAL LOCATION PRIOR TO INSTALLATION. EXTEND POWER TO RECTIFIER AND MAKE FINAL CONNECTION AS REQUIRED BY MANUFACTURER'S RECOMMENDATIONS. (FOR USE WITH WELDED STEEL TANKS ONLY).
- 24. EXTEND A #4 BARE COPPER CONDUCTOR BETWEEN VAULT GROUNDING AND BUILDING

WARNING

IF ANY UTILITY LINES, PIPELINES, OR UNDERGROUND UTILITY LINES ARE SHOWN ON THESE DRAWINGS, THEY ARE SHOWN IN AN APPROXIMATE MANNER ONLY, AND SUCH LINES MAY EXIST WHERE NONE ARE SHOWN. IF ANY SUCH EXISTING LINES ARE SHOWN, THE LOCATION IS BASED UPON INFORMATION PROVIDED BY THE UTILITY OR PIPELINE COMPANY, THE OWNER OR BY OTHERS, AND THE INFORMATION MAY BE INCOMPLETE, OR MAY BE OBSOLETE BY THE TIME CONSTRUCTION COMMENCES.

THE ENGINEER HAS UNDERTAKEN NO FIELD VERIFICATION OF THE LOCATION, DEPTH SIZE OR TYPE OF EXISTING UTILITY LINES, PIPELINES, OR UNDERGROUND UTILITY LINES, MAKES NO REPRESENTATION PERTAINING THERETO, AND ASSUMES NO RESPONSIBILITY OR LIABILITY THEREFORE. THE CONTRACTOR SHALL INFORM ITSELF TO THE LOCATION OF ANY UTILITY LINE, PIPELIE OR UNDERGROUND UTILITY LINE IN OR NEAT THE AREA OF THE WORK IN ADVANCE OF AND DURING EXCAVATION WORK. THE CONTRACTOR IS FULLY RESPONSIBLE OF ANY AND ALL DAMAGE CAUSED BY IT'S FAILURE TO LOCATE, IDENTIFY AND PRESERVE ANY AND ALL EXISTING UTILITIES, LINES, PIPELINES, OR UNDERGROUND UTILITY LINES. THE CONTRACTOR SHALL COMPLY WITH STATE STATUTES, MUNICIPAL AND LOCAL ORDINANCES, RULES, AND REGULATIONS, IF ANY, PERTAINING TO THE LOCATION OF THESE LINES AND FACILITIES IN PLANNING AND CONDUCTING EXCAVATION, WHETHER BY CALLING OR NOTIFYING THE UTILITIES, COMPLYING WITH "NM ONE CALL" PROCEDURES, OR OTHERWISE.



MILLER & I SOUDER, N 5454 VEN ALB

> PLAN R SUPPLY 26.3 SITE


O GALLUP WATER S ROJECT - REACH 26 ELECTRICAL NAVAJO (PRC


NSTRUCTION UNLESS IT



ate: March 14, 2018

roject No: 6921307 E101

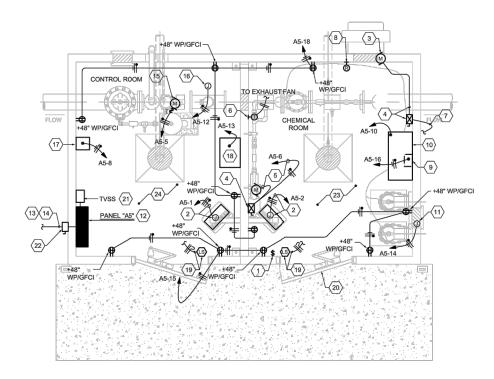


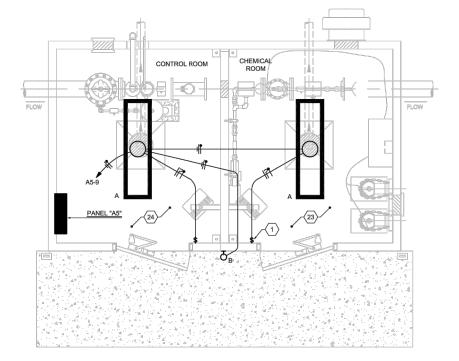

REACH 26.3 CHLORINATION BUILDING - POWER PLAN



REACH 26.3 CHLORINATION BUILDING - LIGHTING PLAN



PANEL	The second second		OC DEVI				₹			E: NEMA		MAINS (A): 100	
		ATION BLDG.					MOUNTING: SURFACE VOLTAGE: 120/240V				WIRING: 1 PH., 3 WIRE AIC: 10,000		
FED FRO	M: SERVICE	DISC SWITCH											
BKR SIZE	NOTES	DESCRIPTION	DEMAND CODE		CKT NO.	PHASE A	LOADS PHASE B	CKT NO.	LOAD (VA)	DEMAND CODE	DESCRIPTION	NOTES	BKR SIZE
30A/2P		UNIT HEATER		2000	1	4000		2	2000		UNIT HEATER		30A/2P
-990.02		930-1953151		2000	3		4000	4	2000				QUITALC:
20A/2P		BOOSTER PUMP		588	5	1452		6	864		CHLORINE PUMP		20A/1P
EUA/EI		DOCUMENT		588	7		838	8	250		VALVE CONTROL		20A/1F
20A/1P		LIGHTS/EXHAUST		320	9	520		10	200		CHLORINE PANEL		20A/1F
20A/1P		HEAT TRACE		100	11		200	12	100		FLOW METER		20A/1F
20A/1P		PLC PANEL		500	13	600		14	100		CHLORINE SCALE		20A/1F
20A/1P		RECEPTACLES		500	15		600	16	100		CHLORIN DET.		20A/1F
20A/1P		CATHODIC PROT		100	17	460		18	360		RECEPTA CLES		20A/1F
20A/1P		SPARE			19		100	20	100		CATHODIC PROT.		20A/1F
		SPACE			21			22			SPARE		20A/1F
		SPACE			23			24			SPARE		20A/1F
		SPACE			25			26			SPARE		20A/1F
		SPACE			27			28			TVSS		30A
		SPACE			29			30			TVSS		2P
	KVA	AMPS	PH	ASE TO	TALS:	VA	AMPS	NOT	ES:				
SECT. 1	12.8	53.2		PHA	ASEA:	7032	58.6	1.) NI	EUTRA	L BAR, GR	OUND BAR		
				PH	ASE B	5738	47.8	2.) D	OOR-IN	DOOR TR	IM, 30 TOTAL PO	DLES	
TOTAL	12.8	53.2											

	LIGHT FIXTURE SCHEDULE		
TYPE	FIXTURE DESCRIPTION	LAMPS	MOUNTING
А	INDUSTRIAL VAPOR TIGHT LED FIXTURE, UL LISTED FOR WET LOCATIONS. METALUX #4VT2-LD4-4-DR-UNV-L835-CD1-WL-SSL-VT2-CHAIN/SET-U	LED 4000 LUMENS	MOUNT AT 8'-0" A.F.F.
В	WALL PACK - LED, DARK SKY COMPLIANT WITH PHOTOCELL LUMARK #LDWP-FC-4B-120V-PE-WG/WPFC	LED 32W	MOUNT AT 8'-0" TO TOP OF FIXTURE

KEYED NOTES

- PROVIDE AND INSTALL A SINGLE THROW, DOUBLE POLE LIGHTING SWITCH, 120 VC SWITCH SHALL CONTROL THE LIGHTING FIXTURE AND EXHAUST FAN, REFER TO CONTROL DIAGRAM FOR ADDITIONAL REQUIREMENTS. INSTALL A NEMA 4X POLYESTER RATED COVER.
- PROVIDE AND INSTALL 4 KW 240 VOLT, SINGLE PHASE ELECTRIC WALL MOUNTED HEATER WITH INTEGRAL THERMOSTAT. AS MANUFACTURED BY CHROMALOX #HVH-04-21-00-TL-D-00-0-S-HWW-1. FAN SHALL BE RATED FOR EXTERIOR USE.
- PROVIDE AND INSTALL A THROUGH WALL EXHAUST FAN 430 CFM. 1/4 HP. 1/20 VOL WITH BACKDRAFT DAMPER. EXHAUST FAN SHALL BE INTERLOCKED WITH DOOR CONTACT, LIGHT SWITCH, AND THERMOSTAT. REFER TO CONTROL DIAGRAM ON SHEET E202 FOR ADDITIONAL REQUIREMENTS. MOTOR ENCLOSURE AND WIRING COMPONENTS SHALL BE RATED FOR EXTERIOR USE. MOUNTED AT 18"24T.
- PROVIDE AND INSTALL A COMBINATION STARTER/NON FUSED DISCONNECT SWITCH 30 AMPS, 2 POLE, NEMA 4X POLYESTER ENCLOSURE, NEMA SIZE 0, H-A SELECTOR SWITCH. THE CHLORINE PUMP STARTER SHALL BE AUTO CONTROLLED FROM THE VC-22D SYSTEM.
- 5. CHLORINE FEED BOOSTER PUMP, 1/3 HP, 120 VOLTS. CONTROLLED FROM THE CHLORINATION SYSTEM. EXTEND CONTROL CONDUCTORS AS REQUIRED BETWEEN THE STARTER AND CHLORINATION SYSTEM
- PROVIDE AND INSTALL A 120 VOLT THERMOSTAT FOR THE CONTROL OF EXHAUST FAN. REFER TO CONTROL DIAGRAM ON SHEET E202 FOR ADDITIONAL REQUIREMENTS.
- 7. EXTEND CONDUIT AND CONDUCTORS FROM THE EXHAUST FAN STARTER TO THE DOOR SWITCH, REFER TO CONTROL DIAGRAM, SHEET E202 FOR ADDITIONAL INFORMATION.
- 8. CHLORINE GAS ALARM STROBE LIGHT, HEAVY-DUTY, RED IMPACT RESISTANT LENS, 120 VAC, NEMA 4 X ENCLOSURE, WALL BRACKET. ALARM STROBE SHALL BE VISIBLE FROM VIEW WINDOW IN CHLORINE ROOM DOOR. THE CHLORINE GAS DETECTOR SHALL ACTIVATE THE STROBE AT THE GAS ALARM SET POINT. PROVIDE AN INTERPOSING RELAY ON CHLORINE GAS DETECTOR ALARM OUTPUT. EXTEND POWER TO INTERPOSING RELAY AND STROBE FROM CHLORINE GAS DETECTOR AT 120 VAC. PROVIDE WITH CHLORINE SYSTEM. EXTEND CONDUIT AND CONDUCTORS FROM STROBE LIGHT LOCATION TO CONTROL PANEL. TERMINATE PER EQUIPMENT MANUFACTURER'S RECOMMENDATION. STROBE BEACON # 105STR-H5-120V-60HZ.
- 9. CHLORINE GAS DETECTOR, SIEMANS, WITH INTEGRAL ALARM HORN AND LED INDICATORS, SENSOR AUTO TEST FEATURE, AND BATTERY BACKUP, NEMA 4X ENLOSURE. MOUNT GAS DETECTOR/RECEIVER TO WALL AT 6' AFF TO TOP OF PANEL MOUNT GAS SENSOR/TRANSMITTER 6' AFF ADJACENT TO CHLORINE GAS CYLINDERS, AND WIRE TO DETECTOR/RECEIVER WITH MANUFACTURER PROVIDED SENSOR CABLE. PROVIDE INTERLOCK WITH THE ALARM STROBE TO ACTIVATE ON GAS ALARM. PROVIDE WARNING ALARM AND SENSOR TROUBLE SIGNAL TO PLC. REFER TO SHEET E103 TERMINATE PER EQUIPMENT MANUFACTURER'S RECOMMENDATION.
- 10. NON-PROPORTIONAL CHLORINE GAS FLOW CONTROL PANEL. PROVIDE AND IN NEMA 4X, HINGED ENCLOSURE. PROVIDE CONDUIT AND FIELD WIRING TO MOTOR CONTROLLER ACTUATOR. COORDINATE FINAL LOCATION OF EQUIPMENT GENERAL CONTRACTOR PRIOR TO EXTENDING CIRCUITING AND CONTROL CIRCUITS. CONTRACTORS TO SEAL CONDUIT PENETRATIONS.
- CHLORINE TANK SCALE, WITH DIGITAL DISPLAY, NEMA 4X ENCLOSURE. TERMINATE POWER CIRCUIT TO EQUIPMENT PER MANUFACTURER'S RECOMMENDATION. FORCE FLOW MODEL GR150-2 WITH FORCE FLOW SOLO G2 DIGITAL INDICATOR.
- 12. NEW PANEL "A5". REFER TO POWER RISER DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 13. NEW METER MOUNT AT POLE. REFER TO POWER RISER DIAGRAM FOR ADDITIONAL
- 14. EXTEND UNDERGROUND SERVICE FROM THE SERVICE DISCONNECT SWITCH TO THE METER AT POLE. REFER TO POWER RISER DIAGRAM AND SITE PLAN FOR ADDITIONAL REQUIREMENTS
- 15. VALVE ACTUATION BOOSTER PUMP, 1/2 HP, 240 VOLT SINGLE PHASE. PUMP CONTROLLED BY INTEGRAL PRESSURE SWITCH. MOTOR ENCLOSURE AND WIRING COMPONENTS SHALL BE RATED FOR EXTERIOR USE.
- 16. FLOW METER. HOMERUN TO CIRCUIT INDICATED. REFER TO CONTROL FLOOR PLAN FOR ADDITIONAL REQUIREMENTS. ELSTER EVO Q4 WITH INTEGRAL TRANSMITTER INSTALL WITH FLOW IN PROPER DIRECTION AS INDICATED.
- 17. FLOW CONTROL VALVE CONTROLLER CLA-VAL VC-22D. THE CONTRACTOR SHALL COORDINATE THE INSTALLATION OF EQUIPMENT WITH THE GENERAL CONTRACTOR PRIOR TO THE EXTENSION OF GIRCUIT AND CONTROLS. TERMINATE POWER AND CONTROL CABLING TO CONTROLLER PER EQUIPMENT MANUFACTURERS RECOMMENDATION. PROVIDE AND INSTALL MANUFACTURER'S NEMA 4X HINGED COVER ENCLOSURE
- 18. PLC/RTU CABINET, NEMA 4X ENCLOSURE. THE CONTRACTOR SHALL COORDINATE THE INSTALLATION OF EQUIPMENT WITH THE GENERAL PRIOR TO THE EXTENSION OF CIRCUIT AND CONTROLS. TERMINATE POWER AND CONTROL CABLING TO CONTROLLER PER EQUIPMENT MANUFACTURER'S RECOMMENDATION. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- 19. DOOR LIMIT SWITCH WITH ADJUSTABLE LEVER ARM AS MANUFACTURED BY SQUARE D #9007C62B2, ARM #HA1. REFER TO CONTROL DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 20. THE CONTRACTOR SHALL PROVIDE AND INSTALL A SIGN SHOWING: "WARNING: FLASHING LIGHT INDICATES TOXIC CHLORINE GAS RELEASE. DO NOT ENTER WITHOUT SCBA GEAR". SIGN SHALL BE RED IN COLOR WITH WHITE 1" LETTERING, MOUNTED BELOW WINDOW.
- 21. REFER TO POWER RISER ON SHEET E201 FOR TVSS REQUIREMENTS.
- PROVIDE AND INSTALL A BUILDING MOUNTED SERVICE DISCONNECT SWITCH. REFER TO POWER RISER ON SHEET E201 FOR ADDITIONAL REQUIREMENTS.
- 23. ALL EXPOSED CONDUIT RUNS WITHIN THE CHLORINATION CHEMICAL SIDE OF THE BUILDING SHALL BE PVC CONDUIT. ALL HANGERS AND FITTINGS SHALL BE PVC COATED. CONDUITS THAT EXITTHE CHEMICAL SIDE OF THE BUILDING SHALL BE PROVIDED WITH A SEAL OFF FITTING AFTER EXITING. ALL EQUIPMENT AND MOTOR ENCLOSURE SHALL BE RATED FOR USE WITHIN A CORROSIVE AGENTS AND WET LOCATION.
- 24. ALL EXPOSED CONDUIT INSTALLED WITHIN THE CONTROL ROOM SIDE OF THE CHLORINATION BUILDING SHALL BE RIGID STEEL CONDUIT WITH THREADED CONDUIT BODIES. ALL EQUIPMENT ENCLOSURES AND CONDUIT INSTALLATION SHALL BE RATED FOR WET LOCATION.

TCH. OR HE	i G	D OLTS,	VOLT.	
Revision	Date	Description	By	Chk'd
15024 E102 Re	each 26.3 - Chlori	15024 E102 Reach 26.3 - Chlorination Building - Electrical Plans.dwg	Bwg	

SOUDER, MILLER & ASSOCIATES
5454 VENICE AVENUE NE, SUITE D
ALBUQUERQUE, NM 87113
ne (505) 299-40942 Toll-Prec (877) 299-40942 Fax (505) 293-3450
www.soudemiller, commisse
Serving the Southweek & Rocky Mountains
Serving the Southweek & Rocky Mountains
surgage, Carlsbeak, Hobbe, Durminghout, Les Chroce, Roward, Stem Fe, Nh.



INATION BUILDING IL PLANS MATER SUPPLY EACH 26.3

NEACH 20.3 - CHECTRICAL PLAN
NAVAJO GALLUP WATER
PROJECT - REACH
ANDOVAL & MCKINLEY COUNTIES

ed Drawn Checked



5024

OSA

HIS DRAWING IS INCOMPLETE
AND NOT TO BE USED FOR
ONSTRUCTION UNLESS IT IS
TAMPED, SIGNED AND DATED

AOTICE OF EXTENDED
PAYMENT PROVISION:
HIS CONTRACT ALLOWS THE
WHER TO MAKE PAYMENT
WITHIN 45 DAYS AFTER
SUBMISSION OF
AN UNDISPUTED REQUEST




ate: March 14, 2018

cale: Horiz: N/A Vert: N/A roject No: 6921307

E102

Copyright 2018 Souder, Miller & Associates - All Rights Reserved

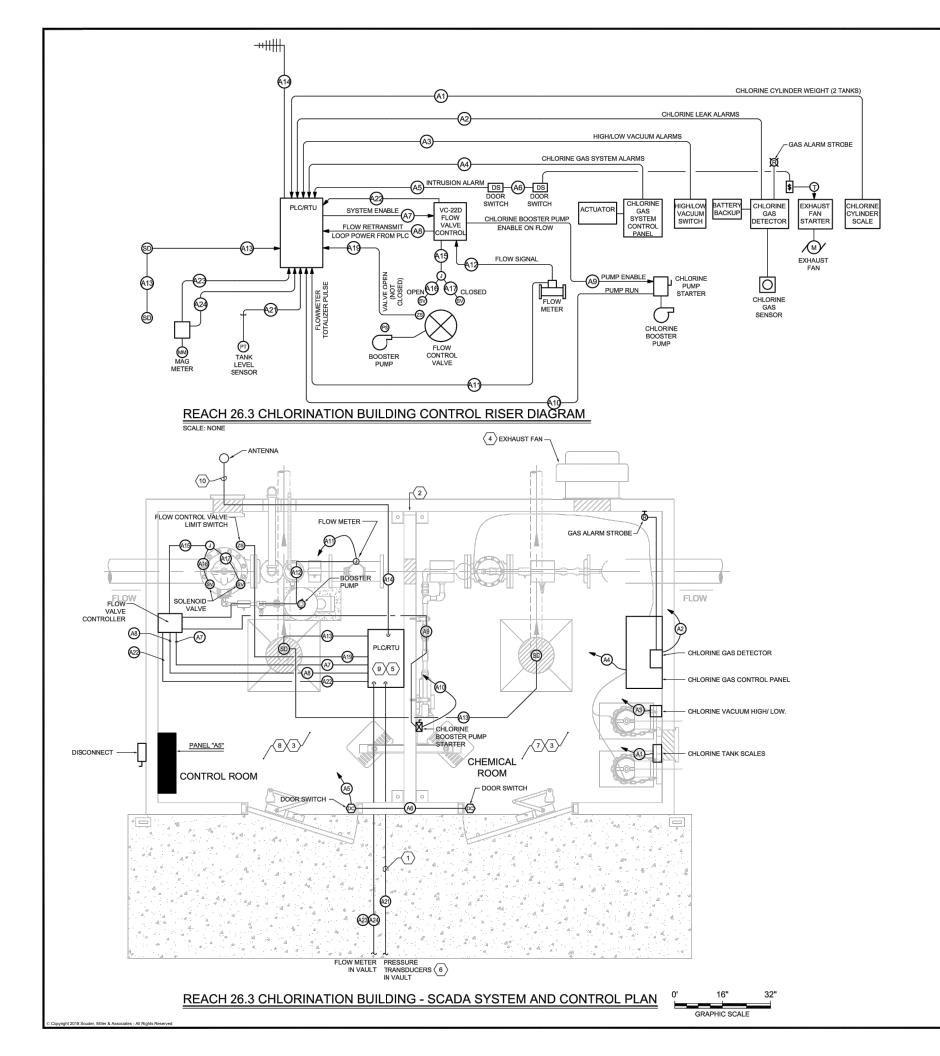

KEYED NOTES ○

- 1. REFER TO SITE PLAN ON E101 FOR LOCATION OF PRESSURE TRANSDUCER.
- 2. PROVIDE (2) 1/4" CONDUIT SLEEVES THROUGH WALL WITH J-BOXES ON EACH SIDE OF WALL AND FIRE SEAL GAS TIGHT. ALL CONTROL CABLES AND WIRING BETWEEN ROOMS SHALL BE ROUTED THROUGH SLEEVES. ONE CONDUIT FOR ANALOG CABLES THE OTHER FOR DIGITAL CABLES. SIZE J-BOXES PER NUMBER OF CONDUITS
- 3. PROVIDE AND INSTALL CONDUIT AND CABLING BETWEEN EQUIPMENT AS CALLED OUT PROVIDE AND INSTALL CONDITI AND CABILITIES BETWEEN EQUIPMENT AS CALLED ON THIS IN THE CONTROL MIRING SCHEDULE AND CONTROL RISER LOCATED ON THIS SHEET. COORDINATE TERMINATION OF CABLE PER THE EQUIPMENT SUPPLIER AND REQUIREMENTS IN THE TECHNICAL SPECIFICATIONS.
- 4. REFER TO CONTROL DIAGRAM ON SHEET E-202 FOR EXHAUST FAN AND DETECTION SYSTEM CONTROLS.
- PLC CONFIGURED TO OWNERS STANDARDS AND REQUIREMENTS, REFER TO SHEET E-301 THRU E-303 AND SPECIFICATIONS.
- TANK LEVEL PRESSURE TRANSDUCER, AMETEK MODEL 88C 003-A-2-RANGE 0-30PSI ANALOG PRESSURE TRANSDUCER, INSTALLED IN NEW VAULT. REFER TO VAULT DETAIL ON SHEET E-201 FOR ADDITIONAL REQUIREMENTS.
- 7. ALL EXPOSED CONDUIT RUNS WITHIN THE CHLORINATION CHEMICAL SIDE OF THE ALL EXPOSED CONDUIT RUNS WITHIN THE CHLORINATION CHEMICAL SIDE OF THE BUILDING SHALL BE PVC CONDUIT. ALL HANGERS AND FITTINGS SHALL BE PVC COATED. CONDUITS THAT EXIT THE CHEMICAL SIDE OF THE BUILDING SHALL BE PROVIDED WITH A SEAL OFF FITTING AFTER EXITING. ALL EQUIPMENT AND MOTOR ENCLOSURE SHALL BE RATED FOR USE WITHIN A CORROSIVE ENVIRONMENT AND WET LOCATION.
- 8. ALL EXPOSED CONDUIT INSTALLED WITHIN THE CONTROL ROOM SIDE OF THE ALL EAPOSED CONDUIT INSTALLED WITHIN THE CONTROL ROOM SIDE OF THE CONCORDING THE CONTROL ROOM SIDE OF THE CONDUIT WITH THREADED CONDUIT BODIES, ALL EQUIPMENT ENCLOSURES AND CONDUIT INSTALLATION SHALL BE RATED FOR WET LOCATION.
- 9. THE PLC / RTU CABINET WILL BE PROVIDED WITH UNLICENSED RADIO TYPE TRANSNET AS MANUFACTURED BY GE, WHICH WILL TRANSMIT AND RECEIVE SIGNALS FROM COUNSELOR SITE.
- 10. PROVIDE AND INSTALL LIGHTNING ARRESTORS ON THE ANTENNA CABLES IN THE PLC / RTU CABINET FOR THE CONNECTION OF THE CABLES BETWEEN THE ANTENNA AND RADIOS. PROVIDE AND INSTALL DATA AND SIGNAL LINE PROTECTION BETWEEN THE PRESSURE TRANSDUCER AND THE PLC CONNECTION. LINE PROTECTOR AS MANUFACTURED BY JOSLYN #1820-28-A3 ON EACH LINE.

			Wiring Schedule			
TAG#	FED FROM	то	WIRE REQUIRMENTS			
A1	Chlorine Scale	PLC Panel	2-2/C #18 Twisted Pair Shielded Cable - 1/2" Conduit			
A2	Chlorine Gas Detector	PLC Panel	6 # 14, 1 # 14 Gnd - 1/2" Conduit			
АЗ	High/Low Vacuum Switch	PLC Panel	6 # 14, 1 # 14 Gnd - 1/2" Conduit			
A4	Chlorine Gas Control Panel	PLC Panel	4 # 14, 1 # 14 Gnd - 1/2" Conduit			
A5	Door Switch	PLC Panel	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A6	Door Switch	Door Switch	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A7	PLC Panel	Flow Valve Control	2-2/C #18 Twisted Pair Shielded Cable - 1/2" Conduit			
A8	Flow Valve Control	PLC Panel	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A9	Flow Valve Control	Chlorine Booster Pump Starter	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A10	Chlorine Booster Pump Starter	PLC Panel	2 # 14, 1 # 14 Gnd - 1/2" Conduît			
A11	Flow Meter	PLC Panel	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A12	Flow Meter	Flow Valve Control	2-2/C #18 Twisted Pair Shielded Cable - 1/2" Conduit			
A13	Smoke Detectors	PLC	2 #14, 1 #14 Gnd - 1/2" Conduit			
A14	Radio Transmitter Unit (RTU)	YAGI Antenna	1" Conduits each with Cable - Refer to Specification 27 43 30 2.4.C2 for Cable Requirements			
A15	Flow Valve Control	Solenoid Valves J-box	3 # 14, 1 # 14 Gnd - 1/2" Conduit			
A16	Solenoid Valve J-box	Solenoid Valve Open	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A17	Solenoid Valve J-box	Solencid Valve Closed	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A18	not used	not used	not used			
A19	Flow Control Valve Limit Switch	PLC Panel	2 # 14, 1 # 14 Gnd - 1/2" Conduit			
A20	Switch		not used			
A21	Pressure Transducer	PLC Panel	1 - 2/C #16 Twisted Pair Shielded Cable - 1" Conduit.			
A22	Flow Rate Signal	PLC/RTU	1 - 2/C #18 Twisted Pair Shielded Cable - 1/2" Conduit.			
A23	Mag Meter Flow Rate	PLC/RTU	2/C #18 Twisted Pair Cable - 3/4" Conduit			
A24	Flow Alarms	PLC/RTU	5 # 14, 1 # 14 Gnd - 1/2" Conduit			



SOUDER, MILLER & ASSOCIATES 5454 VENICE AVENUE AVENUE AVENUE ALBUQUERQUE, NM 87113


ATION BUILDING CONTROL PLAN TER SUPPLY CH 26.3



Date: March 14, 2018

roject No: 6921307

E103



REACH 26.3 CHLORINATOR BUILDING POWER RISER DIAGRAM

LOAD SUMMARY - PANEL "A5"								
DESCRIPTION								
PANELBOARD "A5" ESTIMATED DEMAND PER NEC 220								
MECHANICAL UNITS (8.0 KVA CONN)	8.0	KVA						
RECEPTACLES (0.9 KVA CONN) FIRST 10 KVA AT 100% REMAINING AT 50%	0.9	KVA KVA						
LIGHTING (0.3 KVA CONN) AT 100%	0.3	KVA						
EQUIPMENT (3.6 KVA CONN) AT 100%	3.6	KVA						
TOTAL ESTIMATED LOAD:	12.8	KVA						
53 AMPERES AT 120Y/240V-1Ø-4W								
MINIMUM SERVICE CAPACITY =125% x TOTAL ESTIMATED LOAD	16.0	KVA						
66 AMPERES AT 120Y/240V-1Ø-4W								
MINIMUM RECOMMENDED SERVICE SIZE =	100	AMPS						

KEYED NOTES

- PROVIDE AND INSTALL A 25-0" SOUTHERN PINE CLASS 4 WOOD POLE FOR THE INSTALLATION OF RISER, METER AND DISCONNECT. LOCATE POLE TO PROVIDE A MINIMUM OF 3'-0" CLEARANCE BETWEEN FENCE AND FACE OF METER.
- 2. 4 # 8 1" CONDUIT BETWEEN TVSS AND PANEL.
- 3. PROVIDE A 2" RGS CONDUIT ON POLE RISER WITH CONDUCTORS, COORDINATE INSTALLATION WITH JEMEZ ELECTRIC PRIOR TO PROCEEDING WITH INSTALLATION OF CONDUITS
- PROVIDE AND INSTALL A 100 AMP 120/240 VOLT METER SOCKET PER THE LOCAL UTILITY COMPANY REQUIREMENT FACING FENCE.
- 5. 3 #2 CONDUCTORS IN 2" CONDUIT
- 6. REFER TO TYPICAL 120/240 VOLT GROUND DETAIL
- PROVIDE AND INSTALL A FUSIBLE DISCONNECT SWITCH, 100 AMPS, 250 VOLTS, 2
 POLE, SN AND GROUND LUG, NEMA 3R ENCLOSURE. FUSE AT 100 AMPS. PROVIDE A
 MINIMUM WORKING CLEARANCE OF 3'-0" WIDE IN FRONT OF DISCONNECT SWITCH
 PER DEC. PER NEC.
- 8. 3 # 2, 1 # 8 GROUND 1 1/4" CONDUIT

SEAL AROUND

FLOW METER VAULT DETAIL

CONDUIT PENETRATION

FLOW METER

NOT TO SCALE

9. PROVIDE AND INSTALL A TRANSIENT VOLTAGE SURGE SUPPRESSION DEVICE. THE TVSS SHALL BE MANUFACTURED BY RAYCAP #120-2S-M3-3-06-A-H OR APPROVED EQUAL, NEMA 3R ENCLOSURE.

-EXTEND CABLE BETWEEN

J-BOX AND FLOW METER IN WATERTIGHT FLEXIBLE CONDUIT

GROUND ROD

	Revision	Date	Description	By	유
ES					
3-3430					
Pe, NM	15024 E201 R	each 26.3 - Electr	1 Fc, NM 15024 E201 Reach 26.3 - Electrical Schedules and Details.dwg		
IX.	4/5/2018 8:14	4/5/2018 B:14:35 AM TRuehle			

SOUDER, MILLER & ASSOCIA 5454 VENICE AVENUE IN, SUITE D ALBUQUERQUE, NM 87113

SCHEDULES AND TAILS
P WATER SUPPLY
- REACH 26.3

26.3 - ELECT GALLI NAVAJO (PRC




ONSTRUCTION UNLESS IT

Call befo you dig.

E201

Date: March 14, 2018

Project No: 6921307

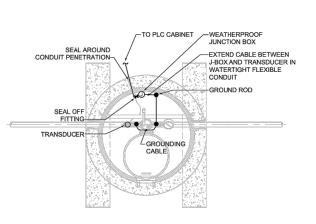

NOT TO SCALE

PRESSURE TRANSDUCER VAULT DETAIL

Site Name

Intrusion Alarm Control Room

Intrusion Alarm Chlorine Room

Smoke Detector

Flow Valve Open

Flow Enable

Distribution Tank Level

Low Temperature Alarm

Chlorine Leak Warning

Chlorine Leak Alarm

Chlorine Detector Fault

Chlorine High Vacuum Alarm

Chlorine Low Vacuum Alarm

Chlorination System Alarm

Chlorine Booster Pump Running

Manual Flow Control Valve Override

Chlorinator Flow Meter Low Battery

Chlorinator Flow Meter Totalizer Pulse

Chlorinator Pulse Modular Low Battery

Chlorinator Flow Meter Tamper Alarm

Chlorinator Flow Meter (Totalizer Pulses)

Vault Flow Meter Totalizer Pulse

Vault Flow Meter Low Battery Vault Pulse Modular Low Battery

Vault Flow Meter Tamper Alarm

Vault Flow Meter (Totalizer Pulses)

Chlorinator Flow Meter (Flow Rate)

Vault Flow Meter (Flow Rate)

Chlorine Bottle #1 Weight

Chlorine Bottle #2 Weight

Reach 26.3 Chlorination

DISCRETE & ANALOG I/O LIST - REFER TO PLANS & SPECIFICATIONS FOR SEQUENCE OF OPERATIONS

114

116

118

120

AI2

AI3

AI4

Tag Point Type Local SCADA

Yes

SCADA override tank level function and close control valve


SCADA shows totalized volume of water (gallons)

nterpose Relay From Distribution Tank Level

Interpose Relay

SCADA shows flow rate (gpm)

SCADA shows flow rate (gpm)

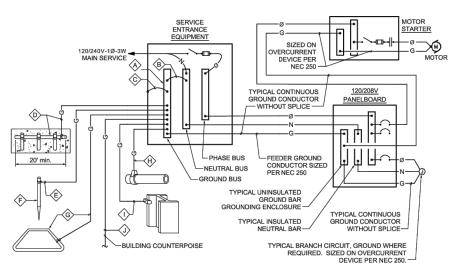


GROUNDING SYSTEM DIAGRAM - 120/240 VOLT SYSTEM

GROUNDING SYSTEM GENERAL NOTES

- A. THE GROUNDING ELECTRODE SYSTEM SHALL CONSIST OF ITEMS A B C D E F AND G, WHERE APPLICABLE.
- B. ITEMS (H) (1) AND (1) MUST BE BONDED TOGETHER AND TO THE GROUNDING ELECTRODE SYSTEM WHEN THEY ARE PRESENT.
- TIEM \(^0\) CONCRETE ENCASED ELECTRODE (UFER) SHALL HAVE UFER SUPPORT CONSISTING OF 5/8" x 10" COPPER GROUND ROD CUT INTO 2 SECTIONS AND DRIVEN FOR SUPPORT OF UFER CONDUCTOR. ONLY COPPER TO COPPER CONNECTIONS ARE ACCEPTABLE. DO NOT USE RE-BAR FOR UFER SUPPORT. (THIS IS TO AVOID THE HARMFUL EFFECTS OF DISSIMIL METALS IN CONTACT.) A U.L. LISTED COPPER TO RE-BAR CLAMP (SUCH AS GRAVES "JONES BOND" SYSTEM) IS AN APPROVED ALTERNATIVE.
- THIS DETAIL IS PROVIDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, ARTICLE 250, PERTAINING TO THE "GROUNDING ELECTRODE SYSTEM".
- E. ALL SPLICING SHALL BE ACCOMPLISHED VIA EXOTHERMIC WELD (CAD-WELD) ONLY.
- ALL CONDUCTOR SIZING INDICATED ON THE GROUNDING SCHEDULE ARE FOR COPPER CONDUCTORS. ALUMINUM IS NOT PERMITTED.
- ANY VARIANCES FROM THIS DIAGRAM AND ASSOCIATED SCHEDULE AND NOTES MUST BE REQUESTED AND APPROVED IN WRITING PRIOR TO
- ALL INSTALLATIONS SHALL COMPLY WITH THE LATEST ADOPTED EDITION OF N.E.C. ARTICLE 250 (ALL SUBPARAGRAPHS) AND ALL STATE AND LOCAL REQUIREMENTS.
- THE GROUNDING SYSTEM SHALL PROVIDE LESS THAN (4) FOUR OHMS RESISTANCE TO GROUND AT THE SERVICE CONNECTION. THE RESULTS SHALL BE VERIFIED BY AN INDEPENDENT TESTING AGENCY VIA GROUND TEST (FALL-OF-POTENTIAL) AND SUBMITTED TO ELECTRICAL ENGINEER UPON COMPLETION OF PROJECT.


				ROUND	ING SCH	<u>IEDULE</u>				
	(A)	⟨B⟩	©	(b)	(E)	(F)	©	(H)	\Diamond	⟨₃⟩
	FACTORY INSTALLED GROUND BUS BAR	INTEGRATED BUS BAR MAIN BOND JUMPER	INTEGRATED BUS BAR CASE BOND JUMPER	CONCRETE ENCASED ELECTRODE (UFER)	GROUNDING ELECTRODE CONDUCTOR TO ROD, PIPE OR PLATE	CU or CU-CLAD STEEL GROUND ROD	COPPER GROUND RING CONDUCTOR	METALLIC PIPING BONDING CONDUCTOR	BUILDING STEEL BONDING CONDUCTOR	BUILDING COUNTER POISE
AND ACITY CE		N.E.C. 250.102	N.E.C. 250.102	N.E.C. 250.50(c) 250.66(b)	N.E.C. 250.52(c) 250.52(d) 250.66(a)	N.E.C. 250.52(c)(2)	N.E.C. 250.50(d) 250.66(c)	N.E.C. 250.50(a) 250.66	N.E.C. 250.50(b) 250.66	N.E.C. 250.66
100 AMP	. 98	#4	#4	#4	#6	5/8"x8'	#2	#4	#4	#2/0
225 AMP	ATIO	#2	#2	#4	#6	5/8"x8'	#2	#2	#2	#2
	SHALL BE SIZED TO ACCOMMODATE ALL GROUND WIRE LUGS AS INDICATED ON GROUNDING DIAGRAM AND/OR REFERENCED ELSEWHERE ON PLANS OR SPECIFICATIONS									



CHLORINATOR BUILDING EXHAUST FAN CONTROL DIAGRAM

CHLORINATION ROOM EXHAUST FAN OPERATES AS FOLLOWS: WITH THE STARTER SWITCH IN AUTO:

- 1. THE FAN WILL TURN ON WHEN THE DOOR IS OPEN VIA THE DOOR
- 2. WITH THE DOOR CLOSED THE FAN WILL TURN ON WHEN THE
- LIGHTING SWITCH IS SWITCHED ON.
 3. WITH THE DOOR CLOSED THE FAN WILL TURN ON BY THERMOSTAT.



SOUDER, MILLER & ASSOCIATES 5454 VENICE AVENUE AVENUE AVENUE OF ALBUQUERQUE, NM 87113

DIAGRAMS AND

R SUPPLY 126.3 S. NEW MEXIC


FAILS WATER S REACH 20



Date: March 14, 2018

Project No: 6921307


E202

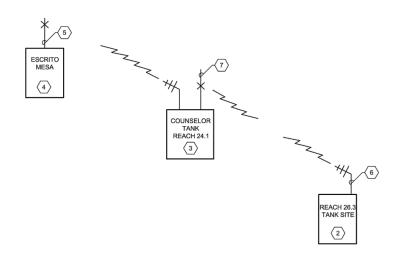

SCADA RADIO TELEMETRY SYSTEM CONFIGURATION


12" MIN. FINISHED GRADE -12" MIN 6" MIN. RED CONCRETE ENCASEMENT ALL SIDES

TYPICAL PRIMARY CONDUIT TRENCH DETAIL




TYPICAL SINGLE CONDUIT TRENCH DETAIL

SCALE: NONE



TYPICAL MULTIPLE CONDUIT TRENCH DETAIL

SCALE: NONE

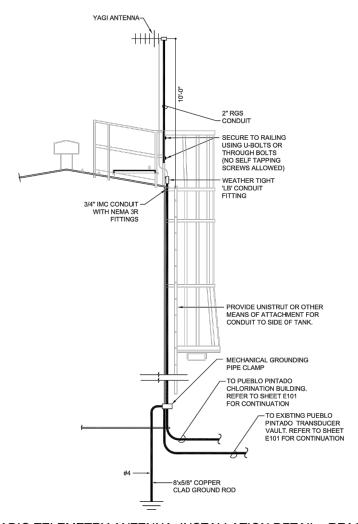

KEYED NOTES

4. EXISTING ESCRITO MESA SITE EXISTING ANTENNA.

7. EXISTING OMNI ANTENNA.

1. REFER TO GENERAL NOTES ON SHEET E001 FOR BACKFILL REQUIREMENTS NEW UNLICENSED GE MDS TRANSNET 900 MHz RADIO LINK. REFER TO SPECIFICATION SECTION 27 43 30 FOR ADDITIONAL REQUIREMENTS. 3. EXISTING UNLICENSED GE MDS TRANSNET 900 MHz RADIO LINK. REPROGRAM EXISTING SCADA PLC TO COMMUNICATE WITH NEW RTU.

6. NEW YAGI ANTENNA. REFER TO SPECIFICATION SECTION 27 43 30 FOR ADDITIONAL REQUIREMENTS.

TYPICAL TANK RADIO TELEMETRY ANTENNA INSTALLATION DETAIL - REACH 26.3


SOUDER, MILLER & ASSOCIATES 5454 VENICE AVENUE NE, SUITE D ALBUQUERQUE, NM 87113

NAVAJO GALLUP WATER SUPPLY PROJECT - REACH 26.3 NDOVAL & MCKINLEY COUNTIES, NEW MEXI REACH 26.3 - ELECTRICAL DETAILS



Date: March 14, 2018

Project No: 6921307 E203

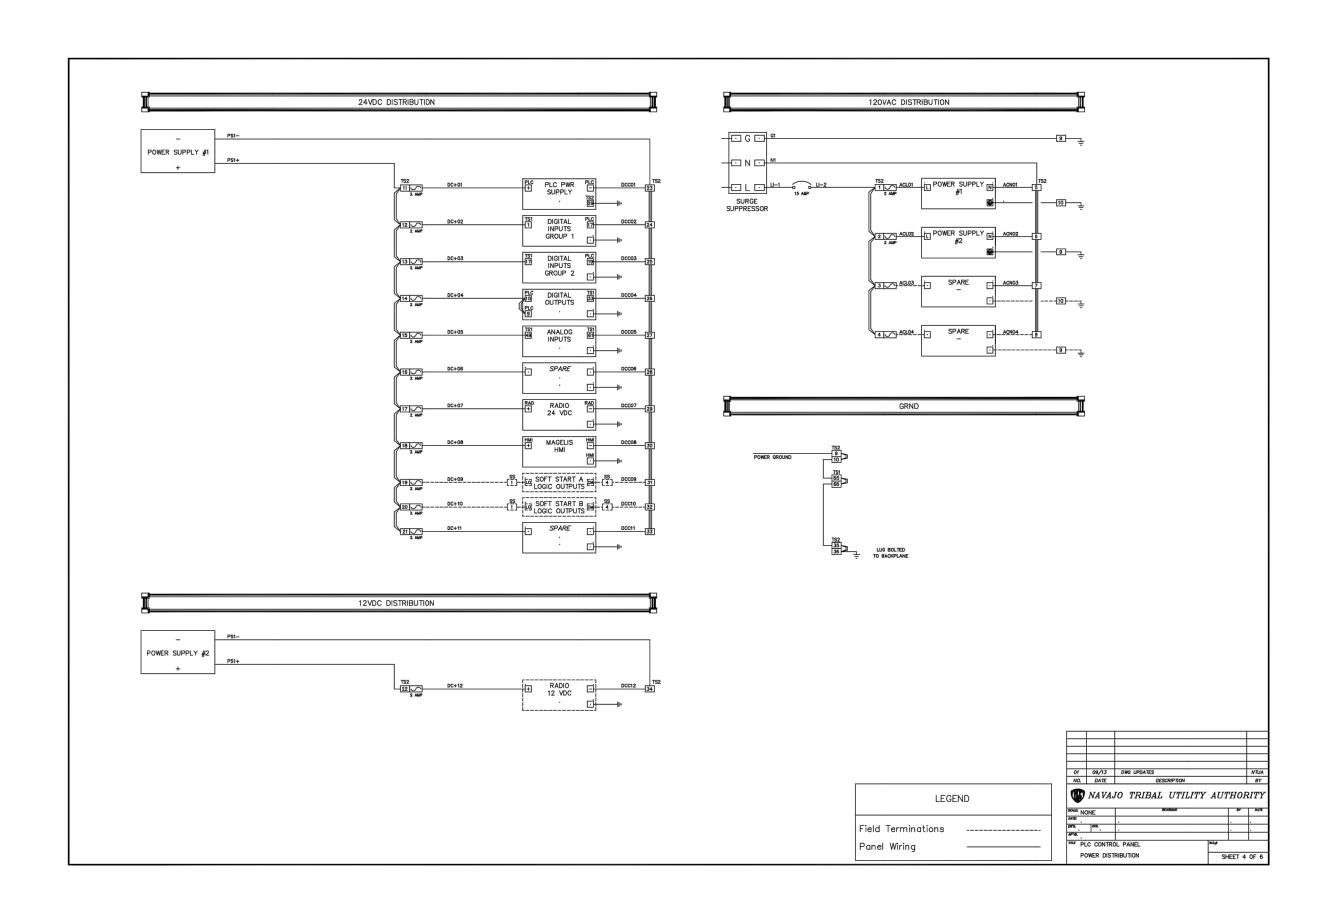

SOUDER, MILLER & ASSOCIATES 5454 VENCE AVENCE AVENTED ALBUQUERQUE, NM 87113

NAVAJO GALLUP WATER SUPPLY PROJECT - REACH 26.3 ANDOVAL & MCKINLEY COUNTIES, NEW MEXICO REACH 26.3 - ELECTRICAL DETAILS




THIS DRAWING IS INCOMPLET AND NOT TO BE USED FOR CONSTRUCTION UNLESS IT IS STAMPED, SIGNED AND DATE



Date: March 14, 2018

Project No: 6921307 E301

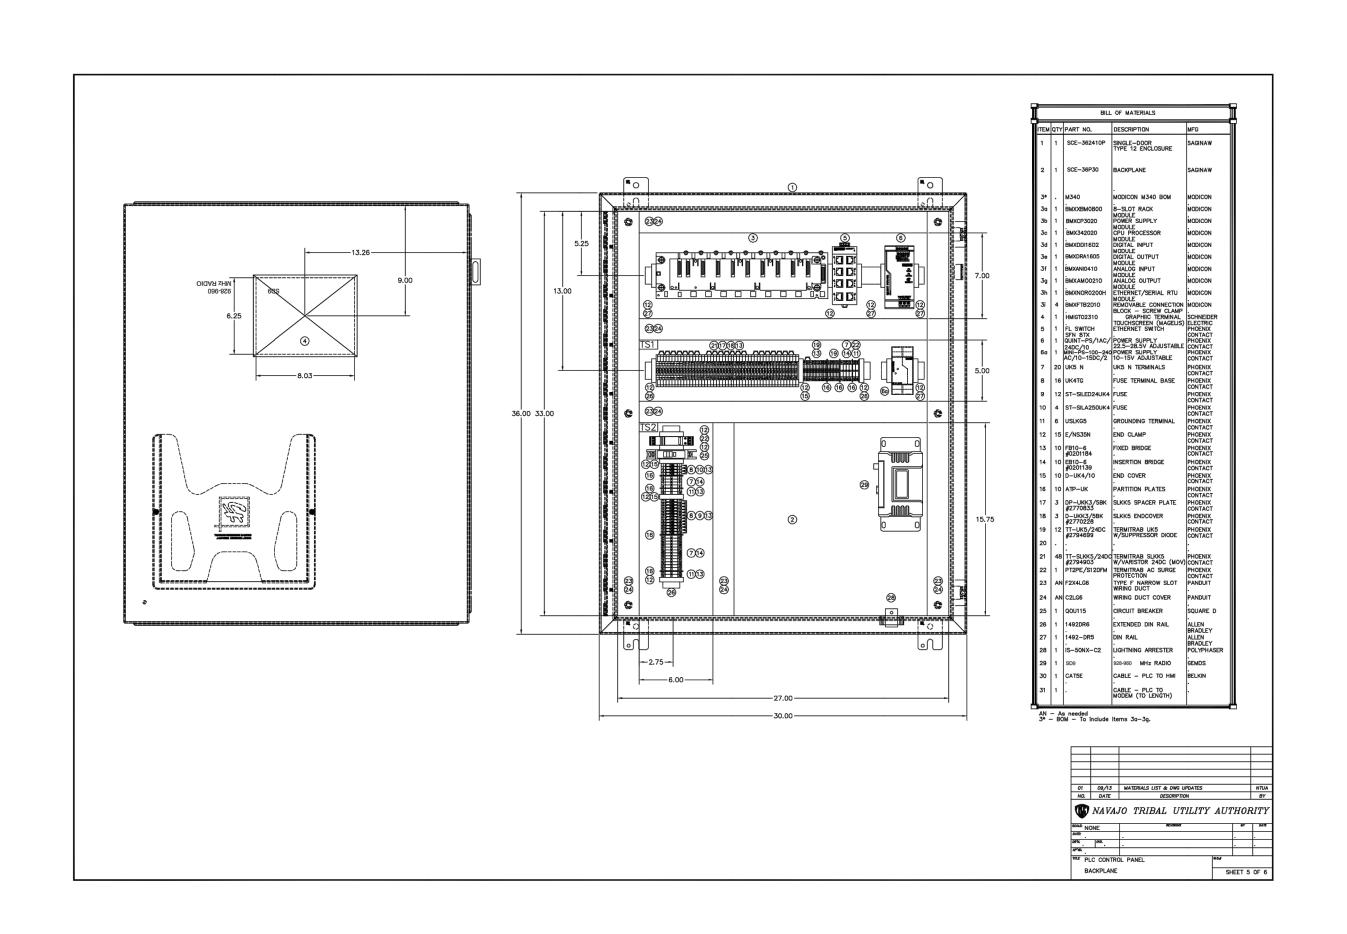


SOUDER, MILLER & ASSOCIATES 5454 VENUE AVENUE AVENUE NE SUITED ALBUQUERQUE, NM 87113

NAVAJO GALLUP WATER SUPPLY PROJECT - REACH 26.3 ANDOVAL & MCKINLEY COUNTIES, NEW MEXI REACH 26.3 - ELECTRICAL DETAILS

Know what's below.
Call before you do

Project No: 6921307 E302

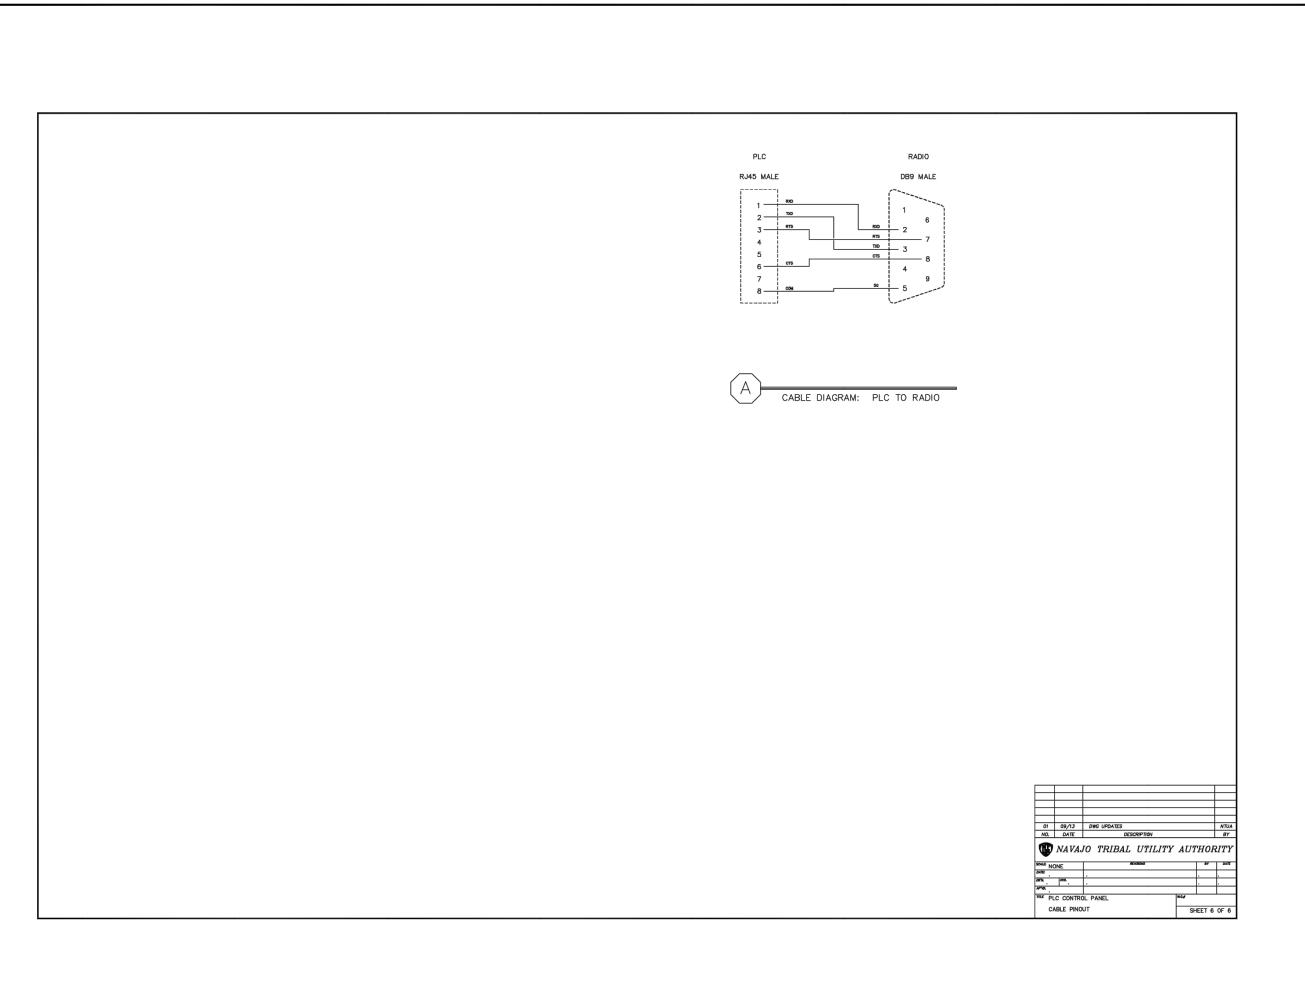



NAVAJO GALLUP WATER SUPPLY PROJECT - REACH 26.3 SANDOVAL & MCKINLEY COUNTIES, NEW MEXICO : The Navajo Nation TOWN: Reach 26.3 To 1
REACH 26.3 - ELECTRICAL DETAILS



Date: March 14, 2018

Scale: Horiz: N/A Vert: N/A Project No: 6921307

Sheet: E303