



CONTRACTOR SUBMITTAL FORM

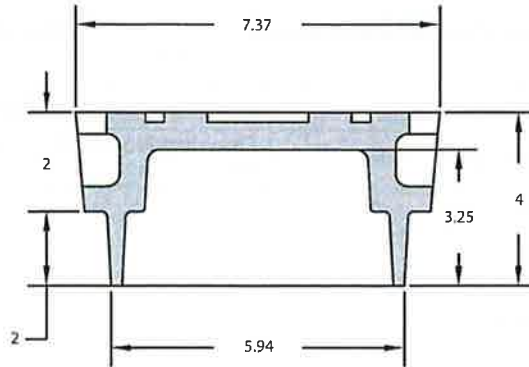
Project Name: Navajo Gallup Water Supply Project Reach 26.3	<input checked="" type="checkbox"/> M (Materials) <input type="checkbox"/> T (Testing) <input type="checkbox"/> A (Administrative)	Submittal No. M023
SMA Project No: 6921307		
Date: 08-08-2019		
Contractor: Navajo Engineering and Construction Authority		No. of Copies: 1

Supplier: Core & Main	Manufacturer: Star Pipe Products
Specification No.: 33 12 16 – 2.8, 2.8C, and 2.8F	Drawing No.: DT-6, DT-8
Bid Item No(s): 17, 18, 19, 20, 21, 22, 43	
Submittal Checklist No(s): M248	
Product Description: 664-A IMP SLIP VALVE BOX COMP 24 VLV BOX EXTENSION SLIP IMP 5-1/4" HD LOCKING LID MWWATER	
Are there any deviations from the Contract Documents? <input checked="" type="checkbox"/> No <input type="checkbox"/> Yes Explain:	
Contractor's certification that product meets requirements of Contract Documents: <input checked="" type="checkbox"/> Certified <input type="checkbox"/> Certified with variations as noted on shop drawings and/or attached sheets.	
Signed:  Quentin Benally, NECA	Date: 08-08-2019

Engineer's Comments: <input type="checkbox"/> No Exception Taken <input checked="" type="checkbox"/> Approved as Corrected <input checked="" type="checkbox"/> Exceptions as Noted <input type="checkbox"/> Submittal Rejected <input type="checkbox"/> Revise and Resubmit to Engineer <input type="checkbox"/> Contractor to Submit Specified Information - "Standard" valve boxes not approved all valve boxes shall be "heavy duty" - If NECA proposes to use standard duty, send in RFI	Review is limited to check for compliance with design concept. No changes from provisions of Contract Documents are intended and Contractor remains responsible for compliance with revisions therein. The Contractor is solely responsible for quantities; correctness of dimensions; verification of physical interrelation of elements of the work as required by the drawings and specifications and by field determination; fabrication procedures, construction methods, techniques and sequences. This review does not relieve the Contractor from these responsibilities. Non-conformities and errors detected have been noted but such markings, or lack thereof, shall not relieve the Contractor from compliance with all requirements of the contract drawings and specifications.
Signed: 	Date: 8/19/19

5 1/4" WATER LID HEAVY DUTY W/ 2" SKIRT

VB-0016



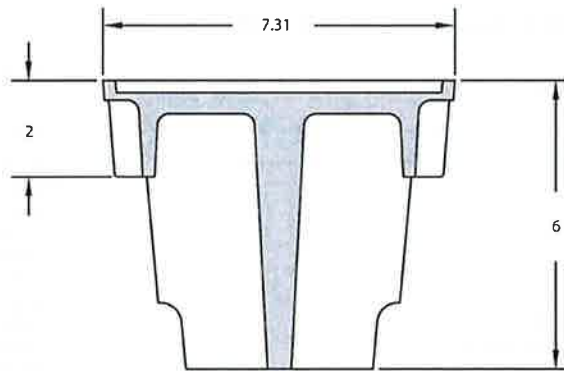
ITEM CODE	APPROX WT. (LBS.)
VBLIDHD2	14

Notes:

- Material - Cast Iron
- Per ASTM A48 Class 30B
- Dimensions in Inches

5 1/4" WATER LID HEAVY DUTY W/ 4" VANES

VB-0017



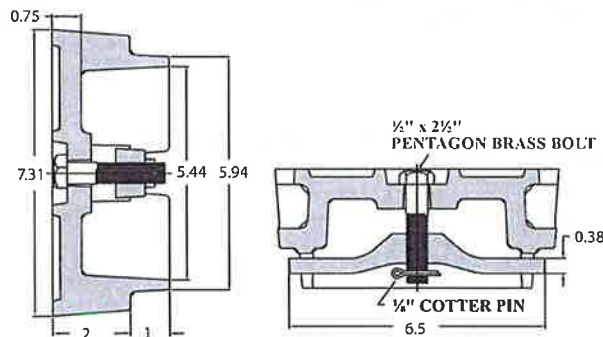
ITEM CODE	APPROX WT. (LBS.)
VBLIDL4V	16.5

Notes:

- Material - Cast Iron
- Per ASTM A48 Class 30B
- Dimensions in Inches

LOCKING LID

VB-0018



ITEM CODE	DETAILS	APPROX WT. (LBS.)
VBLIDLOCKS	SEWER	14.5
VBLIDLOCK	WATER	14.5

Notes:

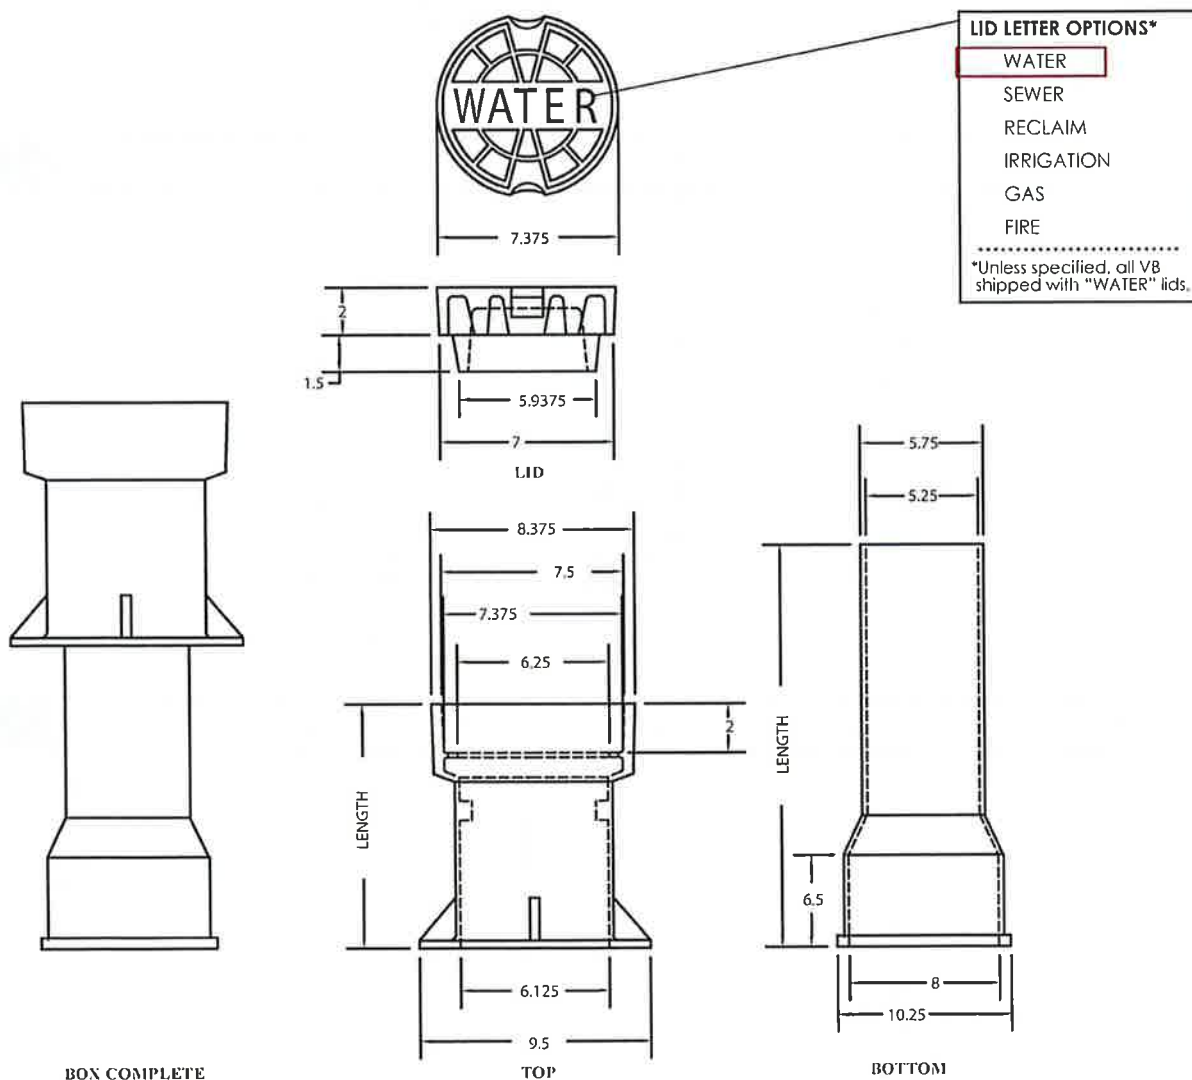
- Material - Cast Iron
- Per ASTM A48 Class 30B
- Dimensions in Inches



2 PIECE STANDARD SLIP TYPE VALVE BOX
VB-0003

ITEM CODE	HEIGHT	APPROX. WT. (LBS)	LENGTH	
			TOP	BOT.
VB461A	20-25	47	10	15
VB462A	29-33	55	10	24
VB562A	29-38	65	16	24
VB564A	41-51	80	16	36
VB664A	41-61	105	26	36
♦VB666A	53-73	125	26	48

♦ - Optional bottom (48" one piece or 24" bottom w/ 24" extension) - Please indicate your preference

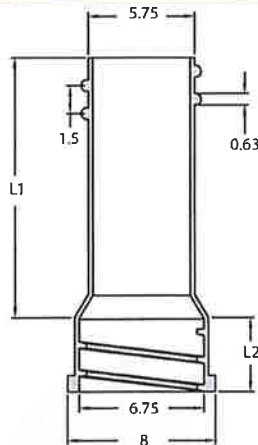
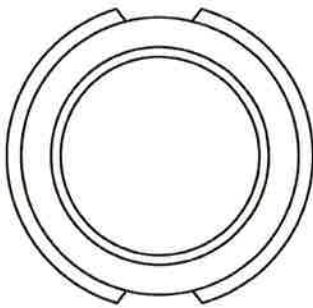

Notes:

- Material - Cast Iron Per ASTM A48 Class 30B
- Dimensions in Inches



© REGISTERED TRADEMARK OF STAR PIPE PRODUCTS

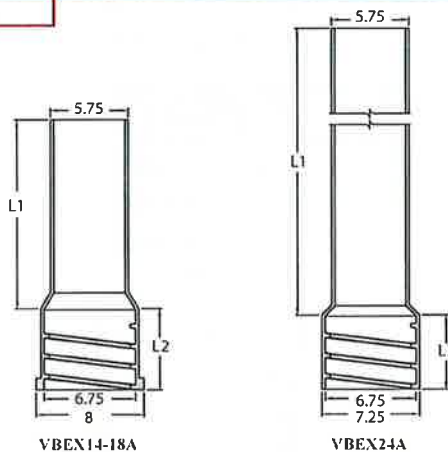
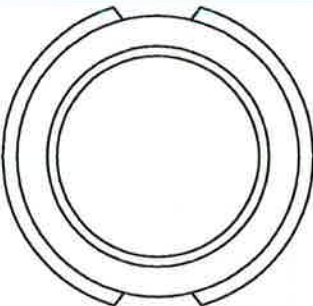
STAR® PIPE PRODUCTS
HOUSTON CORPORATE | TOLL FREE 1-800-939-3009 | FAX 281-558-7000
www.starpipeproducts.com

SCREW TYPE VALVE BOX EXTENSION
VB-0011


ITEM CODE	DETAILS (L1)	DETAILS (L2)	APPROX. WT. (LBS.)
VBEX12S	12	4	24
VBEX14S	14	4	26
VBEX18S	18	4	31
VBEX20S	20	4	33
VBEX24S	24	4	38

Notes:

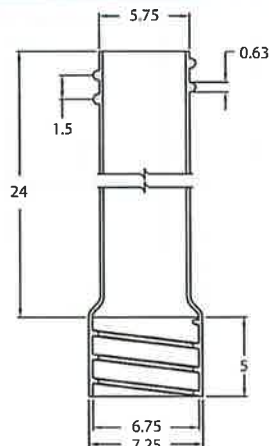
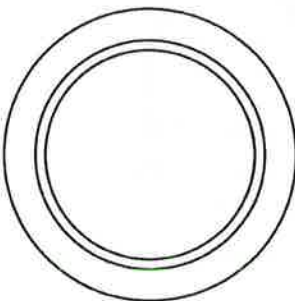
- Material - Cast Iron
- Per ASTM A48 Class 30B
- Dimensions in Inches

SLIP TYPE VALVE BOX EXTENSION
VB-0012


ITEM CODE	L1	L2	APPROX. WT. (LBS.)
VBEX14A	14	6	28
VBEX18A	18	6	33
VBEX24A	24	5.5	38

Notes:

- Material - Cast Iron
- Per ASTM A48 Class 30B
- Dimensions in Inches

24" #60 HEAVY SCREW TYPE EXTENSION (OPTIONAL CLASS 35B)
VB-0013


ITEM CODE	APPROX. WT. (LBS.)
VBEX24SHD #60	36
VBEX24SHD #60CL35	36

Notes:

- Material - Cast Iron
- Per ASTM A48 Class 30B or 35B
- Dimensions in Inches



© REGISTERED TRADEMARK OF STAR PIPE PRODUCTS

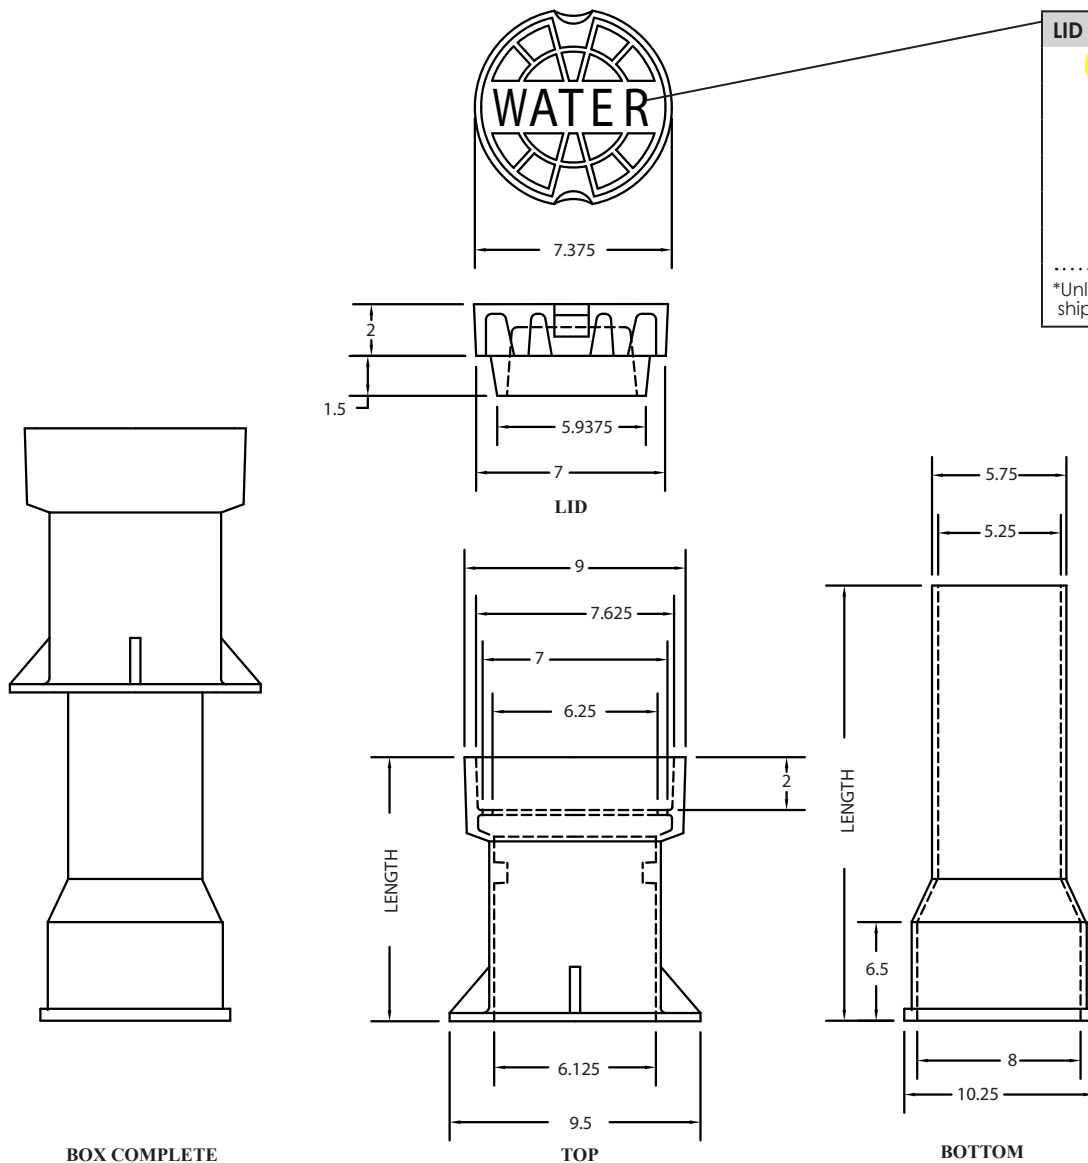
STAR PIPE PRODUCTS
HOUSTON CORPORATE TOLL FREE 1-800-999-3009 FAX 281-558-7000
www.starpipeproducts.com

2 PIECE HEAVY DUTY SLIP TYPE VALVE BOX

VB-0004

ITEM CODE	HEIGHT	APPROX WT. (LBS)	LENGTH	
			TOP	BOT.
VB562AHD	29-38	80	16	24
VB564AHD	41-51	90	16	36
VB664AHD	41-61	110	26	36
♦VB666AHD	53-73	138	26	48

♦ - Optional bottom (48" one piece or 24" bottom w/ 24" extension) - Please indicate your preference



Notes:

- Material - Cast Iron Per ASTM A48 Class 30B
- Dimensions in Inches



® REGISTERED TRADEMARK OF STAR PIPE PRODUCTS

STAR® PIPE PRODUCTS
 HOUSTON **CORPORATE** | TOLL FREE 1-800-999-3009 | FAX 281-558-9000
www.starpipeproducts.com