



Replace float per
Section 33 16 35
Water Storage
Tank Modifications



Sand blast and re-paint overflow weir and outside of pipe per Section 09 97 15 Water Storage Tank Rehabilitation



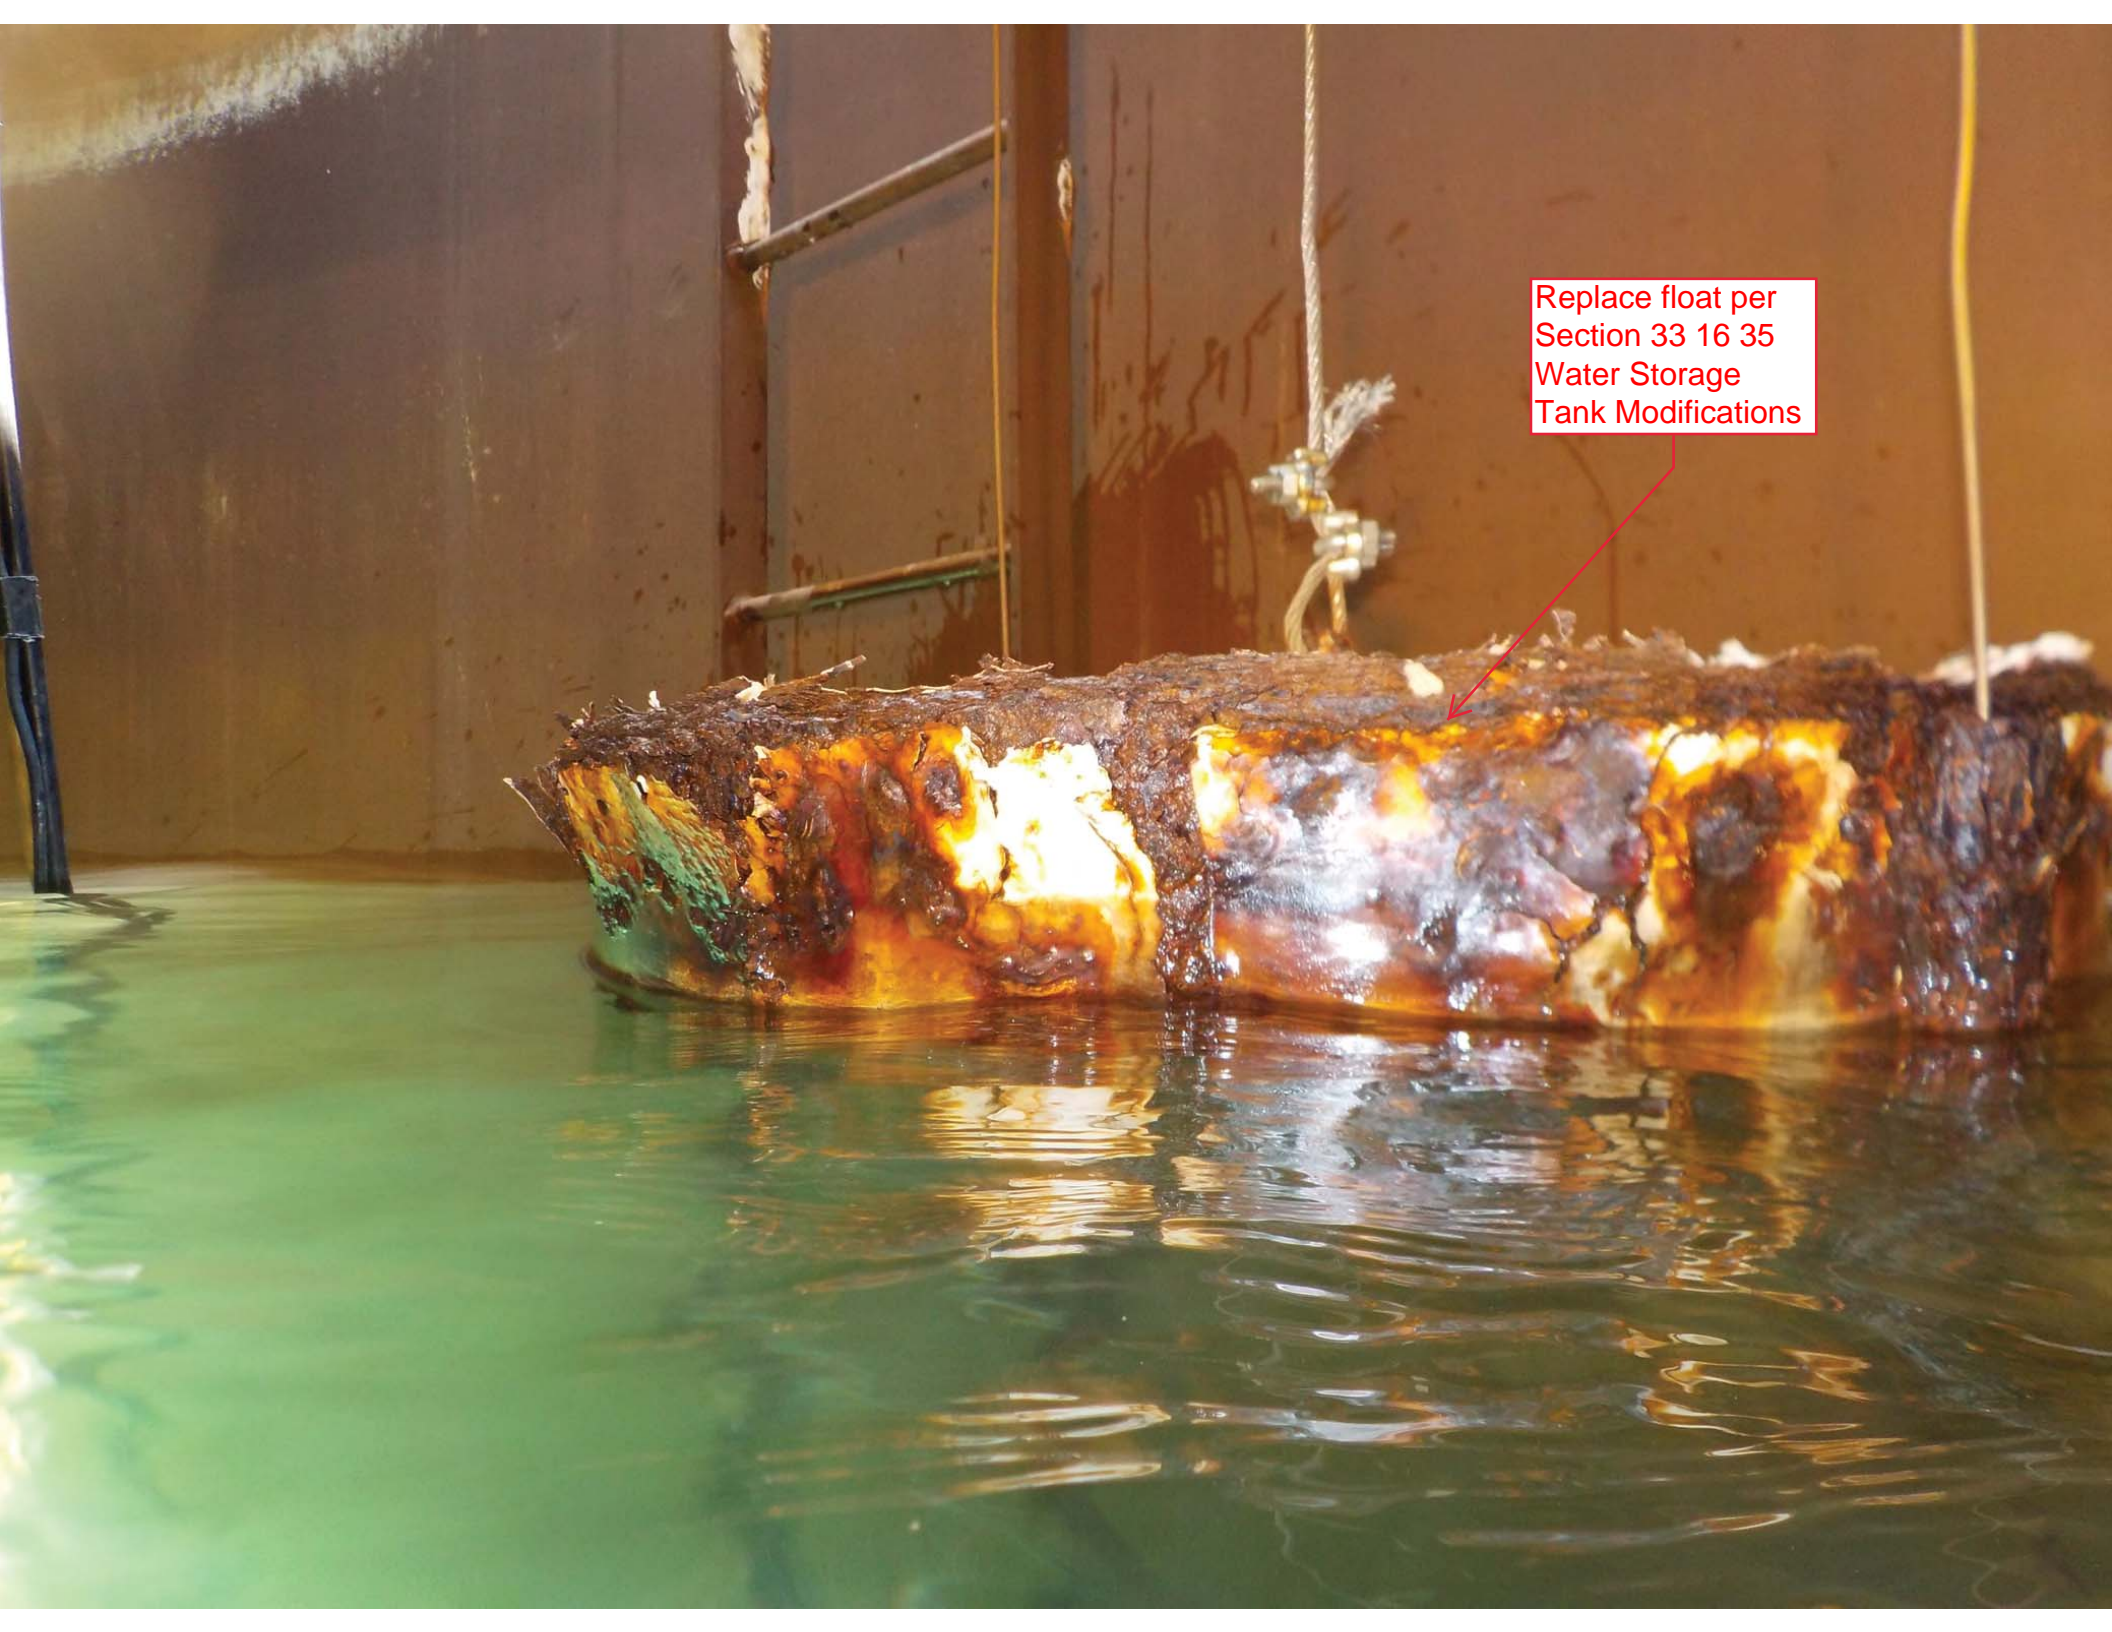

PLACE AND COMPACT 120 C.Y. OF TYPE "G" FILL AT NORTH AND SOUTH TANK PER SPECIFICATIONS TO 6" BELOW TOP OF EXISTING GRADE RING TO REDUCE LOSS OF GRAVEL BENEATH RING.

PRV #1
LOOKING WEST



PRV #1
LOOKING EAST



PRV #1
LOOKING SOUTH



PRV #2
LOOKING EAST



PRV #2
LOOKING SOUTH

