



NAVAJO NATION

DILKON PASS

PIPELINE AND PUMP STATION PROJECT

JANUARY 2022

90% SUBMITTAL



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE
DRAWN: T. PRIDEMORE
CHECKED: C. WILLMORE
CHECKED: ----

APPROVED: S. BRENCHELY


FILENAME	G-000.dwg
BC PROJECT NUMBER	157520
CLIENT PROJECT NUMBER	

GENERAL

COVER SHEET

DRAWING NUMBER
G-000

0 SHEET NUMBER OF 60

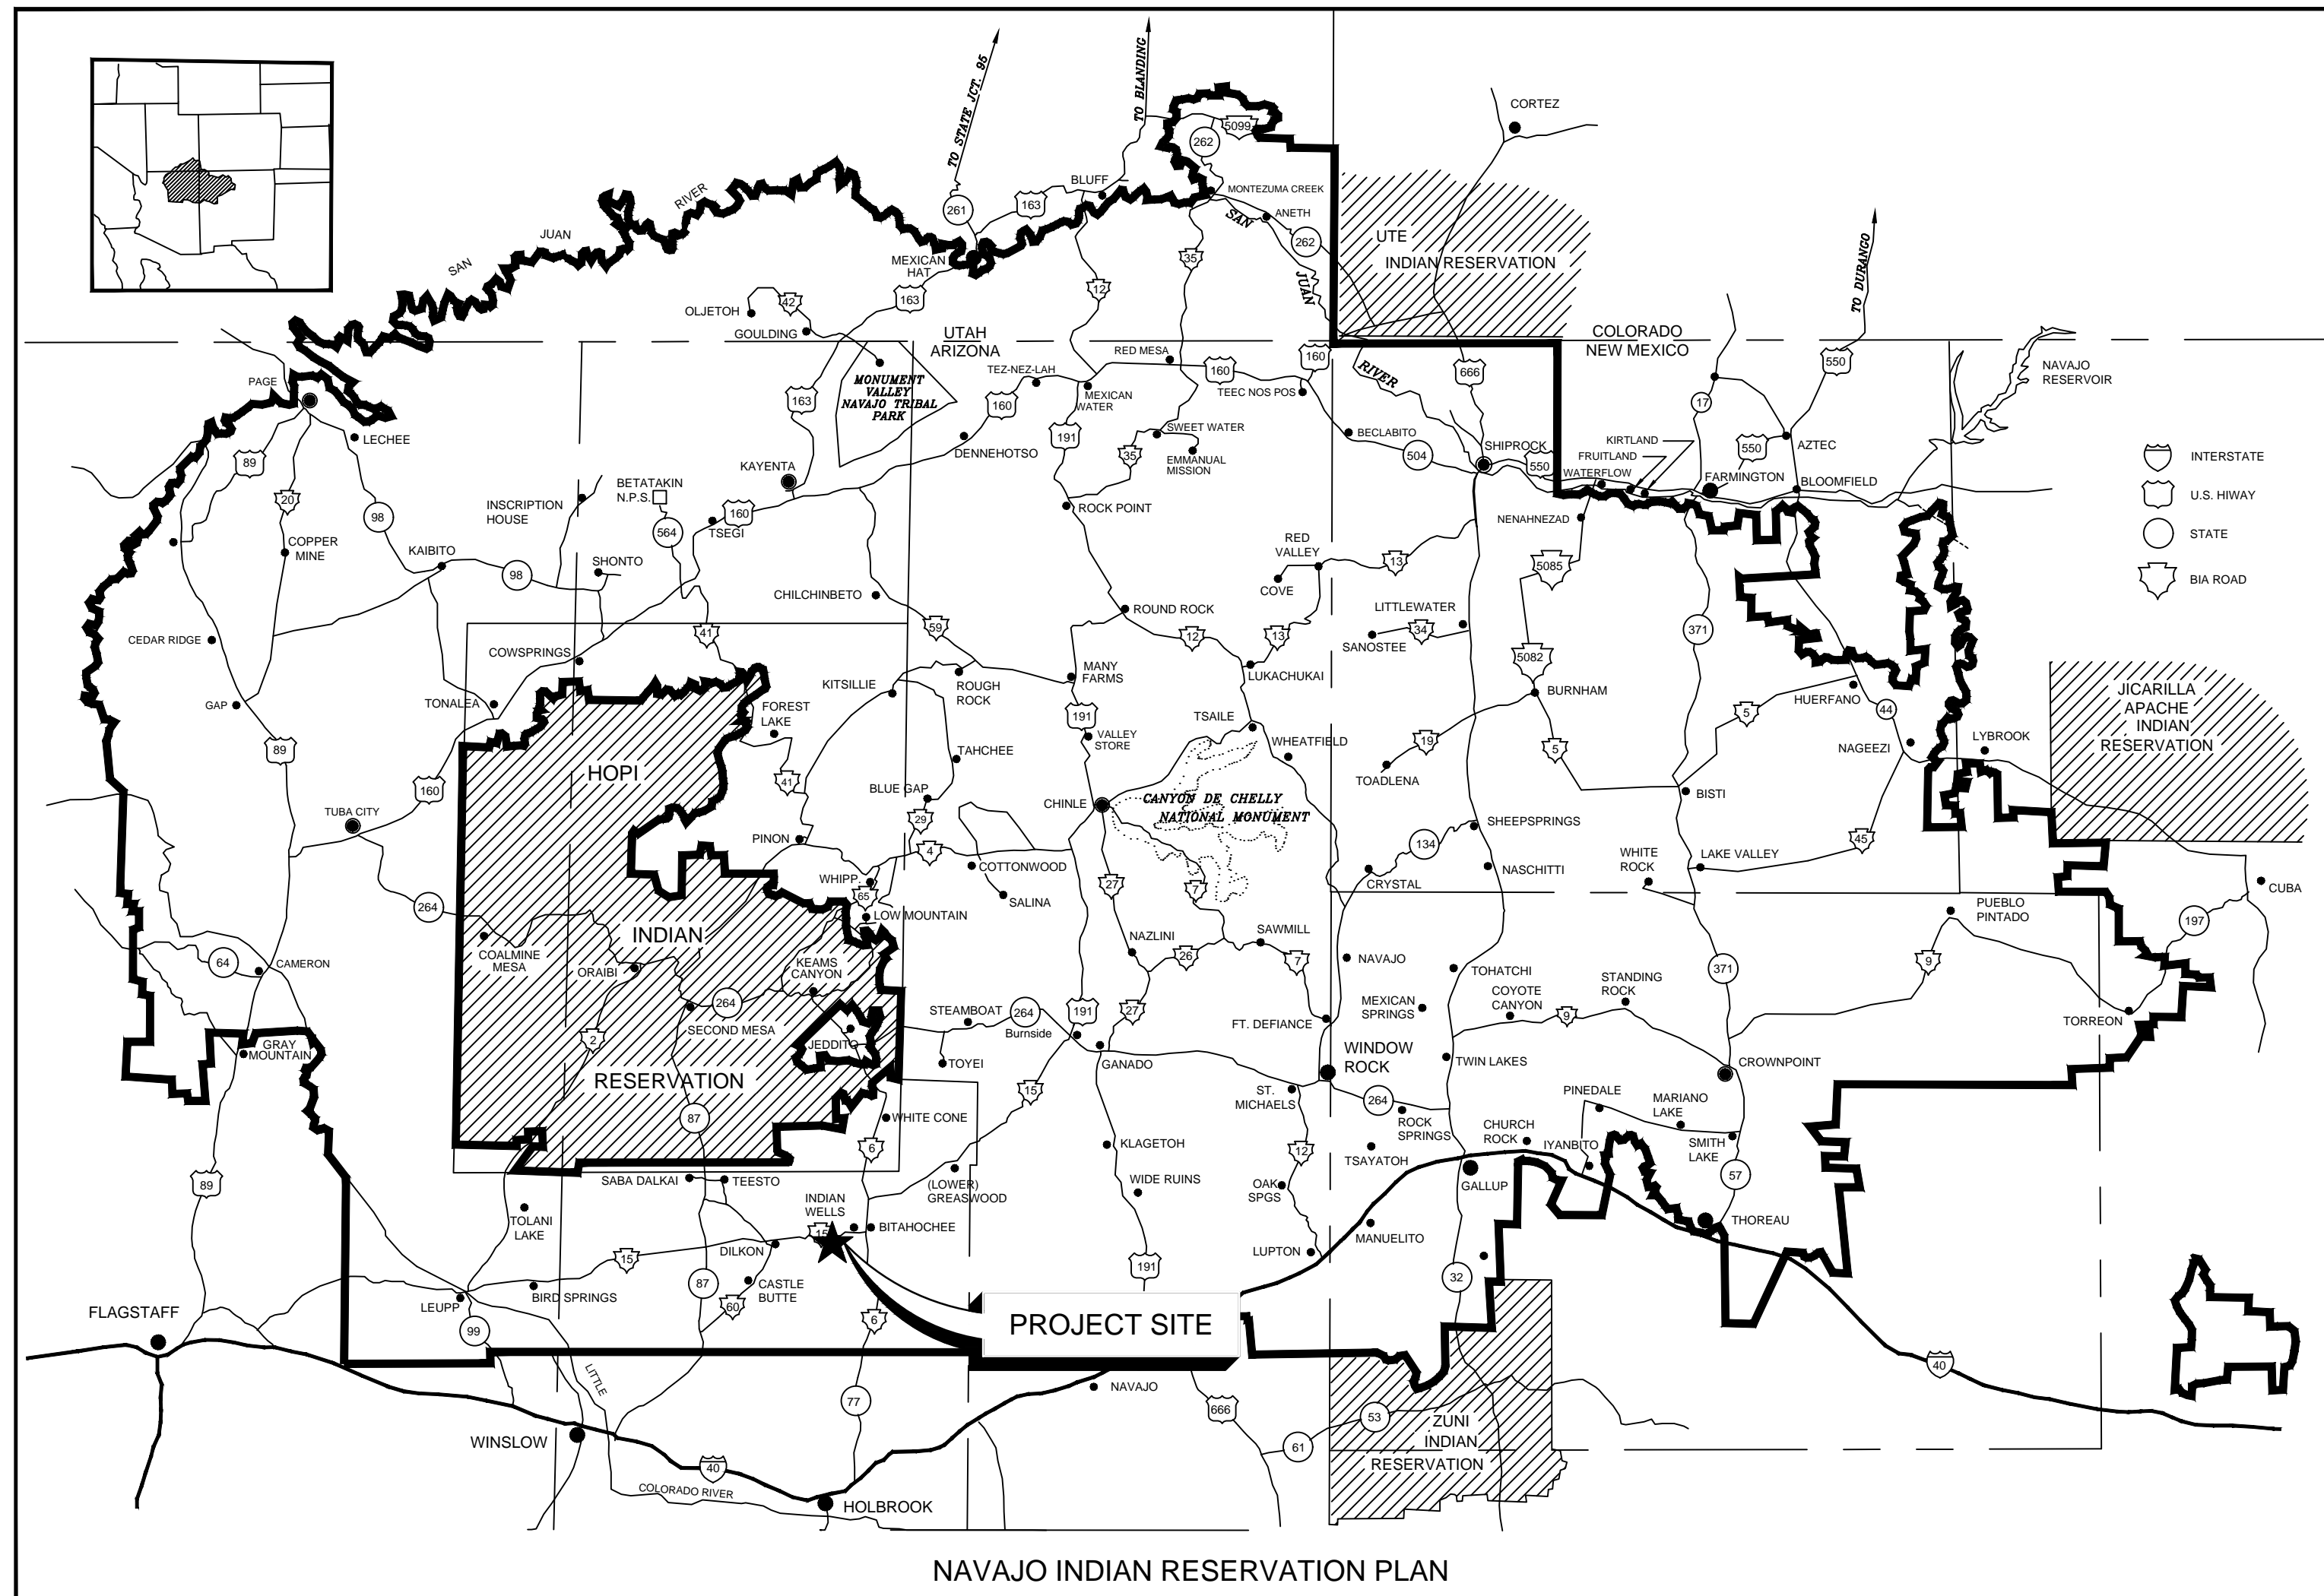

LOCATION MAP
PLAN
NOT TO SCALE



Call at least two full working days
before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\02344900 FILENAME: G-001.DWG PLOT DATE: 1/12/2022 10:05 AM CAD USER: TYLER PRIDEMORE

DRAWING INDEX

GENERAL			ELECTRICAL			NHS STANDARD DETAILS FOR WATER		
SHEET NO.	DWG NO.	DWG TITLE	SHEET NO.	DWG NO.	DWG TITLE	DWG NO.	DWG TITLE	
1	G-000	COVER SHEET	45	E-001	SYMBOLS, ABBREVIATIONS AND NOTES	WS-1	1" WATER SERVICE	
2	G-001	DRAWING INDEX	46	E-002	CONTROL AND ONE-LINE DIAGRAM LEGENDS AND SYMBOLS	WS-1A	MATERIAL LIST: 1" SERVICE	
3	G-002	STANDARD SYMBOLS	47	E-003	STANDARD DETAILS - 1	WS-1B	MATERIAL LIST: 1" SERVICE	
4	G-003	STANDARD ABBREVIATIONS	48	E-004	STANDARD DETAILS - 2	WS-1C	GENERAL NOTES FOR WATER SERVICE	
5	G-004	VICINTY MAP	49	E-005	STANDARD DETAILS - 3	WS-3B	4" x 2" P.R.V.	
			50	E-100	DILKON PASS PUMP STATION SITE PLAN	WS-4C	MATERIAL LIST: 4"X2" P.R.V.	
SURVEY			51	E-101	DILKON PASS PUMP STATION PLAN	WS-10	AIR RELEASE VALVE DETAIL	
SHEET NO.	DWG NO.	DWG TITLE	52	E-102	DILKON PASS PUMP STATION ONE-LINE DIAGRAM	WS-11	2" FLUSH VALVE DETAIL	
6	V-001	RESULTS OF SURVEY	53	E-110	DILKON PASS TANK PLAN	WS-13	MARKER POST DETAIL	
7	V-002	RESULTS OF SURVEY				WS-14	WATER MAIN VALVE INSTALLATION	
DEMOLITION			INSTRUMENTATION			WS-19	GRAVITY/THRUST BLOCK DETAILS	
SHEET NO.	DWG NO.	DWG TITLE	SHEET NO.	DWG NO.	DWG TITLE	WS-19A	GRAVITY/THRUST BLOCK CHART	
8	CD-100	PUMP STATION DEMOLITION SITE PLAN	54	I-001	DILKON PASS COMMUNICATIONS BLOCK DIAGRAM			
CIVIL			PROCESS			IHS STANDARD DETAILS		
SHEET NO.	DWG NO.	DWG TITLE	SHEET NO.	DWG NO.	DWG TITLE	DWG NO.	DWG TITLE	
9	C-001	GENERAL CIVIL NOTES AND SYMBOLS	55	P-100	HYDRAULIC GRADE LINE DIAGRAM - 1	W-33	HDPE WASH CROSSING DETAIL	
10	C-002	MISCELLANEOUS DETAILS - 1	56	P-101	HYDRAULIC GRADE LINE DIAGRAM - 2	W-34	FENCE DETAIL FOR STORAGE TANK AND PUMPHOUSE	
11	C-003	CONNECTION DETAILS - 1				W-39	SILT FENCE	
12	C-100	PUMP STATION SITE PLAN	HVAC			W-40	STRAW BALES	
13	C-110	CHECK VALVE SITE PLAN	SHEET NO.	DWG NO.	DWG TITLE			
14	C-200	KEY MAP	57	H-001	HVAC LEGEND AND GENERAL NOTES	NTUA TECHNICAL PROVISIONS		
15	C-201	PLAN AND PROFILE STA 18+00 TO 18+00	58	H-101	DILKON PASS PUMP STATION HVAC PLAN AND SECTION	DWG NO.	DWG TITLE	
16	C-202	PLAN AND PROFILE STA 18+00 TO 26+00	59	H-102	HVAC DETAILS	1 OF 6	AC TANK PANEL COVER SHEET	
17	C-203	PLAN AND PROFILE STA 26+00 TO 34+00	60	H-501	HVAC SCHEDULES	2 OF 6	AC TANK CONTROL PANEL DISCRETE IO	
18	C-204	PLAN AND PROFILE STA 34+00 TO 42+00				3 OF 6	AC TANK CONTROL PANEL ANALOG IO	
19	C-205	PLAN AND PROFILE STA 42+00 TO 49+45				4 OF 6	AC TANK CONTROL PANEL POWER DISTRIBUTION	
20	C-206	PLAN AND PROFILE STA 49+50 TO 57+50				5 OF 6	AC TANK CONTROL PANEL BACKPLANE	
21	C-207	PLAN AND PROFILE STA 57+50 TO 65+50				6 OF 6	AC TANK CONTROL PANEL CABLE PINOUT	
22	C-208	PLAN AND PROFILE STA 65+50 TO 73+50				1 OF 6	PLC CONTROL PANEL COVER SHEET	
23	C-209	PLAN AND PROFILE STA 73+50 TO 81+50				2 OF 6	PLC CONTROL PANEL DISCRETE I/O (BOOSTER WITH BOOSTERPAQ)	
24	C-210	PLAN AND PROFILE STA 81+50 TO 86+79				3 OF 6	PLC CONTROL PANEL ANALOG I/O (BOOSTER WITH BOOSTERPAQ)	
25	C-211	PLAN AND PROFILE COYOTE WASH				4 OF 6	PLC CONTROL PANEL POWER DISTRIBUTION	
MECHANICAL						5 OF 6	PLC CONTROL PANEL BACKPLANE	
SHEET NO.	DWG NO.	DWG TITLE				5A OF 6	PLC CONTROL PANEL WITH SWING OUT PANEL BACKPLANE	
26	M-001	GENERAL MECHANICAL SYMBOLS - 1				6 OF 6	PLC CONTROL PANEL CABLE PINOUT	
27	M-002	GENERAL MECHANICAL SYMBOLS - 2						
28	M-003	STANDARD DETAILS						
29	M-100	DILKON PASS PUMP STATION BUILDING PLAN						
30	M-101	DILKON PASS PUMP STATION BUILDING SECTION						
STRUCTURAL								
SHEET NO.	DWG NO.	DWG TITLE						
31	S-001	GENERAL STRUCTURAL NOTES						
32	S-002	SPECIAL INSPECTIONS - 1						
33	S-003	SPECIAL INSPECTIONS - 2						
34	S-004	STANDARD DETAILS - 1						
35	S-005	STANDARD DETAILS - 2						
36	S-006	STANDARD DETAILS - 3						
37	S-100	DILKON PASS PUMP STATION BUILDING FOUNDATION PLAN						
38	S-101	DILKON PASS PUMP STATION BUILDING ROOF FRAMING PLAN						
39	S-102	DILKON PASS PUMP STATION BUILDING SECTION AND DETAILS						
ARCHITECTURAL								
SHEET NO.	DWG NO.	DWG TITLE						
40	A-101	DILKON PASS PUMP STATION CODE & FLOOR PLAN						
41	A-102	DILKON PASS PUMP STATION ROOF PLAN						
42	A-201	DILKON PASS PUMP STATION BUILDING ELEVATION						
43	A-202	DILKON PASS PUMP STATION BUILDING SECTIONS						
44	A-301	DILKON PASS PUMP STATION SCHEDULES						



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

G-001.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

GENERAL

DRAWING INDEX

DRAWING NUMBER

G-001

SHEET NUMBER

0

OF

60


Path: C:\BCPM\02344900 FILENAME: G-002.DWG PLOT DATE: 1/5/2022 9:24 AM CAD USER: TYLER PRIDEMORE

CROSS REFERENCING SYSTEM

1. PLAN TITLES:


PLAN TITLE
SCALE: 1/4" = 1'-0"

2. SECTION CUTS

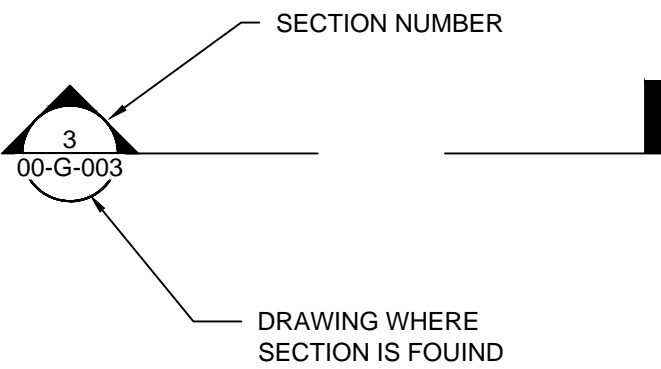


3. DETAIL CALLOUT

A: BY CALLOUT:

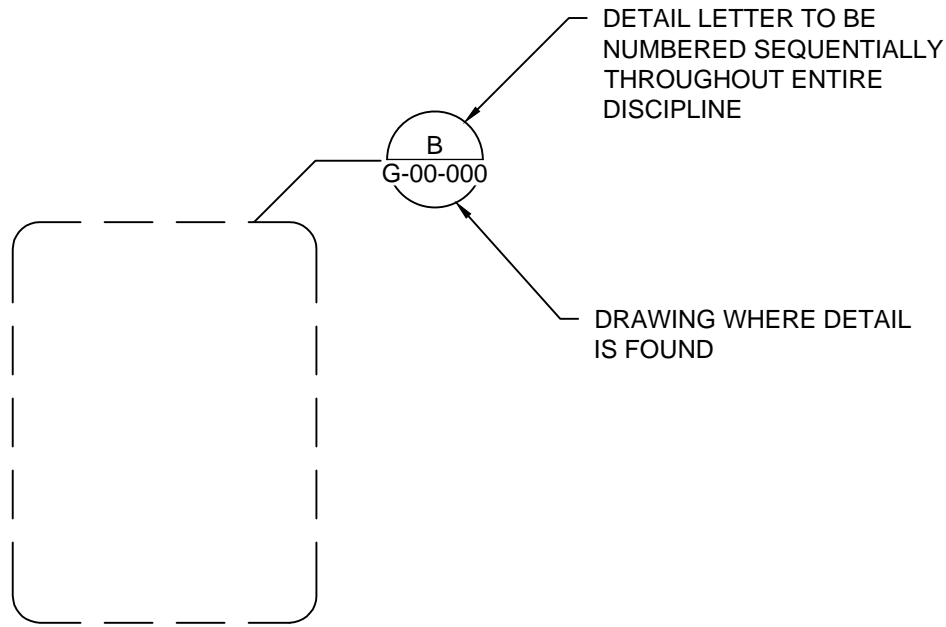


B: BY NOTE: "SEE DETAIL B/D-01-105"
B IS DETAIL REFERENCE LETTER
D-01-105 IS DRAWING WHERE DETAIL IS SHOWN


4. ENLARGED PLAN TITLES:

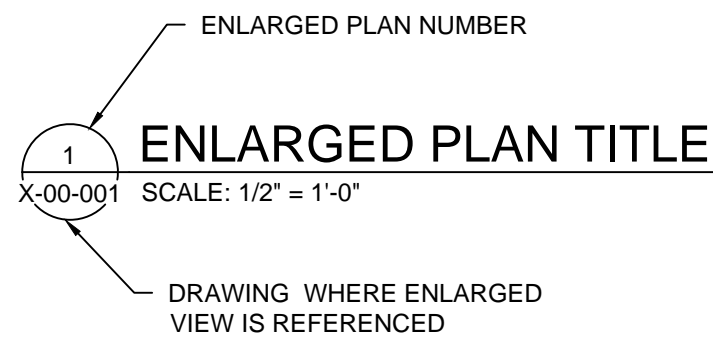


5. SECTION TITLES:

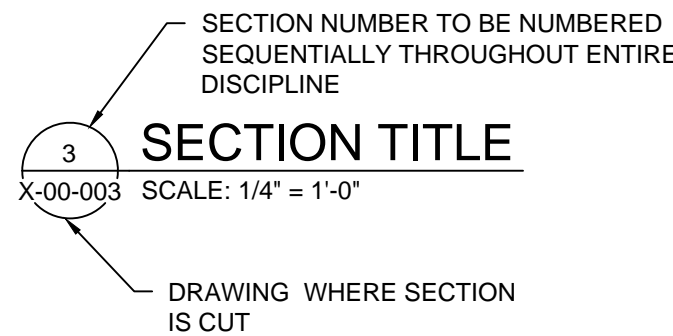

6. DETAIL TITLES:

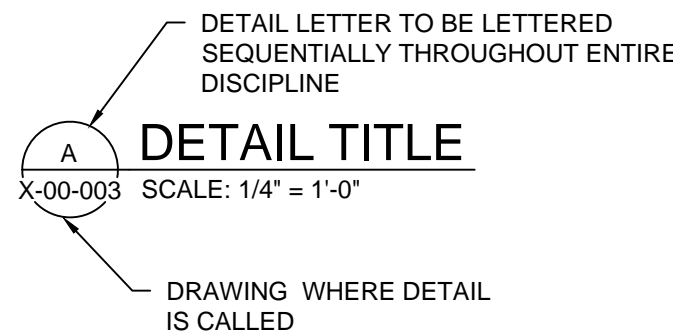


5. TYPICAL DETAIL TITLES

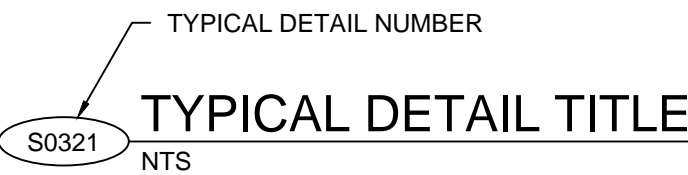


CROSS REFERENCING SYSTEM (CONTINUED)


6. STANDARD DETAILS REFERENCE:

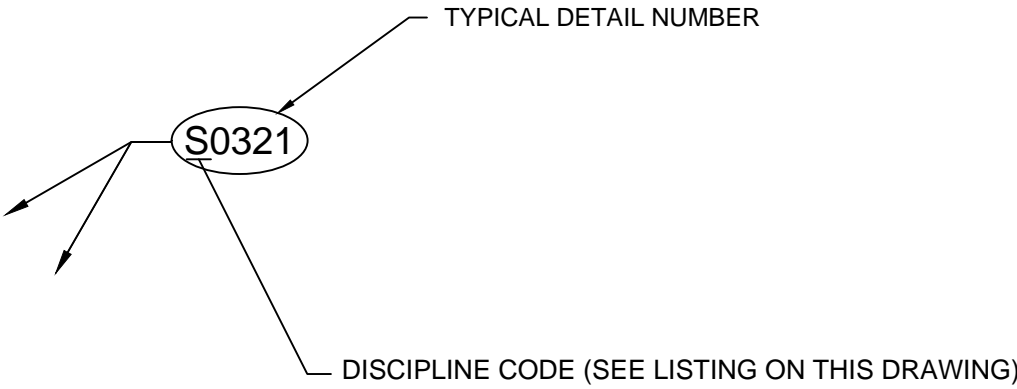


7. KEYNOTES:




PIPING IDENTIFICATION SYSTEM

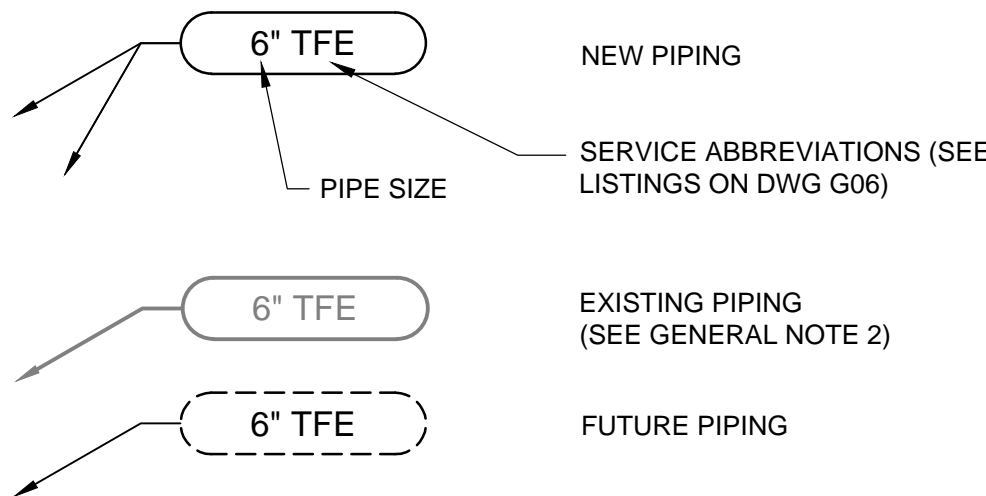

MISCELLANEOUS

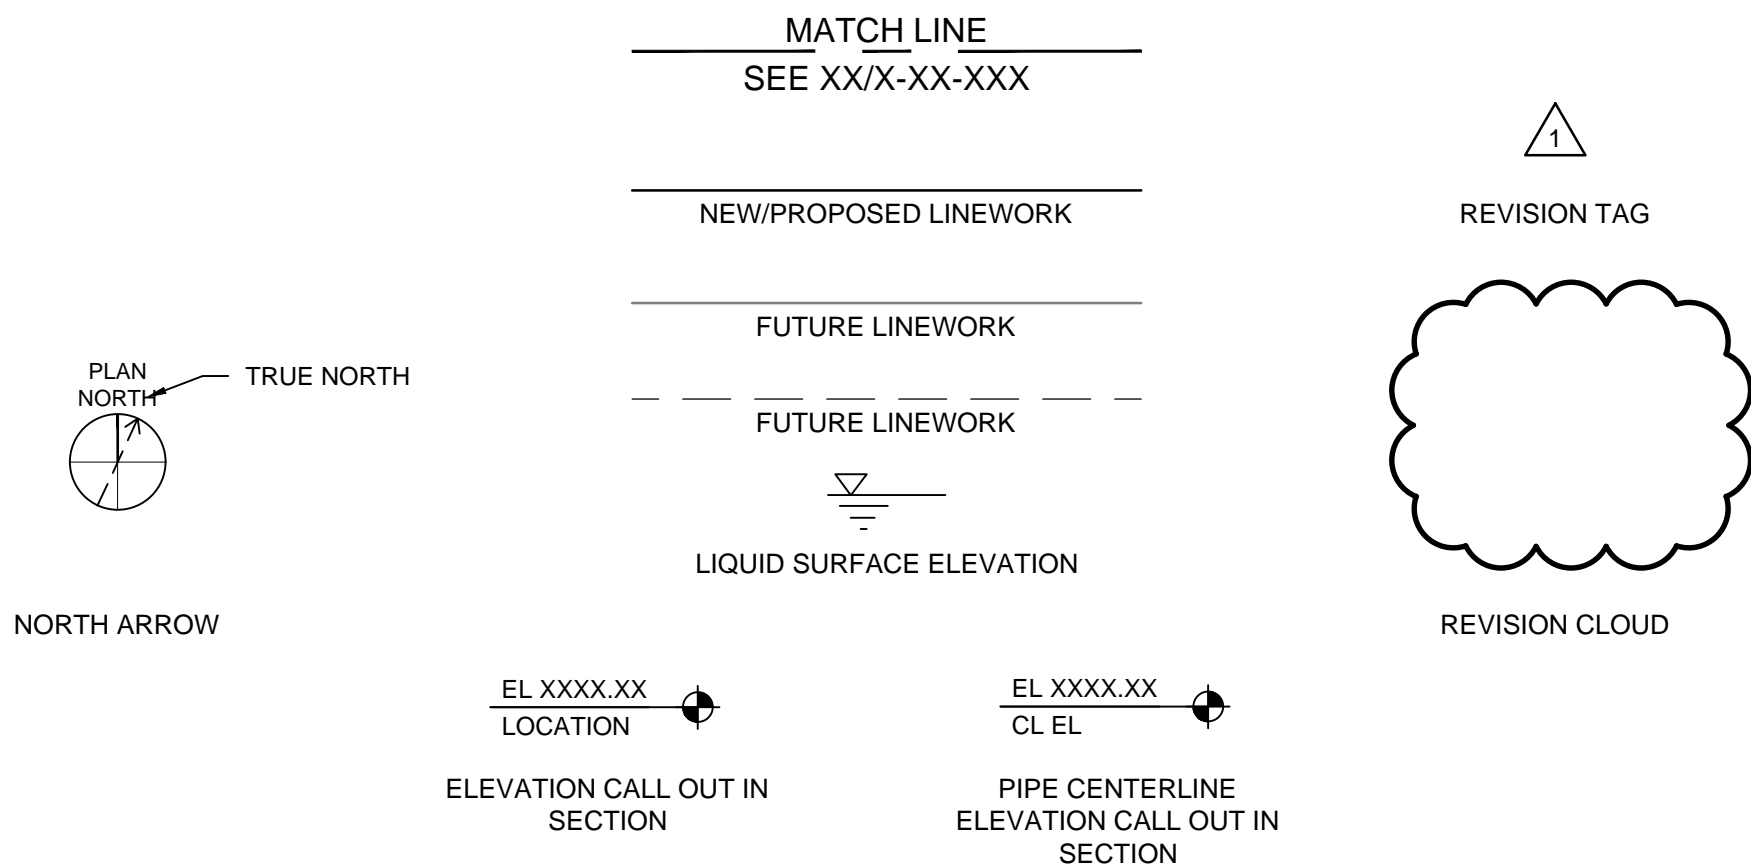

DRAWING NUMBERING SYSTEM

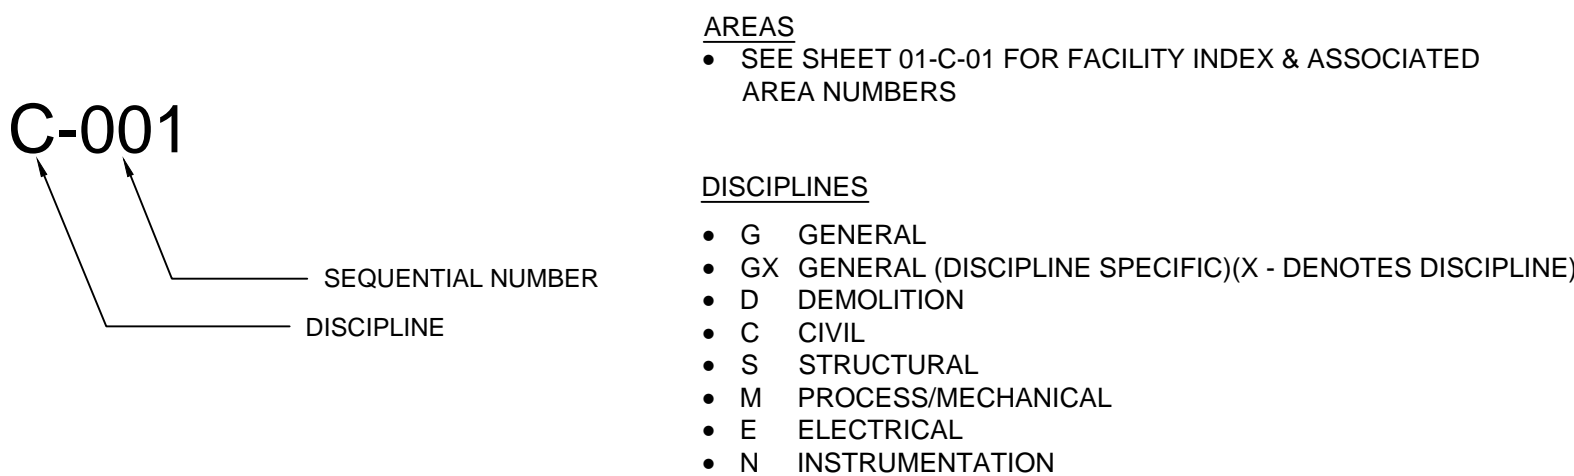

AREAS
• SEE SHEET 01-C-01 FOR FACILITY INDEX & ASSOCIATED AREA NUMBERS

DISCIPLINES
• G GENERAL
• GX GENERAL (DISCIPLINE SPECIFIC)(X - DENOTES DISCIPLINE)
• D DEMOLITION
• C CIVIL
• S STRUCTURAL
• M PROCESS/MECHANICAL
• E ELECTRICAL
• N INSTRUMENTATION

GENERAL NOTES

1. THE NOTE IN THE TITLEBLOCK OF THIS DRAWING WHICH READS "TWO INCHES AT FULL SCALE" APPEARS ON DRAWINGS FOR IDENTIFICATION OF SCALE DISTORTIONS ON HALF SIZE DRAWINGS AND DRAWING REPRODUCTIONS. IT SHALL MEAN THAT THE DRAWING IS FULL SIZE AND THE DRAWING SCALES ACCURATE WHEN THE LENGTH OF THIS LINE IS TWO INCHES. IF THE LENGTH IS OTHER THAN TWO INCHES, DRAWING SCALES MUST BE ADJUSTED ACCORDINGLY.
2. EXISTING PIPING IS DESIGNATED BY SERVICE RATHER THAN MATERIAL TYPE. MATERIAL TYPES, IF KNOWN, APPEAR OUTSIDE THE PIPING CALLOUT BUBBLE, AND MAY NOT BE THE SAME MATERIAL TYPES SPECIFIED FOR NEW PIPING.
3. ABBREVIATIONS USED IN THIS CONTRACT DOCUMENT CONFORM TO ANSI Y1.1, UNLESS NOTED OTHERWISE ON DRAWINGS. SEE SPEC. SECTION 01071 FOR ADDITIONAL ABBREVIATIONS.
4. ALL STANDARD DETAILS APPLY TO ALL THE CONTRACTORS WORK WHETHER SPECIFICALLY REFERENCED OR NOT.
5. SEE FRONT END SHEETS FOR EACH DISCIPLINES STANDARD SYMBOLS, ETC.
6. SEE ADDITIONAL GENERAL NOTES THROUGHOUT DRAWING SET.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T.PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: ----

APPROVED: S. BRENCHEY

FILENAME

G-002.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

GENERAL

STANDARD SYMBOLS

DRAWING NUMBER

G-002

0 SHEET NUMBER OF 60

EA	EXHAUST AIR / ENVIRONMENTAL ASSESSMENT
EAT	ENTERING AIR TEMPERATURE
EAU	ENGINE ALTERNATOR UNIT
EC	END OF CURVE
ECU	EVAPORATIVE COOLING UNIT
ED	EXTRACTOR DAMPER, EQUIPMENT DRAIN
EE	EACH END
EF	EXHAUST FAN
EFF	EFFLUENT
EG	EXHAUST GRILLE

LAT	LEAVING AIR TEMPERATURE, LAT
LCP	LOCAL CONTROL PANEL
LE	LEVEL METER
LEL	LOWER EXPLOSIVE LIMIT
LGW	LOWER GREASEWOOD
LIT	LEVEL INDICATION TRANSMITTER
LOD	LIMITS OF DISTURBMENTS

R	RADIUS
RA	RETURN AIR
RAF	ROLL TYPE AIR FILTER
RCR	RECORDER
REC	RECEIVER
RECD	RECEIVED
RECP	RECEPTACLE
RED	REDUCE(R)
REG	REGULATOR
REL	RELAY
RT	RIGHT
RTP	REINFORCED THERMOSET PLASTIC
RTU	REMOTE TERMINAL UNIT
RGS	RIGID GALVANIZED STEEL
RL	REDUCED LEVEL
RW	RECLAIMED WATER
RWCD	RECALMINED WATER CONSERVATION DISTRICT
RWL	RAINWATER LEADER

YCO YARD CLEANOUT

NOTES:

1. ADDITIONAL ABBREVIATIONS ARE DEFINED IN ANSI Y1.1-1972.
2. ABBREVIATIONS FOR PIPING SYSTEMS ARE SPECIFIED IN SECTION 15050.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

[illegible]

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHLEY

FILENAME
© 2005 A

PROJECT NUM

157520

PROJECT NUMBER

GENERAL

STANDARD ABBREVIATIONS

DRAWING NUMBER

G-003

0 SHEET NUMBER OF 6

Path: C:\BCP\W\D2344900 FILENAME: G-004.DWG PLOT DATE: 1/5/2022 9:23 AM CAD USER: TYLER PRIDEMORE



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHEY

FILENAME

G-004.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

GENERAL

VICINITY MAP

DRAWING NUMBER

G-004

0 SHEET NUMBER OF 60


Call at least two full working days before you begin excavation.

ARIZONA 811

Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: E:\21533 DILKON PASS WATERLINE.DWG FILENAME: DILKON PASS WATERLINE.DWG PLOT DATE: 1/12/2022 12:18 PM CAD USER: HALBERT GOLDTOOTH

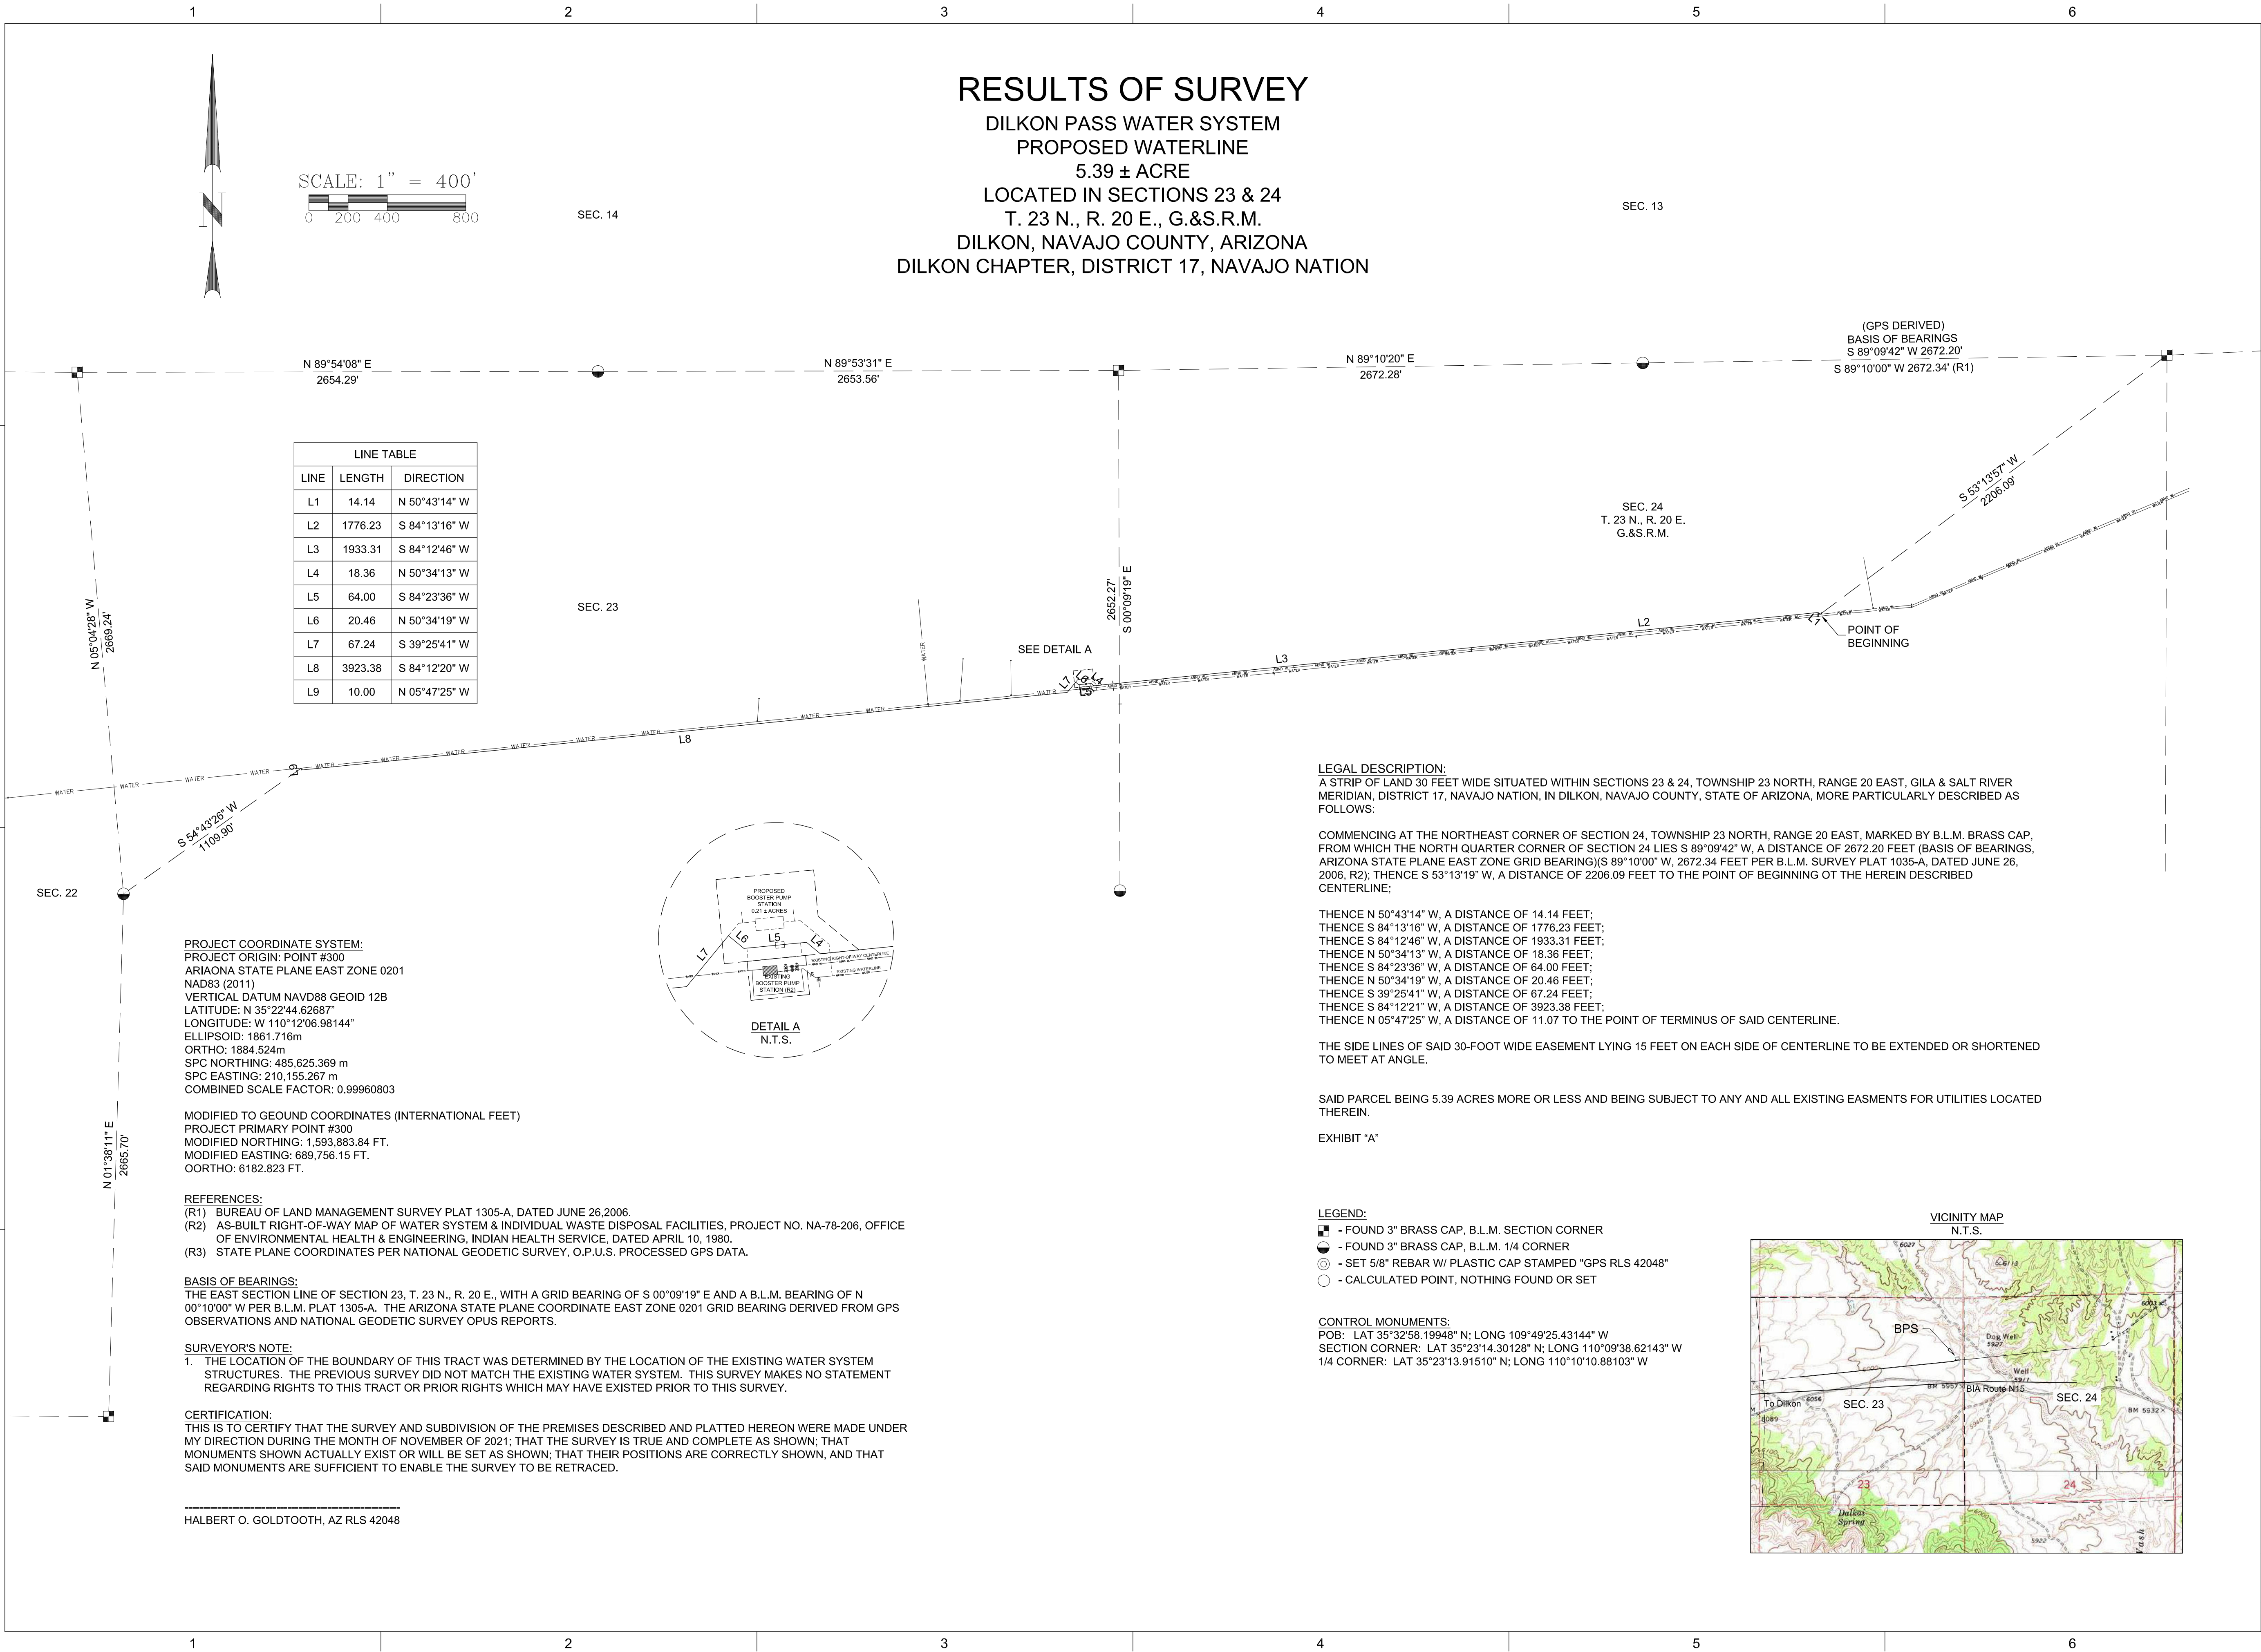

LINE TABLE		
LINE	LENGTH	DIRECTION
L1	14.14	N 50°43'14" W
L2	1776.23	S 84°13'16" W
L3	1933.31	S 84°12'46" W
L4	18.36	N 50°34'13" W
L5	64.00	S 84°23'36" W
L6	20.46	N 50°34'19" W
L7	67.24	S 39°25'41" W
L8	3923.38	S 84°12'20" W
L9	10.00	N 05°47'25" W

PROJECT COORDINATE SYSTEM:
PROJECT ORIGIN: POINT #300
ARIAONA STATE PLANE EAST ZONE 0201
NAD83 (2011)
VERTICAL DATUM NAVD88 GEOID 12B
LATITUDE: N 35°22'44.62687"
LONGITUDE: W 110°12'06.98144"
ELLIPSOID: 1861.716m
ORTHO: 1984.524m
SPC NORTHING: 485,625.369 m
SPC EASTING: 210,155.267 m
COMBINED SCALE FACTOR: 0.99960803

MODIFIED TO GEOUND COORDINATES (INTERNATIONAL FEET)
PROJECT PRIMARY POINT #300
MODIFIED NORTHING: 1,593,883.84 FT.
MODIFIED EASTING: 689,756.15 FT.
OORTHO: 6182.823 FT.

REFERENCES:
(R1) BUREAU OF LAND MANAGEMENT SURVEY PLAT 1305-A, DATED JUNE 26, 2006.
(R2) AS-BUILT RIGHT-OF-WAY MAP OF WATER SYSTEM & INDIVIDUAL WASTE DISPOSAL FACILITIES, PROJECT NO. NA-78-206, OFFICE OF ENVIRONMENTAL HEALTH & ENGINEERING, INDIAN HEALTH SERVICE, DATED APRIL 10, 1980.
(R3) STATE PLANE COORDINATES PER NATIONAL GEODETIC SURVEY, O.P.U.S. PROCESSED GPS DATA.

BASIS OF BEARINGS:
THE EAST SECTION LINE OF SECTION 23, T. 23 N., R. 20 E., WITH A GRID BEARING OF S 00°09'19" E AND A B.L.M. BEARING OF N 00°10'00" W PER B.L.M. PLAT 1305-A. THE ARIZONA STATE PLANE COORDINATE EAST ZONE 0201 GRID BEARING DERIVED FROM GPS OBSERVATIONS AND NATIONAL GEODETIC SURVEY OPUS REPORTS.

SURVEYOR'S NOTE:
1. THE LOCATION OF THE BOUNDARY OF THIS TRACT WAS DETERMINED BY THE LOCATION OF THE EXISTING WATER SYSTEM STRUCTURES. THE PREVIOUS SURVEY DID NOT MATCH THE EXISTING WATER SYSTEM. THIS SURVEY MAKES NO STATEMENT REGARDING RIGHTS TO THIS TRACT OR PRIOR RIGHTS WHICH MAY HAVE EXISTED PRIOR TO THIS SURVEY.

CERTIFICATION:
THIS IS TO CERTIFY THAT THE SURVEY AND SUBDIVISION OF THE PREMISES DESCRIBED AND PLATTED HEREON WERE MADE UNDER MY DIRECTION DURING THE MONTH OF NOVEMBER OF 2021; THAT THE SURVEY IS TRUE AND COMPLETE AS SHOWN; THAT MONUMENTS SHOWN ACTUALLY EXIST OR WILL BE SET AS SHOWN; THAT THEIR POSITIONS ARE CORRECTLY SHOWN, AND THAT SAID MONUMENTS ARE SUFFICIENT TO ENABLE THE SURVEY TO BE RETRACED.

HALBERT O. GOLDTOOTH, AZ RLS 42048

RESULTS OF SURVEY
DILKON PASS WATER SYSTEM
PROPOSED WATERLINE
5.39 ± ACRE
LOCATED IN SECTIONS 23 & 24
T. 23 N., R. 20 E., G.&S.R.M.
DILKON, NAVAJO COUNTY, ARIZONA
DILKON CHAPTER, DISTRICT 17, NAVAJO NATION

LEGAL DESCRIPTION:
A STRIP OF LAND 30 FEET WIDE SITUATED WITHIN SECTIONS 23 & 24, TOWNSHIP 23 NORTH, RANGE 20 EAST, GILA & SALT RIVER MERIDIAN, DISTRICT 17, NAVAJO NATION, IN DILKON, NAVAJO COUNTY, STATE OF ARIZONA, MORE PARTICULARLY DESCRIBED AS FOLLOWS:

COMMENCING AT THE NORTHEAST CORNER OF SECTION 24, TOWNSHIP 23 NORTH, RANGE 20 EAST, MARKED BY B.L.M. BRASS CAP, FROM WHICH THE NORTH QUARTER CORNER OF SECTION 24 LIES S 89°09'42" W, A DISTANCE OF 2672.20 FEET (BASIS OF BEARINGS, ARIZONA STATE PLANE EAST ZONE GRID BEARING)(S 89°10'00" W, 2672.34 FEET PER B.L.M. SURVEY PLAT 1035-A, DATED JUNE 26, 2006, R2); THENCE S 53°13'19" W, A DISTANCE OF 2206.09 FEET TO THE POINT OF BEGINNING OF THE HEREIN DESCRIBED CENTERLINE;

THENCE N 50°43'14" W, A DISTANCE OF 14.14 FEET;
THENCE S 84°13'16" W, A DISTANCE OF 1776.23 FEET;
THENCE S 84°12'46" W, A DISTANCE OF 1933.31 FEET;
THENCE N 50°34'13" W, A DISTANCE OF 18.36 FEET;
THENCE S 84°23'36" W, A DISTANCE OF 64.00 FEET;
THENCE N 50°34'19" W, A DISTANCE OF 20.46 FEET;
THENCE S 39°25'41" W, A DISTANCE OF 67.24 FEET;
THENCE S 84°12'21" W, A DISTANCE OF 3923.38 FEET;
THENCE N 05°47'25" W, A DISTANCE OF 11.07 TO THE POINT OF TERMINUS OF SAID CENTERLINE.


THE SIDE LINES OF SAID 30-FOOT WIDE EASEMENT LYING 15 FEET ON EACH SIDE OF CENTERLINE TO BE EXTENDED OR SHORTENED TO MEET AT ANGLE.

SAID PARCEL BEING 5.39 ACRES MORE OR LESS AND BEING SUBJECT TO ANY AND ALL EXISTING EASMENTS FOR UTILITIES LOCATED THEREIN.

EXHIBIT "A"

- LEGEND:
- FOUND 3" BRASS CAP, B.L.M. SECTION CORNER
 - FOUND 3" BRASS CAP, B.L.M. 1/4 CORNER
 - SET 5/8" REBAR W/ PLASTIC CAP STAMPED "GPS RLS 42048"
 - CALCULATED POINT, NOTHING FOUND OR SET

CONTROL MONUMENTS:
POB: LAT 35°32'58.19948" N; LONG 109°49'25.43144" W
SECTION CORNER: LAT 35°23'14.30128" N; LONG 110°09'38.62143" W
1/4 CORNER: LAT 35°23'13.91510" N; LONG 110°10'10.88103" W

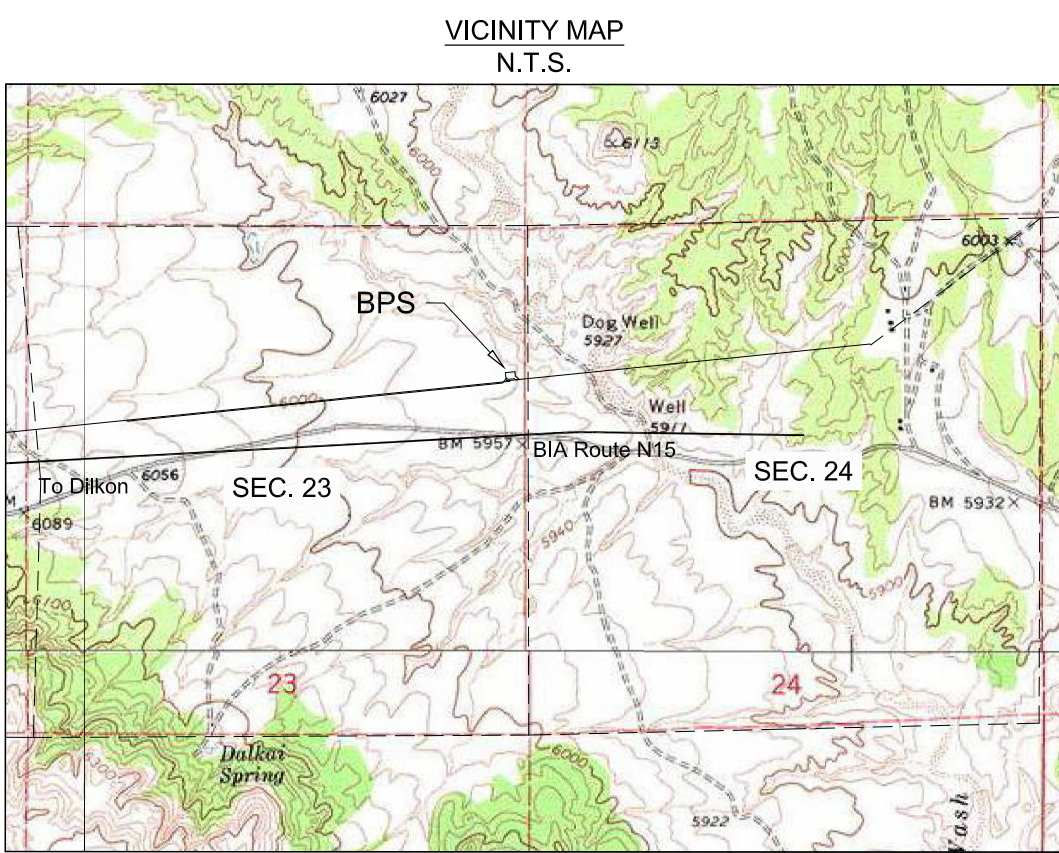

SALT LAKE CITY, UT



60% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION


LINE IS 2 INCHES
AT FULL SIZE

DESIGNED:
DRAWN: H.GOLDTOOTH
CHECKED: H.GOLDTOOTH
APPROVED: H.GOLDTOOTH
FILENAME
BC PROJECT NUMBER
157520
CLIENT PROJECT NUMBER
00357.21

DRAWING NUMBER

SHEET NUMBER
OF 113

Path: E:\21533 DILKON PASS WLDWG FILENAME: DILKON BPS TRACT.DWG PLOT DATE: 1/12/2022 11:53 AM CAD USER: HALBERT GOLDTOOTH

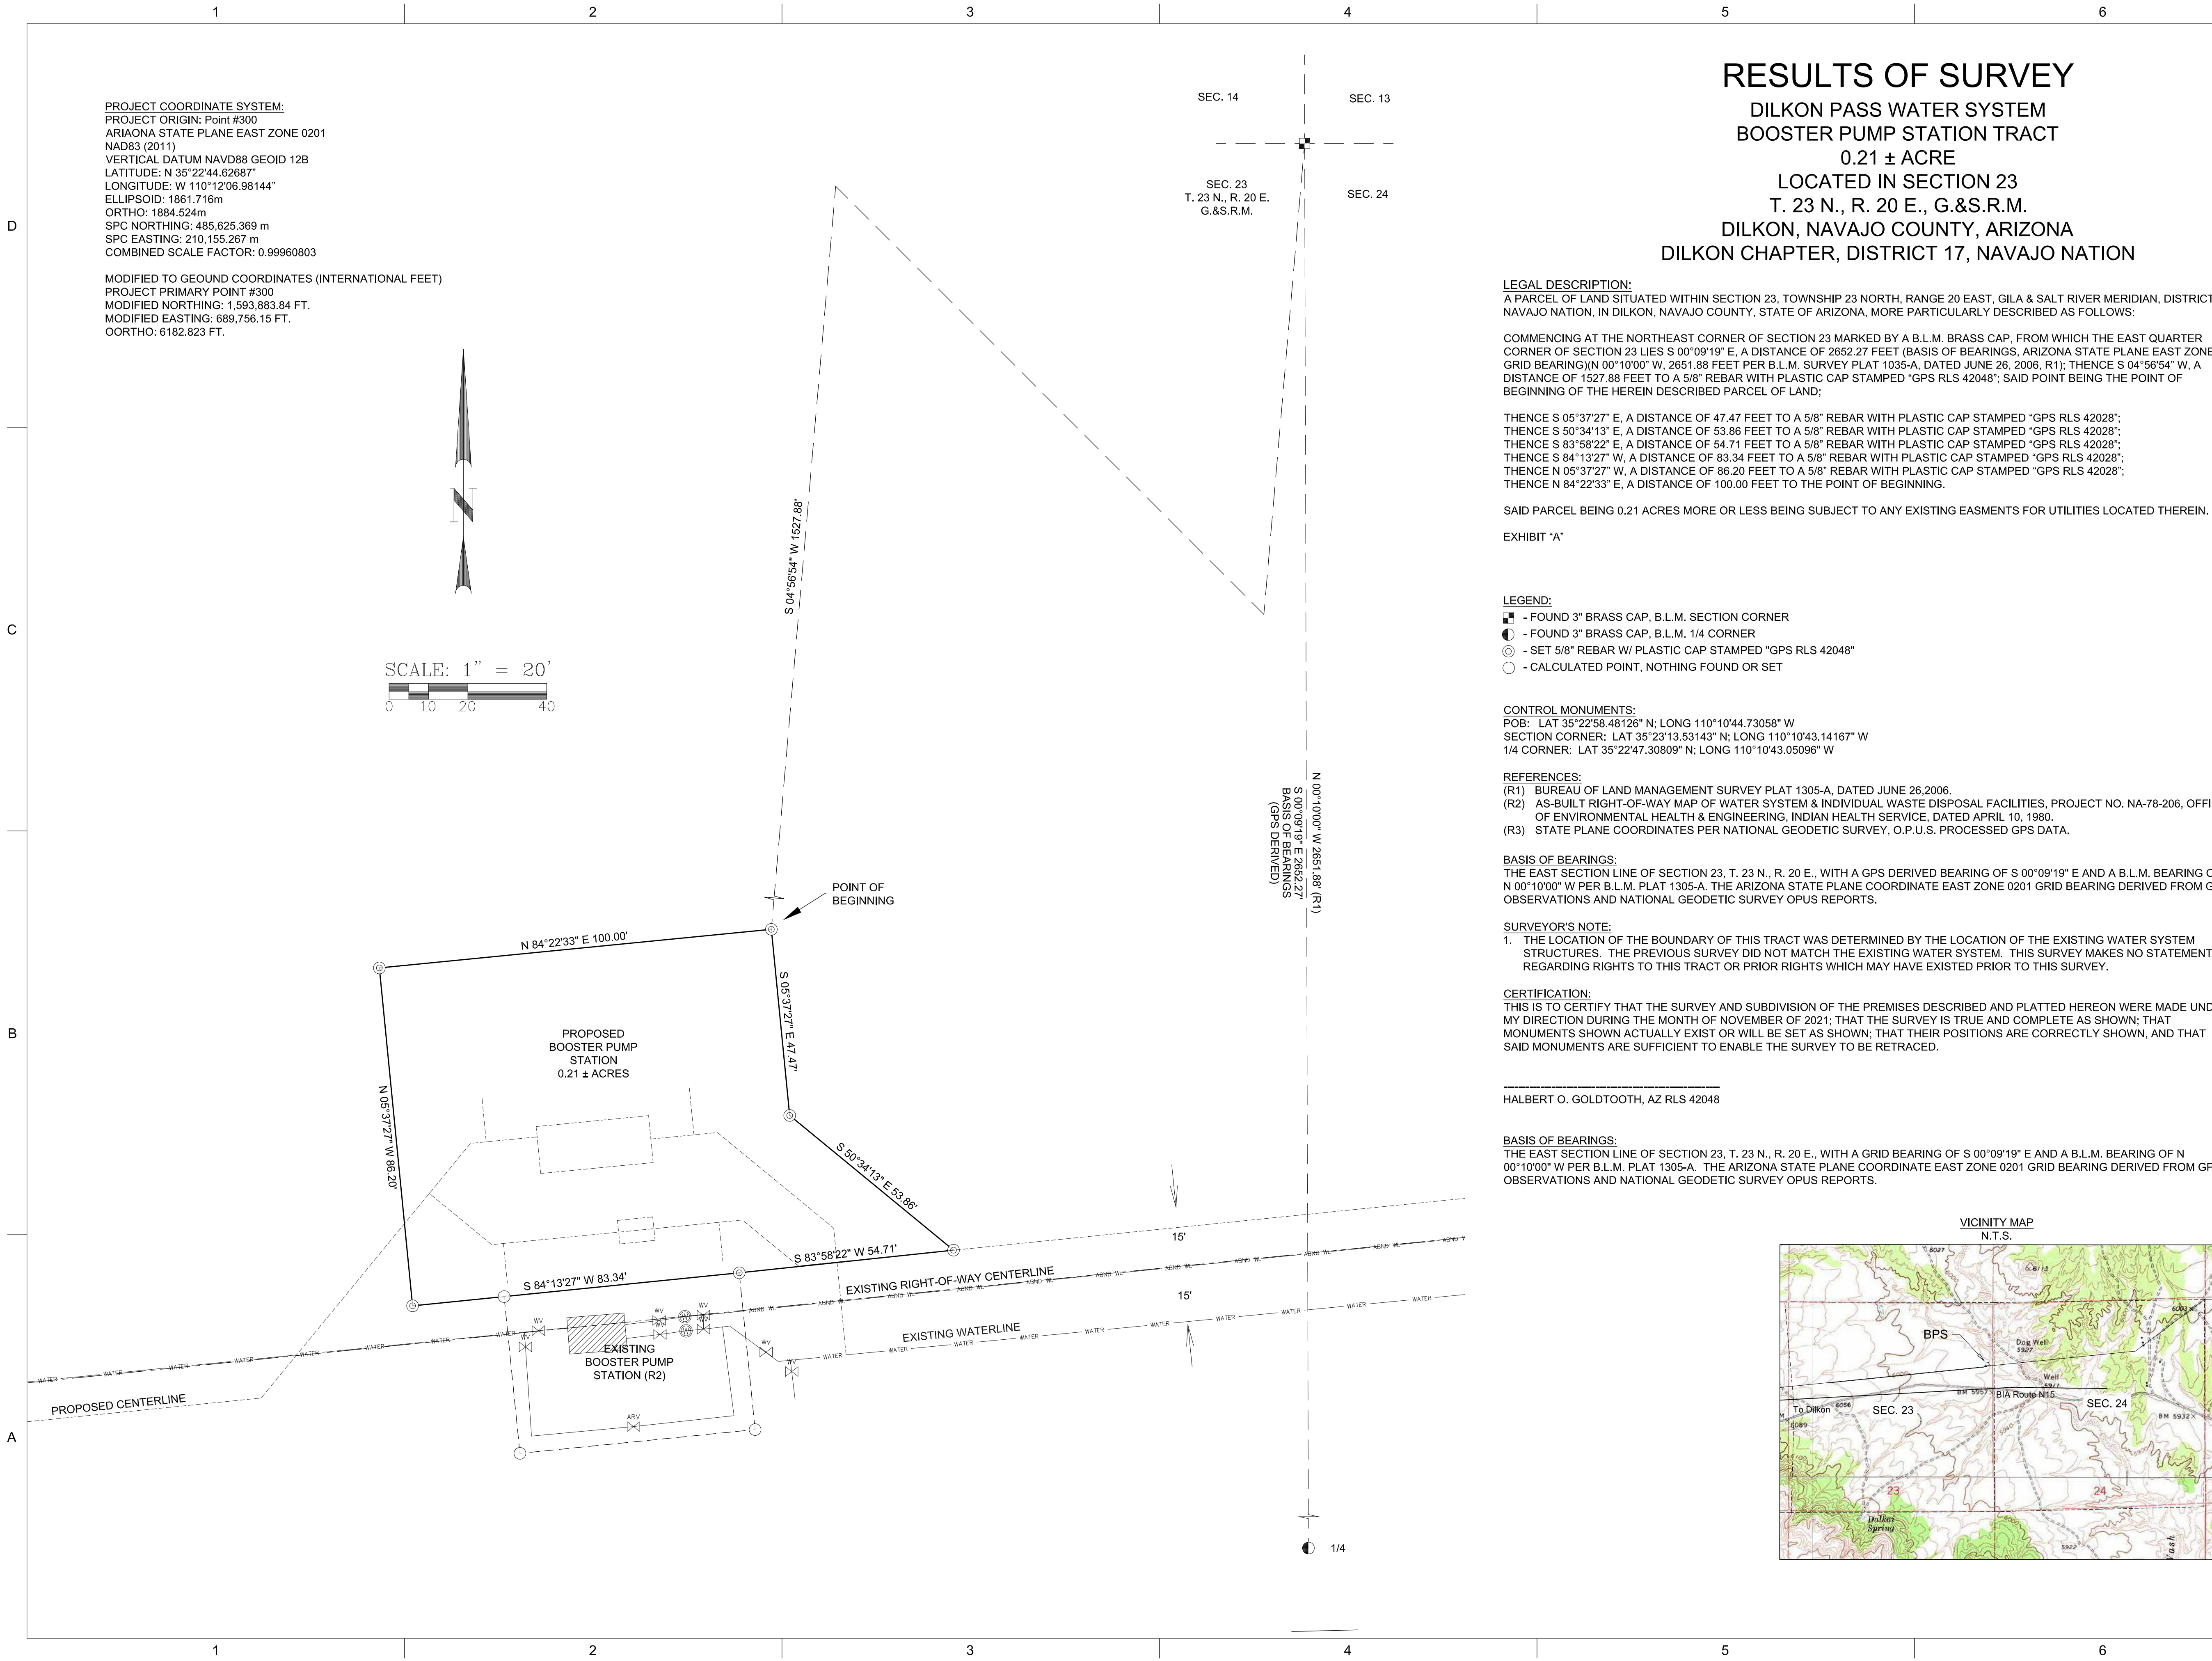

SALT LAKE CITY, UT



60% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED:
DRAWN: H.GOLDTOOTH
CHECKED: H.GOLDTOOTH
CHECKED:
APPROVED: H.GOLDTOOTH
FILENAME

BC PROJECT NUMBER
157520
CLIENT PROJECT NUMBER
00357.21

DRAWING NUMBER

SHEET NUMBER
OF 113

Path: C:\BCP\W\D2344906 FILENAME: CD-100.DWG PLOT DATE: 1/12/2022 9:55 AM CAD USER: TYLER PRIDEMORE



GENERAL NOTES

1. ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE. CONTRACTOR TO FIELD VERIFY AND POTHOLE AS REQUIRED TO COMPLETE THE WORK.
2. CONTRACTOR TO FIELD VERIFY LOCATION, ELEVATIONS, INVERTS, MATERIAL, DIMENSIONS AND CONDITION OF EXISTING UTILITIES.
3. SEE TABLE 2 / C-002 FOR COORDINATE CONTROL INFORMATION.

KEY NOTES

- 1 EXISTING PUMP HOUSE TO BE DEMOLISHED. REMOVE EXISTING EQUIPMENT AND RETURN TO OWNER PRIOR TO DEMOLITION.
- 2 EXISTING WATERLINE TO BE ABANDONED. CUT AND CAP EXISTING LINE, AS REQUIRED.
- 3 EXISTING SUBMERSIBLE PUMP MANHOLE. REMOVE EXISTING EQUIPMENT AND RETURN TO OWNER. REMAINING MANHOLE TO BE ABANDONED AND FILLED.
- 4 EXISTING FENCE TO BE REMOVED.
- 5 EXISTING CONCRETE SIDEWALK TO BE REMOVED.
- 6 EXISTING VALVE TO BE ABANDONED IN PLACE.
- 7 EXISTING PRV MANHOLE. REMOVE EXISTING EQUIPMENT AND RETURN TO OWNER. REMAINING MANHOLE TO BE ABANDONED AND FILLED.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

CD-100.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL DEMOLITION

PUMP STATION DEMOLITION SITE PLAN

DRAWING NUMBER


CD-100

0 SHEET NUMBER OF 60



Call at least two full working days before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.





Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

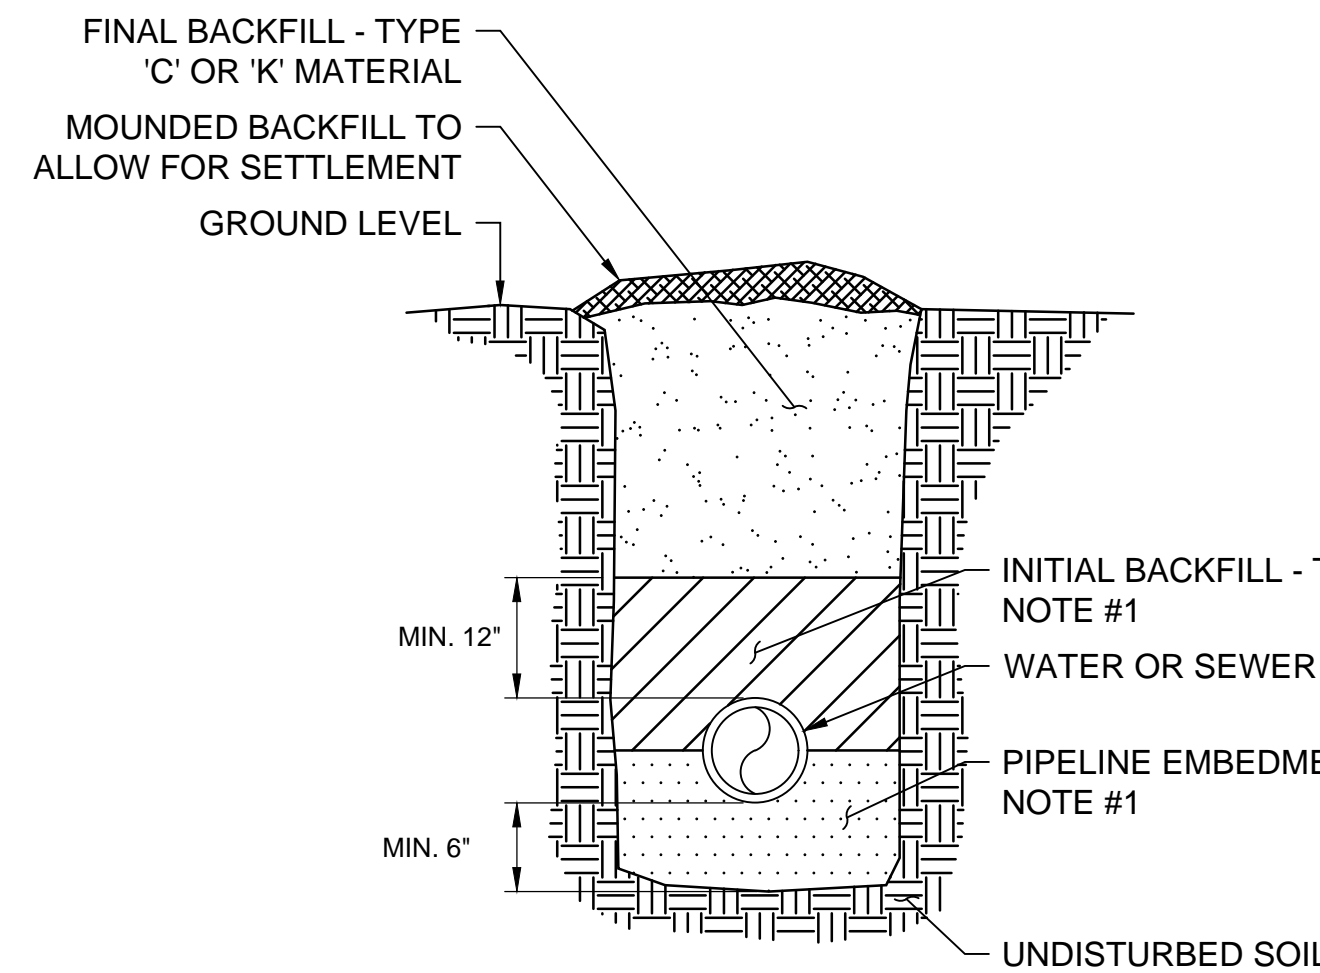

- NOTES:**
1. HAND COMPACTED IN 6" LIFTS FROM BOTTOM OF TRENCH TO 12" ABOVE PIPE CROWN.
 2. OPEN CUT OR PAVED OR GRAVEL ROADS (IF REQUIRED), BACK FILL MINIMUM COMPACTION 95% OPTIMUM DENSITY LIFTS.
 3. REPAVING AND REGRAVELING WILL BE DONE TO ROAD OWNER'S REQUIREMENTS.
 4. KEEP LOWER 5' OF TRENCH WALL VERTICAL, IF POSSIBLE. UPPER PART OF THE TRENCH WILL VARY IN WIDTH TO COMPENSATE FOR UNSTABLE SOIL. APPLICABLE O.S.H.A. REQUIREMENTS SHALL BE MET.

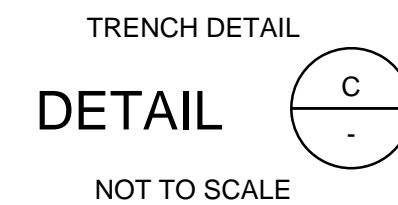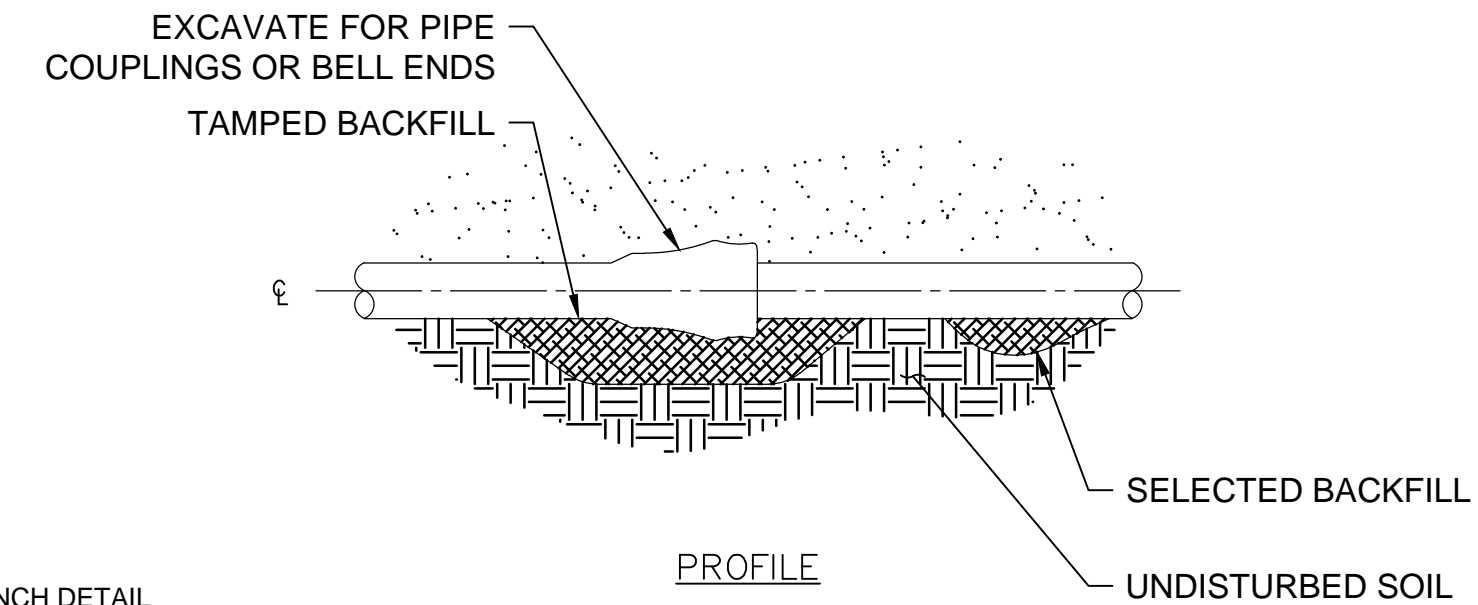

BILL OF MATERIALS		
ITEM	QUANTITY	DESCRIPTION
1	4	QUIK 4 CHAMBER: 34" W x 48" L x 12" H
2	4	QUIK 4 COMBO-END PLATE, SIZE: 34" W x 12" H

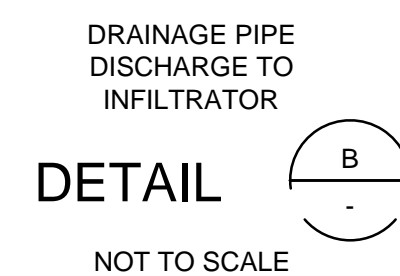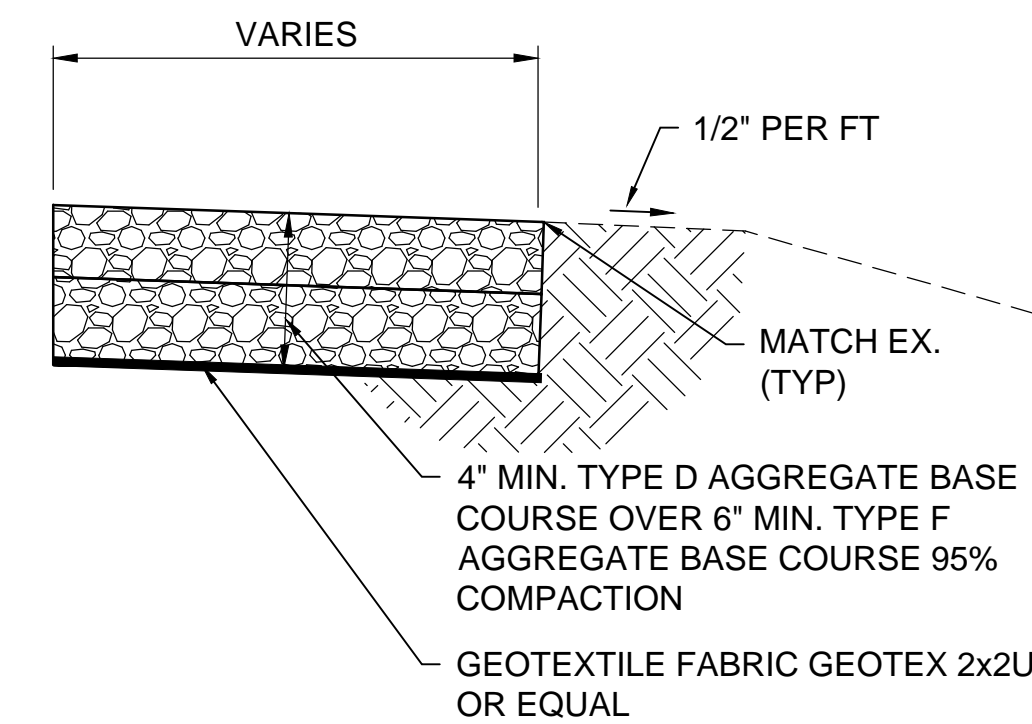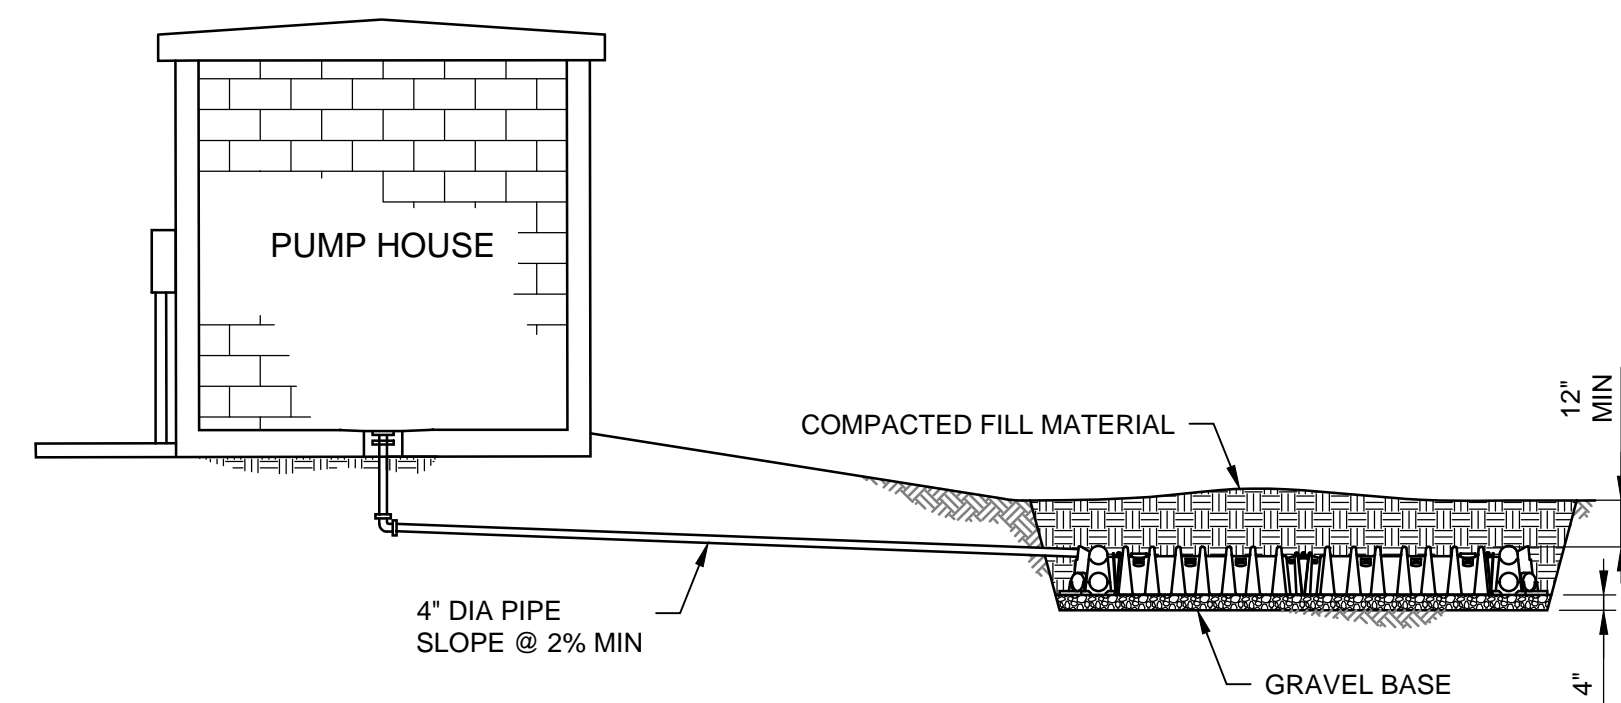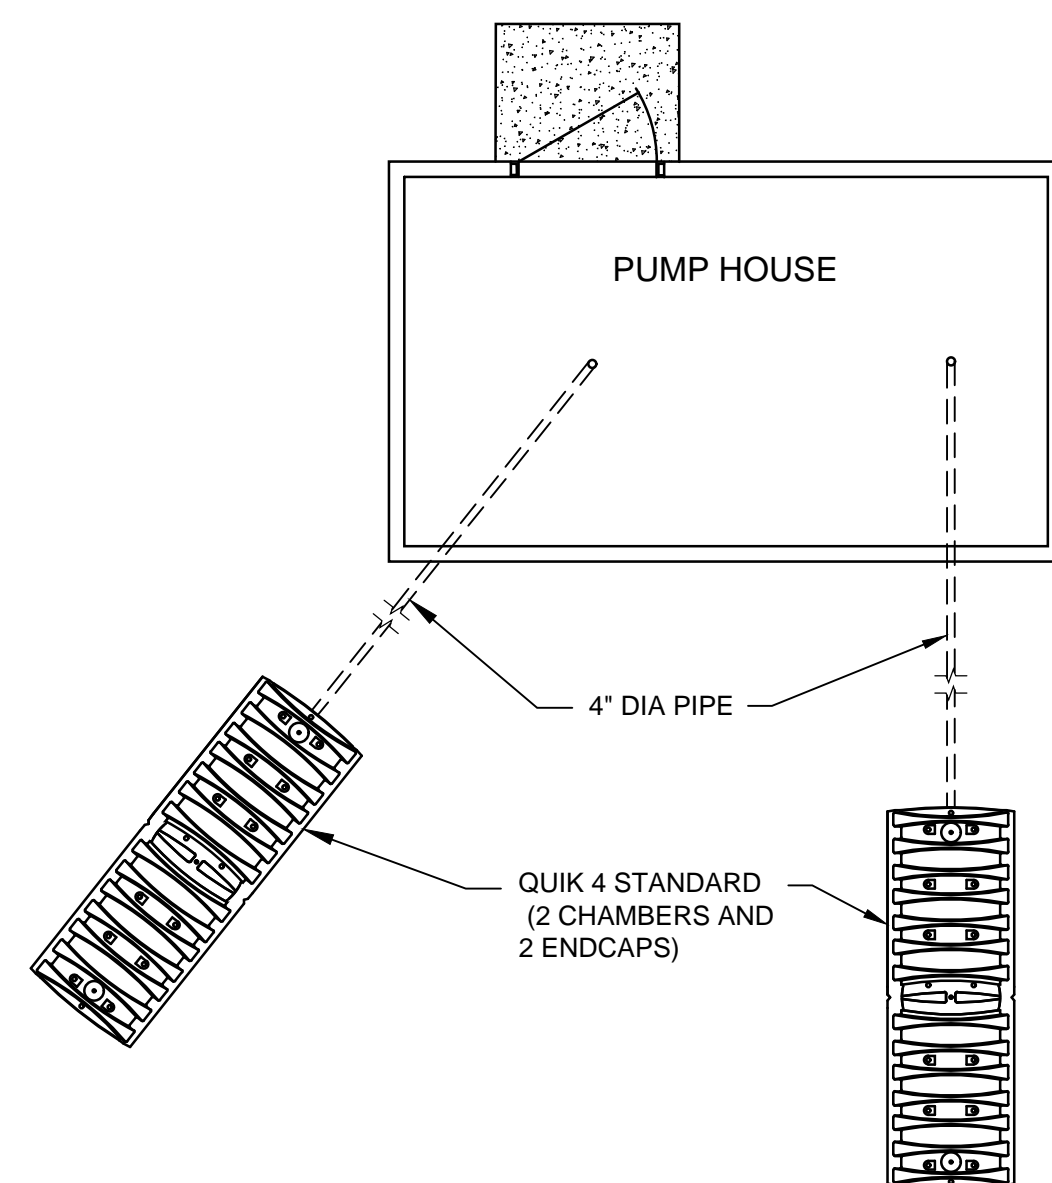

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

[illegible]

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE
DRAWN: T. PRIDEMORE
CHECKED: C. WILLMORE
CHECKED: - -
APPROVED: S. BRENCHLEY

FILENAME
C-003.dwg
BC PROJECT NUMBER
157520
CLIENT PROJECT NUMBER



CIVIL

MISCELLANEOUS DETAILS - 2

DRAWING NUMBER
C-003

0 SHEET NUMBER OF 60

Path: C:\BCP\W\D2344906 FILENAME: C-100.DWG PLOT DATE: 1/12/2022 10:03 AM CAD USER: TYLER PRIDEMORE

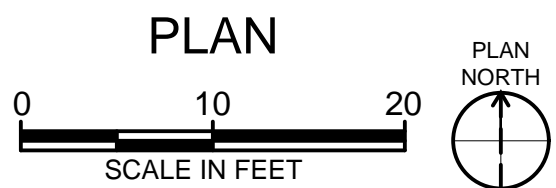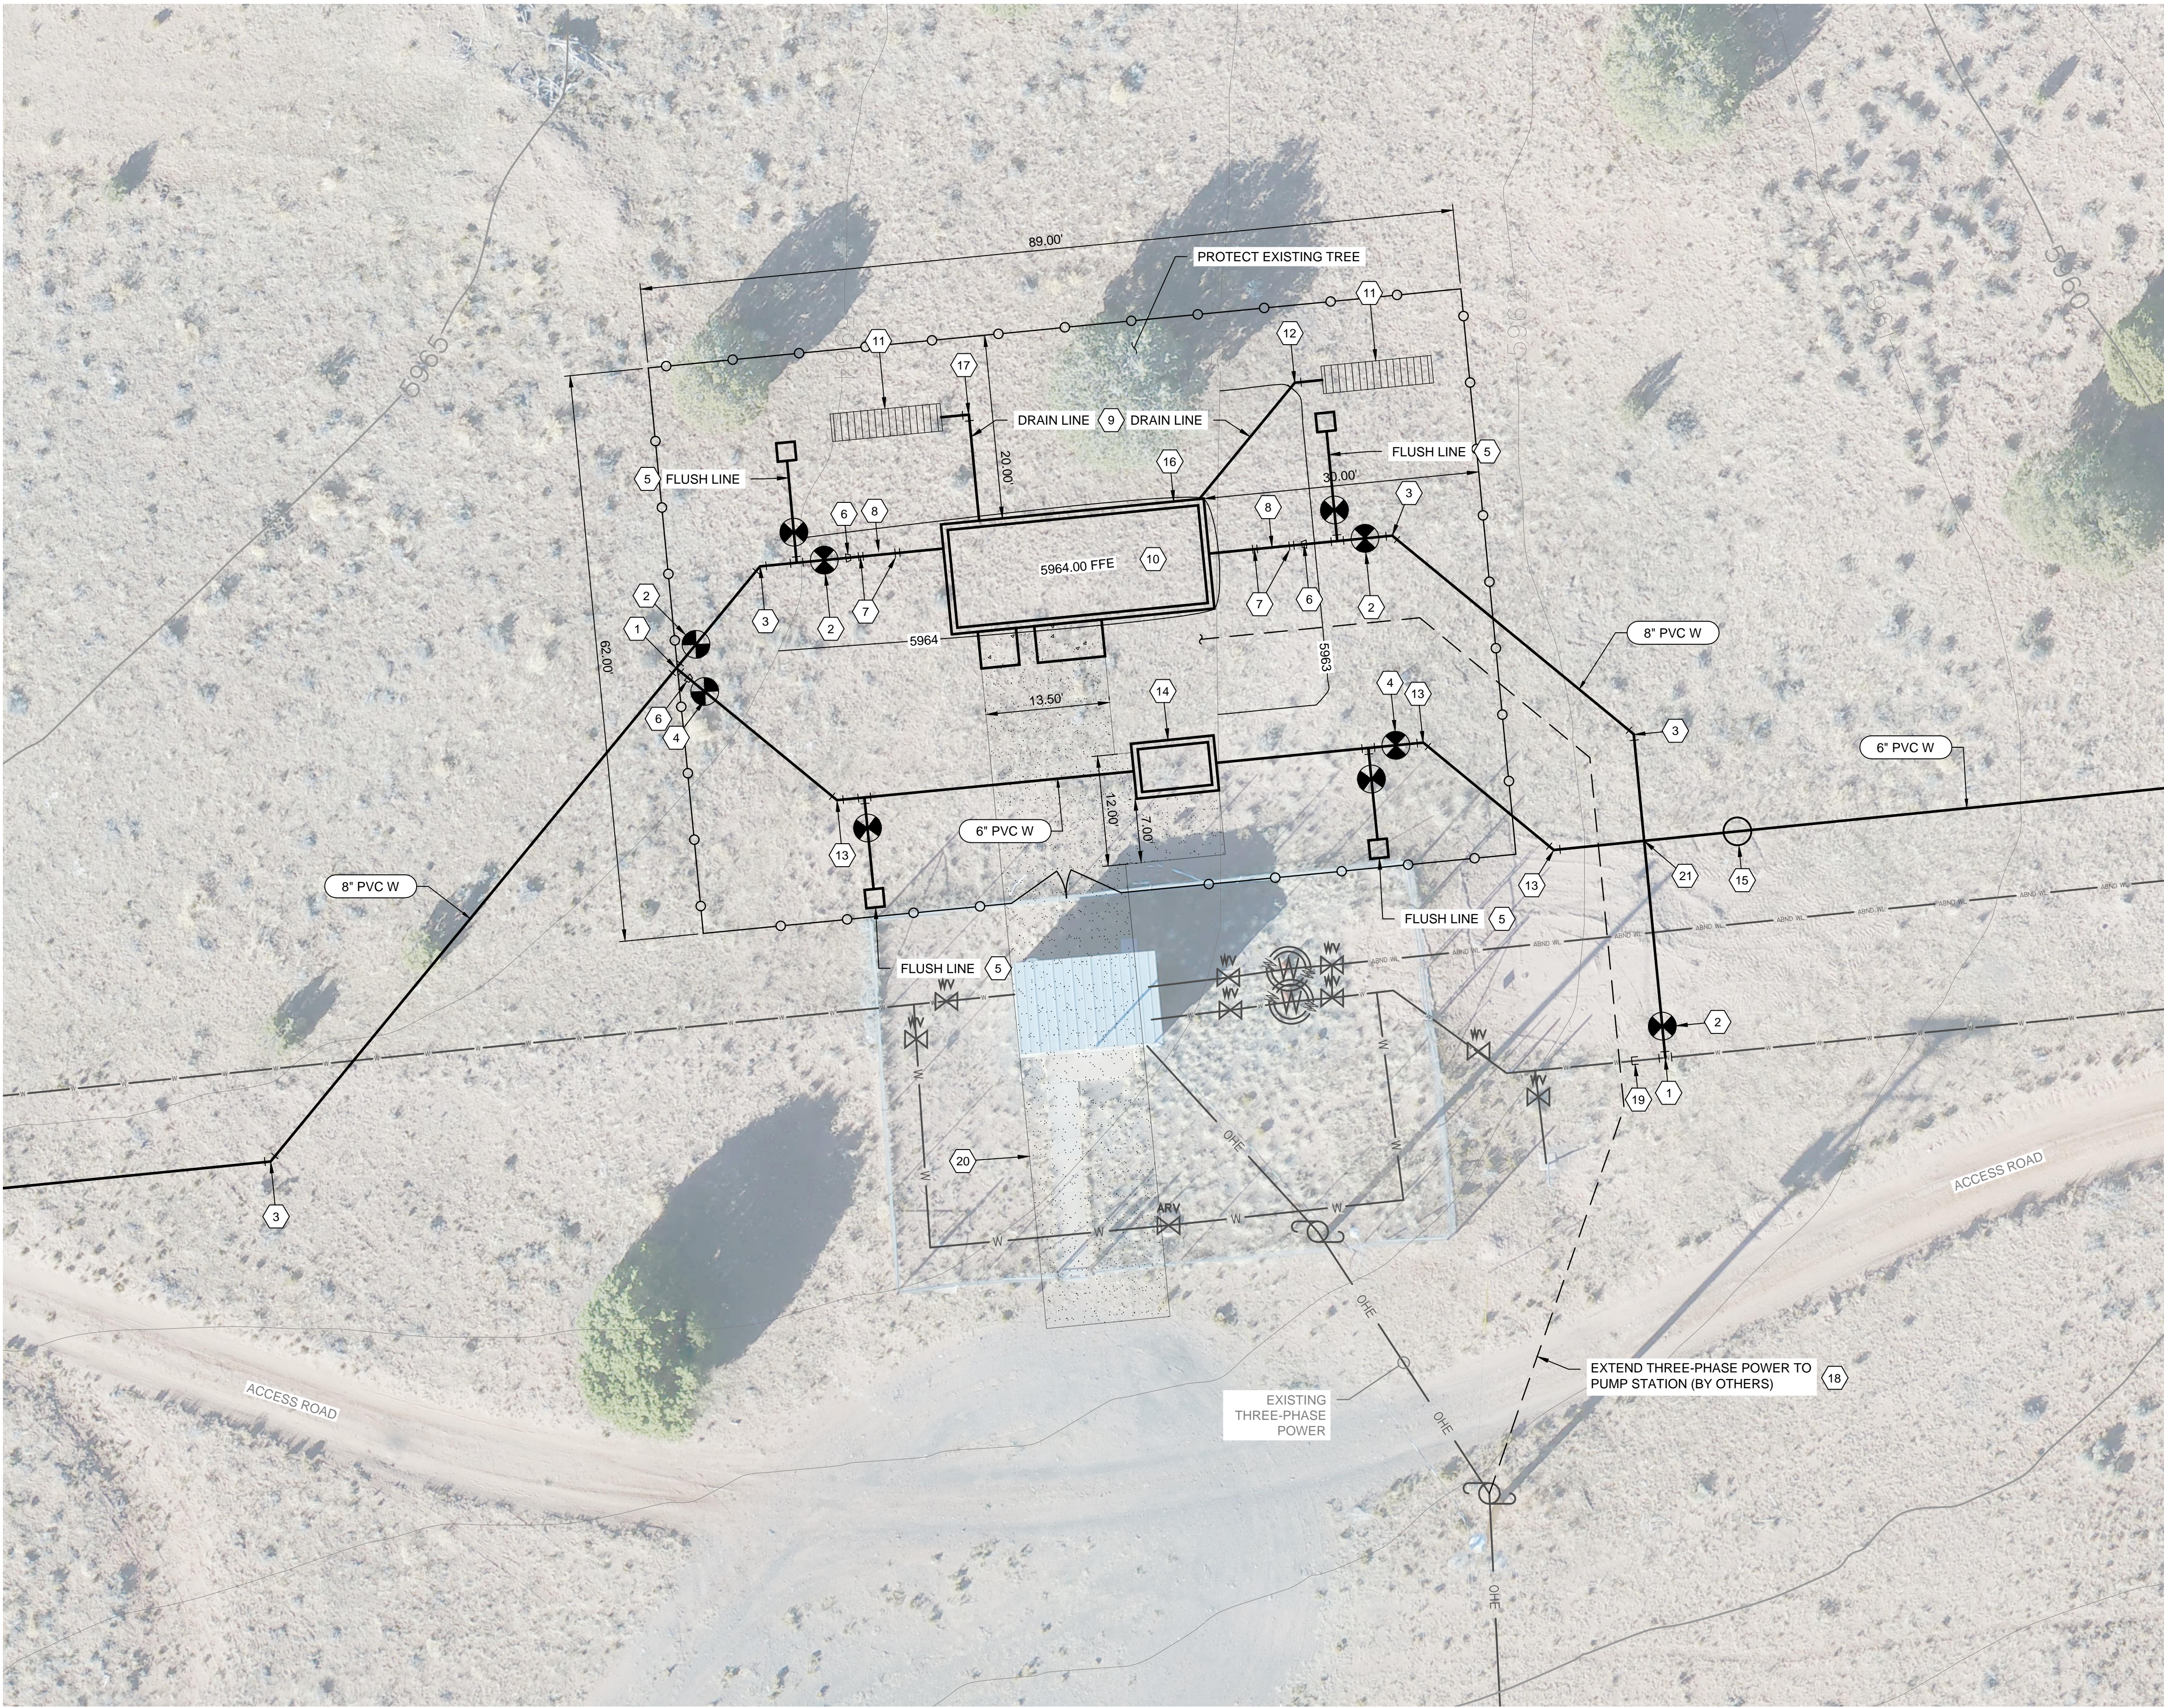

GENERAL NOTES

1. ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE. CONTRACTOR TO FIELD VERIFY AND POTHOLE AS REQUIRED TO COMPLETE THE WORK.
2. CONTRACTOR TO FIELD VERIFY LOCATION, ELEVATIONS, INVERTS, MATERIAL, DIMENSIONS AND CONDITION OF EXISTING UTILITIES.
3. CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES AND CROSSES PER NTUA STD DWG WS-19.
4. CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
5. CONTRACTOR TO INSTALL MARKER POST PER NTUA STD DWG WS-13.
6. EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE SHOWN IN DETAIL B/C-002.
7. SEE V-001 FOR COORDINATE CONTROL INFORMATION.
8. ALL YARD PIPING TO HAVE MJ X MJ FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.

KEY NOTES

- 1 8" X 8" DI TEE
- 2 8" DIA GATE VALVE
- 3 8" DI 45D FITTING
- 4 6" DIA GATE VALVE
- 5 2" DIA FLUSH LINE, SEE NTUA STD DWG WS-11
- 6 8" X 6" REDUCER
- 7 6" DIA ROMAC STYLE 501 FLEXIBLE COUPLING
- 8 6" DIA DIP PC 350
- 9 4" DIA HDPE DRAIN LINE
- 10 CMU PUMPHOUSE, REFERENCE ARCHITECTURAL AND STRUCTURAL PLANS
- 11 DRAINAGE INFILTRATORS, SEE DETAIL B / SHEET C-003
- 12 4" 45D FITTING
- 13 6" 45D FITTING
- 14 6" X 9" PRV ASSEMBLY PER IHS STANDARD DETAIL WS-4B AND WS-4C.
- 15 COMBO AIR VALVE, SEE NTUA STD DETAL WS-10
- 16 ELECTRICAL CABINET
- 17 4" 90D FITTING
- 18 4" SCHEDULE 200 PVC CONDUIT FOR ELECTRICAL POWER LINE
- 19 CUT & CAP EXISTING PIPE ONCE NEW BOOSTER PUMP STATION HAS BEEN COMPLETED AND BROUGHT ONLINE
- 20 GRAVEL ROAD, SEE DETAIL D / SHEET C-003
- 21 WATER MAIN LOOP, SEE DETAIL A / SHEET C-003



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: C. WILLMORE
DRAWN: T. PRIDEMORE
CHECKED: C. WILLMORE
CHECKED: --
APPROVED: S. BRENCHLEY
FILENAME: C-100.dwg
BC PROJECT NUMBER: 157520
CLIENT PROJECT NUMBER:

CIVIL

DILKON PASS PUMP STATION SITE PLAN

DRAWING NUMBER

C-100


0 SHEET NUMBER OF 60

Call at least two full working days before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-110.DWG PLOT DATE: 1/12/2022 10:02 AM CAD USER: TYLER PRIDEMORE

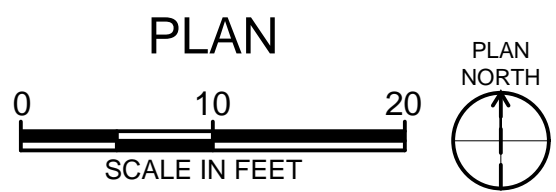

GENERAL NOTES

1. ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE. CONTRACTOR TO FIELD VERIFY AND POTHOLE AS REQUIRED TO COMPLETE THE WORK.
2. CONTRACTOR TO FIELD VERIFY LOCATION, ELEVATIONS, INVERTS, MATERIAL, DIMENSIONS AND CONDITION OF EXISTING UTILITIES.
3. CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES AND CROSSES PER NTUA STD DWG WS-19.
4. CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
5. CONTRACTOR TO INSTALL MARKER POST PER NTUA STD DWG WS-13.
6. EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE SHOWN IN DETAIL B/C-002.
7. SEE V-001 FOR COORDINATE CONTROL INFORMATION.
8. ALL YARD PIPING TO HAVE MJ x MJ FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.

KEY NOTES

- 1 6" 90d BEND
- 2 CUT & CAP EXISTING WATER MAIN
- 3 6" DIA GATE VALVE PER NTUA STD DWG WS-14 AND SECTION 15102
- 4 5' MANHOLE W/ 4" CHECK VALVE AND TWO (2) REDUCERS. SEE DETAIL A / SHEET C-002
- 5 2" DIA DI PC 350 FLUSH LINE, SEE NTUA STD DWG WS-11
- 6 REMOVE EXISTING 6" PVC PIPE



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHEY

FILENAME

C-110.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

CHECK VALVE SITE
PLAN

DRAWING NUMBER

C-110


0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-200.DWG PLOT DATE: 1/5/2022 10:13 AM CAD USER: TYLER PRIDEMORE

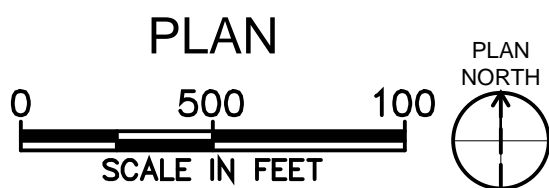

SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: C. WILLMORE
DRAWN: T. PRIDEMORE
CHECKED: C. WILLMORE
CHECKED: - -
APPROVED: S. BRENCHELY

FILENAME
C-200.dwg
BC PROJECT NUMBER
157520
CLIENT PROJECT NUMBER

CIVIL

KEY MAP

Call at least two full working days before you begin excavation.


ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100


DRAWING NUMBER
C-200

0 SHEET NUMBER OF 60

Path: C:\BCP\W\D2344906 FILENAME: C-201.DWG PLOT DATE: 1/12/2022 10:02 AM CAD USER: TYLER PRIDEMORE

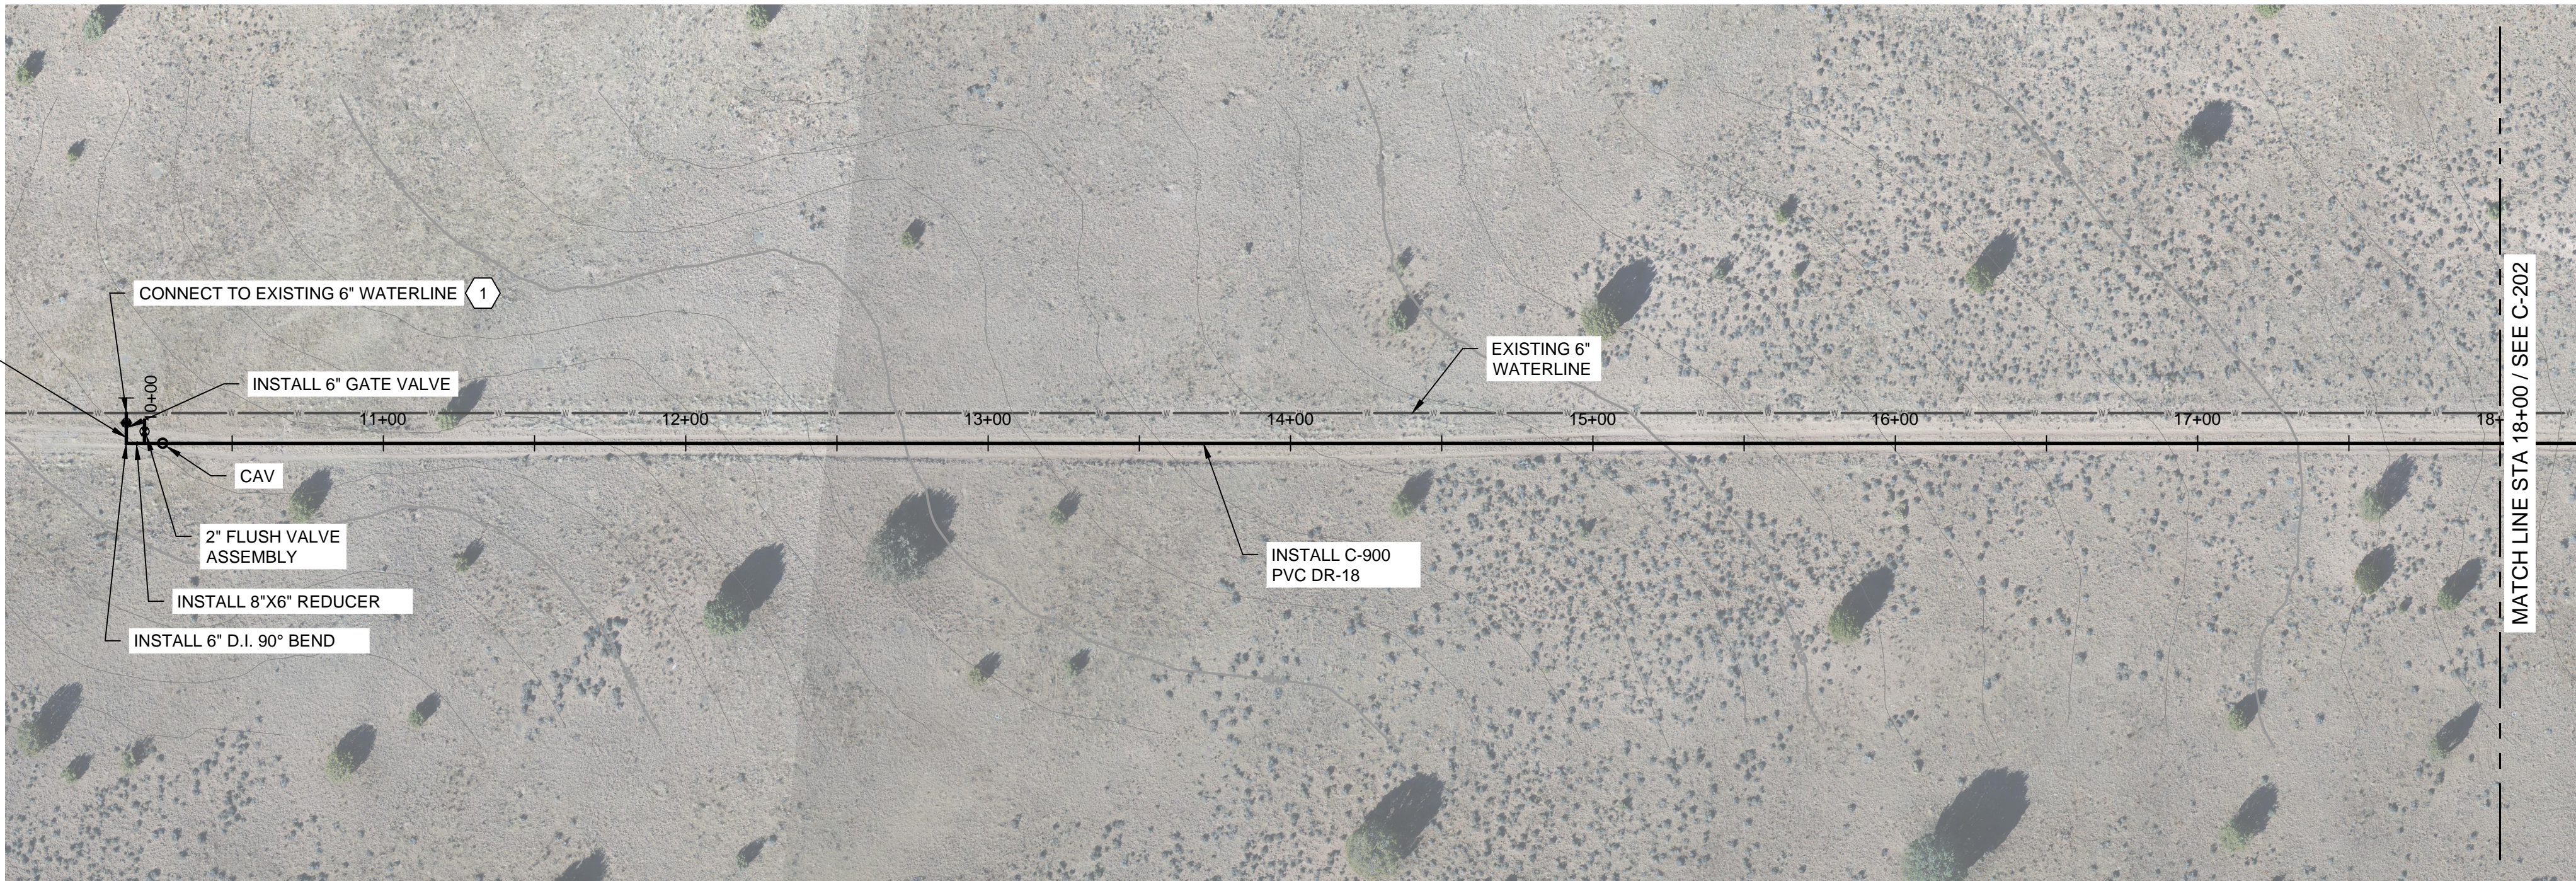

STA 10+00 - STA 18+00
PLAN

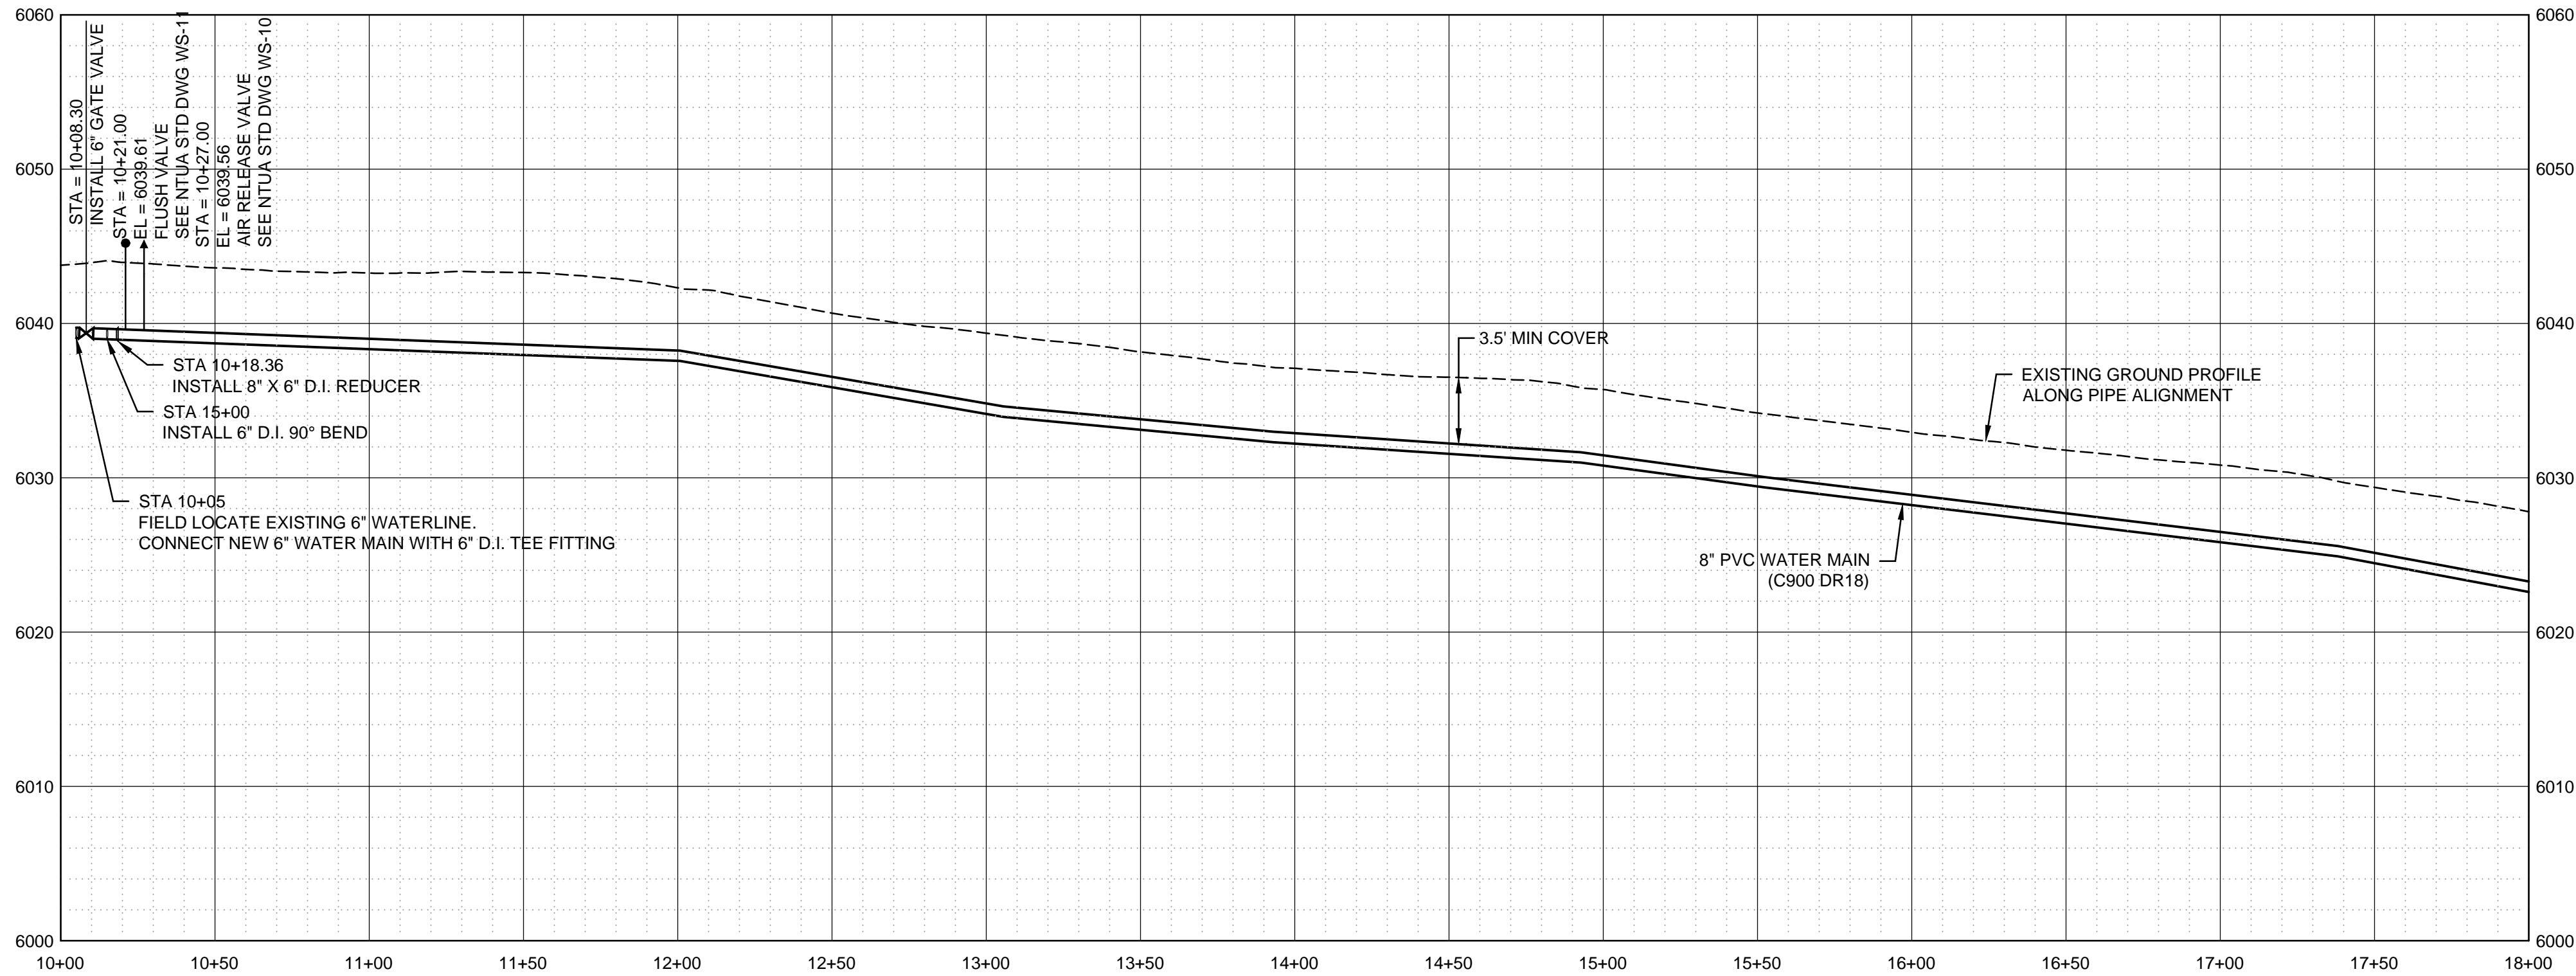

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

- ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POT HOLE AS REQUIRED TO COMPLETE THE WORK.
- CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
- CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
- CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
- CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
- EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
- DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
- ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.

KEY NOTES

- CAP EXISTING 6" WATERLINE EAST ONCE NEW 8" LINE AND PUMPHOUSE ARE APPROVED AND IN OPERATION.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: --

APPROVED: S. BRENCHELY

FILENAME

C-201.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE
- STA 10+00 TO
18+00

DRAWING NUMBER

C-201



0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-202.DWG PLOT DATE: 1/12/2022 10:01 AM CAD USER: TYLER PRIDEMORE

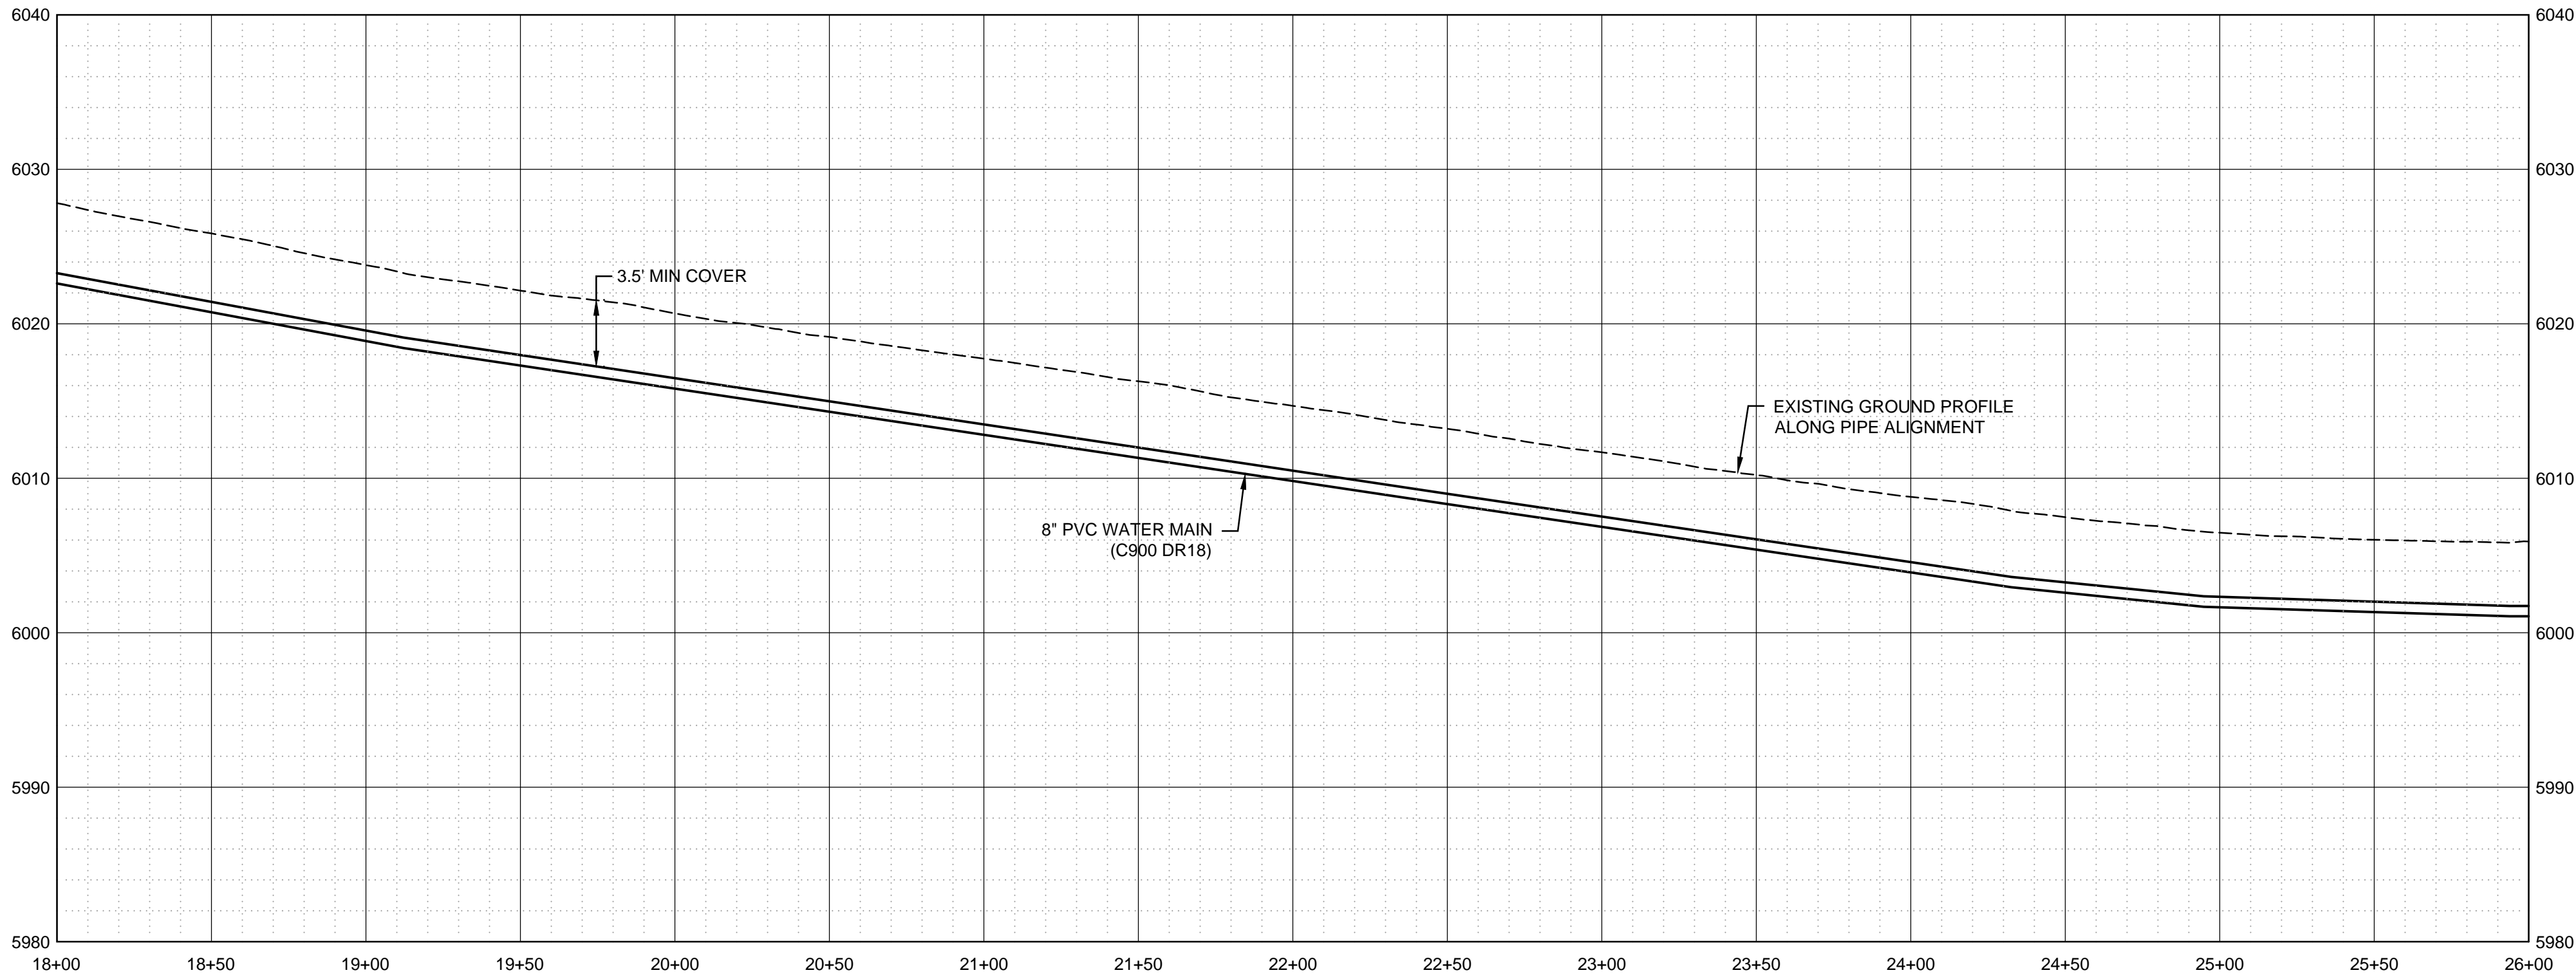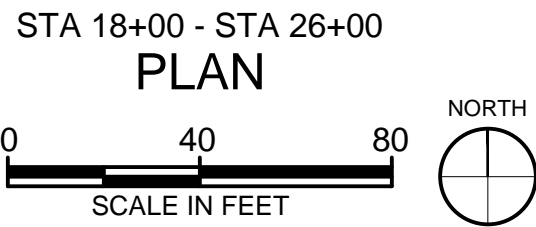

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

1. ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POT HOLE AS REQUIRED TO COMPLETE THE WORK.
2. CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
3. CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
4. CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
5. CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
6. EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
7. DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
8. ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHEY

FILENAME

C-202.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE
- STA 18+00 TO
26+00

DRAWING NUMBER

C-202




0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-203.DWG PLOT DATE: 1/12/2022 10:01 AM CAD USER: TYLER PRIDEMORE

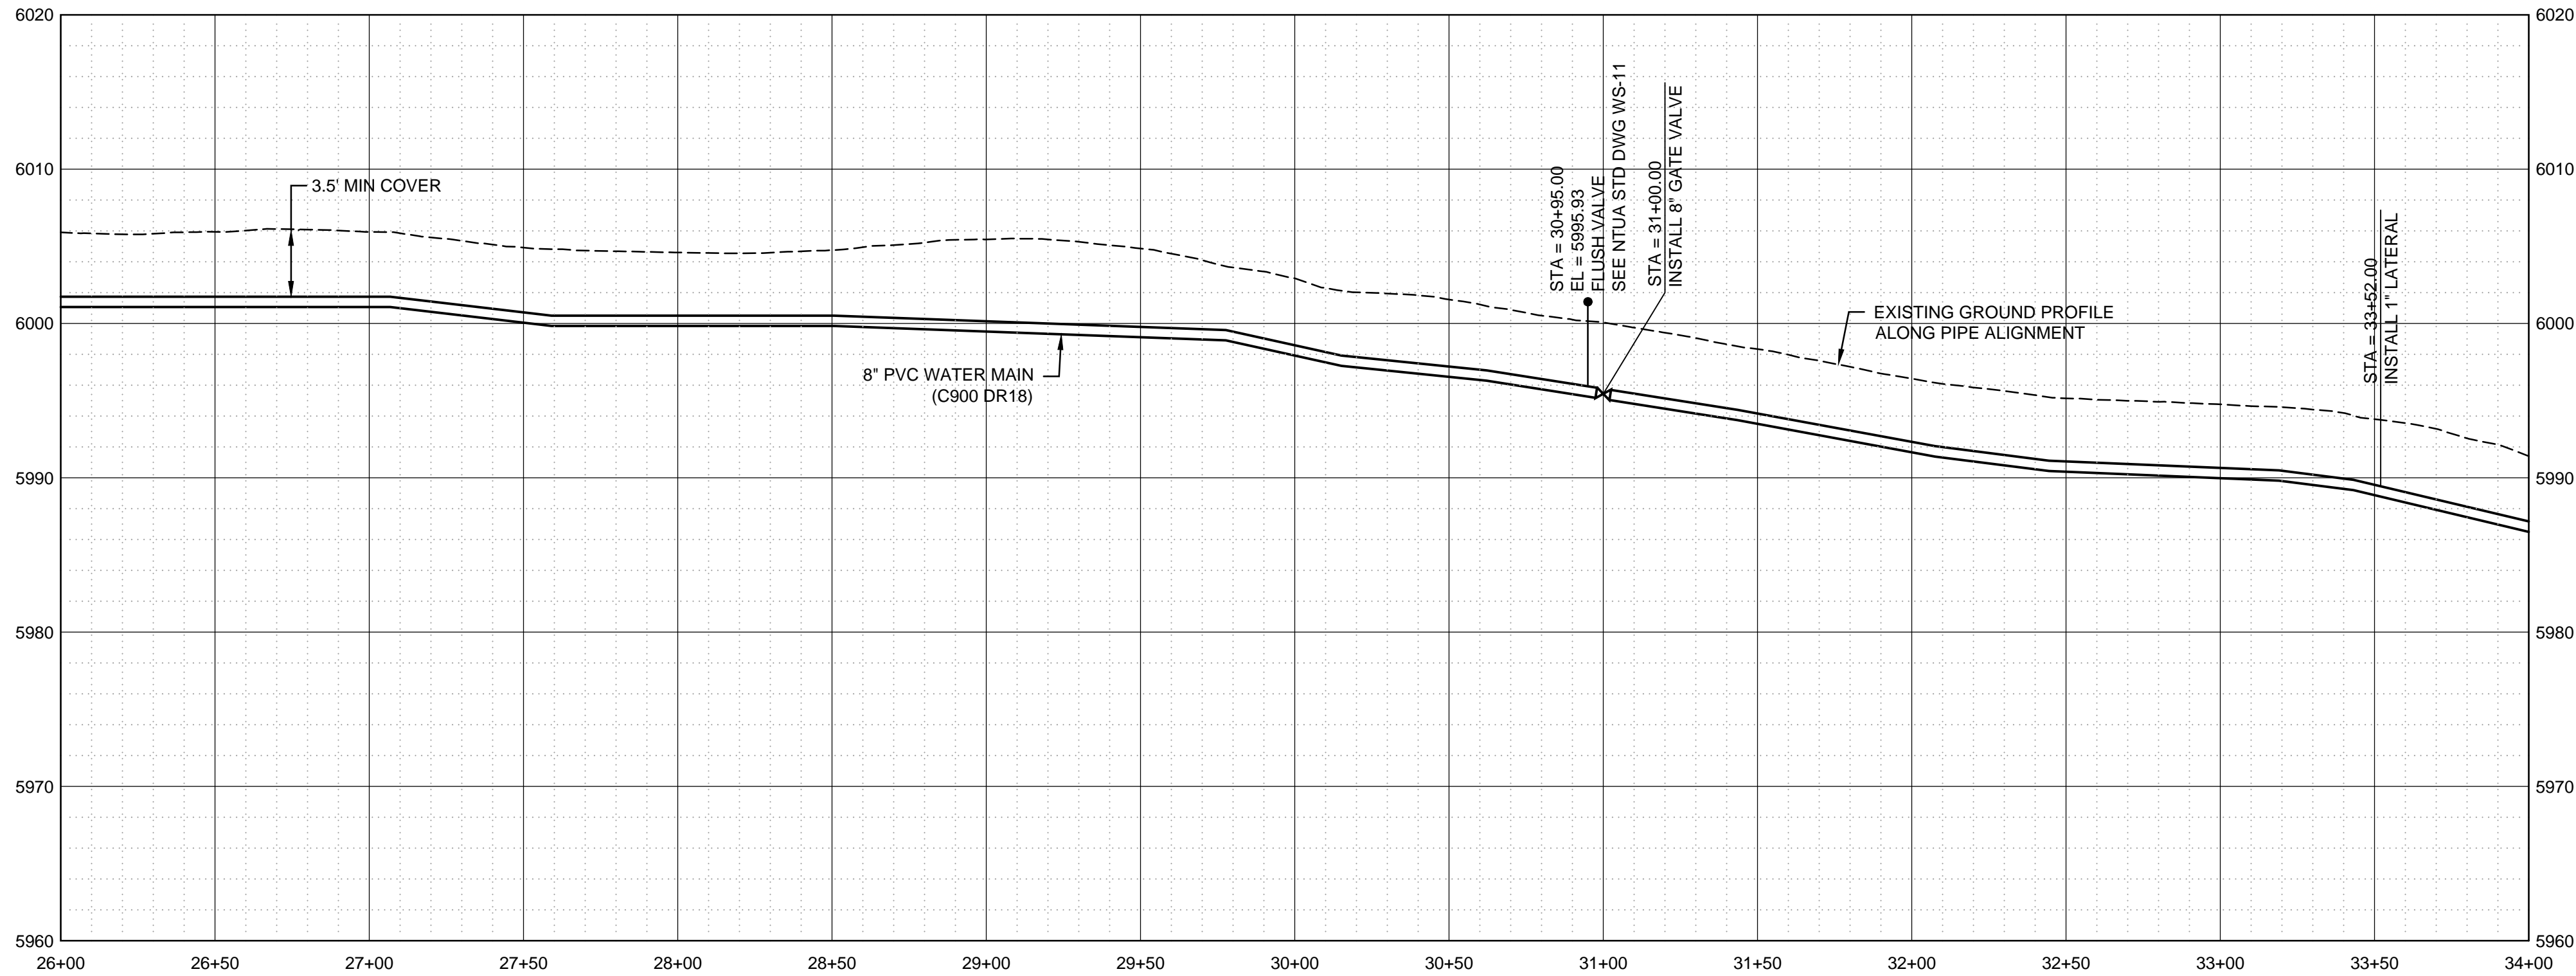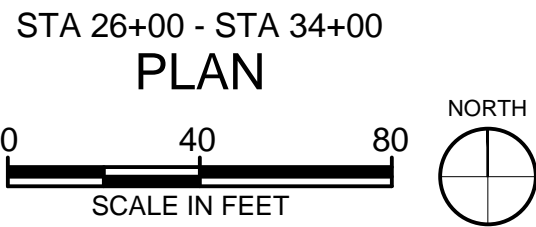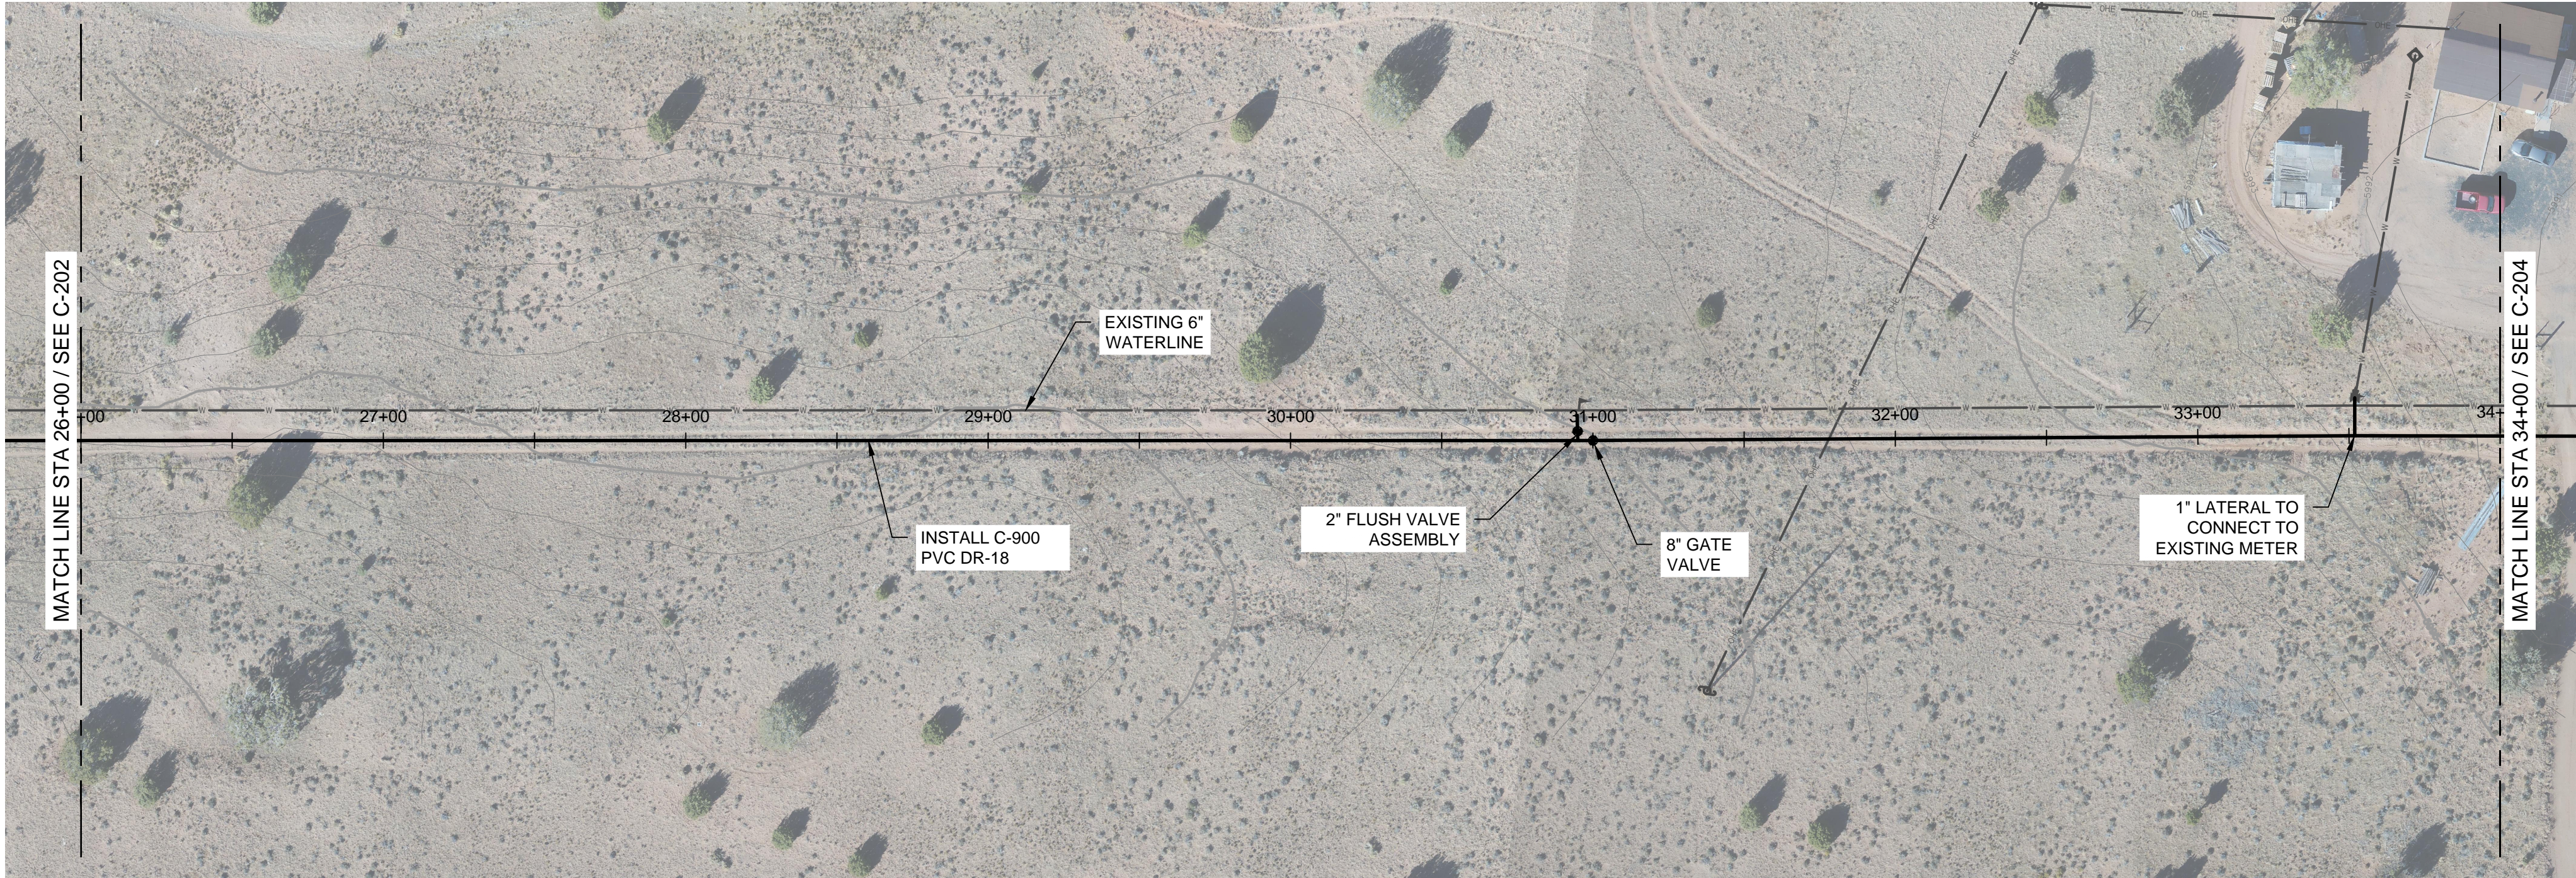

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

1. ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POTHOLE AS REQUIRED TO COMPLETE THE WORK.
2. CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
3. CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
4. CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
5. CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
6. EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
7. DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
8. ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELEY

FILENAME

C-203.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - STA 26+00 TO 34+00

DRAWING NUMBER

C-203




0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-204.DWG PLOT DATE: 1/12/2022 10:00 AM CAD USER: TYLER PRIDEMORE

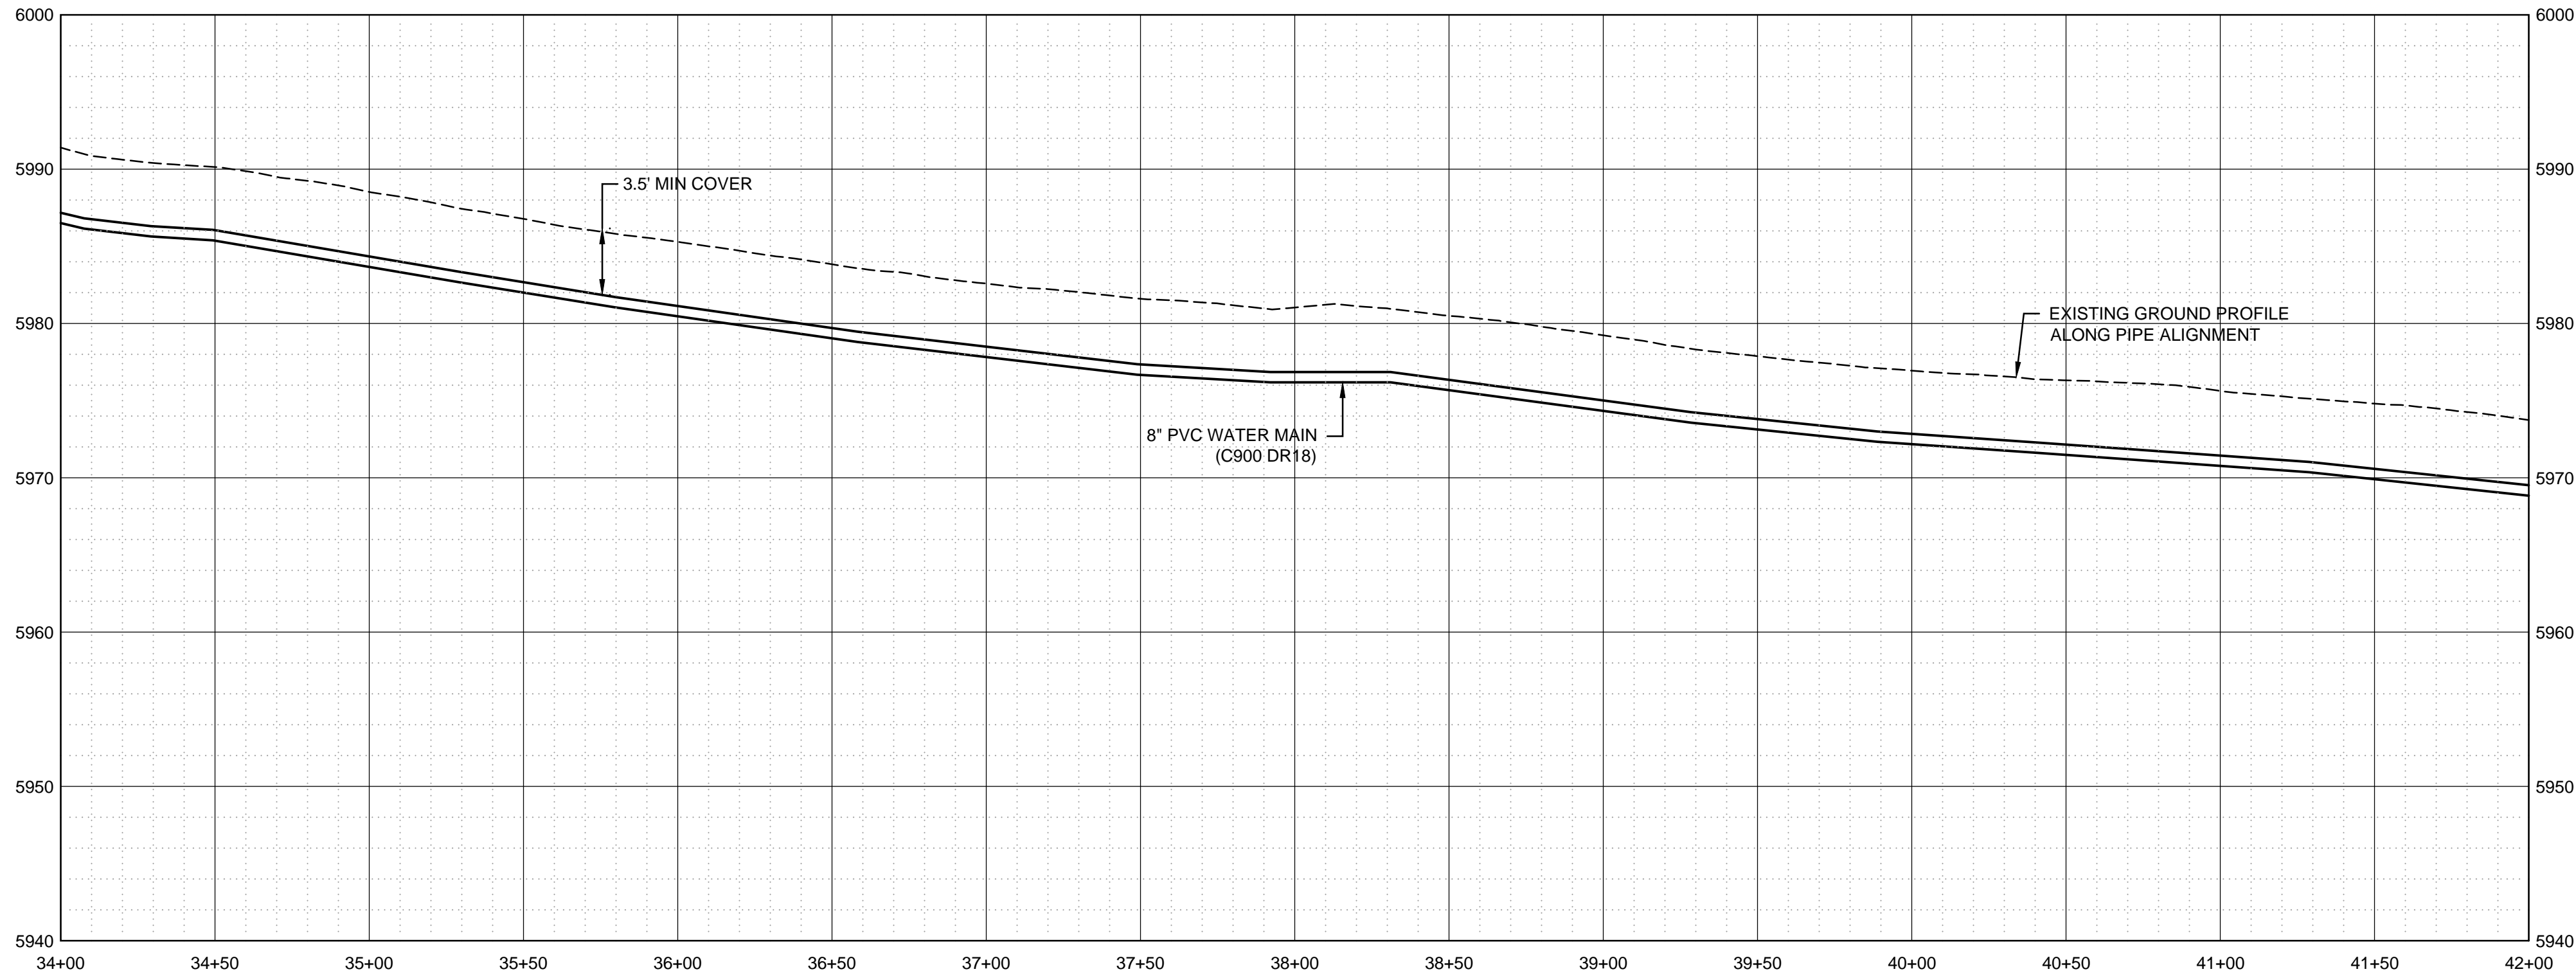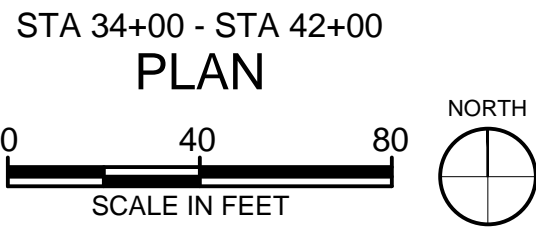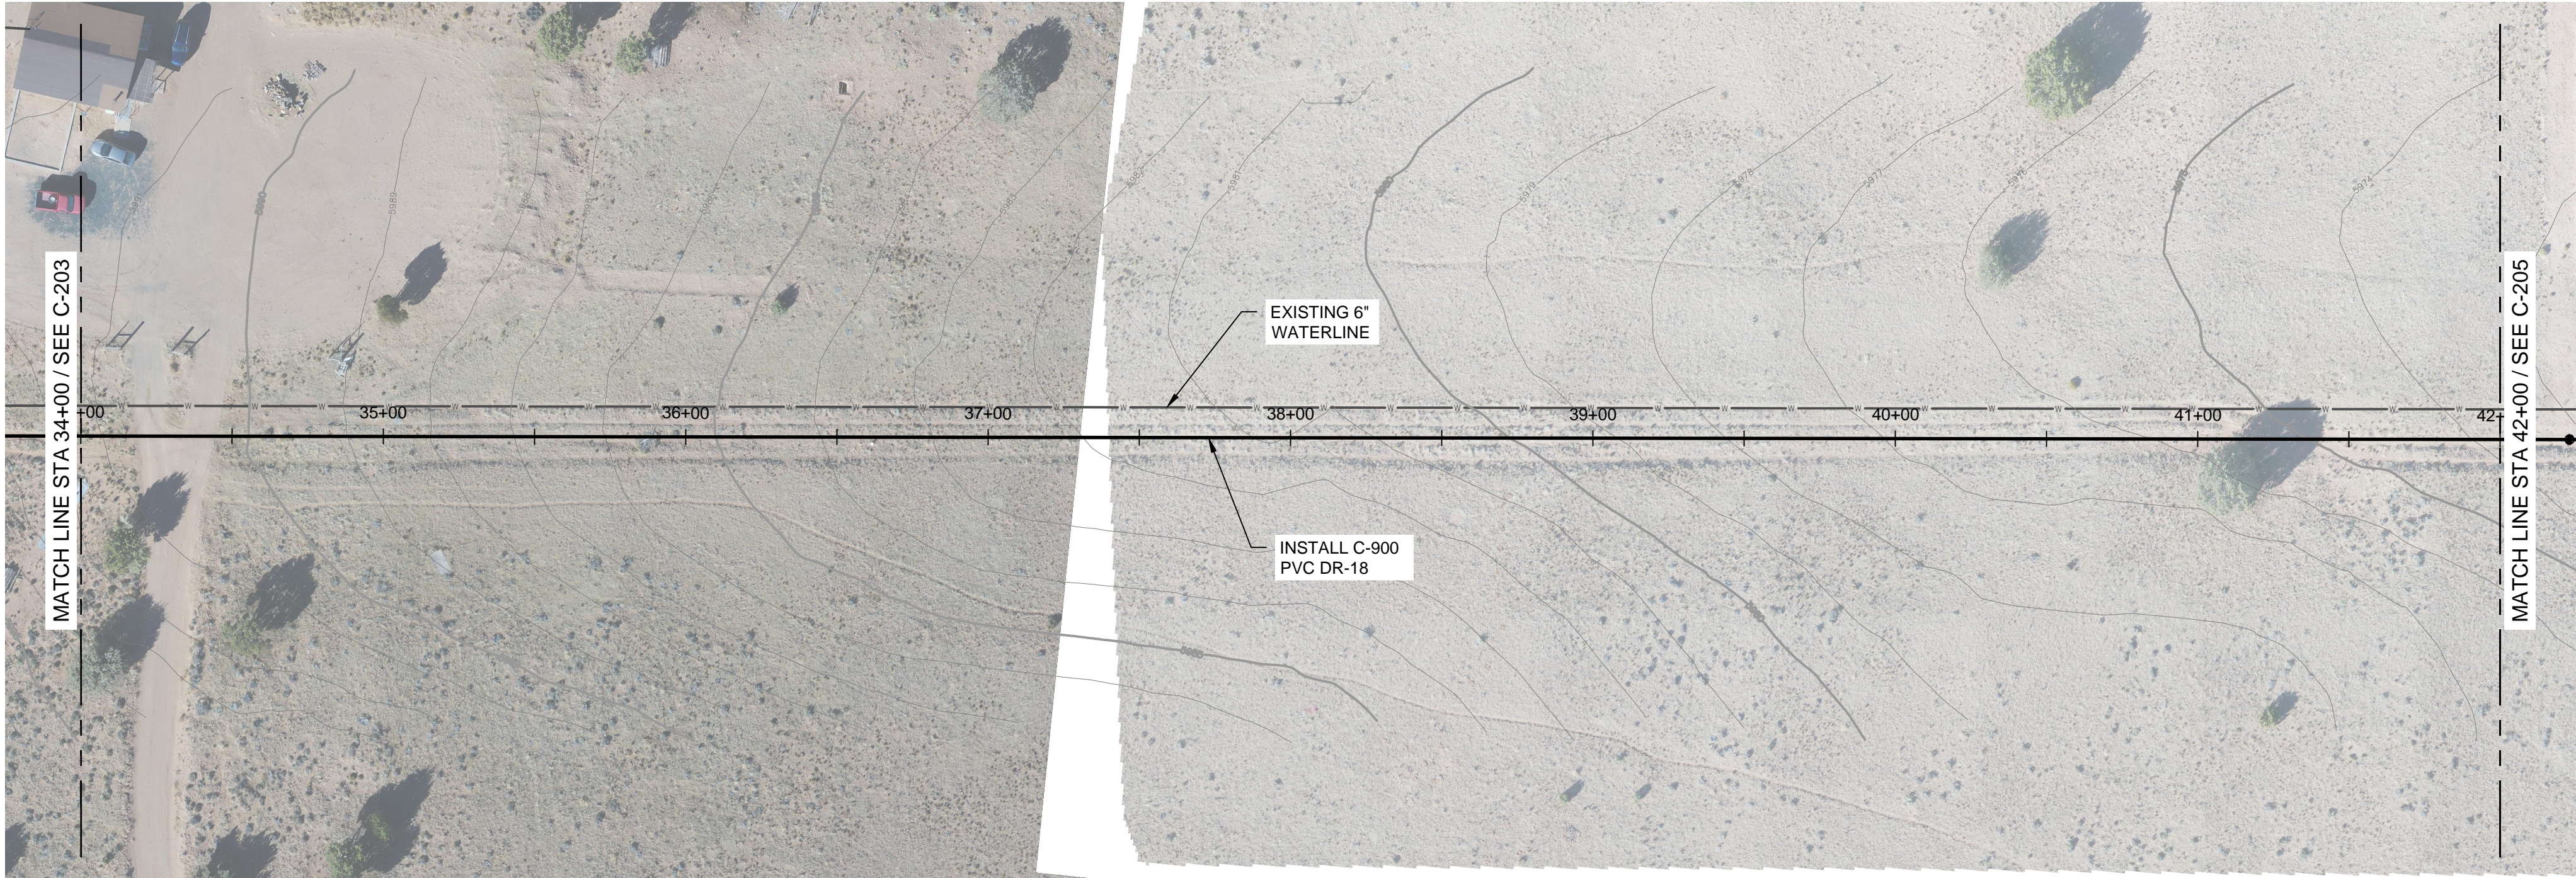

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

1. ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POT HOLE AS REQUIRED TO COMPLETE THE WORK.
2. CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
3. CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
4. CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
5. CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
6. EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
7. DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
8. ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

C-204.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - STA 34+00 TO 42+00

DRAWING NUMBER

C-204


0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.


ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-205.DWG PLOT DATE: 1/12/2022 10:00 AM CAD USER: TYLER PRIDEMORE

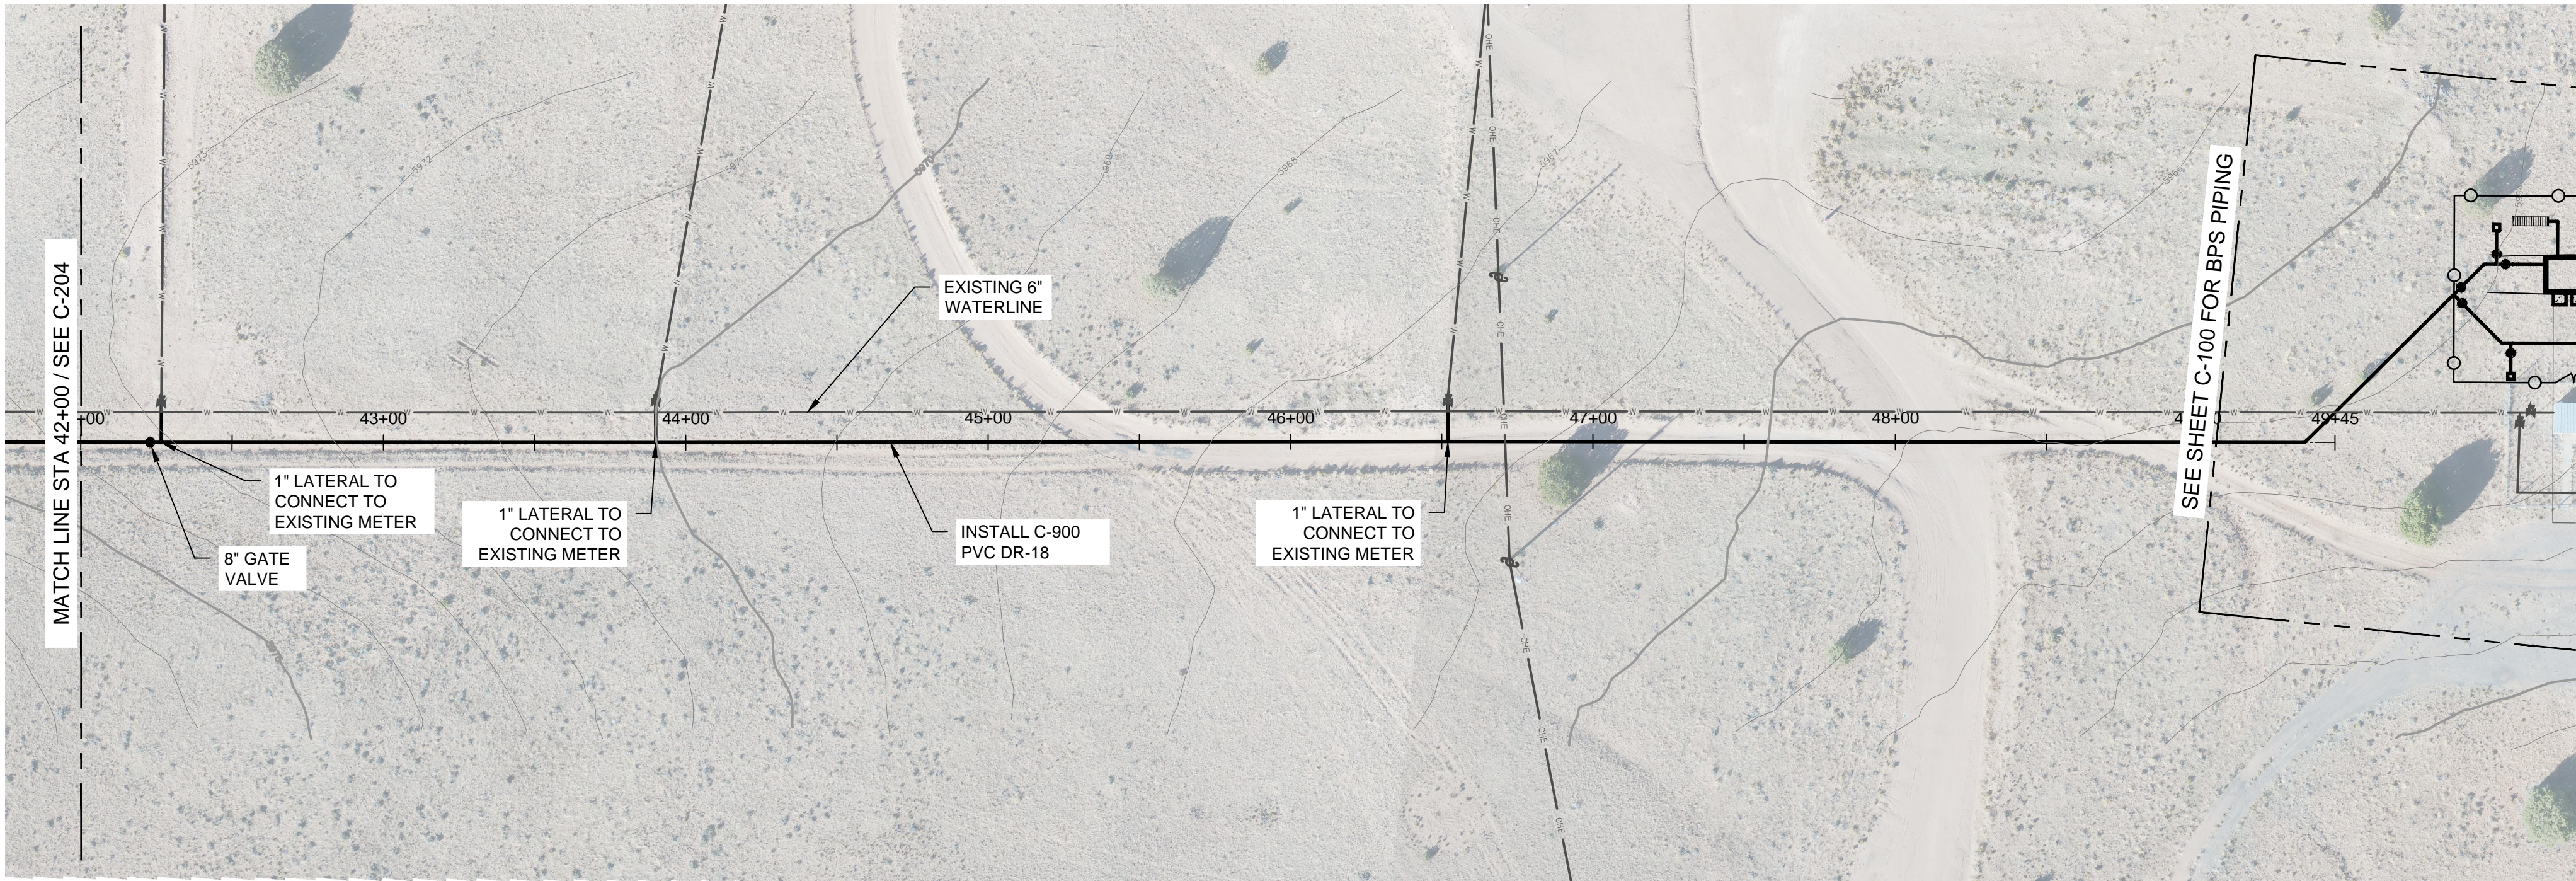

STA 42+00 - STA 49+45
PLAN

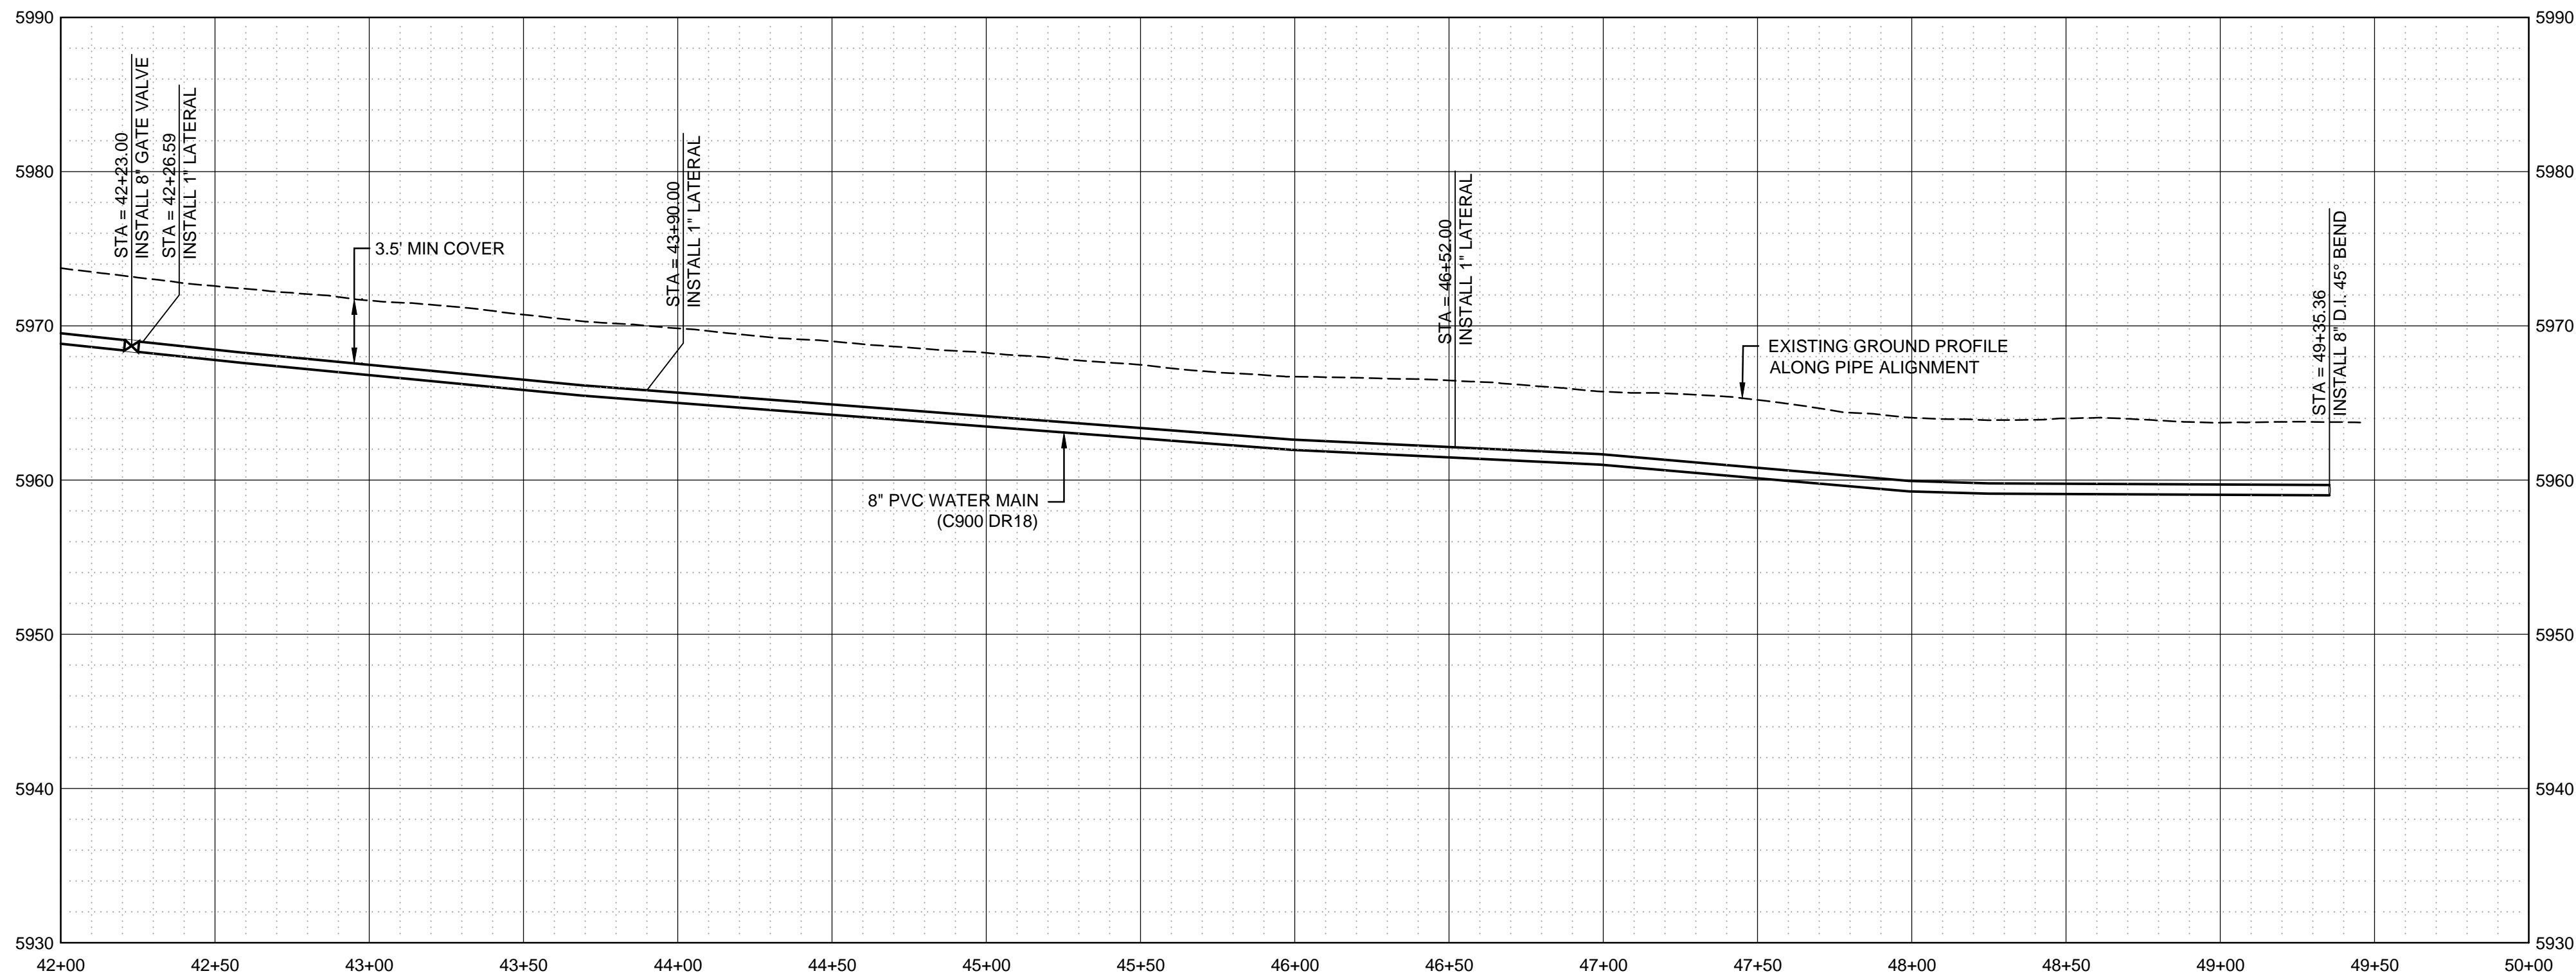

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

- ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POT HOLE AS REQUIRED TO COMPLETE THE WORK.
- CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
- CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
- CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
- CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
- EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
- DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
- ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHEY

FILENAME

C-205.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE
- STA 42+00 TO
49+45

DRAWING NUMBER

C-205

0

SHEET NUMBER
OF


60

Call at least two full working days
before you begin excavation.


ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-206.DWG PLOT DATE: 1/12/2022 9:59 AM CAD USER: TYLER PRIDEMORE

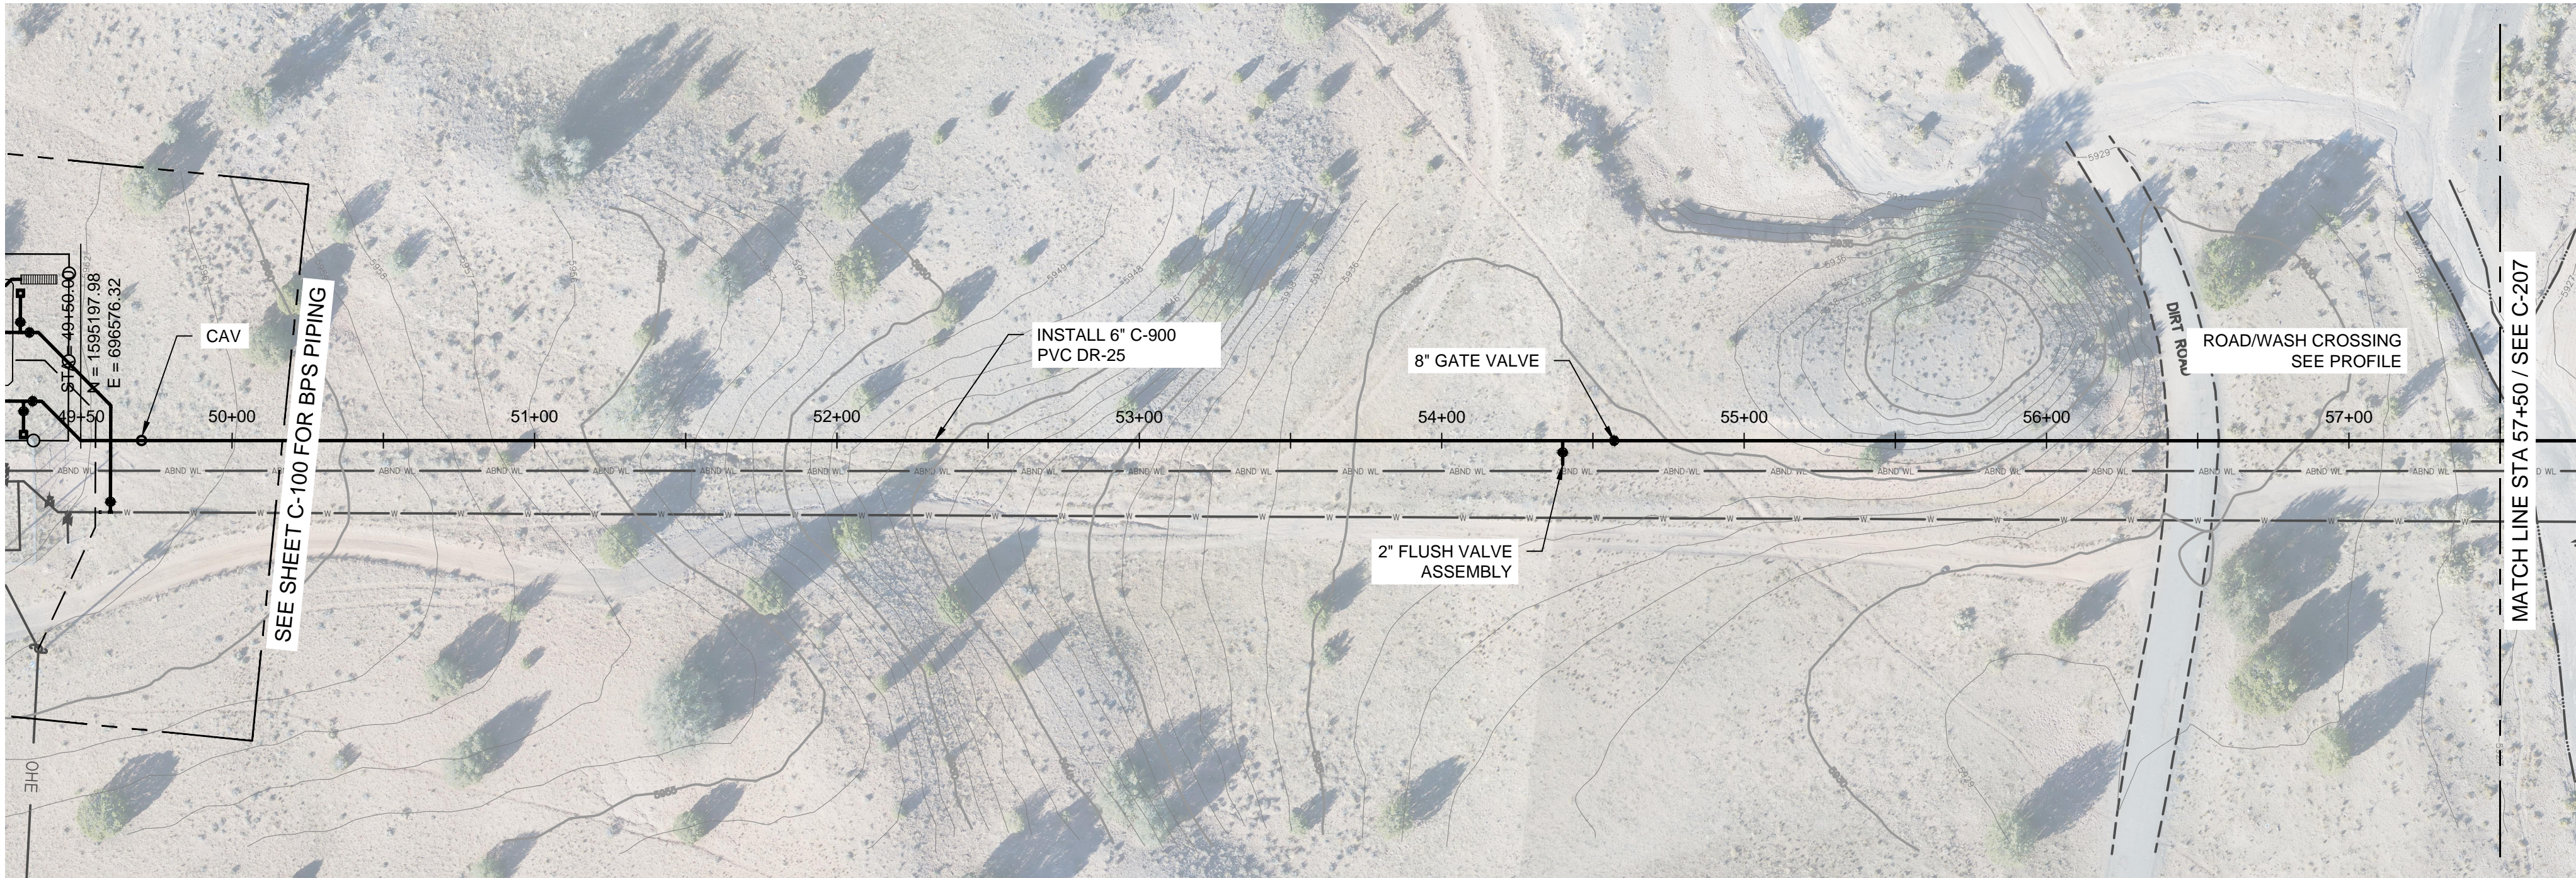

STA 49+50 - STA 57+50
PLAN

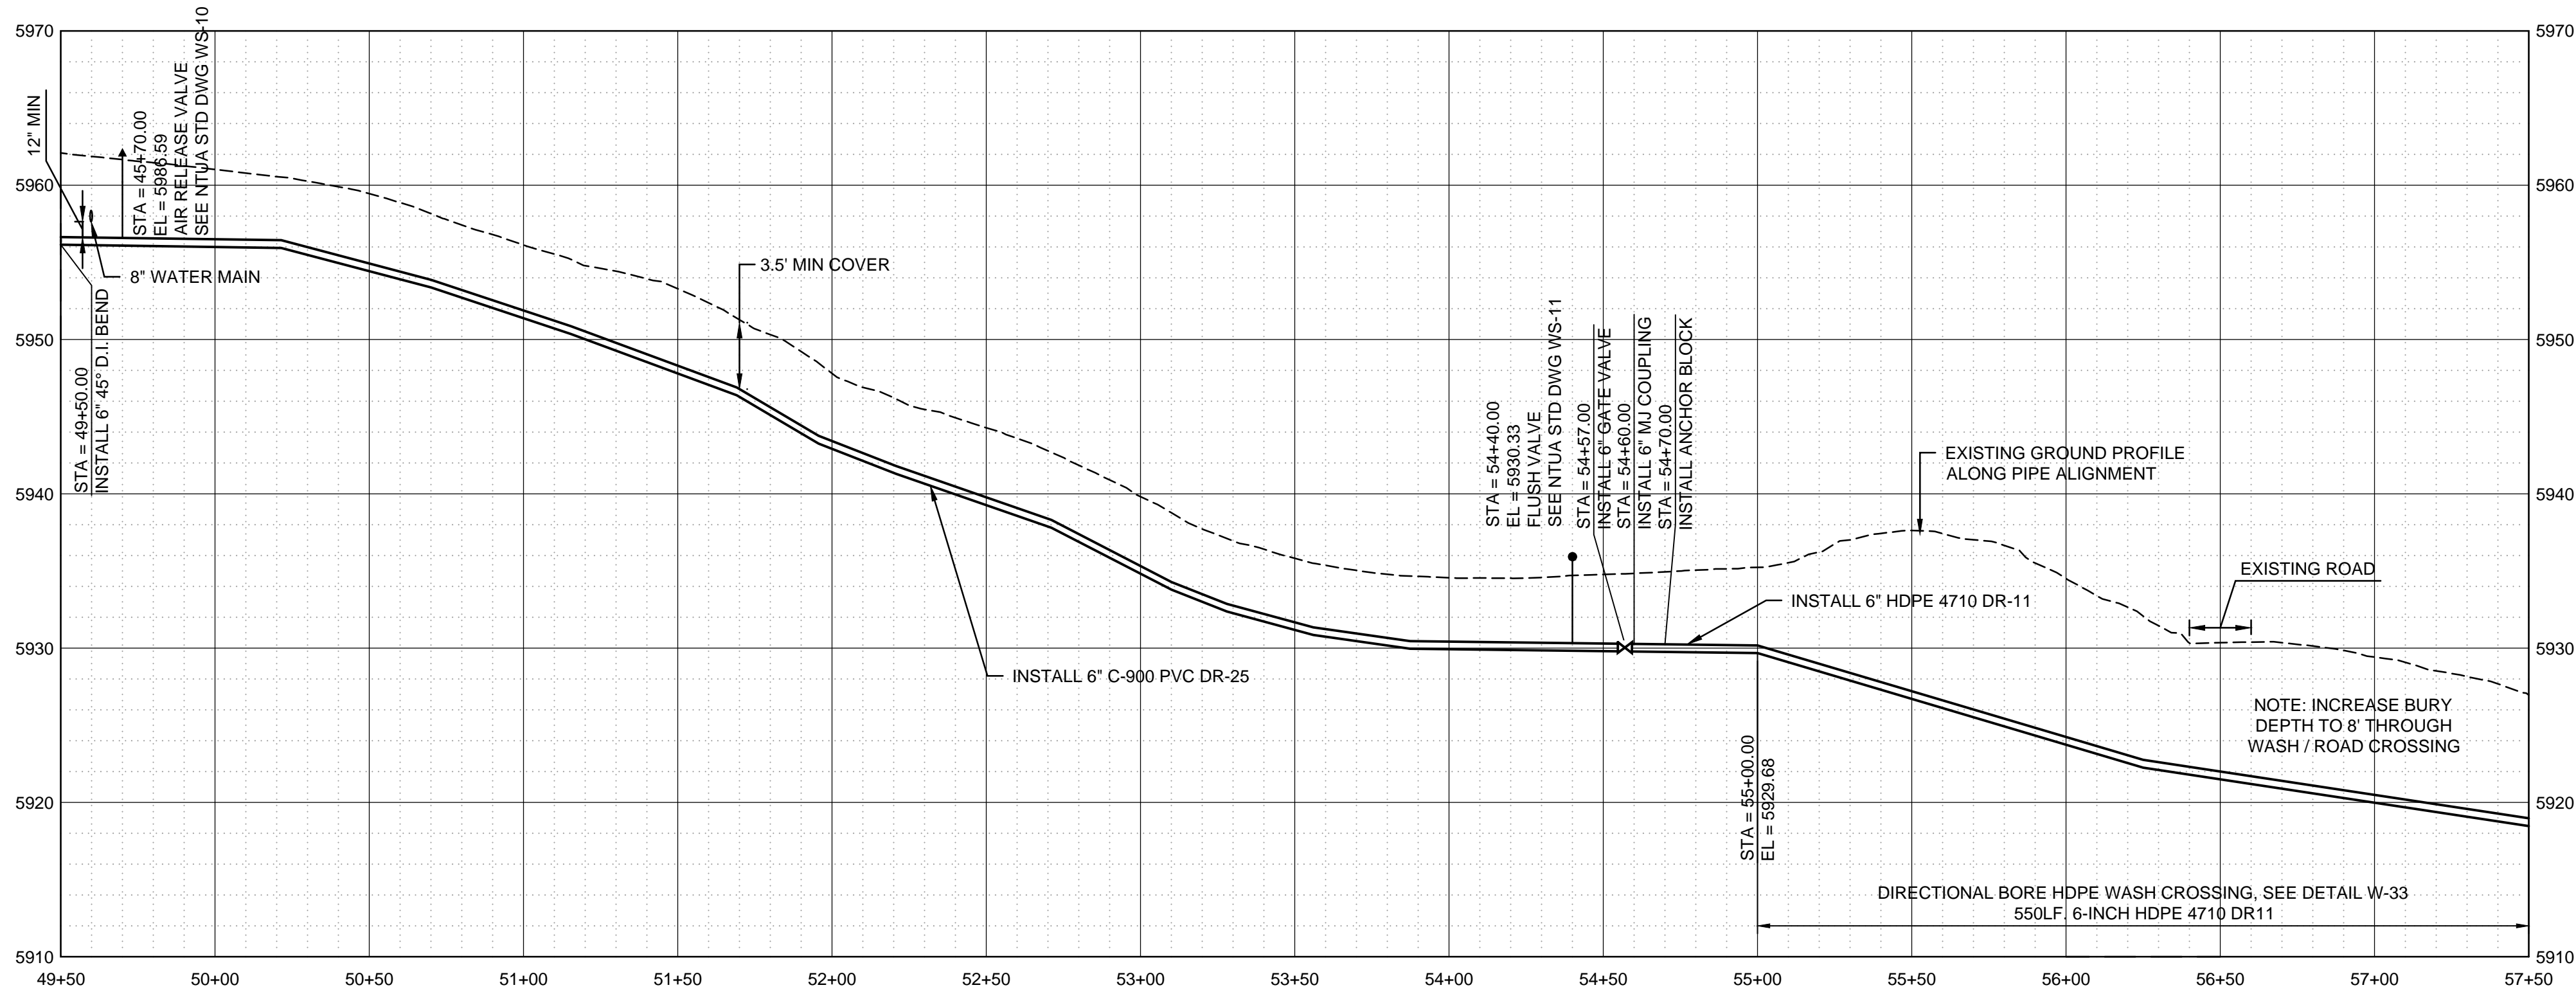

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

- ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POT HOLE AS REQUIRED TO COMPLETE THE WORK.
- CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
- CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
- CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
- CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
- EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
- DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
- ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

APPROVED: - -

APPROVED: S. BRENCHELY

FILENAME

C-206.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - STA 49+50 TO 57+50

DRAWING NUMBER

C-206


0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.




Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\DWG FILENAME: C-207.DWG PLOT DATE: 1/12/2022 9:59 AM CAD USER: TYLER PRIDEMORE

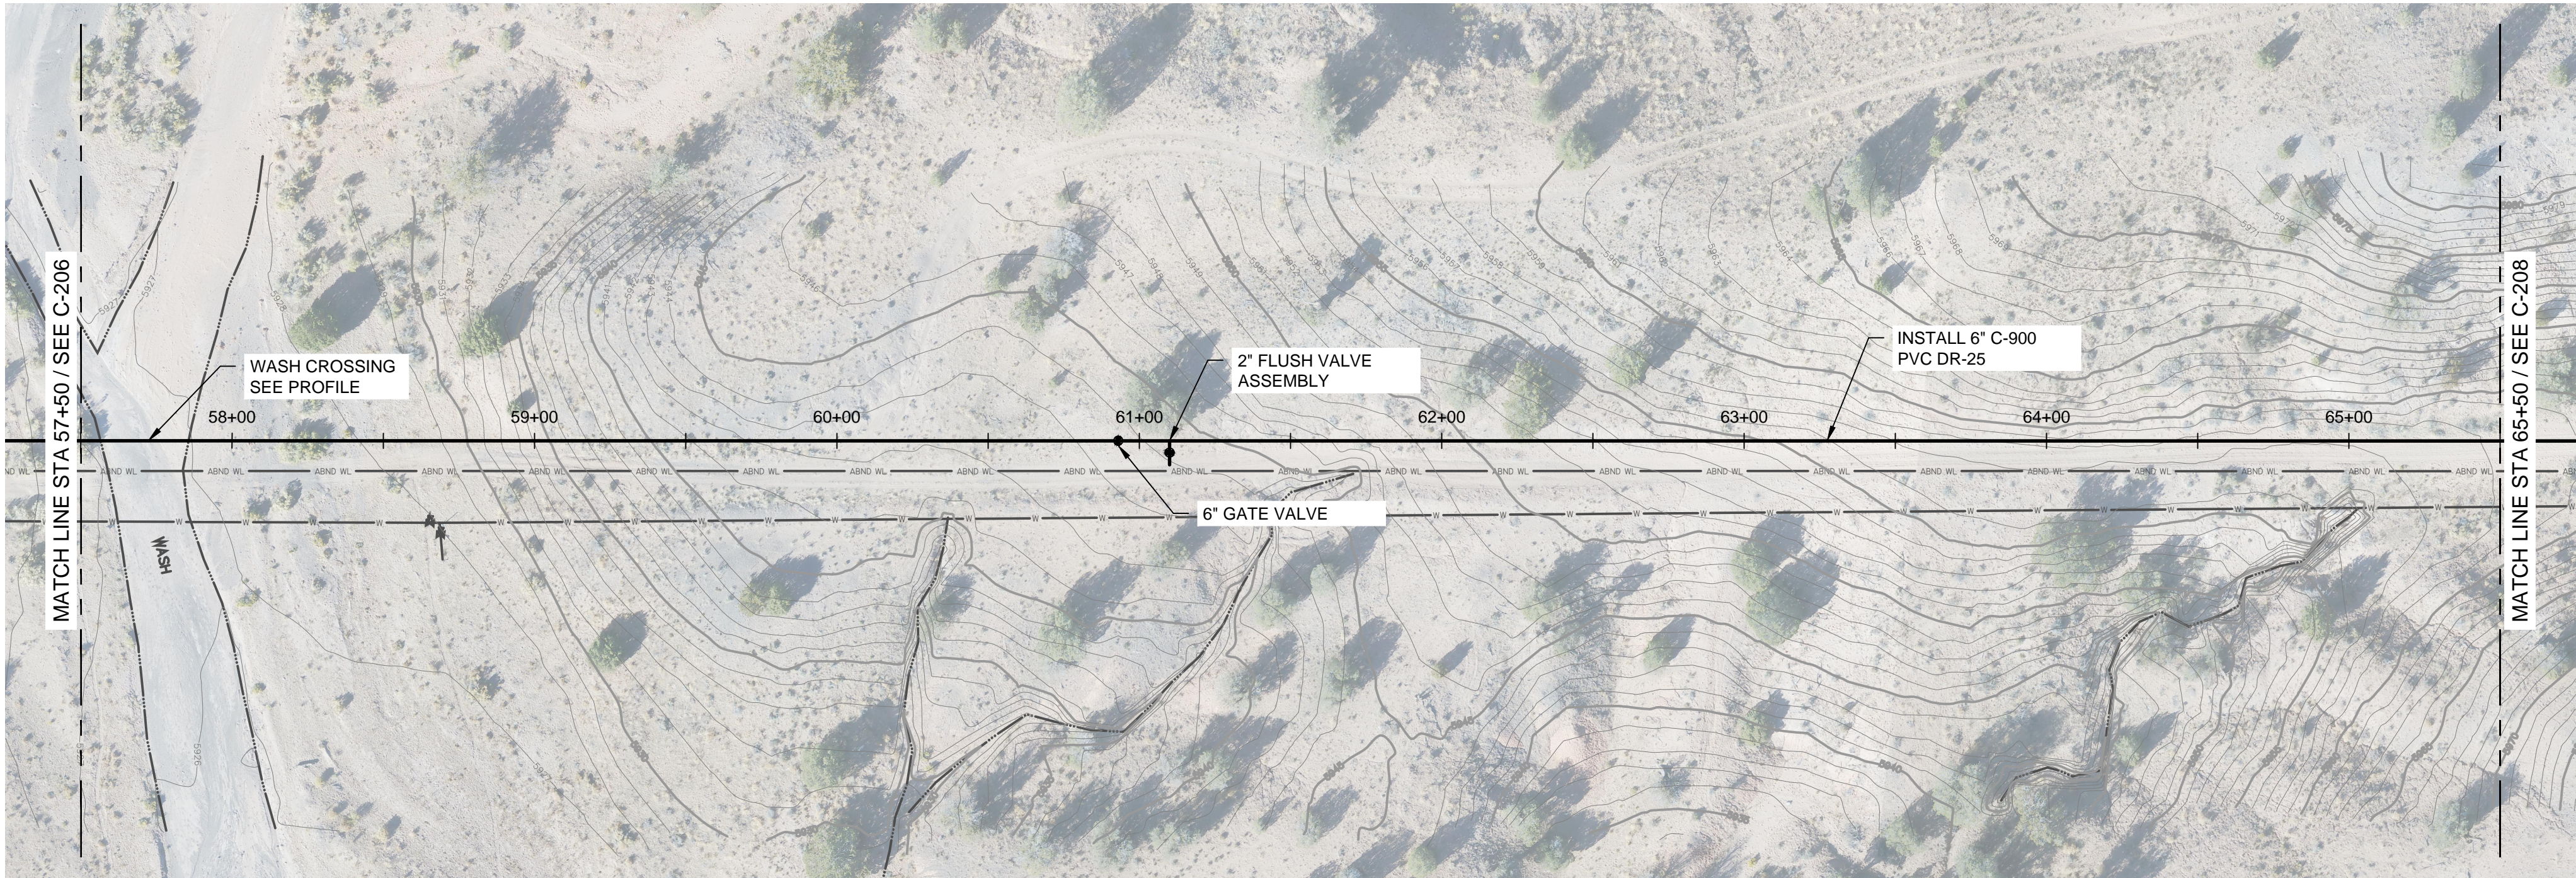

STA 57+50 - STA 65+50
PLAN
0 40 80
SCALE IN FEET
NORTH

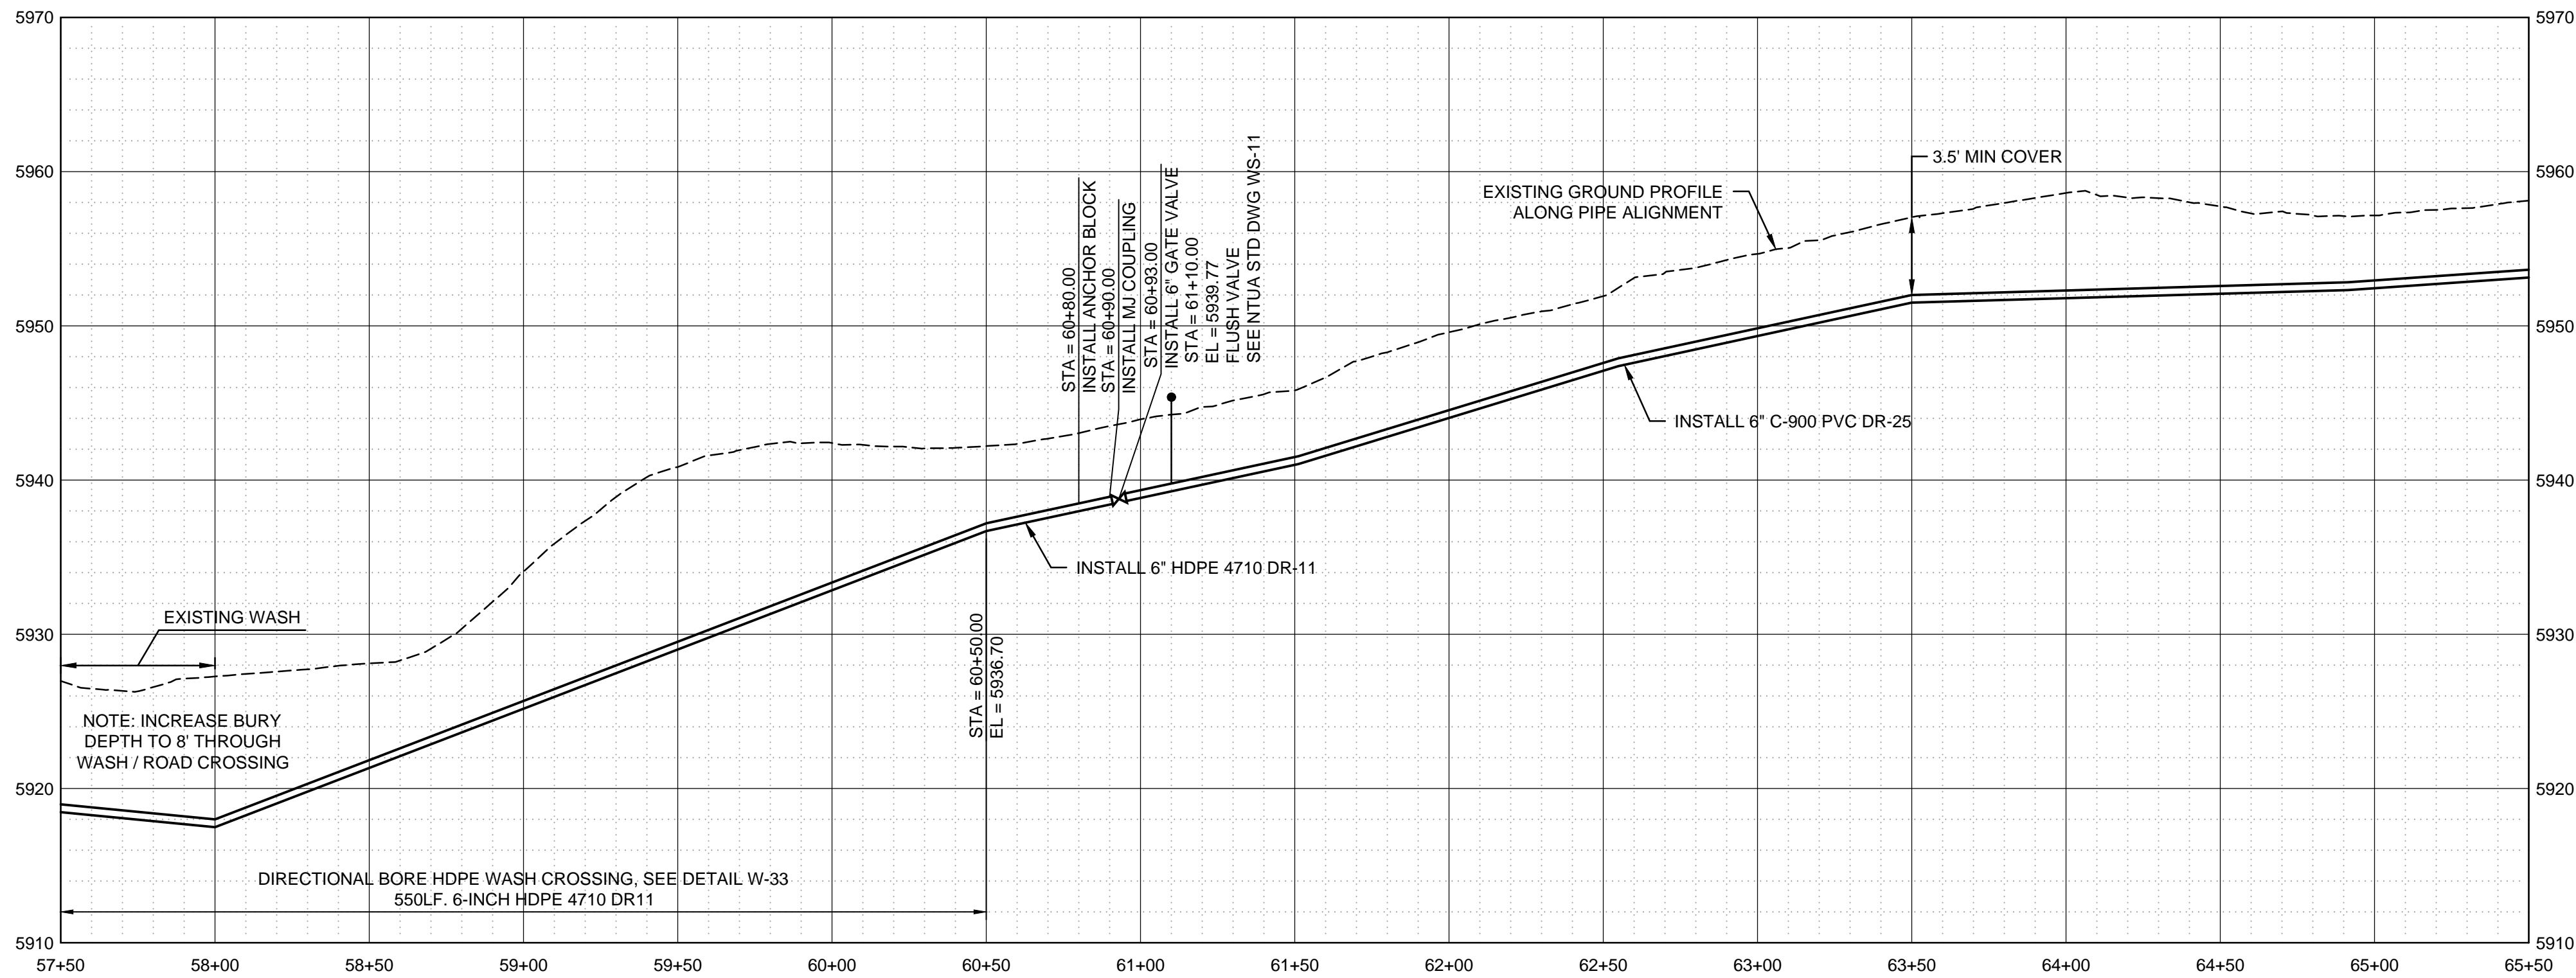

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

- ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POTHOLE AS REQUIRED TO COMPLETE THE WORK.
- CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
- CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
- CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
- CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
- EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
- DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
- ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHEY

FILENAME

C-207.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - STA 57+50 TO 65+50

DRAWING NUMBER

C-207




0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.



Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\W\D2344906 FILENAME: C-208.DWG PLOT DATE: 1/12/2022 9:58 AM CAD USER: TYLER PRIDEMORE

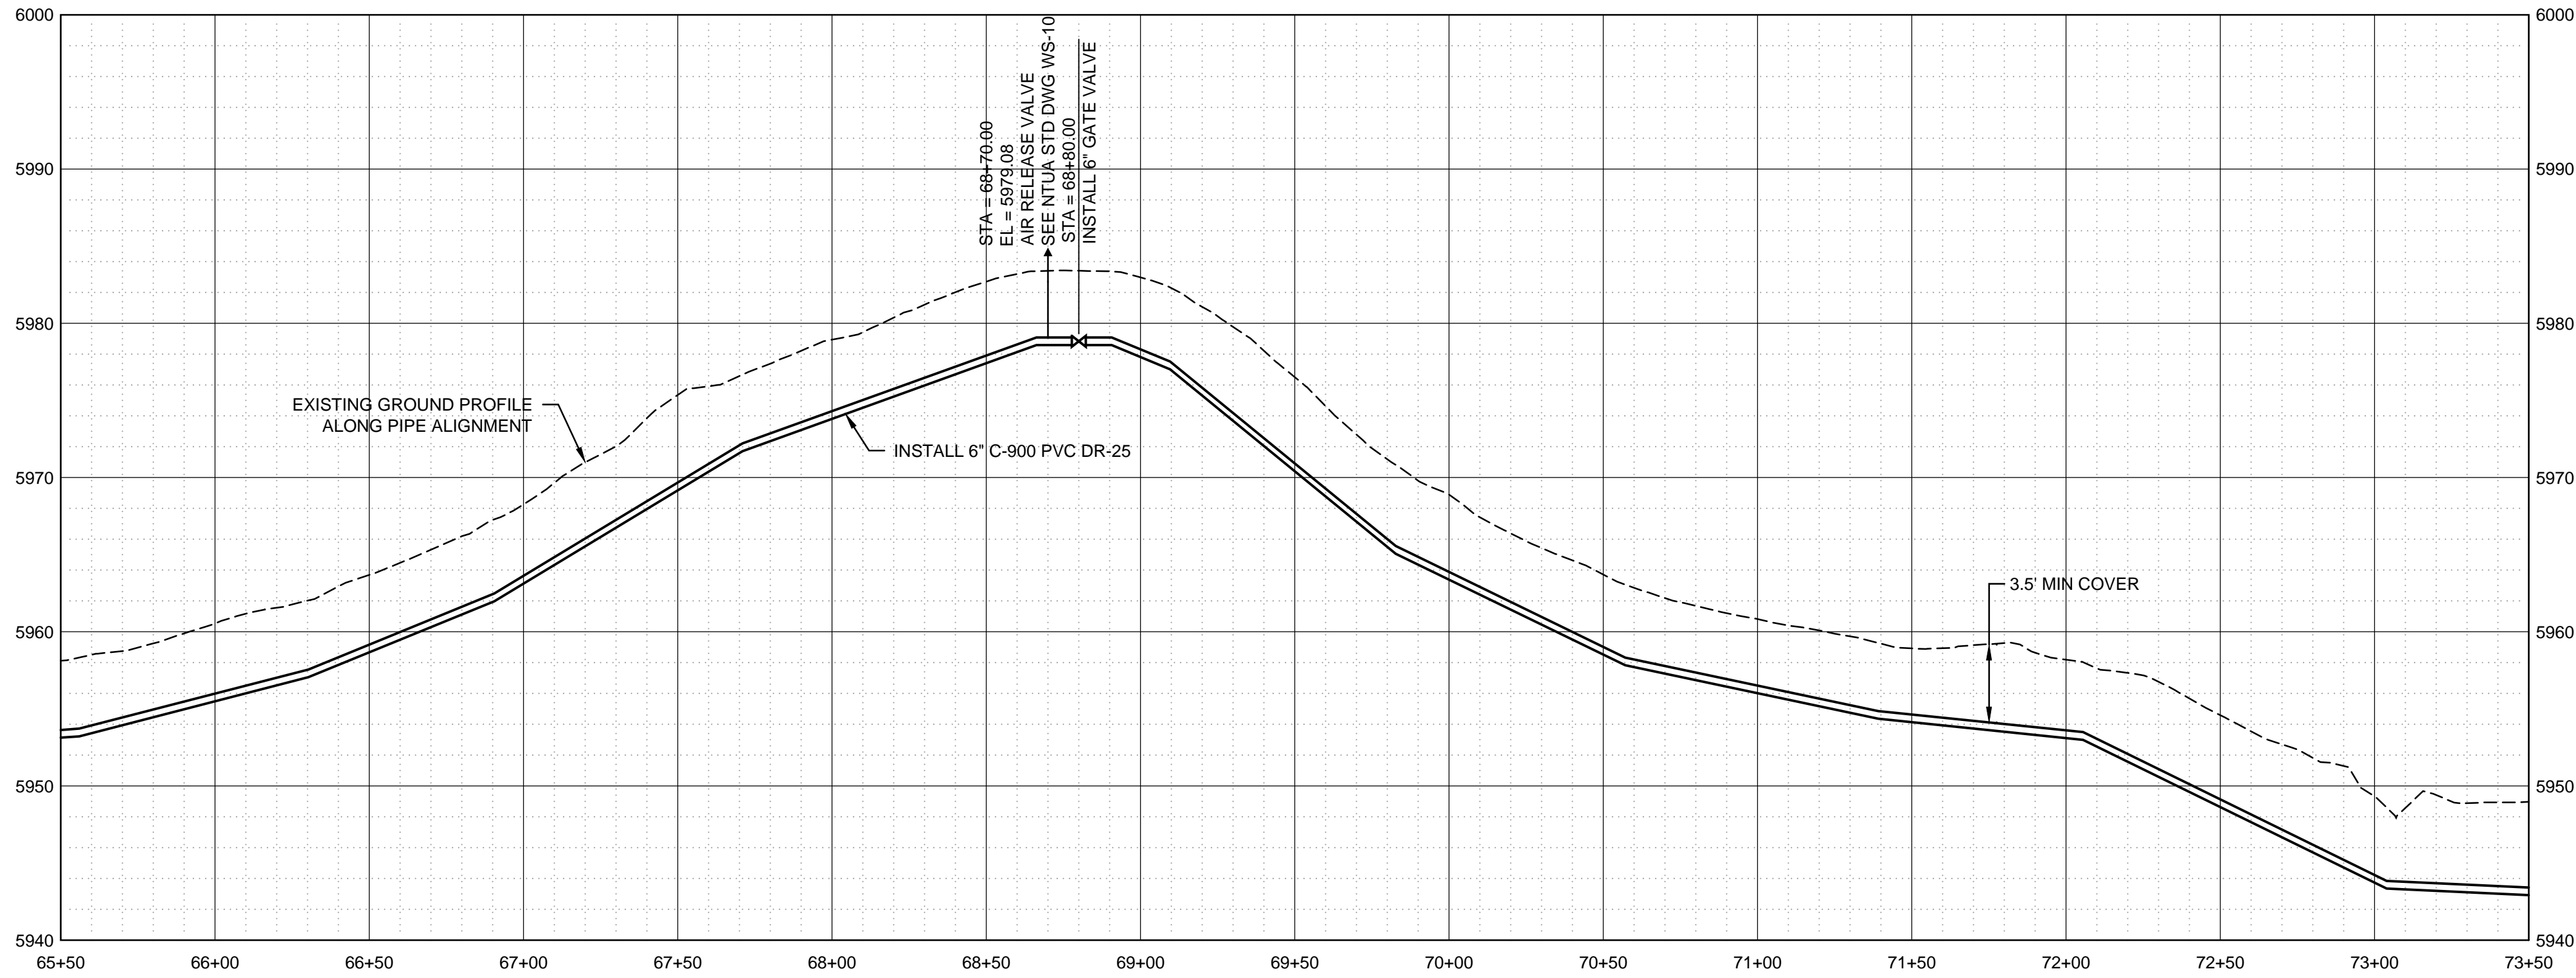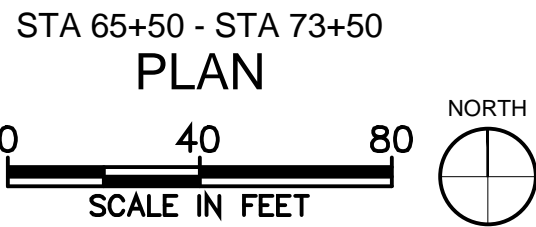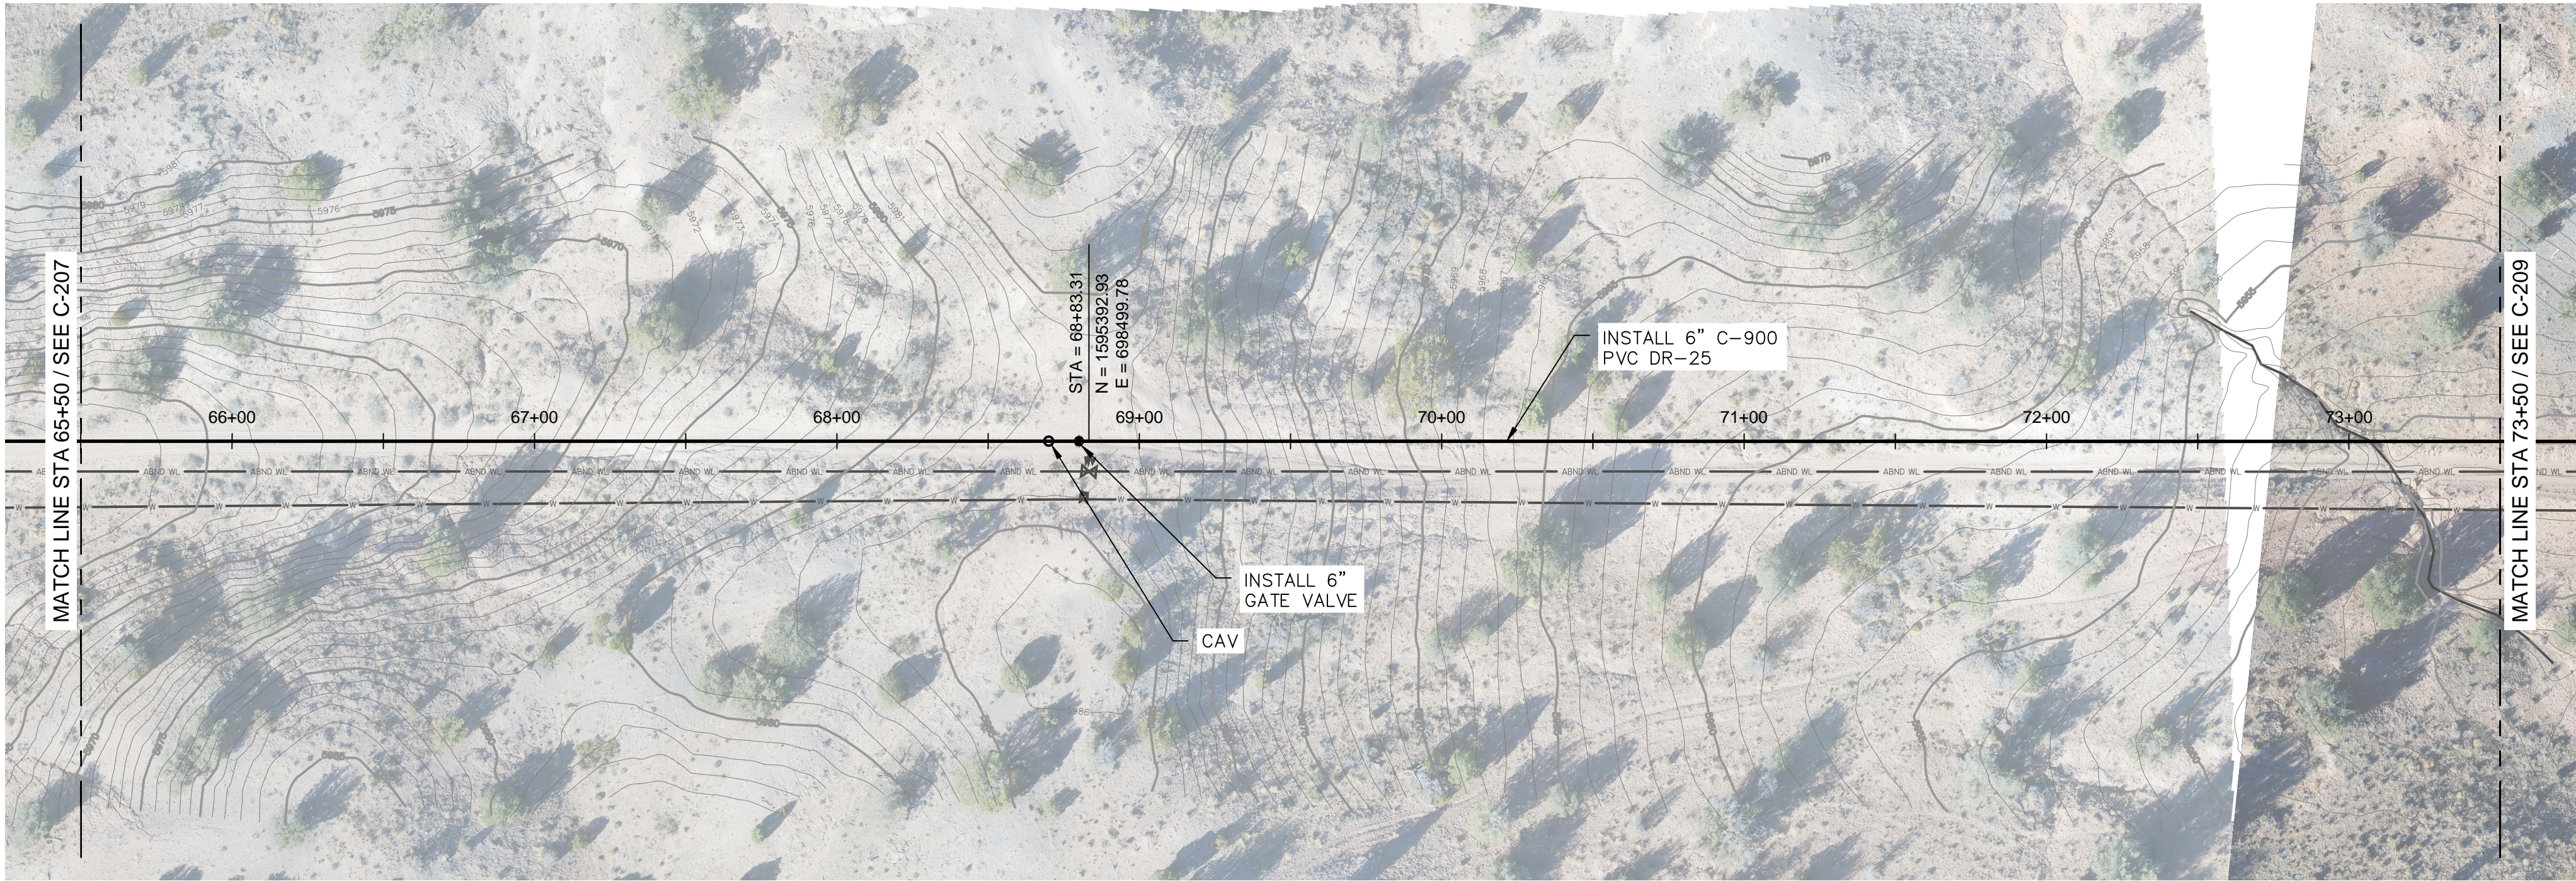

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

- ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POTHOLE AS REQUIRED TO COMPLETE THE WORK.
- CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
- CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
- CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
- CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
- EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
- DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
- ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

C-208.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - STA 65+50 TO 73+50

DRAWING NUMBER

C-208


0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.



ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BPCRM\02344906 FILENAME: C-209.DWG PLOT DATE: 1/12/2022 9:58 AM CAD USER: TYLER PRIDEMORE

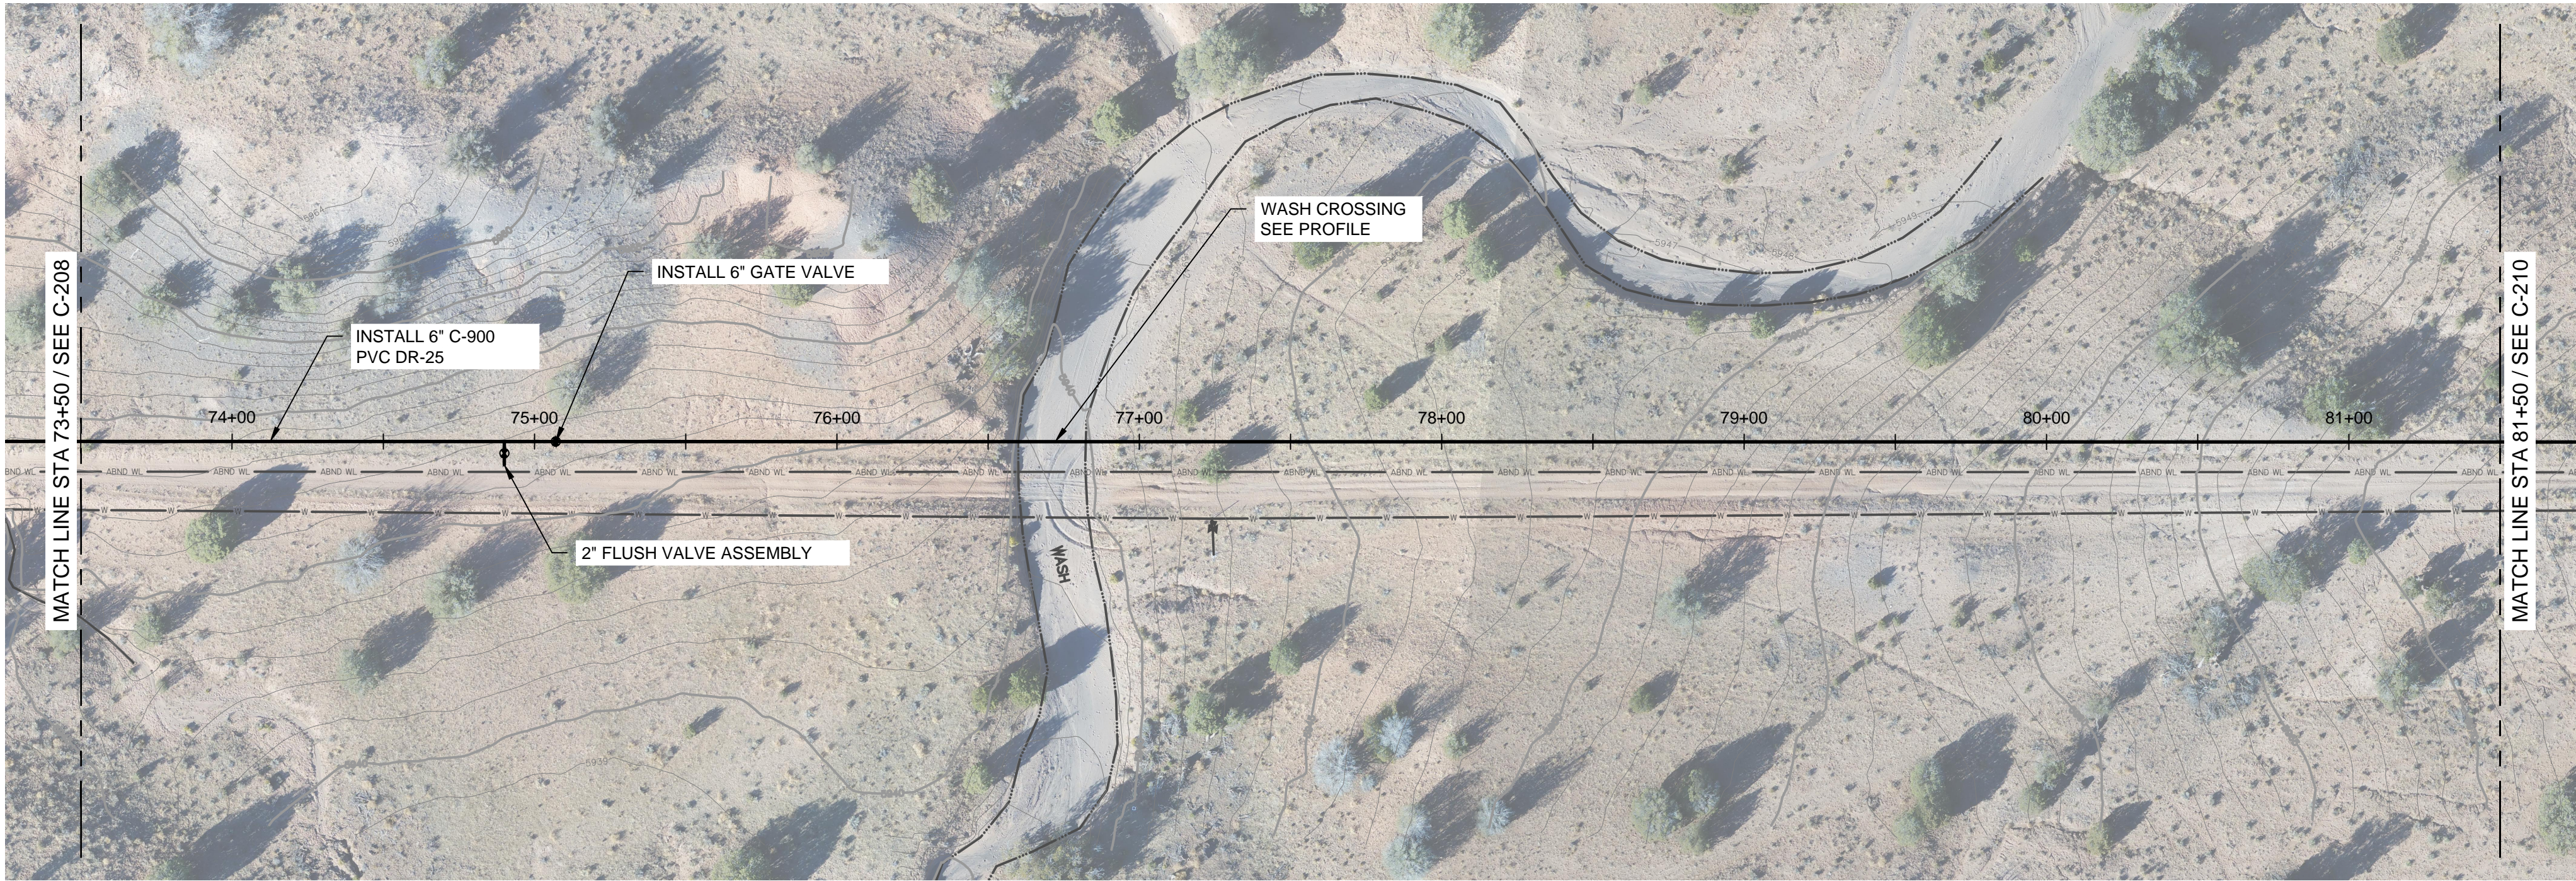

STA 73+50 - STA 81+50
PLAN

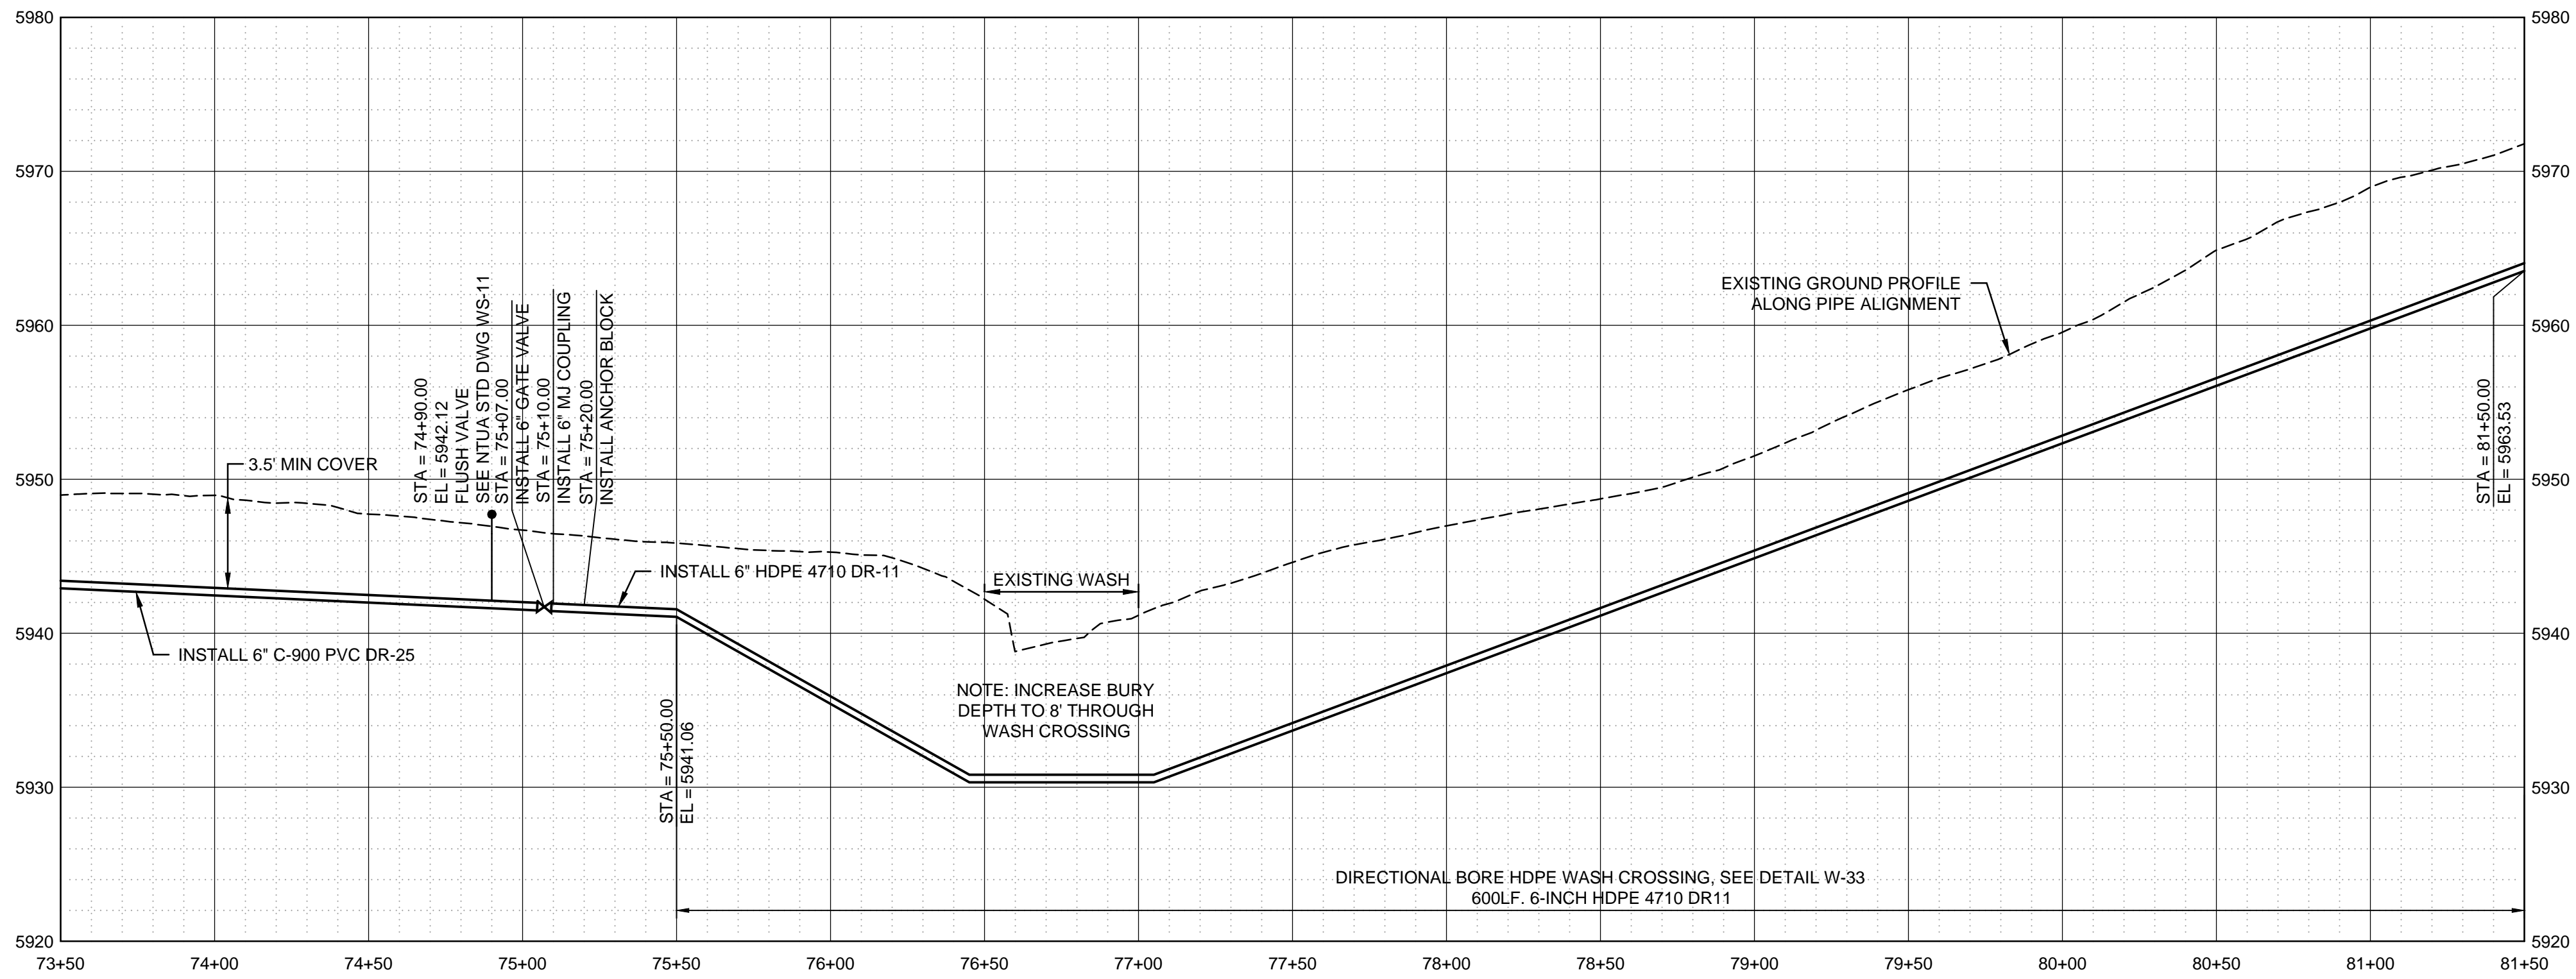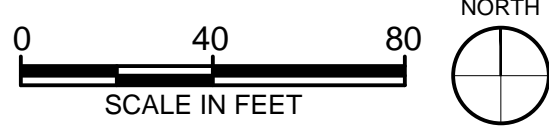

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

- ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POT HOLE AS REQUIRED TO COMPLETE THE WORK.
- CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
- CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
- CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
- CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
- EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
- DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
- ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

C-209.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - STA 73+50 TO 81+50

DRAWING NUMBER

C-209


0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.


ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\DWG FILENAME: C-210.DWG PLOT DATE: 1/12/2022 9:56 AM CAD USER: TYLER PRIDEMORE

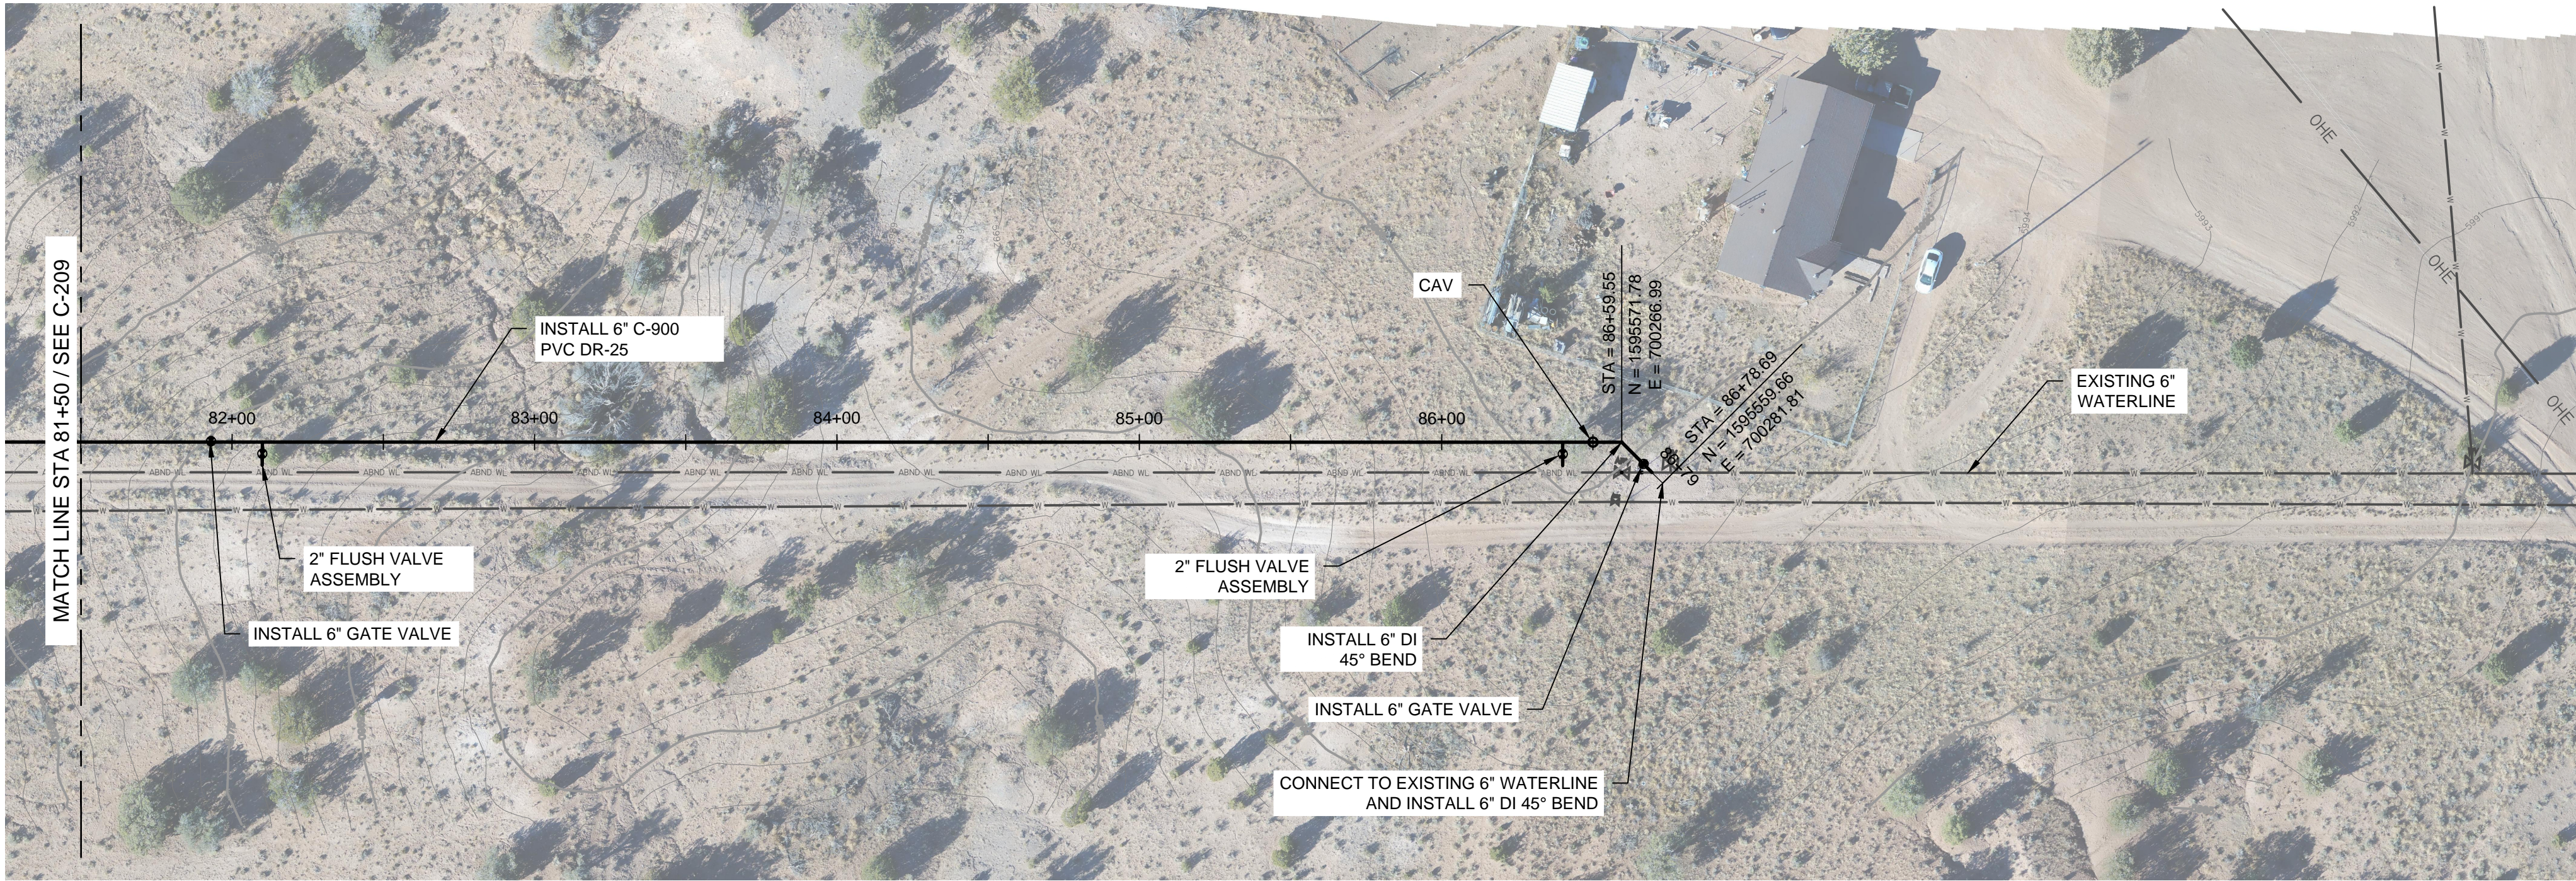

STA 81+50 - STA 86+79
PLAN

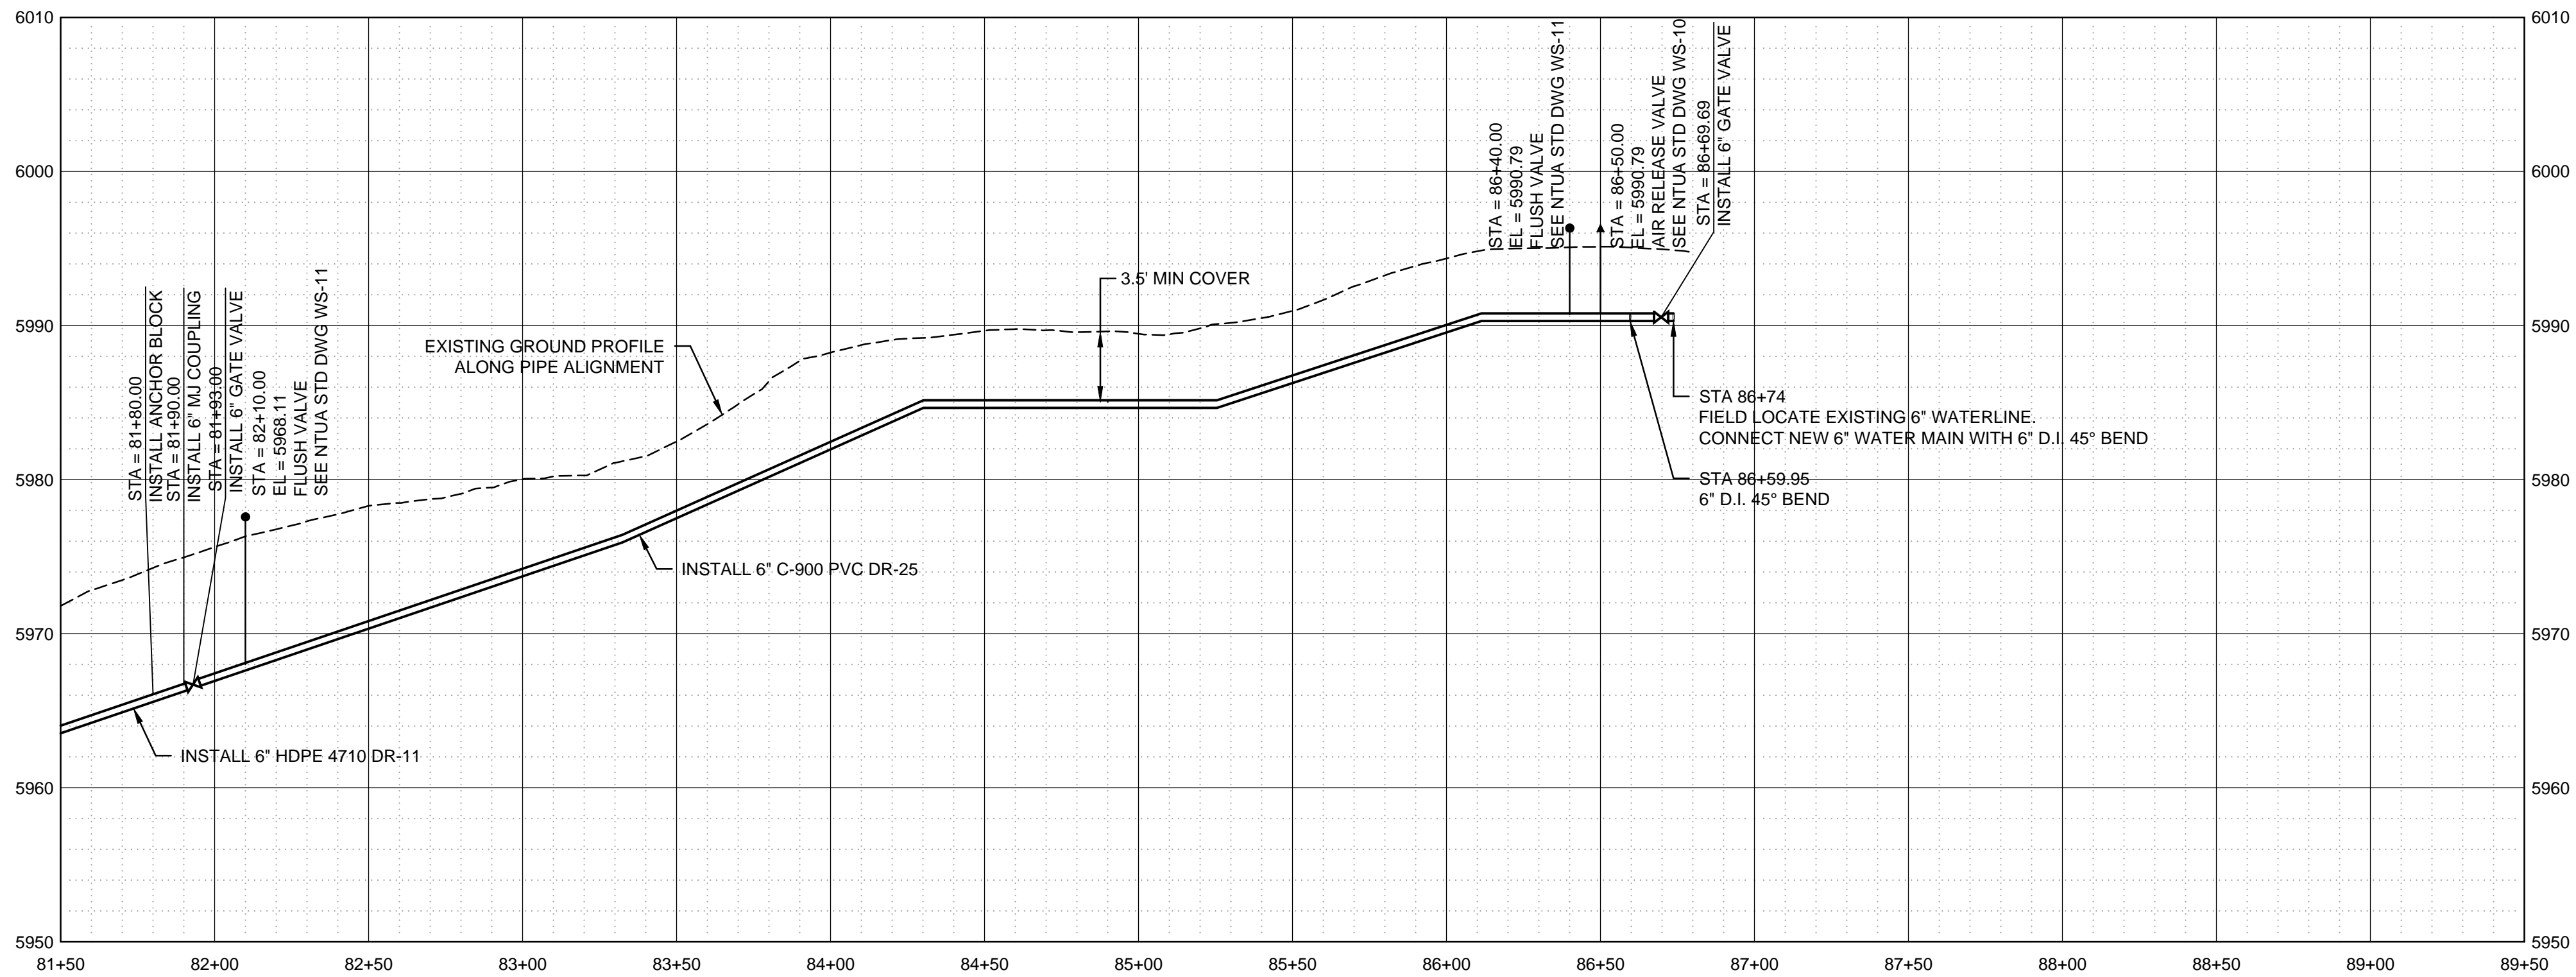

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

- ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POTHOLE AS REQUIRED TO COMPLETE THE WORK.
- CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
- CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
- CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
- CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
- EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
- DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
- ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.

KEY NOTES



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

C-210.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - STA 81+50 TO 89+79

DRAWING NUMBER

C-210




0 SHEET NUMBER
OF 60

Call at least two full working days
before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

Path: C:\BCP\DWG FILENAME: C-211.DWG PLOT DATE: 1/12/2022 9:56 AM CAD USER: TYLER PRIDEMORE

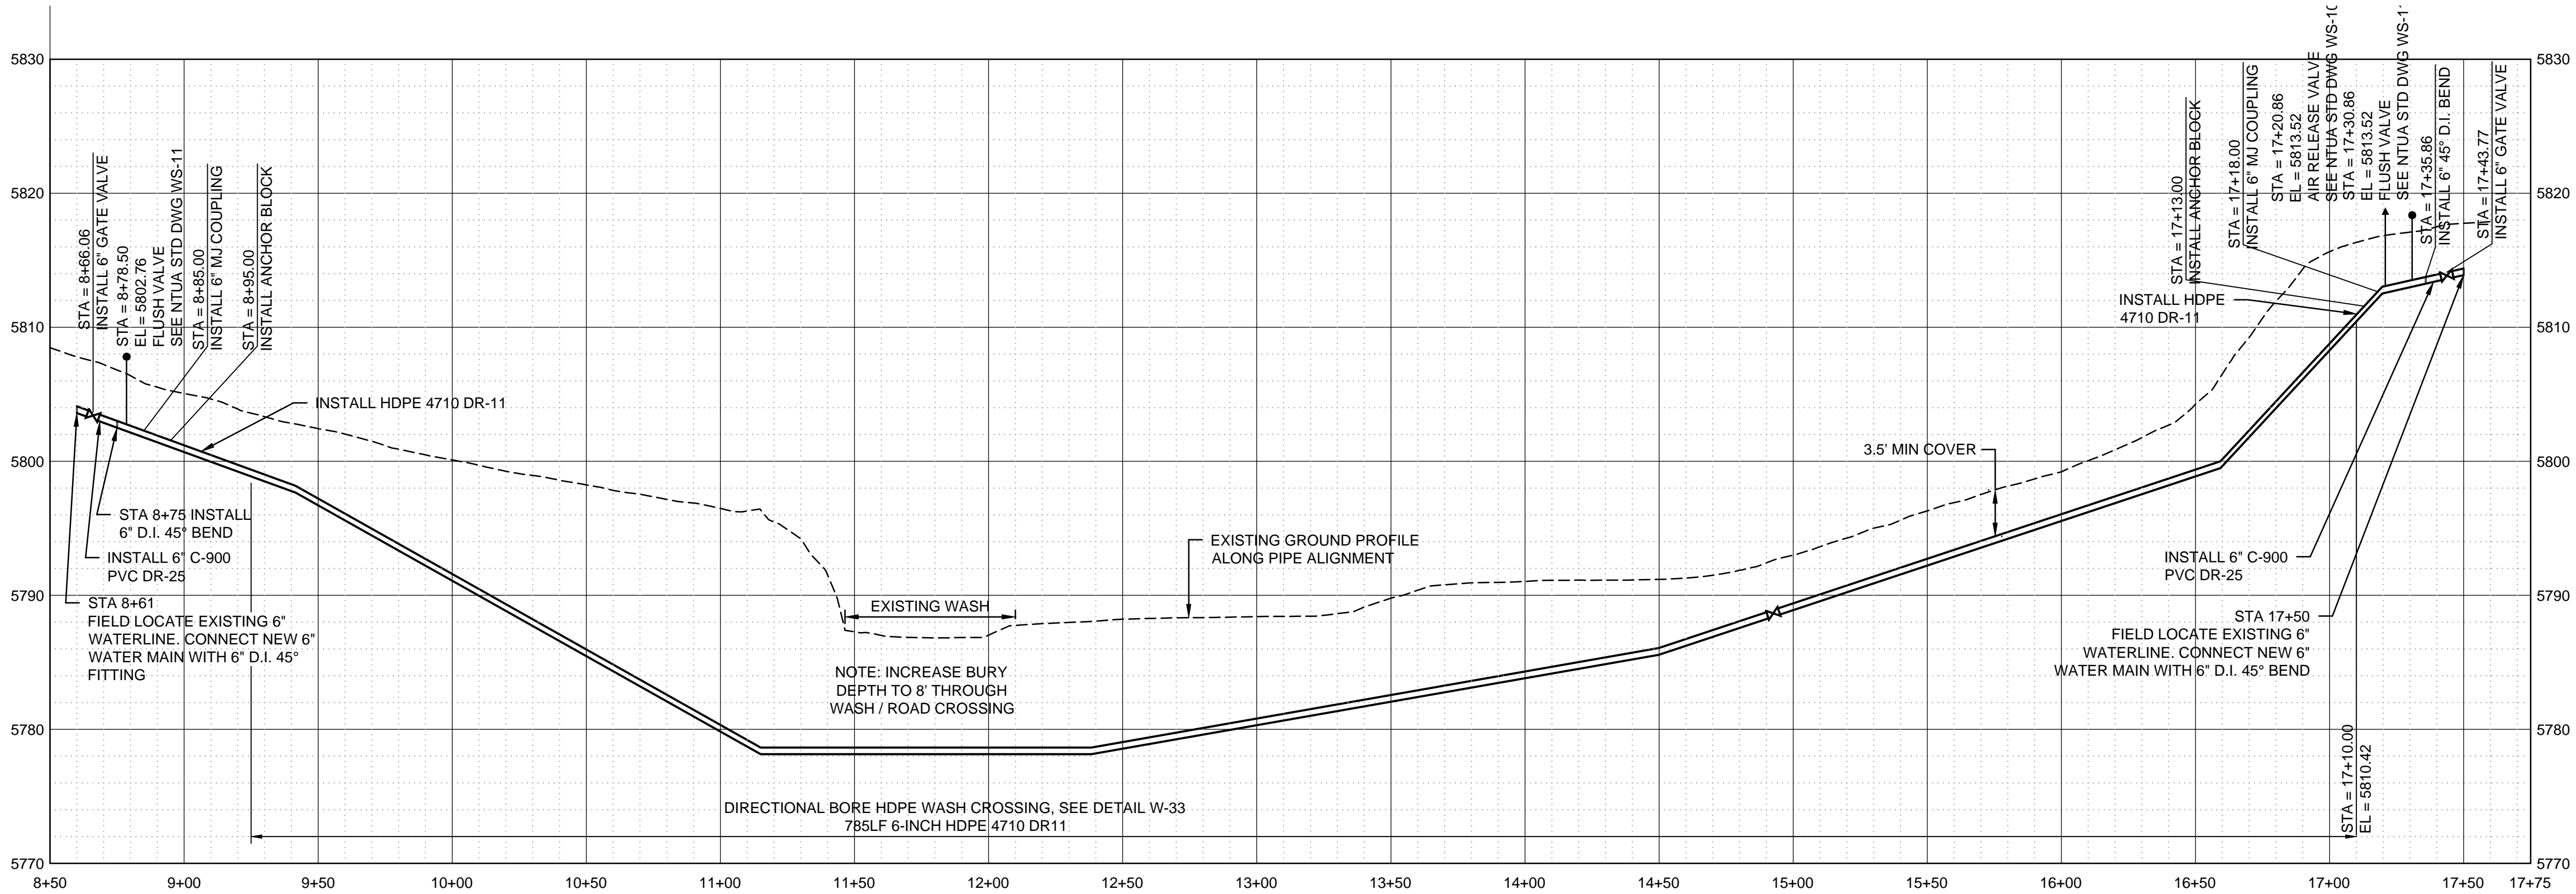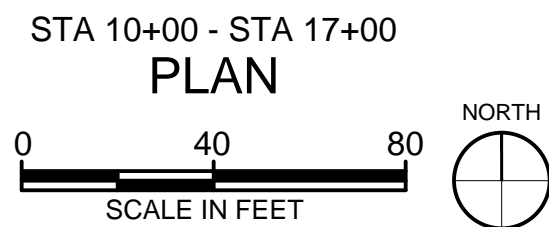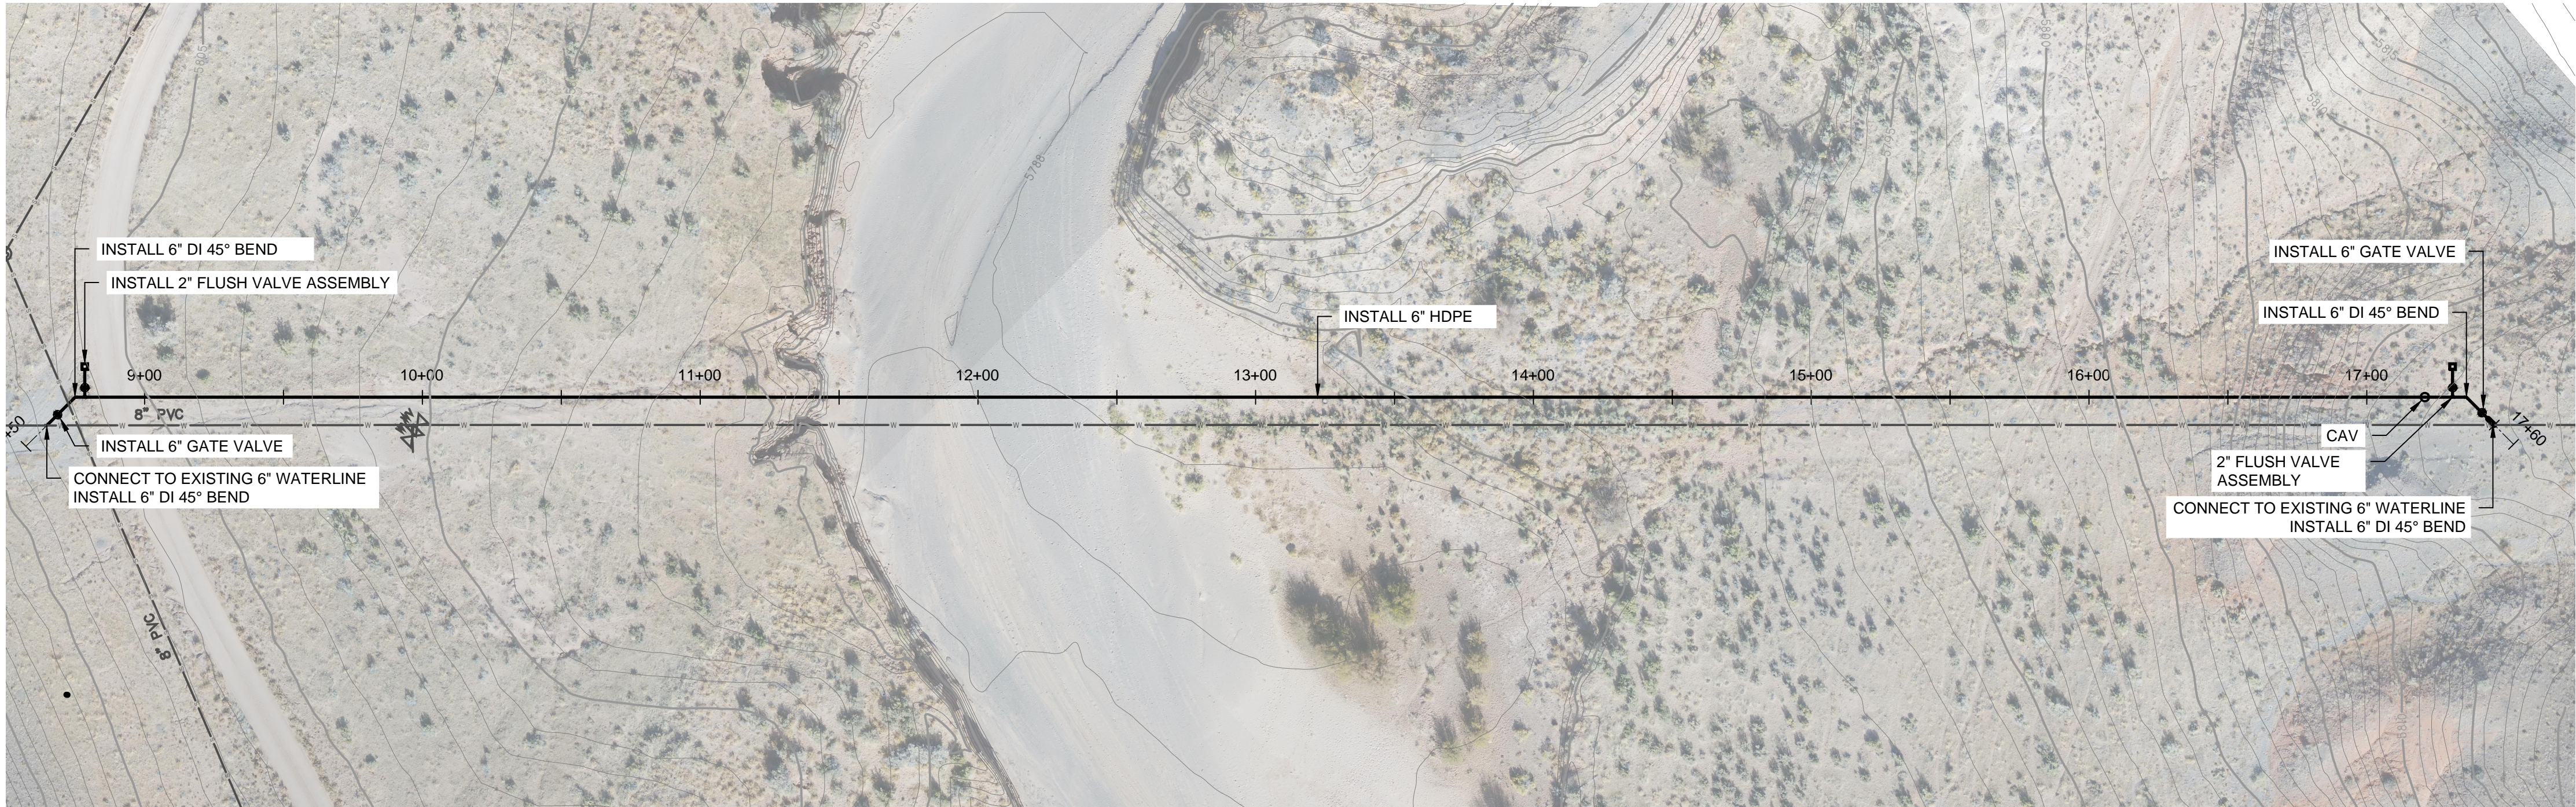

PROFILE
SCALE H: 1" = 40'
V: 1" = 4'

GENERAL NOTES

1. ALL LOCATIONS OF UTILITIES SHOWN ARE APPROXIMATE, CONTRACTOR TO FIELD VERIFY AND POT HOLE AS REQUIRED TO COMPLETE THE WORK.
2. CONTRACTOR TO FIELD VERIFY PHYSICAL LOCATION, ELEVATIONS AND INVERTS. ELEVATIONS ARE BASED ON NAVD 88 EXPRESSED IN INTERNATIONAL FEET.
3. CONTRACTOR TO PROVIDE THRUST BLOCKS AT ALL ELBOWS, TEES, CROSSES PER NTUA STD DWG WS-19. MECHANICAL JOINT RESTRAINTS CAN BE UTILIZED IN PLACE OF THRUST BLOCKS. EBA IRON MEGALUG SERIES 2000 PV FOR FITTINGS AND SERIES 2500 FOR PIPE JOINTS - INSTALL PER MANUFACTURE'S RECOMMENDATIONS.
4. CONTRACTOR TO INSTALL PIPE IN TRENCH PER DETAIL C / SHEET C-003.
5. CONTRACTOR TO INSTALL MARKER POSTS PER NTUA STD DWG WS-13.
6. EASEMENT DIMENSIONS AND PIPELINE OFFSETS ARE PROVIDED ON SHEET C-002.
7. DEFLECT PIPE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AS NECESSARY.
8. ALL YARD PIPING TO HAVE MJ x MJ DI FITTINGS UNLESS NOTED OR OTHERWISE SHOWN IN DETAILS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

C-211.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

CIVIL

PLAN AND PROFILE - COYOTE WASH

DRAWING NUMBER




































































































































































































C-211

0 SHEET NUMBER
OF 60














































































Call at least two full working days
before you begin excavation.



Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

D			CENTRIFUGAL FAN		GRAVITY VENTILATOR		HVAC CONTROL, VALVE ACTUATOR ELECTRIC MOTOR		SQUARE DIRECTIONAL PATTERN SUPPLY AIR DIFFUSER WITH ADJUSTABLE CORE AND PERFORATED FACE PLATE. PROVIDE 4-WAY HORIZONTAL AIR DEFLECTION PATTERN. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.	TEE BAR CEILING (24" X 24")	ALUMINUM	OBVD AND ROUND TO SQUARE NECK REDUCER	 SALT LAKE CITY, UT																						
			PROPELLER FAN				AIR-COOLED CONDENSING UNIT OR HEAT PUMP			HVAC CONTROL, VALVE ACTUATOR ELECTRIC SOLENOID		SQUARE OR RECTANGULAR DIRECTIONAL PATTERN SUPPLY AIR DIFFUSER WITH SNAG-IN REMOVABLE CORE. PROVIDE 4-WAY HORIZONTAL AIR DEFLECTION PATTERN. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.		SURFACE MOUNT ON CEILING OR WALL	ALUMINUM	OBVD AND ROUND TO SQUARE NECK REDUCER																			
			BACKDRAFT DAMPER				ELECTRICAL AND INSTRUMENTATION SYMBOLS					TEMPERATURE TRANSMITTER			ROUND DIRECTIONAL PATTERN SUPPLY AIR DIFFUSER WITH ADJUSTABLE CORE AND PERFORATED FACE PLATE. PROVIDE 1-WAY MULTI-DIRECTIONAL AIR DEFLECTION PATTERN. FINISH SHALL BE ALUMINUM.	BOTTOM OR SIDE OF EXPOSED DUCT	ALUMINUM	OBVD																	
			PARTICULATE FILTER									AIR DISTRIBUTION, DAMPER CONTROL, ELECTRIC OPERATED			INDICATING DIFFERENTIAL PRESSURE SWITCH		RECTANGULAR SUPPLY AIR DIFFUSER. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.	BOTTOM OR SIDE OF EXPOSED DUCT	ALUMINUM	OBVD															
			CHEMICAL FILTER												AIR DISTRIBUTION, DUCT DETECTOR			SMOKE DETECTOR		DRUM LOUVER	BOTTOM OR SIDE OF EXPOSED DUCT	ALUMINUM	NONE												
			PARALLEL BLADE DAMPER															AIR DISTRIBUTION, PNEUMATIC OPERATED DAMPER CONTROL			PRESSURE INDICATOR		PERFORATED RETURN GRILLE TO CEILING PLENUM. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.	TEE BAR CEILING (24" X 24")	ALUMINUM	OBVD AND ROUND TO SQUARE NECK REDUCER									
			OPPOSED BLADE DAMPER																		HVAC CONTROL, PNEUMATIC OPERATED DAMPER CONTROL			TEMPERATURE INDICATOR		SQUARE RETURN/EXHAUST AIR REGISTER WITH PERFORATED FACE PLATE. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.	TEE BAR CEILING (24" X 24")	ALUMINUM	OBVD AND ROUND TO SQUARE NECK REDUCER						
			MOTORIZED DAMPER																					HVAC CONTROL, ELECTRIC PNEUMATIC CONTROL			ON-OFF		RECTANGULAR RETURN / EXHAUST AIR REGISTER WITH STATIONARY HORIZONTAL DEFLECTION VANES SET AT 35 DEGREES ON 1/2 INCH ON CENTER. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.	SURFACE MOUNT ON CEILING OR WALL	ALUMINUM	OBVD			
			LOUVER																								HVAC CONTROL, PNEUMATIC ELECTRIC CONTROL			HAND-OFF-AUTO		SQUARE OR RECTANGULAR RETURN/EXHAUST GRILLE WITH 1/2 X 1/2 X 1/2 INCH SQUARE CORES. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.	BOTTOM OR SIDE OF EXPOSED DUCT	ALUMINUM	OBVD
			ROOF EXHAUST FAN, PROPELLER OR CENTRIFUGAL TYPE																											HVAC CONTROL, PRESSURE STAT			PURGE-OFF-AUTO		ROUND RETURN/EXHAUST AIR REGISTER WITH PERFORATED FACE PLATE. FINISH SHALL BE ANODIZED ALUMINUM.
		HYDRONIC COIL		HVAC CONTROL, PRESSURE SWITCH, TYPE 1				TEST-AUTO																									RECTANGULAR RETURN / EXHAUST AIR REGISTER WITH STATIONARY HORIZONTAL DEFLECTION VANES SET AT 35 DEGREES ON 1/2 INCH CENTERS. FINISH SHALL BE ANODIZED ALUMINUM WITH WHITE PAINT.		BOTTOM OR SIDE OF EXPOSED DUCT
		DIRECT EXPANSION COIL			HVAC CONTROL, REMOTE BULB THERMOSTAT				NORMALLY OPEN																										
		ELECTRIC UNIT HEATER							HVAC CONTROL, SELF-CONTAINED THERMOSTAT																								NORMALLY CLOSED		
		IN-LINE FAN							HVAC CONTROL, SWITCH, NORMALLY CLOSED FLOW																								HVAC CONTROL, THERMAL BULB		
		FUME HOOD															HVAC CONTROL, SWITCH, NORMALLY OPEN FLOW																HVAC CONTROL, THERMOMETER		
		ROOF MOUNTED SUPPLY FAN																		TW													HVAC CONTROL, THERMOSTAT, ELECTRIC		
																				T					F&T										HVAC CONTROL, THERMOSTAT, PNEUMATIC
																					F&T					HVAC CONTROL, THERMOSTAT, SELF-CONTAINED									
																								F&T				HVAC CONTROL, THERMOSTAT, SELF-CONTAINED							
																											F&T		HVAC CONTROL, THERMOSTAT, SELF-CONTAINED						
						F&T																							HVAC CONTROL, THERMOSTAT, SELF-CONTAINED						
						F&T					HVAC CONTROL, THERMOSTAT, SELF-CONTAINED																								
						F&T					HVAC CONTROL, THERMOSTAT, SELF-CONTAINED																								
							F&T					HVAC CONTROL, THERMOSTAT, SELF-CONTAINED																							
									F&T				HVAC CONTROL, THERMOSTAT, SELF-CONTAINED																						
													F&T		HVAC CONTROL, THERMOSTAT, SELF-CONTAINED																				
															F&T		HVAC CONTROL, THERMOSTAT, SELF-CONTAINED																		
																	F&T		HVAC CONTROL, THERMOSTAT, SELF-CONTAINED																
																			F&T		HVAC CONTROL, THERMOSTAT, SELF-CONTAINED														
																					F&T		HVAC CONTROL, THERMOSTAT, SELF-CONTAINED												
																					F&T			HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
								F&T																HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
								F&T																HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
								F&T																HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
								F&T																HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
									F&T															HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
															F&T									HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																	F&T							HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																			F&T					HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																			F&T					HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																			F&T					HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
										F&T														HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
										F&T														HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
										F&T														HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
										F&T														HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
										F&T														HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
															F&T									HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																	F&T							HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																	F&T							HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																	F&T							HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
																	F&T							HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
											F&T													HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
											F&T													HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
											F&T													HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
											F&T													HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
											F&T													HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
															F&T									HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
															F&T									HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
															F&T									HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
															F&T									HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
															F&T									HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
												F&T												HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
												F&T												HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
												F&T												HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
												F&T												HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
												F&T												HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T											HVAC CONTROL, THERMOSTAT, SELF-CONTAINED											
													F&T																						

Path: C:\BCP\M\0244910 FILENAME: M-002.DWG PLOT DATE: 1/8/2022 8:51 AM CAD USER: TYLER PRIDEMORE

HVAC DESIGNATIONS		HVAC DESIGNATIONS (CONT'D)		HVAC DESIGNATIONS (CONT'D)		HVAC DESIGNATIONS (CONT'D)		GENERAL NOTES
	AIR DISTRIBUTION, SUPPLY OUTLET, WALL		AIR DISTRIBUTION, BAROMETRIC DAMPER		SMOKE DAMPER, (HORIZONTAL ORIENTATION IN RECTANGULAR DUCT)		GRILLE, TRANSFER	<div>1. ALL SHEET METAL FLASHING REFERENCED IN DETAILS SHALL BE ALUMINUM.</div> <div>2. CONTRACTOR SHALL BE AWARE THAT SOME HVAC EQUIPMENT MAY NEED TO BE INSTALLED BEFORE BUILDING ROOFS ARE PLACED. CONTRACTOR SHALL SCHEDULE SUBMITTALS AND CONSTRUCTION ACCORDINGLY.</div> <div>3. THIS DRAWING IS GENERAL IN NATURE. SOME DESIGNATIONS AND SYMBOLS MAY NOT BE USED ON THE CONTRACT DRAWINGS.</div>
	DAMPER, MANUAL VOLUME		AIR DISTRIBUTION, DUCTWORK COWL (GOOSENECK)		SMOKE DAMPER, (VERTICAL ORIENTATION IN RECTANGULAR DUCT)		LOUVER, DOOR OR WALL OPENING	
	DAMPER HEATER, DUCT, ELECTRIC		AIR DISTRIBUTION, DUCTWORK SOUND ATTENUATOR		FAN, AXIAL FLOW		LOUVER, INTAKE AND SCREEN	
	DUCT SECTION, CHANGE IN STATIC PRESSURE RATING TAG		AIR DISTRIBUTION, FIRE AND SMOKE DAMPER		AIR DISTRIBUTION, VENTILATION OPENINGS		REGISTER GRILLE, CEILING SUPPLY	
	DUCT SECTION, STATIC PRESSURE RATING TAG		AIR DISTRIBUTION, FIRE DAMPER		DAMPER, STANDARD BRANCH, RETURN		REGISTER GRILLE, SIDE WALL SUPPLY	
	FAN, BLOWER		AIR DISTRIBUTION, FLOW SWITCH		DAMPER, STANDARD BRANCH, SUPPLY		RETURN AIR GRILLE WITH SOUND BOOT	
	FAN, EXHAUST ROOF VENT		AIR DISTRIBUTION, ORIFICE FLOWMETER		DIFFUSER, CEILING, CORNER BLOW		HVAC EQUIPMENT, HEAT EXCHANGER	
	FAN, INTAKE ROOF VENT		AIR DISTRIBUTION, SMOKE DAMPER		DIFFUSER, CEILING, FOUR-WAY, RECTANGLE OR SQUARE		HVAC EQUIPMENT, ROOM AIR CONDITIONING EQUIPMENT	
	FAN, LOUVERED ROOF VENT		AIR DISTRIBUTION, TURNING VANE IN DUCTWORK		DIFFUSER, CEILING, ROUND			
	FAN, PROPELLER		AIR DISTRIBUTION, VENTURI FLOWMETER		DIFFUSER, CEILING, THREE-WAY, RECTANGLE OR SQUARE			
	HEATER, FEED WITH AIR OUTLET		AIR DISTRIBUTION, WATER HEATER DIRECT CONTACT FEED		DIFFUSER, CEILING, TWO-WAY, RECTANGLE OR SQUARE			
	ACCESS DOOR (AD) OR ACCESS PANEL (AP)		DAMPER, BACK DRAFT		DIFFUSER, LINEAR			
	AIR DISTRIBUTION, FLEXIBLE CONNECTOR		DAMPER, FIRE		DIFFUSER, LINEAR SLOT SUPPLY			
	AIR DISTRIBUTION, TRANSITION		DUCTWORK, DIRECTION OF FLOW		DIFFUSER, SIDE WALL SUPPLY			
	DUCT, FLEXIBLE		DUCTWORK, FLEXIBLE CONNECTOR		DOOR GRILLE			
	DUCT SECTION, EXHAUST AIR DOWN		FIRE DAMPER (HORIZONTAL ORIENTATION IN RECTANGULAR DUCT)		DUCTWORK, CEILING			
	DUCT SECTION, EXHAUST AIR UP		FIRE DAMPER (VERTICAL ORIENTATION IN RECTANGULAR DUCT)		DUCTWORK, EXHAUST INLET WALL			
	DUCT SECTION, RETURN AIR		HEAT STOP, FIRE-RATED CEILING		DUCTWORK, RETURN AIR CEILING			
	DUCT SECTION, RETURN AIR DOWN		LIGHT TROFFER INLET, RETURN AIR		DUCTWORK, SUPPLY AIR CEILING			
	DUCT SECTION, STANDARD BRANCH FOR SUPPLY AND RETURN		LIGHT TROFFER OUTLET, SUPPLY AIR		AIR DUCT, FIRST DIMENSION DUCT SIDE SHOWN, SECOND DIMENSION NOT SHOWN, (FOR ACOUSTICAL LINING OR INTERNAL INSULATION, SEE SPECIFICATIONS)			
	DUCT SECTION, SUPPLY AIR		SMOKE AND FIRE DAMPER, (HORIZONTAL ORIENTATION IN RECTANGULAR DUCT)		TURNING VANES IN DUCT			
	DUCT SECTION, SUPPLY AIR DOWN		SMOKE AND FIRE DAMPER, (VERTICAL ORIENTATION IN RECTANGULAR DUCT)		EXHAUST OR RETURN AIR GRILLE OR REGISTER (WIDTH X HEIGHT, INCHES)			
	DUCT SECTION, WYE JUNCTION				SUPPLY GRILLE OR REGISTER (WIDTH X HEIGHT, INCHES)			
	DUCTWORK, CHANGE IN ELEVATION							



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL





DILKON PASS PIPELINE AND PUMP STATION

Path: C:\BCP\M\023449\0 FILENAME: M-003.DWG PLOT DATE: 1/8/2022 8:52 AM CAD USER: TYLER PRIDEMORE

PIPE PENETRATION NOTES:

- WHERE PIPES PASS THROUGH WALLS, FLOORS, OR CEILINGS, PENETRATIONS SHALL CONFORM TO TABLE, EXCEPT AS OTHERWISE SPECIFIED.
- IN TABLE, "TANK" SHALL MEAN ANY PART OF A STRUCTURE CONTAINING LIQUID, OR IN CONTACT WITH THE EARTH.
- IN TABLE, "PASSAGE" SHALL MEAN ANY ROOM, GALLERY, TUNNEL, OR SIMILAR ENCLOSURE.
- IN TABLE, WATER SURFACE "WS" SHALL MEAN AN ELEVATION 9-INCHES ABOVE MAXIMUM WATER SURFACE SHOWN.
- ALL STEEL SLEEVES SHALL BE HOT DIPPED GALVANIZED AFTER FABRICATION.
- IN CONDITION 5, PENETRATION TYPE E,H,J, OR K SHALL BE USED WHERE ONE SIDE IS DESIGNATED AS HAZARDOUS (CLASSIFIED), WHERE FLOODING IS POSSIBLE, OR WHERE SPECIFIED.
- SEAL FLANGES SHALL BE FACED AND DRILLED TO 150 POUND STANDARD. EACH JOINT SHALL BE FULL FACE GASKETED.
- WHERE SPECIFIED, CAST IRON FLANGES MAY BE INSTALLED FLUSH WITH WALL AND TAPPED FOR STUDS.
- PROVIDE CURB WHERE PENETRATING FLOOR, EXCEPT FOR PENETRATION TYPES A AND C. CURB SHALL BE 4" HIGH BY 3" WIDE.
- PROVIDE A MINIMUM OF 3" CLEARANCE BETWEEN REINFORCING STEEL AND FERROUS METAL PENETRATIONS.
- FLEXIBLE JOINTS SHALL BE PROVIDED FOR UNDERGROUND PIPING AS SPECIFIED.
- RESTRAINED FLEXIBLE COUPLINGS FOR STEEL PIPE SHALL BE DESIGNED FOR 100 PSI LINE PRESSURE IN ACCORDANCE WITH AWWA MANUAL M11, FIGURES 19.15 AND 19.16. AWWA MANUAL M11, TABLE 19.7 SHALL BE UTILIZED.
- UNLESS OTHERWISE SPECIFIED, INSULATION SHALL NOT EXTEND THROUGH SLEEVES. CHILLED WATER MUST PENETRATE WITH INSULATION.
- WHERE CAST IRON PIPE IS EMBEDDED IN CONCRETE AT AN EXPANSION JOINT, USE TYPE L PENETRATION.
- WEEP RINGS SHALL HAVE A MINIMUM DIAMETER 3-INCHES GREATER THAN THE OUTSIDE PIPE DIAMETER.
- "TANK SIDE OF WALL" SHALL MEAN SIDE OF WALL NORMALLY EXPOSED TO LIQUID, EARTH, OR OUTSIDE ATMOSPHERE.
- SEAL WITH MASTIC SEALANT WHERE WALL IS EXPOSED TO LIQUID, EARTH, OR A HAZARDOUS (CLASSIFIED) AREA.

PIPE PENETRATION TYPES					
CONDITION			TYPE		
	FROM	TO	STEEL PIPE	CAST IRON	PLASTIC PIPE
1	TANK	TANK BELOW W.S.	E, H OR K	E, F, G OR J	E
2	TANK	TANK ABOVE W.S.	D OR E	D OR E	D OR E
3	PASSAGE	TANK BELOW W.S.	E, H OR K	E, F, G OR J	E
4	PASSAGE	TANK ABOVE W.S.	A, C, D OR E	A, C, D OR E	A, C, D OR E
5	PASSAGE	PASSAGE	B OR C SEE NOTE 6	B OR C SEE NOTE 6	B OR C SEE NOTE 6
6	PASSAGE	OUTSIDE WALL	D OR E	D OR E	D OR E
7	PASSAGE	ROOF	AS SHOWN		
8	TANK	OUTSIDE WALL	E OR F	E, F OR G	E

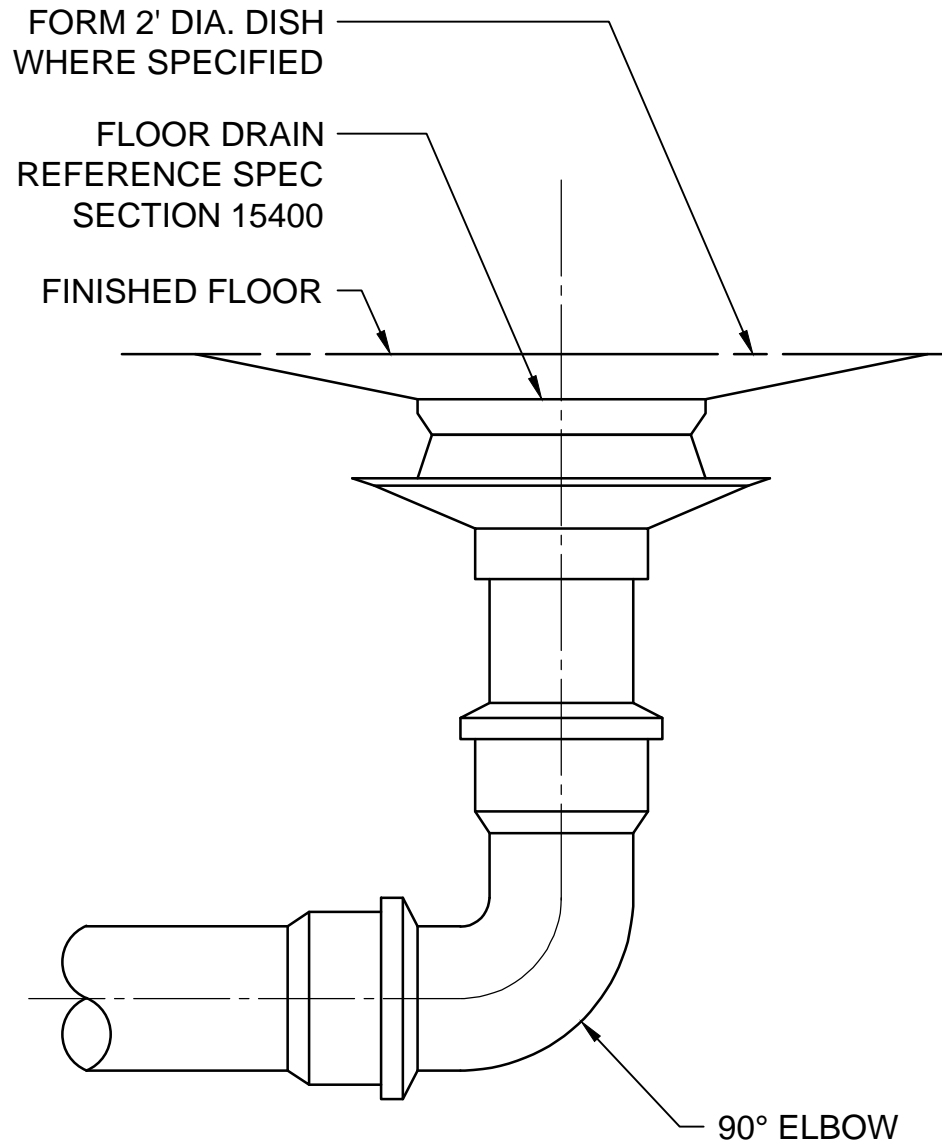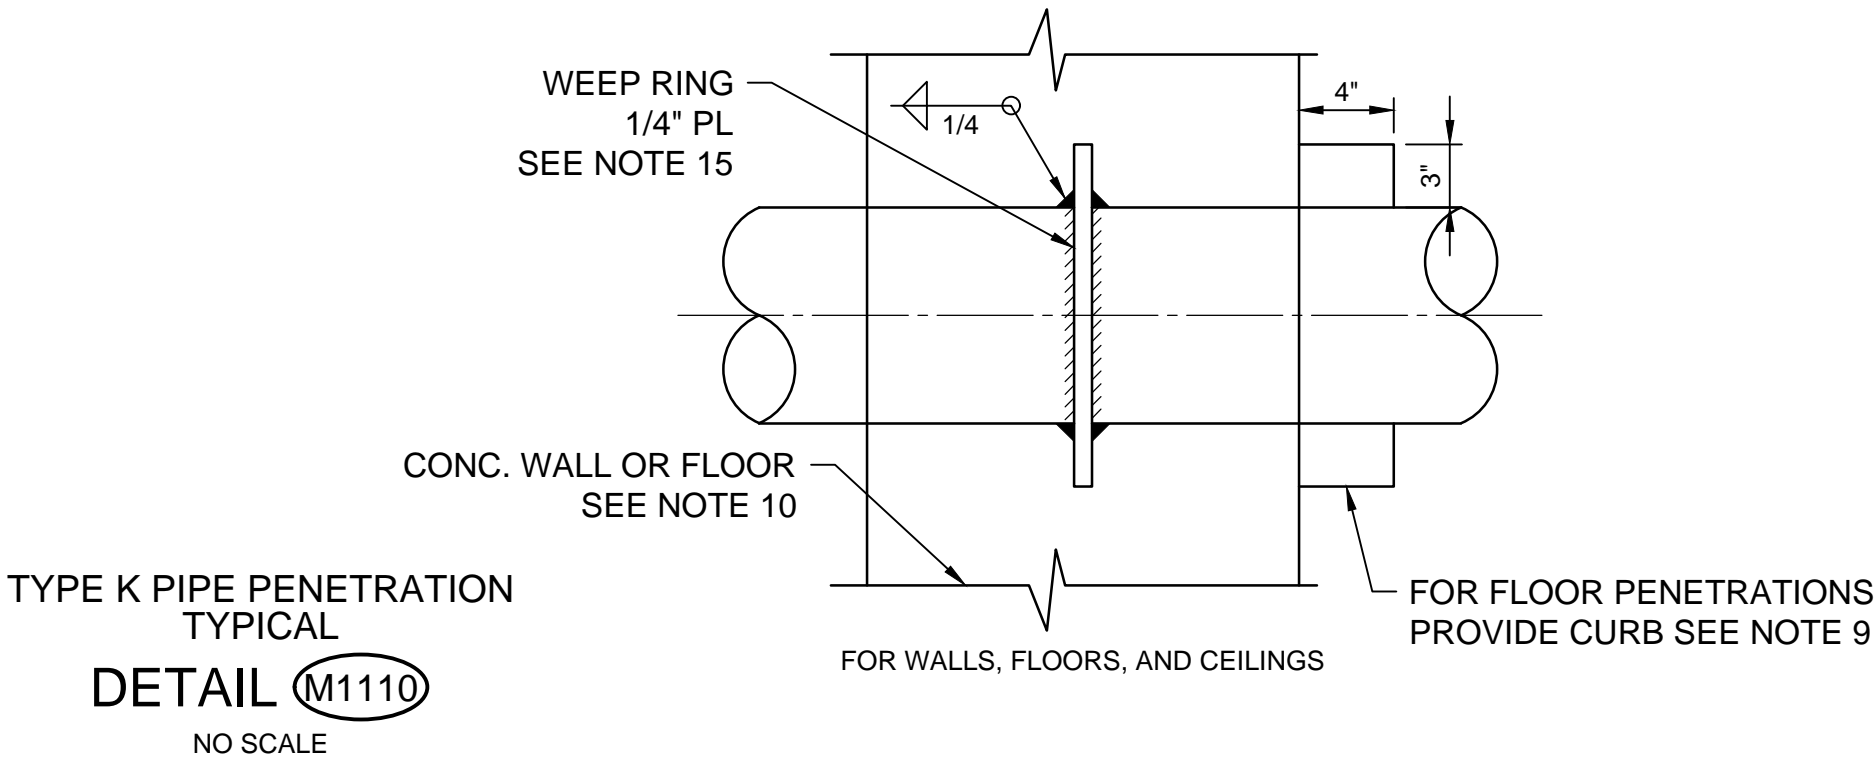

TYPE II FLOOR DRAIN
TYPICAL
DETAIL (M4202)
NO SCALE



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

M-003.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

PROCESS

STANDARD DETAILS

DRAWING NUMBER


M-003

0

SHEET NUMBER
OF

60

Path: C:\BCP\M\023449\0 FILENAME: M-100.DWG PLOT DATE: 1/12/2022 1:57 PM CAD USER: TYLER PRIDEMORE

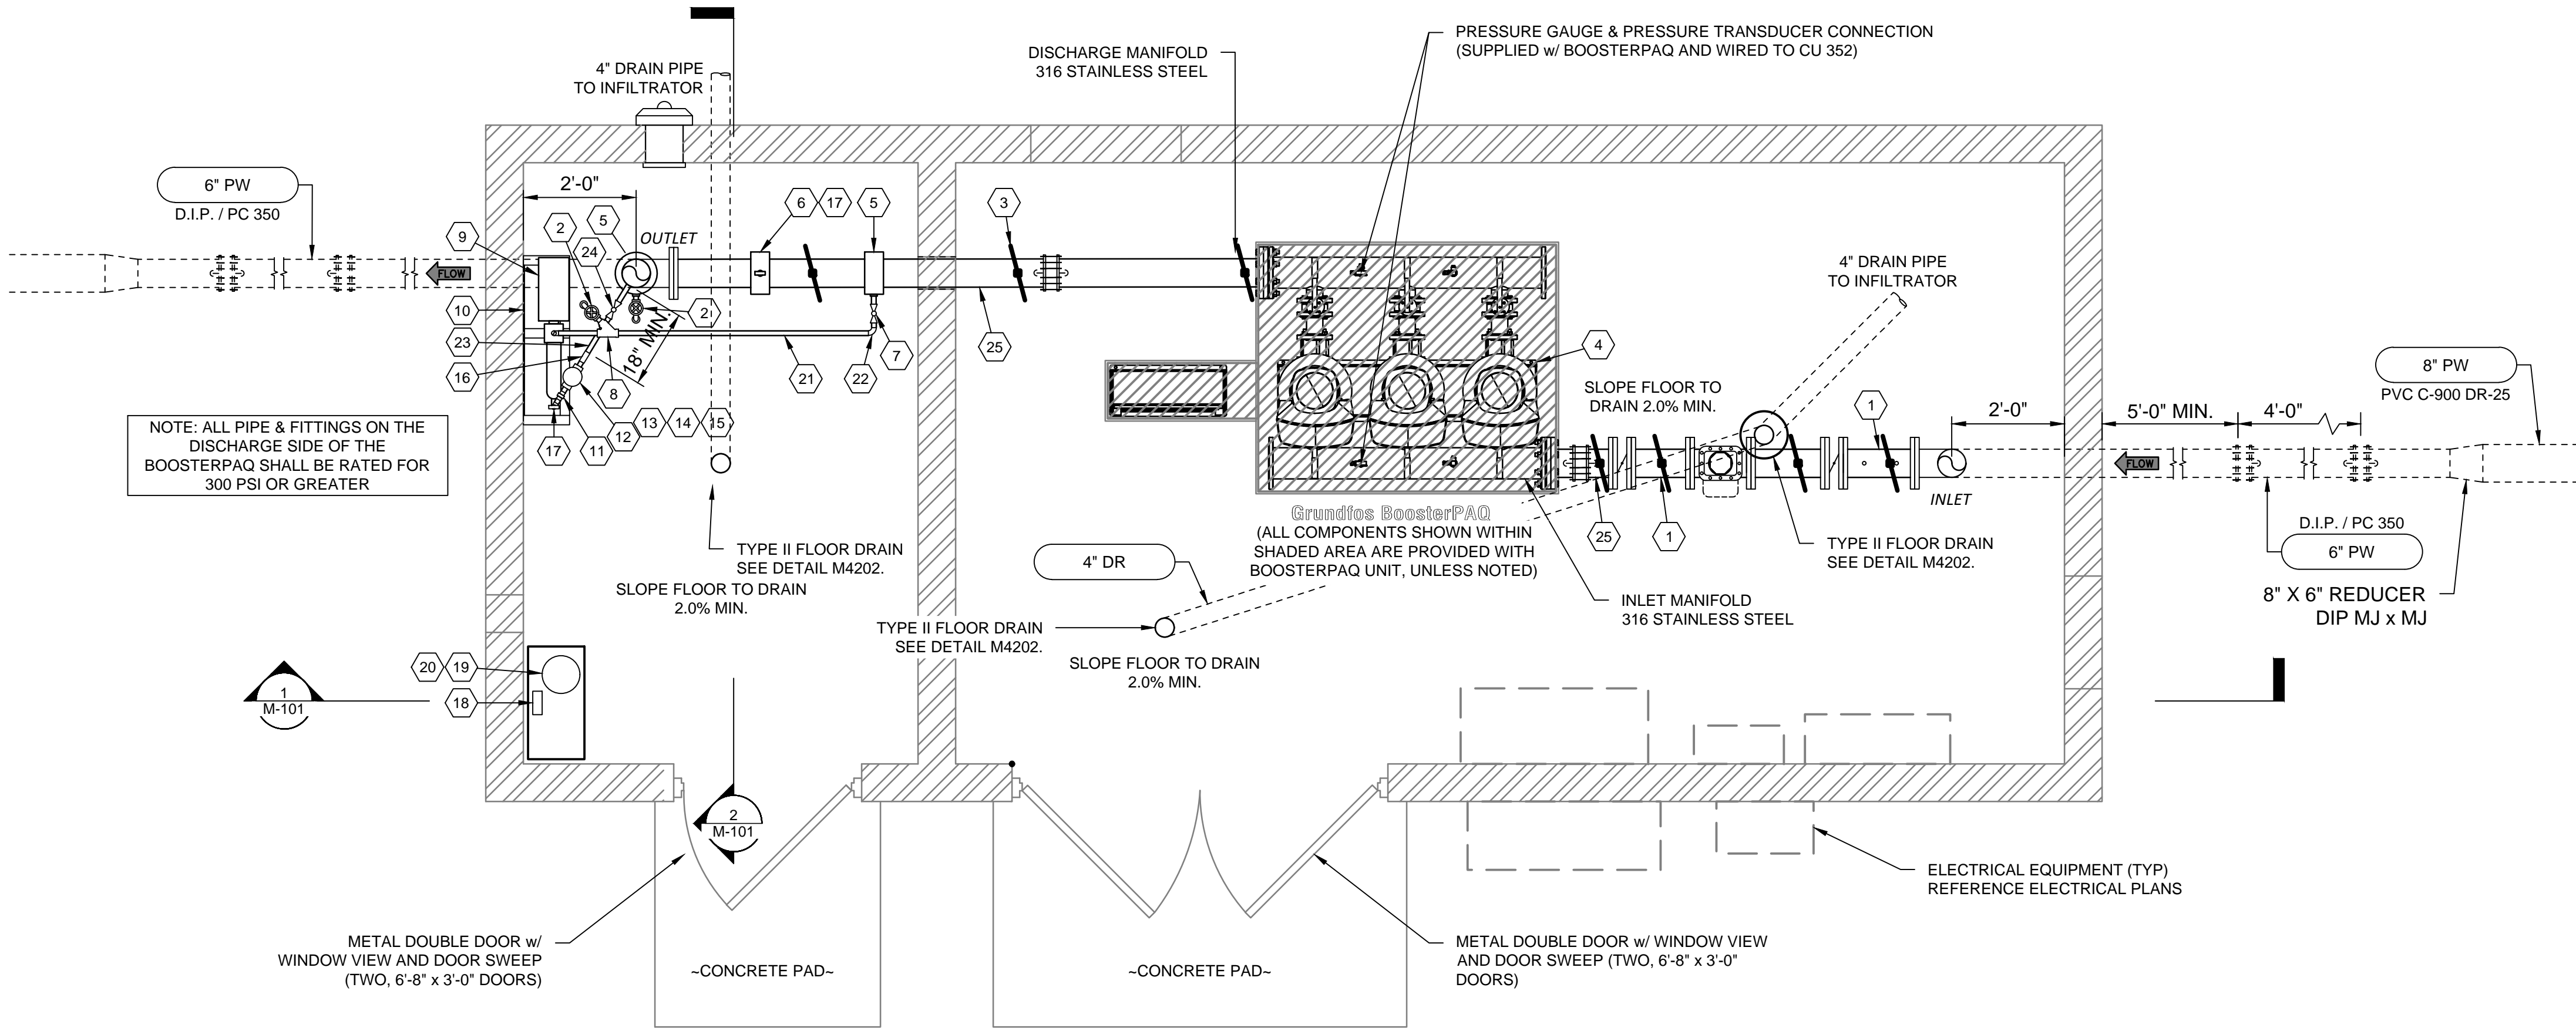

PLAN
SCALE: 1/2" = 1'-0"

GENERAL NOTES

- BOOSTER STATION PIPING DIAMETER VARIES TO FACILITATE: 1) MATCHING MANIFOLD DIAMETER SIZE; 2) DESIGN FLOW OF BOOSTER STATION; 3) AND MAXIMUM ELECTROMAGNETIC METER VELOCITY LIMITS.

KEY NOTES

- 6" FLG X FLG DUCTILE IRON PIPE. PC-350 (TYP.)
- 3/4" HOSE BIB MIPT BRASS
- COATED STEEL PIPE SUPPORT W/ ADJUSTABLE NUT (TYP.)
- GRUNDFOS HYDRO MPC E 3CRE45-4
- SADDLE, 6" x 1" IPT
- SADDLE, 6" x 1" IPT, W/ 1" x 1/4" BUSHING
- GATE VALVE, 1" BRASS, FIPT
- STRAINER, 1" x 1" FIPT G.I.P.
- FRANKLIN ELECTRIC SINGLE PHASE 115/230 VOLTS 3/4 HP BOOSTER PUMP MODEL 5FBT07S4
- BOOSTER PUMP BRACKET
- UNION 1" SLIP SCH. 80 PVC
- WALLACE AND TIERNAN 300 99-C CHLORINE INJECTOR (10LB/DAY)
- BUSHING, 1" x 3/4" FIPT SCH. 80 PVC
- NOZZLE EJECTOR
- TAILWAY EJECTOR
- COUPLING, 1" SLIP SCH. 80 PVC
- GAUGE GLYCER 1/4" 0-350
- CHLORINE SCALE
- GAS CHLORINE CYLINDER
- WALLACE AND TIERNAN SFC SC FLOW PROPORTIONAL CONTROL
- PIPE 1" CUT AND THREADED TO FIT, G.I.P. (TYP.)
- ELBOW 90° 1" FIPT G.I.P.
- PIPE 1" CUT TO FIT SCH. 80 PVC (TYP.)
- BALL VALVE 1" SLIP SCH. 80 PVC
- 6" DUCTILE IRON FLGD X PE SPOOL (TYP.)



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C.WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C.WILLMORE

CHECKED: ----

APPROVED: S. BRENCHELY

FILENAME

M-100.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

PROCESS


DILKON PASS PUMP STATION PLAN

DRAWING NUMBER

M-100

0 SHEET NUMBER OF 60

Path: C:\BCP\W\0234490 FILENAME: M-101.DWG PLOT DATE: 1/12/2022 1:57 PM CAD USER: TYLER PRIDEMORE

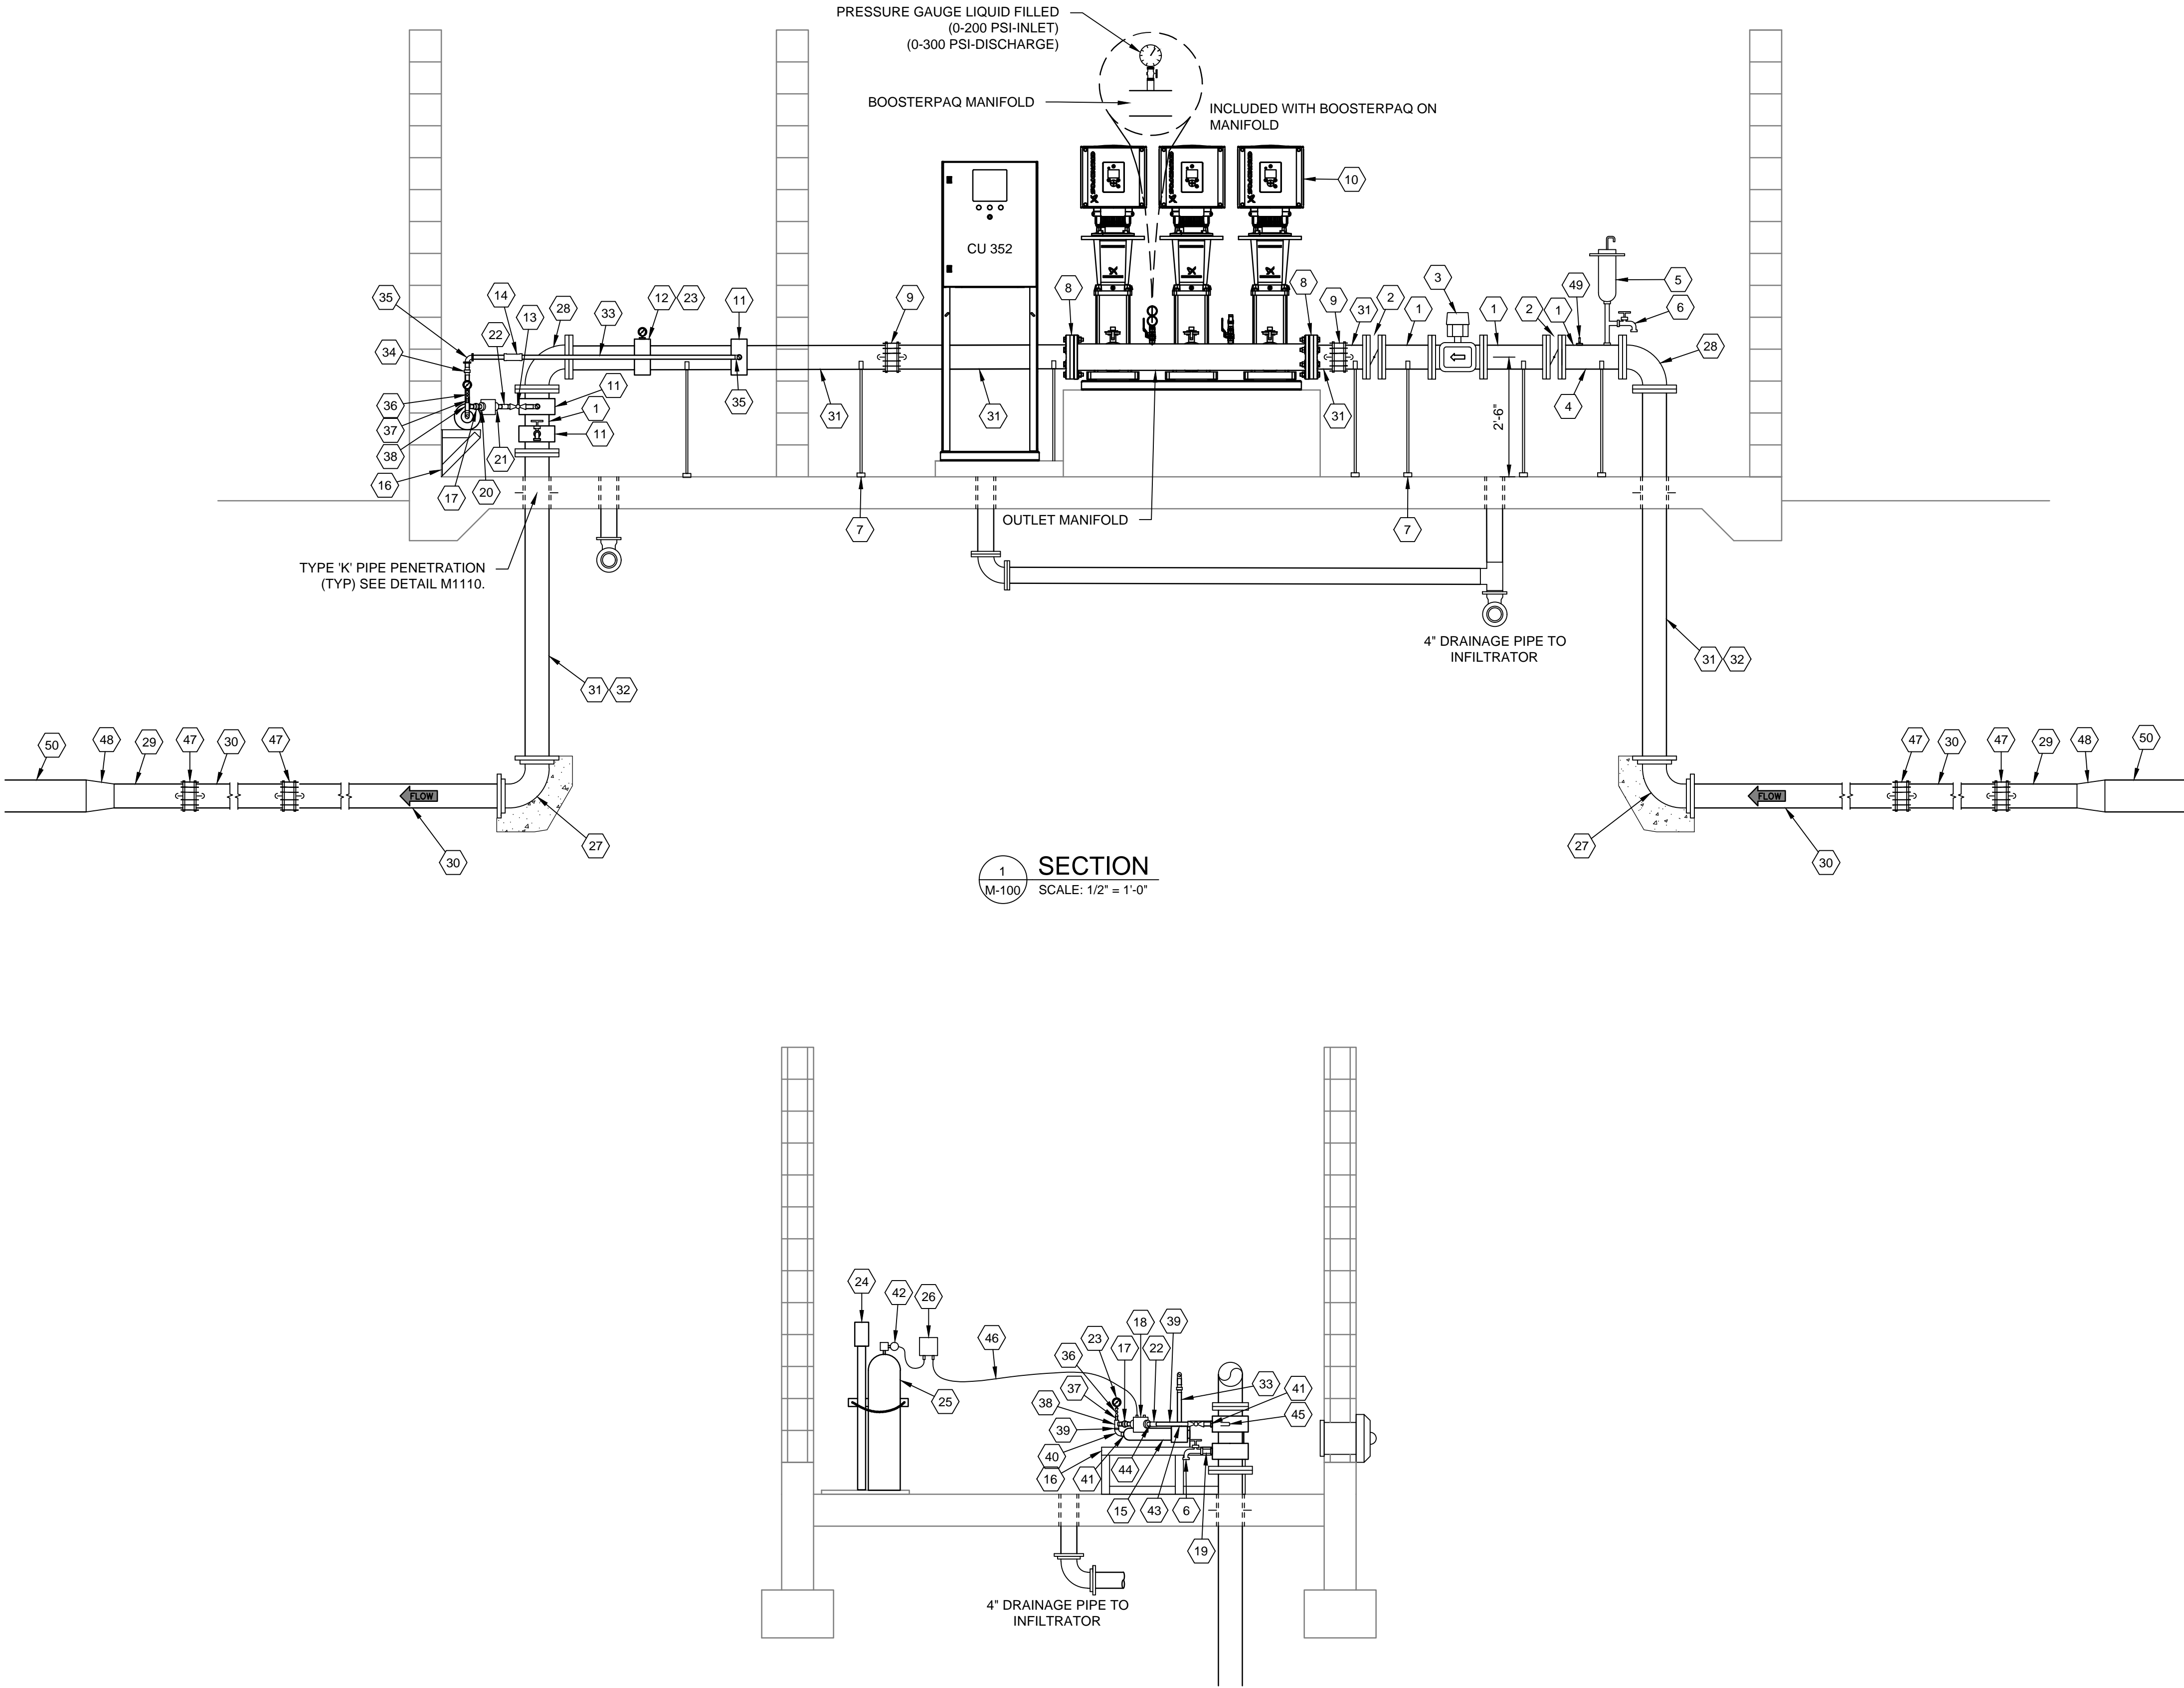

GENERAL NOTES

- BOOSTER STATION PIPING DIAMETER VARIES TO FACILITATE: 1) MATCHING MANIFOLD DIAMETER SIZE; 2) DESIGN FLOW OF BOOSTER STATION; 3) AND MAXIMUM ELECTROMAGNETIC METER VELOCITY LIMITS.

KEY NOTES

- 6" FLG X FLG DUCTILE IRON PIPE, PC-350
- 6" MUELLER LINESEAL III BUTTERFLY VALVE, FLANGED ENDS
- 6" EVOQ4 ELECTROMAGNETIC METER
- SPOOL TO INCLUDE TAPPING BOSS FOR 3/4" HOSE BIB AND CAV VALVE AND PRESSURE TRANSDUCER
- 3/4" COMBINATION AIR/VACUUM VALVE, SEE SPECIFICATION 15150
- 3/4" HOSE BIB MIPT BRASS
- COATED STEEL PIPE SUPPORT W/ ADJUSTABLE NUT (TYP.)
- DIELECTRIC INSULATING JOINT AND FLANGE SPACER WITH BOLT ISOLATORS
- 6" ROMAC STYLE 501 FLEXIBLE COUPLING
- GRUNDFOS HYDRO MPC E 3CRE45-3
- SADDLE, 6" x 1" IPT
- SADDLE, 6" x 1" IPT, W/ 1" x 1/4" BUSHING AND PRESSURE GAGE
- BALL VALVE 1" SLIP SCH. 80 PVC
- STRAINER, 1" x 1" FIPT G.I.P.
- FRANKLIN ELECTRIC SINGLE PHASE 115/230 VOLTS 3/4 HP BOOSTER PUMP MODEL 5FBT07S4
- BOOSTER PUMP BRACKET
- UNION, 1" SLIP SCH. 80 PVC
- WALLACE AND TIERNAN 300 99-C CHLORINE INJECTOR (10 LB/DAY)
- BUSHING, 1" x 3/4"
- NOZZLE EJECTOR
- TAILWAY EJECTOR
- COUPLING, 1" SLIP SCH. 80 PVC
- GAUGE GLYCER 1/4" 0-350
- CHLORINE SCALE
- GAS CHLORINE CYLINDER
- WALLACE AND TIERNAN SFC SC FLOW PROPORTIONAL CONTROL
- DIP MJ X MJ 90° BEND WITH THRUST BLOCK AND MEGALUG RESTRAINED JOINTS
- 6" FLGD 90° STEEL ELBOW
- 6" PVC PIPE, SEE SITE PLAN SHEET C-100
- 6" DI PIPE, PC 350 (WRAP IN TWO (2) LAYERS OF 8 MIL. POLYETHYTENE
- 6" FLGD X PE DI PIPE, PC 350
- (WRAP IN TWO (2) LAYERS OF 8 MIL. POLYETHYTENE
- PIPE 1" CUT AND THREADED TO FIT, G.I.P. (TYP.)
- UNION, 1" FIPT G.I.P.
- ELBOW 90° 1" FIPT G.I.P.
- VALVE PRESSURE COCK 1/4" MIPT BRASS
- BUSHING 1" S X 1/4" FIPT SCH. 80 PVC
- TEE 1" SLIP SCH. 80 PVC
- PIPE 1" CUT TO FIT SCH. 80 PVC (TYP.)
- ELBOW 90° 1" SLIP SCH. 80 PVC
- ADAPTER 1" S X MIPT SCH. 80 PVC
- PRESSURE REGULATOR
- BUSHING 1-1/4" X 1" G.I.P.
- BUSHING 1" S X 3/4" FIPT SCH. 80 PVC
- 1/2" PVC-SOLUTION TUBE
- TUBING
- 6" ROMAC STYLE 501 FLEXIBLE COUPLING
- 8" x 6" MJ x MJ REDUCER
- WICA C-10 PRESSURE TRANSDUCER
- 8" PVC PIPE, SEE SITE PLAN SHEET C-100



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: C. WILLMORE

DRAWN: T. PRIDEMORE

CHECKED: C. WILLMORE

CHECKED: - -

APPROVED: S. BRENCHELY

FILENAME

M-101.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

PROCESS

DILKON PASS PUMP STATION BUILDING SECTION

DRAWING NUMBER

M-101

SHEET NUMBER
OF

0

60

[illegible]

Path: C:\BCP\DWG FILENAME: S-002.DWG PLOT DATE: 1/11/2022 10:55 AM CAD USER: THOMAS BOUFFARD

D

C

B

A

TABLE 1				
REQUIRED SPECIAL INSPECTIONS - STRUCTURAL SYSTEMS				
SYSTEM OR MATERIAL	REQUIRED INSPECTION	FREQUENCY OF INSPECTION		REMARKS
		CONTINUOUS	PERIODIC	
SOILS	VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL		X	
	VERIFY SOIL MATERIALS BELOW FOOTINGS ARE ADEQUATE TO ACHIEVE DESIGN BEARING CAPACITY		X	
	PRIOR TO PLACEMENT OF COMPACTED FILL, OBSERVE SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY		X	
	PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS		X	SEE TABLE 2
	VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL	X		SEE TABLE 2
	PROOF ROLLING OF SOILS DISTURBED BY GROUND IMPROVEMENTS		X	
	SHORING SYSTEM WELDING	X		
CONCRETE	INSPECT FORMWORK FOR LOCATION AND DIMENSIONS OF MEMBER BEING FORMED		X	
	VERIFY MATERIAL FOR REINFORCEMENT		X	CONTRACTOR TO SUBMIT CERTIFIED MILL TEST REPORTS
	REINFORCING STEEL PLACEMENT		X	
	INSPECT ANCHORS TO BE CAST IN CONCRETE		X	PRIOR TO AND DURING CONCRETE PLACEMENT
	INSPECT POST-INSTALLED CONCRETE ANCHORS: - HORIZONTAL AND UPWARDLY INCLINED ADHESIVE ANCHORS - OTHER ANCHORS UNLESS ICC REPORT REQUIRED CONTINUOUS INSPECTION	X	X	INSPECTION TO CONFORM TO IBC AND TO ANCHOR MANUFACTURER'S RECOMMENDATIONS AND ICC REPORTS
	VERIFY USE OF REQUIRED CONCRETE MIX DESIGN(S)		X	
	AT THE TIME FRESH CONCRETE IS SAMPLED TO FABRICATE SPECIMENS FOR STRENGTH TESTS, PERFORM SLUMP AND AIR CONTENT TESTS, AND TEMPERATURE OF CONCRETE	X		CONTINUOUS DURING PREPARATION OF SAMPLES
	CONCRETE PLACEMENT	X		
	INSPECTION FOR MAINTENANCE OF CURING PROCEDURES AND TEMPERATURE		X	VERIFY APPROPRIATE CURING METHOD HAS BEEN IMPLEMENTED AFTER EACH POUR
	VERIFY IN-SITU CONCRETE STRENGTH PRIOR TO REMOVAL OF SHORES AND FORMS FROM STRUCTURAL SLABS AND BEAMS		X	
	CEMENTITIOUS GROUTING OF BASE PLATES AND EPOXY GROUTING FOR EQUIPMENT MOUNTING	X		
STRUCTURAL STEEL	FABRICATION OF STRUCTURAL ELEMENTS			FABRICATOR SHALL BE APPROVED IN ACCORDANCE WITH IBC, CHAPTER 17 TO PERFORM WORK WITHOUT SPECIAL INSPECTION
	VERIFY MATERIAL OF ANCHOR BOLTS AND THREADED RODS		X	CONTRACTOR TO SUBMIT MANUFACTURER'S CERTIFIED TEST REPORTS

TABLE 1				
REQUIRED SPECIAL INSPECTIONS - STRUCTURAL SYSTEMS				
SYSTEM OR MATERIAL	REQUIRED INSPECTION	FREQUENCY OF INSPECTION		REMARKS
MASONRY	VERIFY PROPORTIONS OF SITE -PREPARED MORTAR AND GROUT		X	AT START OF MASONRY CONSTRUCTION
	VERIFY SPECIFIED TYPE, GRADE AND SIZE OF REINFORCEMENT		X	CONTRACTOR TO SUBMIT CERTIFIED MILL TEST REPORTS
	VERIFY MATERIALS FOR MASONRY UNITS, MORTAR, GROUT, ANCHORS, TIES AND ACCESSORIES		X	CONTRACTOR TO SUBMIT MANUFACTURER'S CERTIFIED COMPLIANCE REPORTS
	VERIFY TYPE, SIZE, LOCATION AND INSTALLATION OF EMBEDDED CONNECTORS AND ANCHORS		X	
	VERIFY SIZE AND LOCATION OF STRUCTURAL ELEMENTS		X	
	VERIFY TYPE, SIZE AND LOCATION OF ANCHORAGE OF MASONRY TO OTHER CONSTRUCTION		X	
	VERIFY PROTECTION PROVISIONS FOR COLD AND HOT WEATHER MASONRY CONSTRUCTION		X	
	PLACEMENT OF MASONRY UNITS AND CONSTRUCTION OF MORTAR JOINTS		X	
	REINFORCING STEEL PLACEMENT		X	
	VERIFY GROUT SPACE IS CLEAN		X	
	VERIFY PROPORTIONS OF GROUT; USE OF REQUIRED GROUT MIX DESIGN		X	
	OBSERVE GROUT PLACEMENT	X		
	OBSERVE PREPARATION OF ANY GROUT OR MORTAR SPECIMENS AND/OR PRISMS	X		CONTINUOUS DURING PREPARATION OF SAMPLES

QUALITY ASSURANCE NOTES

- THE QUALITY OF THE WORKMANSHIP AND THE QUALITY OF THE MATERIALS OF CONSTRUCTION ARE GOVERNED BY THE INTERNATIONAL BUILDING CODE, 2015 EDITION (IBC).
- ALL NEW STRUCTURES AND MODIFICATIONS TO EXISTING STRUCTURES TO BE CONSTRUCTED AS A PART OF THIS PROJECT ARE CLASSIFIED AS RISK CATEGORY IV IN ACCORDANCE WITH THE IBC. THE STRUCTURES ARE CLASSIFIED AS SEISMIC DESIGN CATEGORY C.
- TO ASSURE THE QUALITY OF THE CONSTRUCTION OF THIS PROJECT, STRUCTURAL TESTS, SPECIAL INSPECTION AND STRUCTURAL OBSERVATION WILL BE PERFORMED IN ACCORDANCE WITH IBC, CHAPTER 17.
- WHERE FREQUENCY OF INSPECTION IS SPECIFIED TO BE CONTINUOUS, THE SPECIAL INSPECTOR IS EXPECTED TO BE PRESENT IN THE AREA WHERE THE WORK IS BEING PERFORMED AND PROVIDING FULL-TIME OBSERVATION OF THE WORK REQUIRING SPECIAL INSPECTION.
- WHERE FREQUENCY OF INSPECTION IS SPECIFIED TO BE PERIODIC, THE SPECIAL INSPECTOR IS EXPECTED TO BE PRESENT IN THE AREA WHERE THE WORK HAS BEEN OR IS BEING PERFORMED AND AT THE COMPLETION OF THE WORK (PRIOR TO THE NEXT CONSTRUCTION TASK).
- SPECIAL INSPECTIONS ARE IN ADDITION TO INSPECTIONS BY THE BUILDING OFFICIALS. CONSTRUCTION IS SUBJECT TO INSPECTION BY THE BUILDING OFFICIAL. COORDINATE WITH BUILDING DEPARTMENT TO DETERMINE REQUIRED INSPECTIONS.
- CONTRACTOR SHALL PROVIDE ACCESS TO THE WORK FOR REQUIRED INSPECTIONS. CONTRACTOR SHALL PROVIDE NOTIFICATION IN ADVANCE OF REQUIRED INSPECTIONS, TESTING AND STRUCTURAL OBSERVATIONS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: S. BELLIS

DRAWN: T. BOUFFARD

CHECKED:

CHECKED:

APPROVED:

FILENAME

S-002.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

STRUCTURAL

SPECIAL INSPECTIONS 1

DRAWING NUMBER

S-002

SHEET NUMBER

0

OF

60

Path: C:\BCPM\02344908 FILENAME: S-003.DWG PLOT DATE: 1/11/2022 10:56 AM CAD USER: THOMAS BOUFFARD

SPECIAL INSPECTIONS

- SI 1
- AN INDEPENDENT TESTING COMPANY RETAINED BY THE OWNER AND APPROVED BY THE BUILDING OFFICIAL SHALL INSPECT THE FOLLOWING (SEE EXPANDED LIST ON DRAWING S-003, SPECIFICATIONS AND GOVERNING CODE):
1. SOIL COMPACTION AT FOUNDATIONS.

2. REINFORCING BAR, CONCRETE PLACEMENT AND TAKING OF CONCRETE TEST SPECIMENS.

3. ANCHOR BOLTS.

4. HIGH STRENGTH BOLTING.

5. MECHANICAL AND ELECTRICAL EQUIPMENT, PERIODIC SPECIAL INSPECTION OF STRUCTURAL COMPONENTS FOR SEISMIC RESISTANCE:

A. ANCHORAGE OF ELECTRICAL EQUIPMENT.

B. INSTALLATION OF COMPONENTS WHERE THE COMPONENT IMPORTANCE FACTOR IS 1.5.
- SI 2
- CONTRACTOR SHALL NOTIFY THE TESTING COMPANY FOR ALL INSPECTIONS.

STRUCTURAL OBSERVATIONS

- SO 1
- THE OWNER SHALL RETAIN A REGISTERED DESIGN PROFESSIONAL TO PERFORM STRUCTURAL OBSERVATIONS. THE CONSTRUCTION MANAGER SHALL NOTIFY THE OWNER AT LEAST 48 HOURS BEFORE A DESIGNATED WORK IS TO BE COVERED. REFER TO SPECIFICATION 01400 FOR ADDITIONAL REQUIREMENTS.
- SO 2
- REQUIRED STRUCTURAL OBSERVATIONS INCLUDE:

1. STRUCTURAL FILL.

2. FOUNDATIONS PREPARED FOR CONCRETE PLACEMENT.

3. PRIOR TO GROUTING FIRST LIFT OF MASONRY CONSTRUCTION.

4. COMPLETION OF LATERAL FORCE RESISTING ELEMENTS INCLUDING DIAPHRAGMS AND OTHER ELEMENTS.

TENSION DEVELOPMENT AND LAP SPLICE LENGTHS (IN INCHES) FOR UNCOATED BARS IN NORMAL-WEIGHT CONCRETE WITH $f_c' = 4,000$ PSI OR HIGHER

THIS TABLE IS GOOD ONLY FOR CENTER/CENTER SPACING OF REINFORCING BARS EQUAL TO THE MINIMUM SHOWN OR GREATER. NO TRANSVERSE REINFORCING ASSUMED.

BAR SIZE	APPLICATION	CONCRETE COVER = 1.50 IN.			CONCRETE COVER = 2.00 IN.			CONCRETE COVER = 3.00 IN.		
		TOP	OTHER	MIN C/C SPACING	TOP	OTHER	MIN C/C SPACING	TOP	OTHER	MIN C/C SPACING
#3	DEVELOPMENT LAP SPLICE	12 16	12 16	3.50 3.75	12 16	12 16	4.50 4.75	12 16	12 16	6.50 6.75
#4	DEVELOPMENT LAP SPLICE	15 20	12 16	3.50 4.00	15 20	12 16	4.50 5.00	15 20	12 16	6.50 7.00
#5	DEVELOPMENT LAP SPLICE	19 24	15 19	3.75 4.25	19 24	15 19	4.75 5.25	19 24	15 19	6.75 7.25
#6	DEVELOPMENT LAP SPLICE	22 29	17 22	3.75 4.50	22 29	17 22	4.75 5.50	22 29	17 22	6.75 7.50
#7	DEVELOPMENT LAP SPLICE	37 48	28 37	4.00 4.75	33 42	25 33	5.00 5.75	33 42	25 33	7.00 7.75
#8	DEVELOPMENT LAP SPLICE	47 60	36 47	4.00 5.00	37 48	29 37	5.00 6.00	37 48	29 37	7.00 8.00

NOTES:

1. TABULATED VALUES ARE BASED ON GRADE 60 REINFORCING BARS AND NORMAL-WEIGHT CONCRETE.
2. TENSION DEVELOPMENT LENGTHS AND TENSION LAP SPLICE LENGTHS ARE CALCULATED PER ACI 318-14, SECTIONS 25.4.2.3 AND 25.5, RESPECTIVELY.
3. LAP SPLICE LENGTHS ARE LAP CLASS B = $1.3 l_d$ (ACI 318-14, SECTION 25.5.2).
4. TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 IN. OF FRESH CONCRETE CAST BELOW THE BARS. NOTE THAT IN ADDITION TO TOP BARS IN BEAMS AND SLABS, ALL HORIZONTAL BARS IN WALLS ARE CONSIDERED TO BE TOP BARS.

STRUCTURAL DEFERRED SUBMITTALS (IBC 2015, SECTION 107.3.4.1)

- SDS 1
- THE CONTRACTOR SHALL SUBMIT DRAWINGS AND CALCULATIONS BEARING THE SEAL OF A PROFESSIONAL ENGINEER LICENSED IN ARIZONA TO THE ENGINEER FOR REVIEW. STRUCTURAL DEFERRED SUBMITTALS INCLUDE:
1. ANCHOR BOLTS FOR ALL EQUIPMENT ANCHORAGE.

2. CONSTRUCTION SHORING IF REQUIRED.

TABLE 2

REQUIRED TESTING FOR SPECIAL INSPECTIONS

SYSTEM OR MATERIAL	TESTING		REMARKS
	CODE OR STANDARD REFERENCE	FREQUENCY	
GEOTECHNICAL			
PREPARED SUBGRADE DENSITY	ASTM D6938	EACH 300 SF OF PREPARED SUBGRADE	PER GEOTECHNICAL REPORT
FILL IN-PLACE DENSITY	ASTM D6938	EACH 300 SF OF EACH LIFT PLACED EACH DAY	PER GEOTECHNICAL REPORT
CONCRETE			
CONCRETE COMPRESSIVE STRENGTH	ASTM C31,ASTM C39,ASTM C172	SEE SPECIFICATION 03300	
CONCRETE SLUMP	ASTM C143	WHENEVER CYLINDERS ARE CAST	
CONCRETE AIR CONTENT	ASTM C231	WHENEVER CYLINDERS ARE CAST	
CONCRETE TEMPERATURE	ASTM C1064	WHENEVER CYLINDERS ARE CAST	
CEMENTITIOUS AND EPOXY GROUT COMPRESSIVE STRENGTH	ASTM C942 (CEMENTITIOUS) ASTM C579 (EPOXY)		TEST 2" CUBES FOR EACH GROUT SHIPMENT TO THE FIELD
MASONRY			
COMPRESSIVE STRENGTH, f'_m , OF MASONRY ASSEMBLIES			PRIOR TO START OF MASONRY CONSTRUCTION, CONTRACTOR SHALL SUBMIT VERIFICATION OF COMPRESSIVE STRENGTH FOR EACH TYPE OF MASONRY ASSEMBLY. PRISM TEST METHOD SHALL BE USED.
MASONRY UNIT STRENGTH	ASTM C140	(12) UNITS PER EACH 50000 UNITS	CONTRACTOR TO SUBMIT MANUFACTURER'S CERTIFIED TEST REPORTS FOR EACH TYPE OF MASONRY UNIT
GROUT STRENGTH	ASTM C1019	EACH 5000 SF OF WALL	COMPRESSIVE STRENGTH, AIR CONTENT, SLUMP, TEMPERATURE OF FILL FOR MASONRY ASSEMBLIES SHALL BE TESTED PER CONCRETE REQUIREMENTS ABOVE.
PRISM STRENGTH OF MASONRY ASSEMBLY	ASTM C1314	(3) PRISMS FOR EACH 5000 SF OF WALL	A SET OF TESTS IS REQUIRED FOR EACH TYPE OF MASONRY ASSEMBLY



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: S. BELLIS

DRAWN: T. BOUFFARD

CHECKED:

CHECKED:

APPROVED:

FILENAME

S-003.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

STRUCTURAL

SPECIAL
INSPECTIONS 2

DRAWING NUMBER


S-003

SHEET NUMBER

0


OF

60



- 60

Path: C:\BCPM\02344908 FILENAME: S-005.DWG PLOT DATE: 1/11/2022 10:59 AM CAD USER: THOMAS BOUFFARD

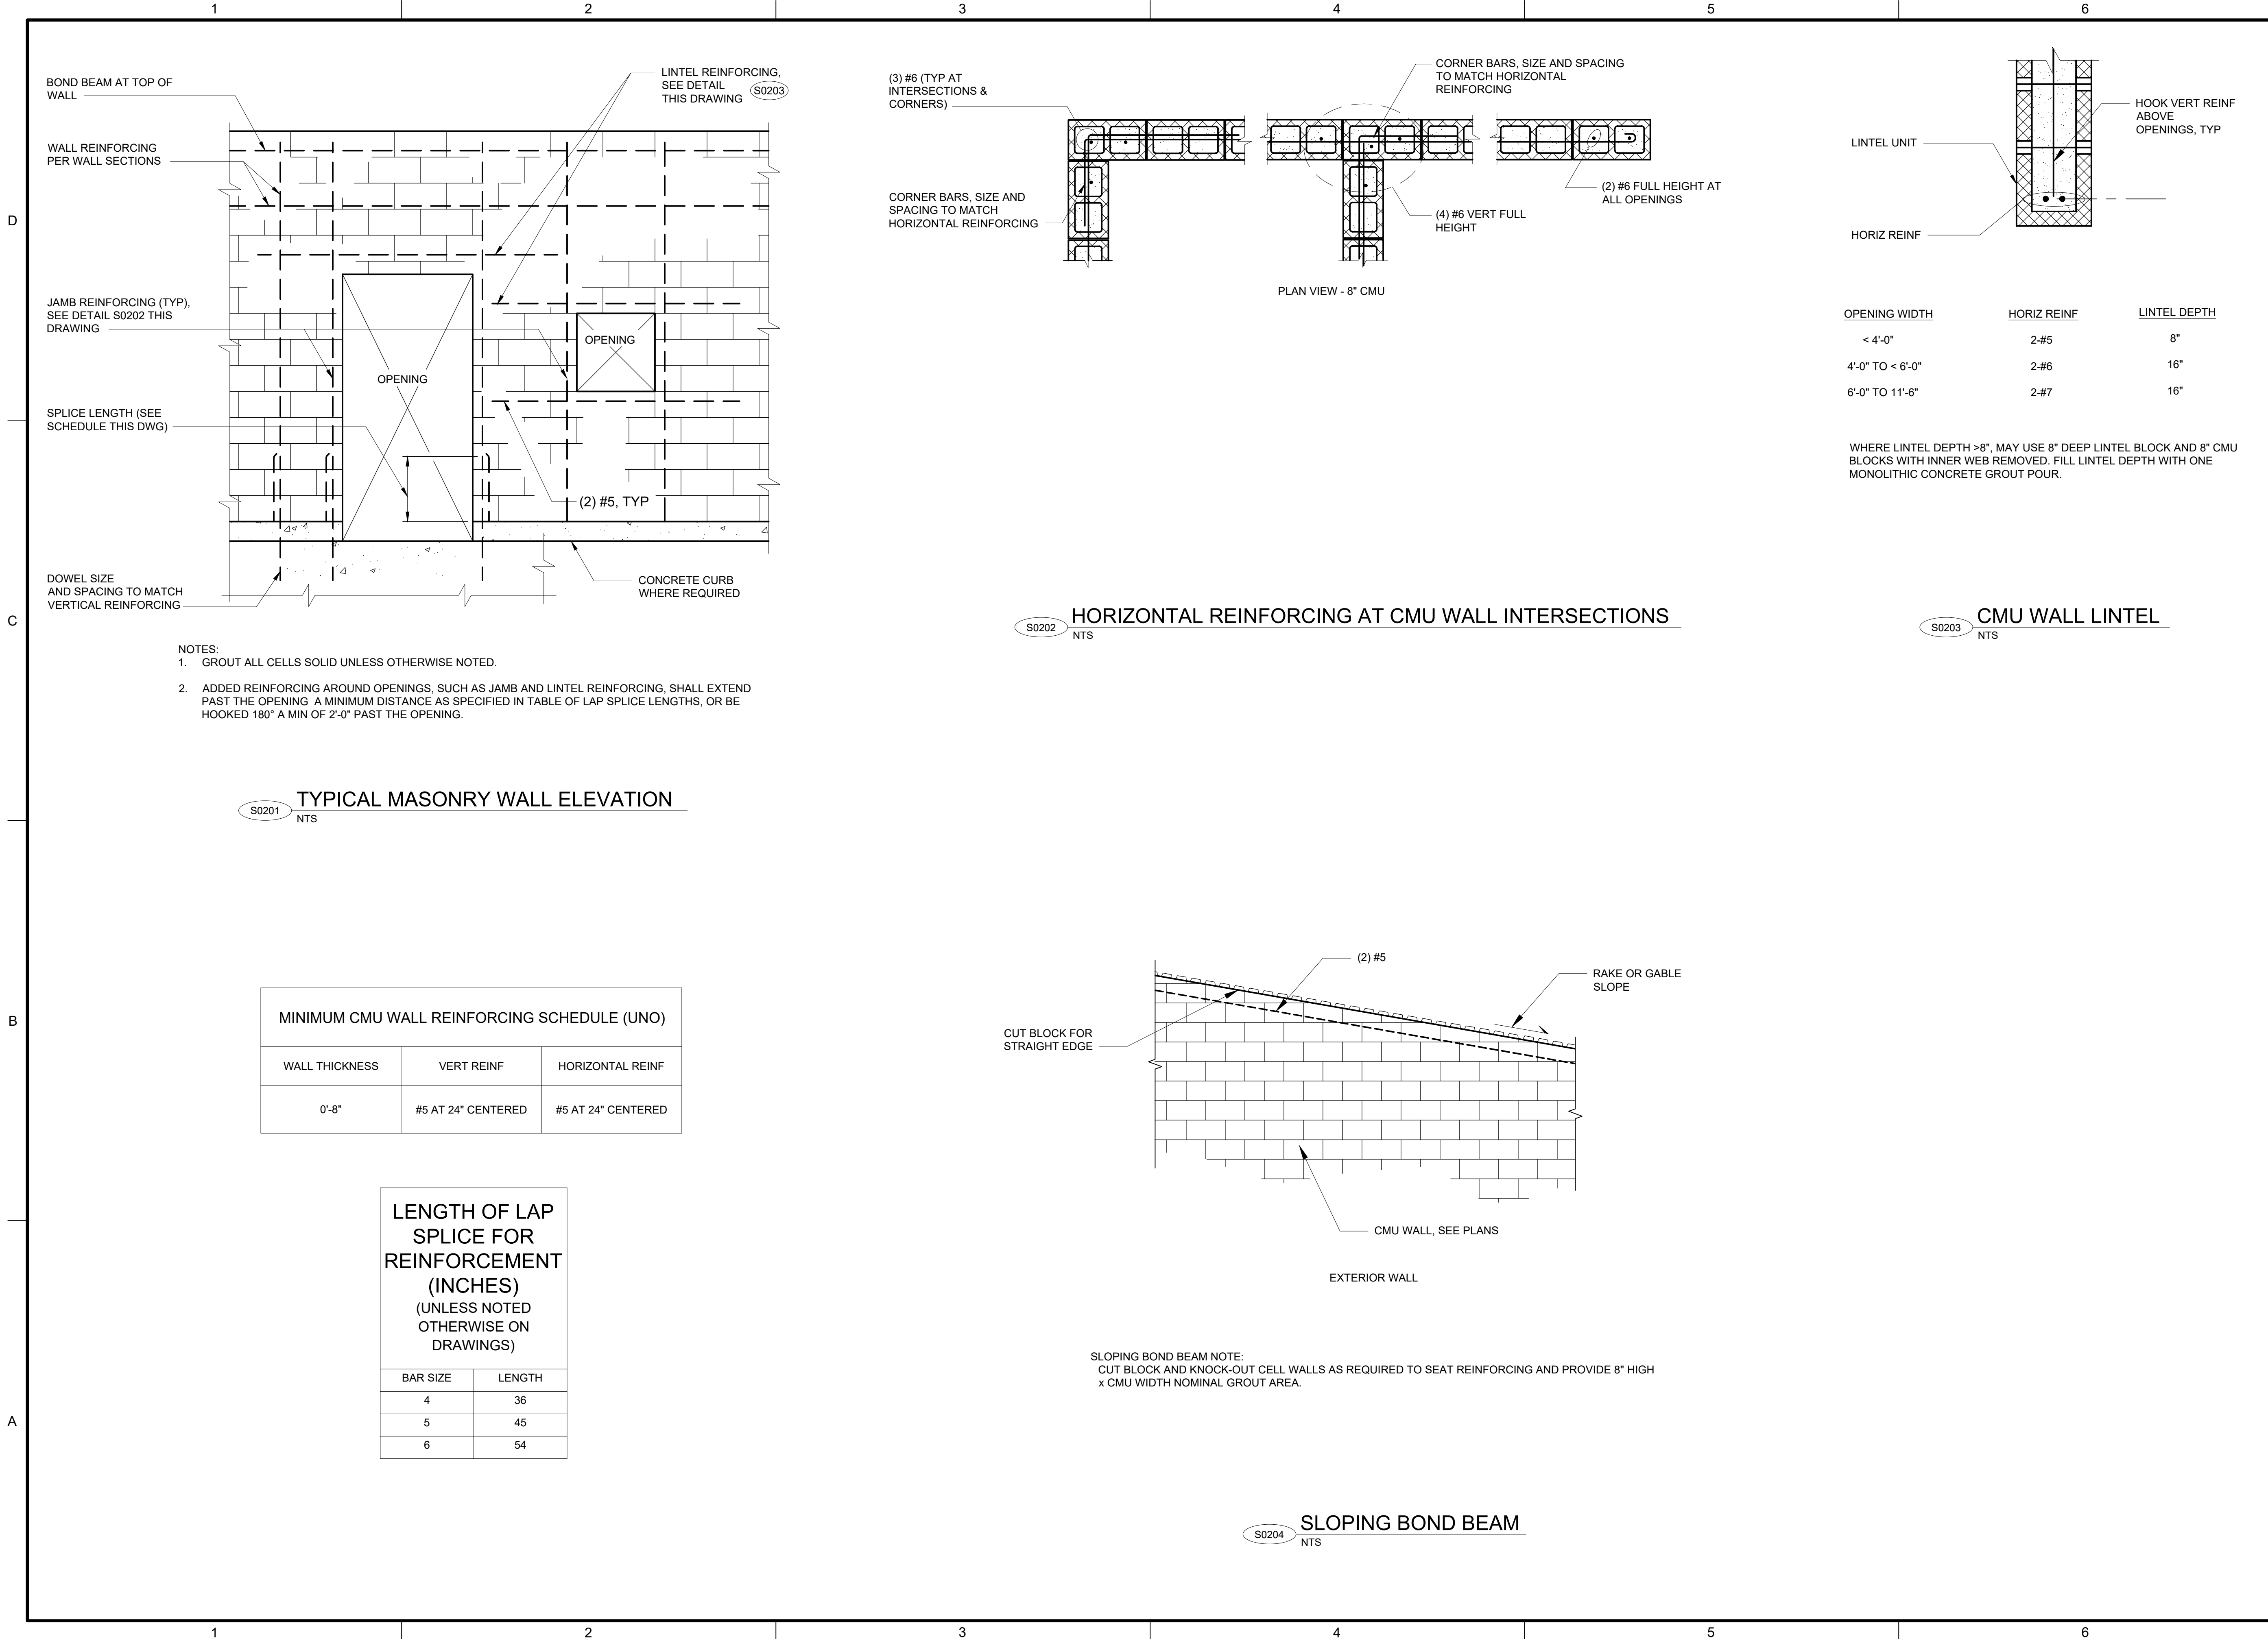

SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: S. BELLIS

DRAWN: T. BOUFFARD

CHECKED:

CHECKED:

APPROVED:

FILENAME

S-005.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER


STRUCTURAL

STANDARD DETAILS
2

DRAWING NUMBER

S-005


0 SHEET NUMBER OF 60



TYPE A


S0301 NTS

S0302 NTS



Path: C:\BCPM\02344908 FILENAME: S-100.DWG PLOT DATE: 1/11/2022 12:48 PM CAD USER: THOMAS BOUFFARD

PLAN
NORTH



1

2

28'-8"

16'-4"

CL VENT

5'-2"

1'-4"

2'-8"

MO

6'-9"

2'-6"

1'-5"

1
S-102

B

CL PIPE

2'-7 1/2"

CL FD

3'-4 1/2"

CL VENT

2'-8"

CL PIPE

8" TYP

CL FD

1'-6" TYP

CL VENT

EDGE OF FOOTING

CL PIPE

1'-6"

3'-6"

2'-8"

2'-8"

5'-4 1/2"

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL PIPE

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD

CL FD



CL FD

CL FD

CL FD

CL FD

Path: C:\BCP\W\02344908 FILENAME: S-101.DWG PLOT DATE: 1/11/2022 12:25 PM CAD USER: THOMAS BOUFFARD

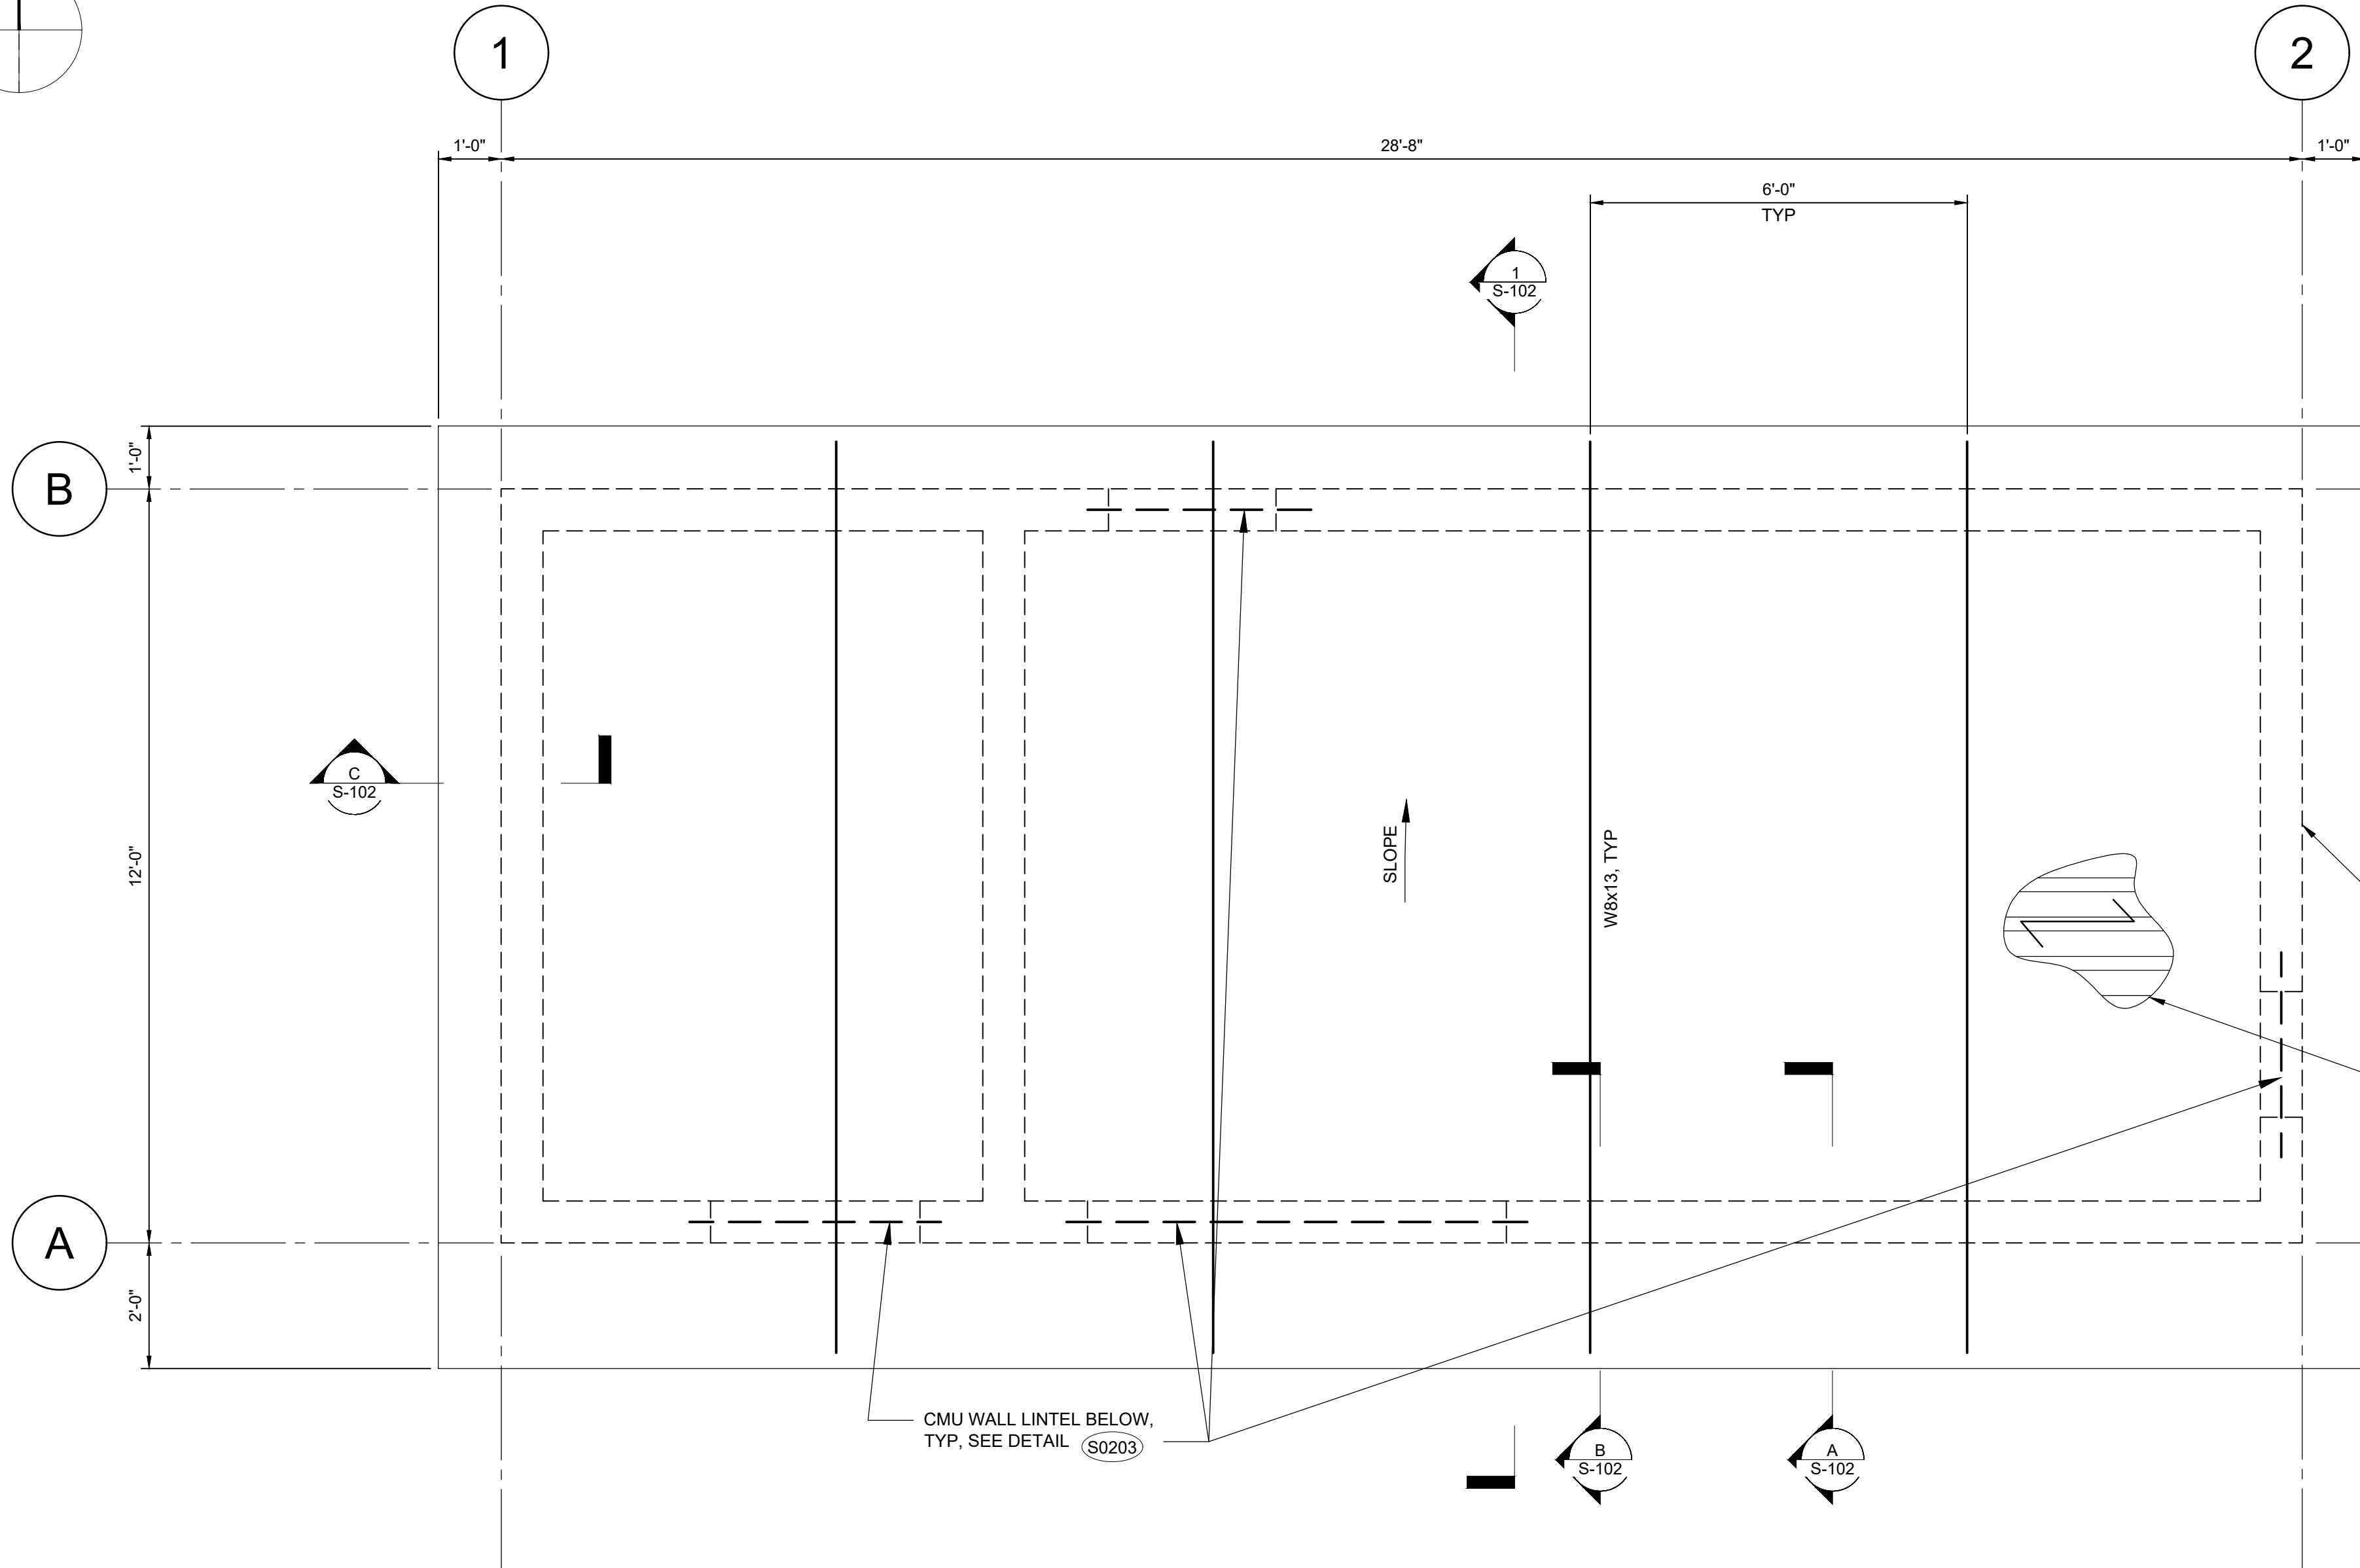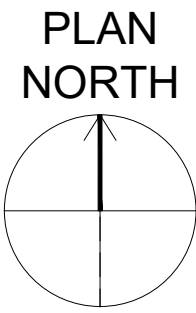

GENERAL NOTES

1. SEE CIVIL FOR BUILDING COORDINATES.
2. SEE ARCHITECTURAL, ELECTRICAL, AND MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION.
3. COORDINATE ALL OPENINGS WITH ARCHITECTURAL, ELECTRICAL, AND MECHANICAL DRAWINGS.
4. COORDINATE SIZE AND LOCATION OF ELEC/MECH PADS WITH APPROVED EQUIPMENT SUBMITTALS AND ELECTRICAL AND MECHANICAL DRAWINGS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: S. BELLIS

DRAWN: T. BOUFFARD

CHECKED:

APPROVED:

FILENAME

S-101.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

STRUCTURAL

DILKON PASS PUMP STATION BUILDING ROOF FRAMING PLANS

DRAWING NUMBER

S-101

SHEET NUMBER OF


0

60


Path: C:\USERS\KWOESSNER\DDTG CLOUD SYNC FOLDER\BUSINESS DEVELOPMENT\DLKON2-DD (CURRENT)\DRAWINGS\DLKON PASS PUMP STATION_A_BASE.DWG PLOT DATE: 1/10/2022 3:34 PM CAD USER: KATIE WOESSNER

BUILDING CODE ANALYSIS


AHJ	NAVAJO NATION (STRUCTURAL DESIGN CRITERIA: COCONINO COUNTY)	
BUILDING CODES	2015 INTERNATIONAL BUILDING CODE 2015 INTERNATIONAL MECHANICAL CODE 2015 INTERNATIONAL FUEL GAS CODE 2015 INTERNATIONAL PLUMBING CODE 2015 INTERNATIONAL ENERGY CONSERVATION CODE 2015 INTERNATIONAL EXISTING BUILDING CODE 2011 NATIONAL ELECTRICAL CODE 2012 INTERNATIONAL FIRE CODE	FIRE EXTINGUISHERS IBC 906.3.1: FIRE EXTINGUISHERS PROVIDED PER IBC TABLE 906.3(1), MIN. KEY BOXES IFC 506.1: KEY BOXES PER UL 1037 IS WILL BE PROVIDED IN LOCATIONS APPROVED BY THE FIRE CODE OFFICIAL ACCESSIBILITY OCCUPANCY GROUP F-2: EXEMPT FROM ACCESSIBILITY REQUIREMENTS PER IBC 1103.2.9 EGRESS DISTANCE TO EXITS: (TABLE 1014.3) F-2 75 FT MAXIMUM, WITHOUT SPRINKLER SYSTEM OCCUPANCY LOADS: (TABLE 1004.1.2) F-2 OCCUPANCY 220 SF / 300 (MECHANICAL EQUIPMENT ROOM) = 1 REQUIRED EXITS = 1 ACUAL EXITS = 1
OCCUPANCY	F-2 LOW HAZARD	
CONSTRUCTION TYPE	TYPE II-B	
ALLOWABLE AREAS	23,000 SF / 3 STORIES / 55 FT	
ACTUAL AREAS	220 SF / 1 STORY / 11'-6" FT	
EXITS		

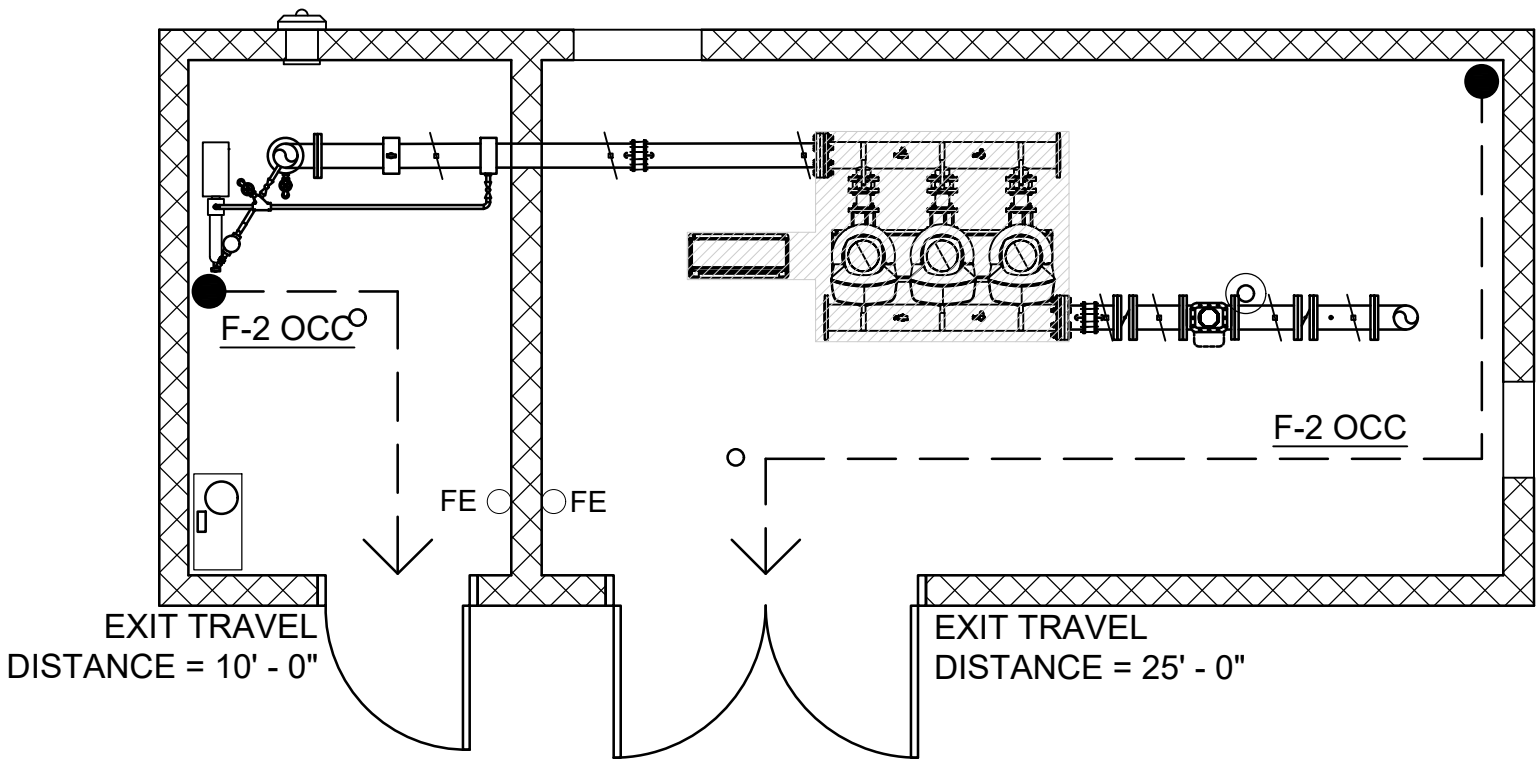

1 CODE PLAN
A102 SCALE: 1/4" = 1'-0"

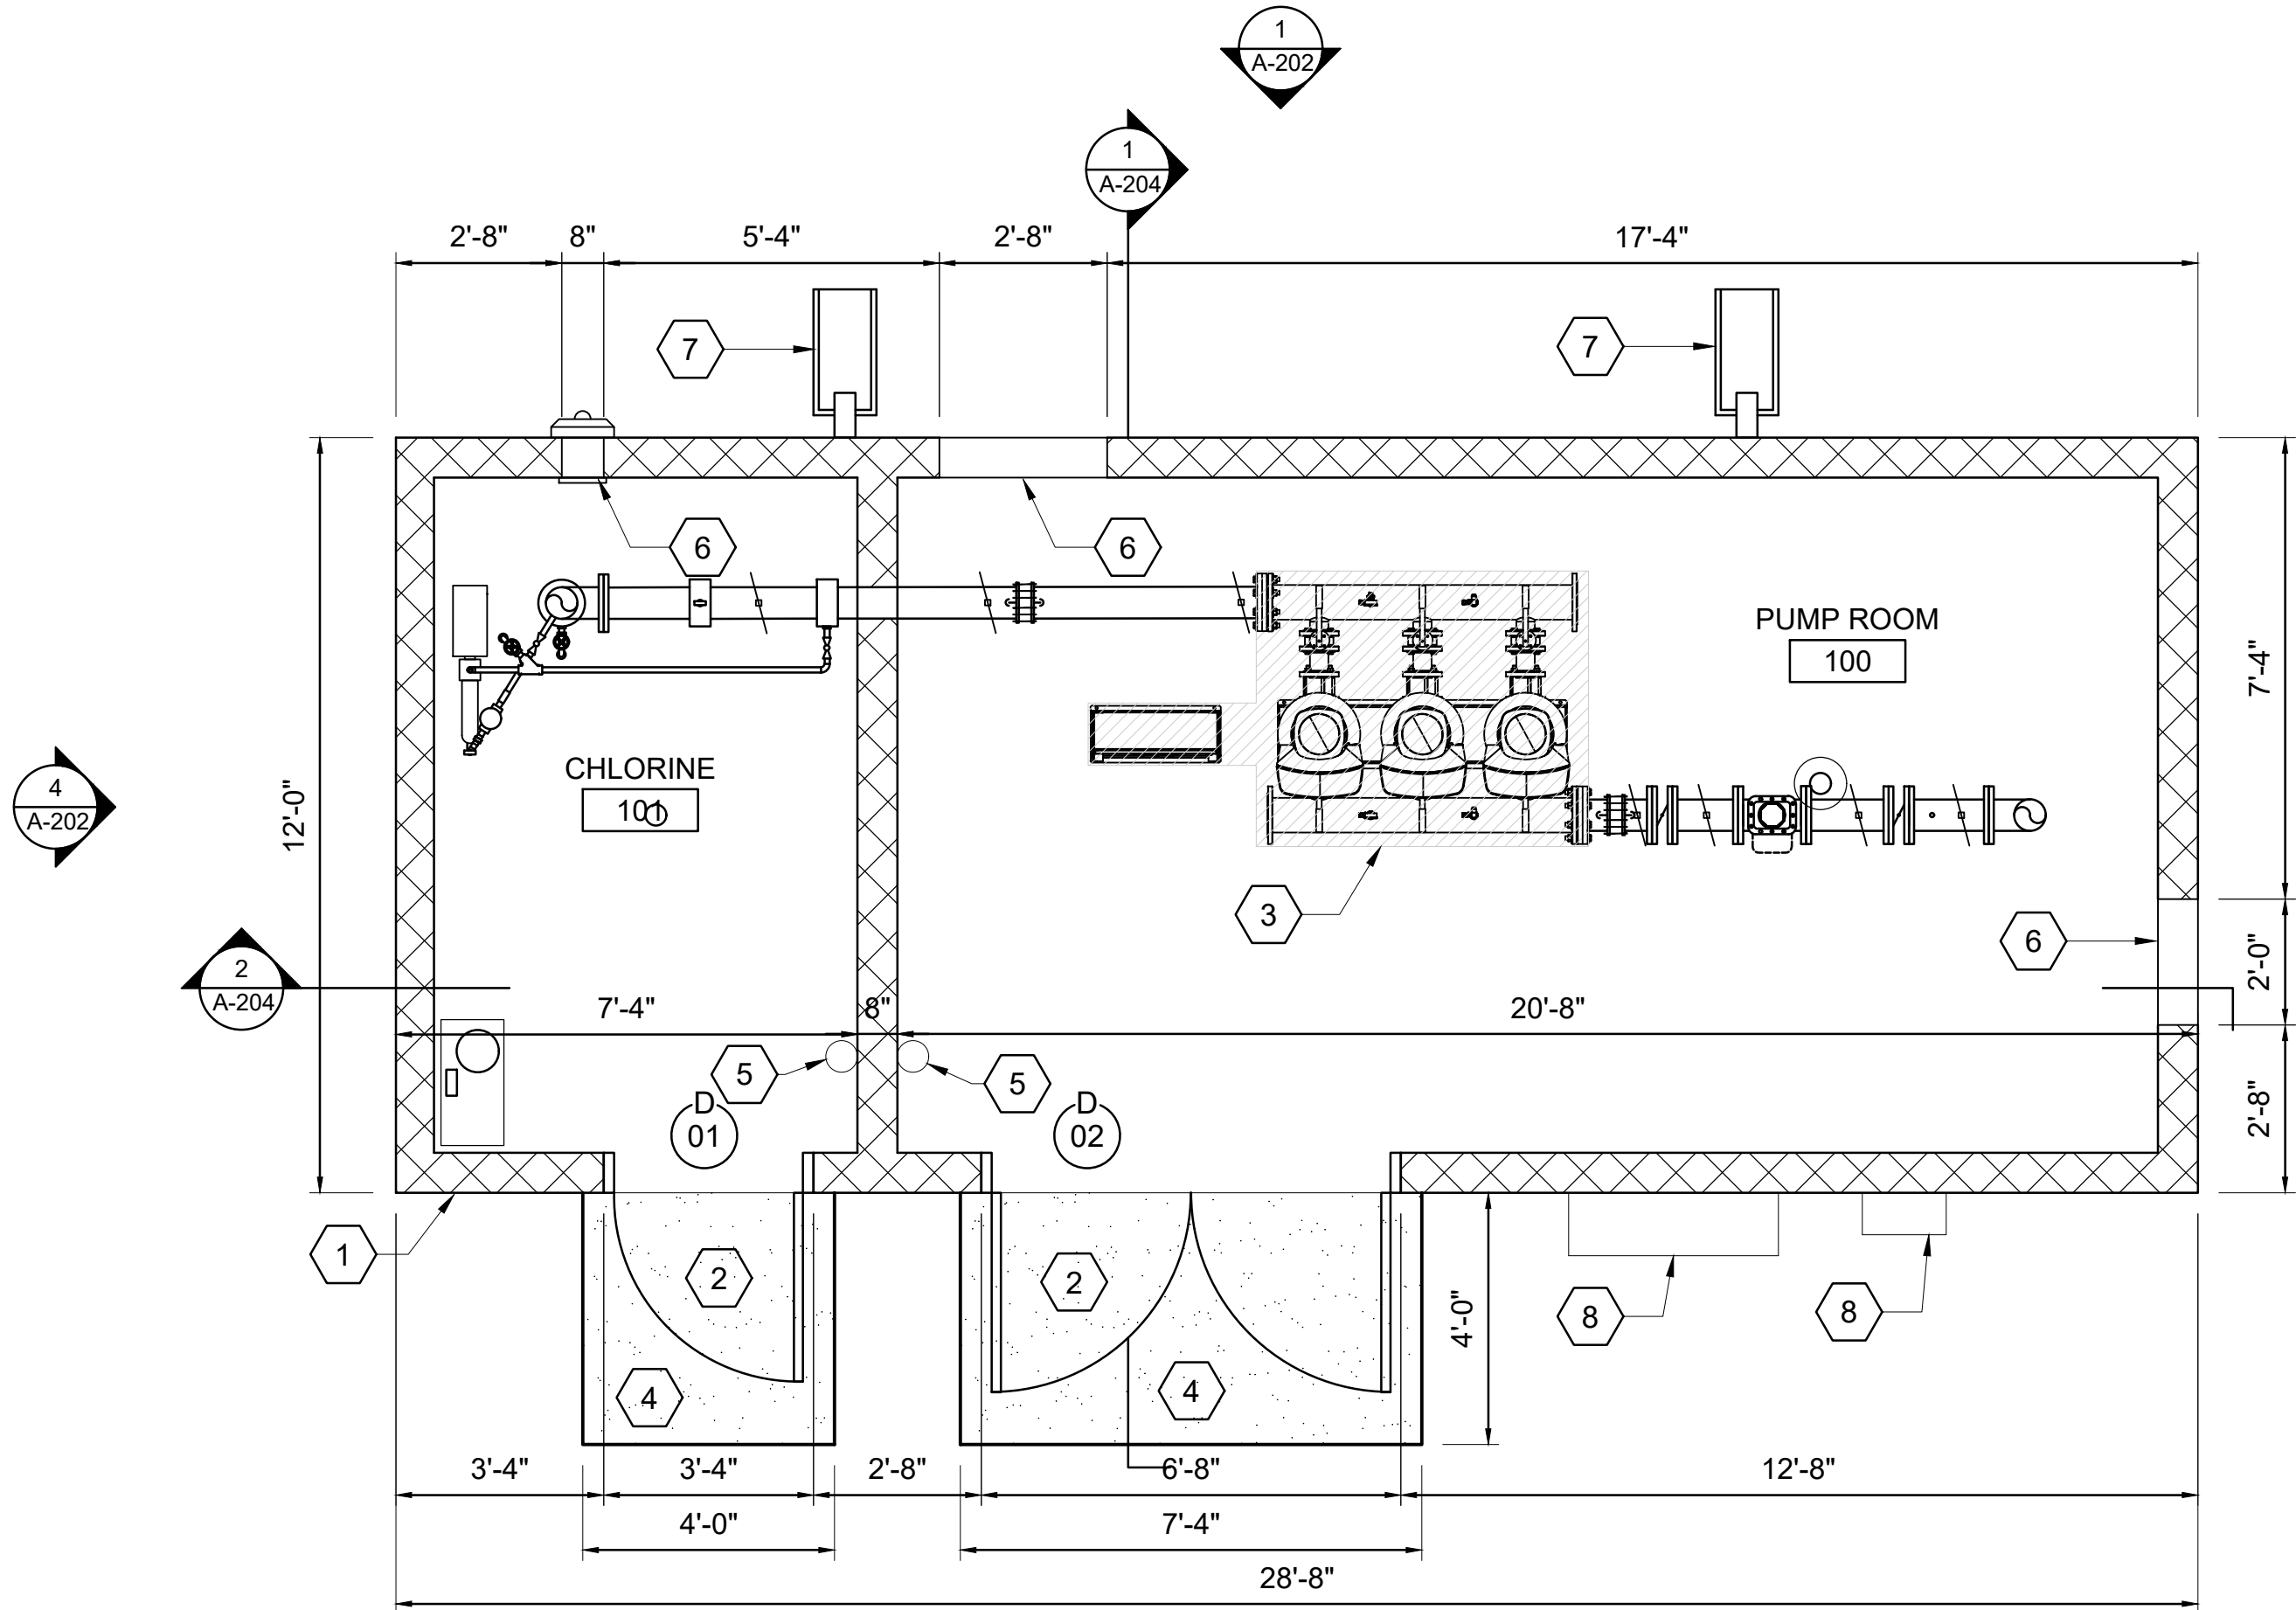

Path: C:\USERS\KWOESSNER\DDTG CLOUD SYNC FOLDER\BUSINESS DEVELOPMENT\DILKON\2-DD (CURRENT)\DRAWINGS\DILKON PASS PUMP STATION_2022.1.6 FILENAME: DILKON PUMP STATION_A_BASE.DWG PLOT DATE: 1/10/2022 3:34 PM CAD USER: KATIE WOESSNER

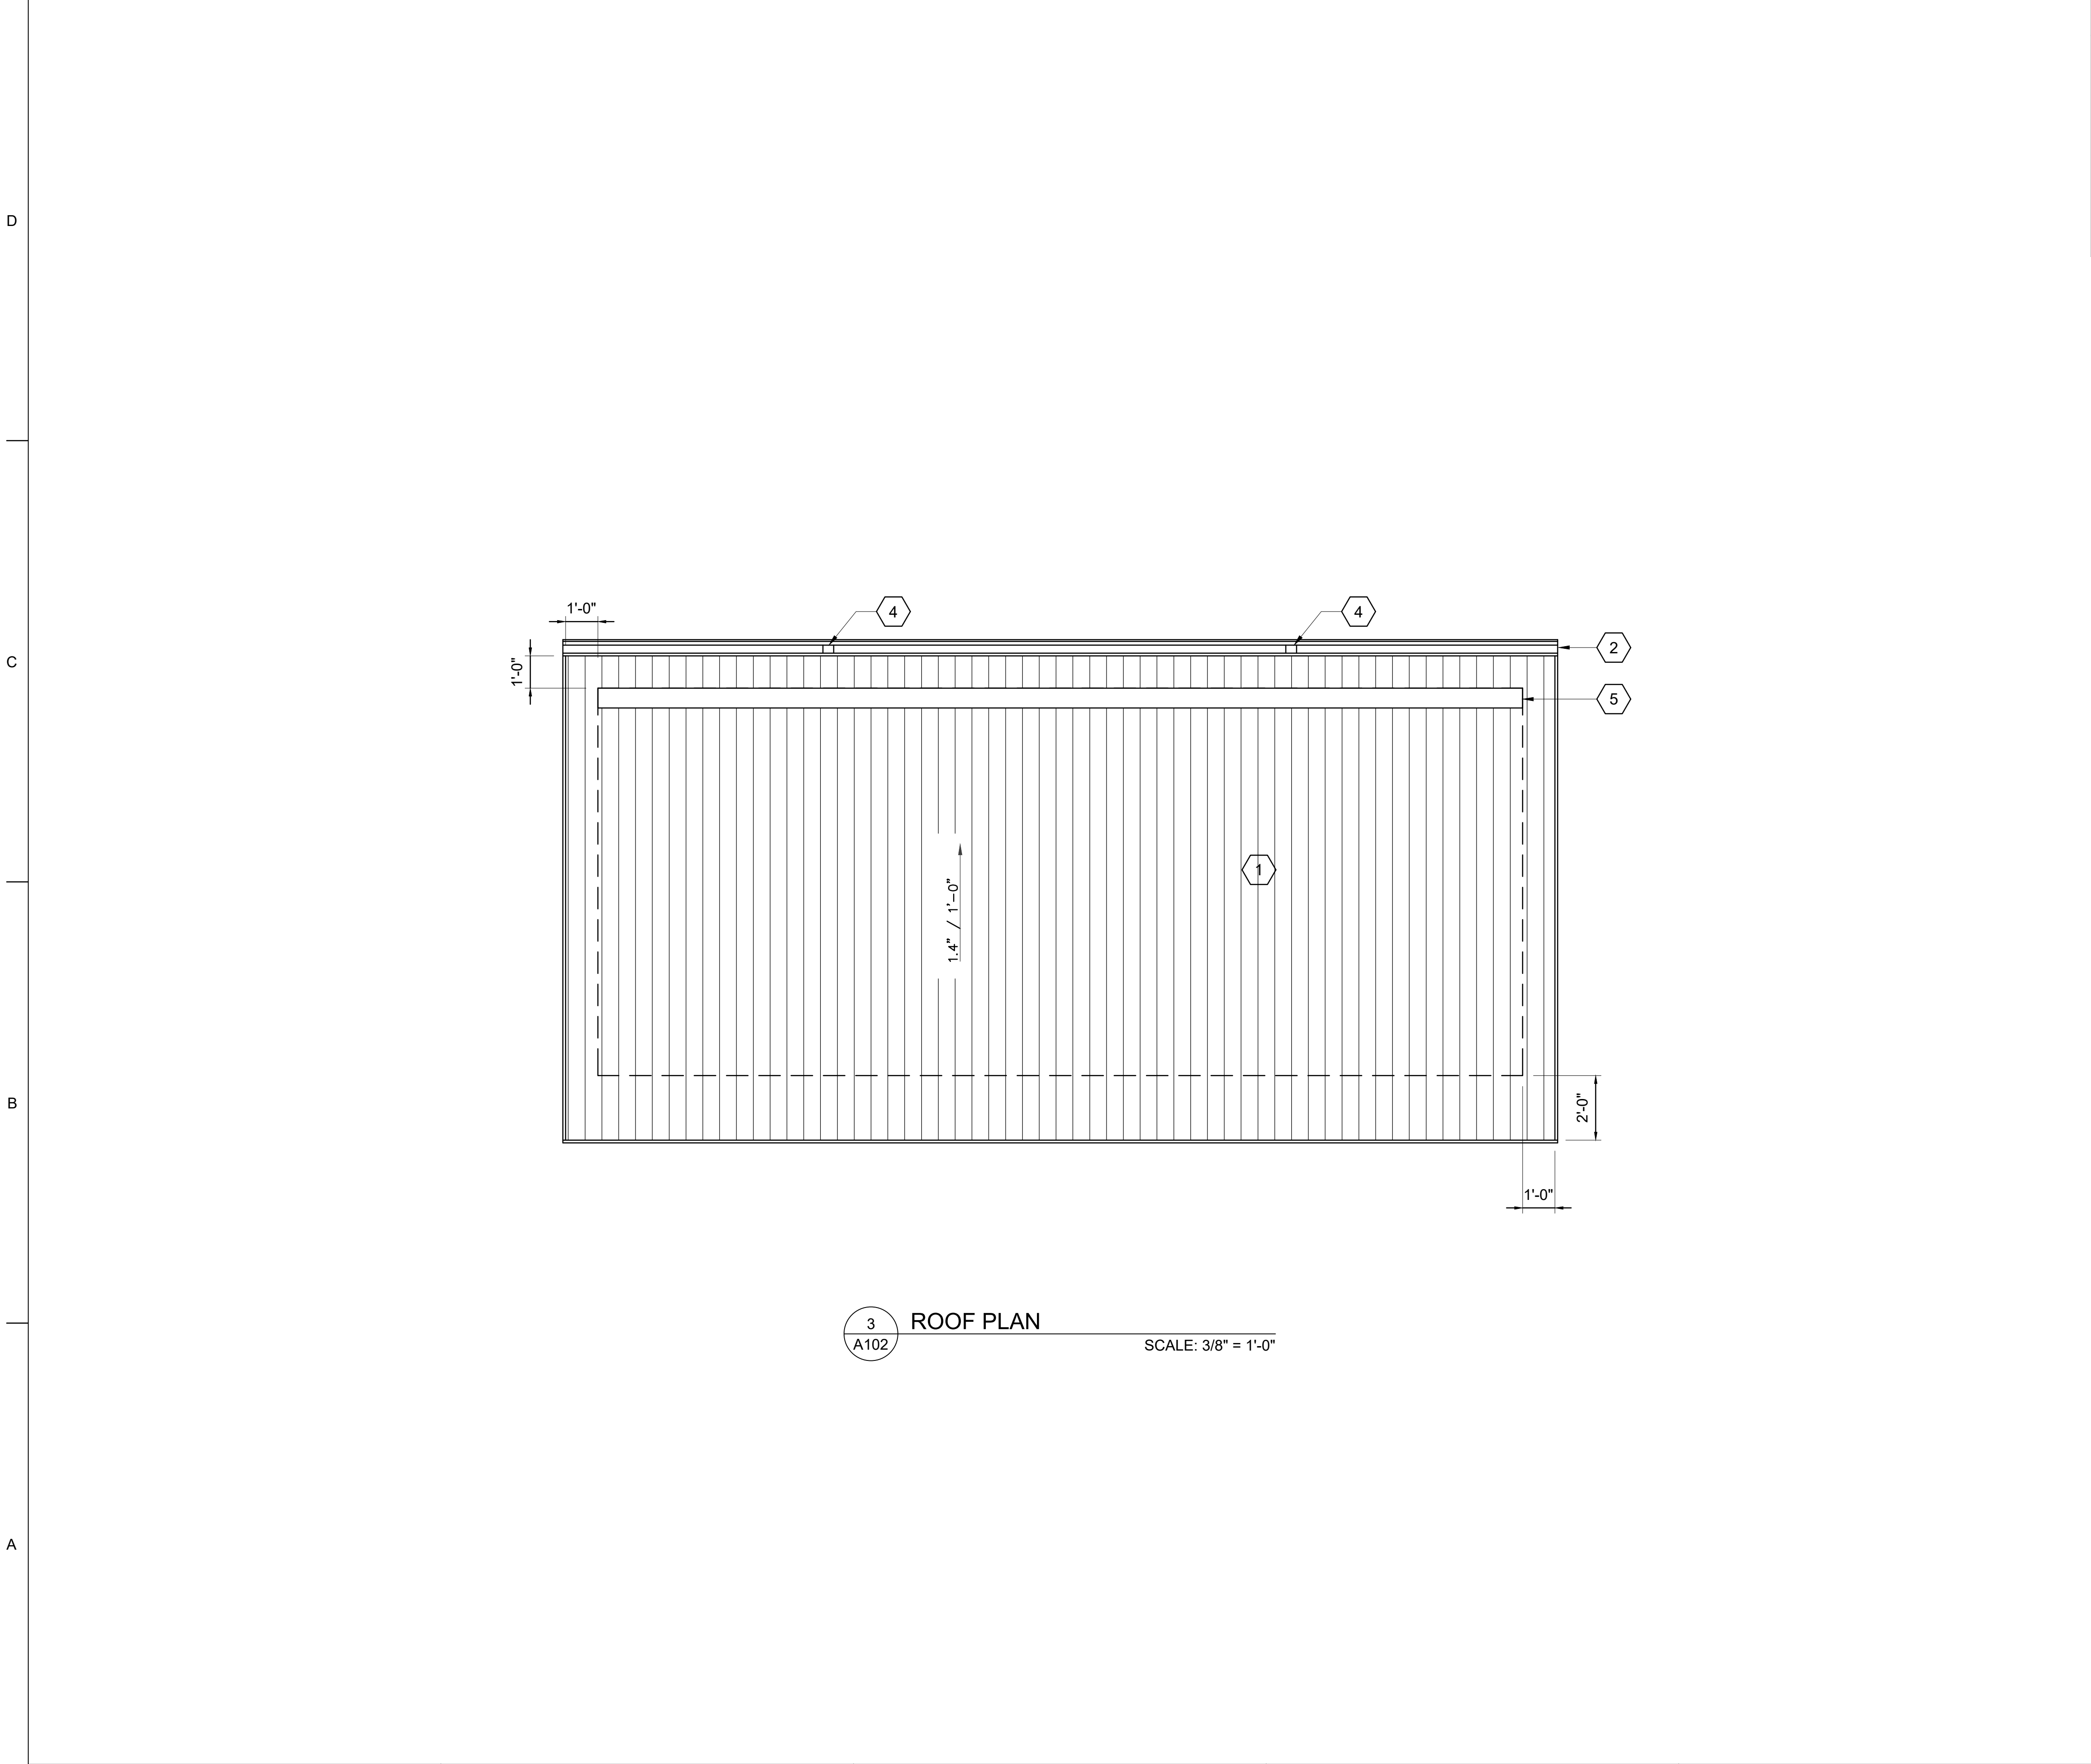

- KEY NOTES**
- 1 STANDING SEAM METAL ROOF PANEL
 - 2 GUTTER - PRE-FINISHED SHEET METAL
 - 3 FASCIA - PRE-FINISHED SHEET METAL
 - 4 DOWNSPOUT - PRE-FINISHED SHEET METAL
 - 5 SNOWGUARD



SALT LAKE CITY, UT



90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: K. WOESSNER

DRAWN: K. WOESSNER

CHECKED: G. SHORT

CHECKED: ---

APPROVED: G. SHORT

FILENAME

DILKON PUMP STATION_A_BASE

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

ARCH

ROOF PLAN

DRAWING NUMBER

A-102

SHEET NUMBER OF

113

- 1 8" CMU WALL, SMOOTH FACE, WATER REPELLENT FULL EXTENT, COLOR A
- 2 HM DOOR AND FRAME, PAINT, RE: DOOR SCHEDULE
- 3 STANDING SEAM METAL ROOF OVER METAL DECK
- 4 GUTTER - PRE-FINISHED SHEET METAL
- 5 FASCIA - PRE-FINISHED SHEET METAL
- 6 DOWNSPOUT - PRE-FINISHED SHEET METAL
- 7 CONCRETE CURB, RE: STRUCT
- 8 INLINE EXHAUST FAN, MOTORIZED DAMPER, AND LOUVER, RE: MECH
- 9 CONCRETE SPLASHBLOCK
- 10 8" CMU WALL, SPLIT FACE, WATER REPELLENT FULL EXTENT, COLOR B
- 11 SNOWGUARD
- 12 EXTERIOR LIGHTING, RE: ELEC
- 13 ELECTRICAL EQUIPMENT, RE: ELEC



THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

[illegible]

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: K. WOESSNER

DRAWN: K. WOESSNER

CHECKED: G. SHORT

CHECKED: ---

APPROVED: G. SHORT

FILENAME

DILKON PUMP STATION_A_BASE
BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

ARCH


BUILDING ELEVATIONS

DRAWING NUMBER

A-201

SHEET NUMBER 113
OF

Path: C:\USERS\KWOESSNER\DDTG CLOUD SYNC FOLDER\BUSINESS DEVELOPMENT\DLKON2-DD (CURRENT)\DRAWINGS\DLKON PASS PUMP STATION_2022.1.6 FILENAME: DLKON PUMP STATION_A_BASE.DWG PLOT DATE: 1/10/2022 3:35 PM CAD USER: KATIE WOESSNER

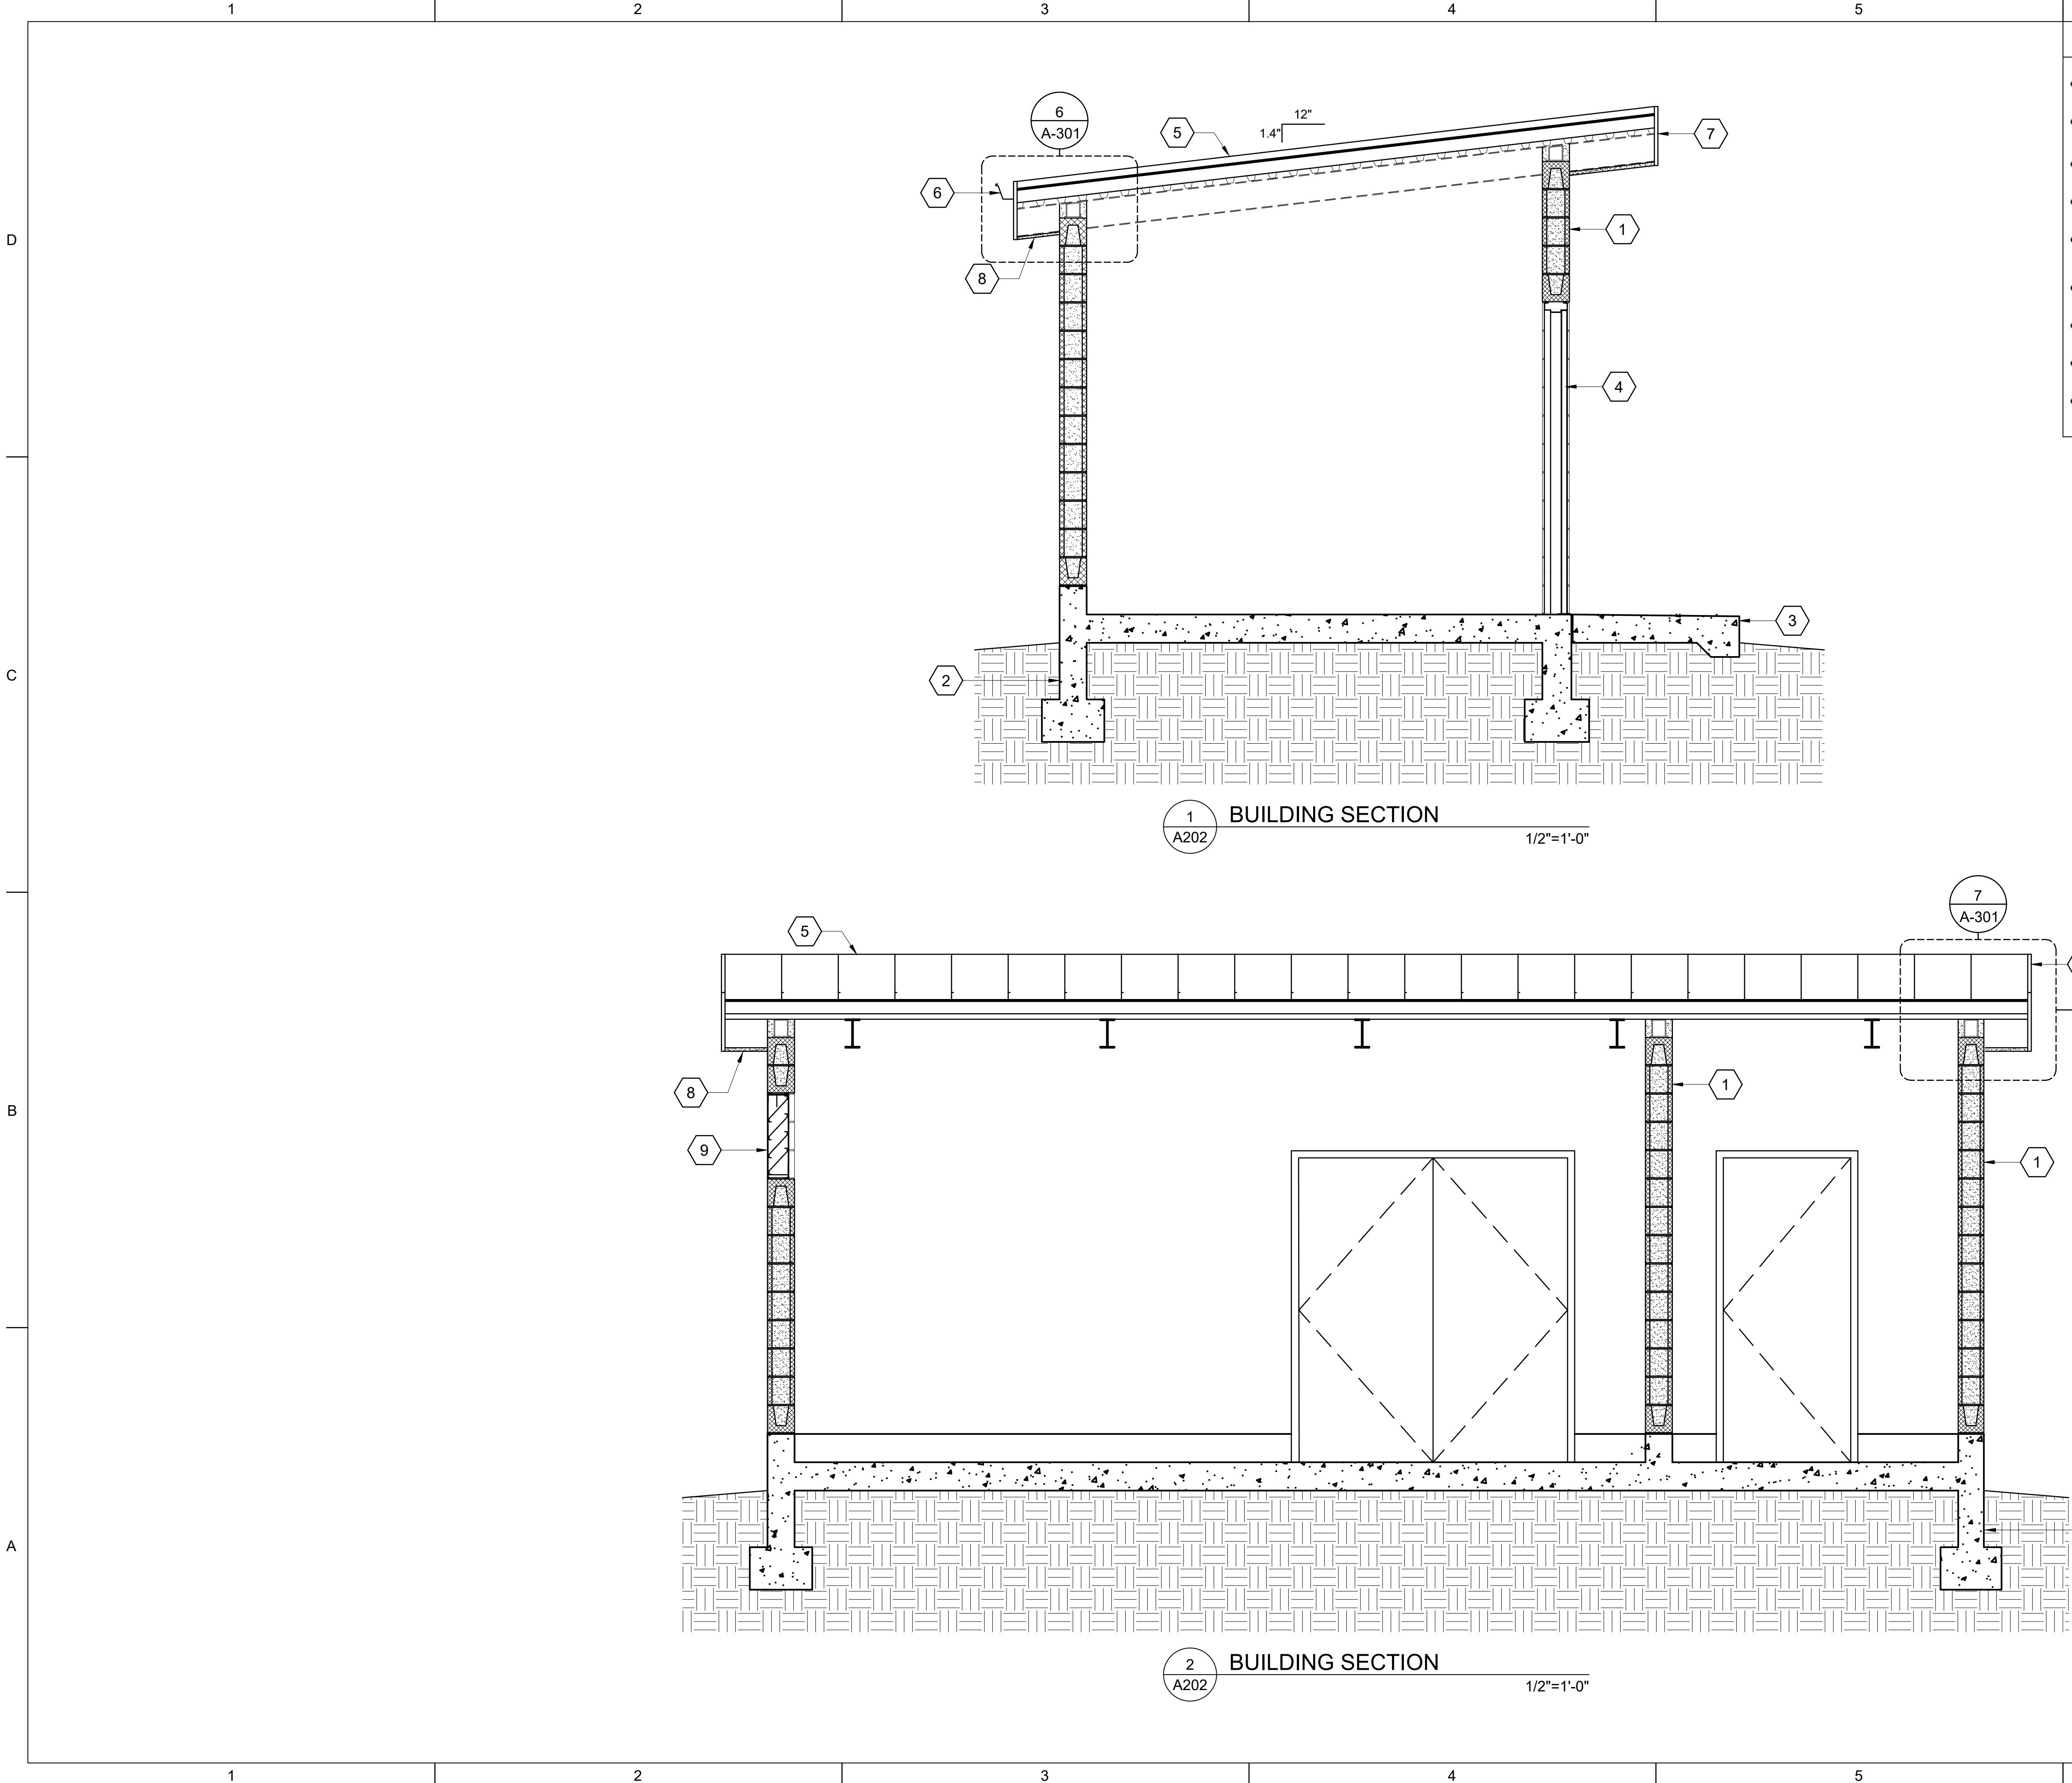

- KEY NOTES
- 1 8" CMU WALL, WATER REPELLENT FULL EXTENT
 - 2 CONCRETE FOUNDATION, RE: STRUCT
 - 3 CONCRETE PAD, RE: CIVIL
 - 4 HM DOOR AND FRAME, PAINT, RE: DOOR SCHEDULE
 - 5 STANDING SEAM METAL ROOF ON 2 LAYERS 30# BUILDING FELT OVER SELF-ADHERING UNDERLAYMENT, 4" NAILBASE INSULATION, AND METAL FRAMING
 - 6 GUTTER - PRE-FINISHED SHEET METAL
 - 7 FASCIA - PRE-FINISHED SHEET METAL
 - 8 SOFFIT - PRE-FINISHED SHEET METAL
 - 9 INLINE EXHAUST FAN, MOTORIZED DAMPER, AND LOUVER, RE: MECH



SALT LAKE CITY, UT



90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: K. WOESSNER

DRAWN: K. WOESSNER

CHECKED: G. SHORT

CHECKED: ---

APPROVED: G. SHORT

FILENAME

DILKON PUMP STATION_A_BASE
BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

ARCH

BUILDING SECTIONS

DRAWING NUMBER

A-202


SHEET NUMBER

OF


113

Path: C:\USERS\KWOESSNER\DDTG_CLOUD_SYNC_FOLDER\BUSINESS_DEVELOPMENT\DLKON2-DD (CURRENT)\DRAWINGS\DLKON PASS PUMP STATION_2022.1.6 FILENAME: DLKON PUMP STATION_A_BASE.DWG PLOT DATE: 1/10/2022 3:35 PM CAD USER: KATIE WOESSNER


1					2					3					4										
DOOR SCHEDULE					<div><div>D</div><div>13</div><div>DOOR DESIGNATION</div><div>DOOR NUMBER</div></div>					DOOR SCHEDULE NOTES:															
DOORS										GEN.	FRAMES														
DOOR NO.	TYPE	DIMENSIONS			MATERIAL	FINISH	HDWRE	TYPE	DETAILS			MATERIAL	FINISH	REMARKS / RATING											
		W	H	TH					SILL	HEAD									JAMB						
1	A	3'-0"	7'-2"	1-3/4"	HM	PAINT	1	1	3/A301	1/A301		2/A301	HM	PAINT	---										
2	B	6'-4"	7'-2"	1-3/4"	HM	PAINT	1	2	3/A301	1/A301		2/A301	HM	PAINT	---										

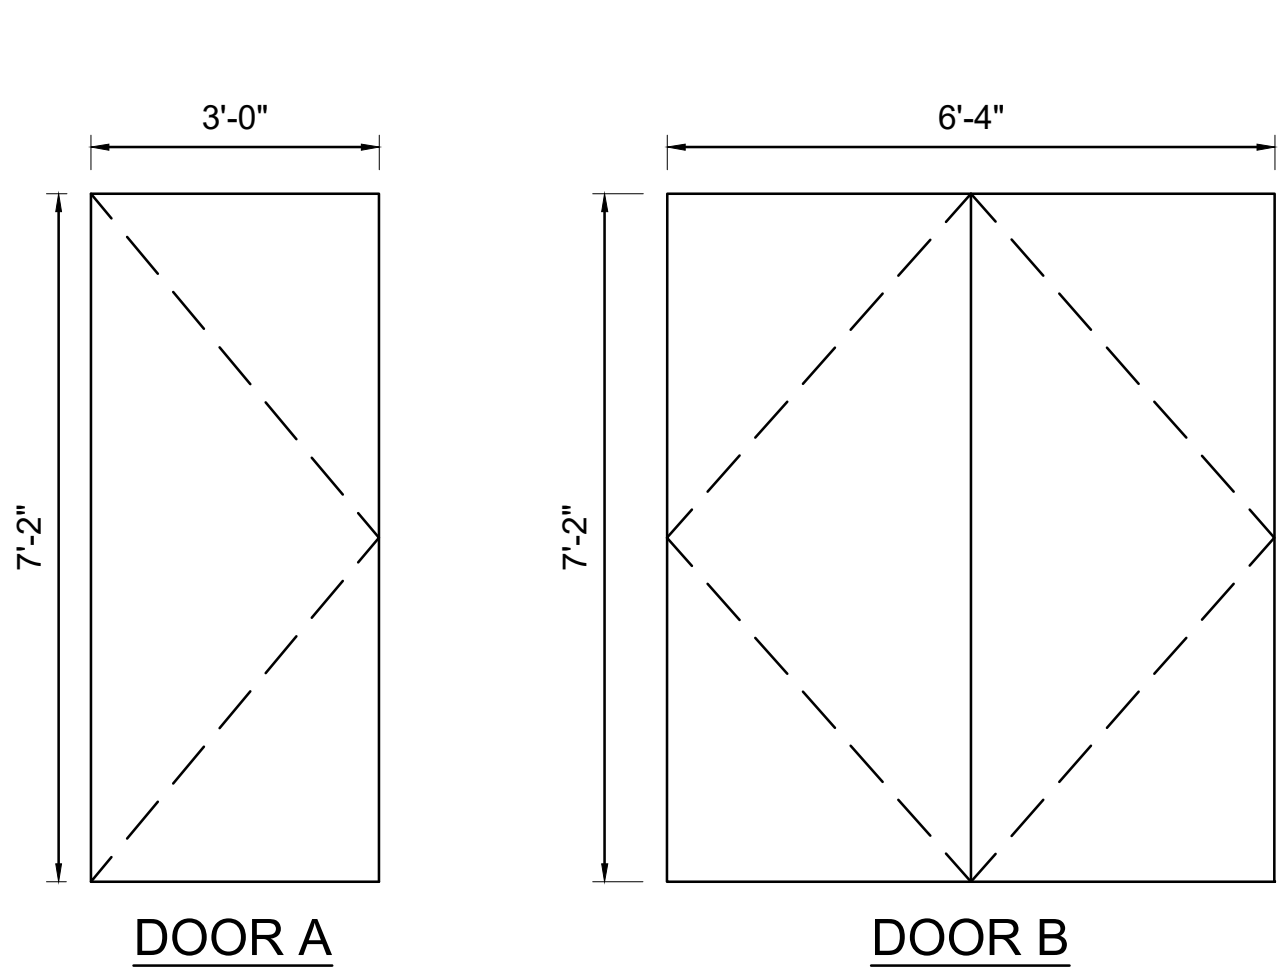

DOOR ELEVATIONS
1/2"=1'-0"

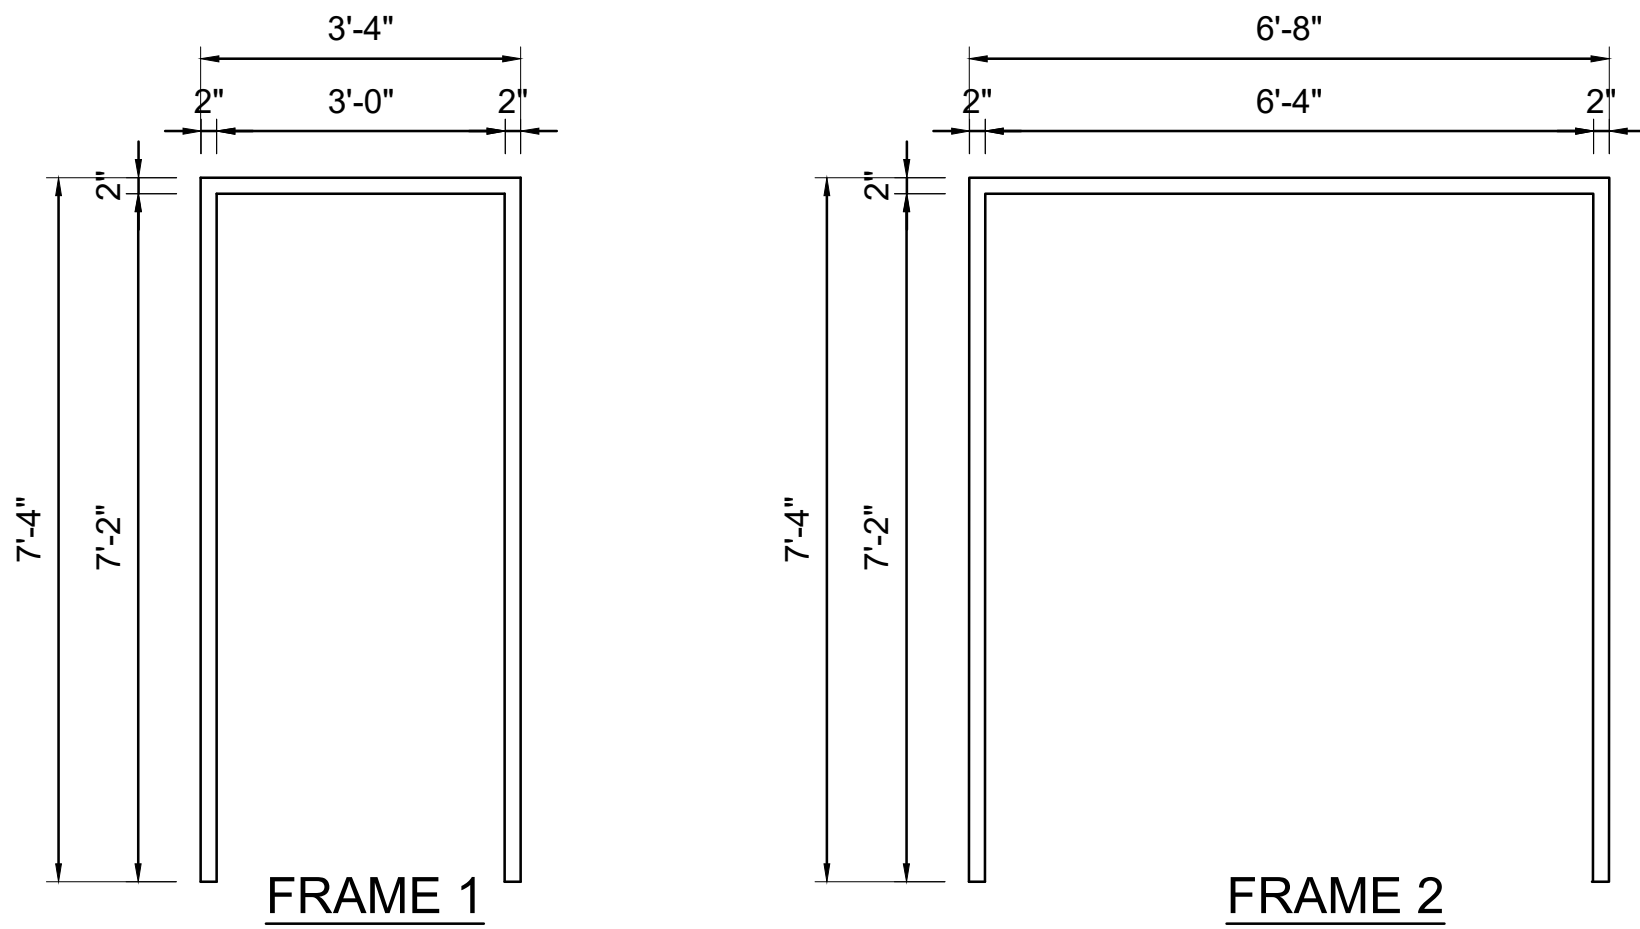


FRAME ELEVATION
1/2"=1'-0"

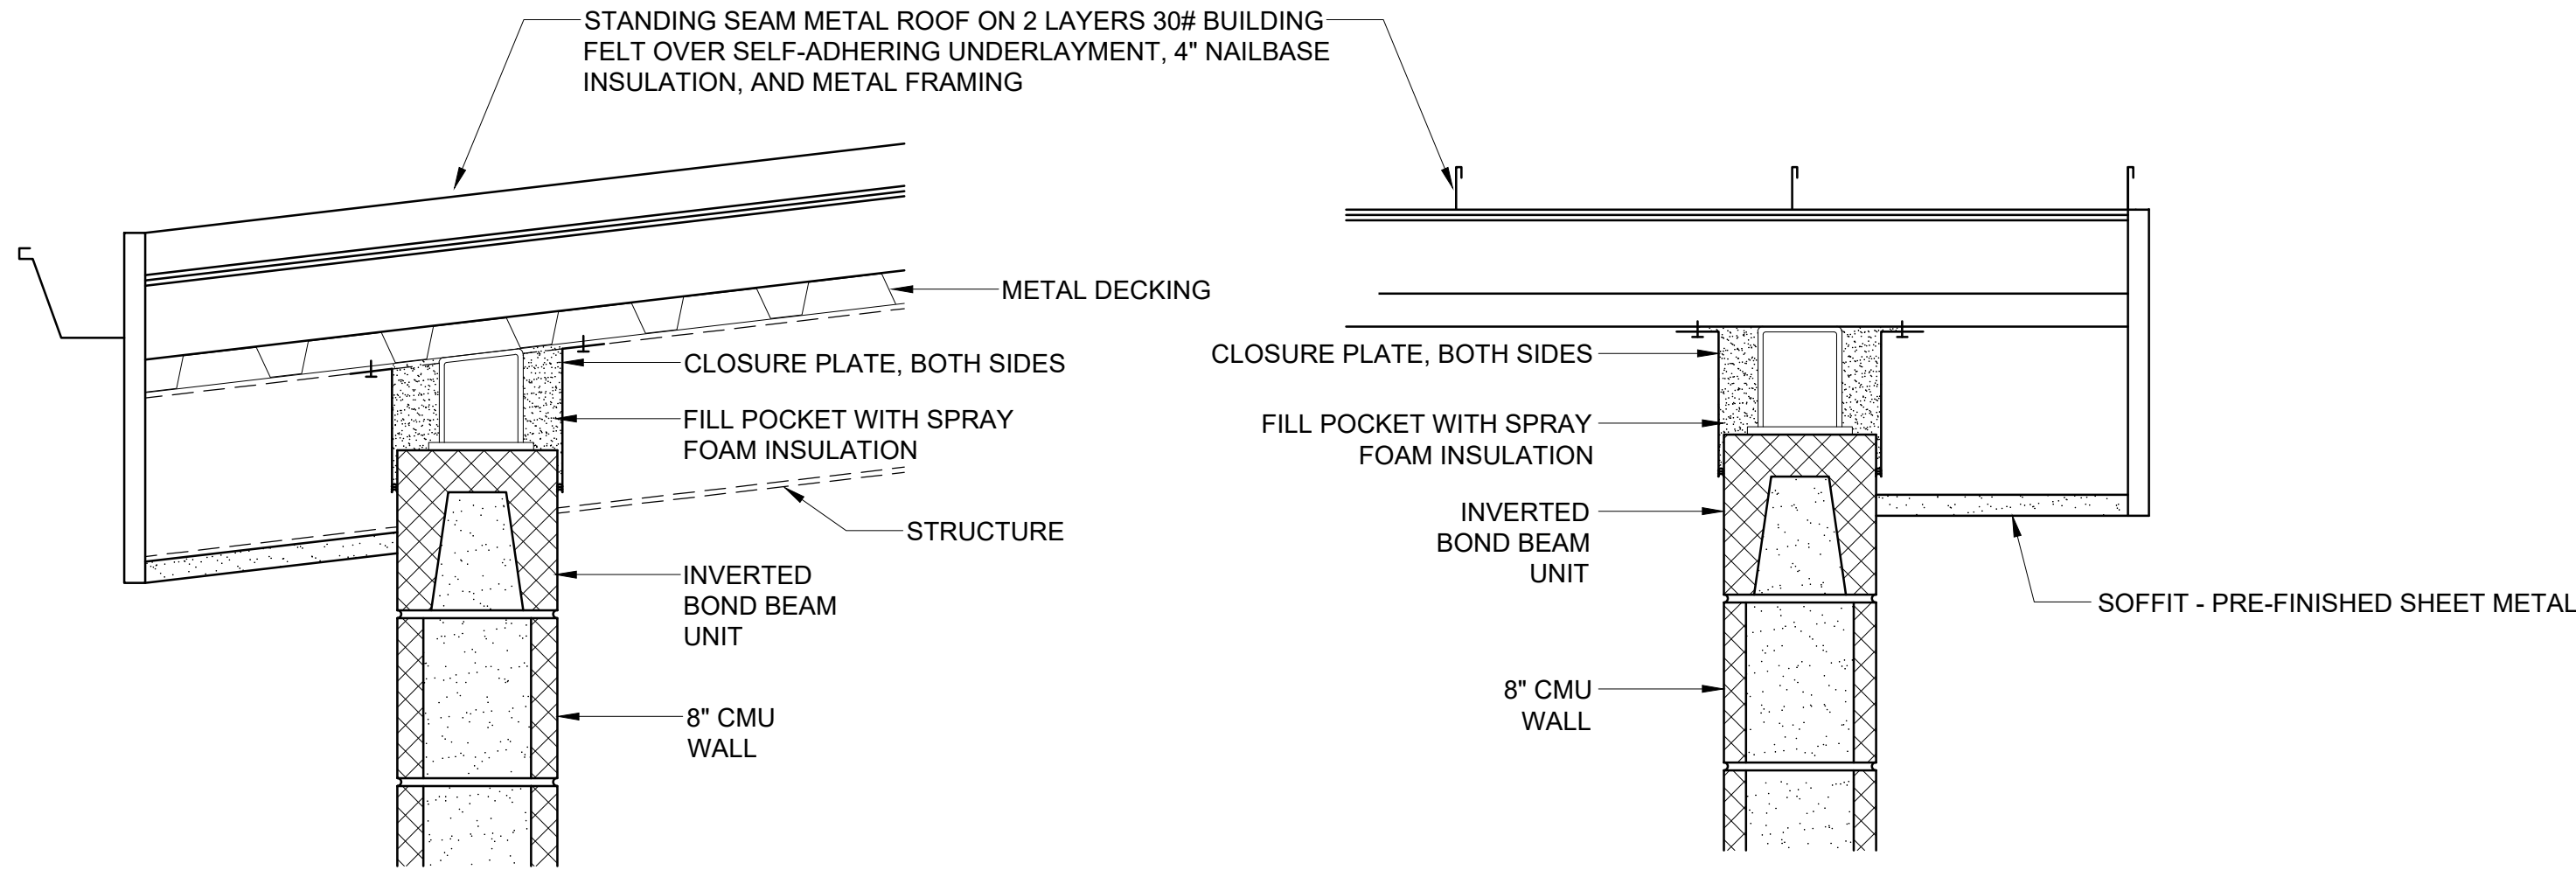


WALL DETAIL AT EAVE
1-1/2"=1'-0"


WALL DETAIL AT RAKE
1-1/2"=1'-0"

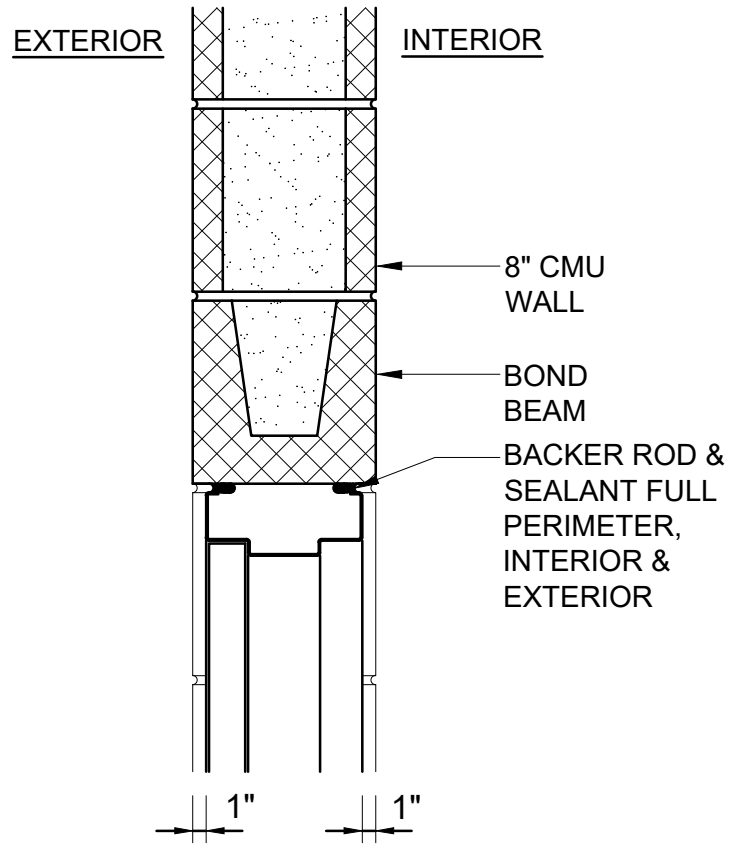


DOOR HEAD DETAIL
1-1/2"=1'-0"

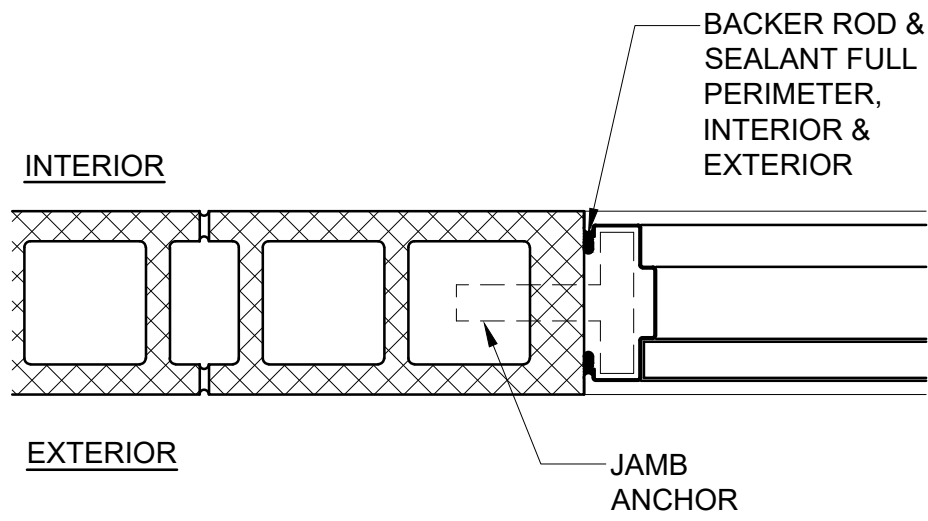


DOOR JAMB DETAIL
1-1/2"=1'-0"

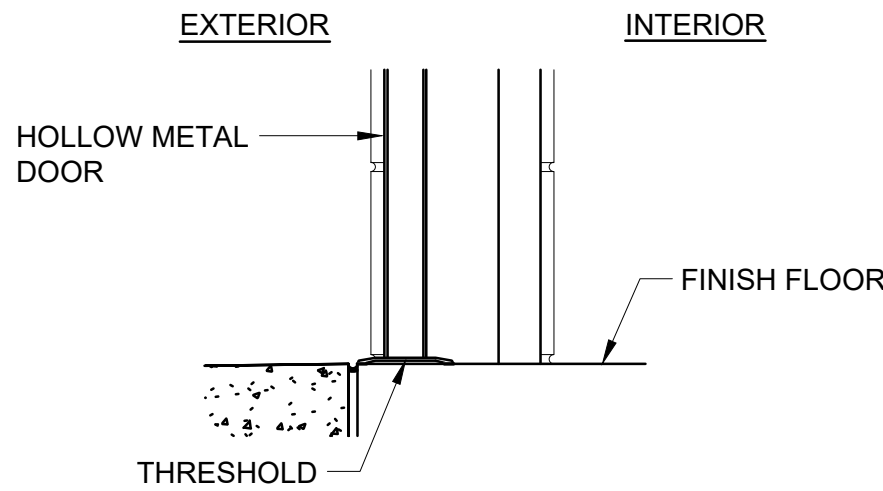

DOOR SILL DETAIL
1-1/2"=1'-0"

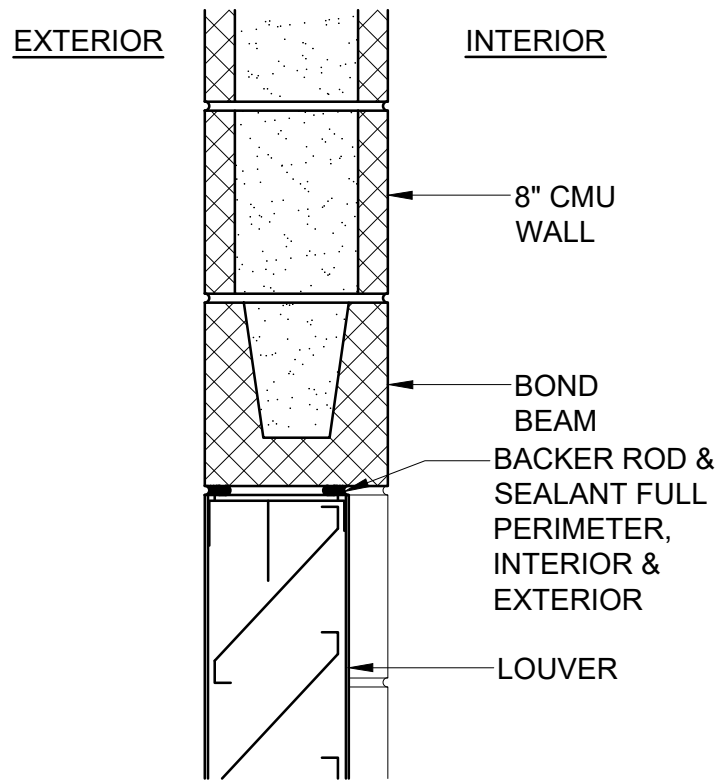

LOUVER HEAD DETAIL
1-1/2"=1'-0"

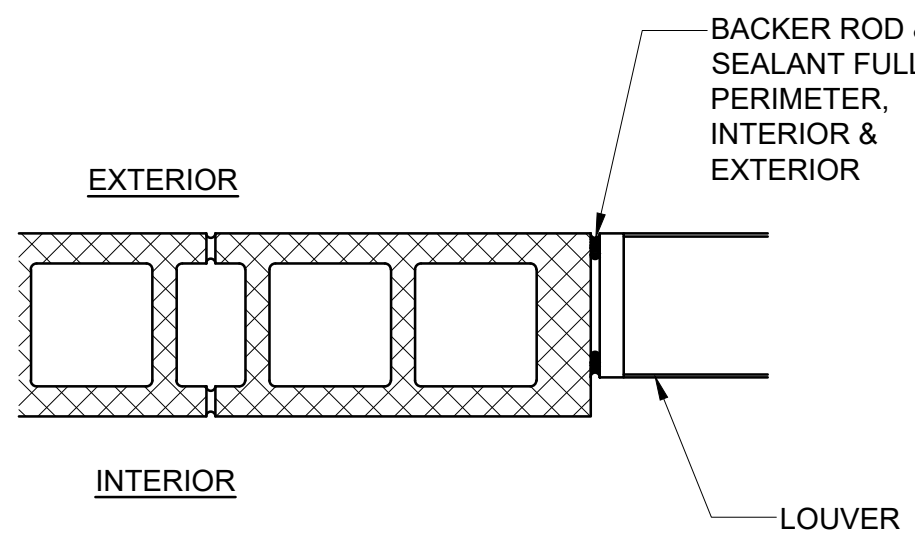

LOUVER JAMB DETAIL
1-1/2"=1'-0"



SALT LAKE CITY, UT



90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: K. WOESSNER

DRAWN: K. WOESSNER

CHECKED: G. SHORT

CHECKED: ---

APPROVED: G. SHORT

FILENAME

DILKON PUMP STATION_A_BASE

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

ARCH

DOOR SCHEDULE AND DETAILS

DRAWING NUMBER


A-301

SHEET NUMBER


OF 113

CONTROL DIAGRAMS:


LINEWORK:

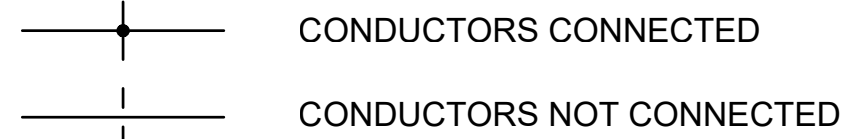


MISCELLANEOUS:

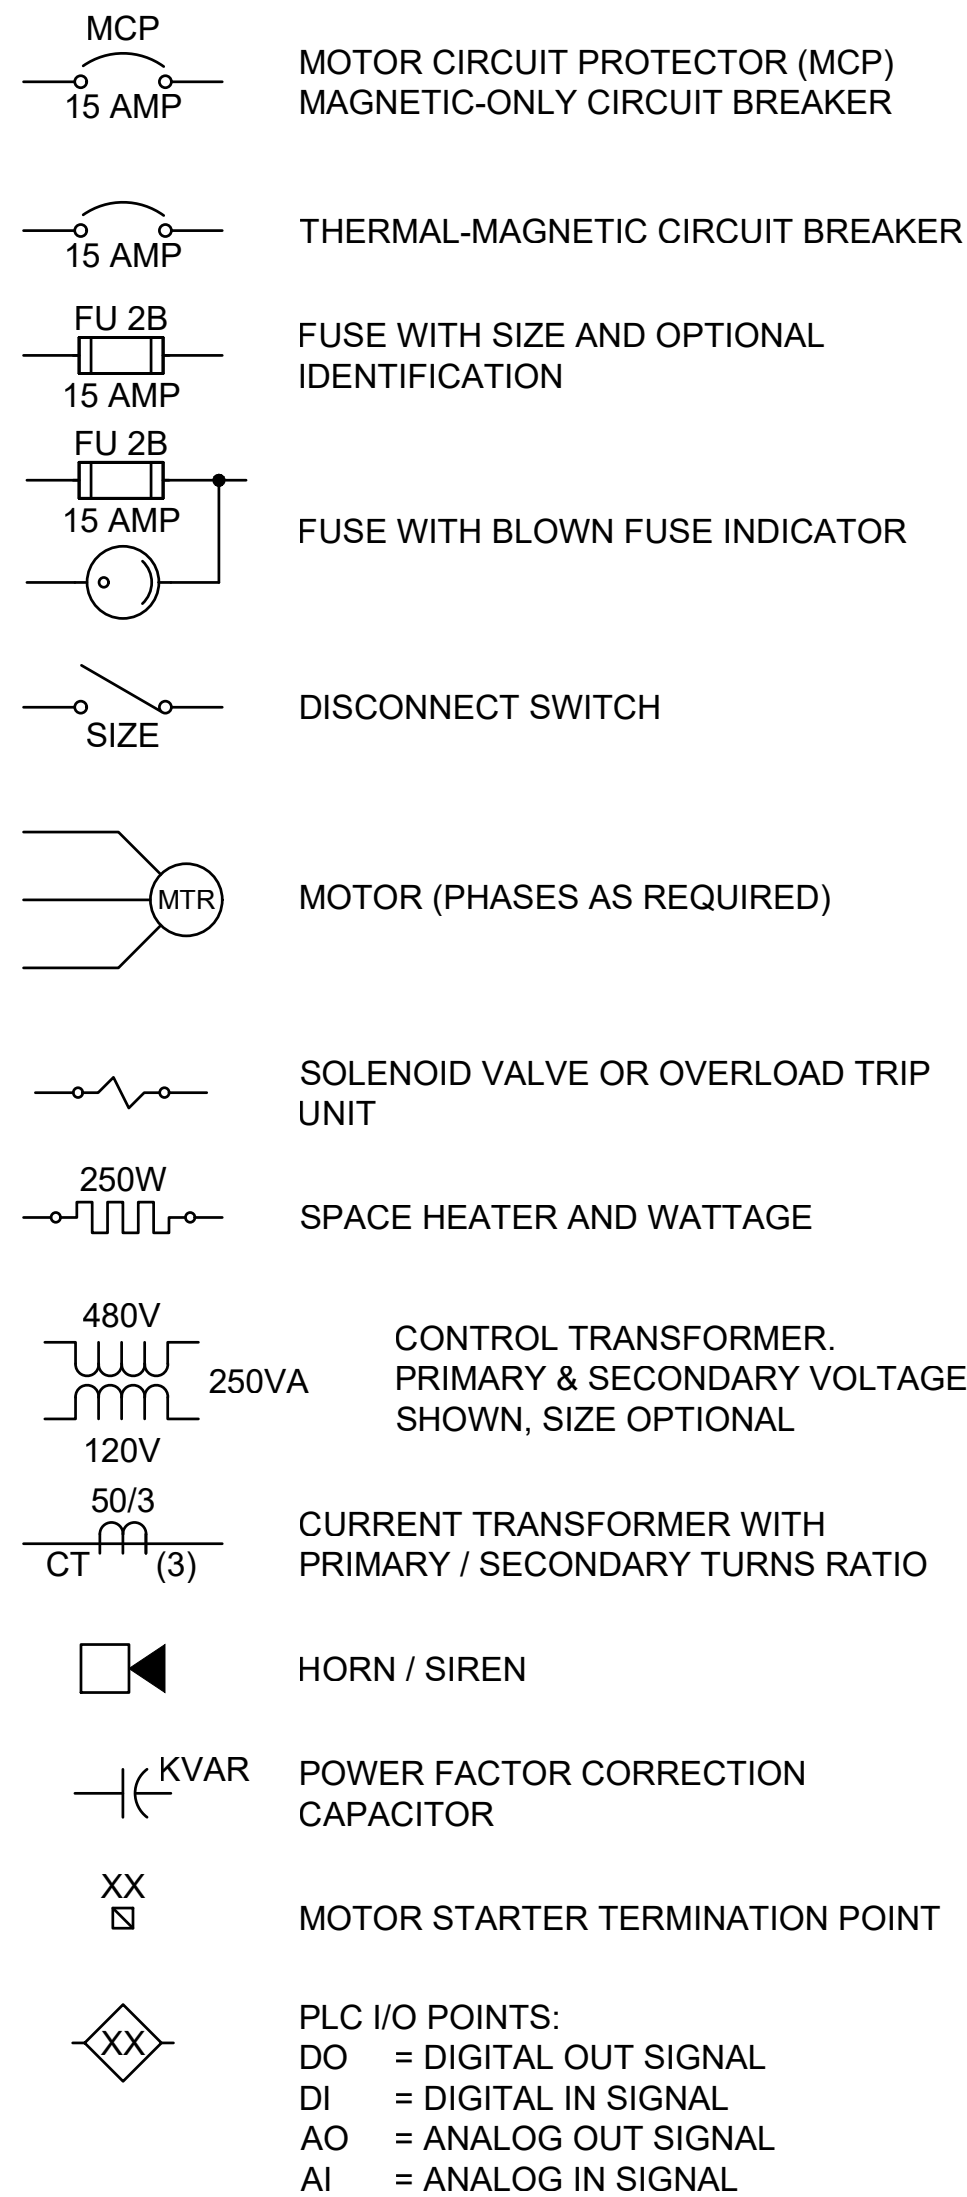


INDICATORS:

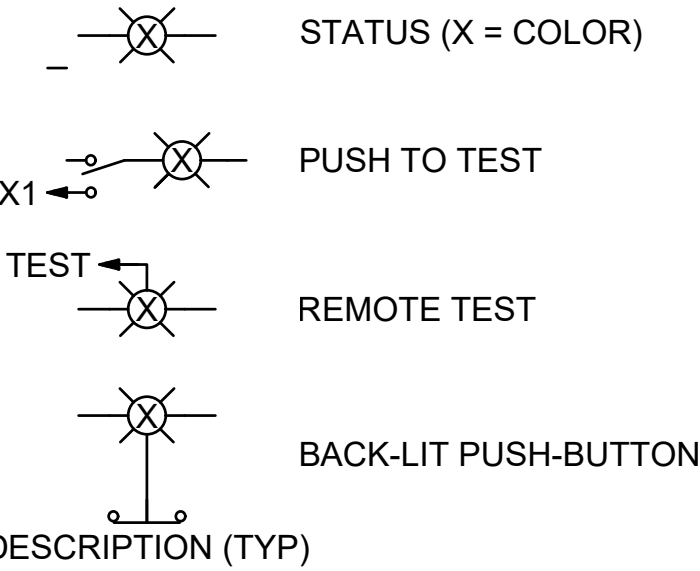


COILS:

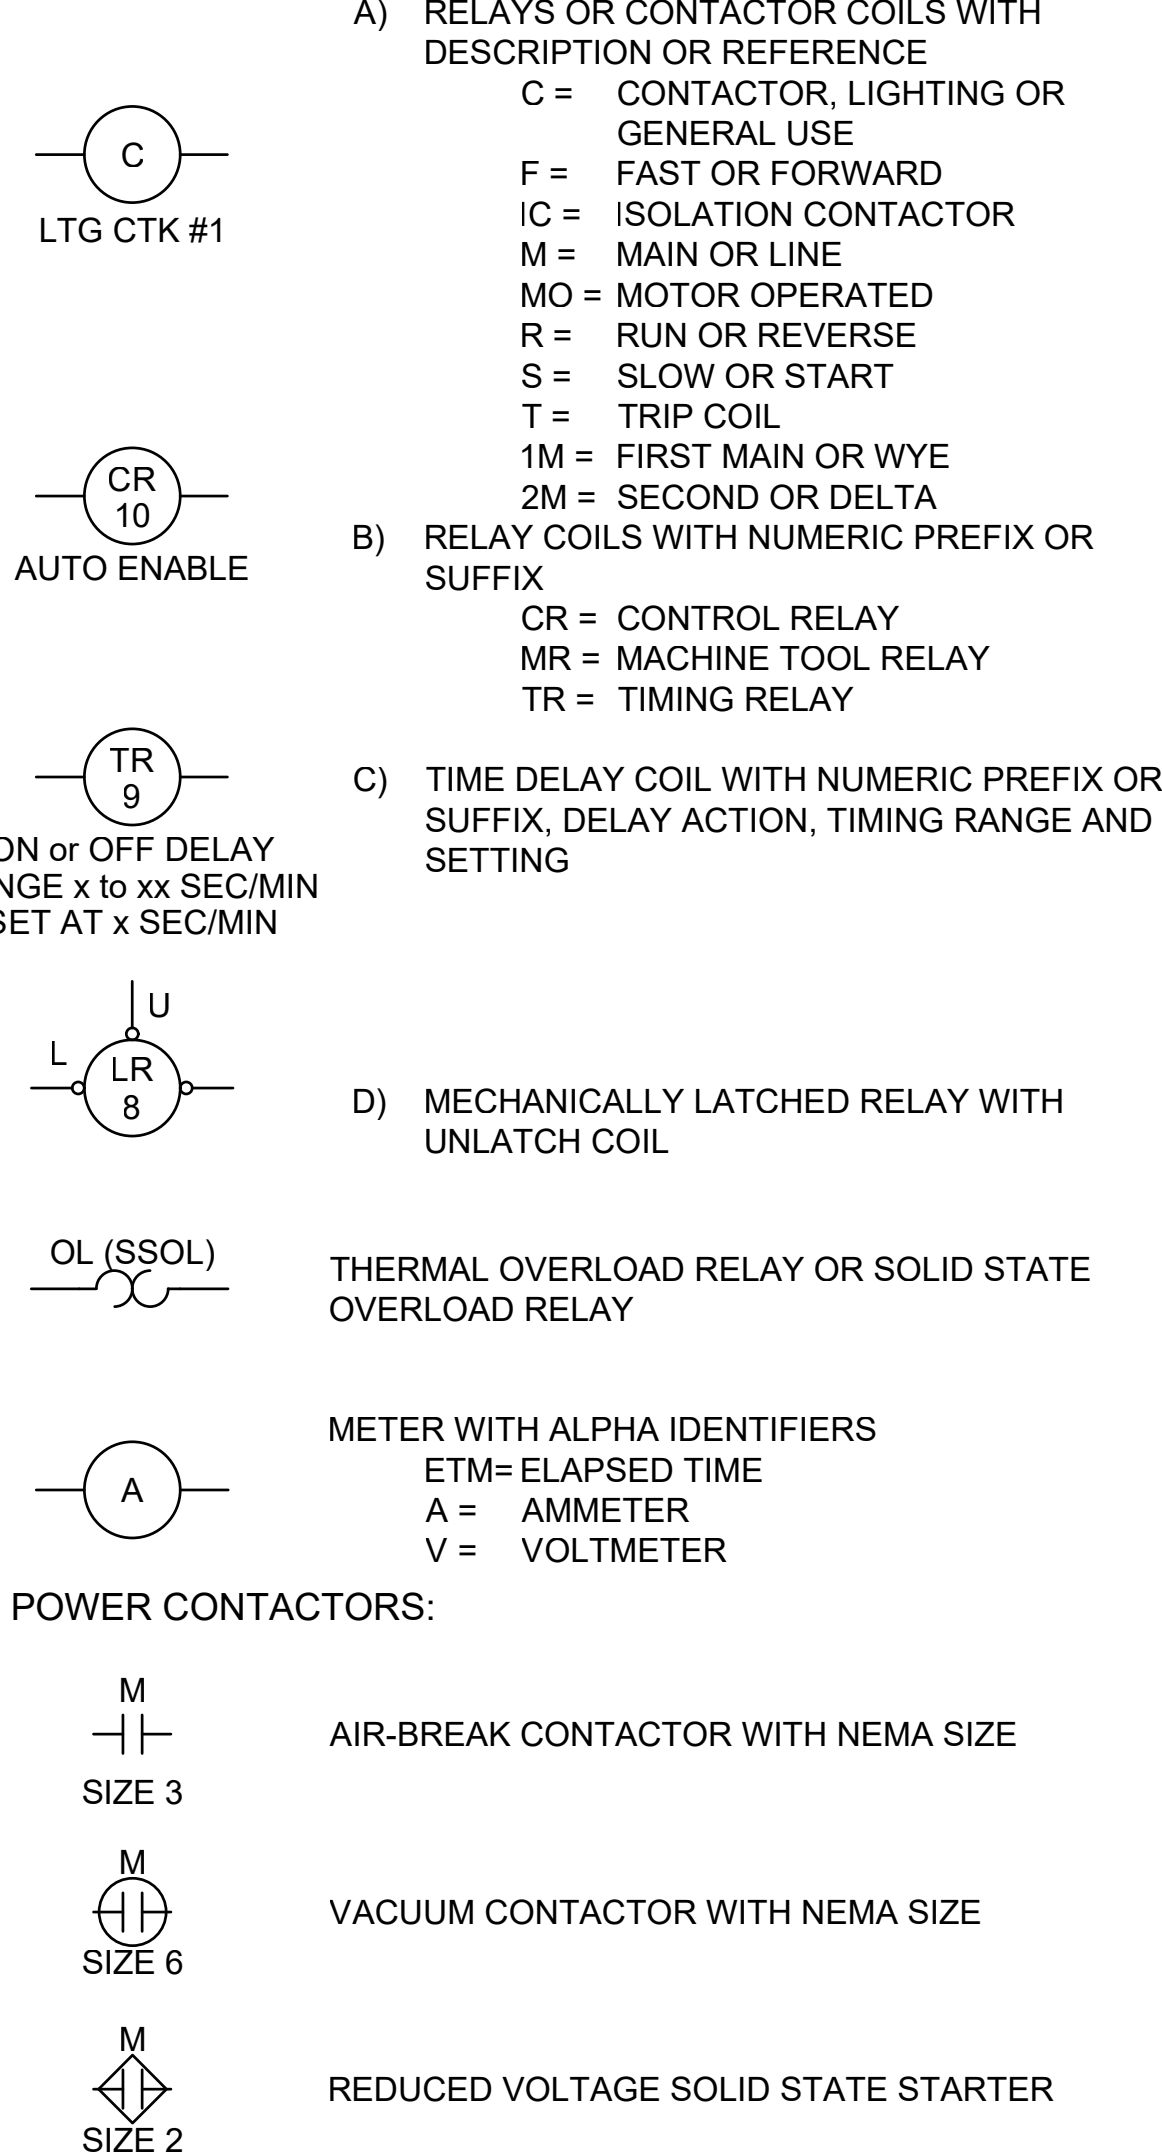


NORMALLY OPEN (NO) NORMALLY CLOSED (NC)

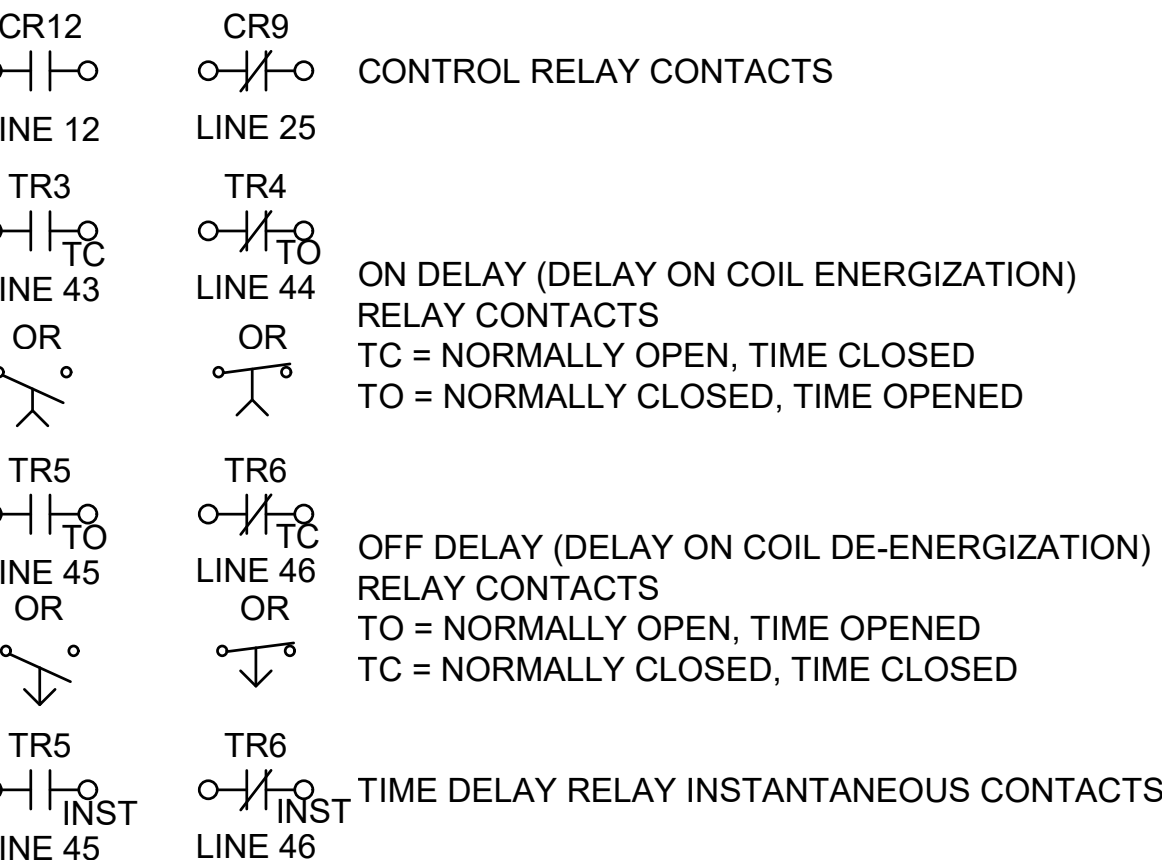

SWITCHES: (SHOWN WITH OPTIONAL LOCATION REFERENCE)

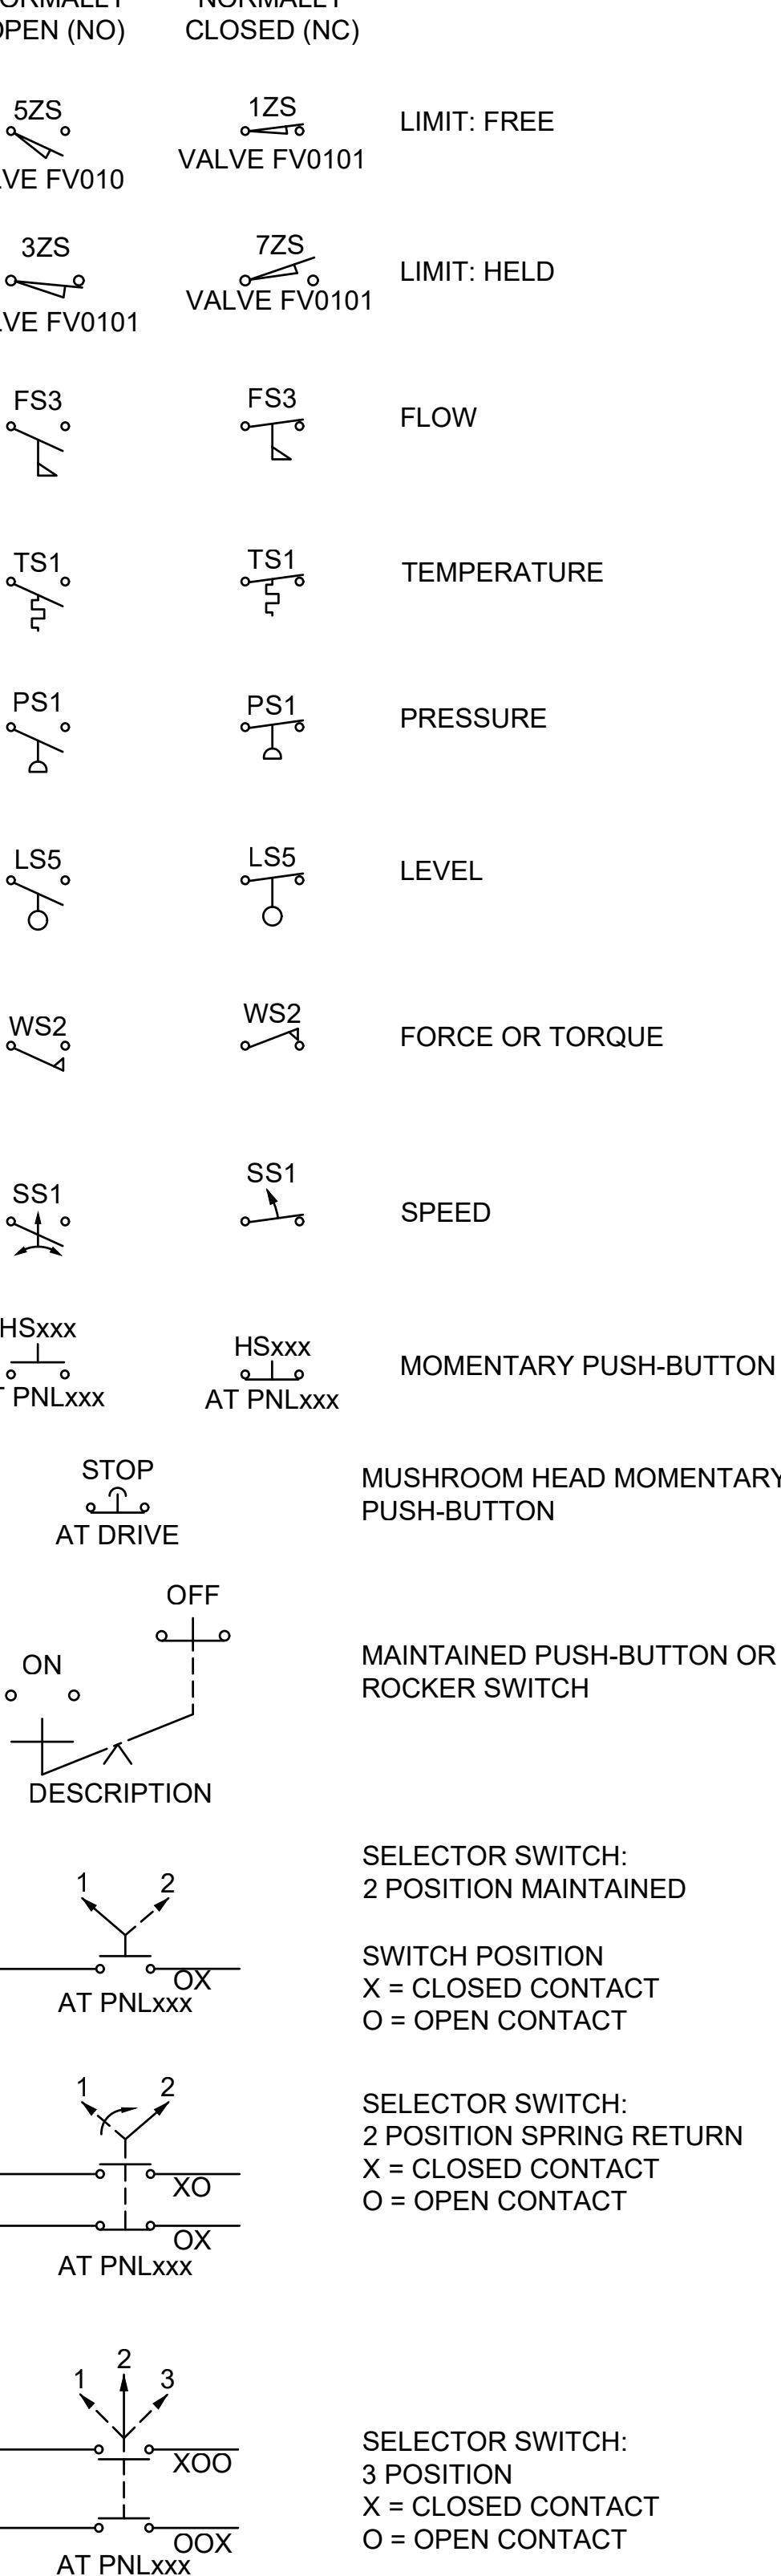

ONE LINE DIAGRAMS:

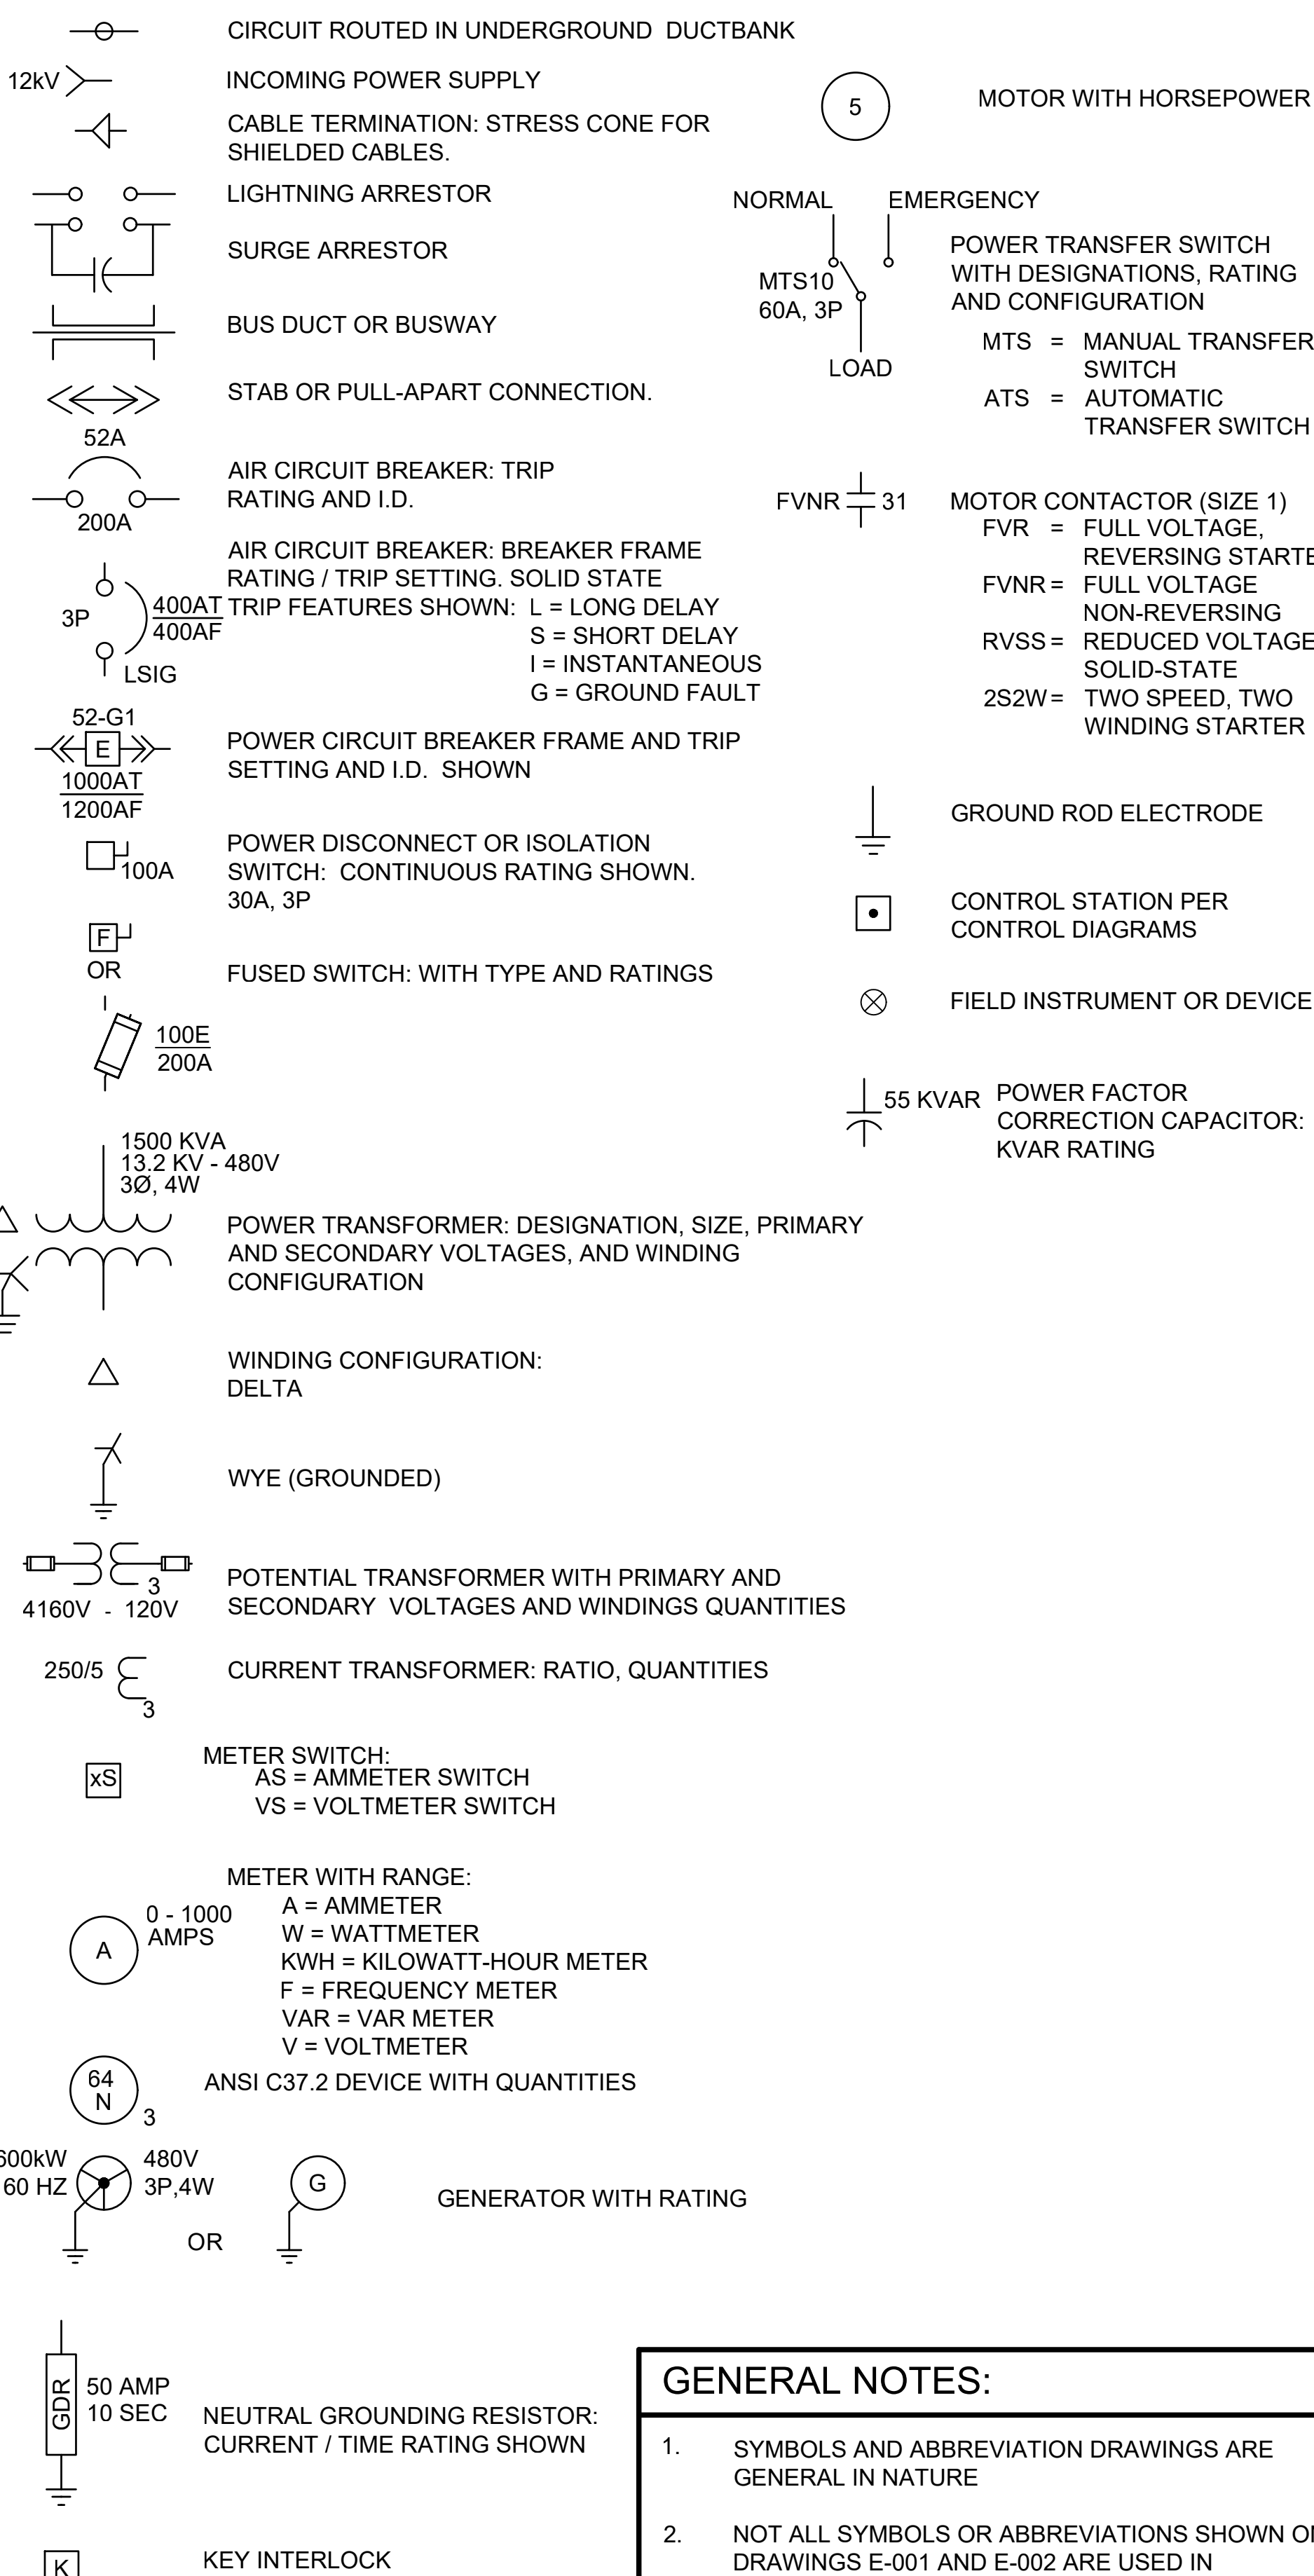

GENERAL NOTES:

- SYMBOLS AND ABBREVIATION DRAWINGS ARE GENERAL IN NATURE
- NOT ALL SYMBOLS OR ABBREVIATIONS SHOWN ON DRAWINGS E-001 AND E-002 ARE USED IN SUBSEQUENT DRAWINGS.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRENCHELEY

FILENAME

E-002.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER


ELECTRICAL

CONTROL AND ONE-LINE DIAGRAM LEGENDS AND SYMBOLS

DRAWING NUMBER



E-002

97 SHEET NUMBER OF 113

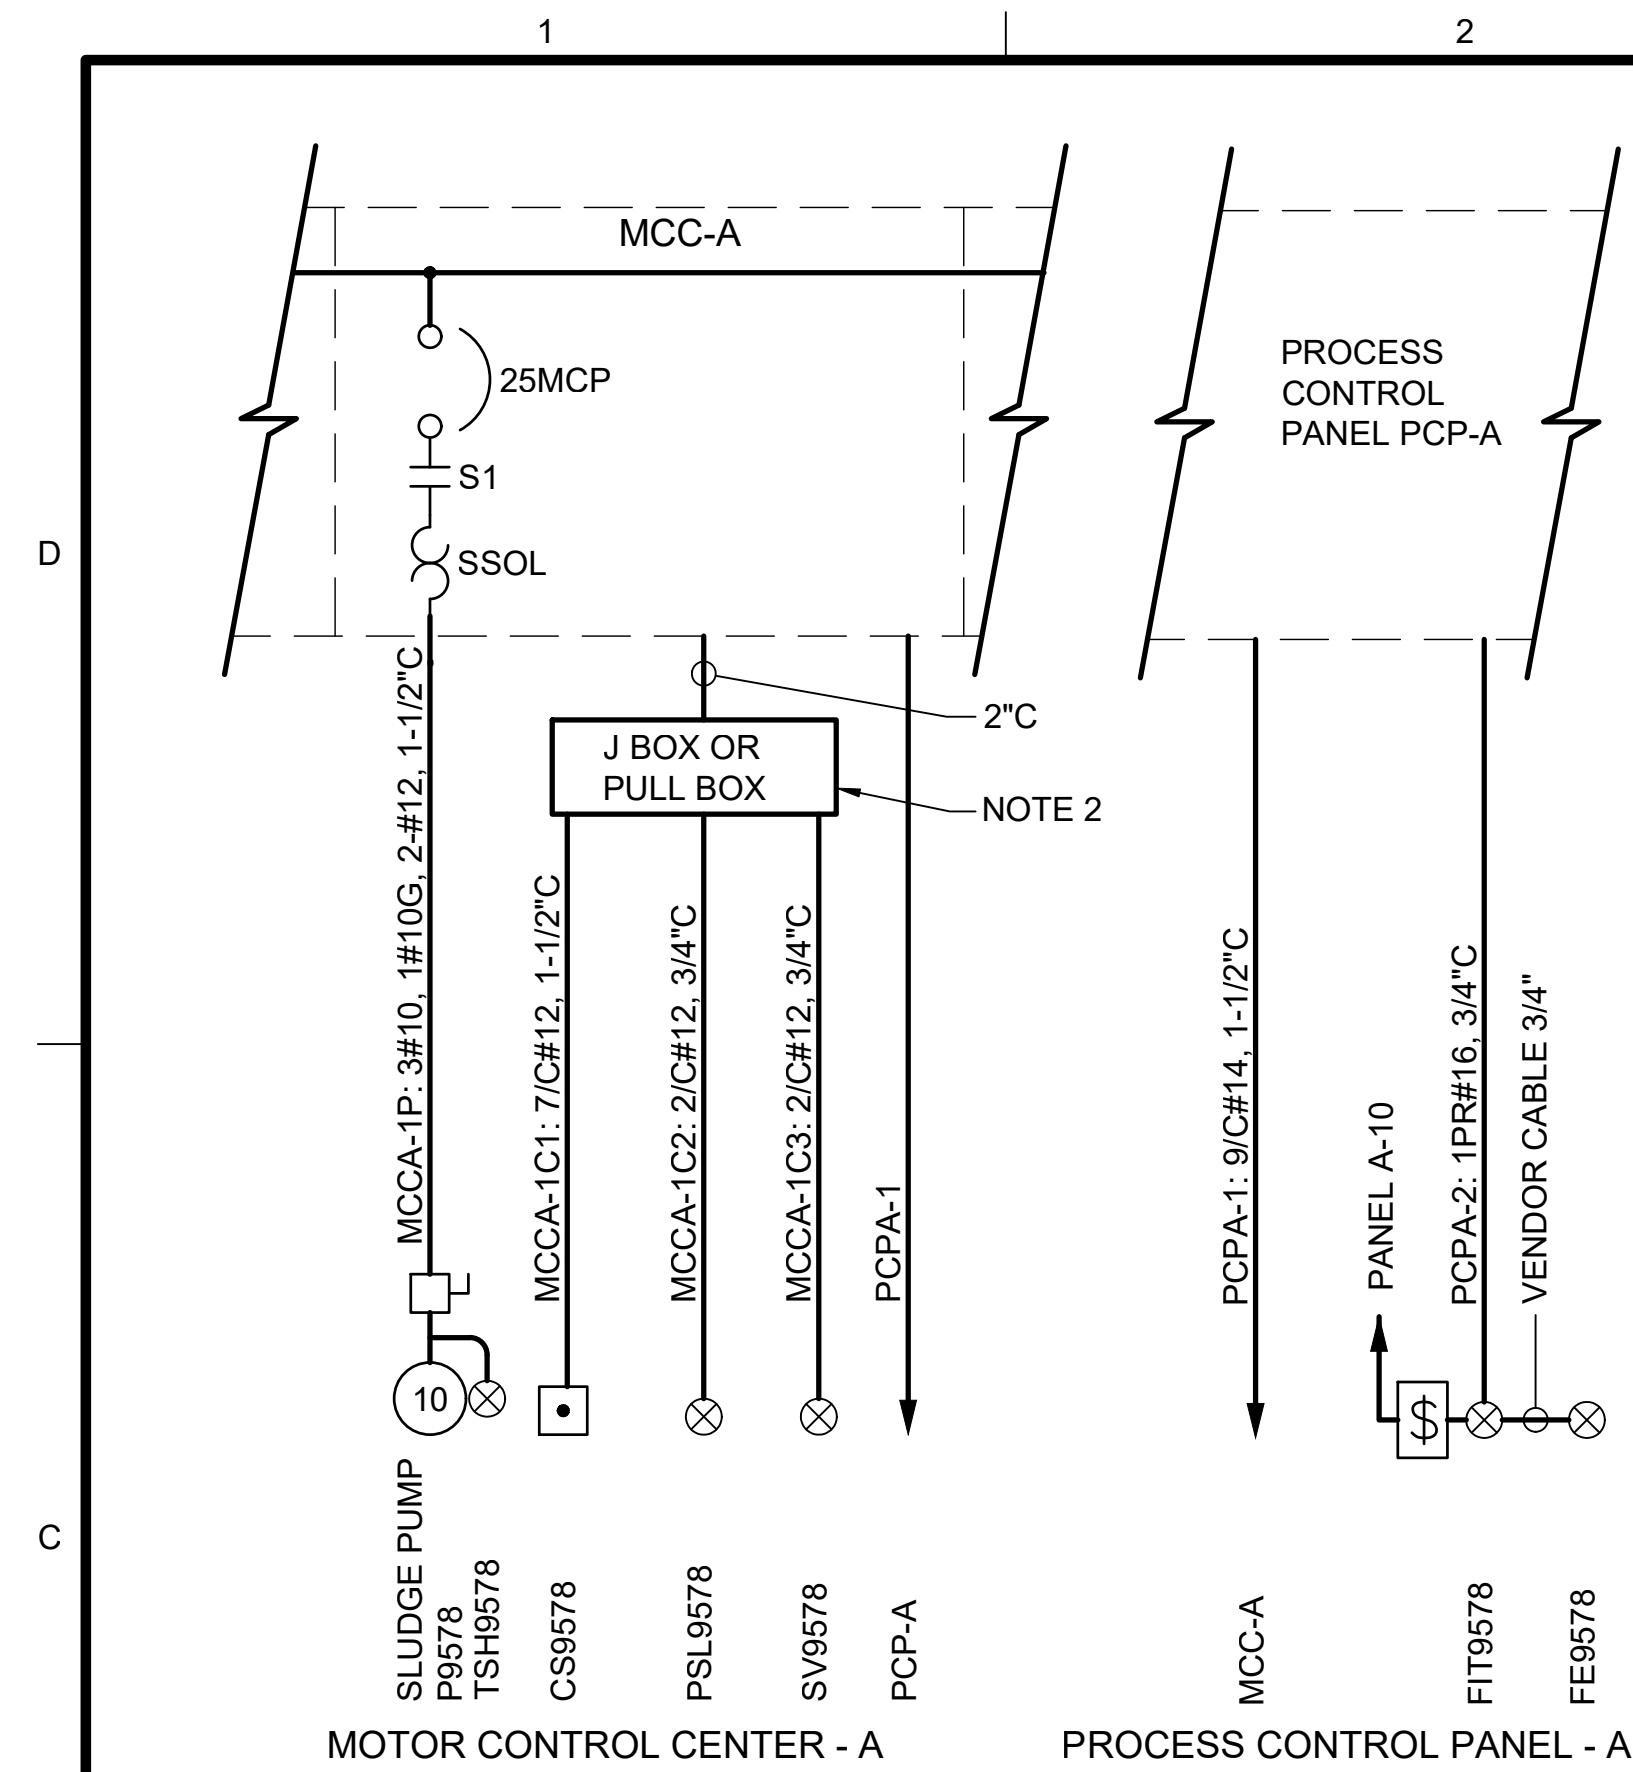


- NOTES:
1. MOTOR CONTROL CENTER AND PROCESS CONTROL PANEL HOMERUN CIRCUIT DESIGNATIONS: REFER TO PLAN DRAWINGS.
 2. PROVIDE TERMINATION BOX, PULL BOX FITTINGS, OR DUCTBANK TRANSITION, AS REQUIRED.

SINGLE-LINE DIAGRAM
TYPICAL
DETAIL (E1001)
NO SCALE

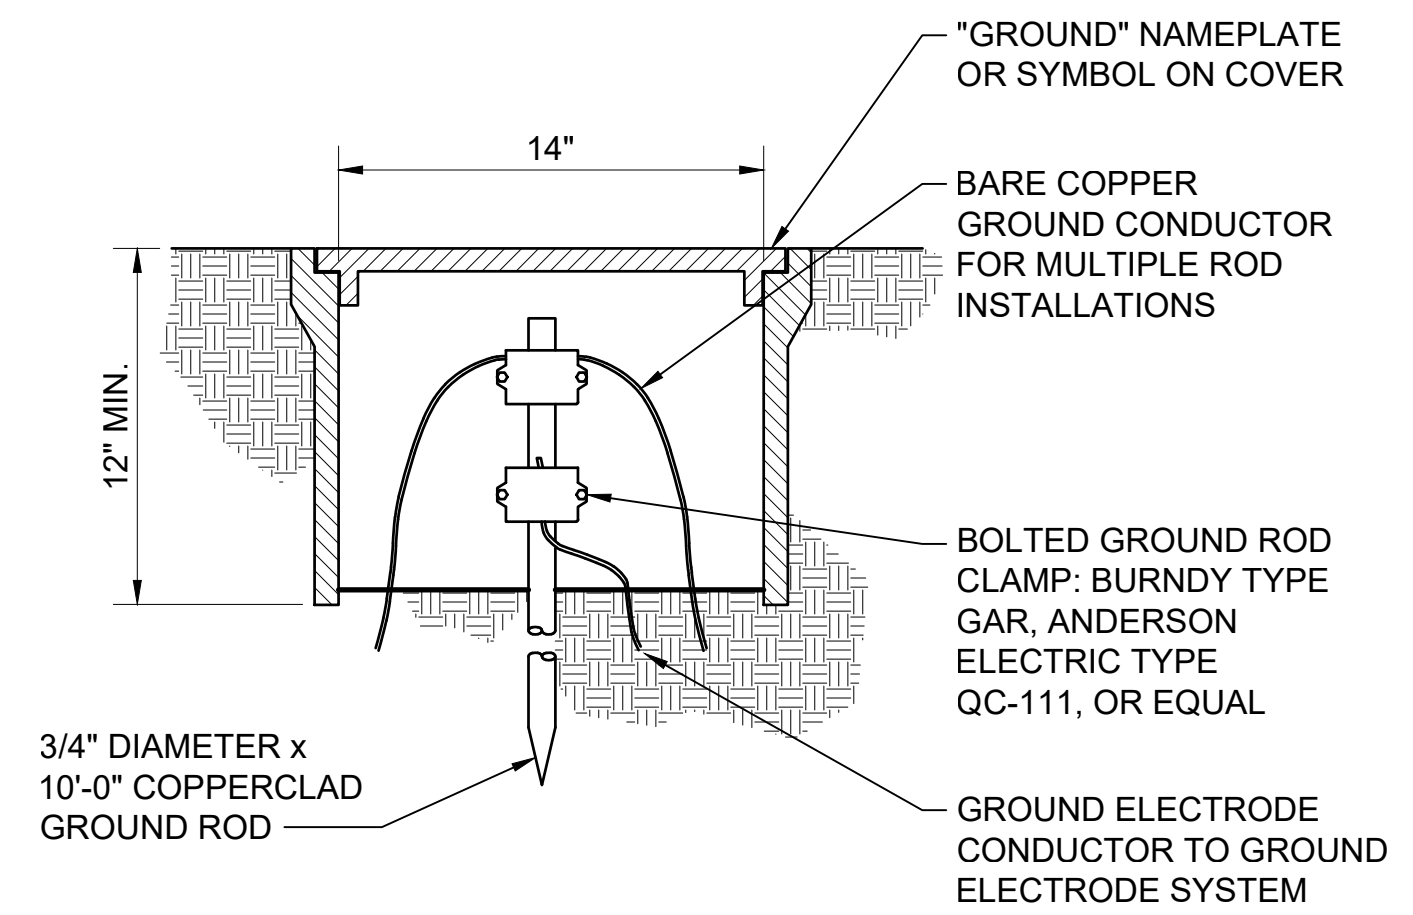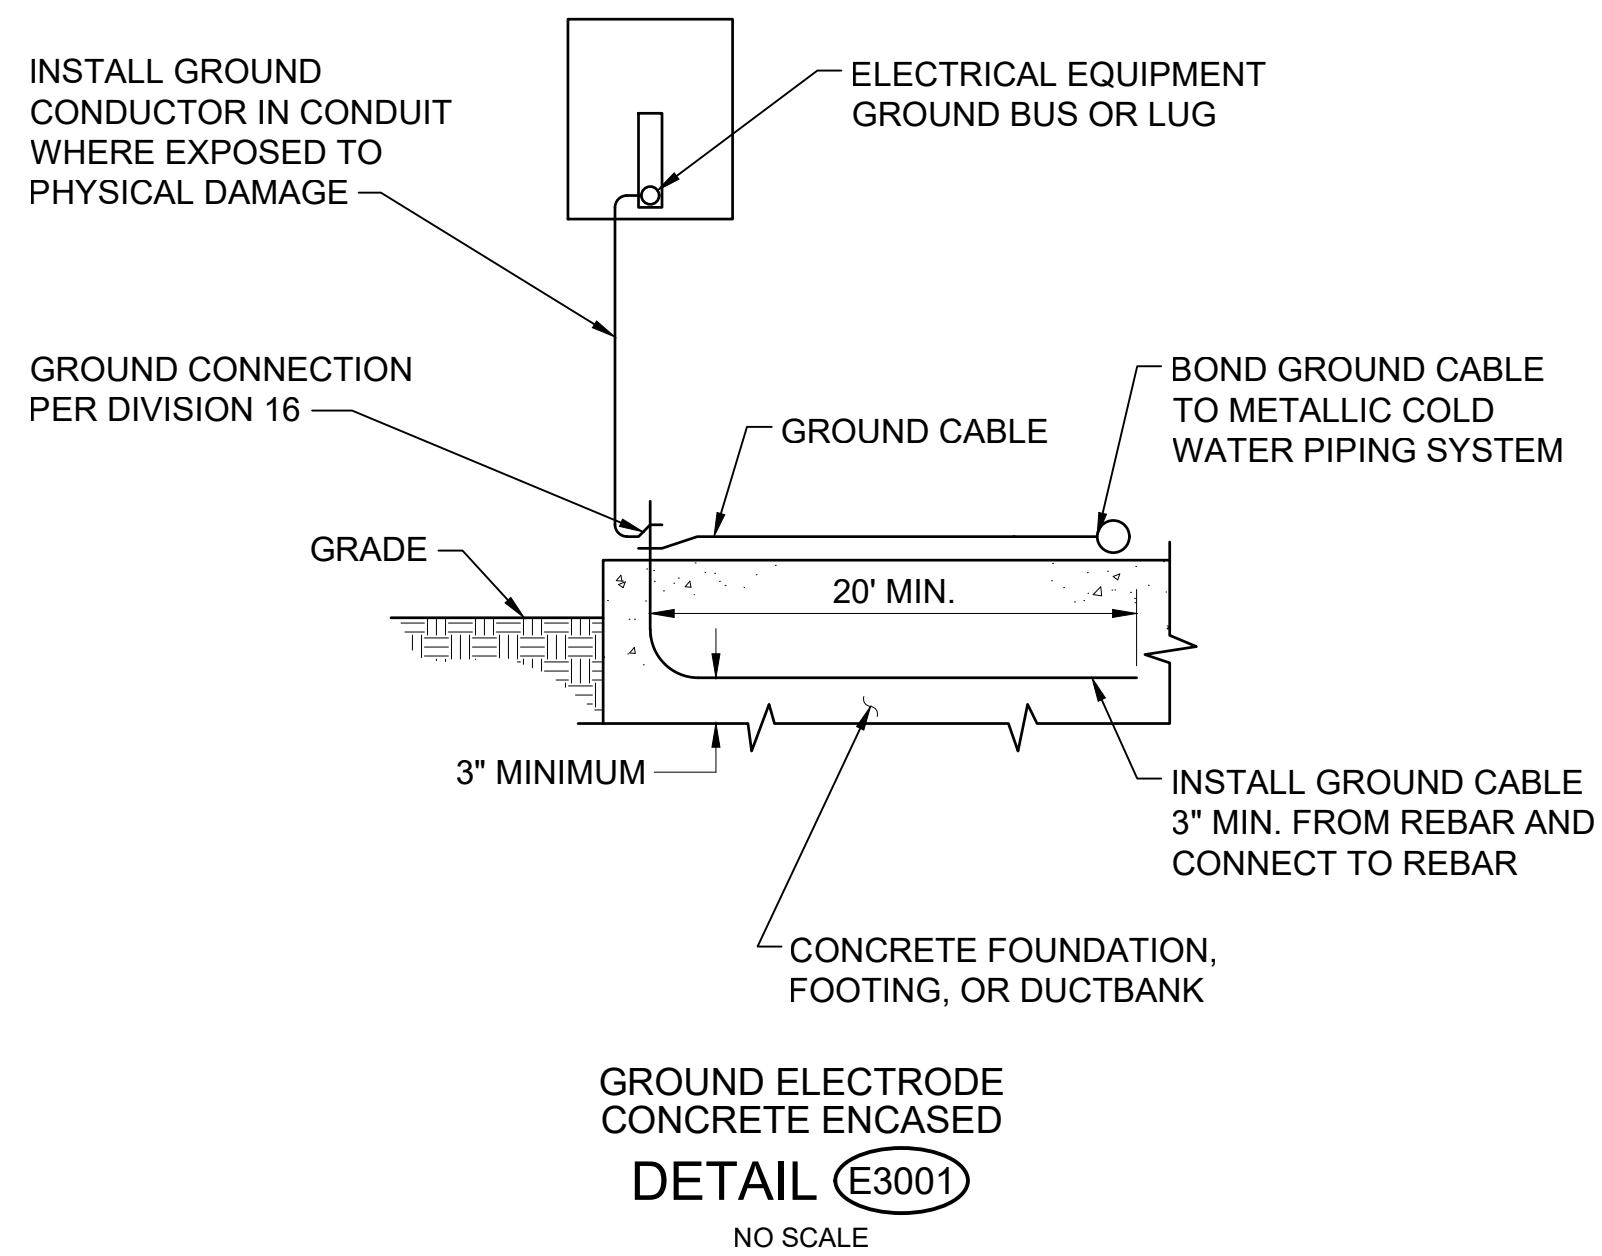


- NOTES:
1. TEST WELL OF CONCRETE, PVC, OR FRP MATERIAL.
 2. H-20 LOAD RATED COVER FOR TEST WELL IN TRAFFIC AREA.

GROUND ELECTRODE
TEST WELL
DETAIL (E3002)
NO SCALE

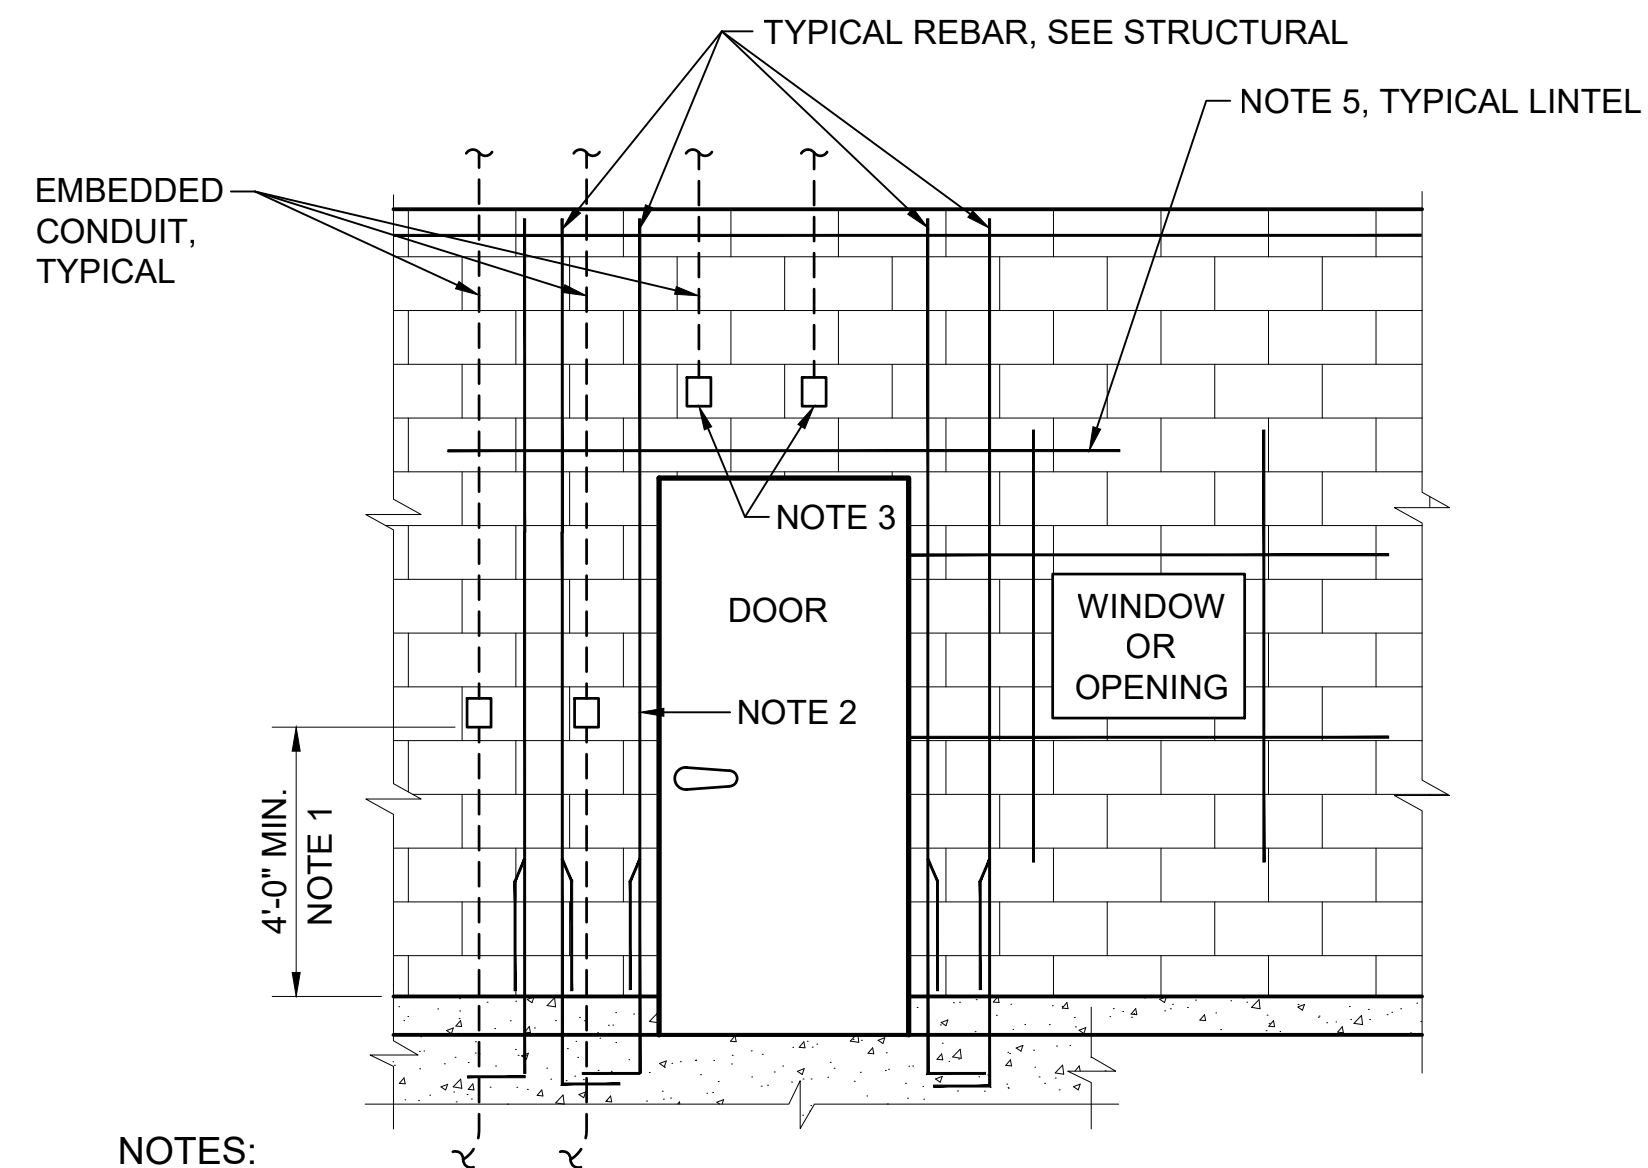


- NOTES:
1. ALL EMBEDDED BOXES ABOVE GROUT LIFTS, AND BOND BEAMS.
 2. EMBEDDED BOXES ARE NOT ALLOWED IN WALL BLOCK CELLS WITH VERTICAL REBAR.
 3. EMBEDDED BOXES FOR EXIT LIGHTS, FIRE ALARMS, INTRUSION SWITCHES, ETC. ABOVE HORIZONTAL LINTEL. SEE STRUCTURAL FOR LINTEL HEIGHTS.
 4. CUT OPENINGS IN CMU FOR EMBEDDED BOXES.
 5. HORIZONTAL CONDUIT RUNS ARE NOT ALLOWED IN BOND BEAM OR LINTEL.
 6. ELECTRICAL EQUIPMENT WEIGHING OVER 200 POUNDS MAY NOT BE ATTACHED TO WALLS. PROVIDE EQUIPMENT RACK PER DETAIL E4001.

EMBEDDED RACEWAYS
CMU WALLS
DETAIL E2211
NO SCALE

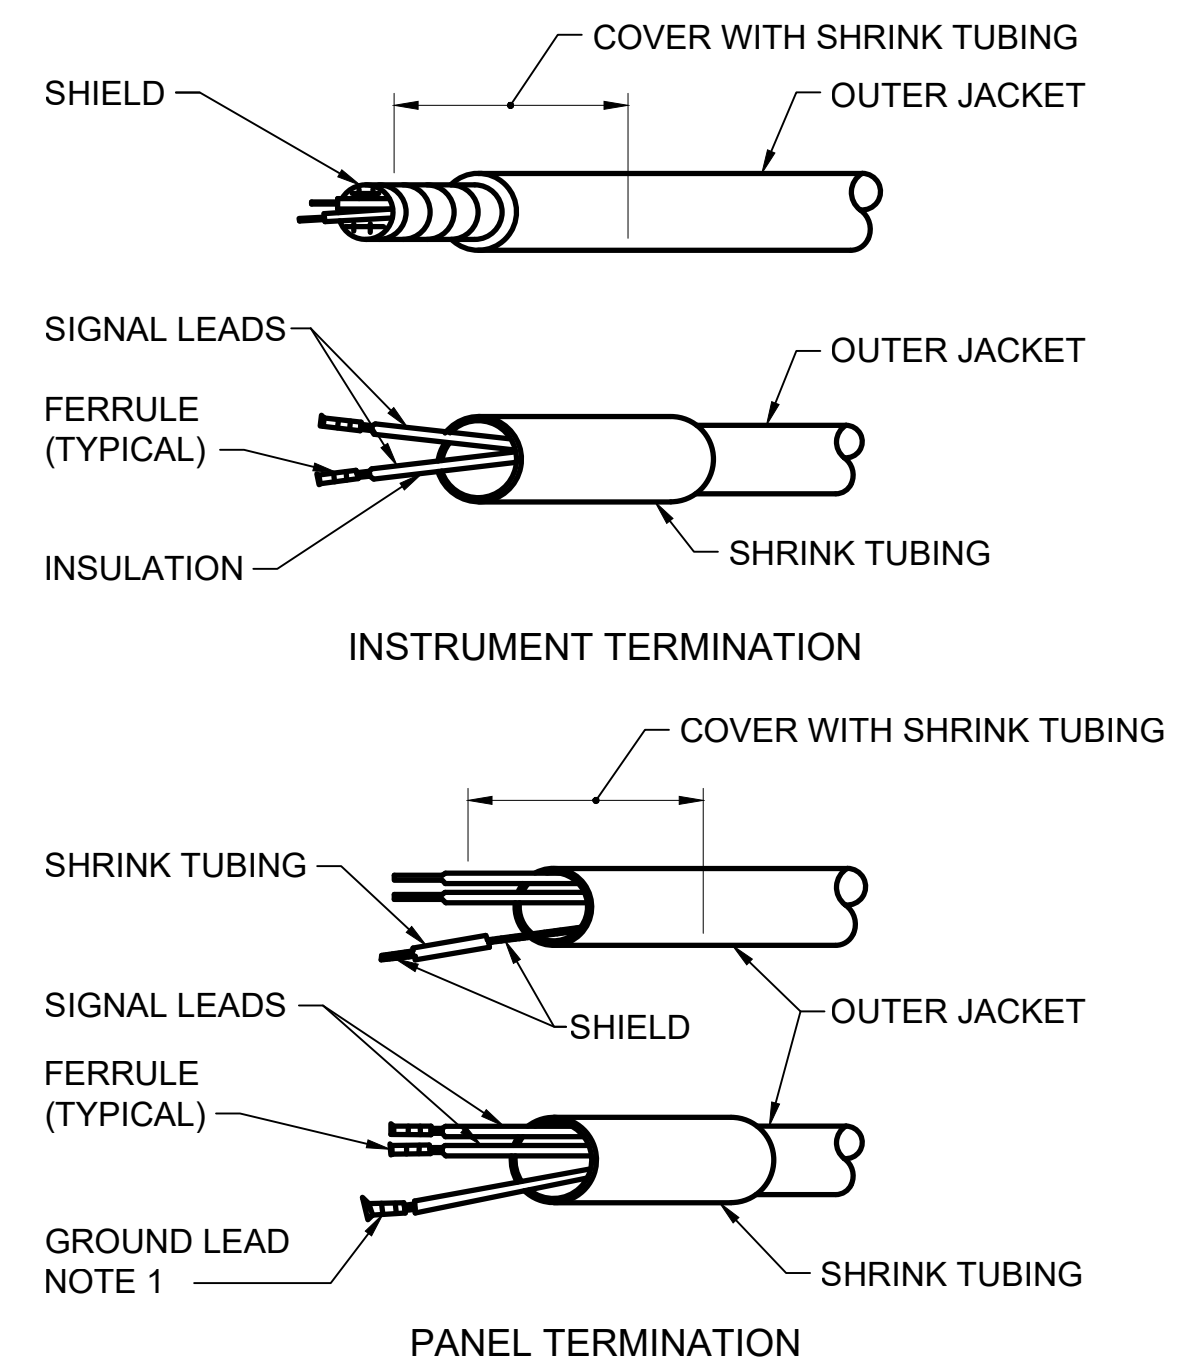

- NOTE:
1. GROUND SHIELD AT PANEL NOT AT INSTRUMENT.

SHIELDED CABLE TERMINATION

DETAIL 

NO SCALE



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

[illegible]

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRECHLEY

FILENAME

E-003.dwg

PROJECT NUMBER
1E7E30

PROJECT NUMBER

ELECTRICAL




STANDARD DETAILS

DRAWING NUMBER

E-003

98

EET NUMBER 113
OF

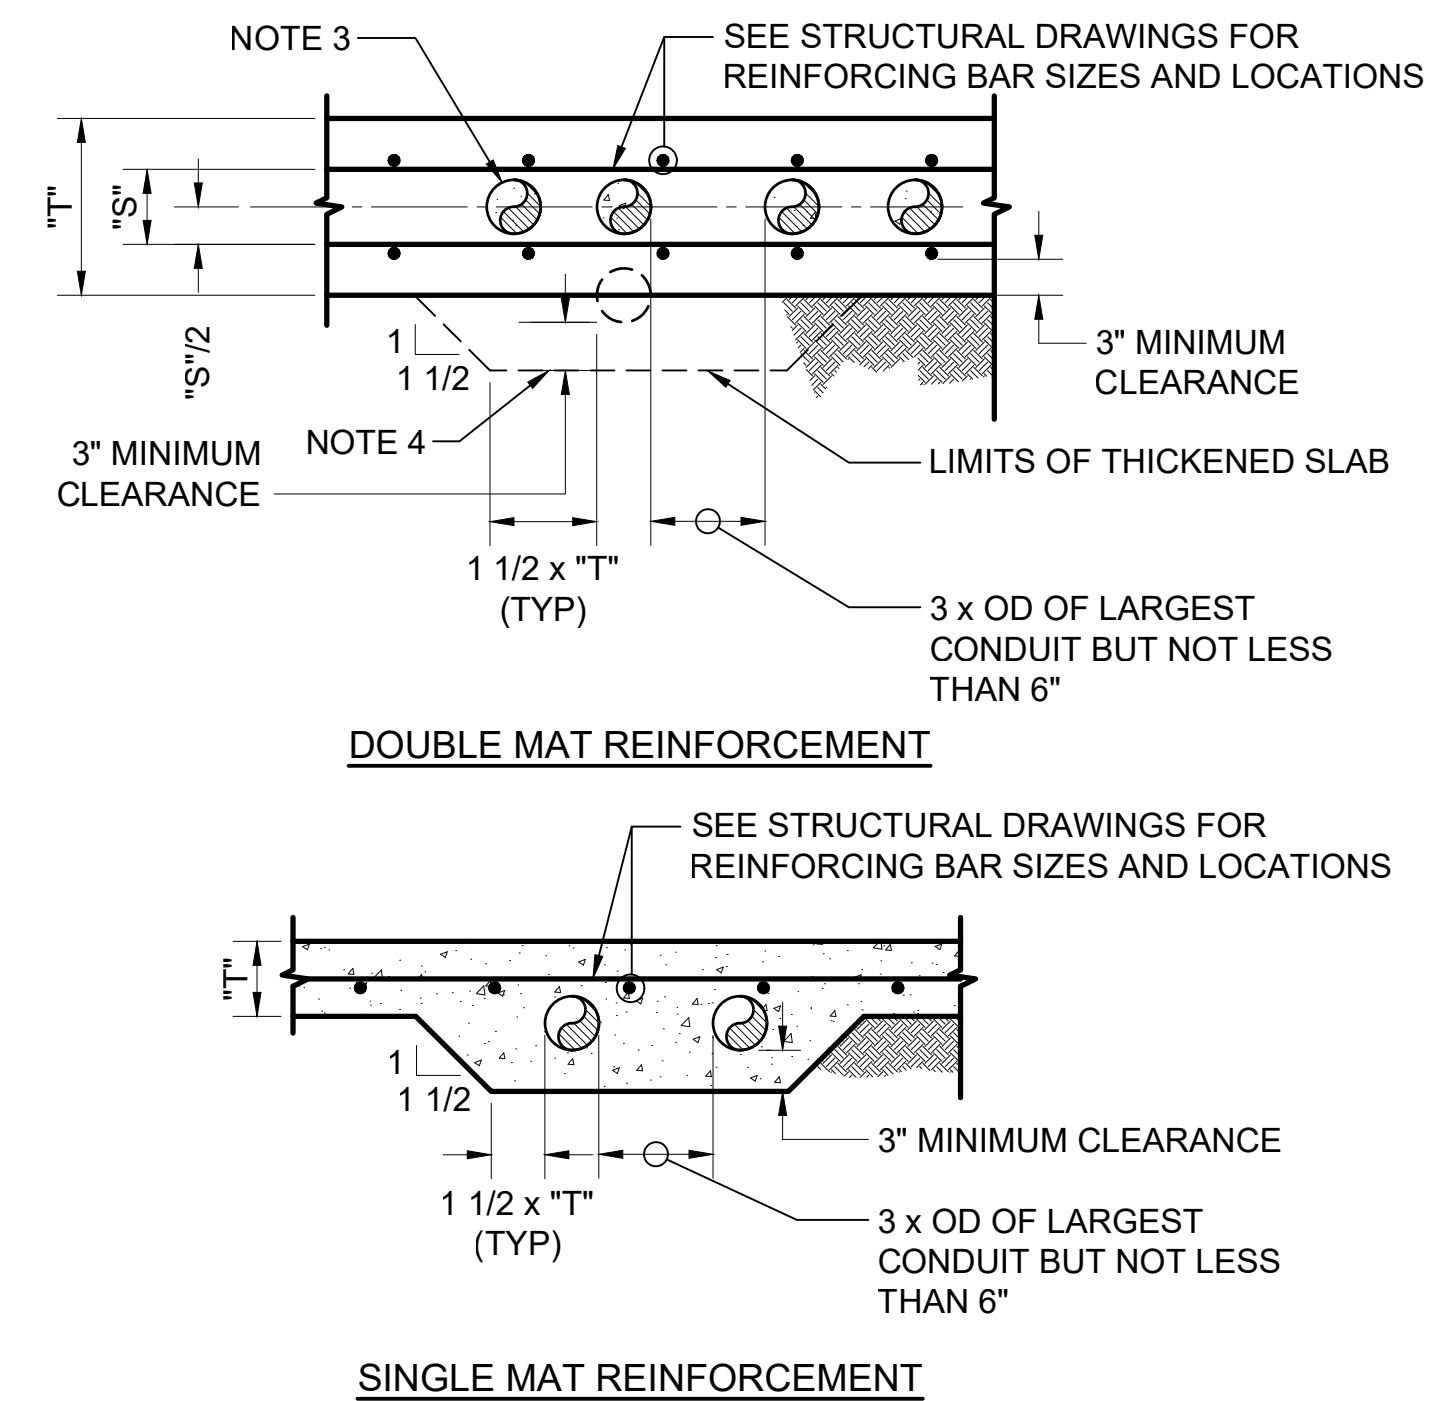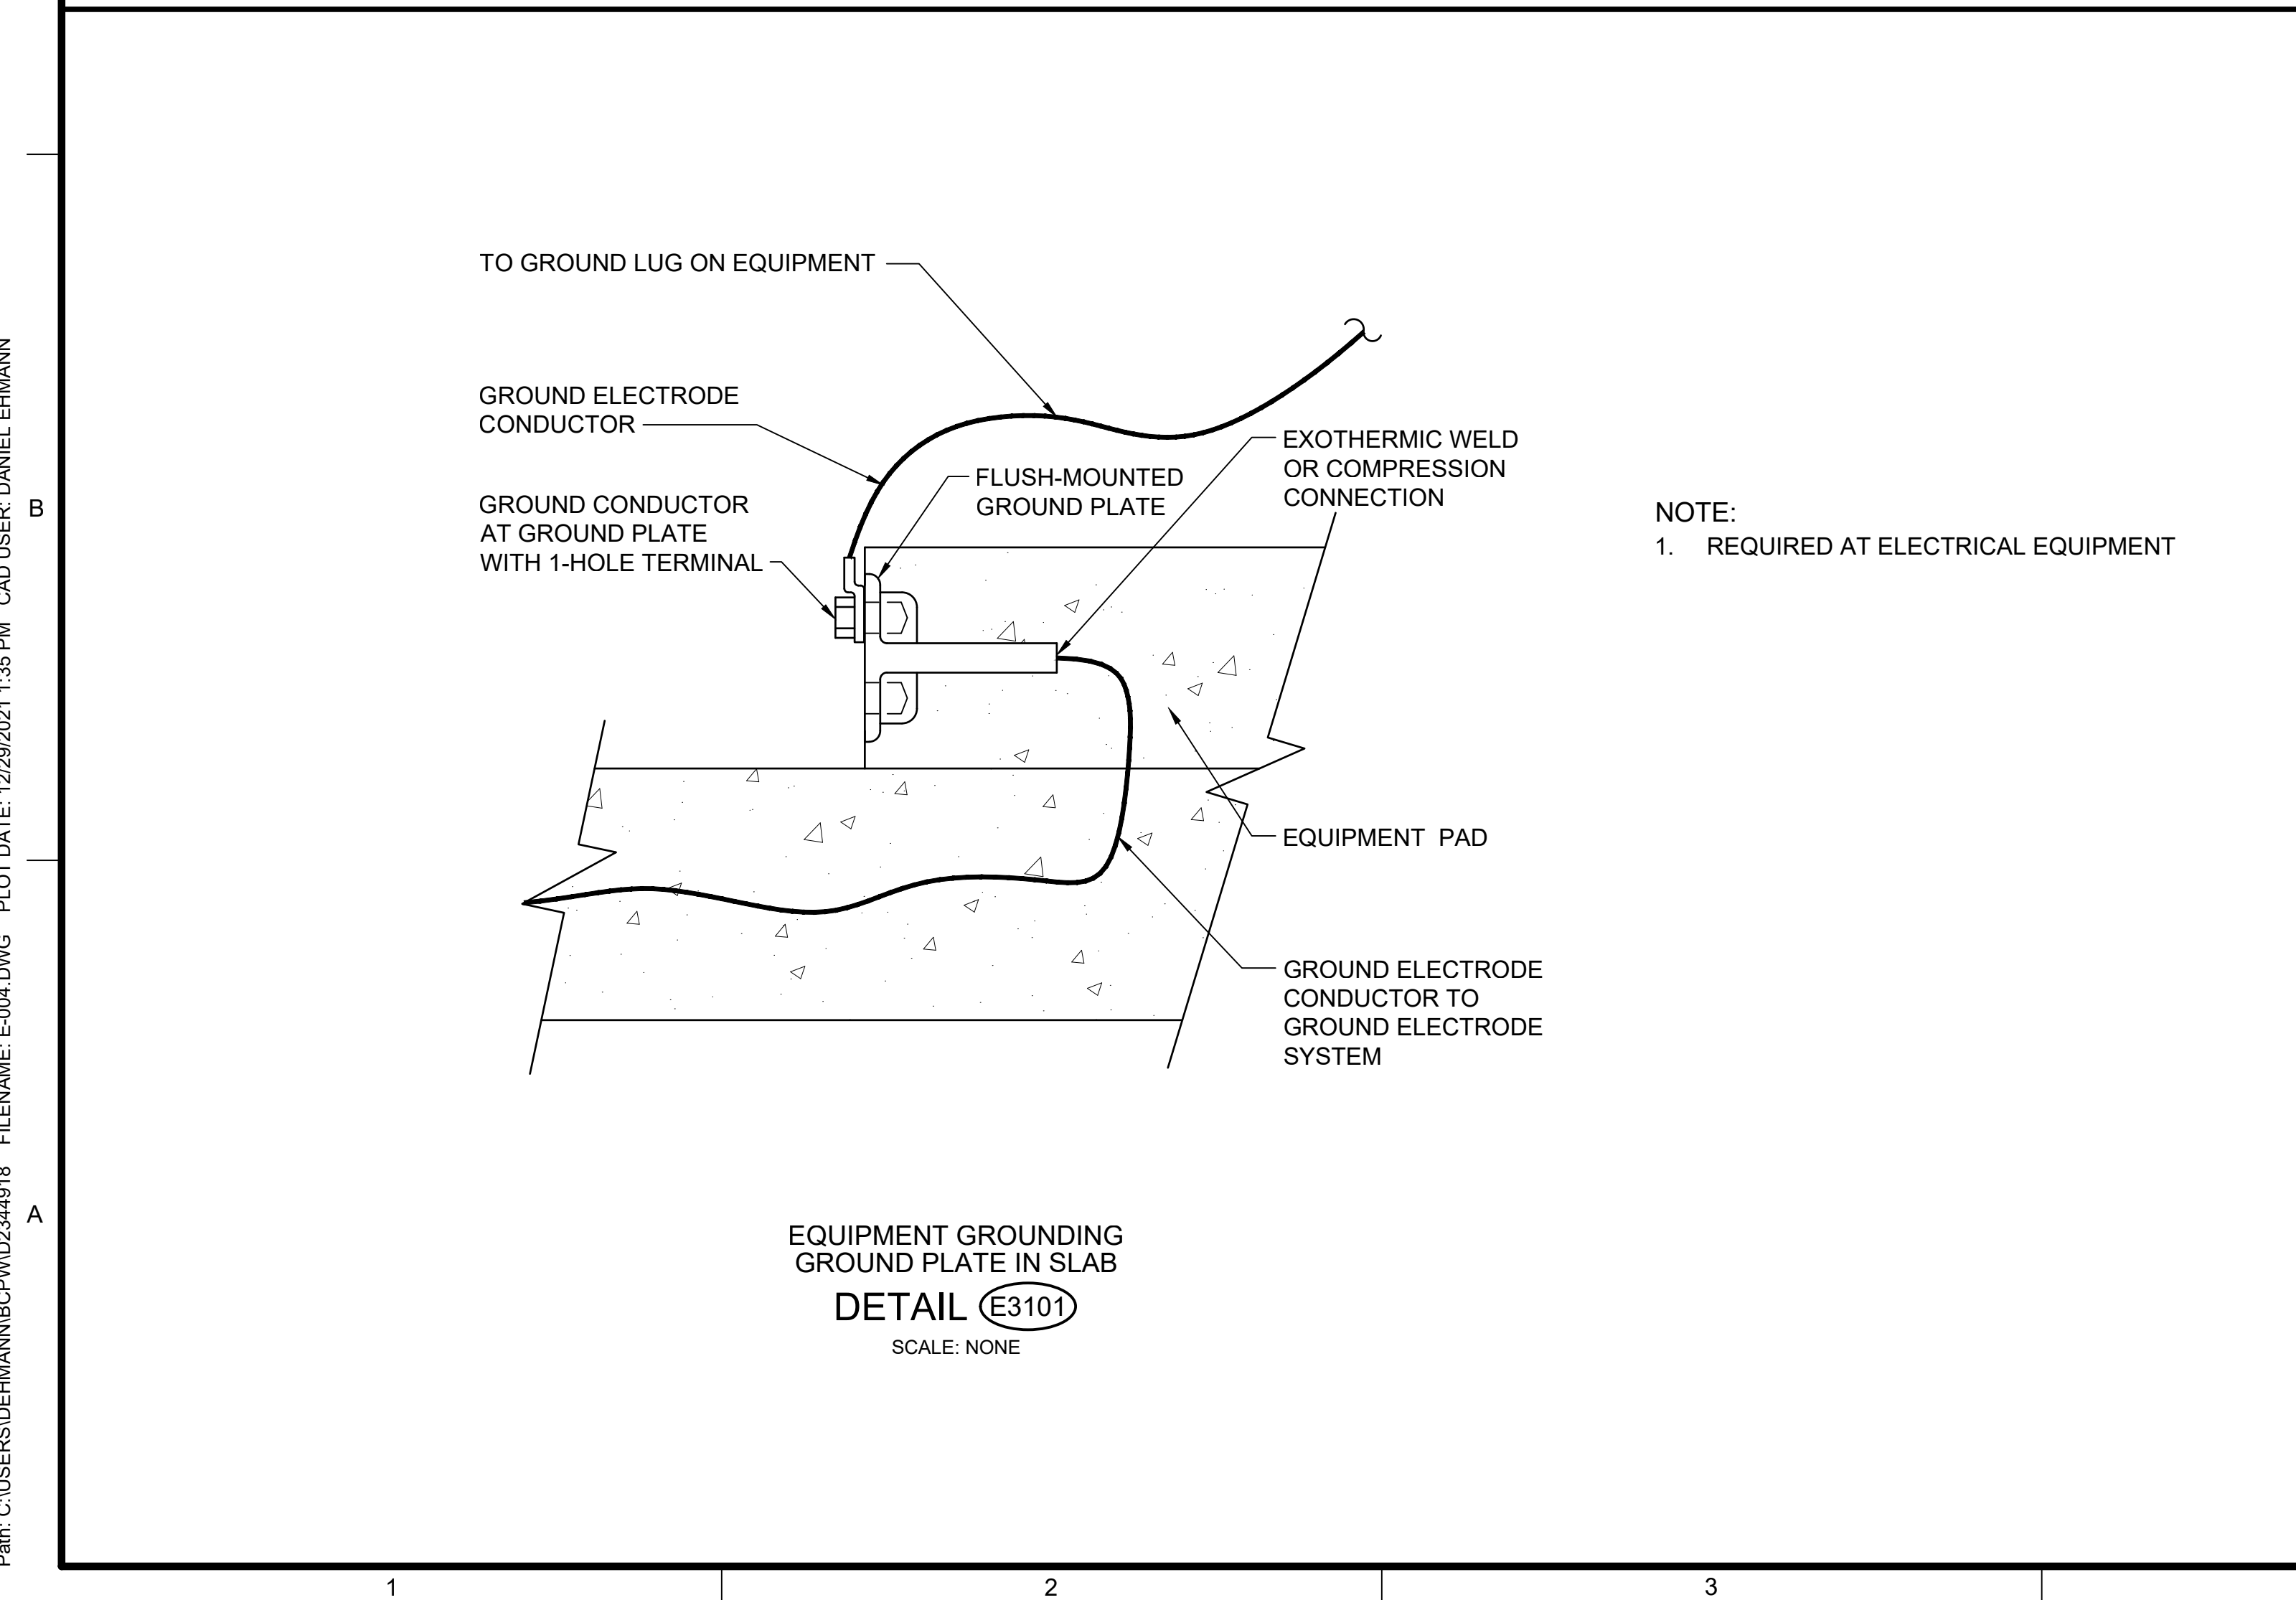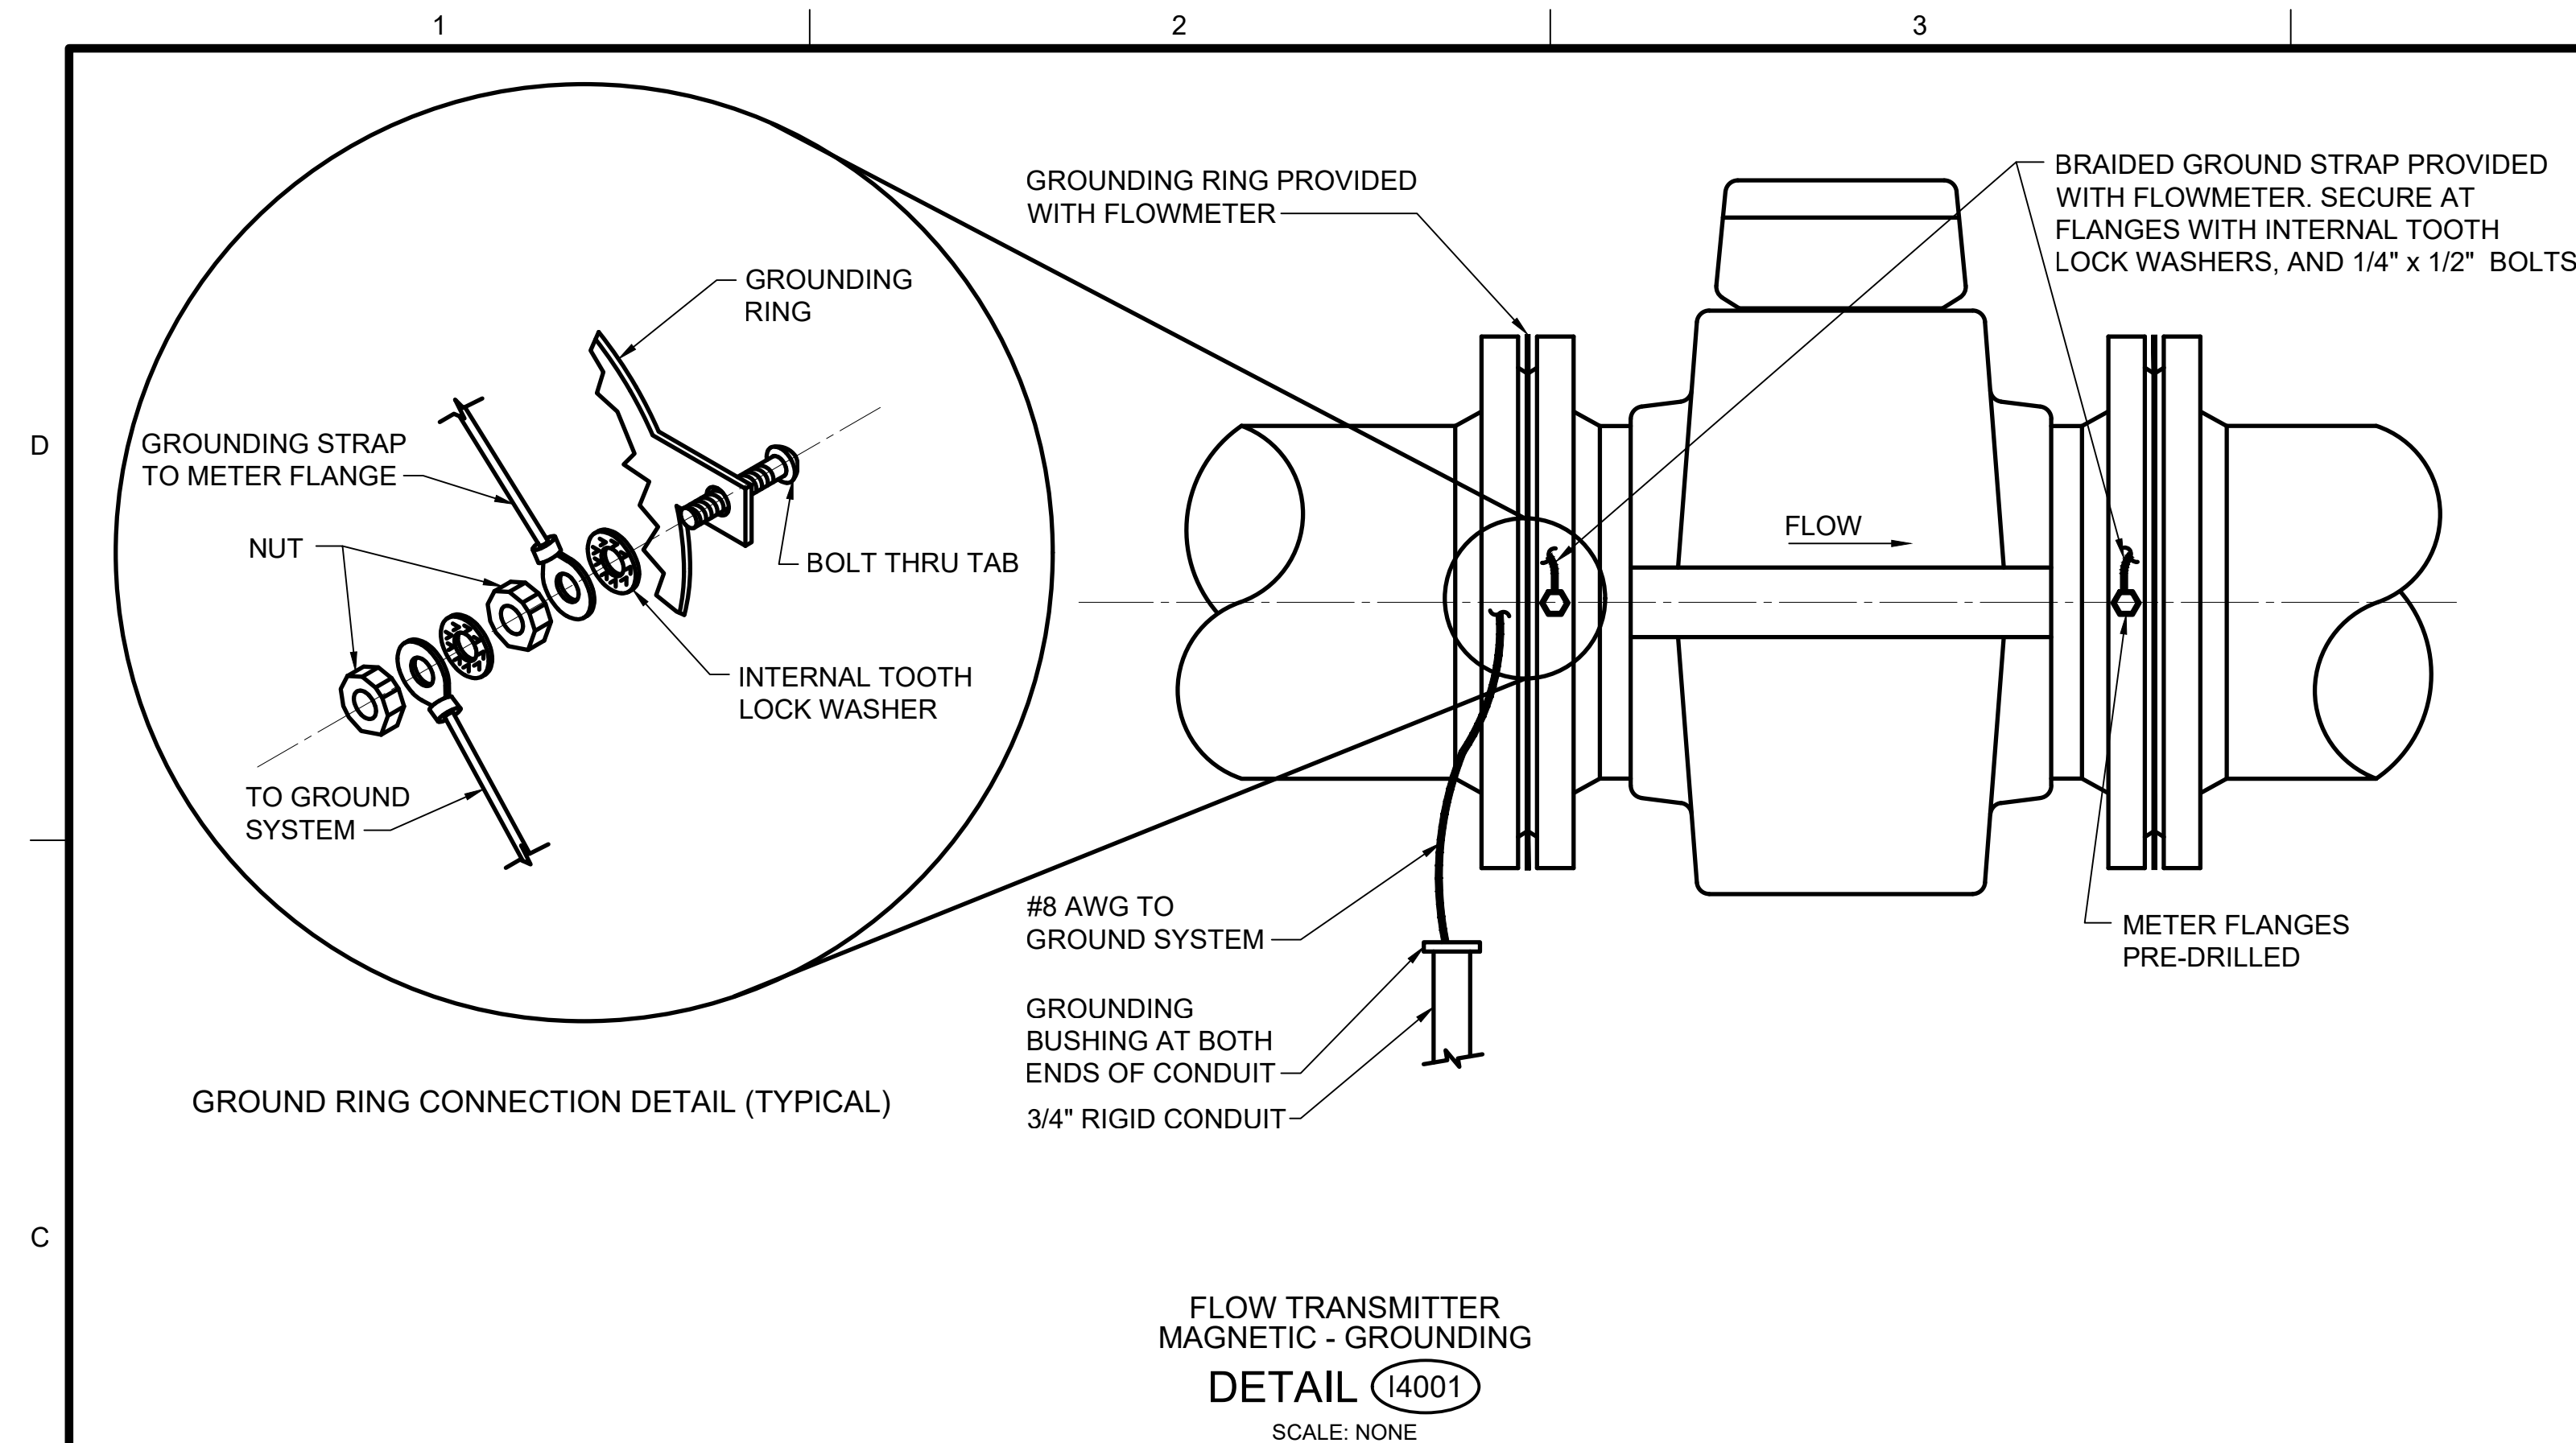

- ## NOTES

1. OD = OUTSIDE DIAMETER OF CONDUIT.
2. "S" = CLEAR SPACE BETWEEN REINFORCING.
3. MAXIMUM OD = T/4 OR S - 1/2".
4. PLACE CONDUIT UNDER SLAB AND ENCASE IN CONCRETE WHERE OD GREATER THAN T/4 OR S - 1/2".
5. PROVIDE PVC OR PVC COATED CONDUITS WHERE IN CONTACT WITH REINFORCING.

EMBEDDED RACEWAYS
SLAB ON GRADE
DETAIL (E2202)
SCALE: NONE



**Brown AND
Caldwell**

SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

[illegible]

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRENCHLEY

FILENAME

E-004.dwg

PROJECT NUMBER
157500

157520
CLIENT PROJECT NUMBER

ELECTRICAL





STANDARD DETAILS

DRAWING NUMBER


E-004

99

SHEET NUMBER
OF

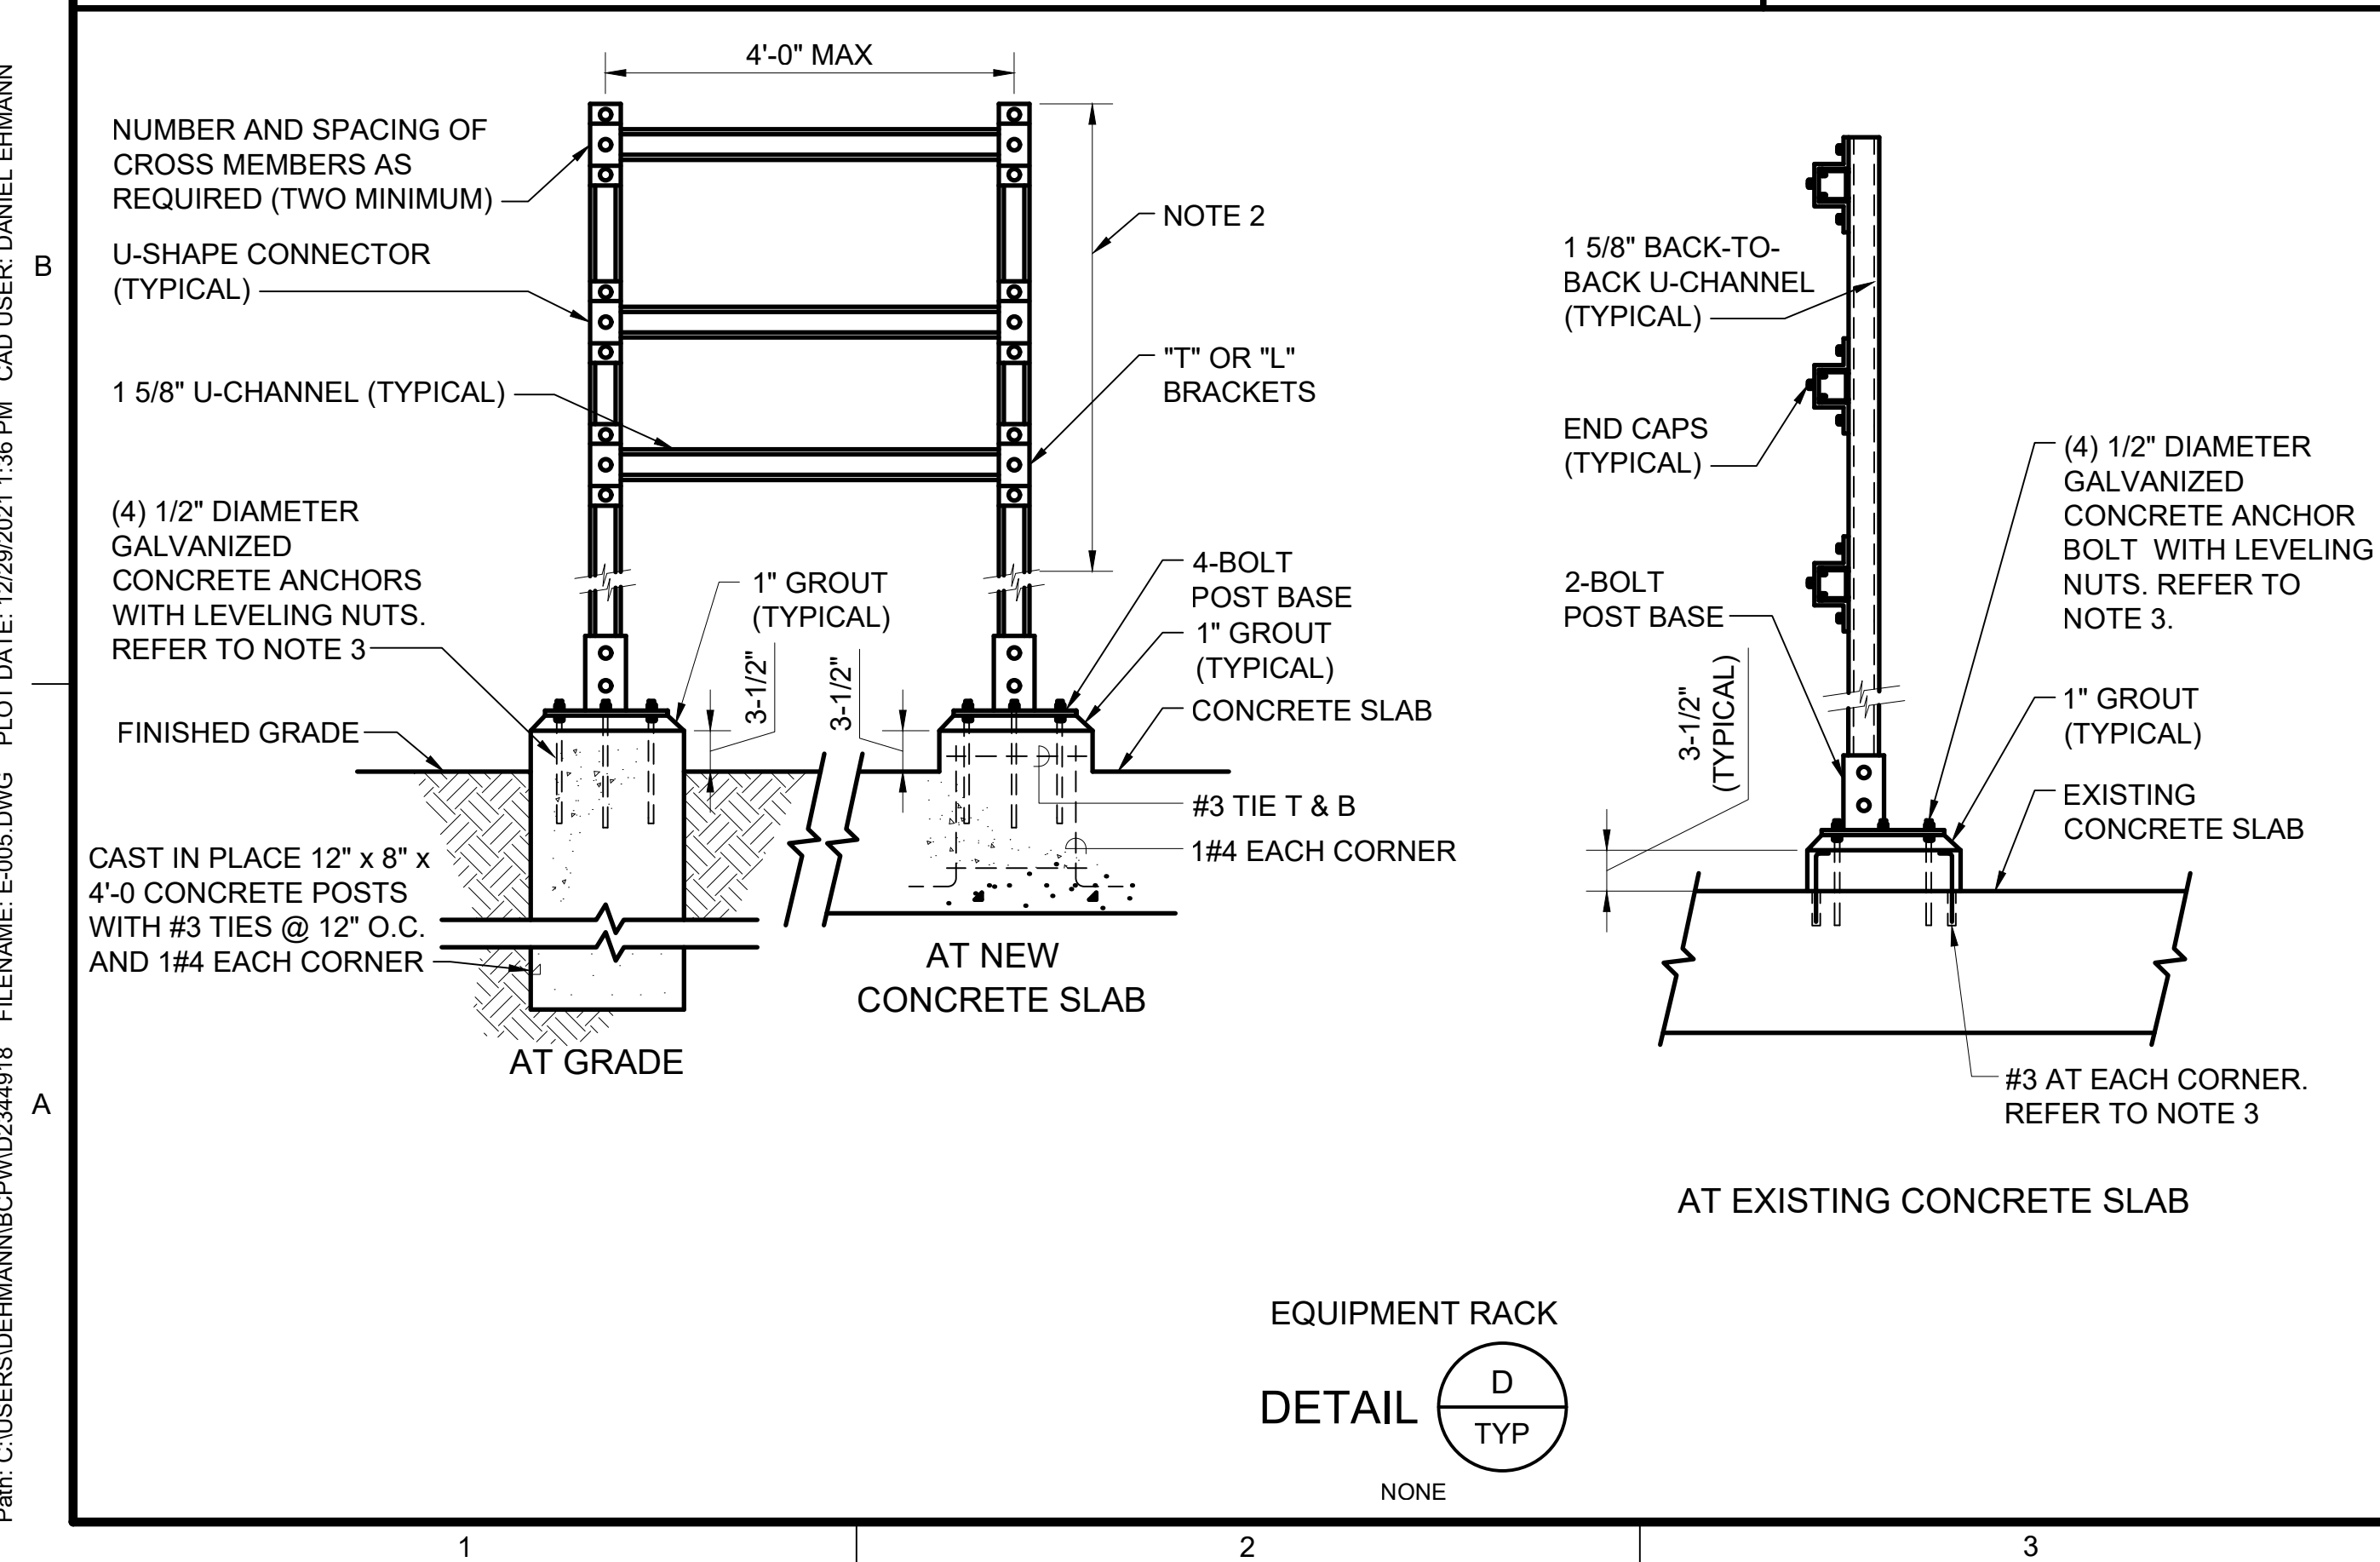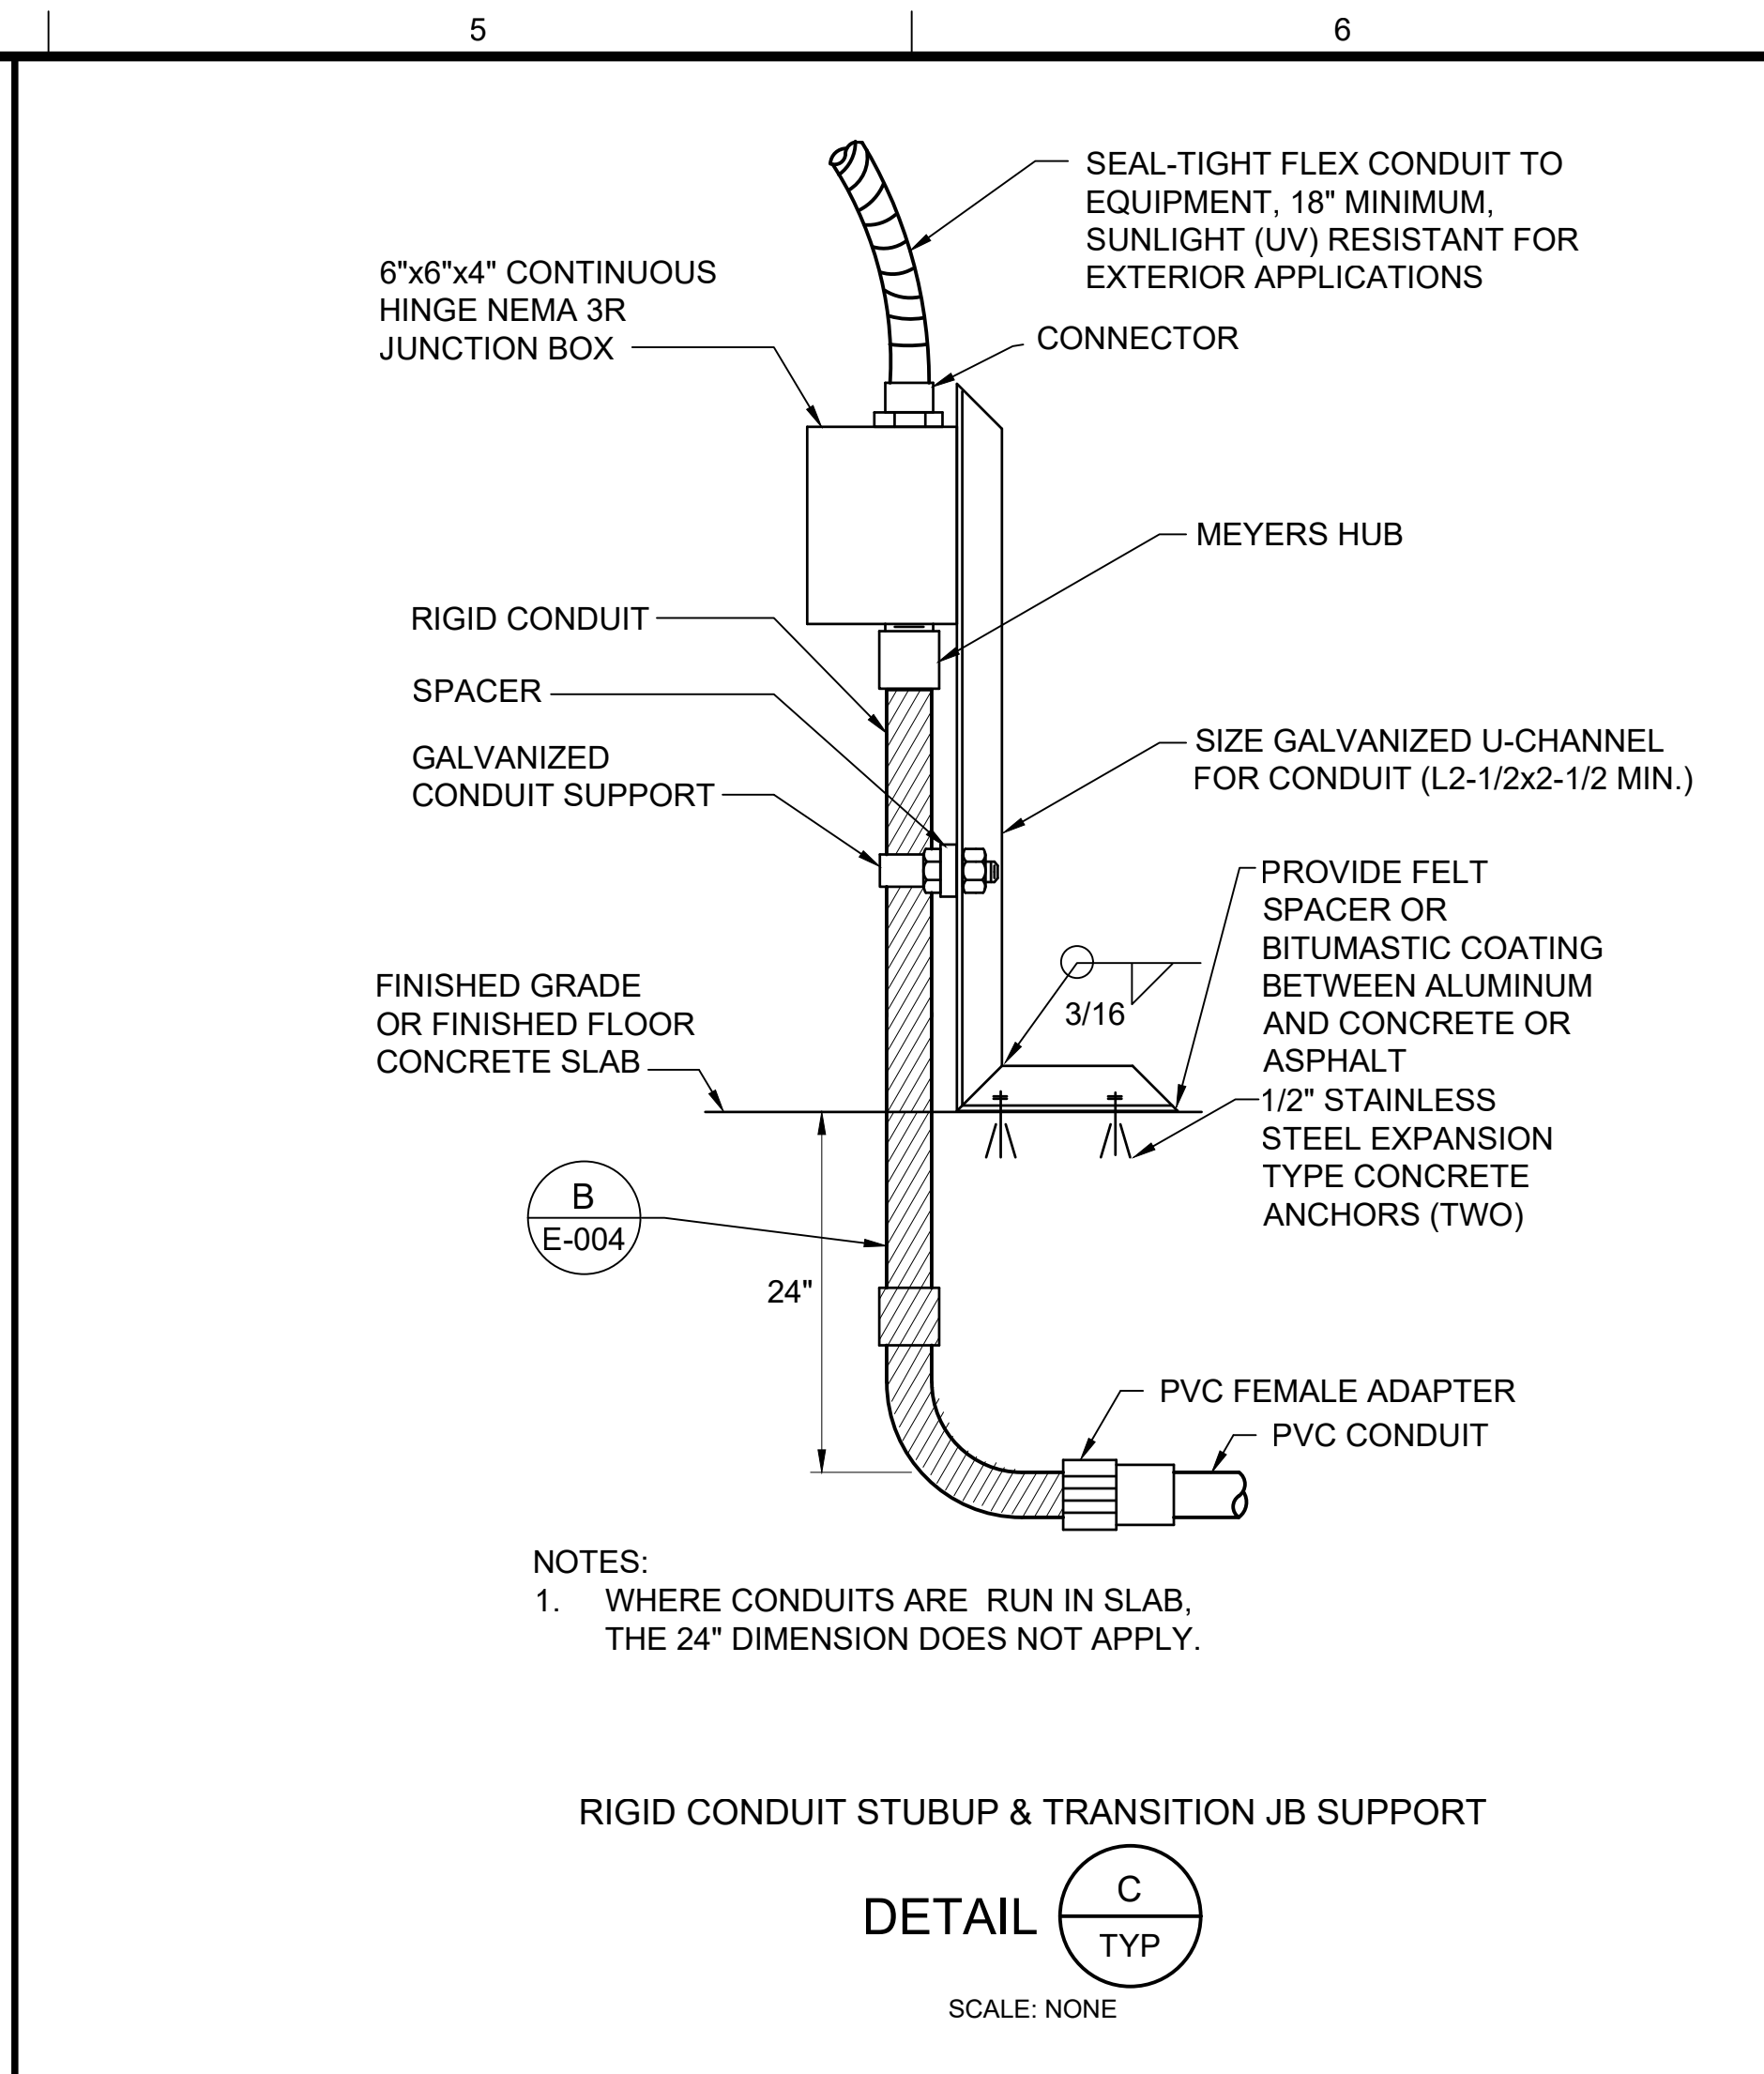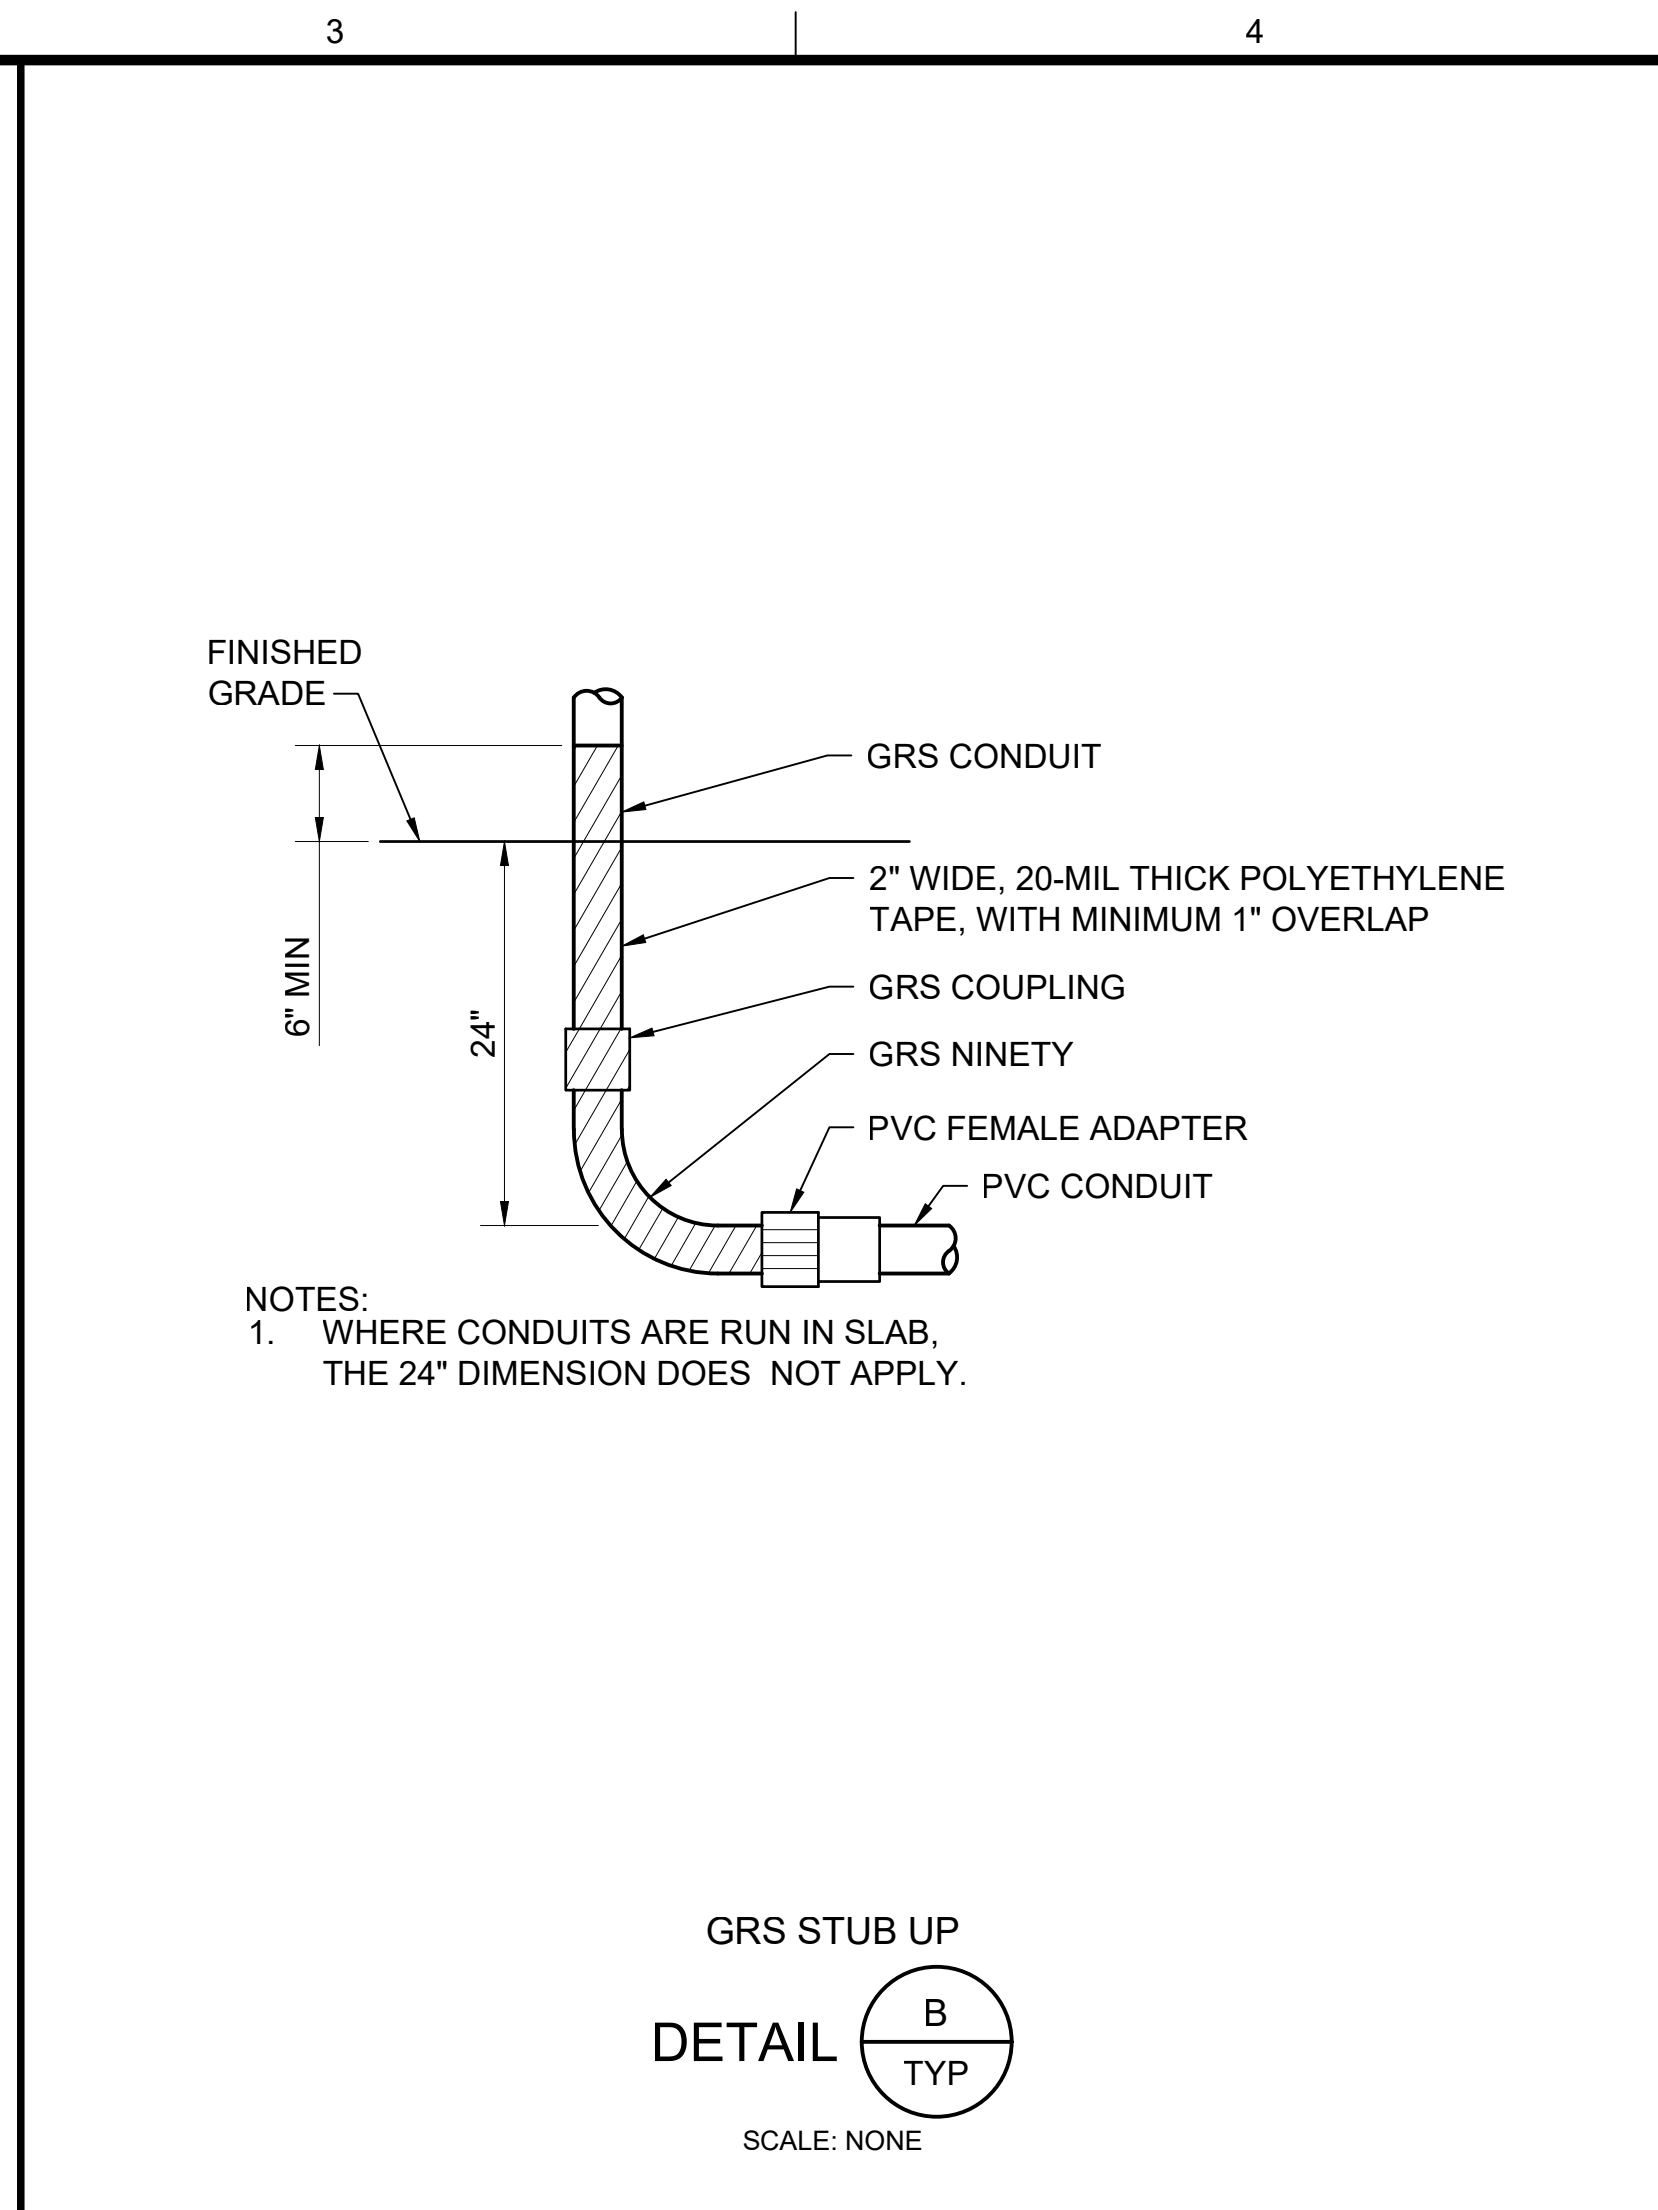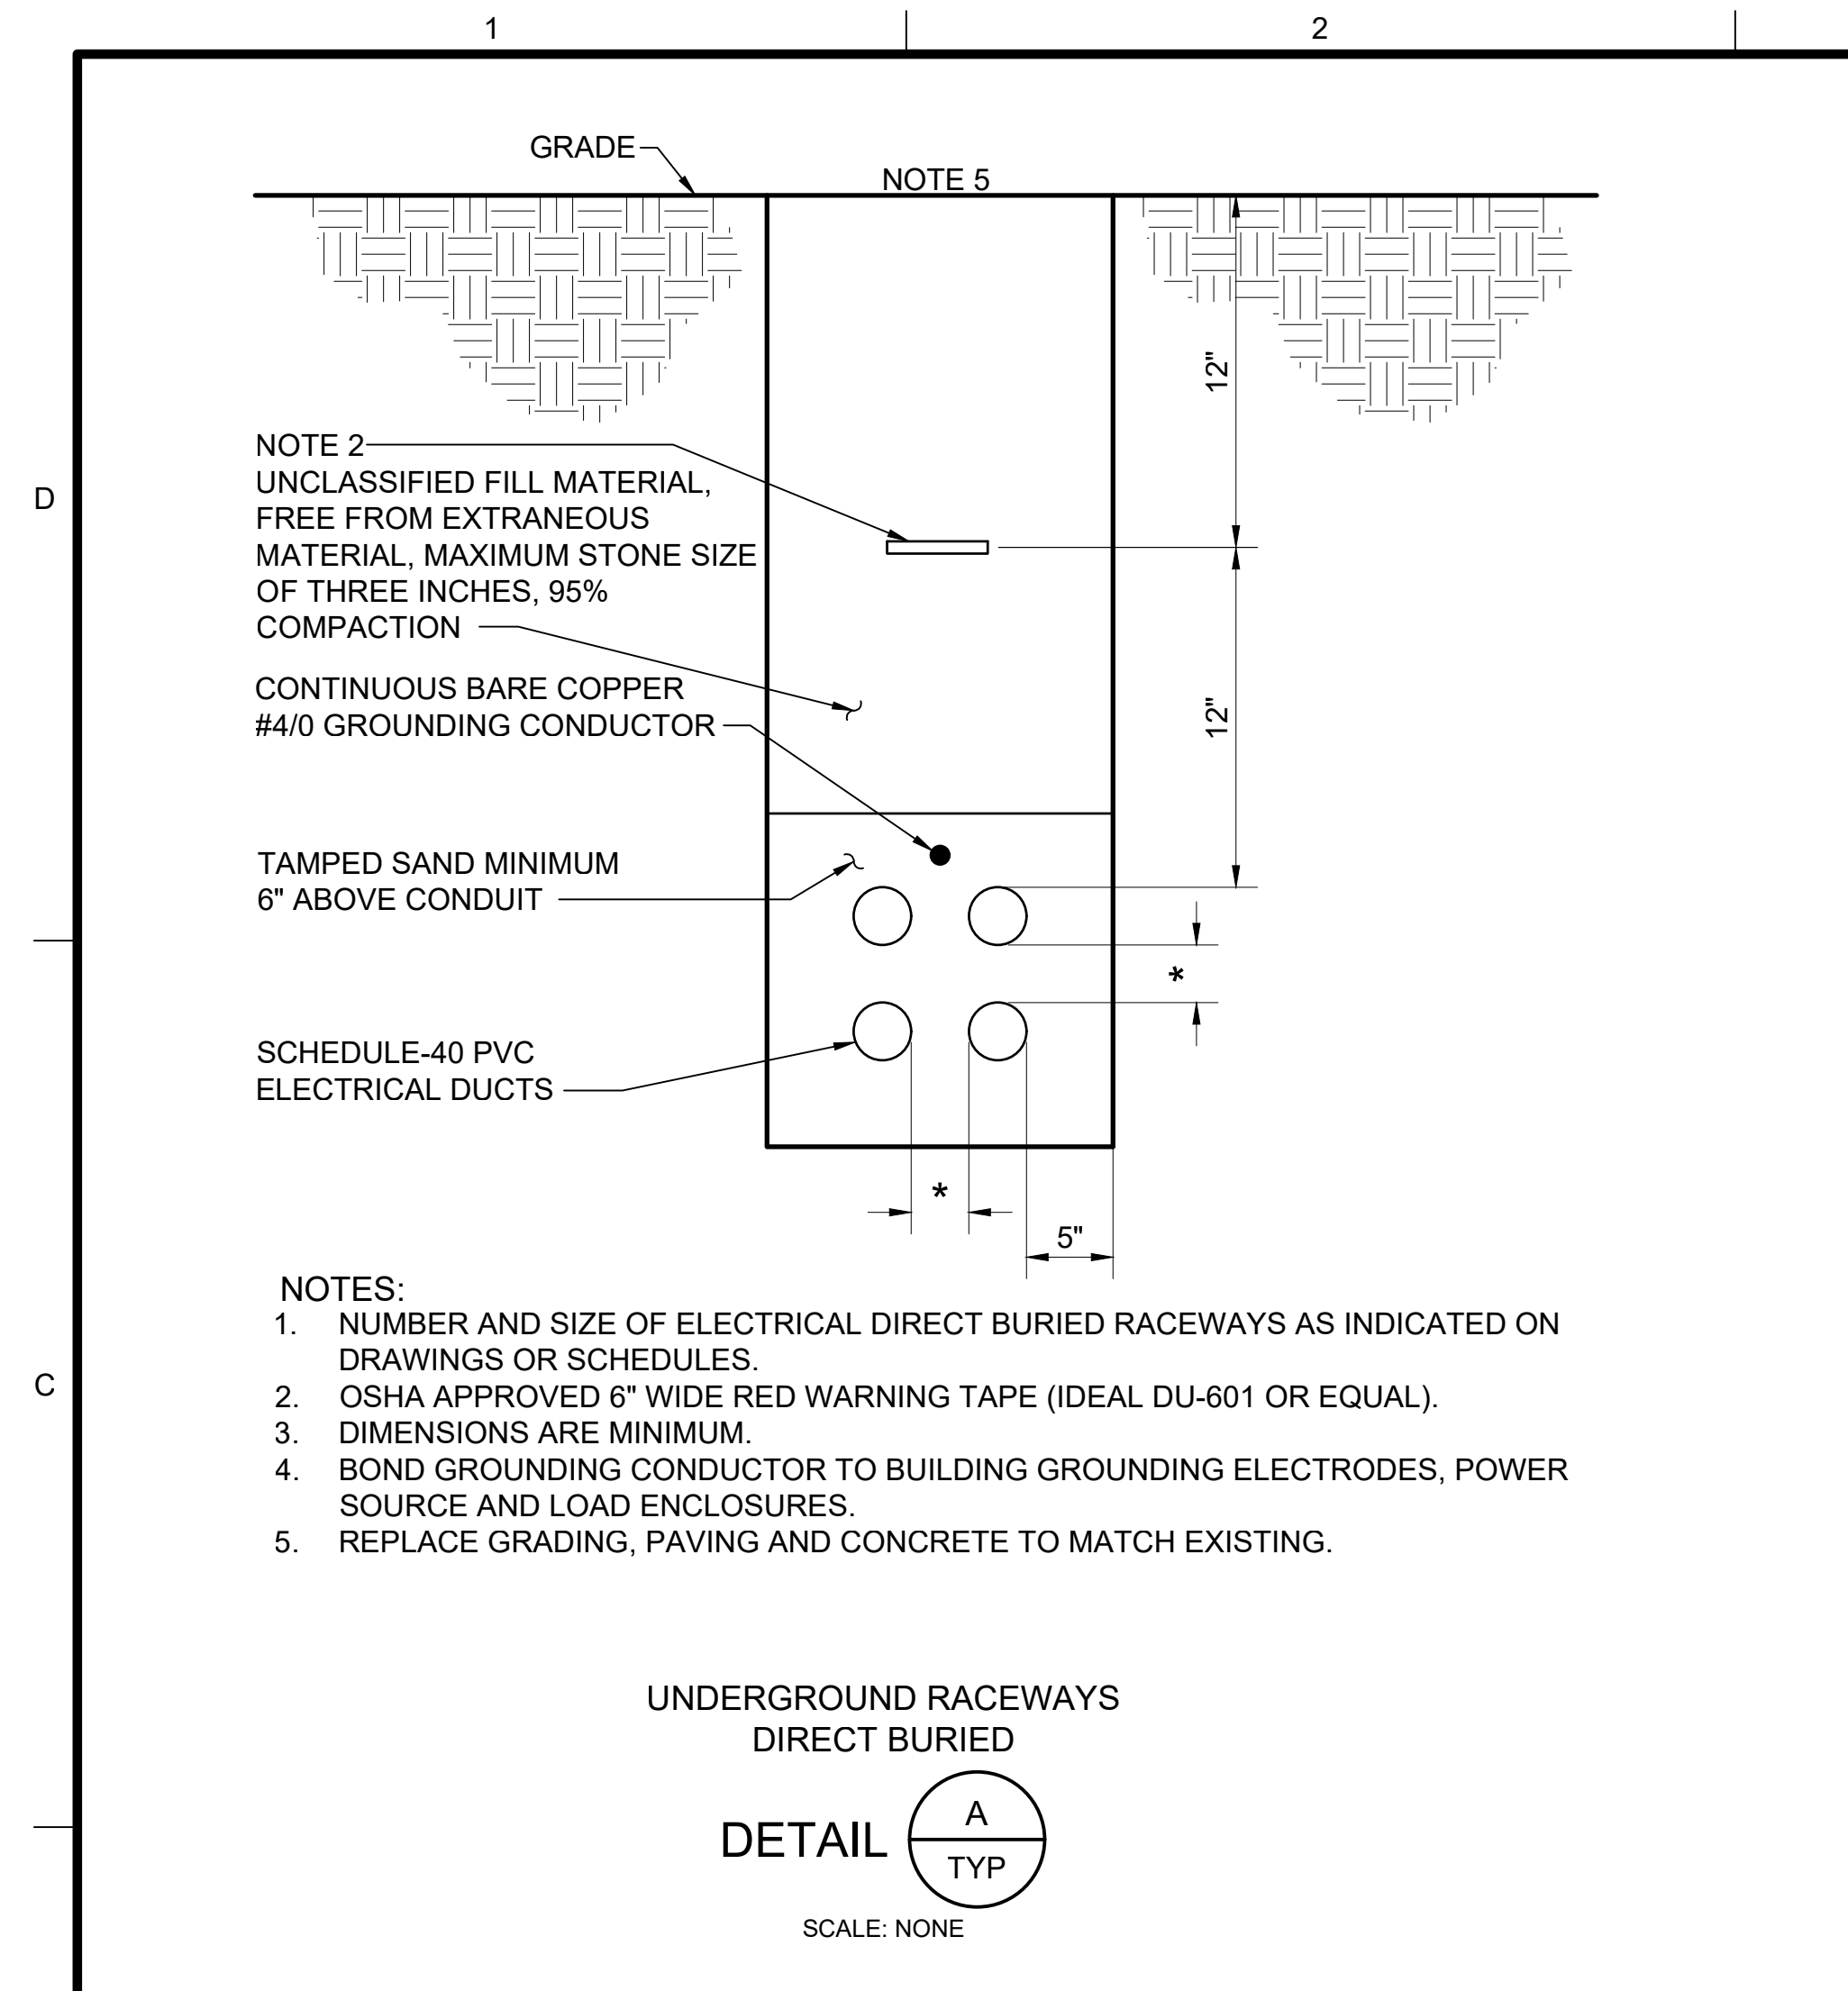

- ## NOTES:
1. EQUIPMENT RACK SIZING:
 - A. ONE ITEM GREATER THAN 150 SQUARE INCHES.
 - B. TWO EQUIPMENT ITEMS GREATER THAN 130 SQUARE INCHES.
 - C. THREE OR MORE EQUIPMENT ITEMS.
 - D. PROVIDE GALVANIZED CHANNEL END-CAPS, AND FITTINGS
 - E. PROVIDE 1/4" MINIMUM ALUMINUM PLATE FOR SMALL ITEMS
 2. MOUNT INDICATORS OR EQUIPMENT OPERATING HANDLES FOUR FEET ABOVE FLOOR OR PLATFORM.
 3. REFER TO STRUCTURAL DRAWINGS AND SPECIFICATION FOR ANCHORAGE MATERIAL AND METHOD REQUIREMENTS.
 4. MATERIAL AND HARDWARE PER SPECIFICATION DIVISION 16.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

[illegible]

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRENCHLEY

FILENAME

E-005.dwg

BC PROJECT NUMBER
157520

CLIENT PROJECT NUMBER

ELECTRICAL


STANDARD DETAILS

DRAWING NUMBER


E-005

100	SHEET NUMBER OF	113
-----	--------------------	-----

Path: C:\USERS\DEHMANN\PCP\WD2344918 FILENAME: E-100.DWG PLOT DATE: 1/6/2022 3:16 PM CAD USER: DANIEL EHMANN

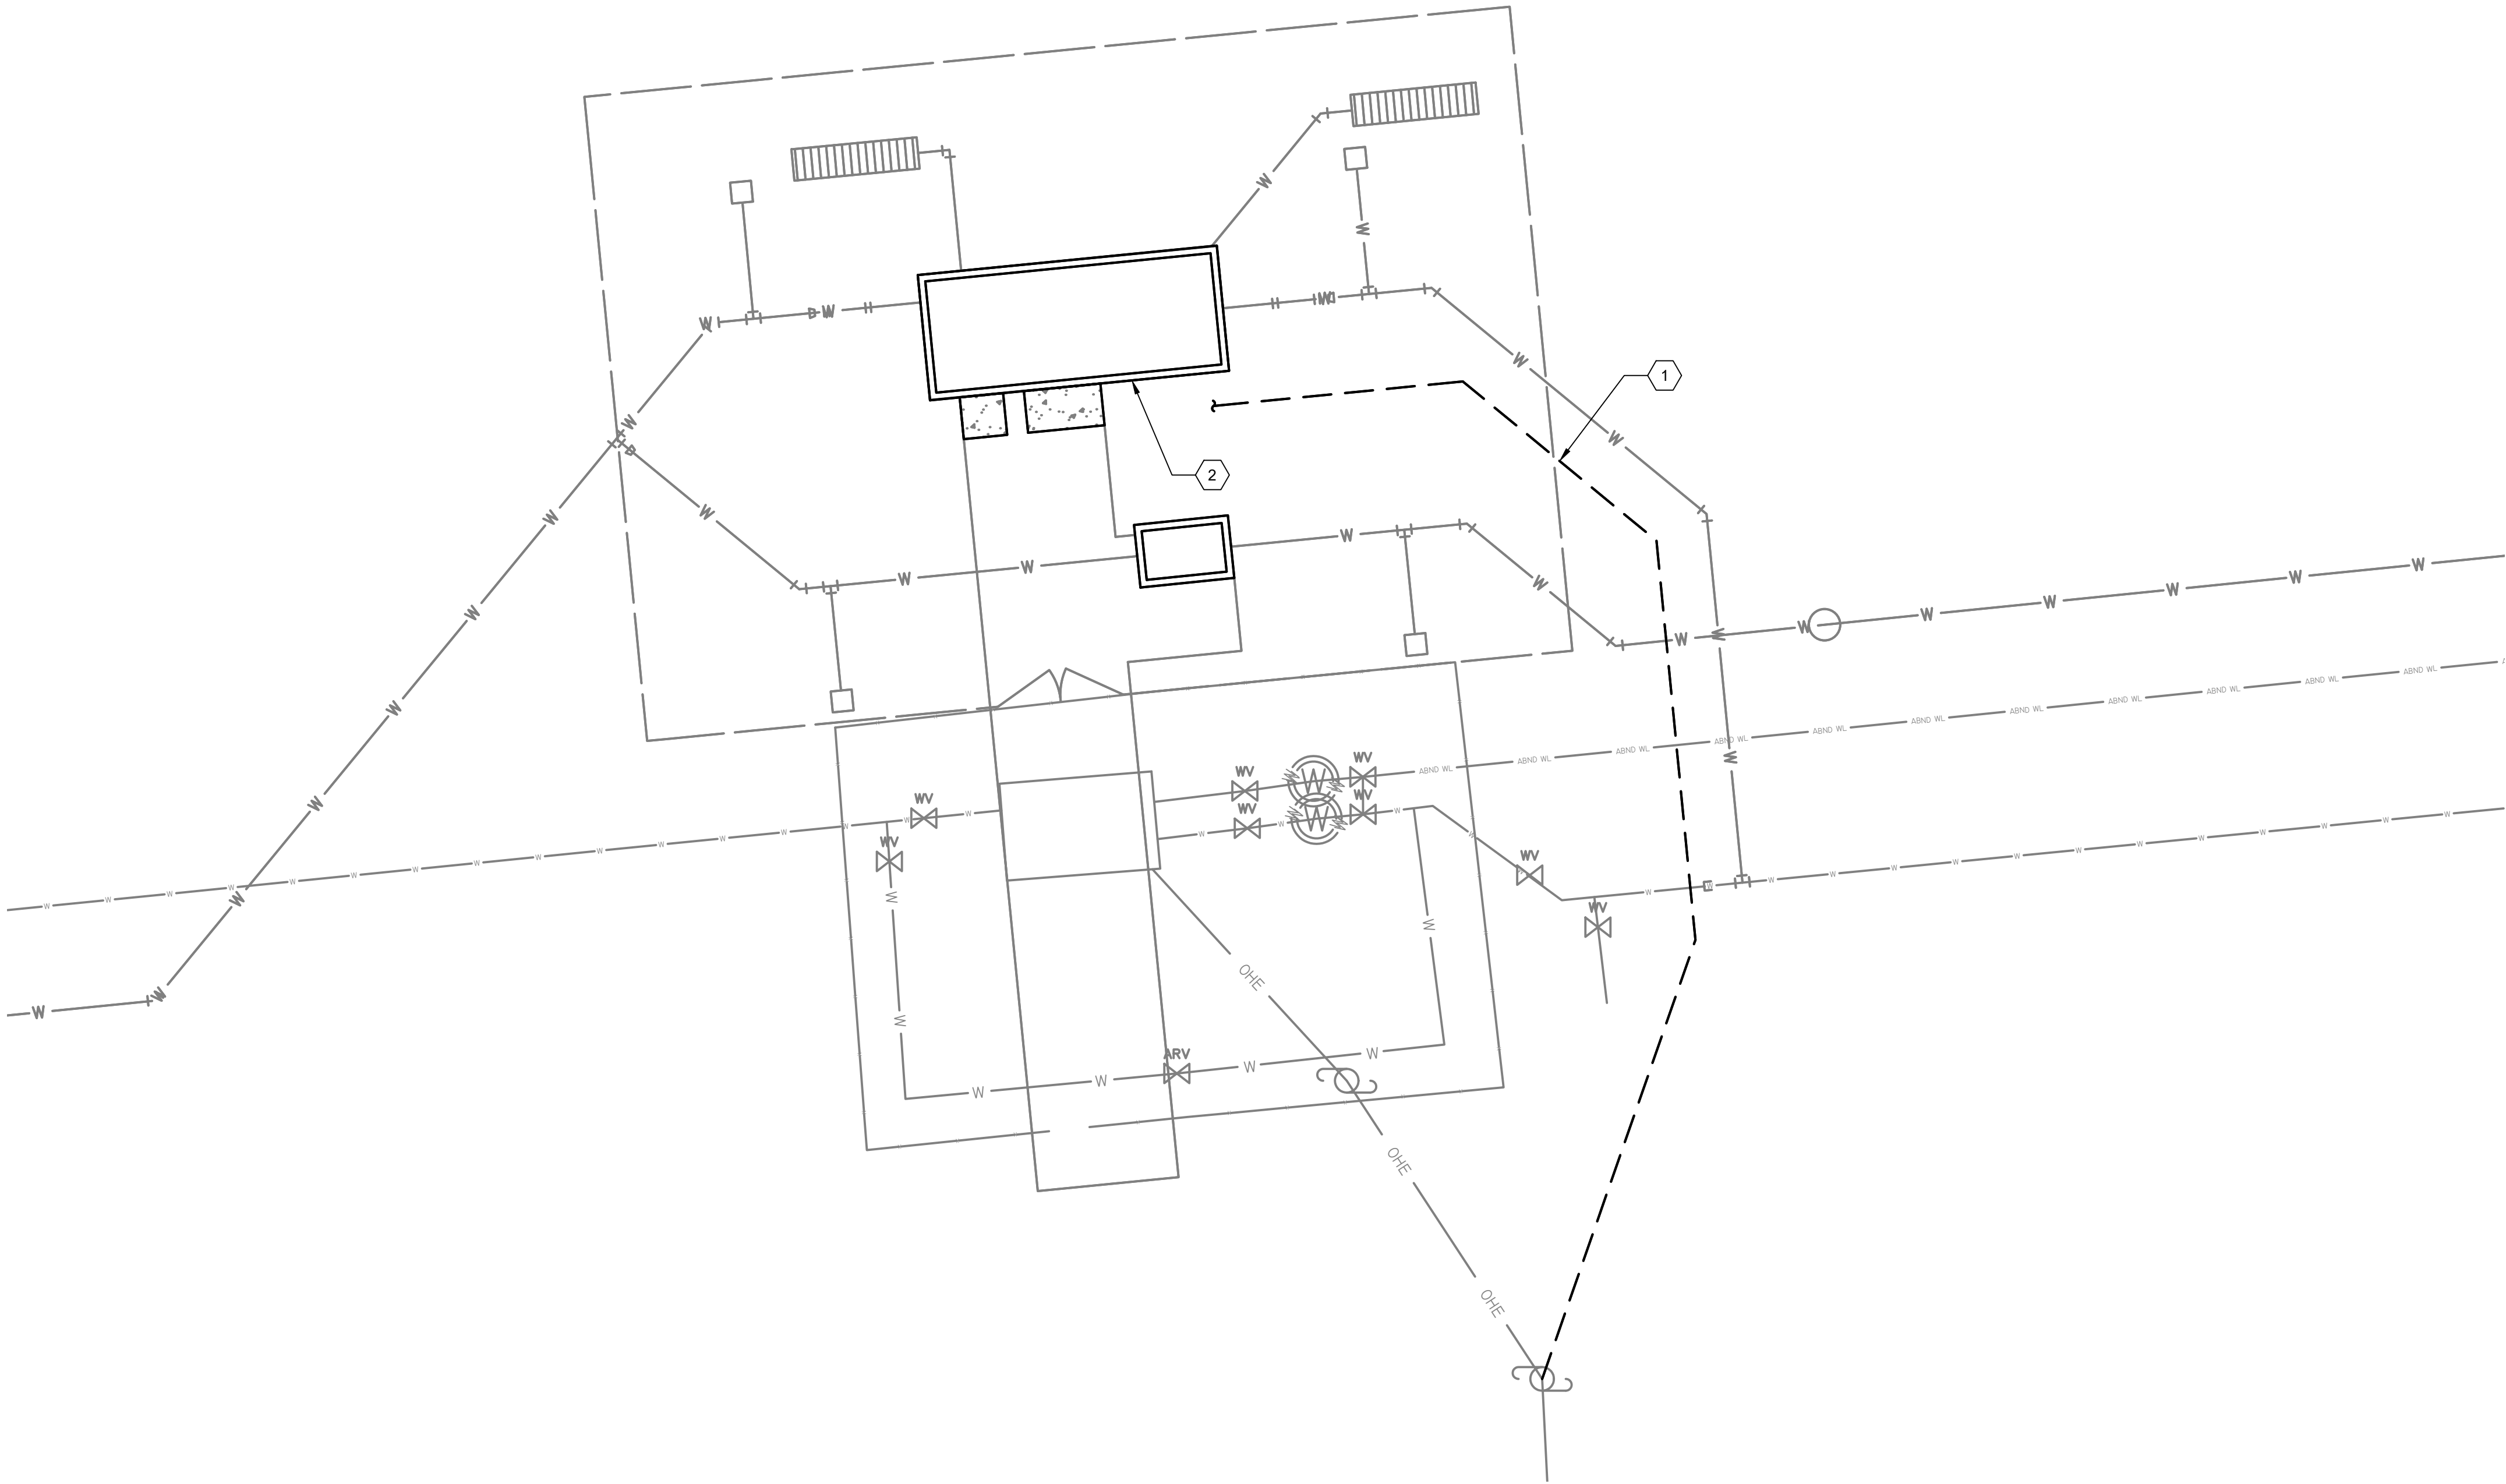

PLAN
SCALE: 3/32" = 1'-0"

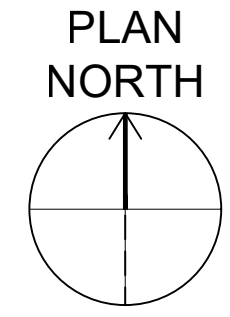

GENERAL NOTES

1. PROVIDE ELECTRICAL, INSTRUMENTATION, AND TELEMETRY SYSTEM.
2. POWER UTILITY: NAVAJO TRIBAL UTILITY AUTHORITY (NTUA), (928) 729-5721.

KEY NOTES

1. UNDERGROUND CIRCUITS BY OTHERS PER DRAWING E-102, POWER UTILITY REQUIREMENTS TO PREVAIL.
2. PROVIDE SERVICE ENTRANCE SECTION METER, ARRESTOR ON OUTSIDE OF BUILDING.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRENCHEY

FILENAME

E-100.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

ELECTRICAL

DILKON PASS PUMP STATION SITE PLAN

DRAWING NUMBER

E-100

101

SHEET NUMBER OF

60

Call at least two full working days before you begin excavation.

ARIZONA 811
Arizona Blue Stake, Inc.

Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
In Maricopa County: (602) 263-1100

DILKON PASS PUMP STATION			
LOAD SUMMARY AT 480 VAC			
LOAD DESCRIPTION	KVA	HP	480 VAC FLA
BOOSTER PUMP 1 VFD		25	34
BOOSTER PUMP 2 VFD		25	34
BOOSTER PUMP 3 VFD		25	
TRANSFORMER FOR PANEL-A	15		31.3
SUBTOTAL:	15	75	99.3
PLUS 25%:			9
AMPERE TOTAL:			107.8

1. GENERAL REQUIREMENTS: SPECIFICATION 16000.
2. TESTING: SPECIFICATION 16030.
3. ARC FLASH HAZARD ANALYSIS AND LABELING: SPECIFICATION 16431.
4. CIRCUITS: DRAWING E-102.
5. SCHEDULE AND COORDINATE WORK TO MINIMIZE WATER SYSTEM CONTROL OUTAGES. REFER TO SPECIFICATION 01014 AND 17900.
6. SUBMIT ELECTRICAL EQUIPMENT LAYOUT PRIOR TO CONDUIT ROUGH-IN.

1. SERVICE ENTRANCE SECTION
2. MAIN DISCONNECT SWITCH
3. PUMP MANAGEMENT UNIT
4. PUMP 1
5. PUMP 2
6. PUMP 3
7. SUCTION LEVEL SWITCH
8. DISCHARGE PRESSURE SWITCH
9. LOAD CENTER DISCONNECT SWITCH
10. FLOW METER
11. FLOW INDICATOR
12. TELEMETRY PLC
13. TRANSFORMER AND LOAD CENTER
14. TELEMETRY ANTENNA ON 2" x 20'-0" PIPE, ANCHORED TO BUILDING. ALIGN TO DILKON PASS TANK SITE. PROVIDE ANTENNA CABLE IN CONDUIT. PROVIDE CGB FITTING AND EXPOSE LOOP OF CABLE FOR FINAL CONNECTION TO ANTENNA. MAKE PENETRATION TO BUILDING WATER TIGHT.
15. HEATER
16. FLOW AMI UNIT
17. FAN, DRAWING H-101
18. MOTORIZED DAMPER
19. DOOR SWITCH
20. THERMOSTAT
21. CHLORINE LEAK DETECTOR. LOCATE SENSOR BELOW AT HEIGHT PER MANUFACTURER. MOUNT BEACON ABOVE.
22. AIR TEMPERATURE SENSOR/SWITCH
23. SUCTION PRESSURE TRANSDUCER
24. DISCHARGE PRESSURE TRANSDUCER
25. CHLORINATOR CONTROLLER

SALT LAKE CITY, UT

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

[illegible]

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRENCHLEY

FILENAME

E-101.dwg
DO PROJECT NAME

BC PROJECT NO.
157520

CLIENT PROJECT


ELECTRICAL

DILKON PASS PUMP STATION PLAN

DRAWING NUMBER

E-101

102	SHEET NUMBER OF	60
-----	--------------------	----

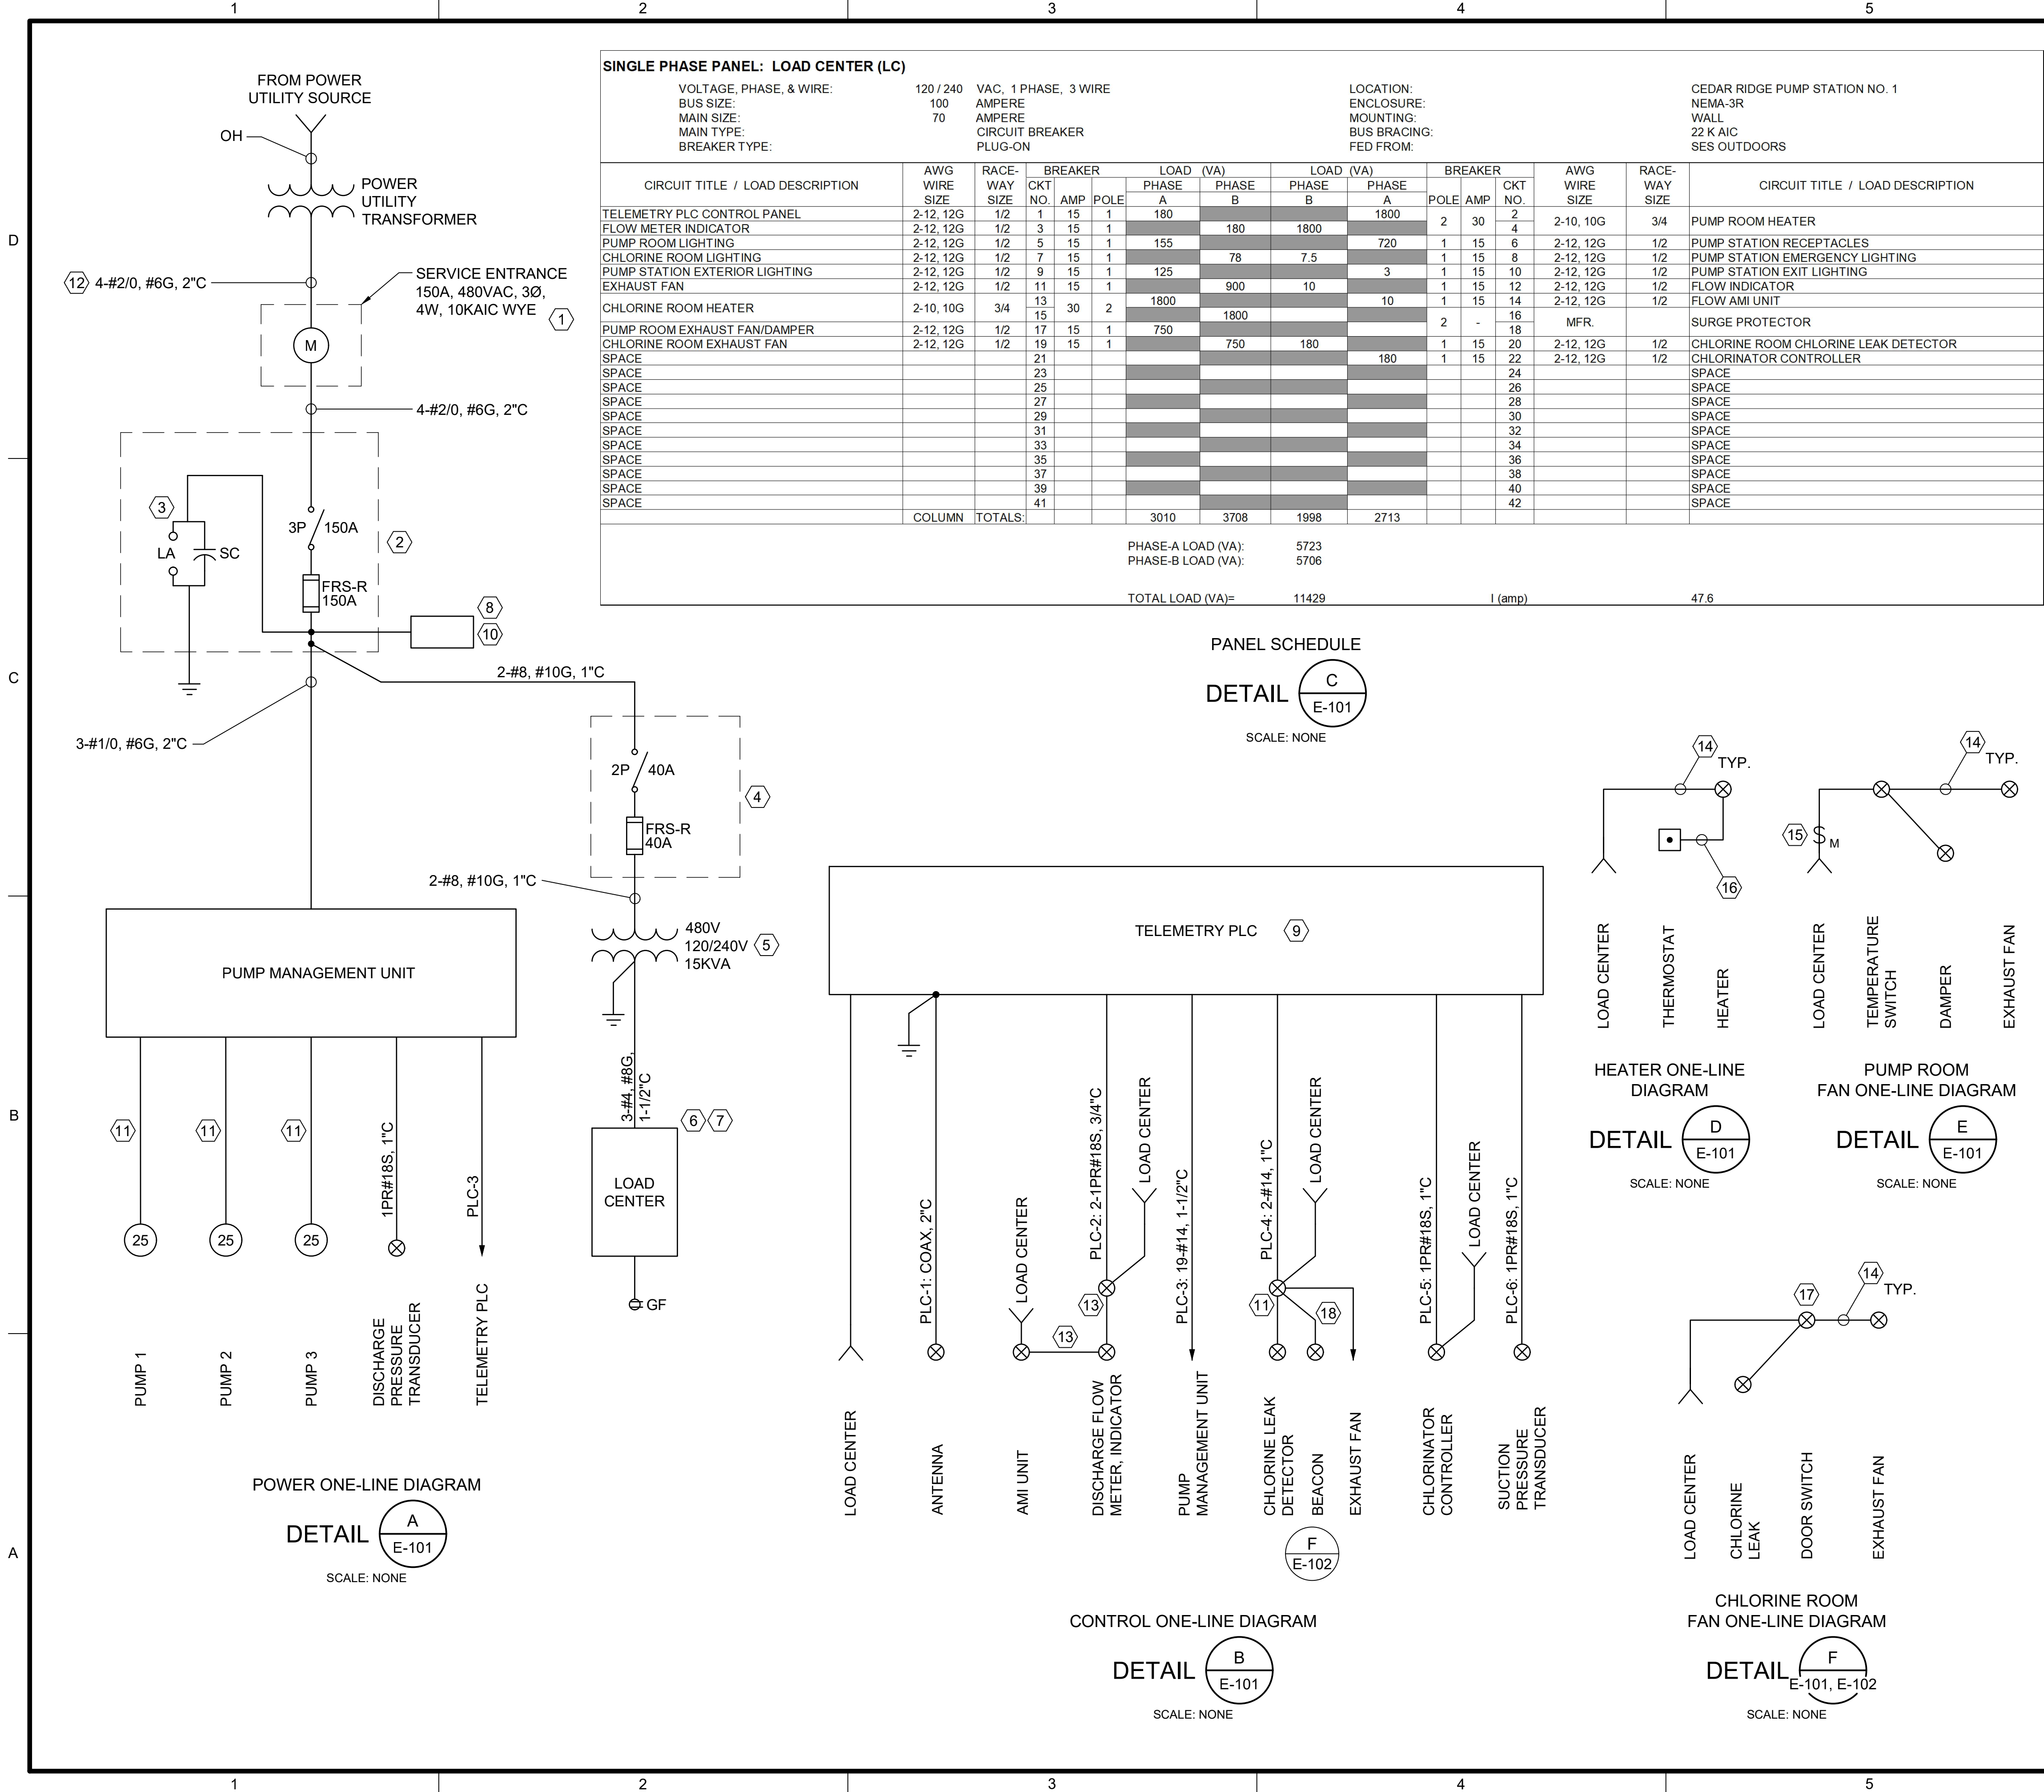

GENERAL NOTES

- POWER UTILITY: NAVAJO TRIBAL UTILITY AUTHORITY.
- GENERAL REQUIREMENTS: SPECIFICATION 16000.
- TESTING: SPECIFICATION 16030.
- ARC FLASH HAZARD ANALYSIS AND LABELING: SPECIFICATION 16431.
- SCHEDULE AND COORDINATE WORK TO MINIMIZE WATER SYSTEM CONTROL OUTAGES. REFER TO SPECIFICATION 01014 AND 17900.
- LOAD SUMMARY: DRAWING E-101.

KEY NOTES

- SERVICE ENTRANCE METER SOCKET, NEMA 3R, EUSERC, TEST BLOCKS, SQUARE D.
- MAIN DISCONNECT SWITCH, HEAVY DUTY, NEMA 3R, CLASS R FUSE REJECTION KIT, SQUARE D.
- LIGHTNING ARRESTOR, DELTA LA603.
- LOAD CENTER DISCONNECT SWITCH, HEAVY DUTY, NEMA 3R SQUARE D MODEL QO.
- TRANSFORMER, TOTALLY ENCLOSED/ENCAPSULATED, 115 DEGREES C RISE, ACME T-2-53517-3S.
- LOAD CENTER, WITH GROUND BAR, NEMA 3R, SQUARE D QO16M100RB.
- SURGE PROTECTIVE DEVICE, BUS CONNECTED, UL 1449 TYPE 2, 22.5KA SURGE, 1 PHASE 3-WIRE, SQUARE D QO2175SB.
- SURGE PROTECTIVE DEVICE, UL 1449 TYPE 1, 40KA SURGE, 3 PHASE 4-WIRE, SQUARE D SDSA3650.
- PROVIDE PER NTUA - TECHNICAL PROVISIONS 4.0 FOR MOTOR CONTROL CENTER AND TANK CONTROL PANEL - PLC CONTROL PANEL, INPUT/OUTPUT WIRING FOR GRUNDFOS BOOSTER PAQ.
- SPD, WIRE SIZE PER MANUFACTURER, 1-1/4"C
- CABLE PER MANUFACTURER, 1"C
- POWER UTILITY REQUIREMENTS FOR CONDUIT AND BURIAL PREVAIL IF DIFFERENT THAN SPECIFIED.
- 1PR #18S, 1/2" C
- FAN CIRCUITS, 2-#12, #12G, 1/2"C
- MANUAL STARTER: SPECIFICATION 16000
- CABLE PER MANUFACTURER, 3/4"C
- DOOR SWITCH, ROCKER/ROLLER, NEMA 4X, 20 AMP, HONEYWELL, ALLEN-BRADLEY, OR EQUAL.
- 2-#14, #14G, 1/2"C



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRENCHLEY

FILENAME

E-102.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

ELECTRICAL

DILKON PASS PUMP STATION ONE-LINE DIAGRAM

DRAWING NUMBER

E-102

103



SHEET NUMBER OF

60

Path: C:\USERS\DEHMANN\BCPWD\2344918 FILENAME: E-110.DWG PLOT DATE: 12/29/2021 1:36 PM CAD USER: DANIEL EHMANN



DILKON PASS TANK
PLAN
SCALE: 1" = 100'-0"

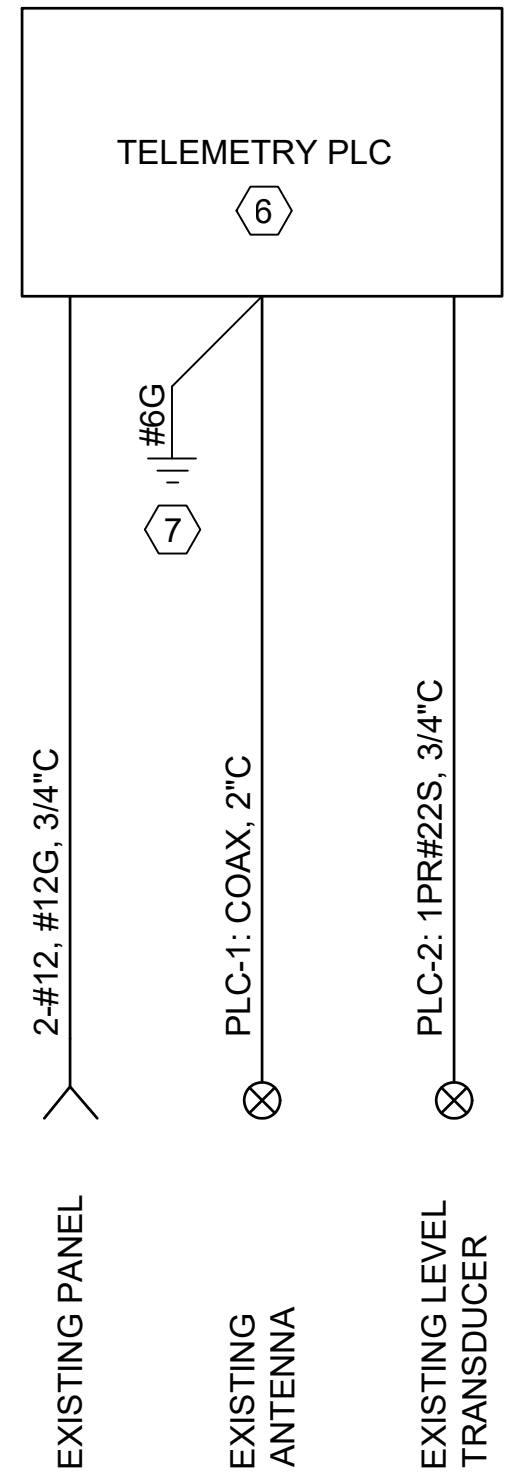

CONTROL ONE-LINE DIAGRAM
DETAIL
SCALE: NONE

GENERAL NOTES

1. PROVIDE ELECTRICAL, INSTRUMENTATION, AND TELEMETRY EQUIPMENT.
2. GENERAL REQUIREMENTS: SPECIFICATION 16000.
3. TESTING: SPECIFICATION 16030.
4. SCHEDULE AND COORDINATE WORK TO MINIMIZE WATER SYSTEM CONTROL OUTAGES. REFER TO SPECIFICATION 01014 AND 17900.

KEY NOTES

1. EXISTING PANEL
2. EXISTING OVERHEAD SERVICE LINE AND POWER POLE.
3. TANK LEVEL (PRESSURE) TRANSDUCER IN VAULT.
4. PROVIDE TELEMETRY PLC
5. RETAIN EXISTING ANTENNA AND TRANSMISSION LINE
6. PROVIDE PER NTUA - TECHNICAL PROVISIONS 4.0 FOR MOTOR CONTROL CENTER AND TANK CONTROL PANEL - AC TANK PANEL.
7. PROVIDE 10 FOOT COPPER GROUND ROD DRIVEN IN EARTH. PROVIDE #6 BOND TO EXISTING GROUND SYSTEM.



SALT LAKE CITY, UT

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS
PIPELINE AND
PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: K. CHANDLER

DRAWN: D. EHMANN

CHECKED: H. PACE

CHECKED: ---

APPROVED: S. BRENCHELY

FILENAME

E-110.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

ELECTRICAL

DILKON PASS
STORAGE TANK
SITE PLAN

DRAWING NUMBER

E-110

104

SHEET NUMBER
OF

113

Path: P:\2021\21161 DILKON PASS BPS & PIPELINE\DRAWINGS FILENAME: M 21161 DILKON PASS BPS & PIPELINE.DWG PLOT DATE: 1/11/2022 10:28 AM CAD USER: ETHAN RIGBY

MECHANICAL LEGEND					
SYMBOL	ABR.	DESCRIPTION	SYMBOL	ABR.	DESCRIPTION
GENERAL TERMINOLOGY			AIR SIDE		WET SIDE
		DETAIL NUMBER DESIGNATION CORRESPONDING WITH GRID LOCATION			EXISTING AIR DUCT TO BE REMOVED
					EXISTING AIR DUCT TO REMAIN
		MECHANICAL EQUIPMENT DESIGNATION EQUIPMENT ITEM DESIGNATION			NEW AIR DUCT
					NEW SPIRAL DUCT
		REGISTER, GRILL OR DIFFUSER DESIGNATION WITH BALANCING CFM LISTED BELOW			NEW MEDIUM PRESSURE DUCT
					BURIED OR UNDER FLOOR DUCT
		GRILLE, OR LOUVER DESIGNATION WHERE BALANCING NOT REQUIRE			FLEXIBLE AIR DUCT
					LINED DUCT
		REVISION DESIGNATOR AND NUMBER			VANED ELBOW
		KEY NOTE DESIGNATOR AND NUMBER			RADIUS ELBOW
	POC	POINT OF CONNECTION			FLEXIBLE AIR DUCT CONNECTION
	POR	POINT OF REMOVAL			VOLUME DAMPER
GC		GENERAL CONTRACTOR			SUPPLY AIR DIFFUSER
MC		MECHANICAL CONTRACTOR			RETURN AIR, FRESH AIR, AND TRANSFER AIR
ATC		CONTROL CONTRACTOR			CEILING MOUNTED EXHAUST FAN OR EXHAUST GRILLE
EC		ELECTRICAL CONTRACTOR			RETURN OR OUTSIDE AIR DUCT UP
FPC		FIRE PROTECTION CONTROL			SUPPLY DUCT UP
NIC		NOT IN CONTRACT			EXHAUST AIR INTAKE UP
NTS		NOT TO SCALE			RETURN OR OUTSIDE AIR DUCT DOWN
C		COMMON			SUPPLY DUCT DOWN
NC		NORMALLY CLOSED			EXHAUST DUCT DOWN
NO		NORMALLY OPEN			ROUND DUCT UP
					ROUND DUCT DOWN
				AP	ACCESS PANEL
					EXISTING EQUIPMENT TO BE REMOVED
					EXISTING EQUIPMENT TO REMAIN
					NEW EQUIPMENT

MECHANICAL GENERAL NOTES:	
GENERAL	
GM-1	THE MECHANICAL INSTALLATION SHALL CONFORM TO THE 2018 EDITION OF THE IMC WITH UTAH ANNOTATIONS AND LOCAL AUTHORITY REQUIREMENTS.
GM-2	MECHANICAL INFORMATION IS NOT LIMITED TO THE MECHANICAL DRAWINGS. CONTRACTOR SHALL BE RESPONSIBLE FOR INFORMATION ON ALL OTHER CONSTRUCTION DOCUMENTS INCLUDING DRAWINGS BY OTHER DISCIPLINES AND SPECIFICATIONS.
GM-3	A - EACH DRAWING SHEET HAS BEEN PREPARED TO SUPPLEMENT EACH OTHER AND THEY SHALL BE INTERPRETED AS AN INTEGRAL UNIT WITH ITEMS SHOWN AND NOTED ON ONE AND NOT THE OTHER BEING FURNISHED AND INSTALLED AS THOUGH SHOWN AND CALLED OUT IN ALL PLACES. B - THE CONTRACTOR WILL BE HELD RESPONSIBLE FOR THE INSTALLATION OF THE SYSTEMS ACCORDING TO THE TRUE INTENT AND MEANING OF THE CONTRACT DOCUMENTS. C - THE CONTRACTOR SHALL INSTALL ALL EQUIPMENT WITH PROPER SERVICE ACCESS AND CLEARANCES ACCORDING TO MANUFACTURERS RECOMMENDATIONS. THE CONTRACTOR SHALL REVIEW SUPPLIERS BID PACKAGES FOR COMPLETENESS AND COMPLIANCE TO THE SPECIFICATIONS, SCHEDULES, AND DESIGN INTENT (ALL EQUIPMENT AND METHODS). THE CONTRACTOR SHALL REMOVE AND REINSTALL CORRECTLY AT HIS OWN EXPENSE ANY EQUIPMENT NOT IN COMPLIANCE. D - THE CONTRACTOR SHALL CONSULT MANUFACTURERS INSTALLATION INSTRUCTIONS FOR SIZES, METHODS, ACCESSORIES, AND CLEARANCES IN SPACE AVAILABLE PRIOR TO BIDDING PROJECT. E - ANYTHING NOT CLEAR OR IN CONFLICT WILL BE EXPLAINED BY MAKING APPLICATION TO THE ENGINEER IN WRITING.
GM-4	ANY AND ALL ALTERATIONS TO THE SYSTEM SHOWN SHALL BE THE RESPONSIBILITY OF THIS CONTRACTOR. ARCHITECT SHALL BE NOTIFIED IN WRITING PRIOR TO CHANGES.
GM-5	CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND LOCATIONS.
GM-6	THE WORKING DRAWINGS ARE DIAGRAMMATIC. THEY DO NOT SHOW EVERY OFFSET, BEND, OR ELBOW NECESSARY FOR THE COMPLETE INSTALLATION IN THE SPACE PROVIDED. ALL LOCATIONS FOR MECHANICAL EQUIPMENT SHALL BE FIELD VERIFIED AND COORDINATED WITH ALL DRAWINGS. THE CONTRACTOR SHALL PROVIDE OR COORDINATE WITH THE GENERAL CONTRACTOR PROVISIONS FOR BLOCK OUTS OR CORE DRILLS THROUGH STRUCTURE. CHANGES REQUIRED IN WORK SPECIFIED IN DIV 22 AND 23 CAUSED BY NEGLECT TO SECURE APPROVAL SHALL BE MADE AT NO COST TO THE OWNER.
GM-7	THE INSTRUCTION TO "PROVIDE" ALSO INCLUDES INSTALLATION.
GM-8	THE CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY IN HANDLING AND DISPOSING OF REFRIGERANTS, OILS, ETC. ALL SUCH MATERIALS SHALL BE HANDLED, DISPOSED, AND USED ON ACCORDANCE WITH ALL LOCAL, STATE, AND FEDERAL LAWS.
GM-9	THE MECHANICAL CONTRACTOR SHALL VERIFY MOTOR VOLTAGES WITH THE ELECTRICAL DRAWING PRIOR TO ORDERING MOTORIZED EQUIPMENT AND CONTROLS.
GM-10	SUPPLIERS SHALL REVIEW ALL DRAWINGS PRIOR TO SUBMITTING PRICES TO THE CONTRACTOR. ALL QUESTIONS AND DISCREPANCIES SHALL BE BROUGHT TO THE ENGINEERS ATTENTION PRIOR TO BIDDING.
GM-11	CONTRACTOR SHALL THOROUGHLY REVIEW AND SIGN SUBMITTALS FOR COMPLETENESS AND COMPLIANCE TO THE SPECIFICATIONS PRIOR TO ENGINEERS REVIEW. SUPPLIERS SHALL HIGHLIGHT OR MARK ALL INFORMATION REQUIRED TO SHOW COMPLIANCE TO THE SPECIFICATIONS. ALL REQUESTED EXCEPTIONS TO THE DRAWINGS, OR SCHEDULES SHALL BE CLEARLY NOTED AND EXPLAINED. SUBMITTAL REVIEW AND ACCEPTANCE IS FOR DESIGN CONCEPT ONLY, AND DOES NOT AT ANY TIME RELIEVE THE CONTRACTOR OF RESPONSIBILITY TO MEET SPECIFICATIONS, CAPACITIES, OR DESIGN INTENT.
GM-12	INSTALLATION AND SELECTION OF MATERIALS AND EQUIPMENT SHALL ADHERE TO THE REQUIREMENTS OF ASHRAE/IEES 90.1-2016 ENERGY EFFICIENT DESIGN OF NEW BUILDINGS EXCEPT LOW RISE AND ENFORCED BY THE LAWS OF THE STATE OF UTAH AND THE LOCAL AUTHORITY HAVING JURISDICTION.
GM-13	PROVIDE OPERATION AND MAINTENANCE (O&M) MANUALS TO THE OWNER. SUBMIT TO ENGINEER ELECTRONICALLY FOR REVIEW AND COMPLETENESS. THIS SHALL INCLUDE MINIMUM 1 YEAR LABOR WARRANTY, ORGANIZED APPROVED SUBMITTALS, O&M DOCUMENTS FOR ALL EQUIPMENT, CONTROLS DIAGRAMS, SEQUENCE OF OPERATIONS, TAB REPORT, ETC. DOCUMENT SHALL BE AN ORGANIZED AND BOOKMARKED PDF.

GM-14	CONTRACTOR SHALL KEEP AN UP TO DATE SET OF MECHANICAL AND PLUMBING DRAWINGS IN HIS CUSTODY SHOWING ALL CHANGES IN RED, CLEARLY DEFINED AND NEATLY DRAFTED BY HIM. AT THE END OF CONSTRUCTION, HE SHALL TURN THESE DRAWINGS OVER TO THE ENGINEER. RECORD DRAWINGS MUST BE COMPLETED AND SUBMITTED PRIOR TO FINAL SITE OBSERVATION.
GM-15	PROVIDE TAGS AND LABELS ON NEW PIPING, DUCTWORK, AND EQUIPMENT. EQUIPMENT TAGS SHALL BE METAL WITH DATA ENGRAVED OR STAMPED FOR PERMANENT ATTACHED ON EQUIPMENT AND SHALL INCLUDE MANUFACTURER, PRODUCT NAME, MODEL NUMBER, SERIAL NUMBER, CAPACITY, OPERATING AND POWER CHARACTERISTICS, AND ESSENTIAL DATA. THESE SHALL BE LOCATED IN AN ACCESSIBLE AND VISIBLE LOCATION. PIPING MARKERS SHALL BE COLOR CODED WITH LETTERING INDICATING SERVICE AND FLOW DIRECTION. DUCT LABELS SHALL BE LOCATED WHERE DUCTS ENTER INTO CONCEALED SPACES AND A MAXIMUM INTERVAL OF 50 FEET IN EXPOSED OR ACCESSIBLE CEILINGS. THESE SHALL INDICATE SERVICE AND FLOW DIRECTION.
GM-16	SEE STRUCTURAL PLANS FOR OFFICIAL SEISMIC AND WIND CLASSIFICATIONS. PROVIDE SEISMIC CALCULATIONS AND DESIGN AS DEFERRED SUBMITTAL FOR ALL COMPONENTS REQUIRED BY IBC BY LICENSED SEISMIC ENGINEER. BUILDING IMPORTANCE FACTOR = 1.0. COMPONENT IMPORTANCE FACTOR SHALL BE THE SAME AS BUILDING UNLESS SPECIFIED DIFFERENTLY IN THE IBC.
	AIR SIDE
GA-1	MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL SMOKE AND FIRE DAMPERS AS REQUIRED BY LOCAL CODES AND AUTHORITIES.
GA-2	SHEET METAL DUCT SIZES SHOWN ON DRAWINGS ARE FREE AREA DIMENSIONS.
GA-3	PROVIDE AND INSTALL BALANCING DAMPERS IN ALL SUPPLY AND EXHAUST AIR BRANCH DUCTS. BALANCE TO CFM SHOWN ON PLAN. TESTING AND BALANCING SHALL BE PERFORMED BY AABC OR NEBB CERTIFIED TAB CONTRACTOR. BALANCE REPORT SHALL BE ISSUED TO THE ENGINEER OF RECORD FOR REVIEW.
GA-4	SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATION OF DIFFUSERS AND GRILLES.
GA-5	PROVIDE TURNING VANES IN ALL ELBOWS OF RECTANGULAR DUCT.
GA-6	C.F.M. LISTED IS ACTUAL AIR.
GA-7	ALL DUCTWORK SHALL BE GALVANIZED STEEL FABRICATED TO SMACNA STANDARDS FOR THE VELOCITY, PRESSURE, AND GEOMETRY INVOLVED. DUCT JOINTS SHALL BE SEALED USING HARD CAST TAPE. TYPE AND APPLICATION TECHNIQUES SHALL BE AS RECOMMENDED BY THE MANUFACTURER FOR THE INTENDED USE AND LOCATION.
GA-8	DUCT LINER SHALL BE ATTACHED TO INSIDE OF DUCTWORK WITH ADHESIVE COATING BETWEEN THE DUCT AND LINER AND FURTHER SECURED BY PINS MECHANICALLY FASTENED TO DUCT. PINS ADHESIVELY ATTACHED ARE NOT ACCEPTABLE ALL EDGES OF LINER SHALL BE THOROUGHLY COATED WITH ADHESIVE AND TIGHTLY BUTTED. LINER SHALL BE FIBERGLASS WITH BLACK CLOTH FINISH ON SMACNA STANDARDS AND ALL REQUIREMENTS OF THE MANUFACTURER. LINER AND ADHESIVE SHALL MEET ALL REQUIREMENTS OF FEDERAL, STATE, AND LOCAL CODES.
GA-9	DUCTWORK ROUTED OUTSIDE OF BUILDING SHALL BE INSULATED AS REQUIRED BY ASHRAE/IEES 90.1-2016. INSULATION SHALL BE MADE UP OF DUCT LINER, EXTERNAL DUCT WRAP WITH A WEATHERPROOF COVER OR A COMBINATION THERE OF AS NEEDED TO MEET REQUIREMENTS. INSULATION SYSTEM SHALL MEET UBC, IMC, ASTM, UL, AND NFPA STANDARDS AND REQUIREMENTS.



SALT LAKE CITY, UT



WHW
ENGINEERING INC.
PROFESSIONAL MECHANICAL ENGINEERING
1505 EAST 2500 SOUTH SUITE 200
SALT LAKE CITY, UTAH 84119
(801)462-2222 FAX (801)462-2222
EMAIL: ecobacco@whw-engineering.com

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: E. RIGBY

DRAWN: E. RIGBY

CHECKED: J. LARSEN

CHECKED: ---

APPROVED: W. PACKER

FILENAME

H-001.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

HVAC

HVAC LEGEND AND GENERAL NOTES


DRAWING NUMBER

H-001


55

SHEET NUMBER
OF

113

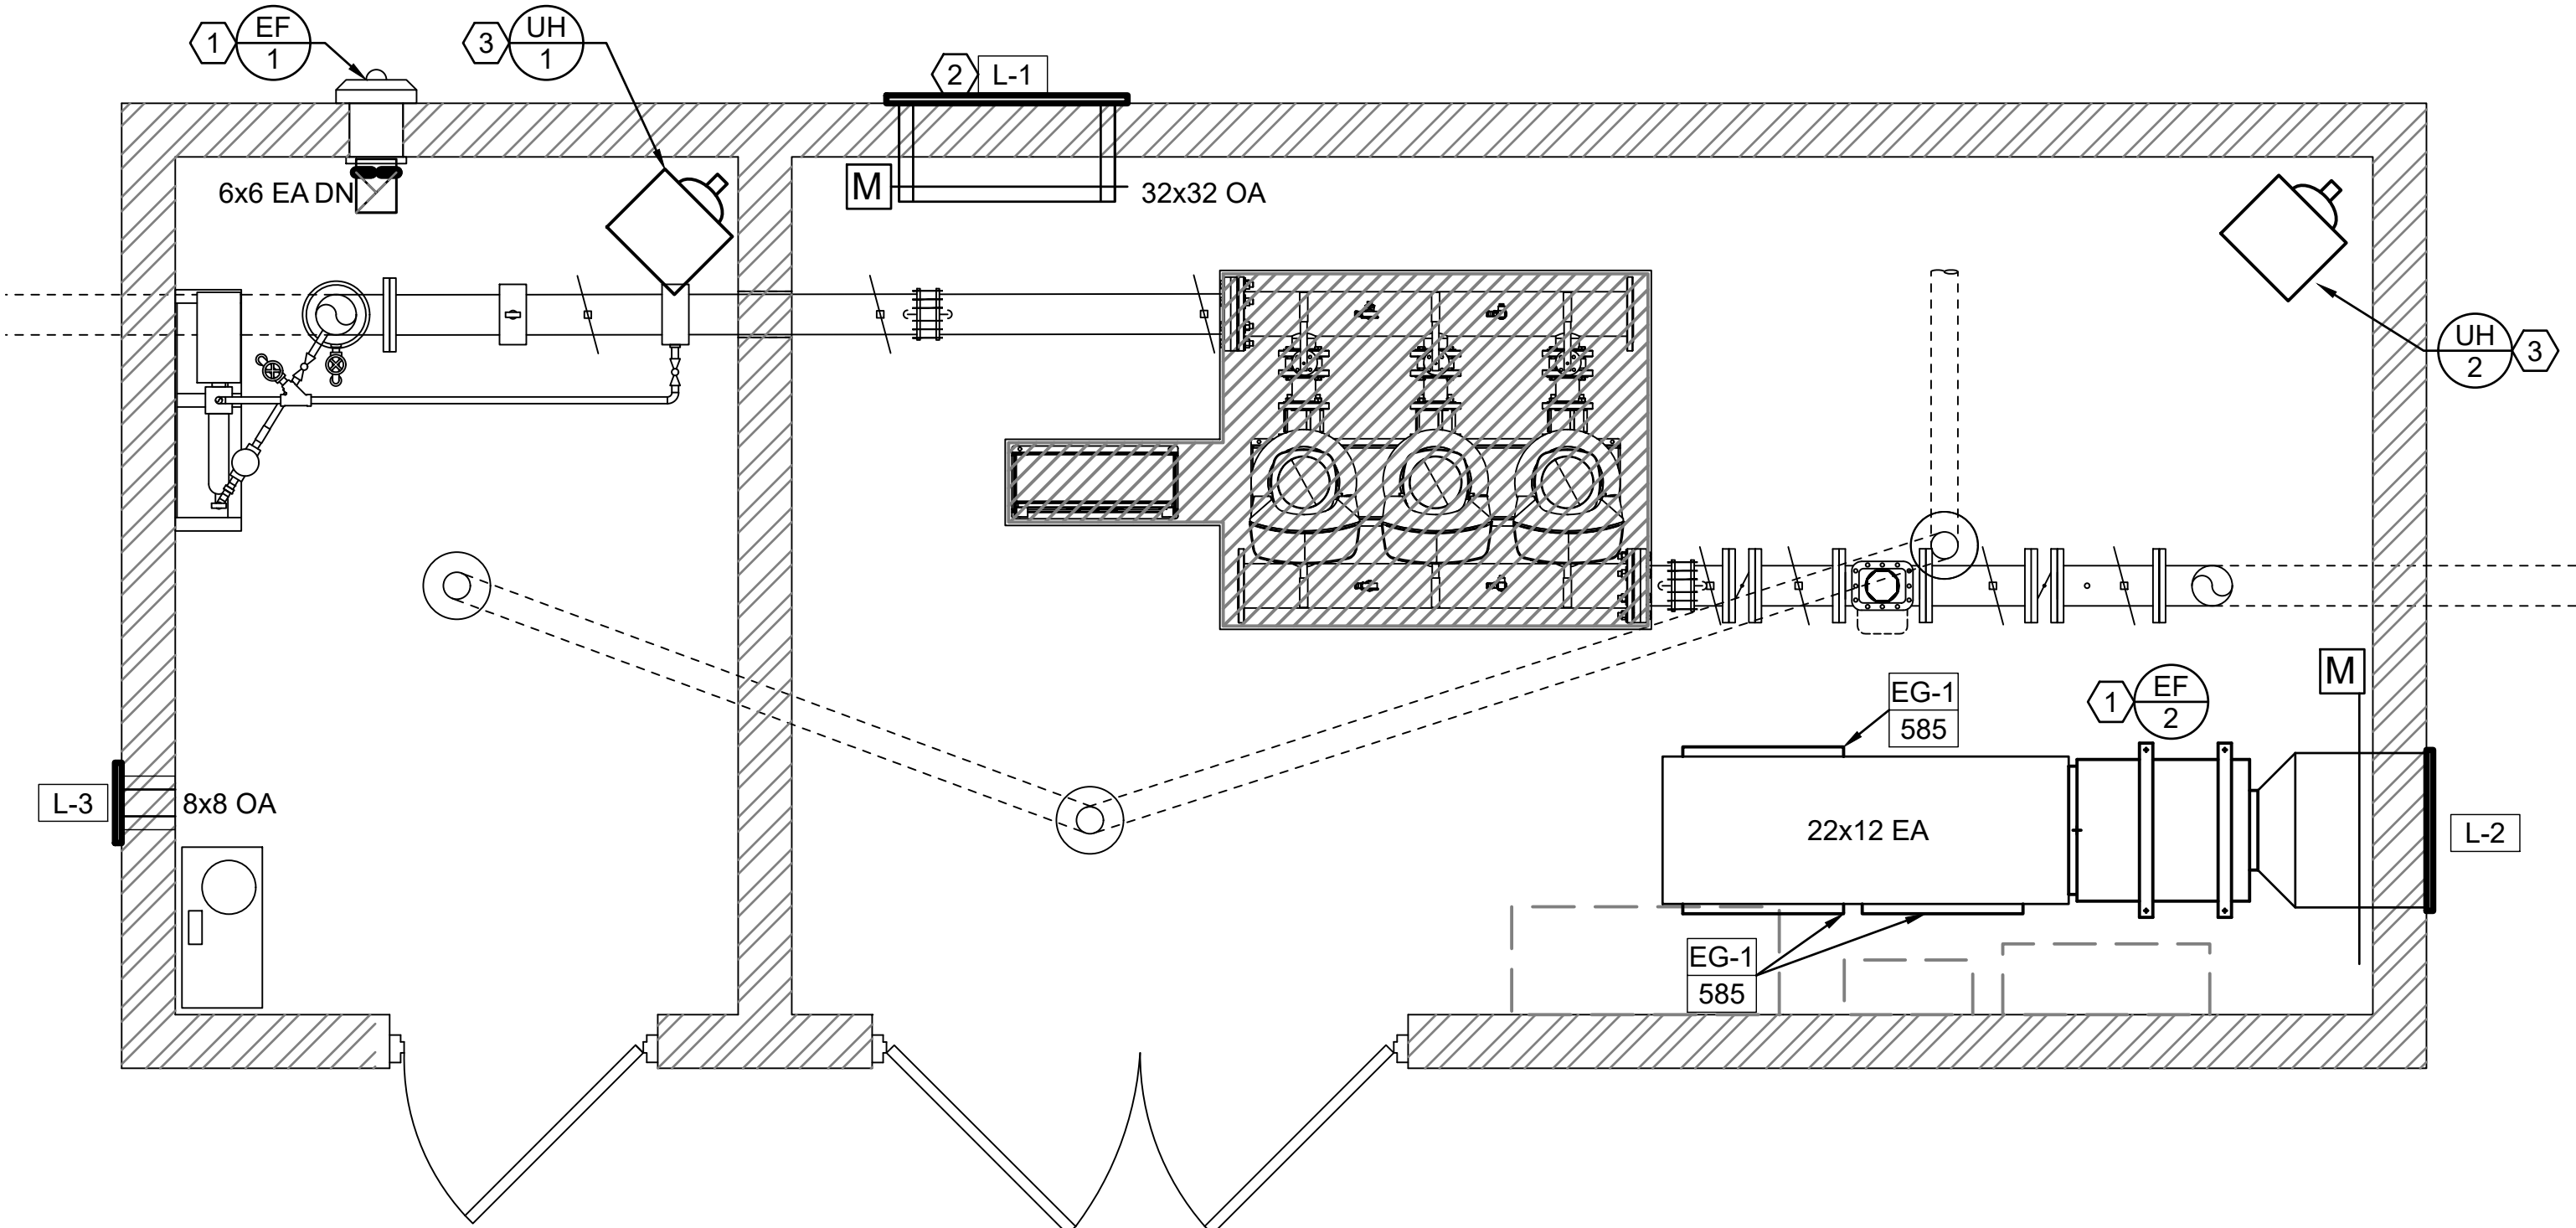

PLAN
SCALE: 1/2" = 1'-0"

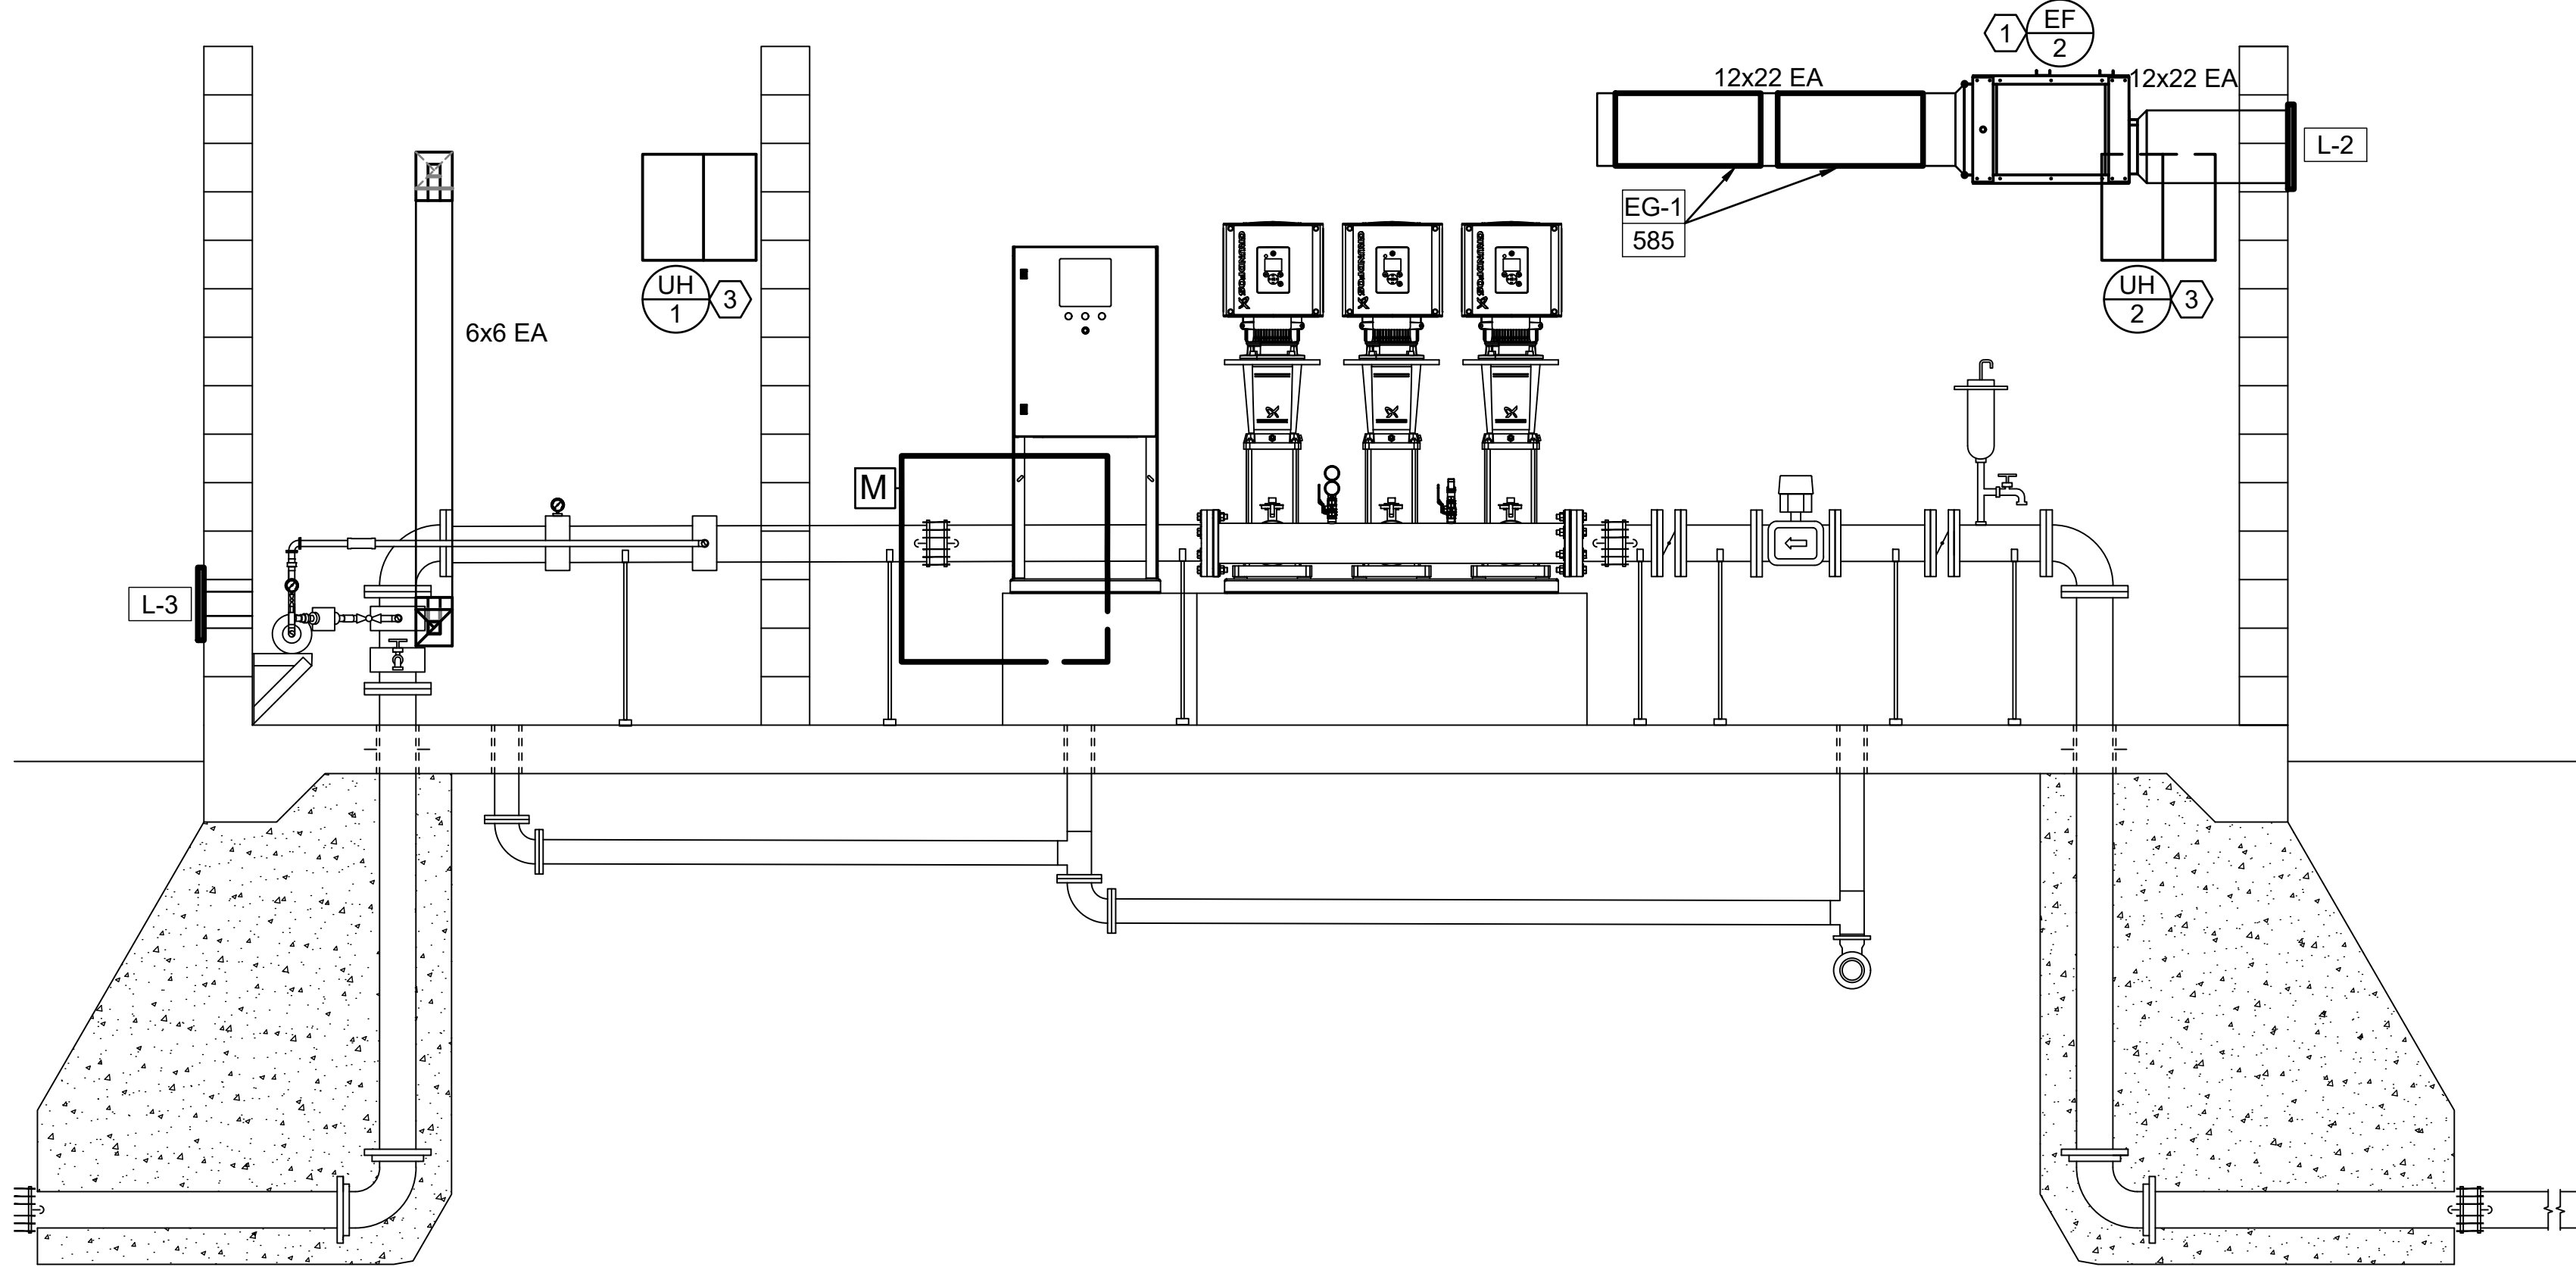

SECTION
SCALE: 1/2" = 1'-0"

- SHEET NOTES:**
- 1 PROVIDE INLINE EXHAUST FAN, MOTORIZED DAMPER, AND LOUVER. INTERLOCK WITH FRESH AIR INLET DAMPER AND DISTRICT SCADA SYSTEM.
 - 2 PROVIDE INTAKE LOUVER, LINED DUCT ELBOW, AND MOTORIZED DAMPER. INTERLOCK DAMPER WITH EXHAUST FAN AND DISTRICT SCADA CONTROL SYSTEM.
 - 3 PROVIDE ELECTRIC UNIT HEATERS. INSTALL PER MANUFACTURE'S RECOMMENDATIONS. TIE TEMPERATURE CONTROL INTO SCADA SYSTEM.



SALT LAKE CITY, UT



90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: E. RIGBY

DRAWN: E. RIGBY

CHECKED: J. LARSEN

CHECKED: ---

APPROVED: W. PACKER

FILENAME

H-101.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

HVAC

DILKON PASS PUMP STATION HVAC PLAN AND SECTION

DRAWING NUMBER


H-101

56


SHEET NUMBER OF

113


Path: P:\2021\21161 DILKON PASS BPS & PIPELINE\DRAWINGS FILENAME: M 21161 DILKON PASS BPS & PIPELINE.DWG PLOT DATE: 1/11/2022 10:28 AM CAD USER: ETHAN RIGBY

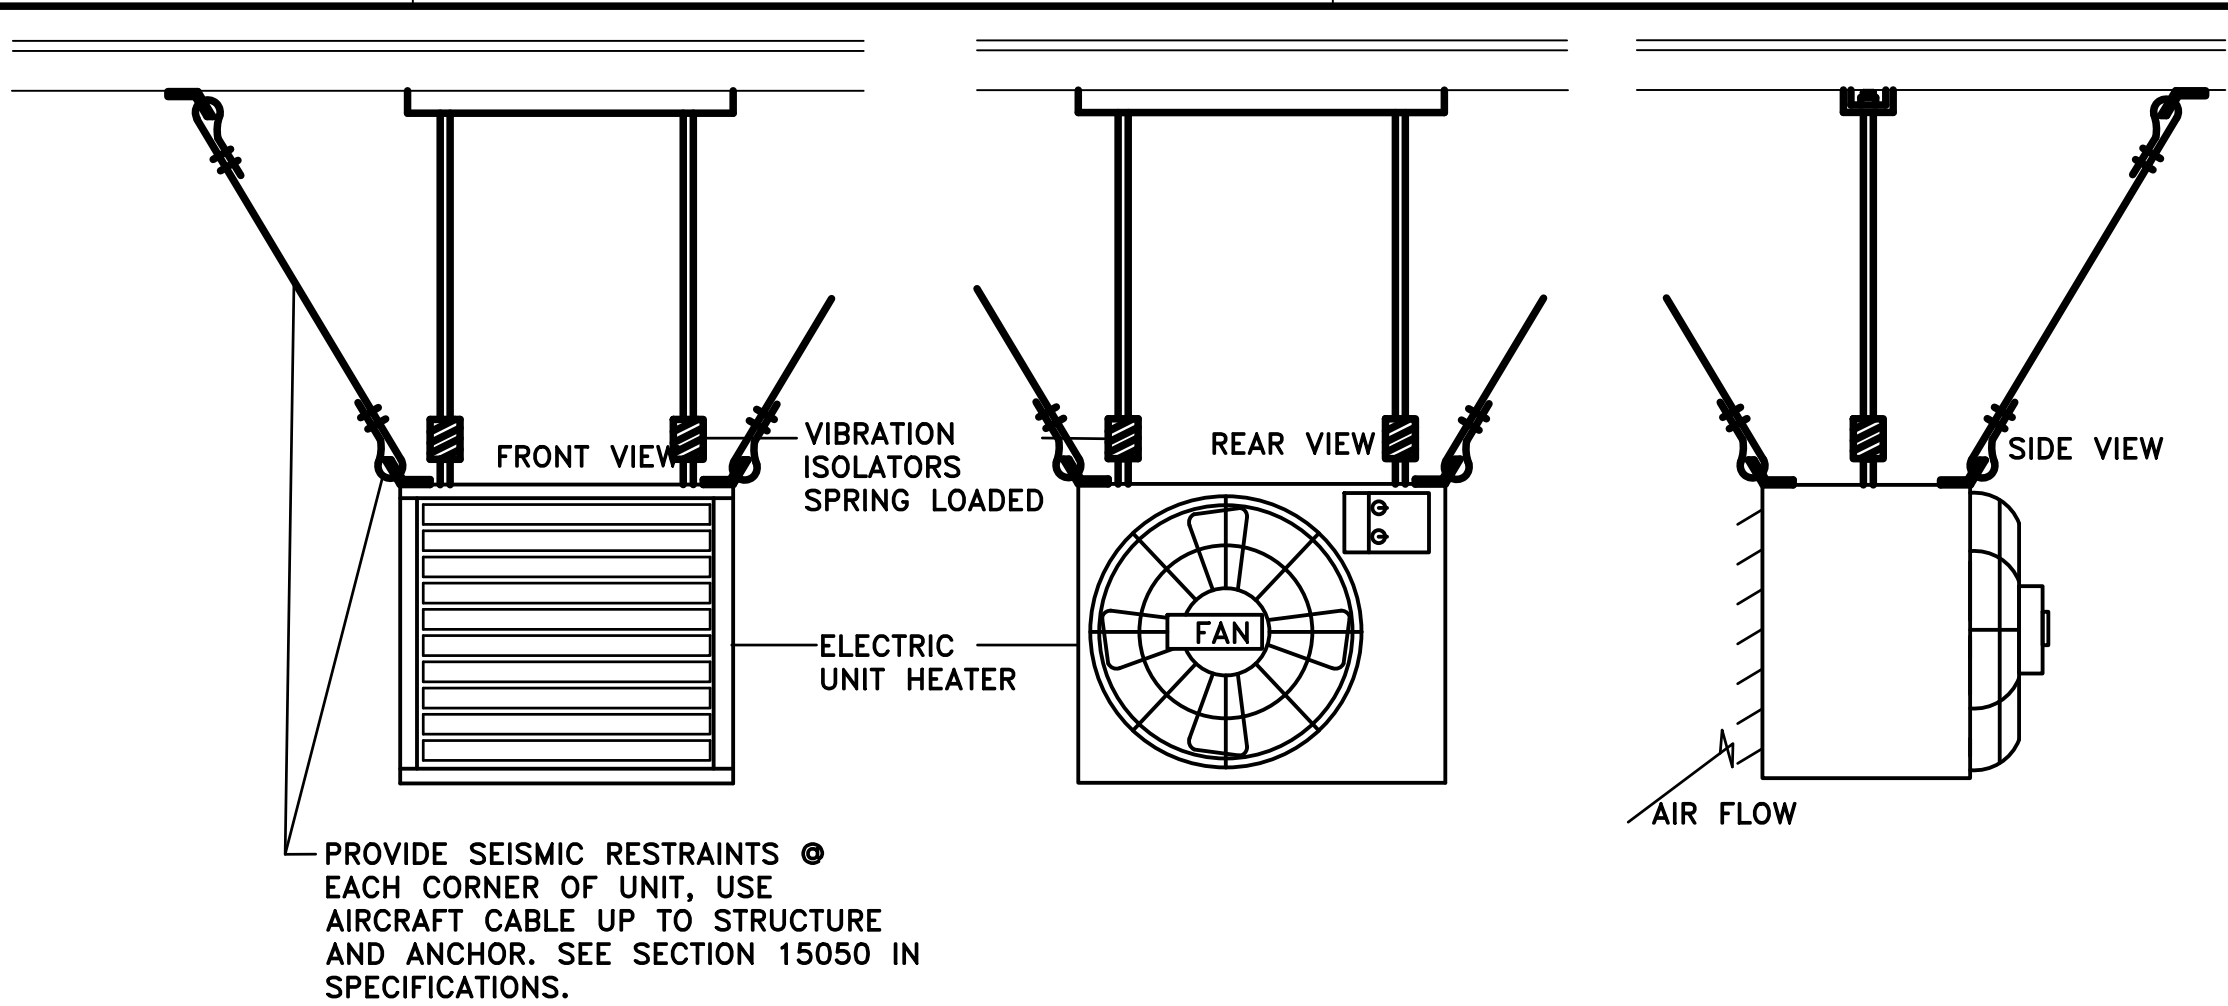

C5 ELECTRIC UNIT HEATER DETAIL
SCALE: NONE

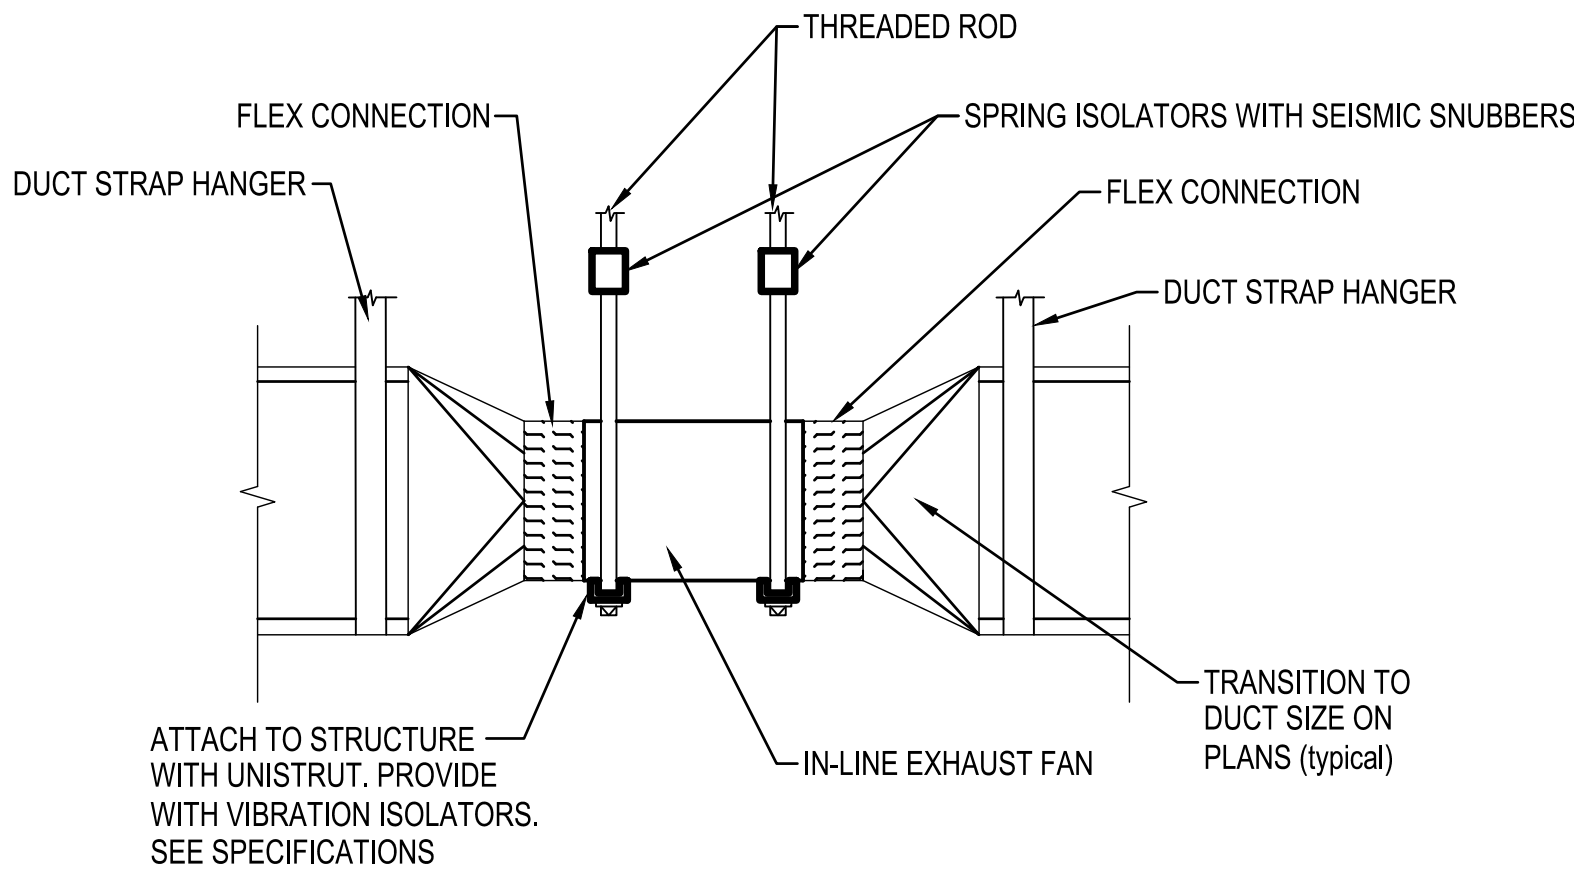

B5 IN-LINE EXHAUST FAN DETAIL
SCALE: NONE

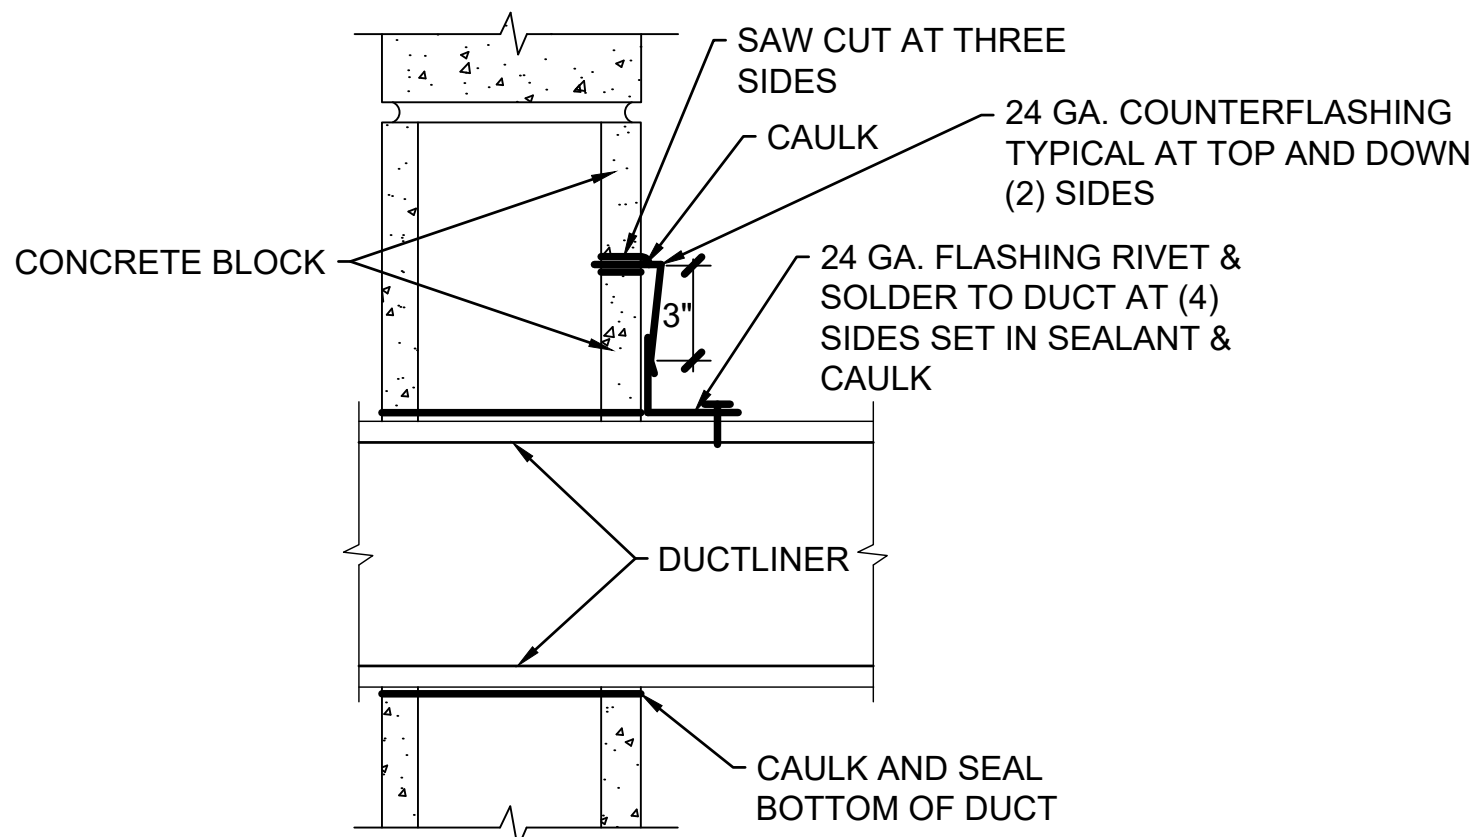

A5 DUCT THRU WALL DETAIL
SCALE: NONE



SALT LAKE CITY, UT



WHW
ENGINEERING INC.
PROFESSIONAL MECHANICAL ENGINEERING
1154 EAST 2100 SOUTH MAIN, 2ND
SALT LAKE CITY, UT 84143
(801) 462-1000 FAX 462-1002
EMAIL: ecaldwell@whw-engineering.com

90% SUBMITTAL

THIS DRAWING IS NOT VALID
FOR CONSTRUCTION
PURPOSES UNLESS IT
BEARS THE SEAL AND
SIGNATURE OF A DULY
REGISTERED
PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES
AT FULL SIZE

DESIGNED: E. RIGBY

DRAWN: E. RIGBY

CHECKED: J. LARSEN

CHECKED: ---

APPROVED: W. PACKER

FILENAME

H-102.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

HVAC

HVAC DETAILS

DRAWING NUMBER

H-102

57

SHEET NUMBER
OF

113

Path: P:\2021\21161 DILKON PASS BPS & PIPELINE\DRAWINGS FILENAME: M 21161 DILKON PASS BPS & PIPELINE.DWG PLOT DATE: 1/11/2022 10:28 AM CAD USER: ETHAN RIGBY

EXHAUST FAN SCHEDULE										
SYMBOL	MANUFACTURER & MODEL No.	SERVES	C.F.M.	STATIC PRESSURE IN. WG.	MAX NOISE SONES	MOTOR			OPER. WT. (LBS)	SCHEDULE NOTES
						V - Ø - Hz	HP	RPM		
<div>EF1</div>	COOK 100 ACWB OR70	CHLORINE ROOM	110	0.35	7.5	115-1-60	1/6	1725	47	1,3,5
<div>EF2</div>	COOK DB9	PUMP ROOM	1750	0.35	11.5	115-1-60	1/2	869	98	1,2,3,4
1. SEE SPECIFICATIONS FOR APPROVED MANUFACTURERS 2. INLINE FAN, SUPPORT FROM SPRING HANGERS. 3. PROVIDE WITH BACKDRAFT DAMPER. 4. SEE DETAIL E ON SHEET E-102 FOR ONE-LINE CONTROL DIAGRAM. 5. SEE DETAIL F ON SHEET E-102 FOR ONE-LINE CONTROL DIAGRAM.										

ELECTRIC UNIT HEATER SCHEDULE											
SYMBOL	MANUFACTURERS AND MODEL NO.	CFM	BTUH	ELECTRICAL			RPM	AIR TEMP RISE (F)	THROW (FT)	WEIGHT (LBS)	SCHEDULE NOTES
				SERVICE	KW	HP					
<div>UH1</div>	MODINE HER30	380	10200	208-1-60	3	1/40	1550	25	12	34	1,2
<div>UH2</div>	MODINE HER30	380	10200	208-1-60	3	1/40	1550	25	12	34	1,2
1. SEE SPECIFICATIONS FOR APPROVED MANUFACTURERS. 2. PROVIDE WITH TEMPERATURE SENSOR AND TIE INTO SCADA SYSTEM. COORDINATE WITH SCADA CONTRACTOR.											

REGISTER, LOUVER, & GRILLE SCHEDULE									
SYMBOL	TYPE	SERVICE	MAX CFM	NOMINAL SIZE	THROAT SIZE	CEILING TYPE	FT./MIN.	MANUF. & MODEL	SCHEDULE NOTES
<div>L-1</div>	WALL	INTAKE	1750	34X34	34X34	N/A	500	RUSKIN ELF811	1,2,3,4,5
<div>L-2</div>	WALL	EXHAUST	1750	28X40	28X40	N/A	600	RUSKIN ELF811	1,2,3,4,5
<div>L-3</div>	WALL	INTAKE	110	12X12	12X12	N/A	300	RUSKIN ELF15J	1,2,4,5
<div>EG-1</div>	DUCT	EXHAUST	750	24X12	24X12	DUCT MOUNTED	500	PRICE 500	2,4,5
1. SEAL ALL PENETRATIONS WEATHER TIGHT. 2. MAXIMUM FT/MIN AT CFM LISTED. 3. PROVIDE TRANSITION TO LOUVER THROAT SIZE AS REQUIRED TO DUCTWORK SHOWN ON PLAN. 4. SEE SPECIFICATIONS FOR OTHER APPROVED MANUFACTURERS. 5. FINISH SHALL BE SPECIFIED BY ARCHITECT.									



SALT LAKE CITY, UT



WHW
ENGINEERING INC.
PROFESSIONAL MECHANICAL ENGINEERING
1104 East 2100 South Suite 200
SALT LAKE CITY, UT 84148
(801)462-1100 FAX 462-8892
EMAIL: ecoburn@whw-engineering.com

90% SUBMITTAL

THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS IT BEARS THE SEAL AND SIGNATURE OF A DULY REGISTERED PROFESSIONAL

90% SUBMITTAL



DILKON PASS PIPELINE AND PUMP STATION

REVISIONS

REV	DATE	DESCRIPTION

LINE IS 2 INCHES AT FULL SIZE

DESIGNED: E. RIGBY

DRAWN: E. RIGBY

CHECKED: J. LARSEN

CHECKED: ---

APPROVED: W. PACKER

FILENAME

H-501.dwg

BC PROJECT NUMBER

157520

CLIENT PROJECT NUMBER

00357.21

HVAC

HVAC SCHEDULES


DRAWING NUMBER

H-501

58

SHEET NUMBER OF

113

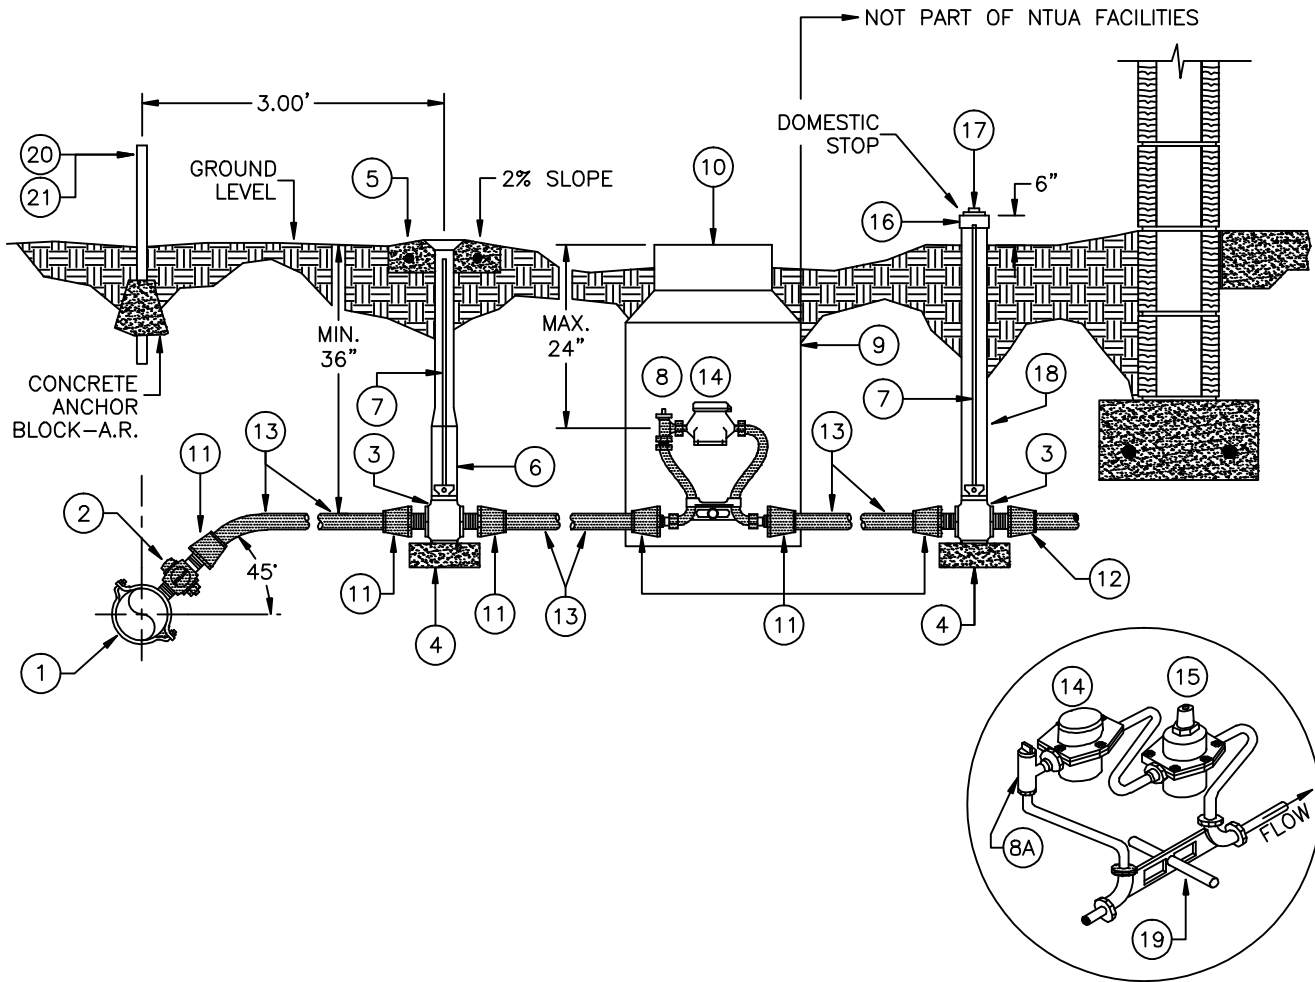

NOTES:

1. SELECT EITHER PAGE 2a OR 2b BASED ON METER SIZE.

2. TEST DURATION SHALL BE FOR 2 HOURS.

DATE PERFORMED: _____. LAB SAMPLE NO.: _____. INITIALED (NTUA): _____.

INDEX	SHEET
1" WATER SERVICE	1 of 5
MATERIAL LIST: 5/8" x 3/4" METER	2a of 5
MATERIAL LIST: 1" METER	2b of 5
GENERAL NOTES	3 of 5
PROPOSED CONSTRUCTION DRAWING	4 of 5
INDIVIDUAL AS-BUILT	5 of 5

AS-BUILT LOCATION OF TAP	
SYSTEM NAME	
PROJECT NO.	
SHEET NO.	
LINE NO.	
STATION NO.	

SHEET 1 OF 7

DESIGNED BY:	NTUA
SURVEYED BY:	
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	
SCALE:	NTS
ACAD FILENAME:	Water Standard
DWG. NO.	WS-1.DWG

NAVAJO TRIBAL UTILITY AUTHORITY 1" WATER SERVICE FOR A 5/8" x 3/4" OR 1" METER	
EQ-ENGINEERING	FT.DEPANCE, AZ

REVISIONS			
No.	Date	Brief	By
01	04/08	Revised	L.H.
02			
03			
04			
05			
06			



DESIGNED BY:	NTUA
SURVEYED BY:	NTUA
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.:	NTS
SCALE:	AS SHOWN
ADD FILENAME:	Water Standard
DWG. NO.:	WS-10.010

NAYAGO TRIBAL UTILITY AUTHORITY	
In the community development	
MATERIAL LIST: 1" SERVICE	
WITH 5/8" x 3/4" METER	
PT. 2 OF 7	

REVISIONS	
No.	Date
01	04/08
02	
03	
04	
05	
06	



MATERIAL LIST		
ITEM	QUAN	DESCRIPTION
1	1	SADDLE, BRASS, 1" FIPT x APPROPRIATE PIPE TYPE, O.D., AND LINE PRESSURE
2	1	CORPORATION STOP, 1" MIPT x 1" FIPT, MUELLER H-10046, OAE
3	1	CURB STOP, 1" FIPT x 1" FIPT, MINNEAPOLIS PATTERN W/ O-RING, MUELLER H-10287, OAE
4	A.R.	CONCRETE BLOCK OR BRICK
5	A.R.	CONCRETE COLLAR, 18" SQUARE x 4" THICK, W/ #4 REBARS, E.W.O.C.
6	1	CURB VALVE BOX, EXTENSION TYPE, MUELLER H-10302, W/ 2" x 1 1/2" BUSHING, OAE
7	2	STATIONARY ROD 36" LONG, MUELLER PART #84338, SECURED TO THE CURB STOP W/ COTTER PIN
8	1	COPPERSETTER W/ VALVED 12" RISER FOR 5/8" x 3/4" WATER METER, FORD NO. VB72-12W-FF-44, OAE, W/ 1" IP UNION NUT/SWIVEL ASSEMBLY CONNECTION ON INLET, OUTLET, AND BRACING EYE
8a	1	TANDEM COPPERSETTER WITH VALVED 12" RISER, 5/8" x 3/4" WATER METER, FORD NO. TVB-72-12W-FF-44, OAE, W/ TWO REGULATOR ADAPTERS FOR THE PRV
9	1	METER CAN, 20" O.D. x 30" HT., DFW PLASTIC, DFW 2030 B SERIES "T" TOP
10	1	METER BOX COVER W/ FROST PLATE, FOR 20" METER CAN, 11 1/2" MINIMUM LID
		OPENING, CASTING M-70
11	6	INSTA-TITE FITTING, 1" MIPT x 1" STAB FOR SIDR 7 P.E. PIPE, MUELLER H15426
12	1	CONNECTOR/ADAPTER, 1" MIPT x APPROPRIATE PIPE TYPE AND O.D.
13	A.R.	PIPE, 1" P.E., ASTM D-2239, SIDR 7, 200 PSI, 200' MAX.
14	1	METER, POSITIVE DISPLACEMENT, NEPTUNE, SR, 5/8" x 3/4", GALLONS, W/ FROST PLATE
15	1	PRV, WILKENS 600 OR WATTS 25 AUB, 3/4" FIPT
16	1	ADAPTER, 3", HUB x FIPT PVC-DWV
17	1	CLEANOUT PLUG, 3" MIPT, PVC-DWV
18	1	RISER, 3" x 36" LONG, PVC-DWV
19	1	STABILIZER, 1/2" O.D. x 12" LONG PIPE, PVC, SCH. 40
20	A.R.	BLUE CARSONITE MARKER POST
21	A.R.	"WATERLINE WARNING" DECAL (FOR ITEM 20)

NOTES:

1. A.R. = AS REQUIRED
2. DECAL TO BE AFFIXED TO ITEM NO. 20.
3. NORMAL FLOW RATE = 1-20 GPM.
4. NTUA WILL NOT PROVIDE WATER METERS FOR SUBDIVISIONS AND DEVELOPERS.
5. WATER METER SERIAL NUMBER: _____
6. SADDLE SIZE: _____

DESIGNED BY:	NTUA
SURVEYED BY:	NTUA
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	NTS
SCALE:	AS SHOWN
ADD FILENAME:	Water Standard
DWG. NO.	WS-1b.DWG

NAVAJO TRIBAL UTILITY AUTHORITY
By Order: <i>(Signature)</i>
MATERIAL LIST: 1" SERVICE
WITH 1" METER
PT. JEROME, AZ

REVISIONS	
No.	Date
01	04/08
02	
03	
04	
05	
06	



MATERIAL LIST		
ITEM	QUAN	DESCRIPTION
1	1	SADDLE, BRASS, 1" FIPT x APPROPRIATE PIPE TYPE, O.D., AND LINE PRESSURE
2	1	CORPORATION STOP, 1" MIPT x 1" FIPT, MUELLER H-10046, OAE
3	1	CURB STOP, 1" FIPT x 1" FIPT, MINNEAPOLIS PATTERN W/ O-RING, MUELLER H-10287, OAE
4	A.R.	CONCRETE BLOCK OR BRICK
5	A.R.	CONCRETE COLLAR, 18" SQUARE x 4" THICK, W/ #4 REBARS, E.W.O.C.
6	1	CURB VALVE BOX, EXTENSION TYPE, MUELLER H-10302, W/ 2" x 1 1/2" BUSHING, OAE
7	2	STATIONARY ROD, 36" LONG, MUELLER PART #84338, SECURED TO THE CURB STOP W/ COTTER PIN
8	1	COPPERSETTER W/ VALVED 12" RISER, 1" WATER METER, FORD NO. VB74-12W-FF-44,
		OAE, W/ 1" IP UNION NUT/SWIVEL ASSEMBLY CONNECTION ON INLET, OUTLET, AND BRACING EYE
8a	1	TANDEM COPPERSETTER WITH VALVED 12" RISER, 1" WATER METER, FORD NO. TVB-74-12W-FF-44,
		OAE, W/ TWO REGULATOR ADAPTERS FOR THE PRV
9	1	METER CAN, 20" O.D. x 30" HT., DFW PLASTIC, DFW 2030 B SERIES "T" TOP
10	1	METER BOX COVER W/ FROST PLATE, FOR 20" METER CAN, 11 1/2" MINIMUM LID
		OPENING, CASTING M-70
11	6	INSTA-TITE FITTING, 1" MIPT x 1" STAB FOR SIDR 7 P.E. PIPE, MUELLER H15426
12	1	CONNECTOR/ADAPTER, 1" MIPT x APPROPRIATE PIPE TYPE AND O.D.
13	A.R.	PIPE, 1" P.E., ASTM D-2239, SIDR 7, 200 PSI, 200' MAX.
14	1	METER, POSITIVE DISPLACEMENT, SENSUS, SR, 1", GALLONS, W/ FROST PLATE
15	1	PRV, WILKENS 600 OR WATTS 25 AUB, 1" FIPT
16	1	ADAPTER, 3", HUB x FIPT PVC-DWV
17	1	CLEANOUT PLUG, 3" MIPT, PVC-DWV
18	1	RISER, 3" x 36" LONG, PVC-DWV
19	1	STABILIZER, 1/2" O.D. x 12" LONG PIPE, PVC, SCH. 40
20	A.R.	BLUE CARSONITE MARKER POST
21	A.R.	"WATERLINE WARNING" DECAL (FOR ITEM 20)

NOTES:

1. A.R. = AS REQUIRED
2. DECAL TO BE AFFIXED TO ITEM NO. 20.
3. NORMAL FLOW RATE = 3-50 GPM.
4. WATER METER SERIAL NUMBER: _____
5. SADDLE SIZE: _____

1. PROVIDE 10' MINIMUM HORIZONTAL SEPARATION IN SEPARATE TRENCHES BETWEEN WATER AND SEWER SERVICES, PAST THE BUILDING PLUMBING. PROVIDE 5' MINIMUM HORIZONTAL SEPARATION BETWEEN WATER SERVICE AND OTHER UTILITIES. FOR WATER AND SEWER CROSSING. PROVIDE A MINIMUM OF 12" VERTICAL CLEARANCE, PIPE O.D. TO PIPE O.D. IF WATER SERVICE CROSSES OTHER UTILITIES, ALL STIPULATIONS FOR THE OTHER UTILITY MUST BE MET.
2. BUILDING PLUMBING, WATER AND SEWER SERVICES TO BE INSTALLED IN ACCORDANCE WITH THE NATIONAL PLUMBING CODE ADOPTED BY THE NAVAJO NATION.
3. WATER SERVICES SHALL HAVE A MINIMUM COVER OF 36" AND SHALL BE INSTALLED IN CONFORMANCE WITH NTUA STANDARDS.
4. SADDLES SHALL BE SINGLE STRAP/BAND TYPE, FOR STEEL PIPE O.D. PVC. SADDLES SHALL BE DOUBLE STRAP/BAND TYPE, FOR D.I., A.C., OR C-900 PIPE. ON EXISTING 2" PIPING, A 2" x 1" PVC TEE SHALL BE USED. CONTACT NTUA HEADQUARTERS ENGINEERING ON PIPING SMALLER THAN 2".
5. PROVIDE THE AS-BUILT SWING TIE INFORMATION FOR THE TAP POINT AND OTHER APPURTENANCES INSTALLED, ON SHEET 5 of 5.
6. THE WATER METER SHALL BE CENTERED AND SET A MAX. OF 24" BELOW THE TOP OF THE METER BOX COVER.
7. THE METER CAN SHALL BE LOCATED JUST BEYOND THE SIDEWALK AT THE PROPERTY LINE OR WITH OWNER'S PERMISSION A MINIMUM OF 10' FROM THE BUILDING.
8. WATER SERVICE LINES ARE LIMITED TO A MAXIMUM OF 200'. IF THE PRESSURE AT THE HOME SITE IS ABOVE 70 PSI, INSTALL THE APPROPRIATE TANDEM COPPERSETTER WITH AN INDIVIDUAL PRV (ITEM 8A).
9. USE FIELD MARKERS WHERE APPROPRIATE.
10. SUBMIT CONSTRUCTION COST OF NEW INSTALLATION UP TO AND INCLUDING THE METER. INDICATE AS FOLLOWS: A. MATERIAL COST, B. LABOR COST, C. EQUIPMENT COST, D. TOTAL CONSTRUCTION COST. THE COST SHALL BE SHOWN ON SHEET 5 of 5 AND THE TRANSFER AGREEMENT.
11. SHEETS 4 OF 5 AND 5 OF 5 ARE FOR RESIDENTIAL INSTALLATIONS ONLY. ALL OTHER PROJECTS, SUBMIT 4 SETS OF COMPLETE DRAWINGS.

SHEET 4 OF 7

DESIGNED BY:	NTUA
SURVEYED BY:	
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	
SCALE:	NTS
ACAD FILENAME:	Water Standard
DWG. NO.	WS-1c.DWG

NAVAJO TRIBAL UTILITY AUTHORITY <small>By Civil Engineering Department</small>	
GENERAL NOTES FOR WATER SERVICE	
HQ-ENGINEERING	FT.DEFIANCE, AZ

REVISIONS			
No.	Date	Brief	By
01	04/08	Revised	L.H.
02			
03			
04			
05			
06			



4" x 2" P.R.V.

#

MATERIAL LIST

ITEM	QTY	DESCRIPTION
1	1	4" CLA-VAL, PRESSURE REDUCING VALVE, THREADED ENDS, STAINLESS STEEL (S.S.) TRIM & PILOT TUBING, 90 SERIES W/ OPTIONS A, B, C, D, V & M
2	A.R.	4" DUCTILE IRON (D.I.) PIPE, CLASS 350, PLAIN END, CUT AS NEEDED
3	1	4" DRESSER COUPLING (6" LONG FOR D.I. PIPE)
4	2	4" GATE VALVE, F.I.P.T., N.R.S., R.H.T., BRASS HAND WHEEL
5	2	2" DOUBLE STRAP W/ 2" x 3/4" BUSHING AND 3/4" x 1/4" BUSHING FOR PRESSURE GAGE
6	2	PRESSURE GAUGE W/ 1/4" BRASS SHUTOFF VALVE
7	1	2" CLA-VAL, PRESSURE REDUCING VALVE, THREADED ENDS, STAINLESS STEEL (S.S.) TRIM & PILOT TUBING, 90 SERIES W/ OPTIONS A, B, C, D, V & M
8	A.R.	2" S.S. PIPE, THREADED, CUT AS NEEDED
9	1	2" DRESSER COUPLING (6" LONG FOR S.S. PIPE)
10	2	2" GATE VALVE, F.I.P.T., N.R.S., R.H.T., BRASS HAND WHEEL
11	4	4" x 2" TAP SADDLE
12	2	2" 90° S.S. ELBOW, F.I.P.T.
13	1	2" S.S. HOSE BIB
14	1	2" S.S. TEE W/ 2" x 3/4" BUSHING AND 3/4" x 1/4" BUSHING FOR HOSE BIB
15	2	VAULT BORE DONUT, 6" O.D. / 4" I.D.
16	2	4" D.I. 'E-Z' FLANGED ADAPTER
17	2	4" GATE VALVE, M.J., RESILIENT SEAT, FLANGED, N.R.S., R.H.T., W/ 2" OPERATING NUT
18	4	VALVE BOX, 2-PIECE SCREW TYPE, 5-1/4" SHAFT W/ CAST IRON DROP LID
19	-	4" C-900 PVC PIPE
20	2	2" CORPORATION STOP, MIPT x FIPT
21	2	INSTALL 2" FLUSH VALVE PER NTUA STD. DTL. WS-11 (AFTER THE CORP. STOP)
22	1	'LANE' POLYPROPYLENE VAULT LADDER W/ PULL-UP HANDRAIL (5 RUNG)
23	1	9' x 6' x 6' (INT. DIM.) PRECAST CONCRETE VAULT (4,000 PSI MIN.), 6" THICK WALLS W/ 6" THICK REINFORCED CONCRETE TOP (NON-TRAFFIC RATED) AND 6" REINFORCED CONCRETE BASE
24	1	ACCESS COVER, 6' x 6' (INT. DIM) SQ., INSULATED, DOUBLE DOOR COVER AND SAFETY GRATE, ALUMINUM CHANNEL FRAME W/ T-HANDLE SLAM LOCK AND COVERED PADLOCK CLIP
25	A.R.	VAULT JOINTS TO BE SEALED WITH BITUMASTIC GASKET
26	4	24" x 24" x 4" CONCRETE COLLAR W/ #4 REBAR, E.W., INDICATE PIPE SIZE & FLOW DIRECTION
27	5	ADJUSTABLE METAL PIPE SUPPORT (UNDER 4" VALVES AND AT 2" 90° ELBOWS & 2" P.R.V.)
28	5	12" x 12" x 4" CONC. BLOCK
29	-	NOT USED
30	A.R.	CONCRETE ANCHOR BLOCK PER NTUA STD. DTL. WS-19 & WS-19a
31	4	6" DIA. BOLLARDS AT 12" MIN. FROM VAULT CORNERS PER MAG. STD. 140, TYPE 1

GENERAL NOTES:

1. PROVIDE ADEQUATE CLEARANCE BETWEEN FLANGE BOLTS AND VAULT WALLS FOR MAINTENANCE.
2. GATE VALVES TO BE SUPPORTED ON 95% STANDARD PROCTOR.
3. ALL PIPES AND FITTINGS 4" OR LESS TO BE STAINLESS STEEL.
4. HEX HEAD BOLTS/NUTS TO BE STAINLESS STEEL, TYPE 304.
5. A.R. = AS REQUIRED.
6. INSTALL GATE VALVE AND FLUSH VALVE WITHIN 25 FT OF PRV VAULT.

SHEET 2 OF 2

DESIGNED BY:	NTUA-HQ
SURVEYED BY:	-
DRAFTED BY:	NTUA-HQ
APPROVED BY:	NTUA-HQ
DATE:	01/2019
PROJECT NO.	-
SCALE:	NTS
ACAD FILENAME:	2019 NTUA Std. Dtl. for Water.dwg
DETAIL NO.	WS-4c

NAVAJO TRIBAL UTILITY AUTHORITY
ENGINEERING & CONSTRUCTION OPERATIONS DIVISION

MATERIAL LIST:
4" x 2" P.R.V.


NTUA HEADQUARTERS

FT.DEFIANCE, AZ

REVISIONS

No.	Date	Brief	By
01	09/15	2015 Addition	A.S.
02	01/19	2019 Update	A.S.
03			
04			
05			
06			



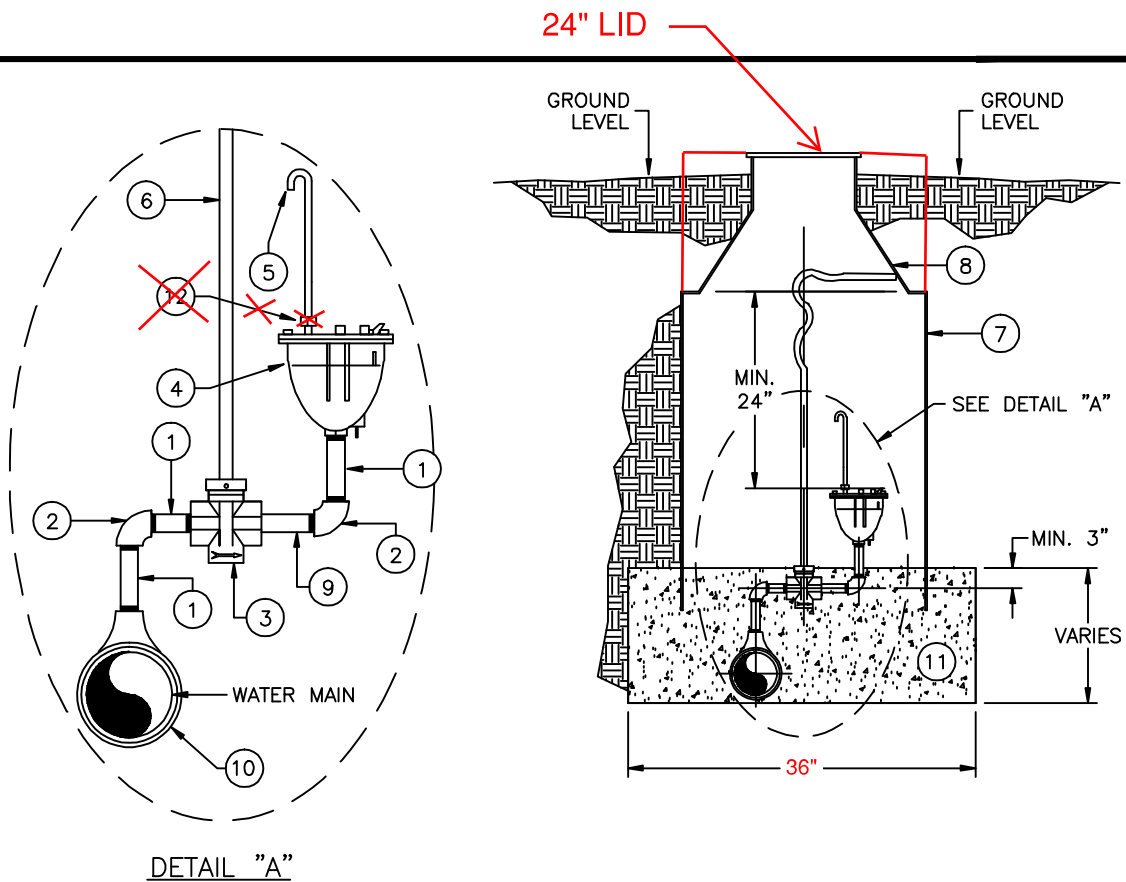

MATERIAL LIST

ITEM	QUAN	DESCRIPTION
1	3	1" x 3" NIPPLE, BRASS
2	2	1" x 90° ELBOW, BRASS
3	1	1" CURB STOP VALVE, FIPT, MUELLER H-10287, OAE
4	1	1" COMBINATOIN AIR RELEASE/VACUUM VALVE
5	1	1" O.D. PIPE, BRASS, 12" MIN.
6	1	STATIONARY ROD, 42"
7	1	METER CAN, 36" O.D. x 30" DEPTH, SONOLOC
8	1	METER CAN COVER W/ DOUBLE LID (FROST PLATE) FOR 36" O.D. CAN, CASTING M-70
9	1	1" x 6" NIPPLE, BRASS
10	1	SADDLE, BRASS, 1" TAP x APPROPRIATE PIPE O.D. SIZE
11	3 CF*	1" TO 2" FILTER ROCK
12	1	1" UNION

*CF = CUBIC FEET

DESIGNED BY:	NTUA
SURVEYED BY:	
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	
SCALE:	NTS
ACAD FILENAME:	Water Standard
DWG. NO.	WS-10.DWG

NAVAJO TRIBAL UTILITY AUTHORITY
By Civil Infrastructure Department

AIR RELEASE VALVE DETAIL


BQ-ENGINEERING

FT.DENANCE, AZ

REVISIONS

No.	Date	Brief	By
01	04/08	Revised	L.H.
02			
03			
04			
05			
06			



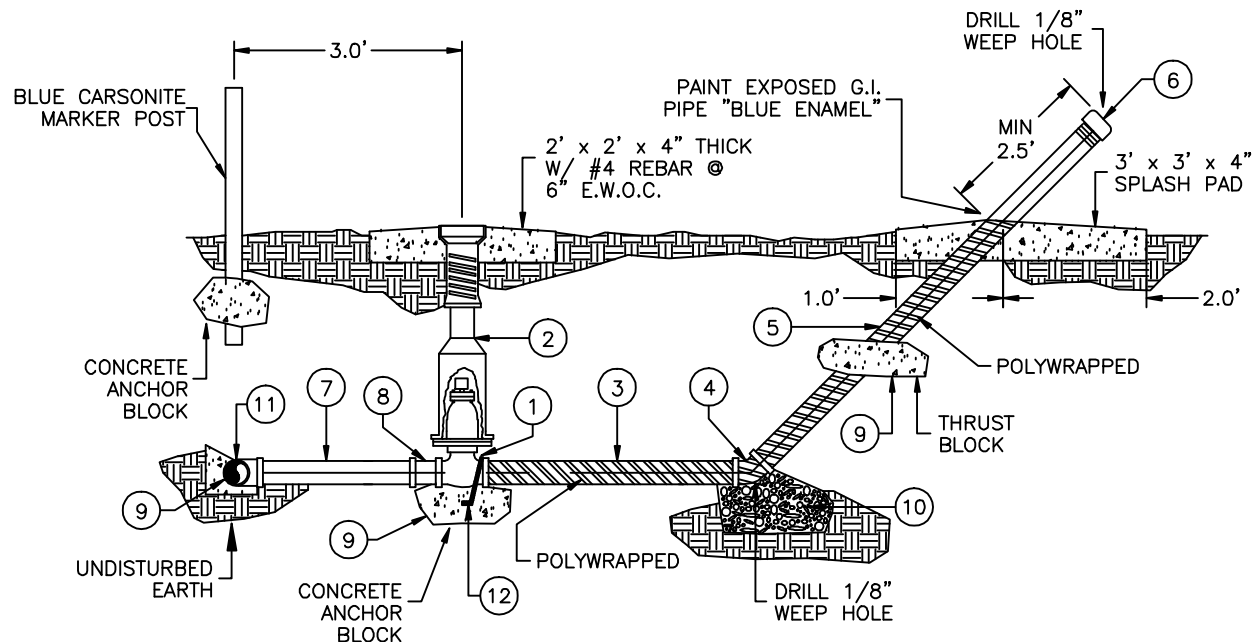

MATERIAL LIST

ITEM	QUAN	DESCRIPTION
1	1	2' GATE VALVE, C.I., FIPT, RW, NRS, RHT, W/ 2' OPERATING NUT, MUELLER A-2360-37
2	1	VALVE BOX, SCREW-TYPE, C.I., 2 PIECE, 5 1/4" SHAFT, TYLER 6850
3	1	2" x 3' PIPE (MIN.), G.I., COATED OR POLYWRAPPED
4	1	2" x 45" ELBOW, G.I., W/ 1/8" WEEP HOLE
5	1	2" PIPE, G.I. x CUT TO LENGTH AS NEEDED
6	1	2" CAP, G.I. W/ 1/8" VENT HOLE
7	1	2" PIPE, PVC CUT TO LENGTH AS NEEDED
8	1	2" ADAPTER, PVC, SLIP-GASKET x MIPT, SDR-21
9	A.R.	CONCRETE THRUST BLOCK, (DO NOT COVER JOINTS OR BOLTS), MIN. 1.5 CUBIC FEET
10	1.5 CF	CLEAN GRAVEL
11	1	MAIN LINE SADDLE OR TEE
12	A.R.	#4 REBAR

DESIGNED BY:	NTUA
SURVEYED BY:	
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	
SCALE:	NTS
ACAD FILENAME:	Water Standard
DWG. NO.	WS-11.DWG

NAVAJO TRIBAL UTILITY AUTHORITY
By Civil Engineering Department

2" FLUSH VALVE DETAIL



BQ-ENGINEERING

FT. DEFENCE, AZ

REVISIONS

No.	Date	Brief	By
01	04/08	Revised	L.H.
02			
03			
04			
05			
06			



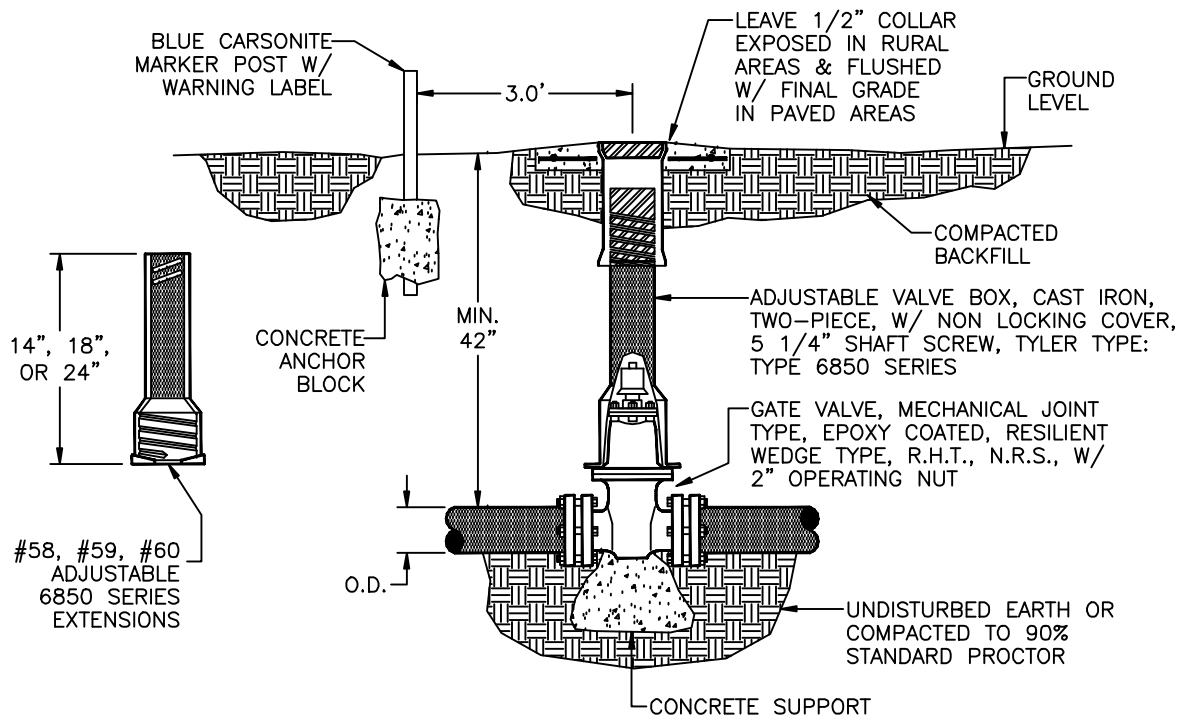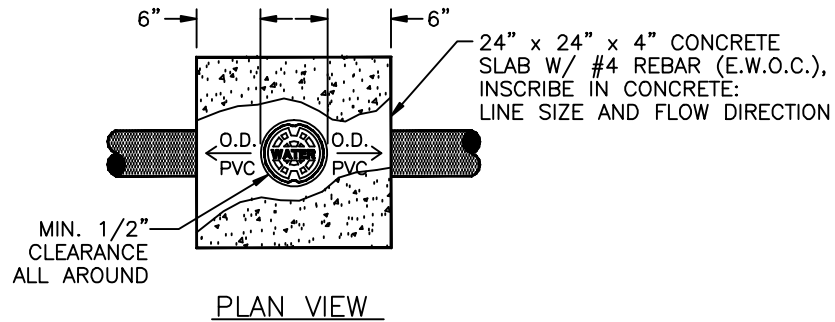

NOTES:


1. IF APPROPRIATE, USE SERIES 2000 PV MEGALUG GLANDS FOR SDR-21, PVC TO SECURE GATE VALVE(S) TO OTHER FITTINGS/PIPE, USE OTHER MEGALUGS FOR DIFFERENT OUTSIDE DIAMETER PIPE/TYPE.
2. DO NOT COVER JOINTS AND BOLTS WITH CONCRETE.
3. SEE WS-13 FOR APPROPRIATE LOCATION OF MARKER POST.

DESIGNED BY:	NTUA
SURVEYED BY:	
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	
SCALE:	NTS
ACAD FILENAME:	Water Standard
DWG. NO.	WS-14.DWG


NAVAJO TRIBAL UTILITY AUTHORITY <small>By Civil Engineering Department</small>	
WATER MAIN VALVE INSTALLATION	
EQ-ENGINEERING	FT.DEPIANCE, AZ

REVISIONS			
No.	Date	Brief	By
01	04/08	Revised	L.H.
02			
03			
04			
05			
06			




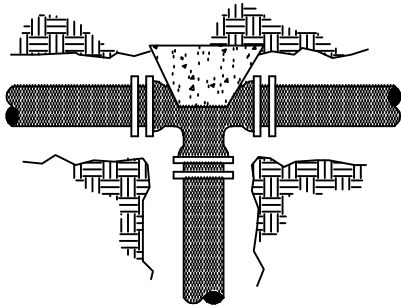


TEE
(PLAN VIEW)

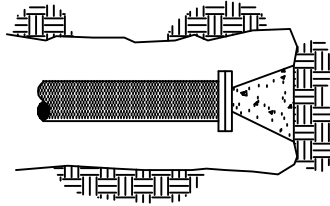


DEAD END CAPPED OR PLUG
(PLAN VIEW)

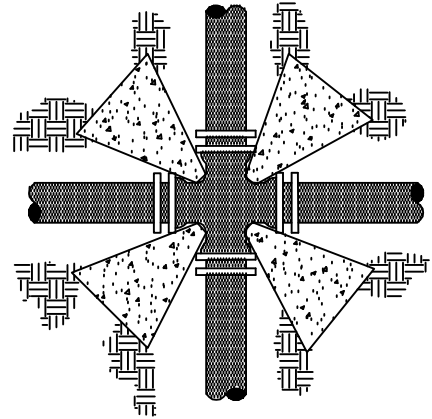


CROSS
(PLAN VIEW)




90° ELBOW
(PLAN VIEW)

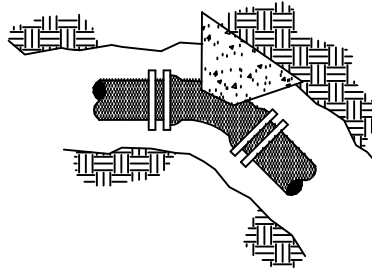


45° ELBOW
(PLAN VIEW)

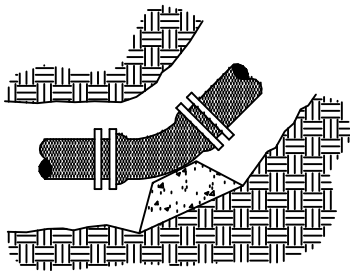

VERTICAL BENDS
(SECTION VIEW)

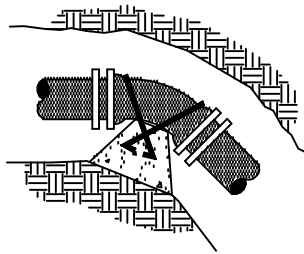

VERTICAL GRAVITY THRUST BLOCK
(SECTION VIEW)

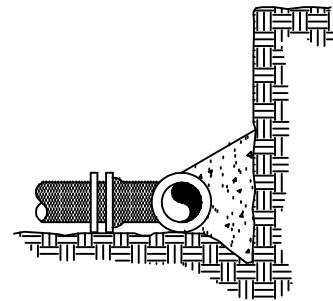

BEARING AREA
(SECTION VIEW)

NOTES:

1. DO NOT COVER GASKETED JOINTS AND NUTS/BOLTS.

MINIMUM BEARING AREAS IN SQUARE FEET

PIPE SIZE	TEE & PLUG	90° ELBOW	45° OR 22 1/2° ELBOW	CROSS
2"	0.5	0.5	0.5	0.5
4"	1.5	2.0	1.5	1.0
6"	3.0	4.5	2.5	2.0
8"	5.0	7.5	4.0	4.0
10"	8.0	11.0	6.5	5.5
12"	11.0	15.5	9.0	8.0
14"	15.0	21.0	12.0	10.5
16"	19.0	27.0	15.5	13.5
18"	24.0	34.0	19.0	17.0

SHEET 1 OF 2

DESIGNED BY:	NTUA
SURVEYED BY:	
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	
SCALE:	NTS
ACAD FILENAME:	Water Standard
DWG. NO.	WS-19.DWG

NAVAJO TRIBAL UTILITY AUTHORITY
By Civil Engineering Department

GRAVITY/THRUST
BLOCK DETAILS

BQ-ENGINEERING

FT. DEFENCE, AZ

REVISIONS

No.	Date	Brief	By
01	04/08	Revised	L.H.
02			
03			
04			
05			
06			



GRAVITY THRUST BLOCK
(ALSO TO BE USED IN UNSTABLE TRENCH CONDITIONS)
RESULTANT THRUST IN POUNDS OF FITTINGS AT 100 PSI WATER PRESSURE

TOTAL POUNDS					
PIPE SIZE	DEAD END	90° ELBOW	45° ELBOW	22 1/2° ELBOW	11 1/4° ELBOW
3"	1,232	1,742	943	481	241
4"	1,810	2,559	1,385	706	355
6"	3,739	5,288	2,862	1,459	733
8"	6,433	9,097	4,923	2,510	1,261
10"	9,677	13,685	7,406	3,776	1,897
12"	13,685	19,353	10,474	5,340	2,683
14"	18,385	26,001	14,072	7,174	3,604
16"	23,799	33,628	18,199	9,278	4,661
18"	29,865	42,235	22,858	11,653	5,855
20"	36,644	51,822	28,046	14,298	7,183
24"	52,279	73,934	40,013	20,398	10,249
30"	80,425	113,738	61,554	31,380	15,766
36"	115,209	162,931	88,177	44,952	22,585
42"	155,528	219,950	119,036	60,684	30,489
48"	202,683	286,637	155,127	79,083	39,733
54"	260,214	367,999	199,160	101,531	51,011
60"	298,121	421,606	228,172	116,321	58,442
64"	338,707	479,004	259,235	132,157	66,398

NOTES:

1. THE THRUST (IN TOTAL POUNDS) IN THE CHART IS BASED ON DUCTILE IRON OUTSIDE DIAMETER PIPE DIMENSION. SURGES SHOULD BE CONSIDERED AT TWICE THE NORMAL OPERATING PRESSURE. THE VOLUME OF THE GRAVITY THRUST BLOCK IS BASED ON CONCRETE AT 150 LBS./FT³.
2. TO OBTAIN VOLUME OF CONCRETE REQUIRED, USE:
VOLUME OF CONCRETE(FT³)= THRUST(LBS.) x SYSTEM PRESSURE(Psi)/100 PSI // 150 LBS./FT³.

E.G.: CALCULATE THE VOLUME OF THE GRAVITY THRUST BLOCK FOR AN 8" x 45° BEND AT AN OPERATING PRESSURE OF 80 PSI.

ANSWER: 4923 LBS. x 160 PSI/100 PSI DIVIDED BY 150 LBS./CUBIC FT. = 52.5 CUBIC FEET OR 2 CUBIC YARDS.


SHEET 2 OF 2

DESIGNED BY:	NTUA
SURVEYED BY:	
DRAWN BY:	NTUA
APPROVED BY:	NTUA
DATE:	04/08
PROJECT NO.	
SCALE:	NTS
ACAD FILENAME:	Water Standard
DWG. NO.	WS-19a.DWG


NAVAJO TRIBAL UTILITY AUTHORITY <small>By Civil Engineering Department</small>	
GRAVITY/THRUST BLOCK CHART	
BQ-ENGINEERING	FT.DEFIANCE, AZ

REVISIONS			
No.	Date	Brief	By
01	04/08	Revised	L.H.
02			
03			
04			
05			
06			




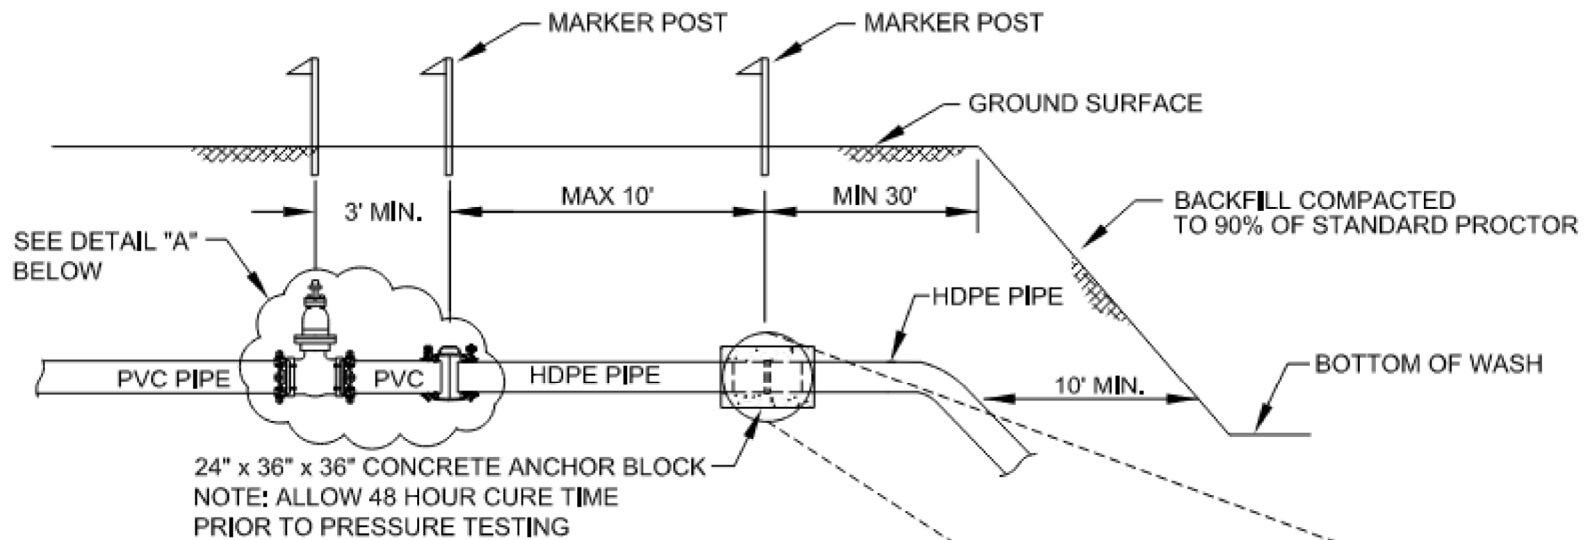



PROFILE VIEW
TYP. HDPE PIPE WASH CROSSING DETAIL
N.T.S.

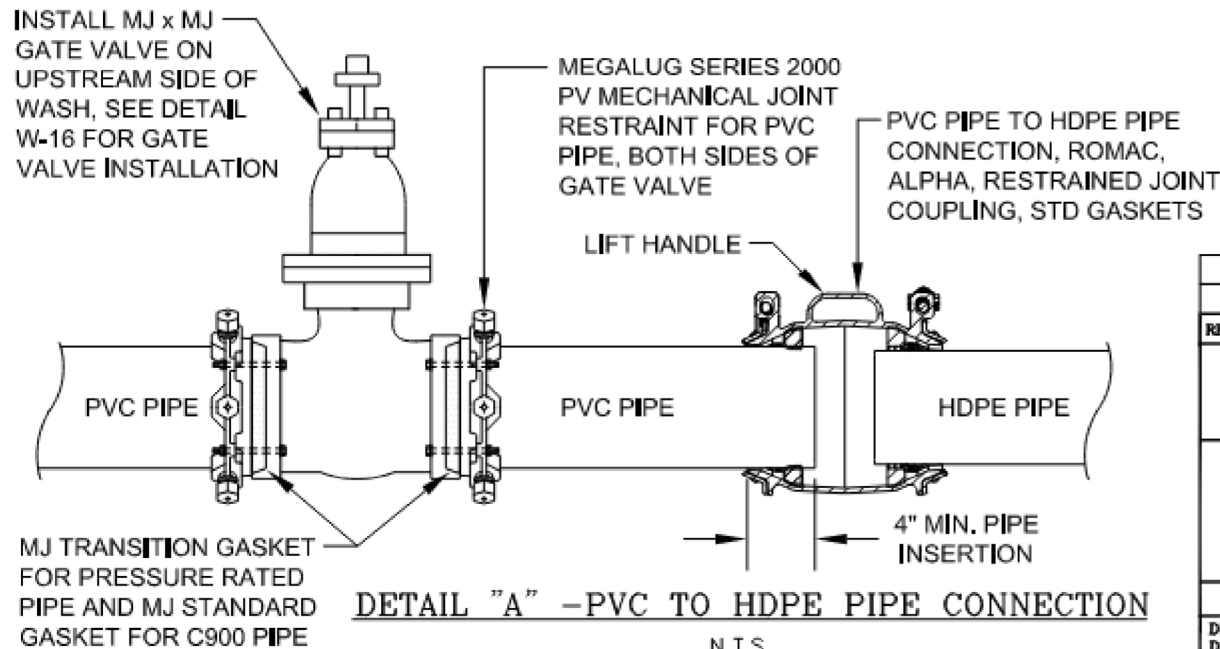

DETAIL "A" - PVC TO HDPE PIPE CONNECTION
N.T.S.

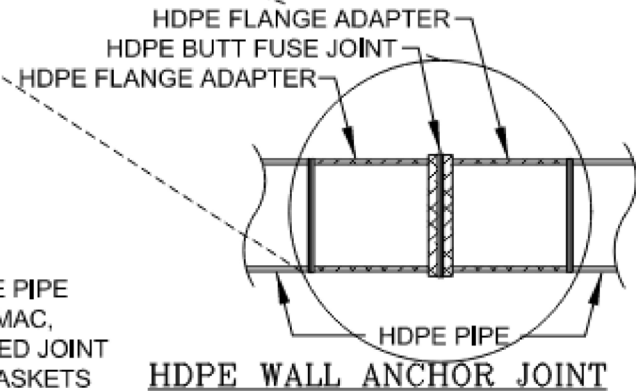


REVISION	DATE	BRIEF	BY
U.S. DEPARTMENT OF HEALTH AND HUMAN SERVICES PUBLIC HEALTH SERVICE INDIAN HEALTH SERVICE NAVAJO NATION			
STANDARD DRAWING No. W-33 HDPE WASH CROSSING DETAIL FOR 4" THRU 12" PIPE			
NAVAJO ENGINEERING & CONSTRUCTION AUTHORITY			
DRAWN BY: WZS DATE: 8/24/16	CHECKED BY: S.C. DATE: 8/24/16	APPR. BY: S.C. DATE: 8/24/16	AUTOCAD DRAWING

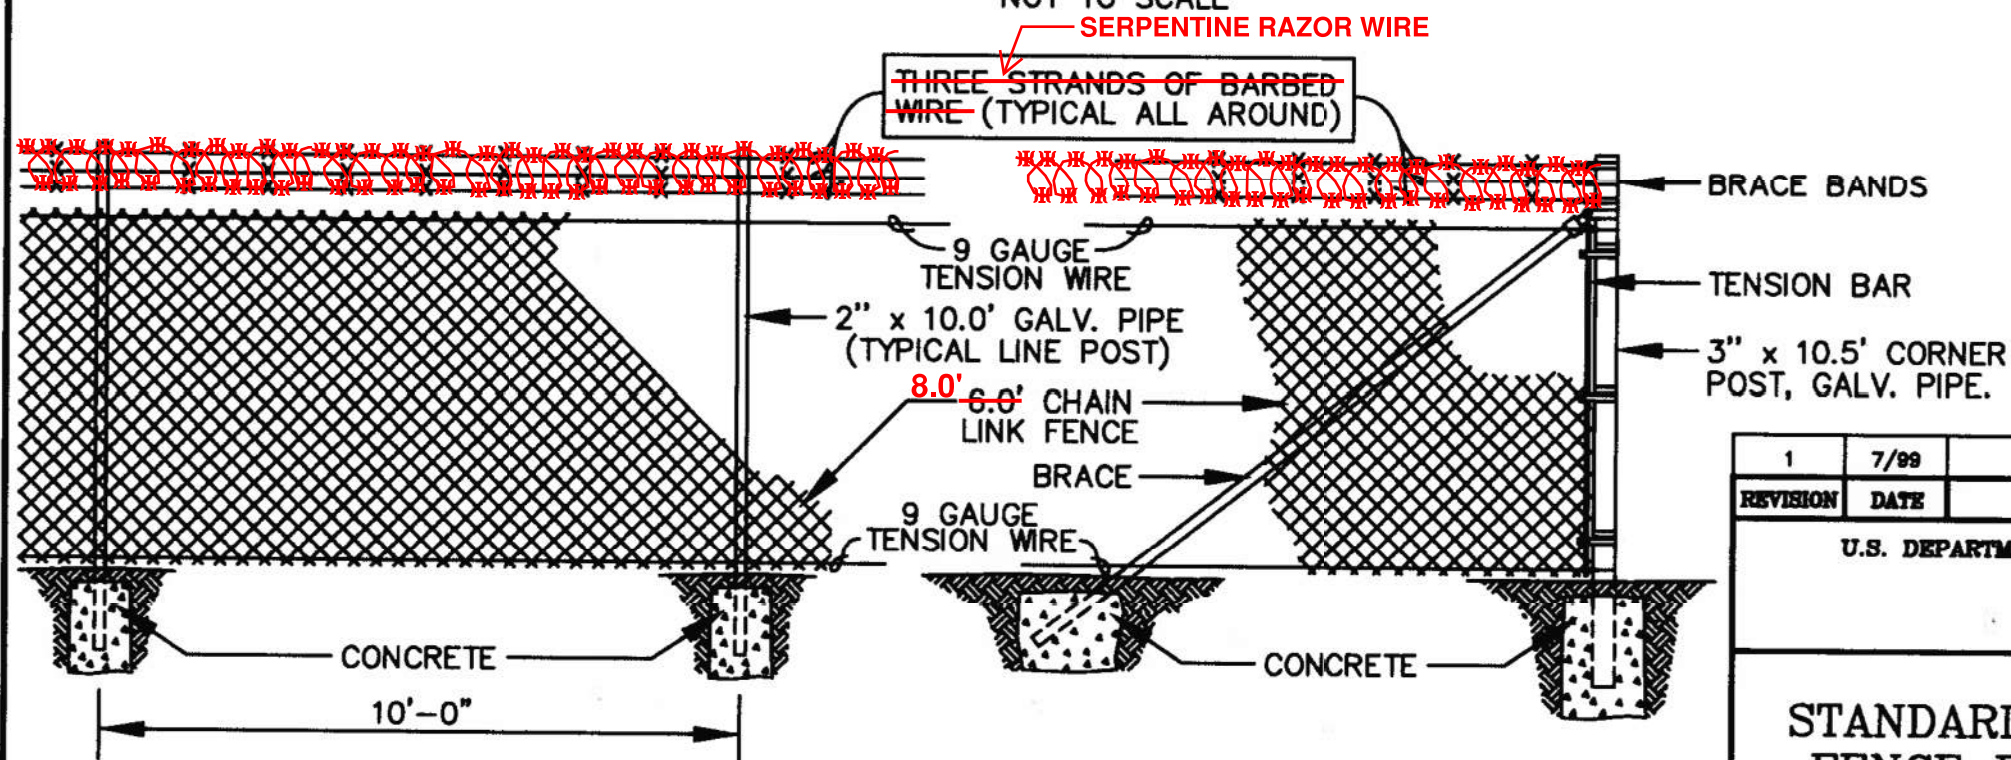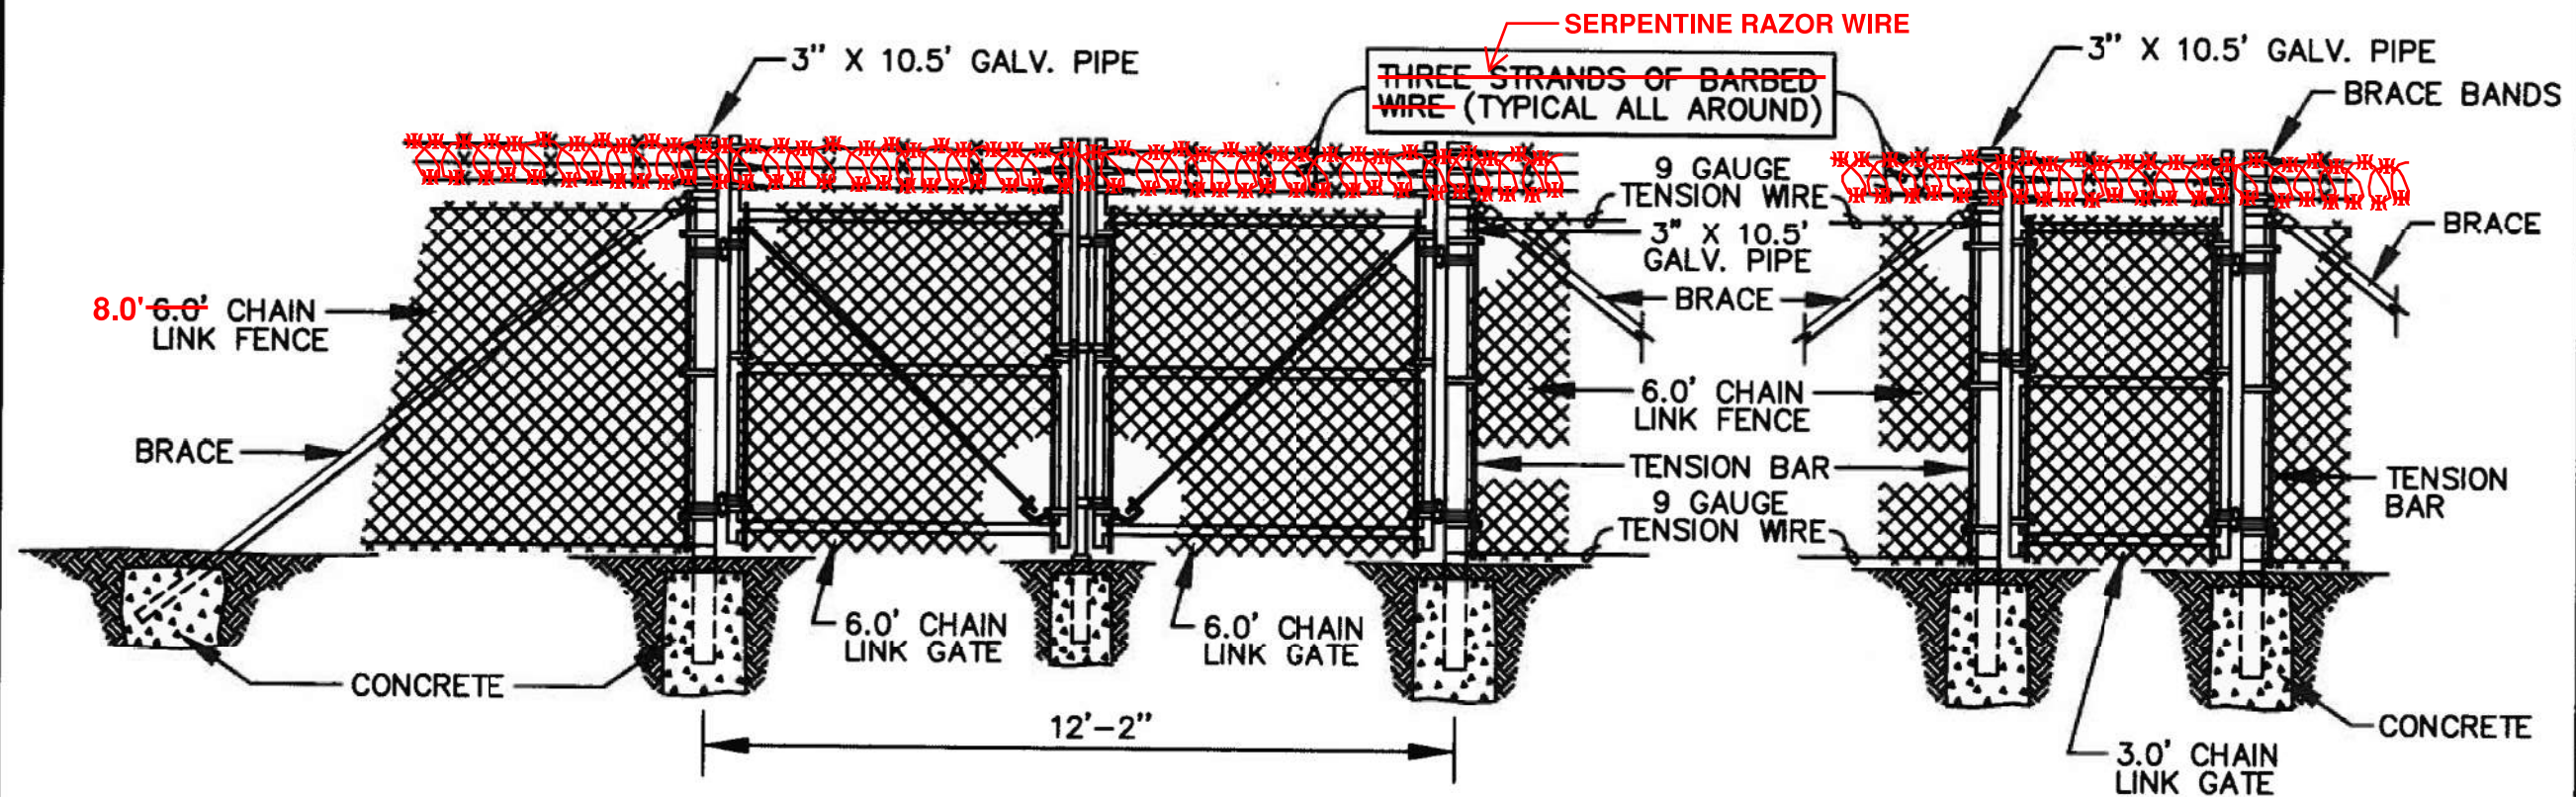


1	7/99	STANDARDIZED	B.M.
REVISION	DATE	BRIEF	BY
U.S. DEPARTMENT OF HEALTH AND HUMAN SERVICES PUBLIC HEALTH SERVICE INDIAN HEALTH SERVICE NAVAJO NATION			
NAVAJO NATION, STANDARD DRAWING NO. W-34 FENCE DETAIL FOR STORAGE TANK & PUMPHOUSE			
OFFICE OF ENVIRONMENTAL HEALTH AND ENGINEERING NAVAJO AREA OFFICE, WINDOW ROCK, ARIZONA			
DRAWN BY: L.S. DATE: 12/92	CHECKED BY: P.S. DATE: 12/92	APPR. BY: P.S. DATE: 12/92	AUTOCAD DRAWING

SILT FENCE DETAILS

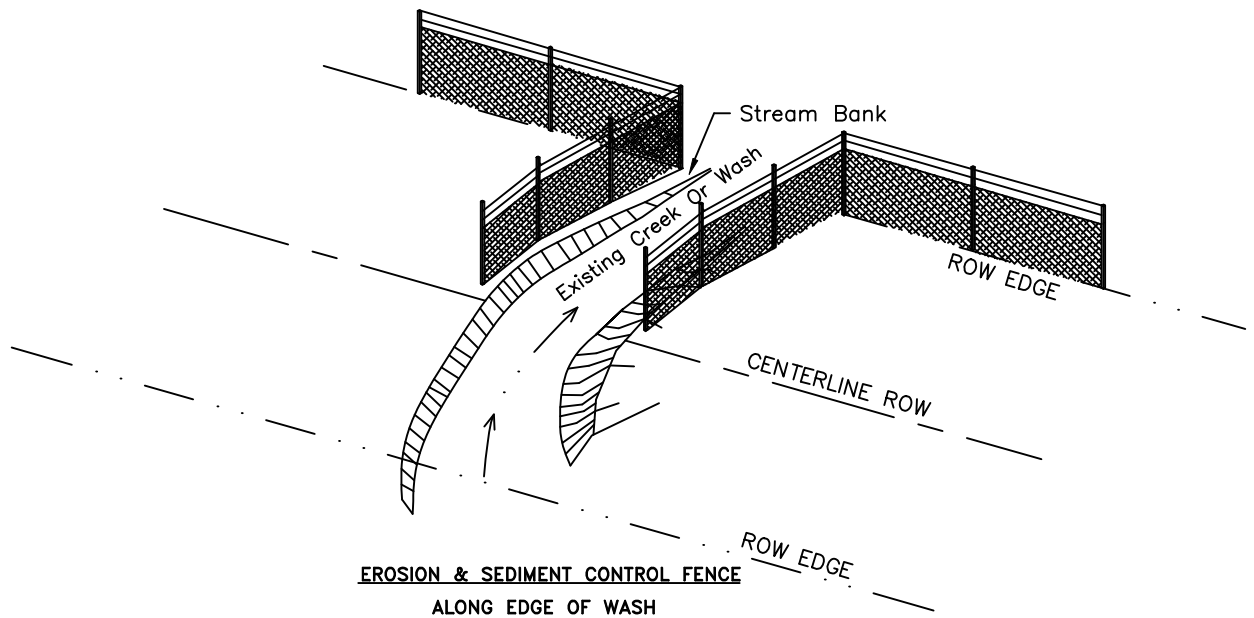


INSTALLATION NOTES

1. THE SILT FENCING CONSISTS OF 3' SEDIMENT CONTROL FABRIC CLOTH WITH BURIED-TOE AND WOODEN OR STEEL POSTS (TEE OR U TYPE) 10' AND SHALL COMPLY WITH AASHTO M-288.
2. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED BY 6" AND FOLDED. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

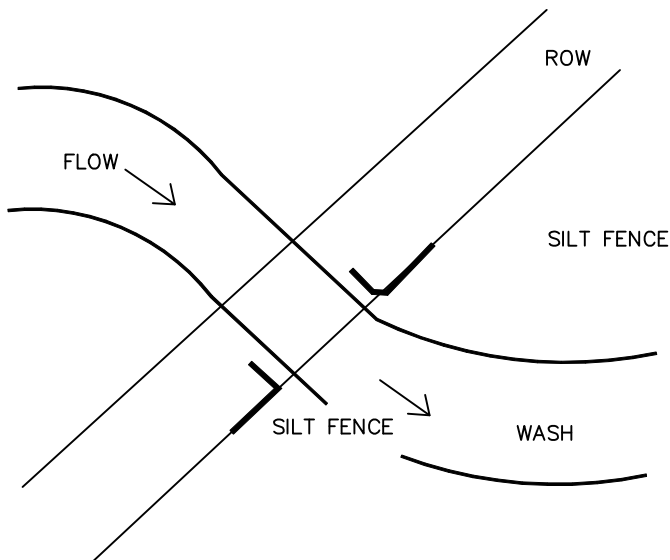


SILT FENCE:
PLAN VIEW

REVISION	DATE	BRIEF	BY
DEPARTMENT OF HEALTH AND HUMAN SERVICES U.S. PUBLIC HEALTH SERVICE INDIAN HEALTH SERVICE NAVAJO NATION			
NAVAJO NATION STANDARD DRAWING NO. W-39 SILT FENCE DRAWING 1 OF 2			
PUBLIC LAW 86-121 OFFICE OF ENVIRONMENTAL HEALTH AND ENGINEERING NAVAJO AREA OFFICE, WINDOW ROCK, ARIZONA			
DRAWN BY: TL DATE: 9/01	CHECKED BY: RG DATE: 9/01	APPR. BY: BM DATE: 9/01	AUTOCAD DRAWING

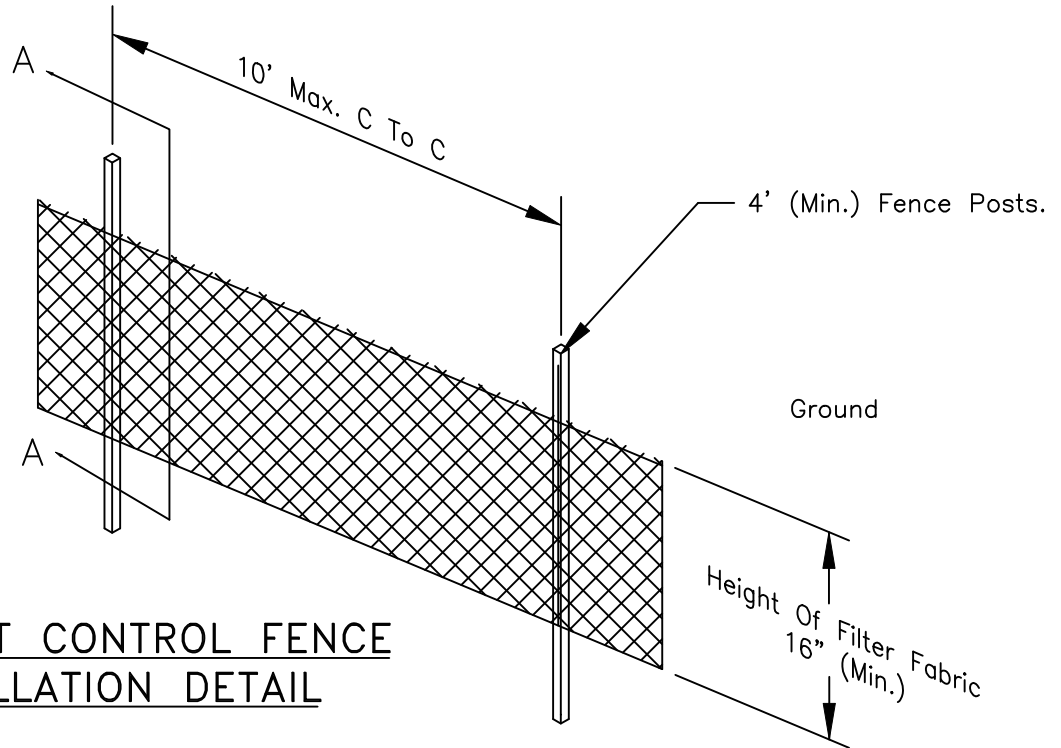


SEDIMENT CONTROL FENCE INSTALLATION DETAIL

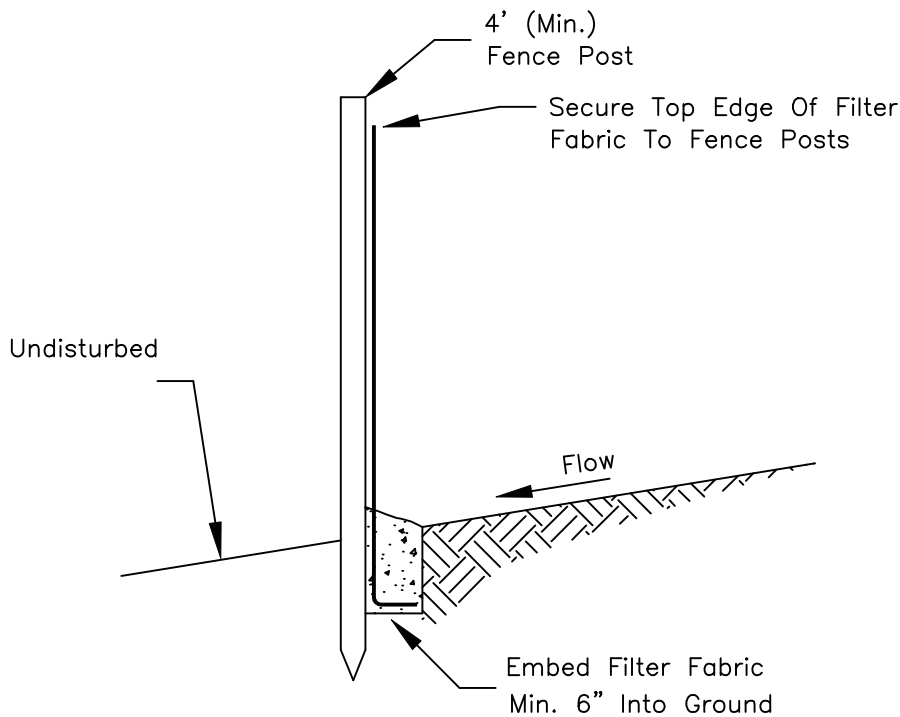

SECTION A-A

REVISION	DATE	BRIEF	BY
DEPARTMENT OF HEALTH AND HUMAN SERVICES U.S. PUBLIC HEALTH SERVICE INDIAN HEALTH SERVICE NAVAJO NATION			
NAVAJO NATION STANDARD DRAWING NO. W-39 SILT FENCE DRAWING 2 OF 2			
PUBLIC LAW 86-121 OFFICE OF ENVIRONMENTAL HEALTH AND ENGINEERING NAVAJO AREA OFFICE, WINDOW ROCK, ARIZONA			
DRAWN BY: TL DATE: 9/01	CHECKED BY: RG DATE: 9/01	APPR. BY: BM DATE: 9/01	AUTOCAD DRAWING

STRAW BALE DETAILS (For Check Dams to Retain Water and Sediment)

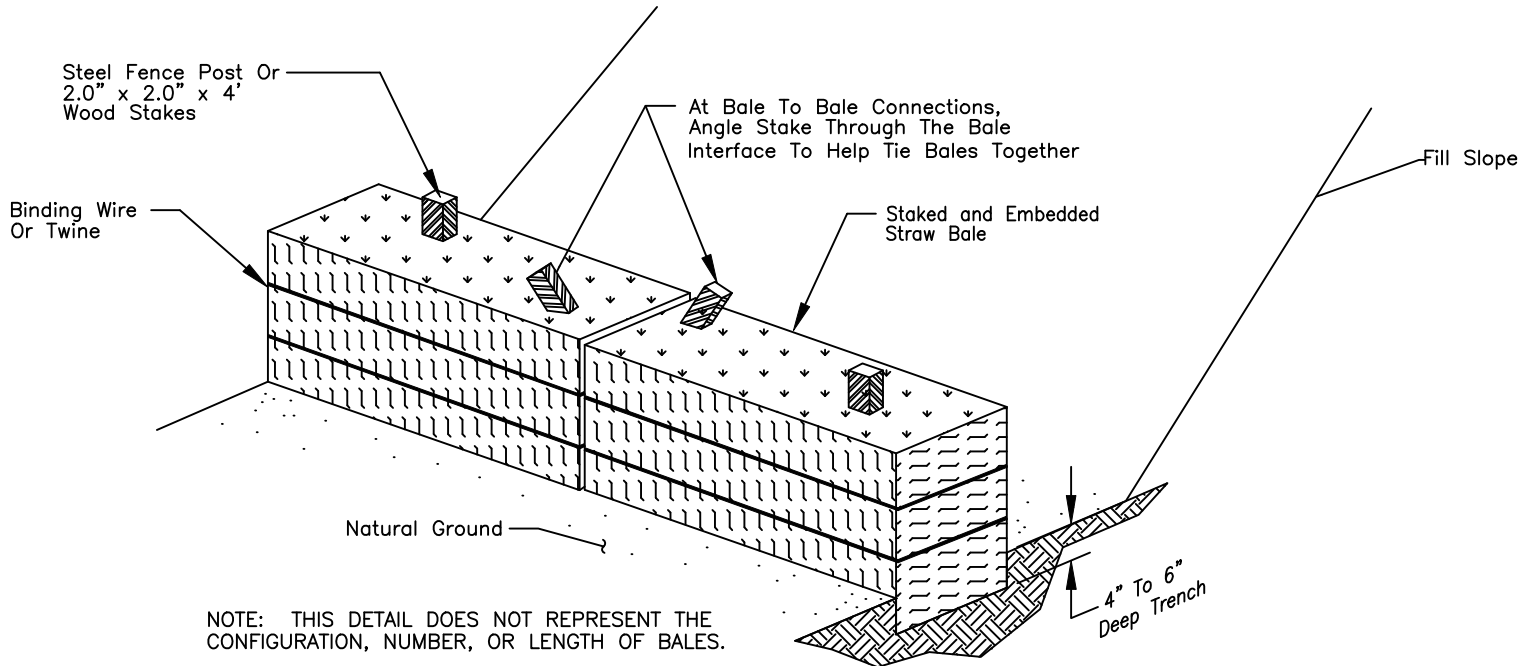


TYPICAL STRAW BALE STAKING AND TRENCHING DETAIL

INSTALLATION NOTES

1. STRAW BALES MAY BE USED FOR DIKES PROVIDED THEY ARE PROPERLY ANCHORED WITH STEEL FENCE POSTS OR 2" X 2" X 4' WOOD STAKES (TWO PER BALE) ANCHORED 1.5' INTO THE NATURAL GROUND. STRAW BALES SHALL BE CERTIFIED 0.5% WEED FREE. DO NOT USE STRAW BALES IN AREAS OF CONCENTRATED FLOW AND CUT DITCHES.

GENERAL NOTES

1. THE CONTRACTOR SHALL HAVE ON-SITE A COPY OF THE STORM WATER POLLUTION PREVENTION PLAN (SWPPP) WITH PROJECT SPECIFIC COVER SHEET.
2. CONSTRUCT CHECK DAMS AND/OR FILTERS IN STRATEGIC LOCATIONS ON THE PROJECT TO FILTER STORM RUNOFF BEFORE IT LEAVES THE PROJECT CONSTRUCTION LIMITS OR ENTERS A WASH. SEE PROJECT CONSTRUCTION PLANS FOR LOCATIONS OF CHECK DAMS & FILTERS.
3. CLEAN ALL SEDIMENT BASIN AND TRAPS OF ACCUMULATED SEDIMENT WHEN HALF FULL OF SEDIMENT.
4. THE CONTRACTOR SHALL INSPECT AND MAINTAIN ALL SWPPP MEASURES MONTHLY AND AFTER EACH SIGNIFICANT STORM EVENT (I.E. 0.5 IN. OF MOISTURE IN 24 HOURS).
5. THE CONTRACTOR, IN CONSULTATION WITH THE PROJECT ENGINEER SHALL ADJUST THE DIMENSIONS AND/OR LOCATIONS OF TEMPORARY SEDIMENT AND EROSION CONTROL DEVICES TO FIT ACTUAL FIELD CONDITIONS. ALL ADJUSTMENTS WILL BE DOCUMENTED ON THE INSPECTION FORMS INCLUDED WITH THE SWPPP.
6. REMOVE AND DISPOSE OF EROSION CONTROL MEASURES WHEN THE PERMANENT EROSION CONTROL MEASURES ARE SATISFACTORILY ESTABLISHED.

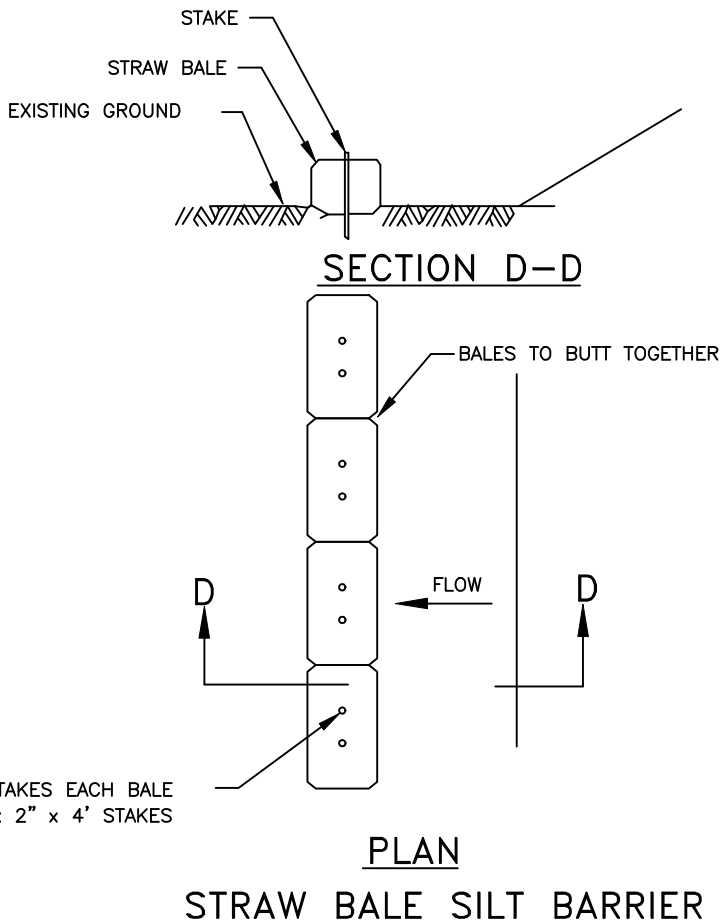


REVISION	DATE	BRIEF	BY
DEPARTMENT OF HEALTH AND HUMAN SERVICES U.S. PUBLIC HEALTH SERVICE INDIAN HEALTH SERVICE NAVAJO NATION			
NAVAJO NATION STANDARD DRAWING NO. W-40 STRAW BALES			
PUBLIC LAW 86-121 OFFICE OF ENVIRONMENTAL HEALTH AND ENGINEERING NAVAJO AREA OFFICE, WINDOW ROCK, ARIZONA			
DRAWN BY: TL DATE: 9/01	CHECKED BY: RG DATE: 9/01	APPR. BY: BM DATE: 9/01	AUTOCAD DRAWING


NAVAJO TRIBAL UTILITY AUTHORITY
CONTROL PANEL LAYOUT




AC TANK CONTROL PANEL


SCHEDULE OF DRAWINGS			
PAGE	FILENAME	TITLE	NOTES
1	AC_CV	COVERSHEET	SCHEDULE OF DRAWINGS
2	AC_DIO	DISCRETE I/O	WIRING
3	AC_AIO	ANALOG I/O	WIRING
4	AC_PWR	POWER DISTRIBUTION	WIRING
5	AC_BP	BACKPLANE LAYOUT	BP W/ BOM
6	AC_CBL	COMM CABLES PINOUT	WIRING


NO.	DATE	DESCRIPTION	BY
 NAVAJO TRIBAL UTILITY AUTHORITY			
SCALE: NONE	REVISIONS		BY DATE
DATE:			
DRN:	CRD:		
APVD:			
TITLE: AC TANK PANEL		NO. #	
COVER SHEET		SHEET 1 OF 6	

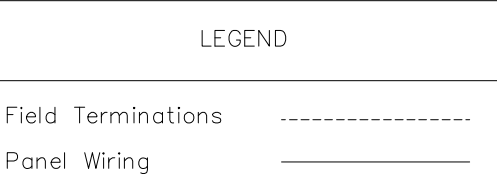

01	3/19	DWG. UPDATES						NTUA	
NO.	DATE	DESCRIPTION						BY	
 NAVAJO TRIBAL UTILITY AUTHORITY									
SCALE: NONE		REVISIONS					BY	DATE	
DATE:	
DRN.	OKD.						.	.	
AP'D: .							.	.	
TITLE		AC TANK CONTROL PANEL					W.O.#		
		DISCRETE 1/0					SHEET 2 OF 6		



POWER DISTRIBUTION THIS PAGE REFLECTS "LOGICAL" SCHEMATIC SEE "DC DISTRIBUTION" DRAWING AND "AC DISTRIBUTION" DRAWING FOR POINT TO POINT TERMINATIONS

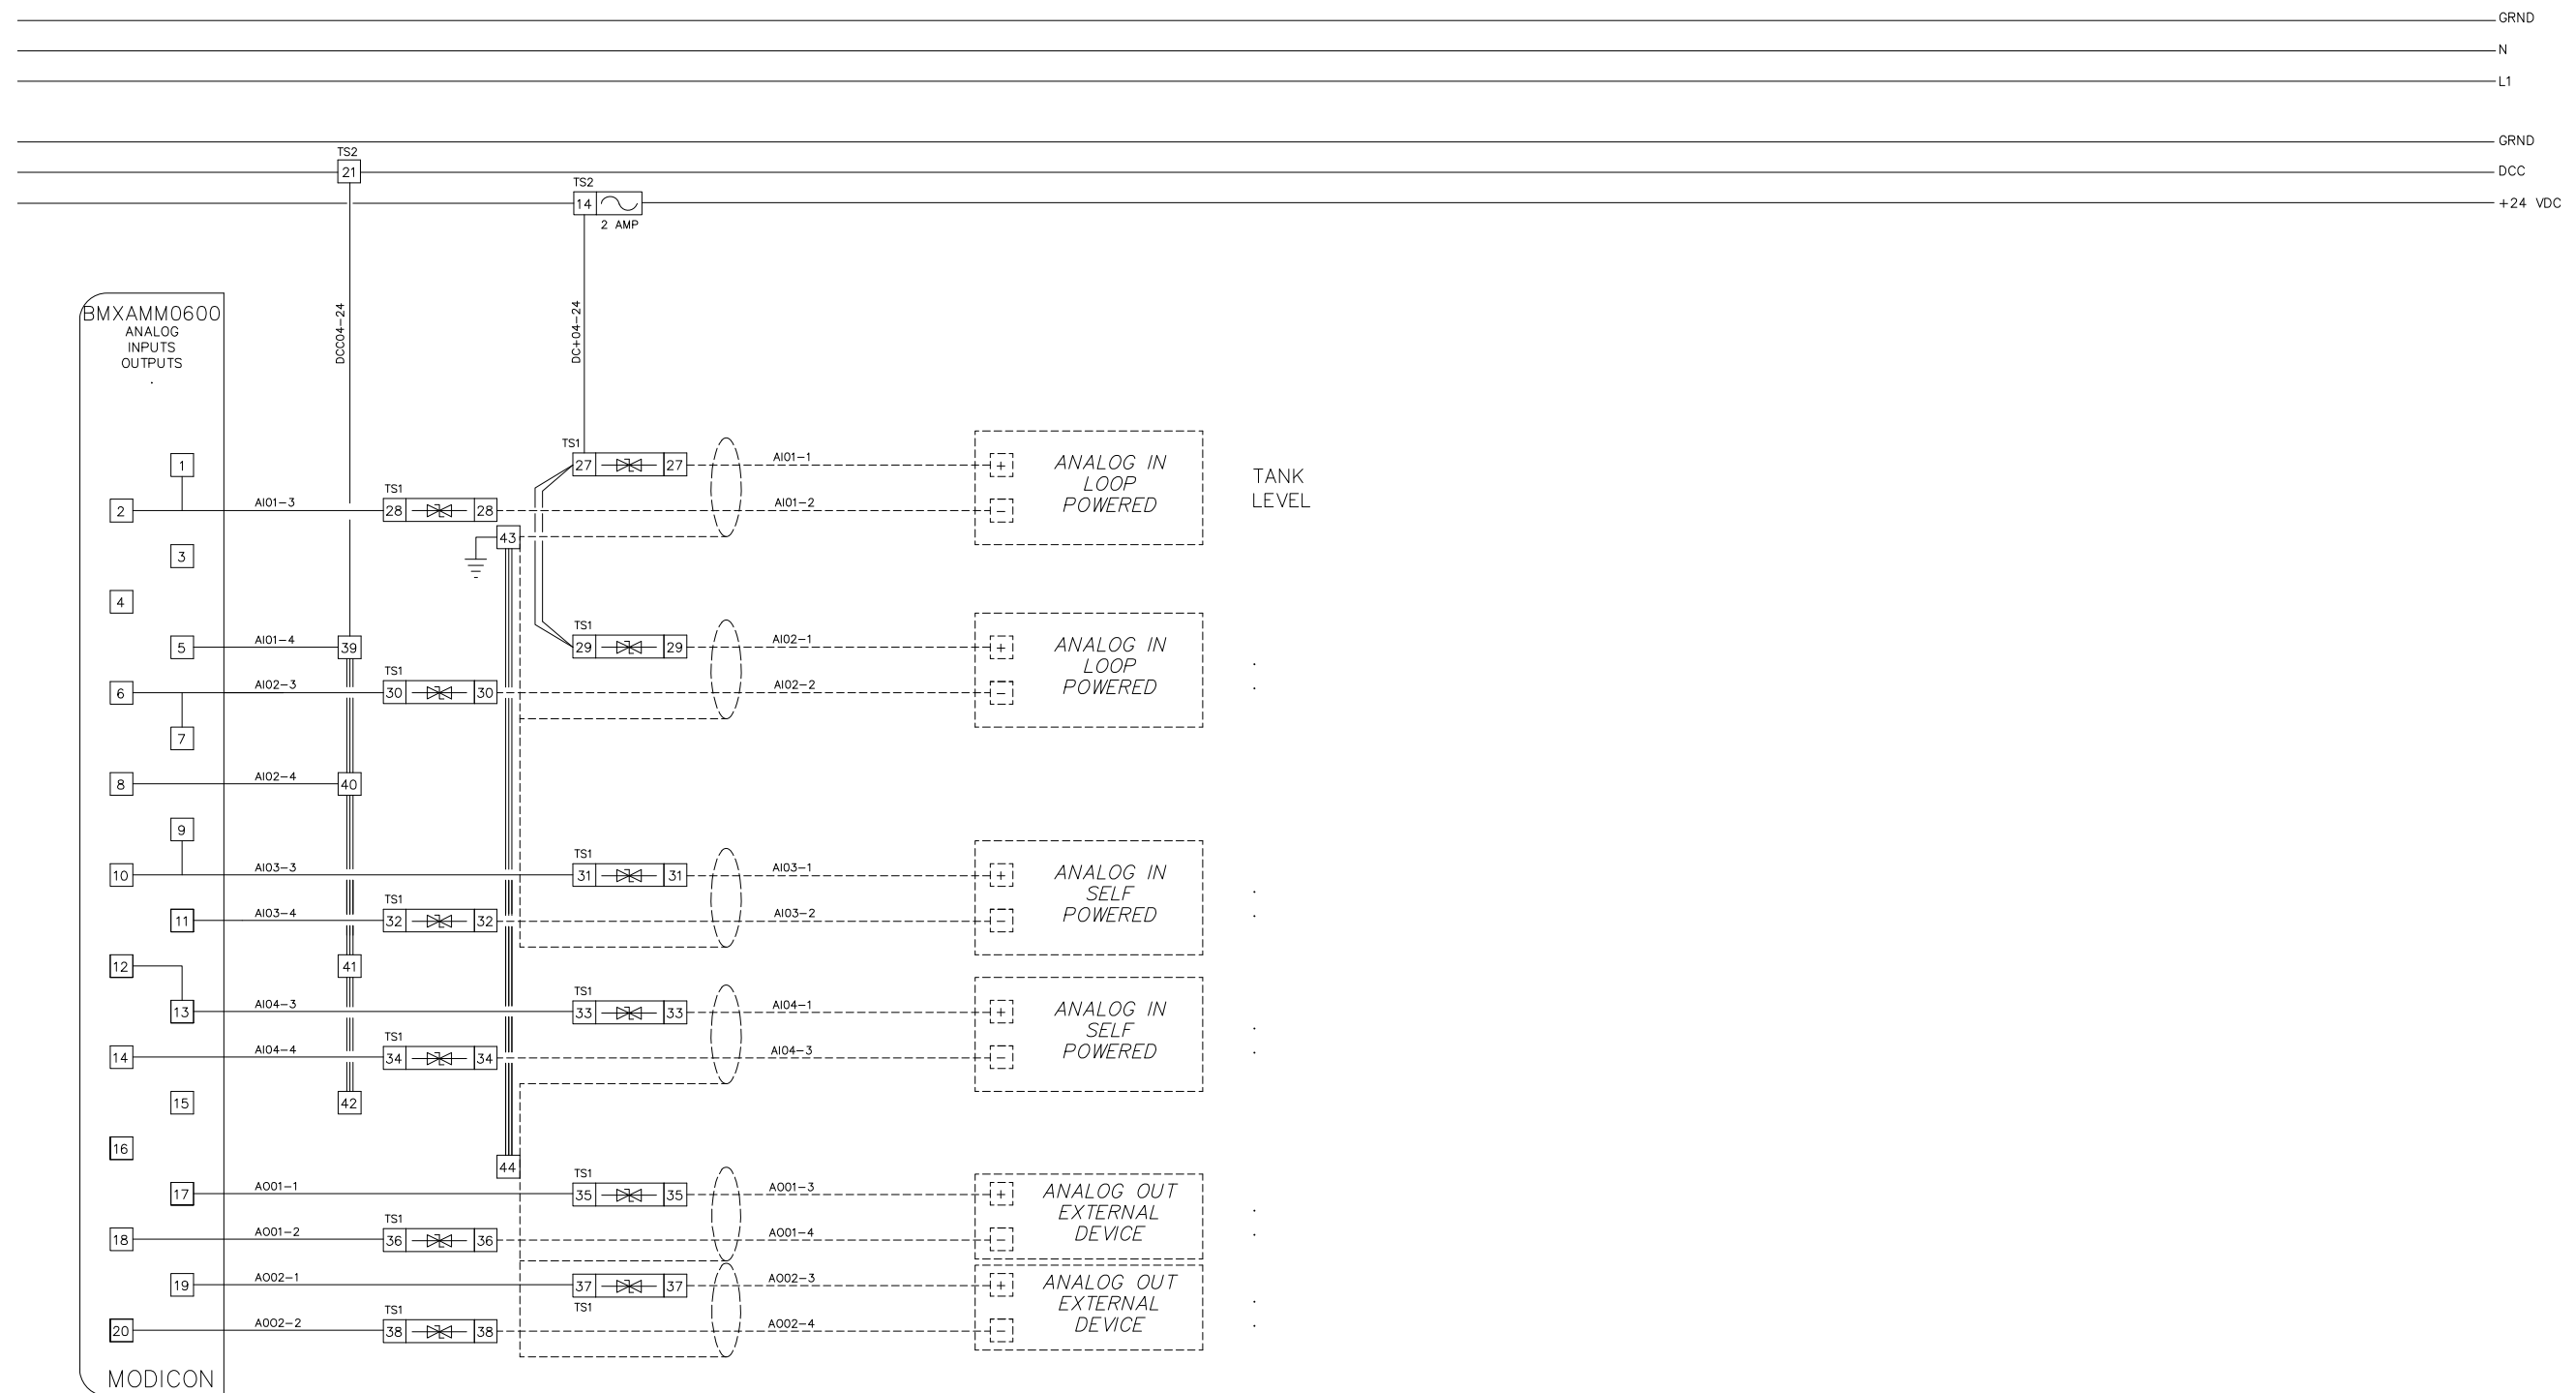

01	3/19	DWG UPDATES		NTUA
NO.	DATE	DESCRIPTION		BY
 NAVAJO TRIBAL UTILITY AUTHORITY				
SCALE:	NONE	REVISIONS	BY	DATE
DATE:			-	-
DRYN.			-	-
ORD.			-	-
APVD.			-	-
TITLE			W.O.#	
AC TANK CONTROL PANEL				
ANALOG I/O			SHEET 3 OF 6	

LEGEND

Field Terminations	-----
Panel Wiring	_____

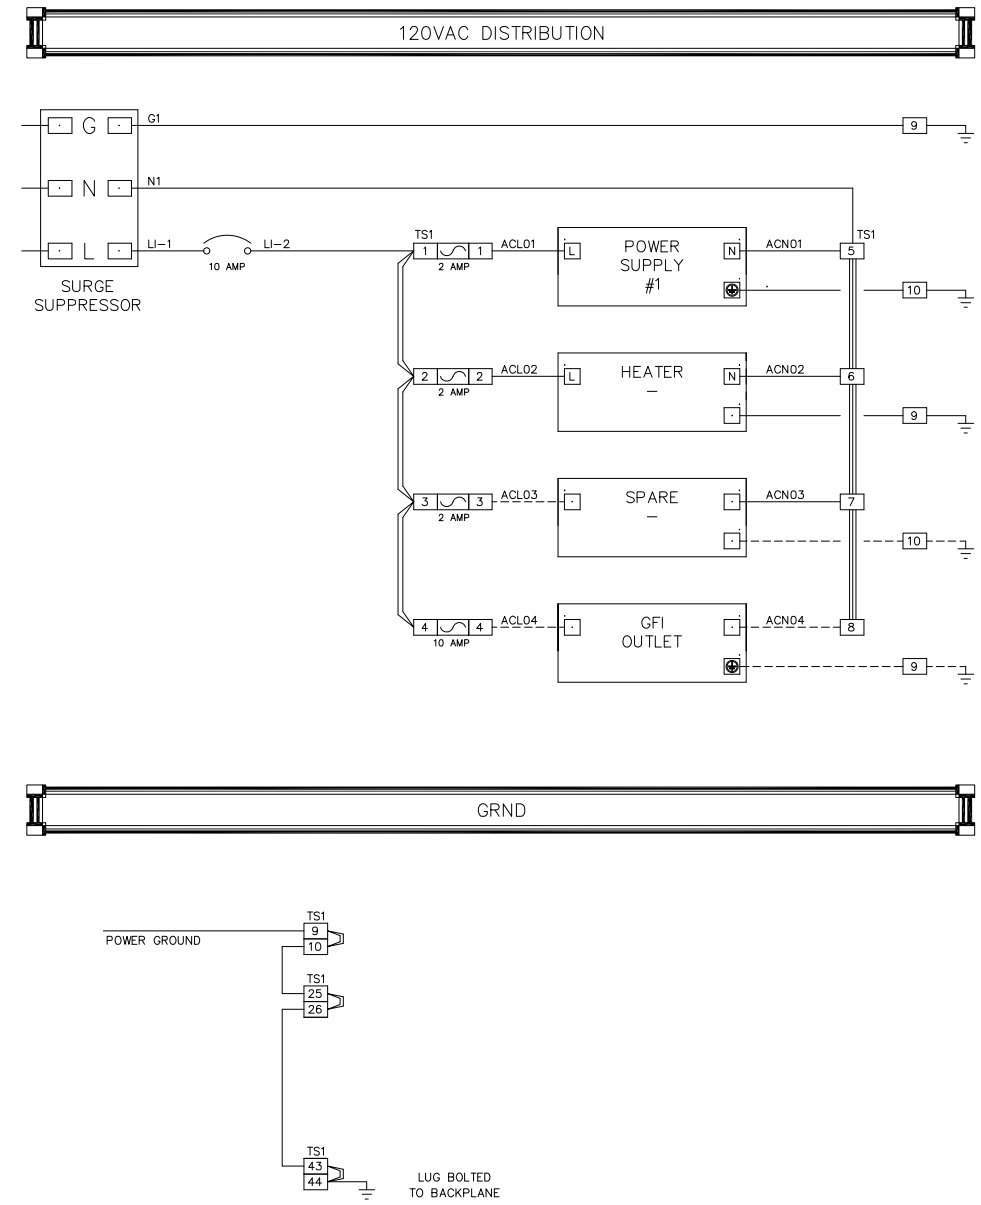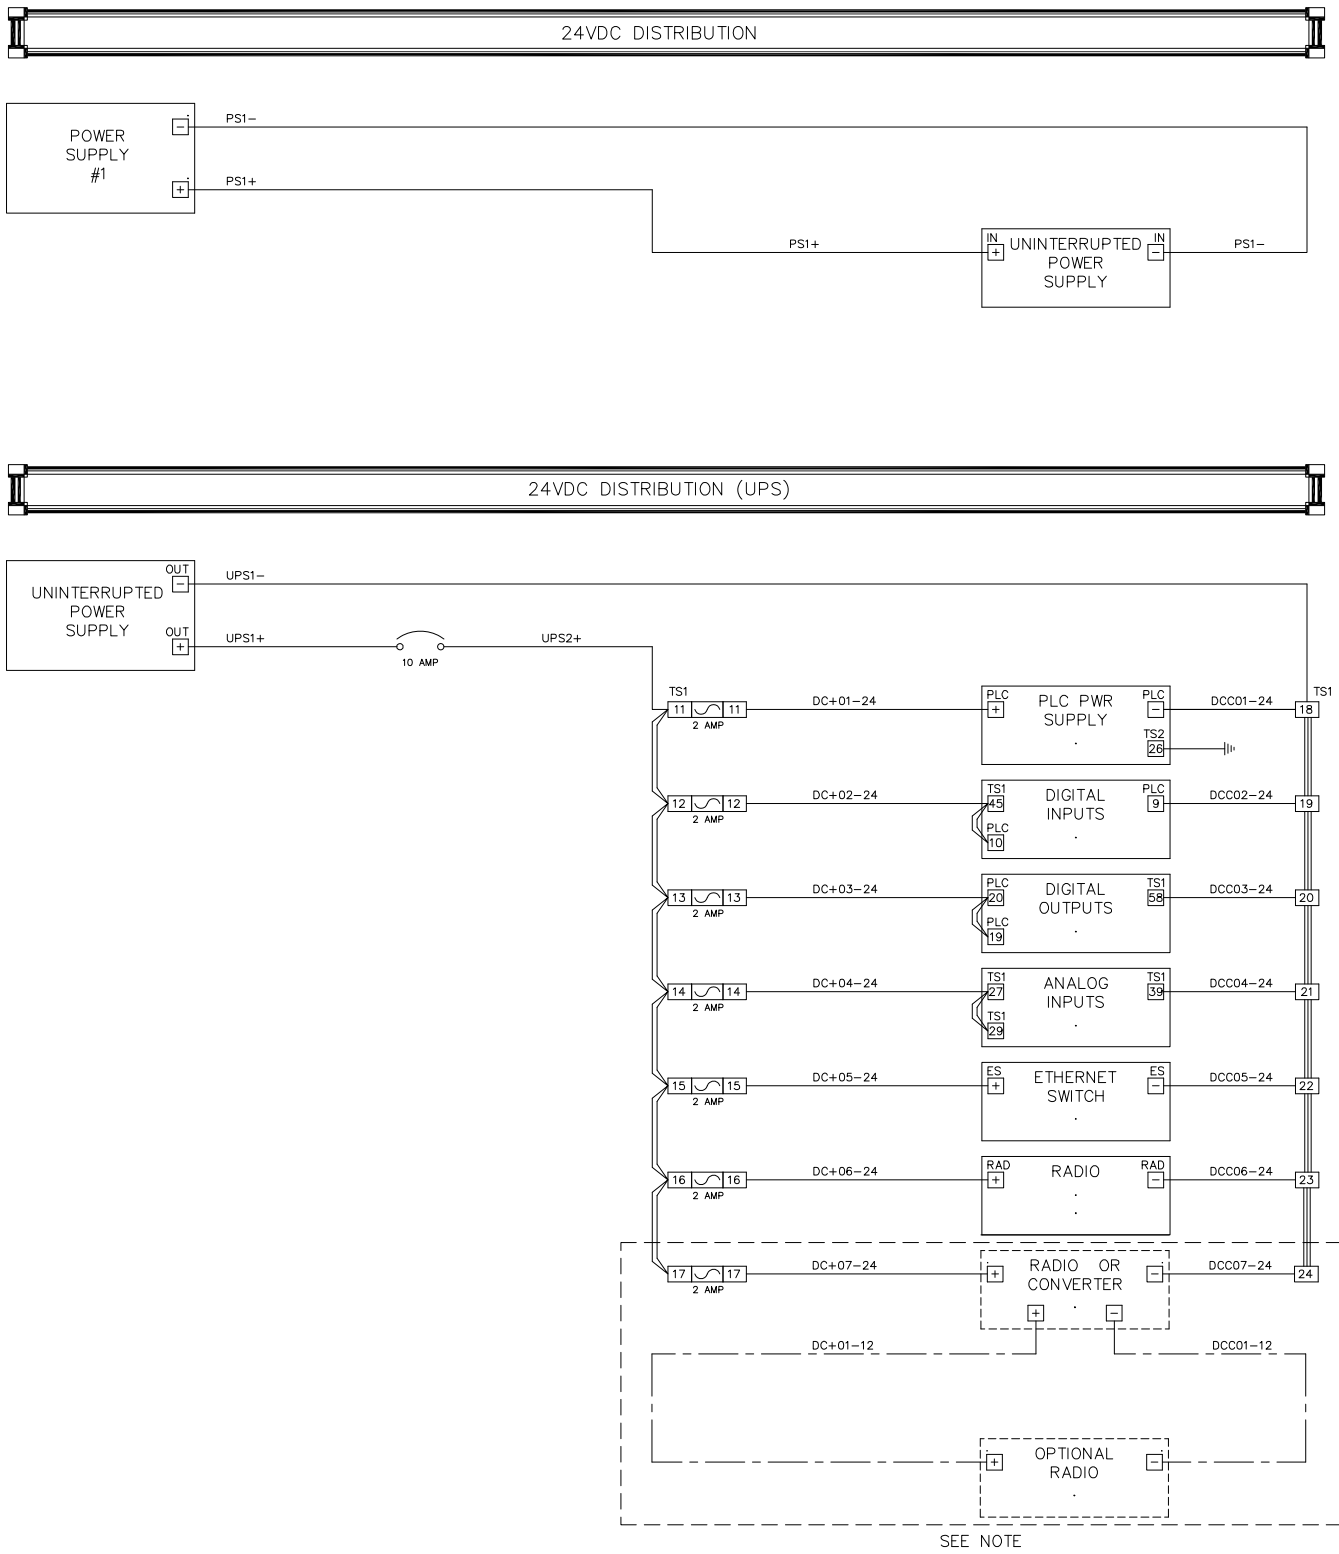


NOTE: SEE OPTIONS BELOW IF ADDITIONAL RADIO IS REQUIRED, IMPLEMENT ONE OF THE TWO OPTIONS BELOW. OTHERWISE, THIS AREA CAN BE LEFT VACANT FOR ANY FUTURE POWER REQUIREMENTS:

OPTION #1; WHEN INSTALLING A 24 VDC RADIO, WIRE RADIO DIRECTLY TO TERMINALS 17 & 24 ON TS1.

OPTION #2; WHEN INSTALLING A 12-13.8 VDC RADIO, INSTALL DC/DC CONVERTER POWERED BY TERMINALS 17 & 24 ON TS1, THEN WIRE RADIO DIRECTLY TO THE DC/DC CONVERTER.

LEGEND	
Field Terminations	-----
Panel Wiring	_____


01	3/19	DWG UPDATES	NTUA
NO.	DATE	DESCRIPTION	BY
NAVAJO TRIBAL UTILITY AUTHORITY			
SCALE:	REVISIONS		BY DATE
DATE:			
DRN:	CRD:		
APVD:			
TITLE AC TANK CONTROL PANEL			W.O.#
POWER DISTRIBUTION			SHEET 4 OF 6

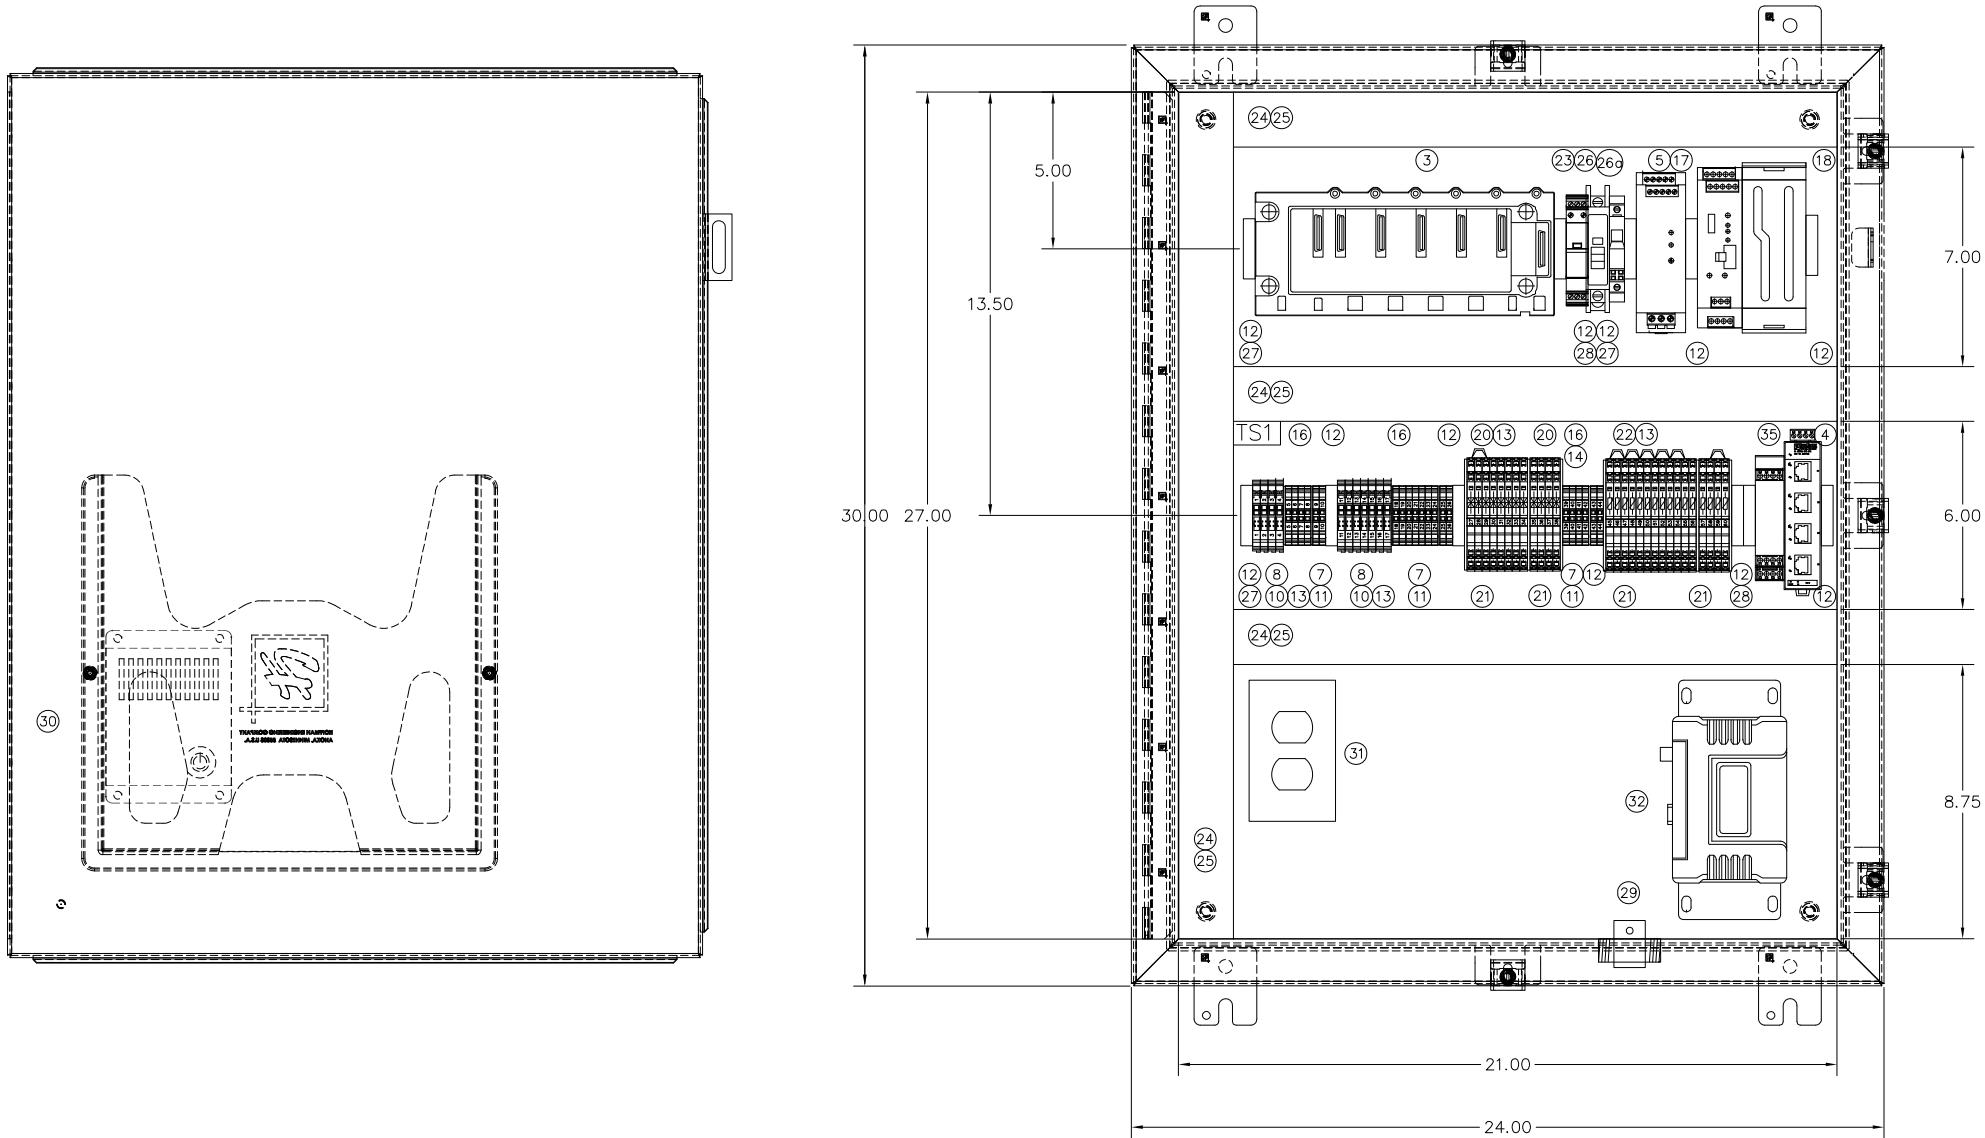

BILL OF MATERIALS				
ITEM	QTY	PART NO.	DESCRIPTION	MFG
1	1	A30H24DLP	SINGLE-DOOR TYPE 4 ENCLOSURE	HOFFMAN
2	1	A30P24	BACKPLANE	HOFFMAN
3*	.	M340	MODICON M340 BOM	SCHNEIDER ELECTRIC
3a	1	BMXXBM0400	4-SLOT RACK	SCHNEIDER ELECTRIC
3b	1	BMXCPS3020	MODULE POWER SUPPLY	SCHNEIDER ELECTRIC
3c	1	BMXP342020	MODULE CPU PROCESSOR	SCHNEIDER ELECTRIC
3d	1	BMXDM16025	MODULE DIGITAL INPUT/OUTPUT	SCHNEIDER ELECTRIC
3e	1	BMXAMM0600	MODULE ANALOG INPUT/OUTPUT	SCHNEIDER ELECTRIC
3f	2	BMXFTB2010	REMOVABLE CONNECTION BLOCK - SCREW CLAMP	SCHNEIDER ELECTRIC
3g*	1	BMXNOM0200	SERIAL LINK	SCHNEIDER ELECTRIC
4	1	FL SWITCH SFN 5TX	MODULE INDUSTRIAL ETHERNET	PHOENIX CONTACT
5	1	QUINT4-PS/1AC/ 24DC/5	SWITCH POWER SUPPLY	PHOENIX CONTACT
6	.	.	22.5-28.5V ADJUSTABLE	.
7	14	UT2,5	UT2,5 TERMINALS	PHOENIX CONTACT
8	10	UT4TG	FUSE TERMINAL BASE	PHOENIX CONTACT
9	7	P-FU5X20LED24	FUSE PLUG	PHOENIX CONTACT
10	4	P-FU5X20LA250	FUSE PLUG	PHOENIX CONTACT
11	6	UT2,5PE	GROUNDING TERMINAL	PHOENIX CONTACT
12	15	E/NS35N	END CLAMP	PHOENIX CONTACT
13	3	FBS 20-6 BU #3032208	FIXED BRIDGE	PHOENIX CONTACT
14	3	FBS 20-5 BU #3036929	INSERTION BRIDGE	PHOENIX CONTACT
15	8	D-UT2,5/10	END COVER	PHOENIX CONTACT
16	4	ATP-UT	PARTITION PLATES	PHOENIX CONTACT
17	2	QUINT4-UPS/24DC /24DC/10	UNINTERRUPTIBLE POWER SUPPLY	PHOENIX CONTACT
18	2	UPS-BAT/VRLA/ 24DC/1.3AH	ENERGY STORAGE	PHOENIX CONTACT
19	.	.	.	PHOENIX CONTACT
20	12	TTC-6-TVSD-C- 24DC-UT-I	SURGE PROTECTION #2906831	PHOENIX CONTACT
21	6	TTC-6-LCP #2908729	END COVER	PHOENIX CONTACT
22	16	TTC-6-MOV-C- 24DC-UT-I	SURGE PROTECTION # 2906837	PHOENIX CONTACT
23	1	PLT-SEC-T3-120 -FM #2905228	TYPE 3 SURGE PROTECTION DEVICE	PHOENIX CONTACT
24	AN	F2X4LG6	TYPE F NARROW SLOT WIRING DUCT	PANDUIT
25	AN	C2LG6	WIRING DUCT COVER	PANDUIT
26	1	TMC 61C 10A #0902072	CIRCUIT BREAKER	PHOENIX CONTACT
26a	1	UT6-TMCM 10A #0916610	CIRCUIT BREAKER	PHOENIX CONTACT
27	AN	1492DR6	EXTENDED DIN RAIL	ALLEN BRADLEY
28	AN	1492-DR5	DIN RAIL	ALLEN BRADLEY
29	1	IS-50NX-C2	LIGHTNING ARRESTER	POLYPHASER
30	1	D-AH1001A	HEATER 100W 115V .9A	HOFFMAN
31	1	DRUBGF115	DIN RAIL UTILITY BOX	HUBBELL
32	1	ORBIT OR TRANSNET	902 - 928 MHz RADIO	GEMDS
33	1	CAT6	SPREAD SPECTRUM CABLE - PLC TO HMI	BELDEN
34*	1	.	CABLE - PLC TO MODEM (TO LENGTH)	.
35*	1	MINI-PS-12-24 DC/5-15/2	DC/DC CONVERTER	PHOENIX CONTACT


AN - As needed
3* - BOM - To include items 3a-3g.
3g* - Include in the event item 35* is required.
34* - Include (1) additional in the event item 33* is required.
35* - Include in the event a 13.8 VDC radio is required.

01	3/19	DWG UPDATES	NTUA
NO.	DATE	DESCRIPTION	BY
NAVAJO TRIBAL UTILITY AUTHORITY			
SCALE:	NONE	REVISIONS	BY DATE
DATE:	.	.	.
DRN:	CRD:	.	.
APVD:	.	.	.
TITLE AC TANK CONTROL PANEL			SHEET 5 OF 6

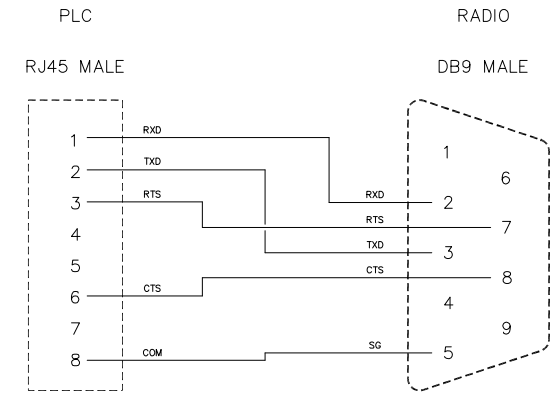

A

CABLE DIAGRAM: PLC TO RADIO


01	3/19	DWG UPDATES	NTUA
NO.	DATE	DESCRIPTION	BY
<div><div></div><div>NAVAJO TRIBAL UTILITY AUTHORITY</div></div>			
SCALE: NONE		REVISIONS	BY DATE
DATE: . .			
DRN: .	CRD: .		
APVD: .			
TITLE: AC TANK CONTROL PANEL		NO.#	
CABLE PINOUT		SHEET 6 OF 6	

NAVAJO TRIBAL UTILITY AUTHORITY
PUMP CONTROL PANEL LAYOUT


SCHEDULE OF DRAWINGS			
SHEET	FILENAME	TITLE	NOTES
1	PLC_CV	COVERSHEET	SCHEDULE OF DRAWINGS
2	PLC_DIO	DISCRETE I/O	WIRING
3	PLC_AIO	ANALOG I/O	WIRING
4	PLC_PWR	POWER DISTRIBUTION	WIRING
5	PLC_BP	BACKPLANE LAYOUT	BP W/ BOM
5A	PLC_SOP	SWING OUT PANEL	BP W/ BOM
6	PLC_CBL	COMM CABLES PINOUT	



PLC CONTROL PANEL

NO.	DATE	DESCRIPTION	BY
 <i>NAVAJO TRIBAL UTILITY AUTHORITY</i>			
SCALE: NONE	REVISIONS		BY DATE
DATE:			
DRN:	CRD:		
APVD:			
TITLE: PLC CONTROL PANEL			W.O.#
COVER SHEET			SHEET 1 OF 6

POWER DISTRIBUTION THIS PAGE REFLECTS "LOGICAL" SCHEMATIC SEE "DC DISTRIBUTION" DRAWING AND "AC DISTRIBUTION" DRAWING FOR POINT TO POINT TERMINATIONS

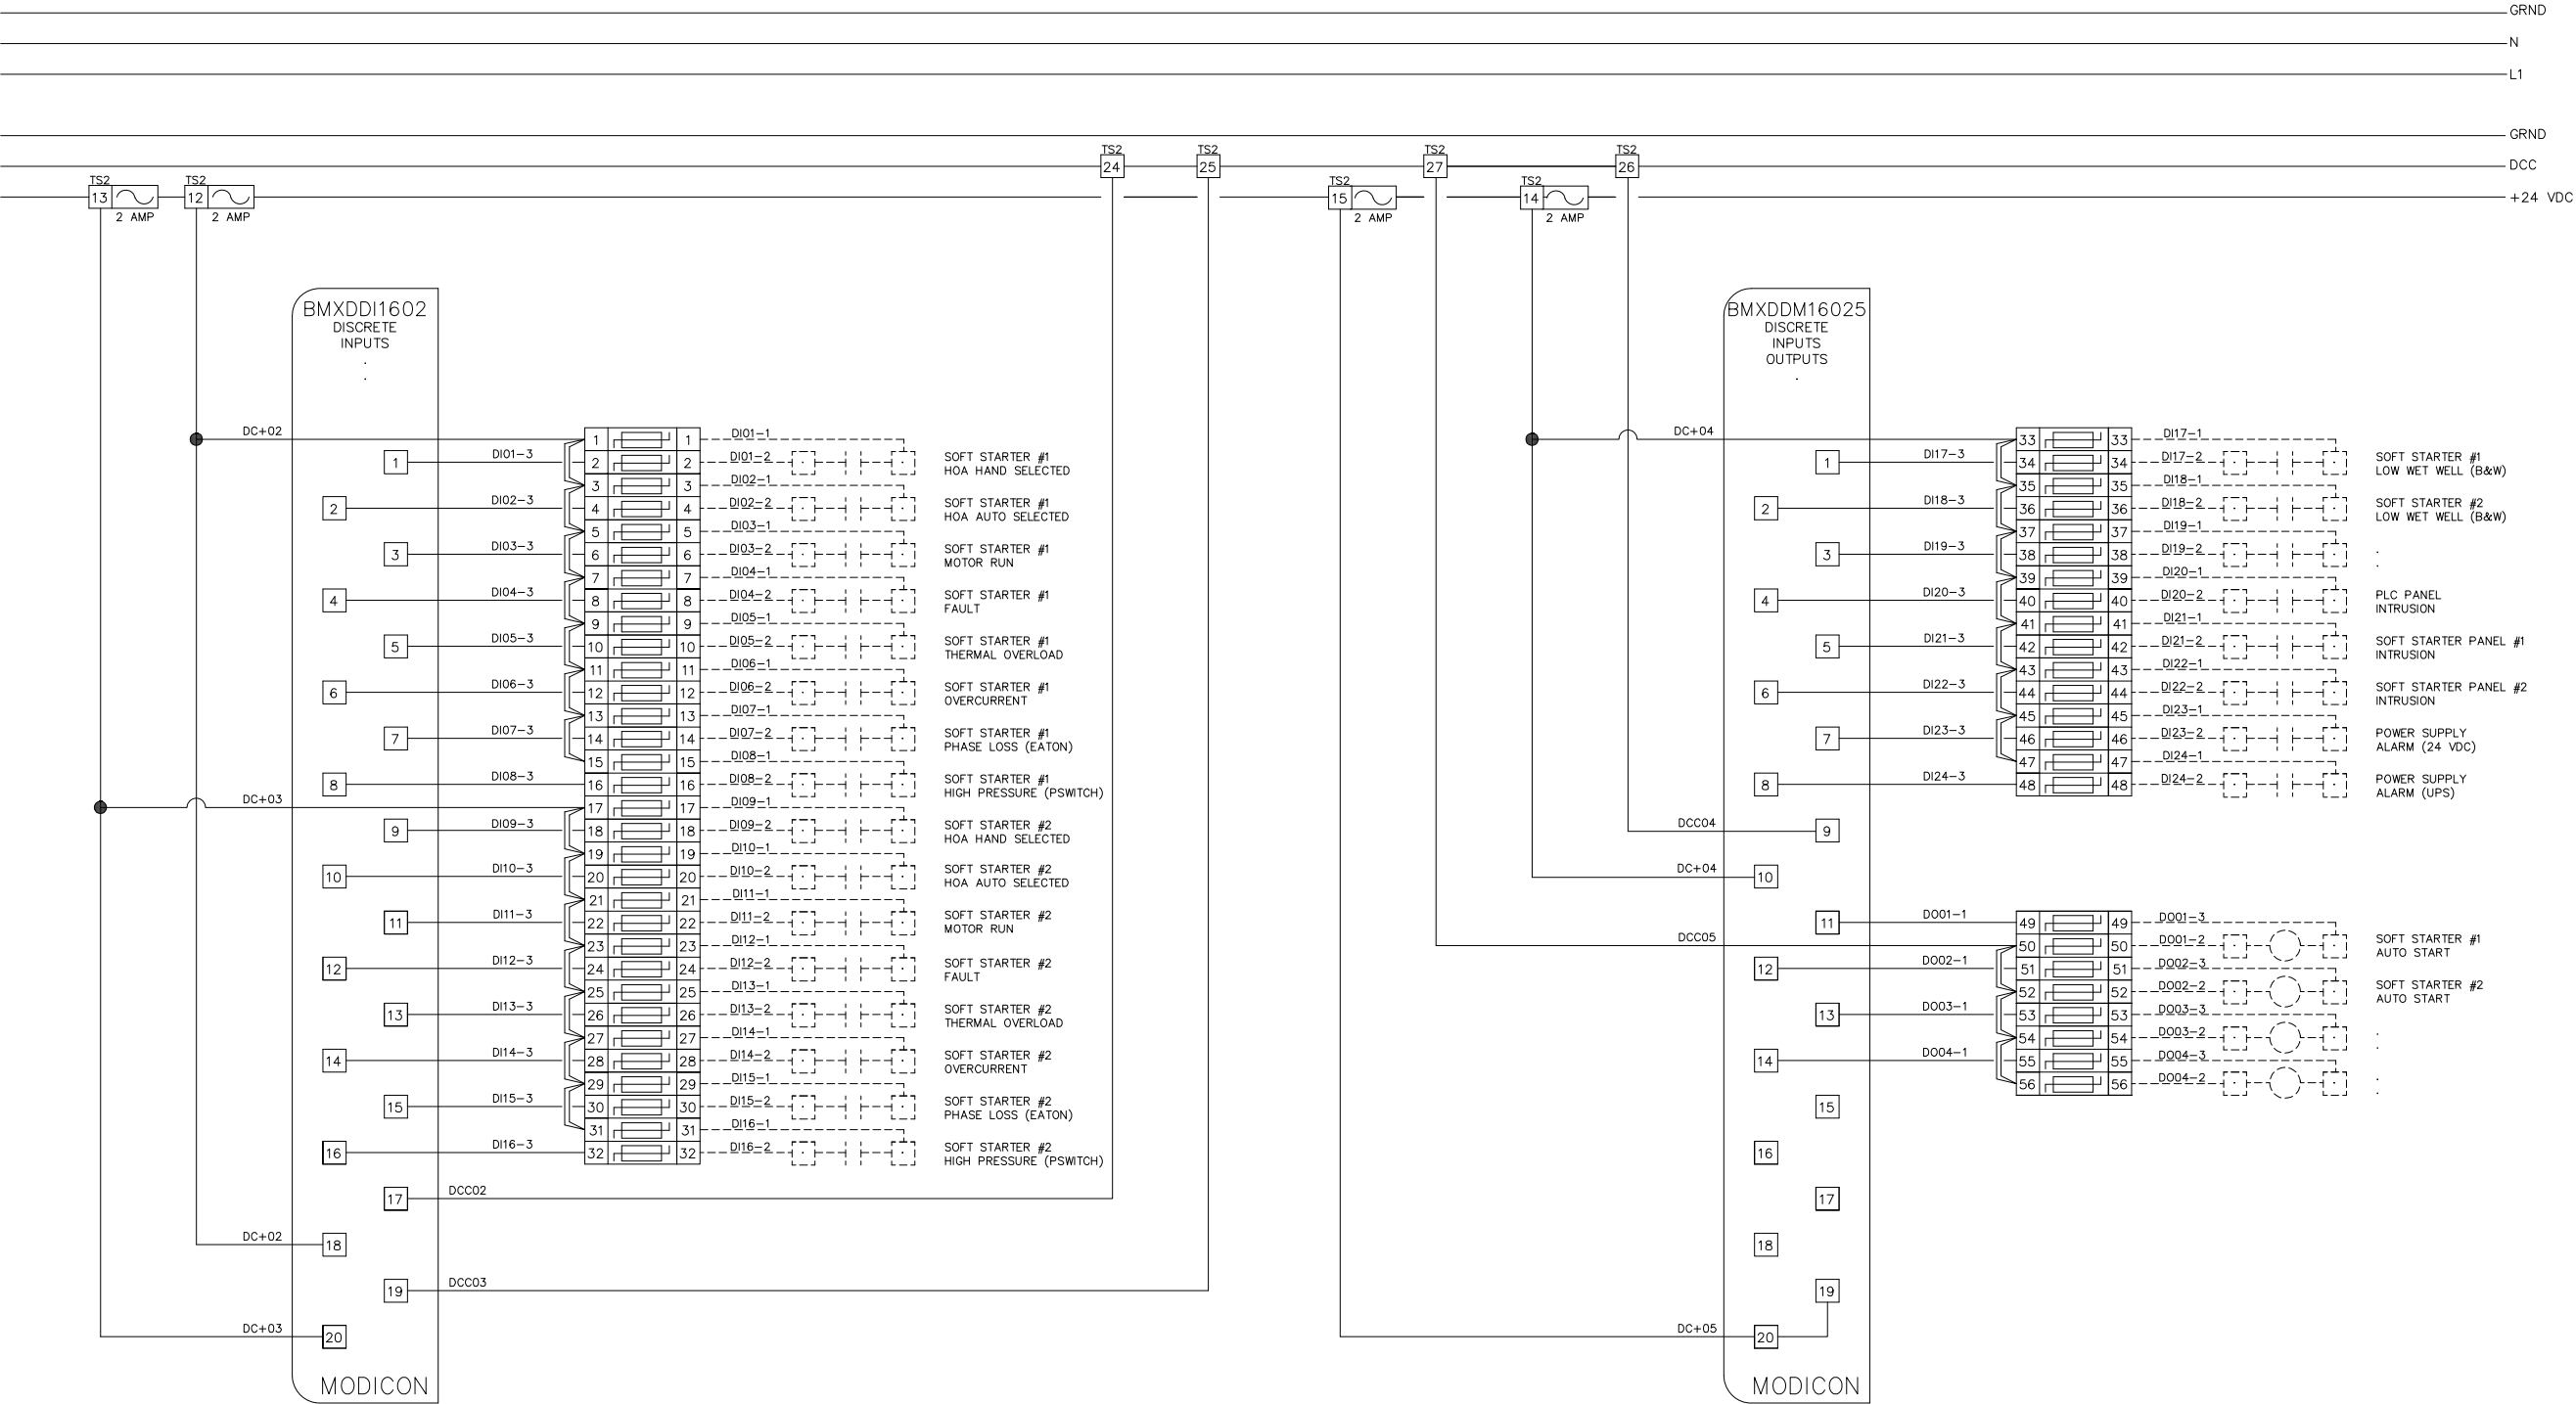


LEGEND

Field Terminations -----

Panel Wiring _____

01	3/19	DWG UPDATES	NTUA
NO.	DATE	DESCRIPTION	BY
NAVAJO TRIBAL UTILITY AUTHORITY			
SCALE: NONE	REVISIONS		BY DATE
DATE:			
DRN:	CRD:		
APVD:			
TITLE: PLC CONTROL PANEL DISCRETE I/O (BOOSTER WITH SOFT STARTER)			SHEET 2 OF 6


POWER DISTRIBUTION THIS PAGE REFLECTS "LOGICAL" SCHEMATIC SEE "DC DISTRIBUTION" DRAWING AND "AC DISTRIBUTION" DRAWING FOR POINT TO POINT TERMINATIONS

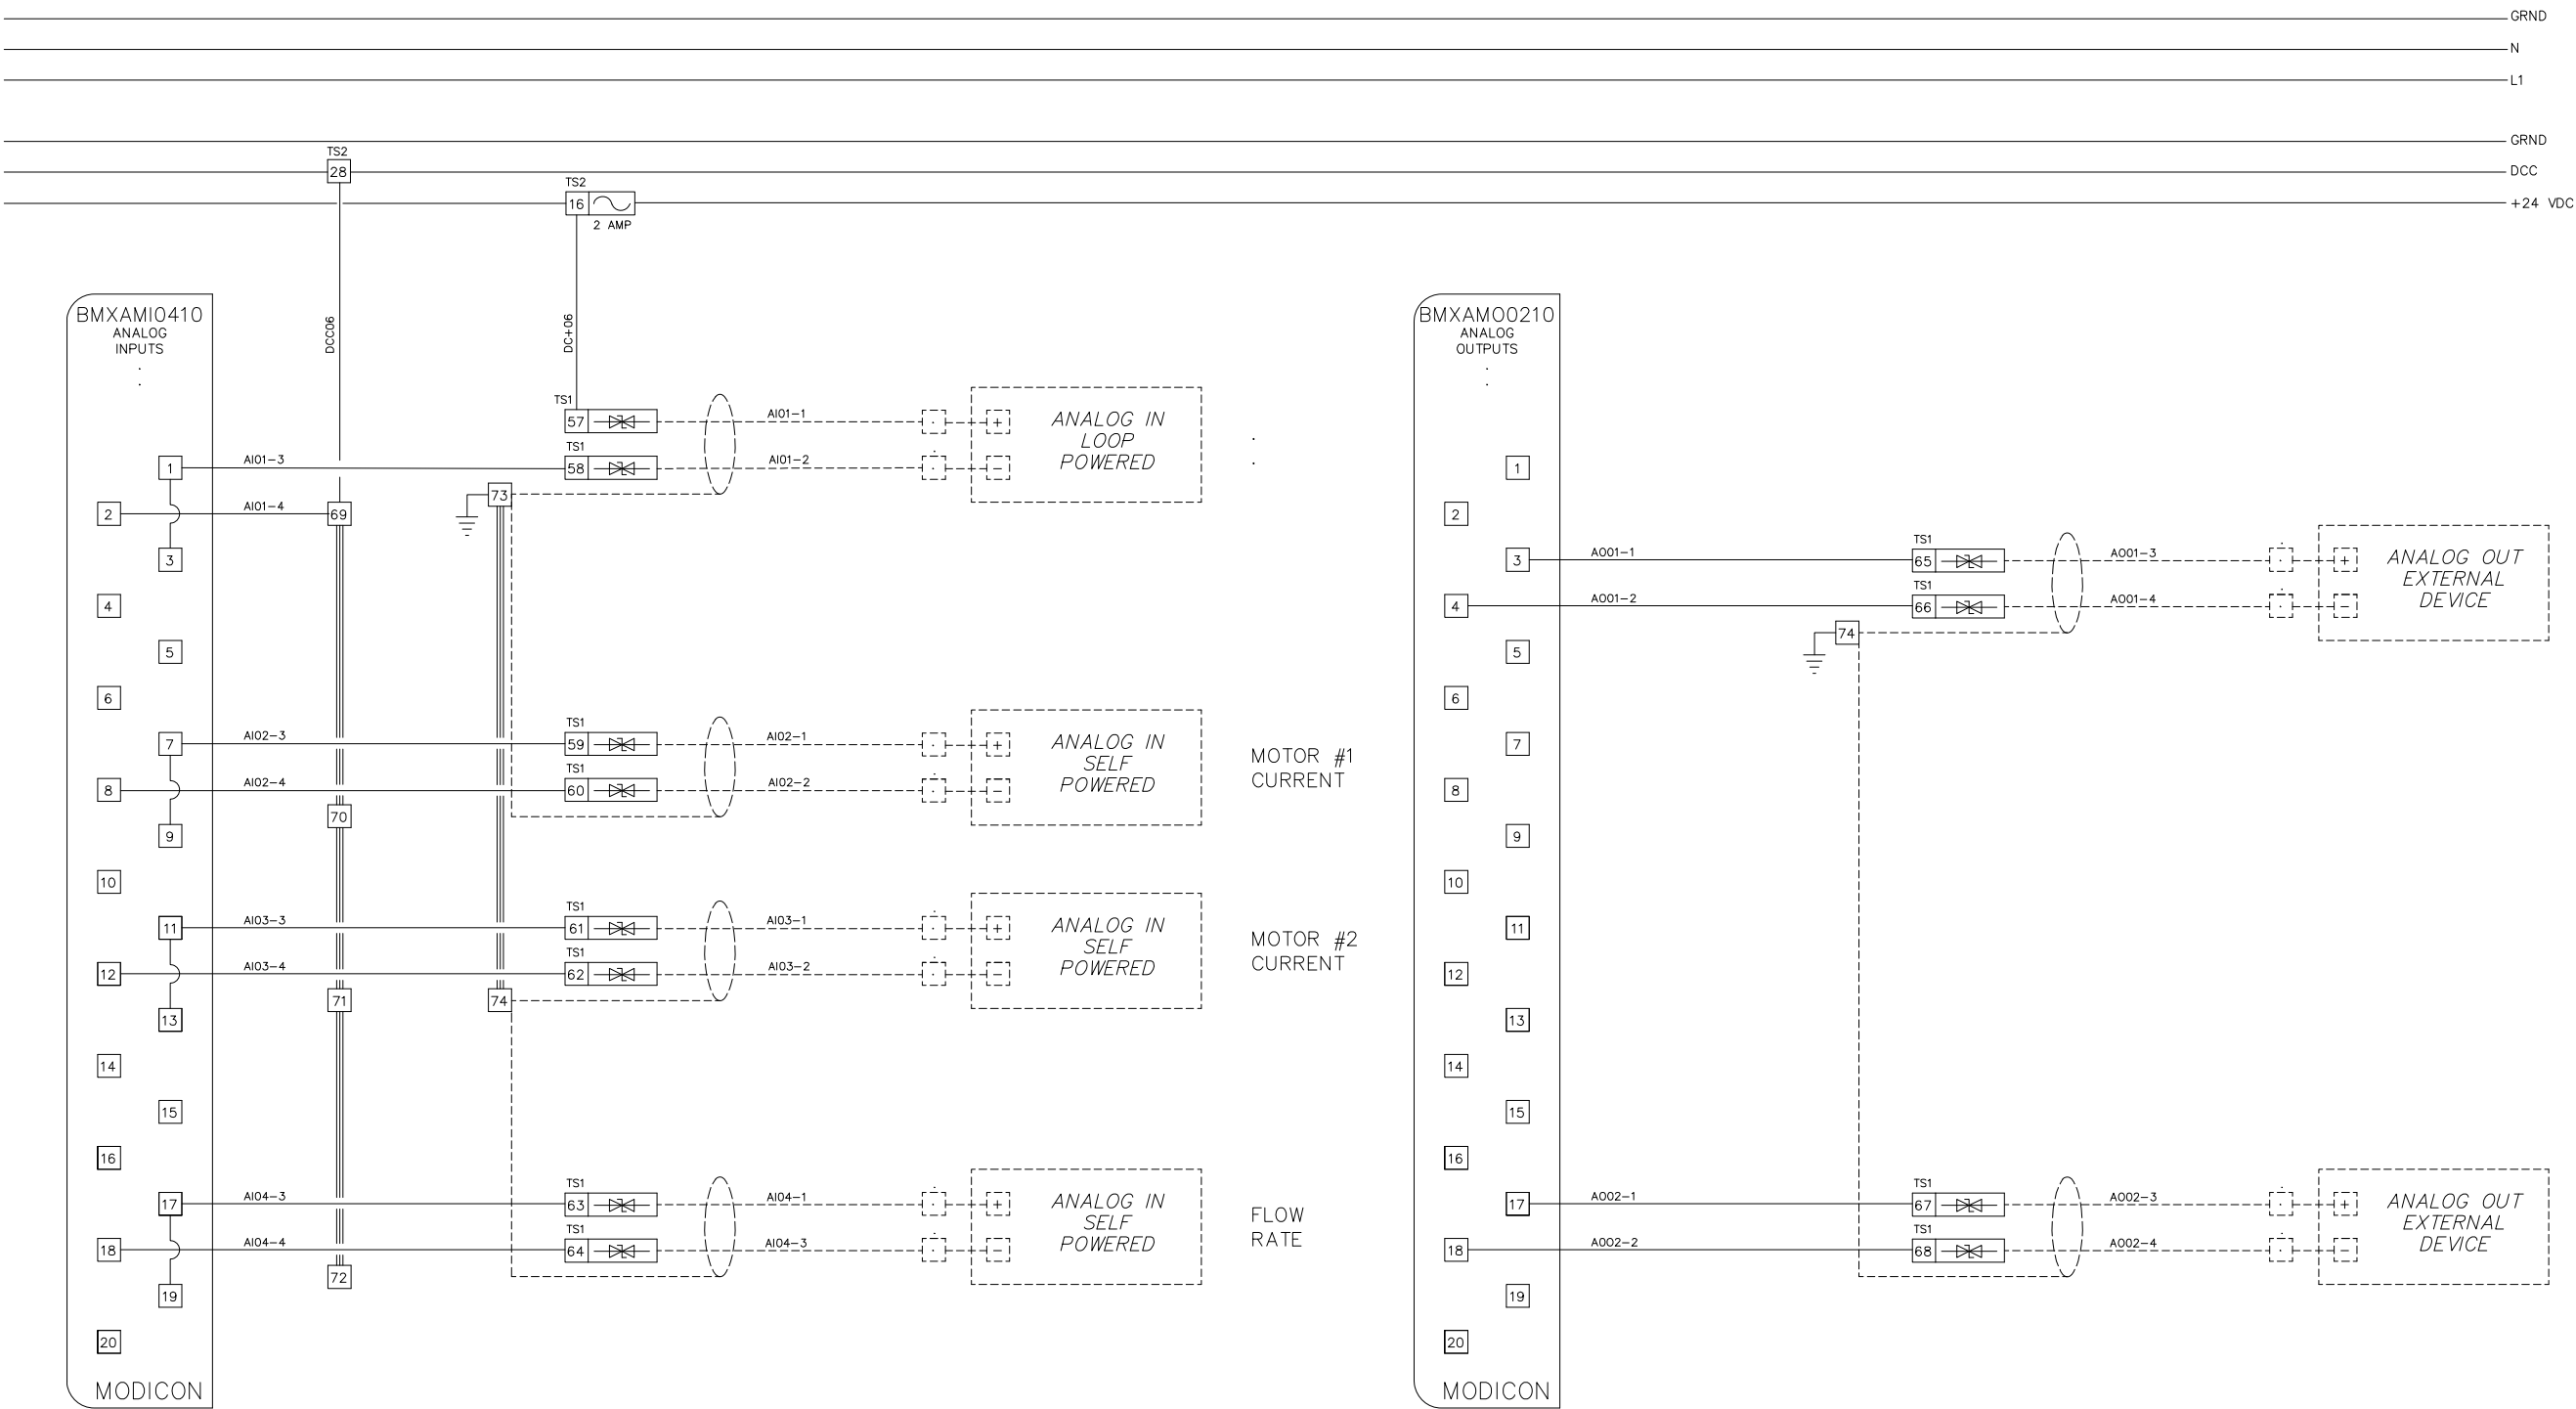


LEGEND	
Field Terminations	-----
Panel Wiring	_____

01	3/19	DWG UPDATES	NTUA
NO.	DATE	DESCRIPTION	BY
NAVAJO TRIBAL UTILITY AUTHORITY			
SCALE:	NONE	REVISIONS	BY DATE
DATE:	.	.	.
DRN:	ORD.	.	.
APVD:	.	.	.
TITLE: PLC CONTROL PANEL ANALOG I/O (BOOSTER WITH SOFT STARTER)			W.O.# SHEET 3 OF 6


24VDC DISTRIBUTION

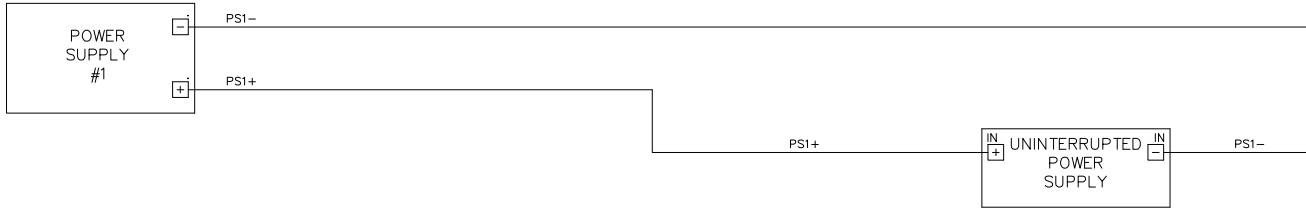


24VDC DISTRIBUTION (UPS)

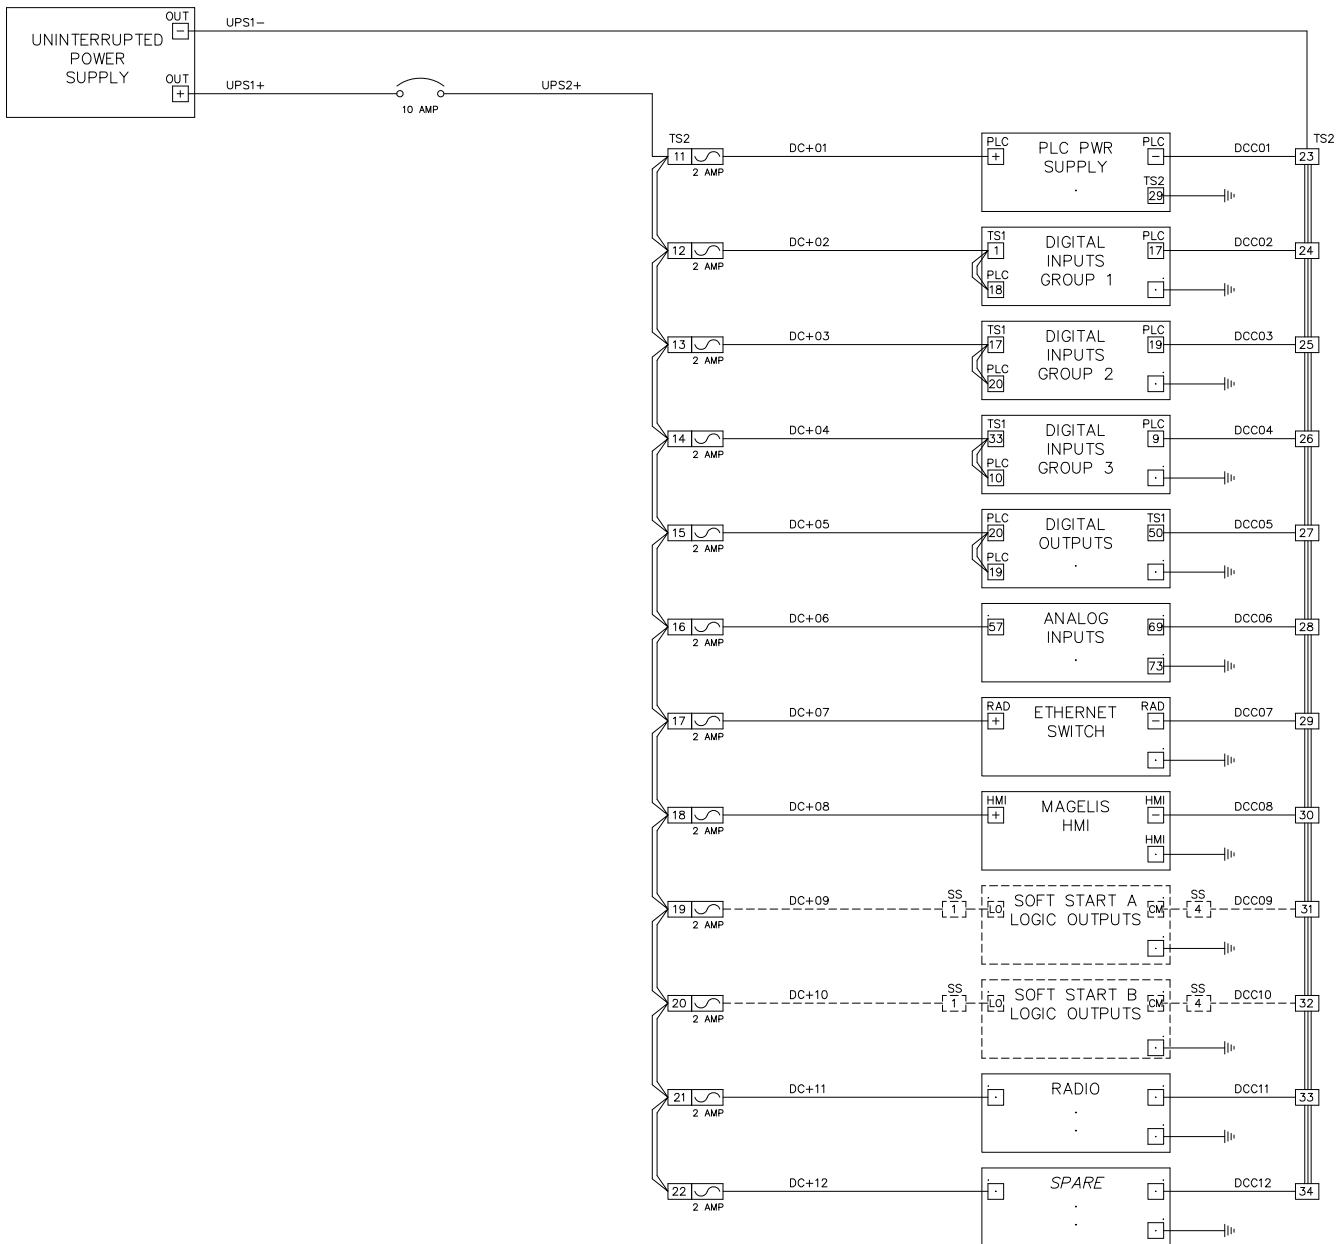


120VAC DISTRIBUTION


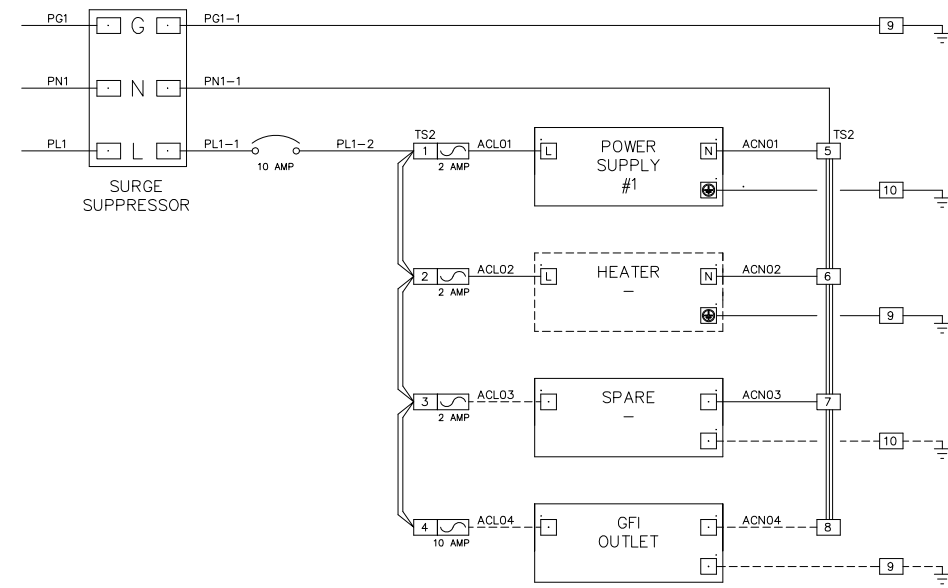


GRND

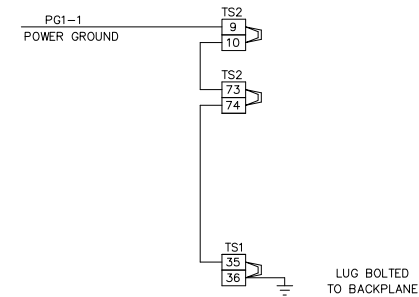

LEGEND	
Field Terminations	-----
Panel Wiring	_____



01	12/16	DWG UPDATES		NTUA
NO.	DATE	DESCRIPTION		BY
 <i>NAVAJO TRIBAL UTILITY AUTHORITY</i>				
SCALE:	REVISIONS			BY DATE
DATE:				
DRN:	CRD:			
APVD:				
TITLE		PLC CONTROL PANEL		NO.#
		POWER DISTRIBUTION		
				SHEET 4 OF 6

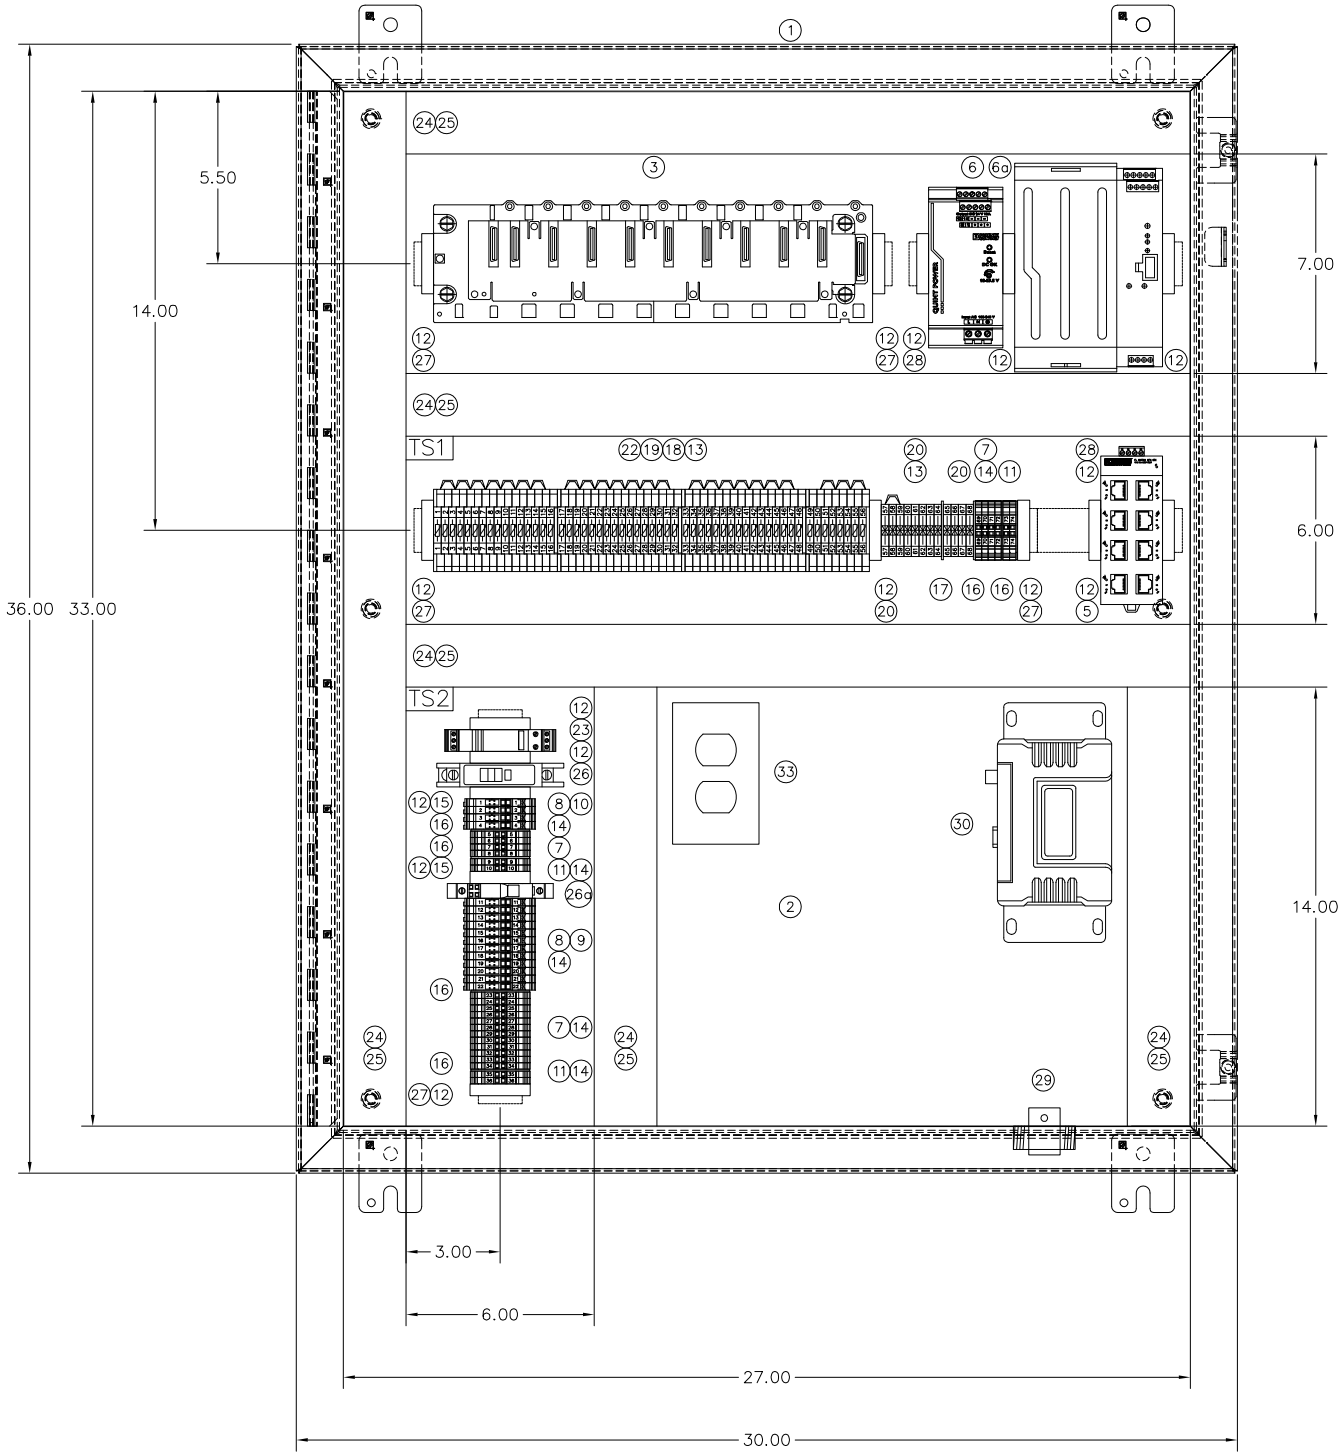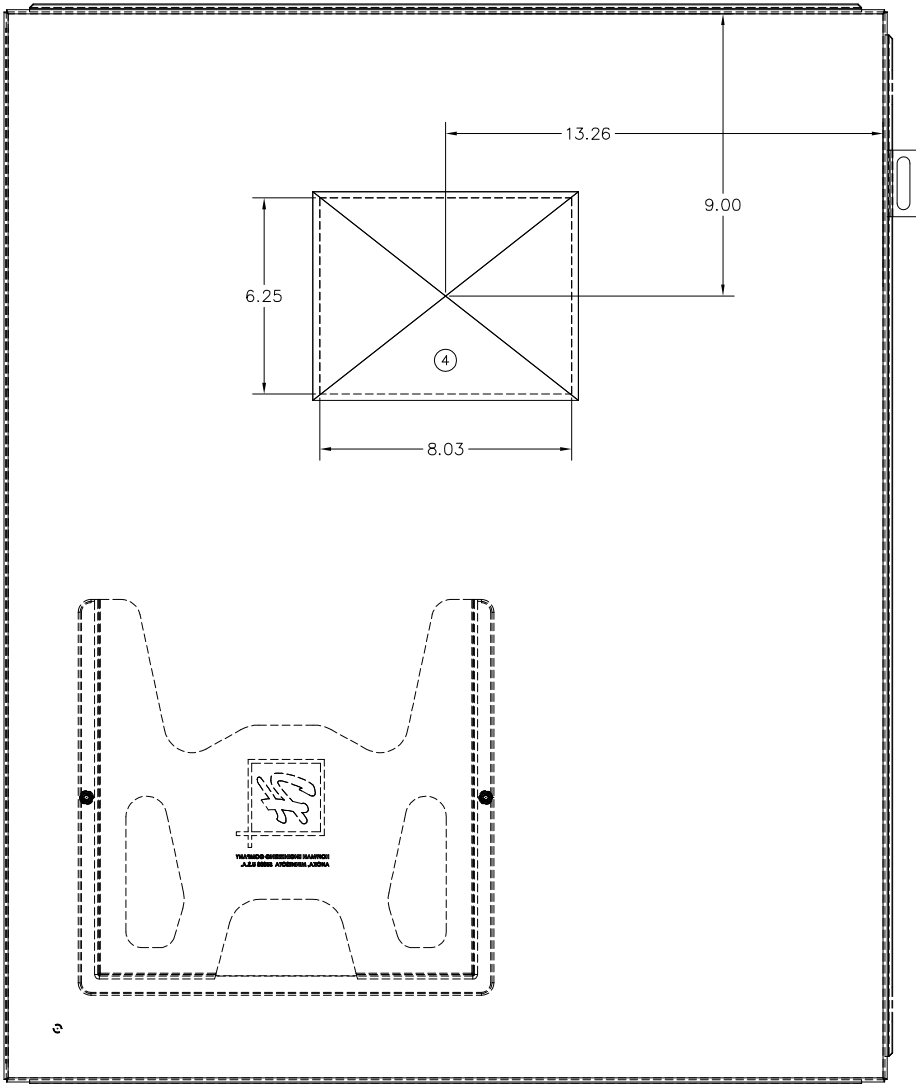

BILL OF MATERIALS				
ITEM	QTY	PART NO.	DESCRIPTION	MFG
1	1	A-363012LP	SINGLE-DOOR TYPE 12 ENCLOSURE	HOFFMAN
2	1	A-36P30	BACKPLANE	HOFFMAN
3*	.	M340	MODICON M340 BOM	MODICON
3a	1	BMXXBP0800	8-SLOT RACK	MODICON
3b	1	BMXCPS3020	MODULE POWER SUPPLY	MODICON
3c	1	BMXP342020	MODULE CPU PROCESSOR	MODICON
3d	1	BMXDD1602	MODULE DIGITAL INPUT	MODICON
3e	1	BMXDDM16025	MODULE DIGITAL INPUT/OUTPUT	MODICON
3f	1	BMXAMI0410	MODULE ANALOG INPUT	MODICON
3g	1	BMXAM00210	MODULE ANALOG OUTPUT	MODICON
3h	1	BMXFTB2010	MODULE REMOVABLE CONNECTION	MODICON
4	1	HMIGT04310	BLOCK - SCREW CLAMP 7.5 GRAPHIC TERMINAL	SCHNEIDER
5	1	FL SWITCH SFN 8TX	TOUCHSCREEN (MAGELUS)	ELECTRIC
6	1	QUINT-PS/1AC/ 24DC/10	INDUSTRIAL ETHERNET SWITCH	PHOENIX
6a	1	QUINT-UPS/24DC /24DC/10/3.4AH	POWER SUPPLY 22.5-28.5V ADJUSTABLE	PHOENIX
7	26	UT2,5	UNINTERRUPTIBLE POWER SUPPLY	PHOENIX
8	16	UT4TG	UT2,5 TERMINALS	PHOENIX
9	12	P-FU5X20LED24	FUSE TERMINAL BASE	PHOENIX
10	4	P-FU5X20LA250	FUSE PLUG	PHOENIX
11	6	UT2,5PE	FUSE PLUG	PHOENIX
12	15	E/NS35N	GROUNDING TERMINAL	PHOENIX
13	4	FBS 20-6 BU #3032208	END CLAMP	PHOENIX
14	4	FBS 20-5 BU #3036929	FIXED BRIDGE	PHOENIX
15	6	D-UT2,5/10	INSERTION BRIDGE	PHOENIX
16	6	ATP-UT	END COVER	PHOENIX
17	2	ATP-UK	PARTITION PLATES	PHOENIX
18	4	DP-UKK3/5BK #2770833	PARTITION PLATES	PHOENIX
19	4	D-UKK3/5BK #2770228	SLKK5 SPACER PLATE	PHOENIX
20	12	TT-UK5/24DC #2794699	SLKK5 ENDCOVER	PHOENIX
21	3	D-TERMITRAB UK5	TERMITRAB UK5 W/SUPPRESSOR DIODE	PHOENIX
22	56	TT-SLKK5/24DC #2794903	END COVER	PHOENIX
23	1	PT2PE/S120FM	TERMITRAB SLKK5 W/VARISTOR 24DC (MOV)	PHOENIX
24	AN	F2X4LG6	TERMITRAB AC SURGE PROTECTION	PHOENIX
25	AN	C2LG6	TYPE F NARROW SLOT WIRING DUCT	PANDUIT
26	1	TMC 61C 10A #0902072	WIRING DUCT COVER	PANDUIT
26a	1	UT6-TMCM 10A #0916610	CIRCUIT BREAKER	PHOENIX
27	AN	1492DR6	CIRCUIT BREAKER	PHOENIX
28	AN	1492-DR5	EXTENDED DIN RAIL	ALLEN
29	1	IS-50NX-C2	DIN RAIL	BRADLEY
30	1	ORBIT OR TRANSNET	LIGHTNING ARRESTER	POLYPHASER
31	2	CAT6	902 - 928 MHz RADIO SPREAD SPECTRUM	GEMDS
32	1	DRUBGF115	ETHERNET PATCH CABLE (4' - BLACK)	BELDEN
33	1	DRUBGF115	CABLE - PLC TO MODEM (TO LENGTH)	HUBBELL

AN - As needed
3* - BOM - To include items 3a-3h.


01	12/16	DWG UPDATES		NTUA
NO.	DATE	DESCRIPTION		BY
NAVAJO TRIBAL UTILITY AUTHORITY				
SCALE:	NONE	REVISIONS	BY	DATE
DATE:				
DRN:	DRN:			
APVD:				
TITLE	PLC CONTROL PANEL			NO.#
	BACKPLANE			SHEET 5 OF 6

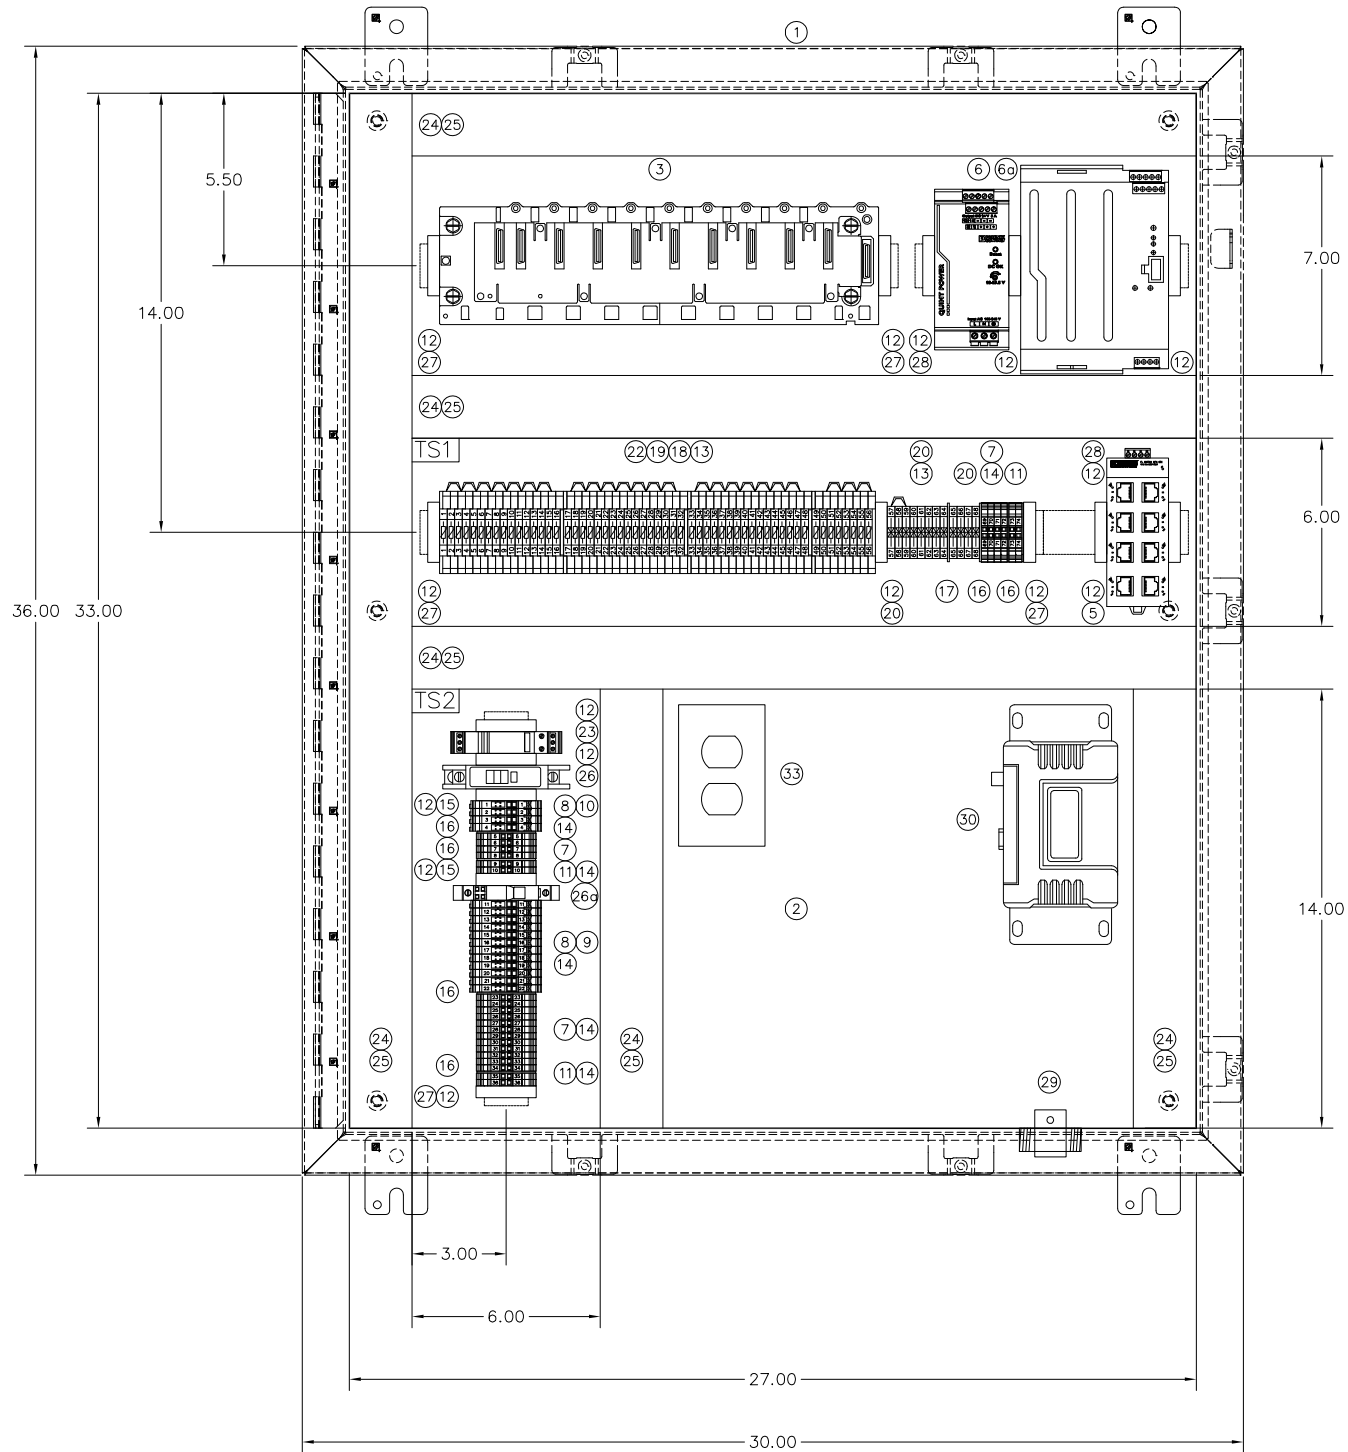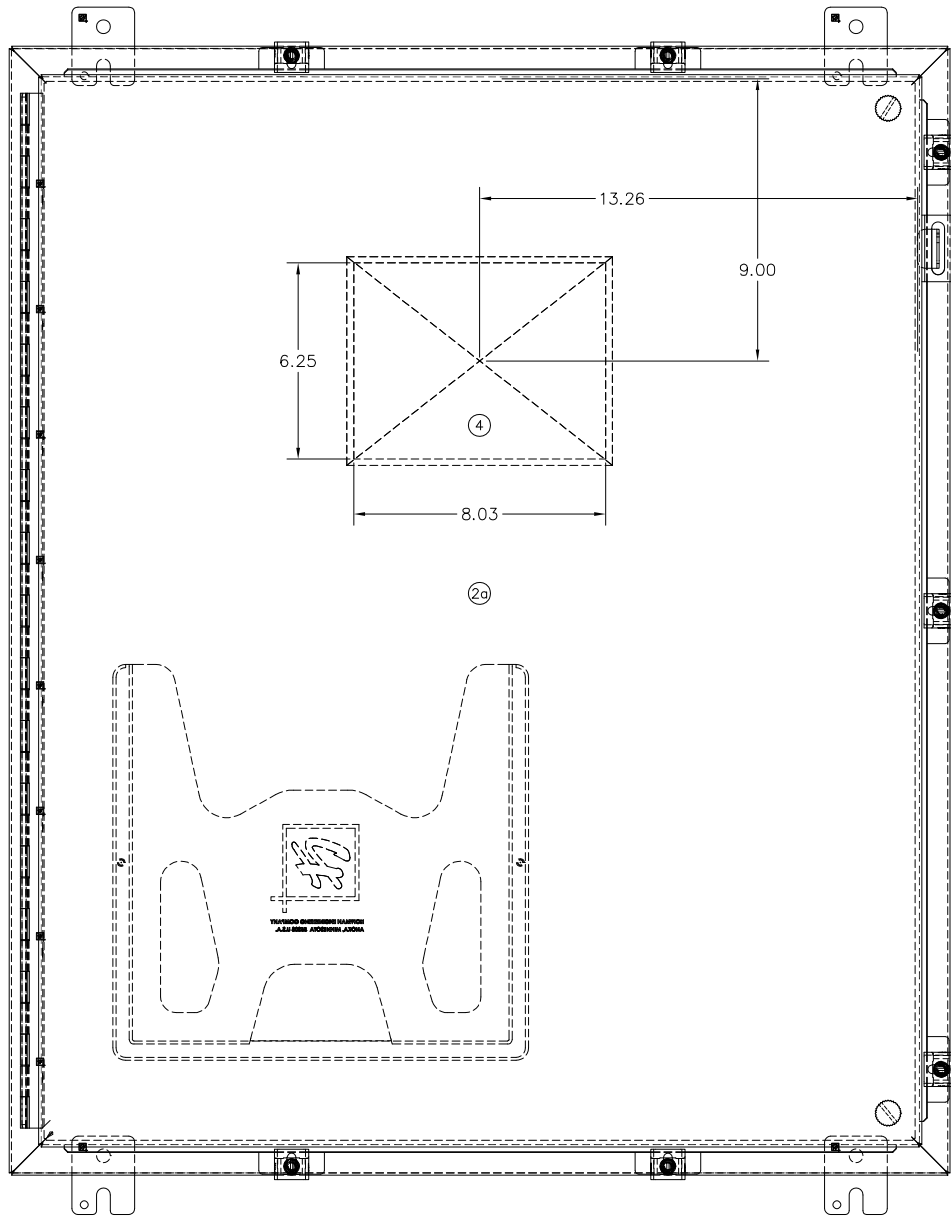

BILL OF MATERIALS				
ITEM	QTY	PART NO.	DESCRIPTION	MFG
1	1	A-36H30DLP	SINGLE-DOOR TYPE 4 ENCLOSURE	HOFFMAN
2	1	A-36P30	BACKPLANE	HOFFMAN
2a	1	A-NADFK	SWING OUT PANEL KIT	HOFFMAN
3*	.	M340	MODICON M340 BOM	MODICON
3a	1	BMXXBM0800	8-SLOT RACK MODULE	MODICON
3b	1	BMXCPS3020	POWER SUPPLY MODULE	MODICON
3c	1	BMX342020	CPU PROCESSOR MODULE	MODICON
3d	1	BMXDDI1602	DIGITAL INPUT MODULE	MODICON
3e	1	BMXDDM16025	DIGITAL INPUT/OUTPUT MODULE	MODICON
3f	1	BMXAMI0410	ANALOG INPUT MODULE	MODICON
3g	1	BMXAMO0210	ANALOG OUTPUT MODULE	MODICON
3h	4	BMXFTB2010	REMOVABLE CONNECTION BLOCK - SCREW CLAMP	MODICON
4	1	HMIQT04310	7.5 GRAPHIC TERMINAL TOUCHSCREEN (MAGELIS)	SCHNEIDER
5	1	FL SWITCH SFN 8TX	INDUSTRIAL ETHERNET SWITCH	ELECTRIC CONTACT
6	1	QUINT-PS/1AC/ 24DC/10	POWER SUPPLY 22.5-28.5V ADJUSTABLE	PHOENIX CONTACT
6a	1	QUINT-UPS/24DC /24DC/10/3.4AH	UNINTERRUPTIBLE POWER SUPPLY	PHOENIX CONTACT
7	26	UT2,5	UT2,5 TERMINALS	PHOENIX CONTACT
8	16	UT4TG	FUSE TERMINAL BASE	PHOENIX CONTACT
9	12	P-FU5X20LED24	FUSE PLUG	PHOENIX CONTACT
10	4	P-FU5X20LA250	FUSE PLUG	PHOENIX CONTACT
11	6	UT2,5PE	GROUNDING TERMINAL	PHOENIX CONTACT
12	15	E/NS35N	END CLAMP	PHOENIX CONTACT
13	4	FBI 20-6 BU #3032208	FIXED BRIDGE	PHOENIX CONTACT
14	4	FBS 20-5 BU #3036929	INSERTION BRIDGE	PHOENIX CONTACT
15	6	D-UT2,5/10	END COVER	PHOENIX CONTACT
16	6	ATP-UT	PARTITION PLATES	PHOENIX CONTACT
17	2	ATP-UK	PARTITION PLATES	PHOENIX CONTACT
18	4	DP-UKK3/5BK #2770833	SLKK5 SPACER PLATE	PHOENIX CONTACT
19	4	D-UKK3/5BK #2770228	SLKK5 ENDCOVER	PHOENIX CONTACT
20	12	TT-UK5/24DC #2794699	TERMITRAB UK5 W/SUPPRESSOR DIODE	PHOENIX CONTACT
21	3	D-TERMITRAB UK5	END COVER	PHOENIX CONTACT
22	56	TT-SLKK5/24DC #2794903	TERMITRAB SLKK5 W/VARISTOR 24DC (MOV)	PHOENIX CONTACT
23	1	PT2PE/S120FM	TERMITRAB AC SURGE PROTECTION	PHOENIX CONTACT
24	AN	F2X4LG6	TYPE F NARROW SLOT WIRING DUCT	PANDUIT
25	AN	C2LG6	WIRING DUCT COVER	PANDUIT
26	1	TMC 61C 10A #0902072	CIRCUIT BREAKER	PHOENIX CONTACT
26a	1	UT6-TMCM 10A #0916610	CIRCUIT BREAKER	PHOENIX CONTACT
27	AN	1492DR6	EXTENDED DIN RAIL	ALLEN BRADLEY
28	AN	1492-DR5	DIN RAIL	ALLEN BRADLEY
29	1	IS-50NX-C2	LIGHTNING ARRESTER	POLYPHASER
30	1	ORBIT OR TRANSNET	902 - 928 MHz RADIO SPREAD SPECTRUM	GEMDS
31	2	CAT6	ETHERNET PATCH CABLE (4' - BLACK)	BELDEN
32	1	.	CABLE - PLC TO MODEM (TO LENGTH)	.
33	1	DRUBGF115	DIN RAIL UTILITY BOX	HUBBELL


AN - As needed
3* - BOM - To include items 3a-3h.

01	12/16	DRAWING	NTUA
NO.	DATE	DESCRIPTION	BY
NAVAJO TRIBAL UTILITY AUTHORITY			
SCALE: NONE	REVISIONS		BY DATE
DATE:			
DRN:	CRD:		
APVD:			
TITLE: PLC CONTROL PANEL WITH SWING OUT PANEL BACKPLANE			SHEET 5A OF 6

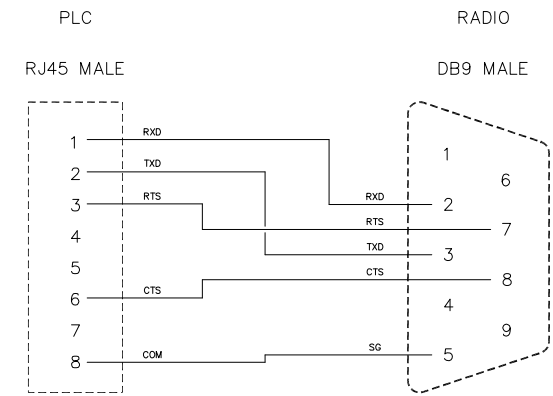

A

CABLE DIAGRAM: PLC TO RADIO

01	12/16	DWG UPDATES	NTUA
NO.	DATE	DESCRIPTION	BY
<div><div></div><div>NAVAJO TRIBAL UTILITY AUTHORITY</div></div>			
SCALE: NONE		REVISIONS	BY DATE
DATE: . .			
DRN: .	CRD: .		
APVD: .			
TITLE: PLC CONTROL PANEL			NO.#
CABLE PINOUT			SHEET 6 OF 6