

TUBA CITY WWTP  
HIGH PERFORMANCE POND SYSTEM  
NAVAJO TRIBAL UTILITY AUTHORITY  
TUBA CITY, ARIZONA



SITE LOCATION  
NTS



VICINITY MAP  
NTS

DATE OF PREPARATION:

ORIGINAL ISSUE: 06/26/2023

ENGINEER CONSULTANT:

WSP E&IS  
4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109 (505) 821-1801


THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE EXISTING INFORMATION SHOWN ON THESE PLANS IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR WILL BE RESPONSIBLE FOR FIELD VERIFYING LOCATIONS AND DEPTHS OF EXISTING UTILITIES BEFORE COMMENCING CONSTRUCTION. THE CONTRACTOR MUST ALSO CALL 811 AND NAVAJO TRIBAL UTILITY AUTHORITY, P.O. BOX 170, FORT DEFANCE, AZ, 86504 AT 928-729-5721 AT LEAST 3 WORKING DAYS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES.

SHEET INDEX

	SHEET NO.	SHEET TITLE
1	G-001	COVER SHEET
2	G-002	GENERAL NOTES AND LEGEND
3	C-100	EXISTING SITE LAYOUT AND SURVEY CONTROL
4	C-101	PROPOSED HIGH-PERFORMANCE POND SYSTEM
5	C-102	MANHOLE TIE-IN PLAN AND PROFILE
6	C-103	MANHOLE TIE-IN PLAN AND PROFILE
7	C-301	DISCHARGE STRUCTURE DETAILS
8	C-302	DIFUSER DETAILS
9	C-303	DISCHARGE STRUCTURE DETAILS
10	C-304	BLOWER SYSTEM
11	C-401	BAFFLE CURTAIN DETAIL
12	C-402	DETAILS
13	C-403	FLOATING DREDGE, COMPONENTS LAYOUT
14	C-404	BIOFUSER DETAILS
15	E-100	ELECTRICAL SITE LAYOUT DRAWING
16	E-101	SWITCH BOARD SINGLE LINE DIAGRAM
17	E-102	CONTROL PANEL SINGLE LINE DIAGRAM
18	T-A01	TITLE PAGE
19	T-A02	PROCESS FLOW SYMBOLS & NOTES PG. 1 - P & ID
20	T-A03	PROCESS FLOW SYMBOLS & NOTES PG. 2 - P & ID
21	T-A04	PROCESS FLOW SYMBOLS & NOTES PG. 3 - P & ID
22	T-A05	PROCESS FLOW SYMBOLS & NOTES PG.4 - P & ID
23	T-C01	AREA MAP AND CONSTRUCTION NOTES
24	T-C02	BLANK PAGE
25	T-D01	NETWORK AND CONDUIT DIAGRAM: PANEL AND FIELD
26	T-E00	480VAC THREE-LINE DIAGRAM
27	T-E01	480VAC THREE-LINE DIAGRAM
28	T-E02	480VAC THREE-LINE DIAGRAM
29	T-F01	120VAC SCHEMATIC
30	T-G01	24VDC SCHEMATIC
31	T-H00	PLC POWER AND COMMUNICATION - RACK 1 MODULE 00
32	T-H01	I/O SCHEMATIC PLC RACK 1 MODULES 01 & 02
33	T-H02	I/O SCHEMATIC PLC RACK 1 MODULE 03
34	T-H03	I/O SCHEMATIC PLC RACK 1 MODULE 04
35	T-H04	I/O SCHEMATIC PLC RACK 1 MODULE 05
36	T-M01	ASSEMBLY DRAWING ENCLOSURE
37	T-M02	ASSEMBLY DRAWING BACKPLATE
38	T-M03	BILL OF MATERIALS



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

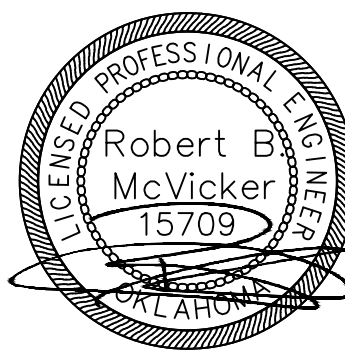

06/26/2023

FINAL

PROJECT:  
TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN



NAVAJO TRIBAL UTILITY  
AUTHORITY  
PO BOX 170  
FT. DEFANCE, AZ 86504

WSP PROJECT No:  
2251700010

REVISIONS

NO.	DATE	BY	APPROVED

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:

COVER SHEET

SHEET NUMBER:	REV. #
G-001	
SHEET 1 OF 38 SHEETS	



P:\consulting\projects\22-517-00010\NTUA HPP Tuba City WWF\CAD\2-G-002\_GENERAL NOTES & LEGEND.dwg

GENERAL NOTES:

QUALITY CONTROL

- 1.0 UNLESS OTHERWISE STATED, INDIAN HEALTH SERVICE (IHS)/NAVAJO ENGINEERING AND CONSTRUCTION AUTHORITY (NECA) SPECIFICATIONS (REV 1.5) AND INDIAN HEALTH SERVICE STANDARD DETAILS FOR WATER (REV 3.2) AND SEWER (REV 1.9) SHALL CONTROL THE MATERIALS AND WORKMANSHIP OF THIS PROJECT WHETHER SPECIFICALLY CALLED OUT OR NOT. THE IHS/NECA SPECIFICATIONS ARE A SEPARATE VOLUME AND NOT ISSUED AS PART OF THE CONSTRUCTION SET. SPECIFICATION SECTIONS AND STANDARD DRAWINGS, WHEN NOTED HEREIN, REFER TO CORRESPONDING PARTS OF THESE DOCUMENTS.
- 2.0 IF DURING THE COURSE OF WORK THE CONTRACTOR BECOMES AWARE OF A CONTRADICTION IN THE REQUIREMENTS BETWEEN THE STANDARD SPECIFICATIONS AND DRAWINGS AND THESE PLANS, THE CONTRACTOR SHALL NOTIFY THE ENGINEER.

SAFETY

- 3.0 THE CONTRACTOR IS SOLELY RESPONSIBLE FOR JOBSITE SAFETY AND FOR KNOWLEDGE AND COMPLIANCE WITH APPLICABLE O.S.H.A. STANDARDS AND OTHER FEDERAL, STATE, TRIBAL AND LOCAL SAFETY AND WORKPLACE COMPLIANCE REQUIREMENTS.

EXISTING CONDITIONS

- 4.0 THE LOCATION OF EXISTING UTILITIES, AS SHOWN ON THE DRAWINGS, ARE APPROXIMATE. THE CONTRACTOR IS RESPONSIBLE FOR THEIR ACCURATE LOCATION IN THE FIELD.
- 5.0 IF EVIDENCE OF SUBSURFACE ARCHAEOLOGICAL OR HISTORIC FEATURES ARE OBSERVED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY HALT CONSTRUCTION IN THE AREA, PROTECT THE SITE, AND NOTIFY THE ENGINEER. NO CONSTRUCTION ACTIVITY SHALL OCCUR WITHIN THE 50 FOOT BUFFER AROUND THE EXISTING ARCHAEOLOGICAL SITE UNTIL APPROVED.

PROJECT CONTROL

- 6.0 PROJECT CONTROL SHOWN HEREON WAS ESTABLISHED USING REAL TIME KINEMATIC OBSERVATIONS FROM NATIONAL GEODETIC SURVEY CONTROL POINTS .

LOCAL HORIZONTAL DATUM: AZSPCS CENTRAL ZONE

VERTICAL DATUM: NAD 83 NAVD88 (2011)

CONTROL POINTS HAVE BEEN INSTALLED ONSITE AND ARE THE BASIS OF HORIZONTAL CONTROL FOR THE PROJECT. CONTROL POINTS SHALL BE MAINTAINED AND REMAIN UNDISTURBED DURING CONSTRUCTION.

Control Points				
Point #	Elevation	Northing	Easting	Description
AB2088	4905.00	1863150.90	905427.15	BLM MARKER
GP0470	5617.04	1857278.07	885964.10	NGS MARKER
CP1	4528.99	1853504.50	884002.95	REBAR/CAP
CP2	4525.96	1853416.74	884008.11	MAGNAIL
CP3	4531.03	1853485.03	884049.20	MAGNAIL
CP4	4531.64	1853495.11	884077.25	REBAR/CAP
CP5	4536.51	1853514.19	886674.73	REBAR/CAP
CP6	4538.14	1853476.33	886679.06	MAGNAIL
CP7	4540.40	1855113.29	887124.93	REBAR CAP
CP8	4551.15	1855229.93	887124.57	REBAR CAP
CP9	4545.59	1855853.46	887804.14	REBAR CAP
CP10	4545.33	1855829.39	887804.79	REBAR CAP

- 7.0 SCALES IN THESE PLANS ARE VALID WHEN PLOTTED ON 22"X34" (ANSI).

WORK AREA

- 8.0 THE CONTRACTOR SHALL CONFINE WORK TO WITHIN THE PRESCRIBED CONSTRUCTION LIMITS, EASEMENT, RIGHT-OF-WAY OR PROPERTY.
- 9.0 THE CONTRACTOR SHALL COORDINATE ACTIVITIES WITH THE OWNER AND ENGINEER TO MINIMIZE ACCESS TO ADJACENT PROPERTIES AND TRAFFIC DISRUPTIONS.
- 10.0 THE CONTRACTOR SHALL ACQUIRE THE NECESSARY LICENSES OR PERMITS WHEN WORKING WITHIN OR NEAR A RIGHT-OF-WAY, STREET, ROAD OR HIGHWAY, SIDEWALK, TRAIL, OR OTHER PUBLIC THOROUGHFARE AND SHALL INCORPORATE THE REQUIREMENTS OF SAID LICENSE/PERMIT.
- 11.0 WHEN WORKING IN OR NEAR TRAFFIC THE CONTRACTOR SHALL (AT A MINIMUM) PROVIDE, ADEQUATE SIGNS, BARRICADES, WARNING LIGHTS, AND FLAGGERS TO ENSURE THE SAFETY/PROTECTION OF THE PUBLIC, EMPLOYEES, AND THE WORK IN ACCORDANCE WITH THE "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES" (MUTCD), LATEST EDITION.
- 12.0 IT WILL BE THE CONTRACTOR'S RESPONSIBILITY TO MAINTAIN ACCESS TO EXISTING RESIDENCES, BUSINESSES, TURNOUTS AND INTERSECTING ROADS AT ALL TIMES DURING CONSTRUCTION.
- 13.0 IF A FENCED/SECURE STORAGE AREA FOR MATERIALS AND EQUIPMENT IS DESIRED, THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AN AREA OFF THE PROJECT SITE. USING THE AREA FOR STORAGE SHALL COMPLY WITH LOCAL ZONING OR OTHER ORDINANCES AND SHALL BE PERMITTED, IF REQUIRED.
- 14.0 OVERNIGHT PARKING OF CONTRACTOR'S EQUIPMENT SHALL NOT OBSTRUCT ACCESS OR DESIGNATED TRAFFIC LANES. THE CONTRACTOR SHALL PARK OR STORE EQUIPMENT AT SAFE DISTANCES FROM THE TRAVELED WAY.
- 15.0 THE CONTRACTOR IS RESPONSIBLE FOR SOIL EROSION, DRAINAGE CONTROL AND DUST DURING CONSTRUCTION AND MUST, WHEN APPLICABLE, PREPARE AND ADHERE TO A STORM WATER POLLUTION PREVENTION PLAN (SWPPP) PREPARED ACCORDING TO THE U.S. ENVIRONMENTAL PROTECTION AGENCY'S CONSTRUCTION GENERAL PERMIT (CGP).

OTHER UTILITIES

- 16.0 THE CARE AND PROTECTION OF OTHER UTILITIES, STREET APPURTENANCES, DRAINAGE STRUCTURES AND OTHER INFRASTRUCTURE, WHETHER PUBLIC OR PRIVATE, THAT ARE NOT PART OF THE INTENDED WORK ARE THE RESPONSIBILITY OF THE CONTRACTOR.
- 17.0 WHERE TRENCHING AROUND OR BENEATH EXISTING UTILITY LINES OCCURS, THE CONTRACTOR WILL BE RESPONSIBLE FOR COORDINATING WITH THE UTILITY OWNER AND FOR SUPPORTING THE UTILITY LINE, AS REQUIRED BY THE UTILITY OWNER, DURING CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ASSURING THE UTILITY IS ADEQUATELY SUPPORTED BY COMPACTED BACKFILL OR OTHER MEANS AT THE COMPLETION OF CONSTRUCTION AS REQUIRED BY THE UTILITY OWNER. IF THE TECHNIQUES REQUIRED FOR STABILIZING OTHER UTILITIES CONFLICT WITH THE REQUIREMENTS OF THIS PROJECT THE CONTRACTOR SHALL NOTIFY THE ENGINEER.

EXCESS MATERIAL & DEBRIS

- 18.0 ANY EXTRA NATURAL SOIL (CLEAN OF OIL AND CHEMICALS) REMAINING AFTER BACKFILL AND COMPACTION MAY BE DISPOSED AT A SITE APPROVED BY THE OWNER. CONTRACTOR SHALL HAUL DEBRIS AND NON-NATURAL SOILS TO A CERTIFIED LANDFILL.

RECORD DRAWINGS

- 19.0 THE CONTRACTOR SHALL PREPARE AND MAINTAIN AN UP-TO-DATE SET OF RECORD DRAWINGS FOR THE PROJECT. THESE PLANS SHALL BE KEPT CURRENT DAILY AND SHALL BE MADE AVAILABLE FOR REVIEW AS REQUESTED BY THE ENGINEER. THE COST OF PREPARING AND MAINTAINING A RECORD DRAWING SET SHALL BE INCIDENTAL TO THE PROJECT.

STRUCTURAL NOTES:

FOUNDATIONS:

BELOW GRADE FOUNDATIONS SHALL BEAR ON A MINIMUM OF THREE (3) FEET OF GRANULAR NON-EXPANSIVE ENGINEERED FILL UNDERLAIN BY A REINFORCING GEOGRID.

SLABS SHOULD BEAR ON THREE (3) FEET OF NON-EXPANSIVE LOW PERMEABILITY ENGINEERED FILL.

FILL MATERIALS ARE TO CONFORM TO GRADATION AS FOLLOWS.

SIEVE SIZE	PERCENT PASSING
1"	100
NO. 4	50-100
NO.40	35 MAX.

ENGINEERED FILL OR OTHER APPROVED GRANULAR SOILS SHOULD BE PLACED IN A MAXIMUM LIFT NOT TO EXCEED 8", MATERIAL IS TO BE COMPACTED TO 95% ASTM D698 PER GETOECHNICAL REPORT.

THE GEOGRID SHOULD BE PER TESAR TRIAX TX 160 OR EQUIVALENT AS APPROVED BY THE ENGINEER.

ALL EARTH WORK, FOOTING DEPTHS, AND EXCAVATIONS FOR FOUNDATIONS SHALL BE INSPECTED BY THE ENGINEER TO VERIFY ASSUMED ALLOWABLE SOIL BEARING AND LOW SETTLEMENT AND SWELL POTENTIAL, AND TO MAKE ANY ADDITIONAL RECOMMENDATIONS.

CONCRETE:

SHALL MEET ALL THE REQUIREMENTS OF THE CURRENT ISSUE OF THE ACI MANUAL OF CONCRETE PRACTICE, WITH TYPE 1-11 CEMENT. MINIMUM 28 DAY STRENGTH, 3000 PSI, EXCEPT AS FOLLOWS:

FOUNDATIONS, GRADE BEAMS, OR ANY OTHER CONCRETE  
IN CONTACT WITH EARTH.....3000 PSI (MAX W/C = 0.45)

CAST IN PLACE SLABS NOT ON GRADE.....4000 PSI

MAXIMUM SLUMP FOR ALL CONCRETE.....5"

CONTRACTOR SHALL SUBMIT FOR APPROVAL CONCRETE MIX DESIGNS FOR EACH CLASS OF CONCRETE. THE MIX SUBMITTAL SHALL INDICATE WHICH OF THE FOLLOWING ACI 318 METHODS THE CONCRETE SUPPLIER ALONG WITH THE TESTING LAB METHOD HE/SHE INTENDS TO USE FOR CONCRETE PROPORTIONING - THE FIELD EXPERIENCE METHOD, THE LABORATORY TRIAL MIXTURE METHOD OR A COMBINATION OF BOTH. IF CONSECUTIVE TESTS (15 TO 30) ARE BEING RELIED UPON PER ACI 318, SECTION 5.3 THOSE TESTS SHALL BE SUBMITTED ALONG WITH THE MIX DESIGNS. MIX DESIGNS SHALL BEAR THE STAMP OF A LICENSED ENGINEER.

NO ADMIXTURES SHALL BE USED WITHOUT APPROVAL. NO AIR ENTRAINMENT SHALL BE ALLOWED IN FLAT SLABS. ADMIXTURES CONTAINING CHLORIDES SHALL NOT BE USED. CONCRETE SHALL NOT BE IN CONTACT WITH ALUMINUM. MECHANICALLY VIBRATE ALL CONCRETE WHEN PLACED. EXCEPT THAT SLABS ON GRADE NEED BE VIBRATED ONLY AROUND EMBEDDED ITEMS. DO NOT TAMP SLABS. USE ROLLER BUG, VIBRATING SCREED OR BULL FLOAT TO FINISH. SEE SPECIFICATIONS FOR CURING.

MINIMUM STRENGTH FOR REMOVAL OF FORMS AND SHORING SHALL BE 75% OF SPECIFIED STRENGTH AT 28 DAYS.

LEGEND:

EXISTING		PROPOSED	
	TOPOGRAPHIC CONTOUR		TOPOGRAPHIC CONTOUR
	FENCE		FENCE
	SANITARY SEWER LINE		SANITARY SEWER LINE
	MANHOLE		MANHOLE
	POWER POLE		GATE VALVE
	OVERHEAD ELECTRIC LINE		BIOLOGIC DIFFUSER
	UNDERGROUND ELECTRIC LINE		
	WATERLINE		
	ROAD		

FLY ASH (POZZOLAN) IF PERMITTED PER SPECIFICATIONS SHALL NOT EXCEED 25% REPLACEMENT OF TOTAL CEMENT CONTENT USING A 1:1 REPLACEMENT FACTOR.

REINFORCING:

LATEST ACI CODE AND DETAILING MANUAL APPLY. ALL REINFORCING BARS DEFORMED EXCEPT #2 BARS AND WIRE MESH.

ALL REINFORCING SHALL BE ASTM A-615 GRADE 60 EXCEPT AS FOLLOWS:

SPIRALS.....GRADE 60 OR COLD DRAWN A-82  
#2 AND #3 BARS.....GRADE 40  
WIRE MESH.....A-185  
WELDED ANCHORS.....GRADE 40 CHEMICAL ANALYSIS LIMITED PER AWS SPECIFICATIONS FOR WELD WITHOUT PREHEAT.  
WELDED ANCHORS #5 AND LARGER.....ASTM A-706

CLEAR CONCRETE COVER TO REINFORCING ARE AS FOLLOWS:

CAST-IN-PLACE CONCRETE (NON-PRESTRESSED):

CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH.....3"

EXPOSED TO EARTH OR WEATHER:  
#6 THROUGH #18.....2"  
#5 AND SMALLER.....1 1/2"

LAP SPLICES IN CONCRETE SHALL BE CLASS B TENSION LAPS 70 BAR Ø MIN.


WHERE BARS ARE SHOWN SPLICED, THEY MAY RUN CONTINUOUS AT CONTRACTORS OPTION.

PROVIDE SHOP DRAWING AND FABRICATE AFTER THE CONTRACTORS REVIEW. ALL SPLICE LOCATIONS ARE SUBJECT TO APPROVAL, PLACE REBAR PER CRSI STANDARDS.

REBAR SPACING GIVEN IS MAXIMUM ON CENTER AND ALL REBAR IS CONTINUES UNLESS OTHERWISE NOTED. PROVIDE BENT CORNER REBAR TO MATCH AND LAP WITH HORIZONTAL REBAR AT CORNERS AND INTERSECTIONS OF WALLS. DOWEL ALL VERTICAL WALL REBAR TO FOUNDATIONS. SECURELY TIES ALL REBAR, INCLUDING DOWELS, IN LOCATION BEFORE PLACING CONCRETE OR GROUT.



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

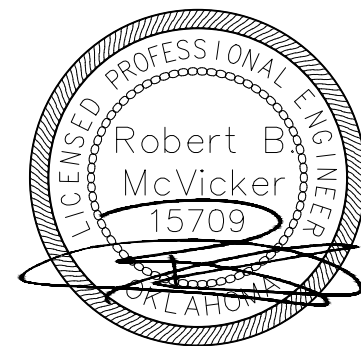

06/26/2023

FINAL

PROJECT:  
TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN



NAVAJO TRIBAL UTILITY  
AUTHORITY  
PO BOX 170  
FT. DEFIANC, AZ 86504

WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023


SHEET TITLE:

GENERAL NOTES  
& LEGEND

SHEET NUMBER:	REV. #
G-002	
SHEET 2 OF 38 SHEETS	



P:\consulting\projects\22\22-517-00010\NTUA HPP Tuba City WWF\CAD\3.C-100\_EXISTING SITE CONDITIONS PLAN.dwg

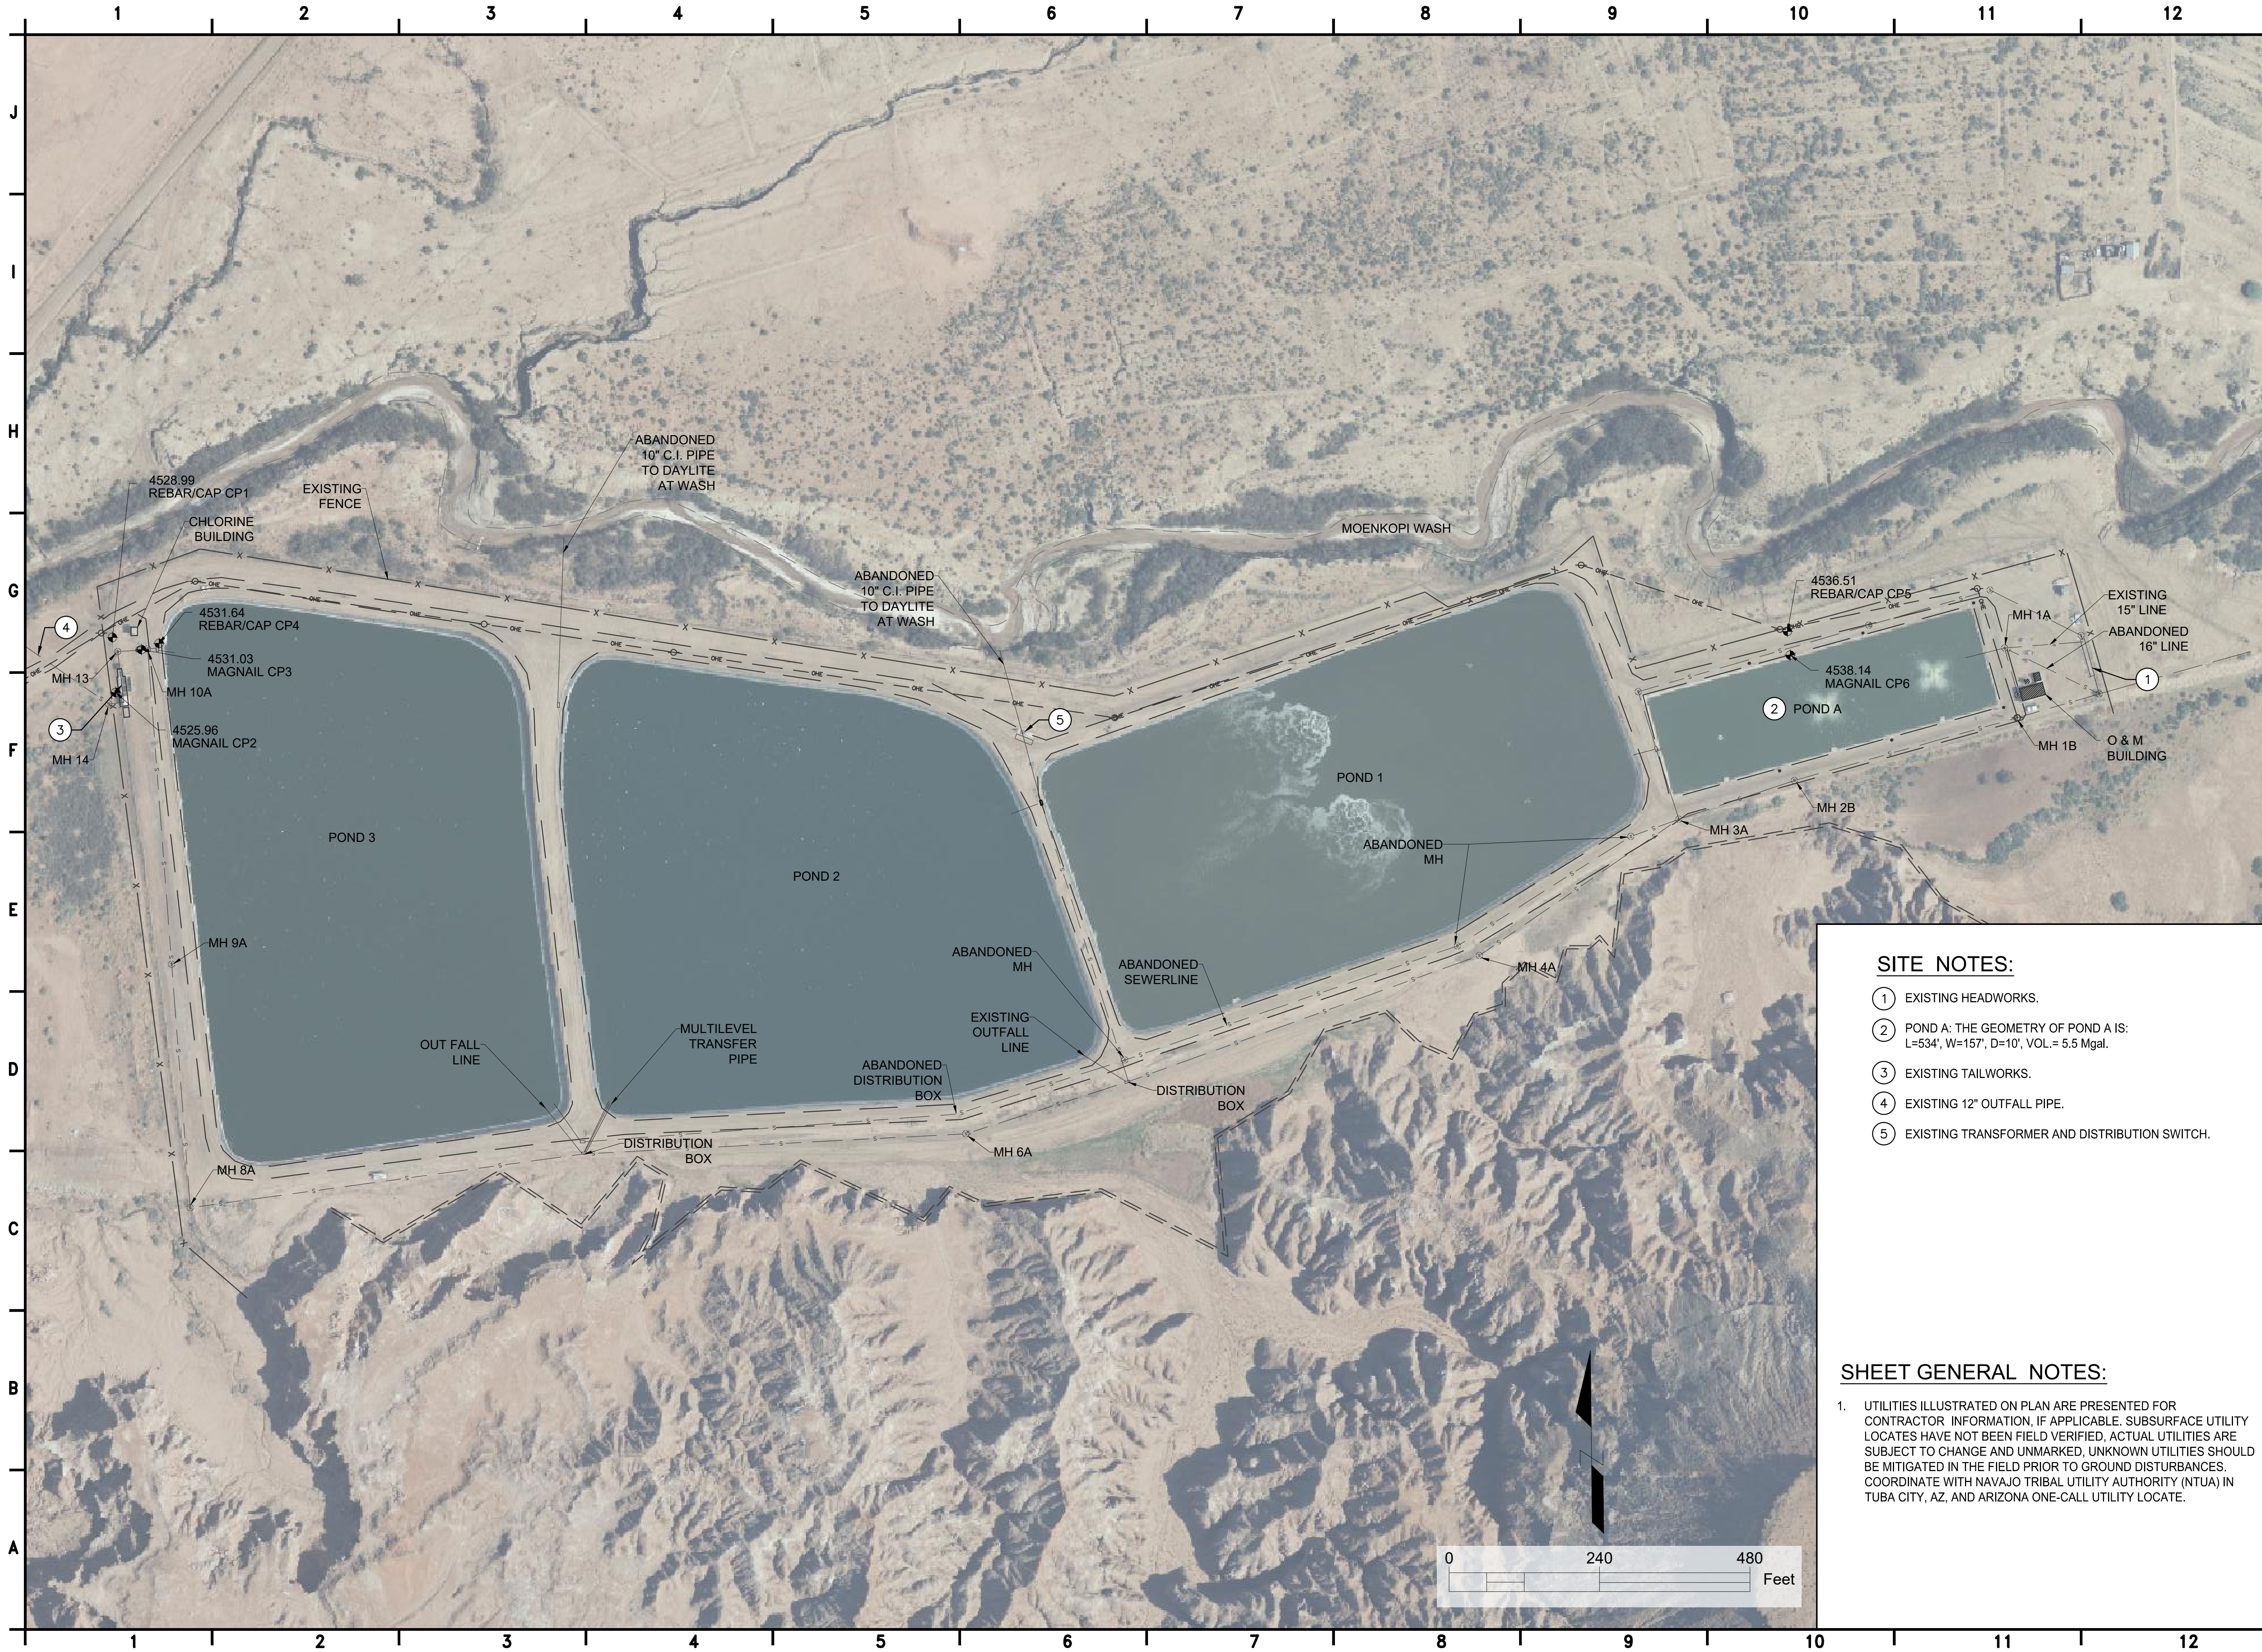



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801



06/26/2023

# FINAL

PROJECT:  
**TUBA CITY WWTW  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:

**EXISTING  
SITE LAYOUT AND  
SURVEY CONTROL**

SHEET NUMBER:	REV. #
<b>C-100</b>	
SHEET 3 OF 38 SHEETS	

### SITE NOTES:


- EXISTING HEADWORKS.
- POND A: THE GEOMETRY OF POND A IS:  
L=534', W=157', D=10', VOL.= 5.5 Mgal.
- EXISTING TAILWORKS.
- EXISTING 12" OUTFALL PIPE.
- EXISTING TRANSFORMER AND DISTRIBUTION SWITCH.

### SHEET GENERAL NOTES:


- UTILITIES ILLUSTRATED ON PLAN ARE PRESENTED FOR CONTRACTOR INFORMATION, IF APPLICABLE. SUBSURFACE UTILITY LOCATES HAVE NOT BEEN FIELD VERIFIED. ACTUAL UTILITIES ARE SUBJECT TO CHANGE AND UNMARKED. UNKNOWN UTILITIES SHOULD BE MITIGATED IN THE FIELD PRIOR TO GROUND DISTURBANCES. COORDINATE WITH NAVAJO TRIBAL UTILITY AUTHORITY (NTUA) IN TUBA CITY, AZ, AND ARIZONA ONE-CALL UTILITY LOCATE.



P:\consulting\projects\22-517-00010\NTUA HPP Tuba City WWF\CAD\4.C-101\_PROPOSED HPP SYSTEM.dwg

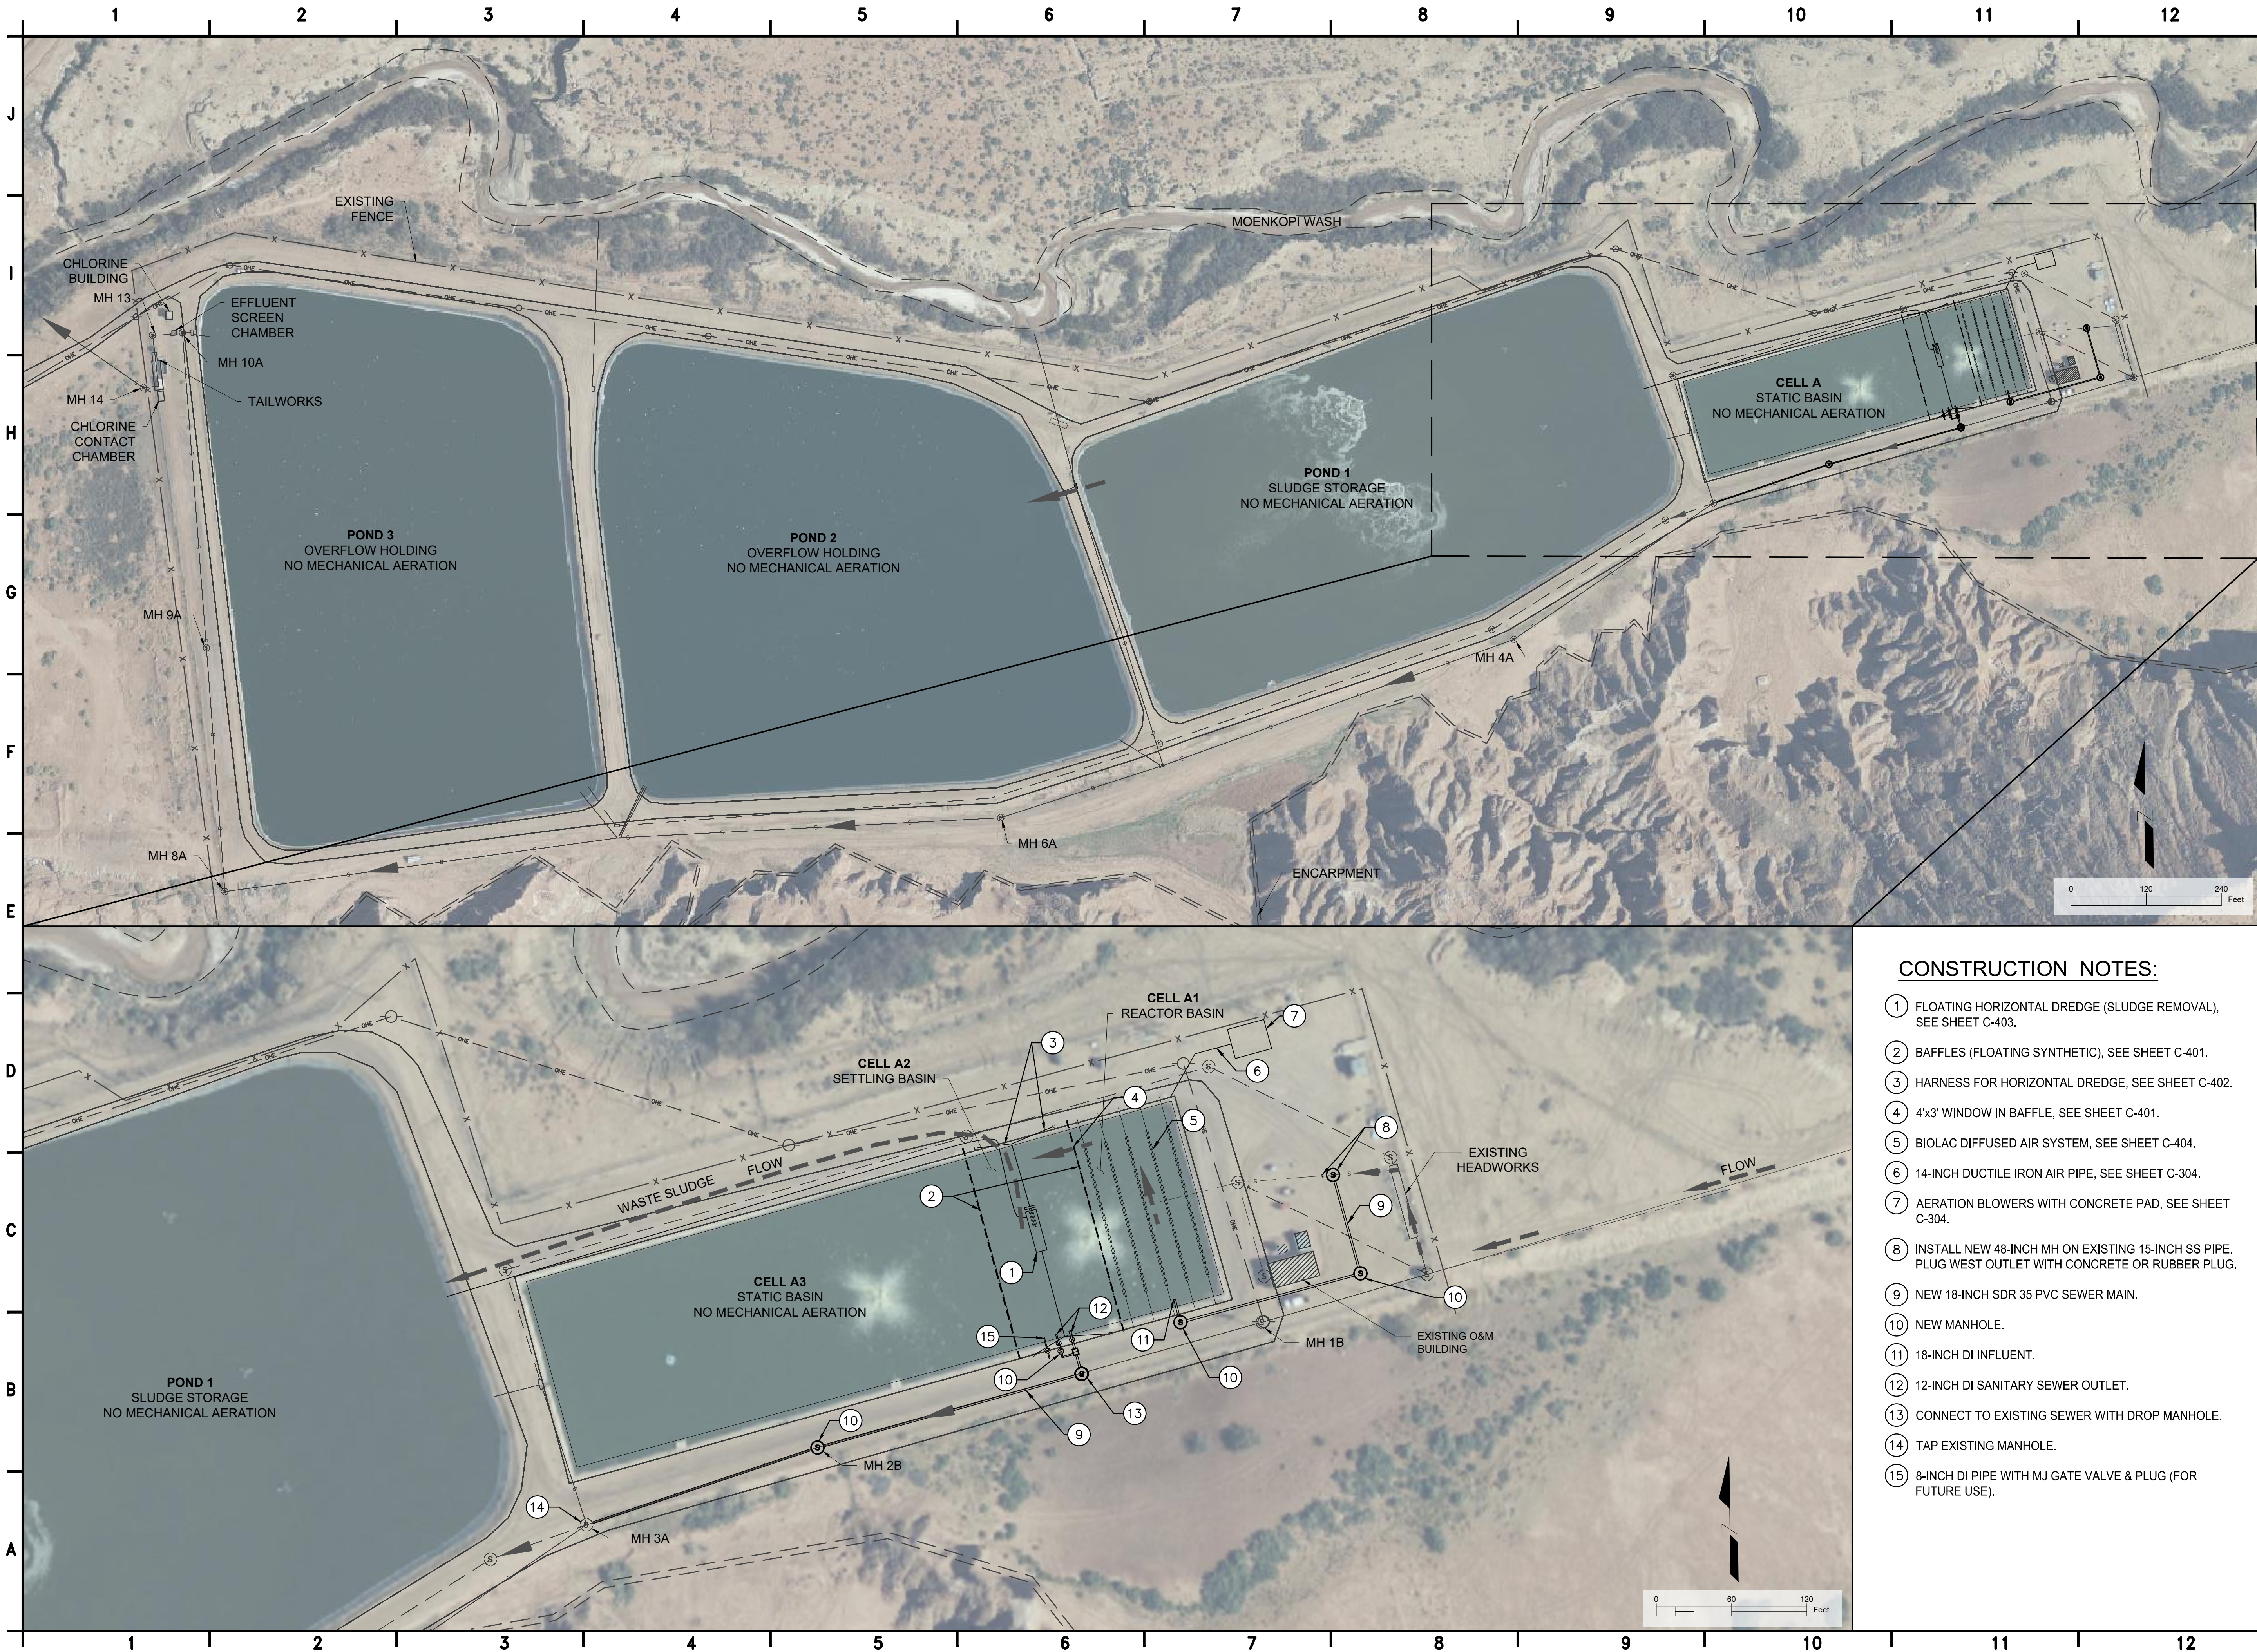

4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

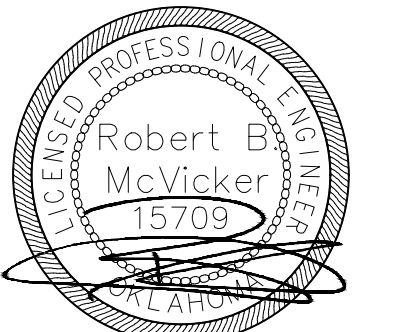

06/26/2023

**FINAL**

PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY  
PO BOX 170  
FT. DEFIANC, AZ 86504**

WSP PROJECT No:  
2251700010

#### CONSTRUCTION NOTES:

- 1 FLOATING HORIZONTAL DREDGE (SLUDGE REMOVAL), SEE SHEET C-403.
- 2 BAFFLES (FLOATING SYNTHETIC), SEE SHEET C-401.
- 3 HARNESS FOR HORIZONTAL DREDGE, SEE SHEET C-402.
- 4 4'x3' WINDOW IN BAFFLE, SEE SHEET C-401.
- 5 BIOLAC DIFFUSED AIR SYSTEM, SEE SHEET C-404.
- 6 14-INCH DUCTILE IRON AIR PIPE, SEE SHEET C-304.
- 7 AERATION BLOWERS WITH CONCRETE PAD, SEE SHEET C-304.
- 8 INSTALL NEW 48-INCH MH ON EXISTING 15-INCH SS PIPE. PLUG WEST OUTLET WITH CONCRETE OR RUBBER PLUG.
- 9 NEW 18-INCH SDR 35 PVC SEWER MAIN.
- 10 NEW MANHOLE.
- 11 18-INCH DI INFLUENT.
- 12 12-INCH DI SANITARY SEWER OUTLET.
- 13 CONNECT TO EXISTING SEWER WITH DROP MANHOLE.
- 14 TAP EXISTING MANHOLE.
- 15 8-INCH DI PIPE WITH MJ GATE VALVE & PLUG (FOR FUTURE USE).

REVISIONS			
NO.	DATE	BY	APPROVED


DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
**PROPOSED HIGH  
PERFORMANCE  
POND SYSTEM**

SHEET NUMBER:	REV. #
<b>C-101</b>	
SHEET 4 OF 38 SHEETS	



P:\consulting\projects\22\22-517-00010\NTUA HPP Tuba City WWF\CAD\5.C-102 &103\_NEW SEWER P&P.dwg

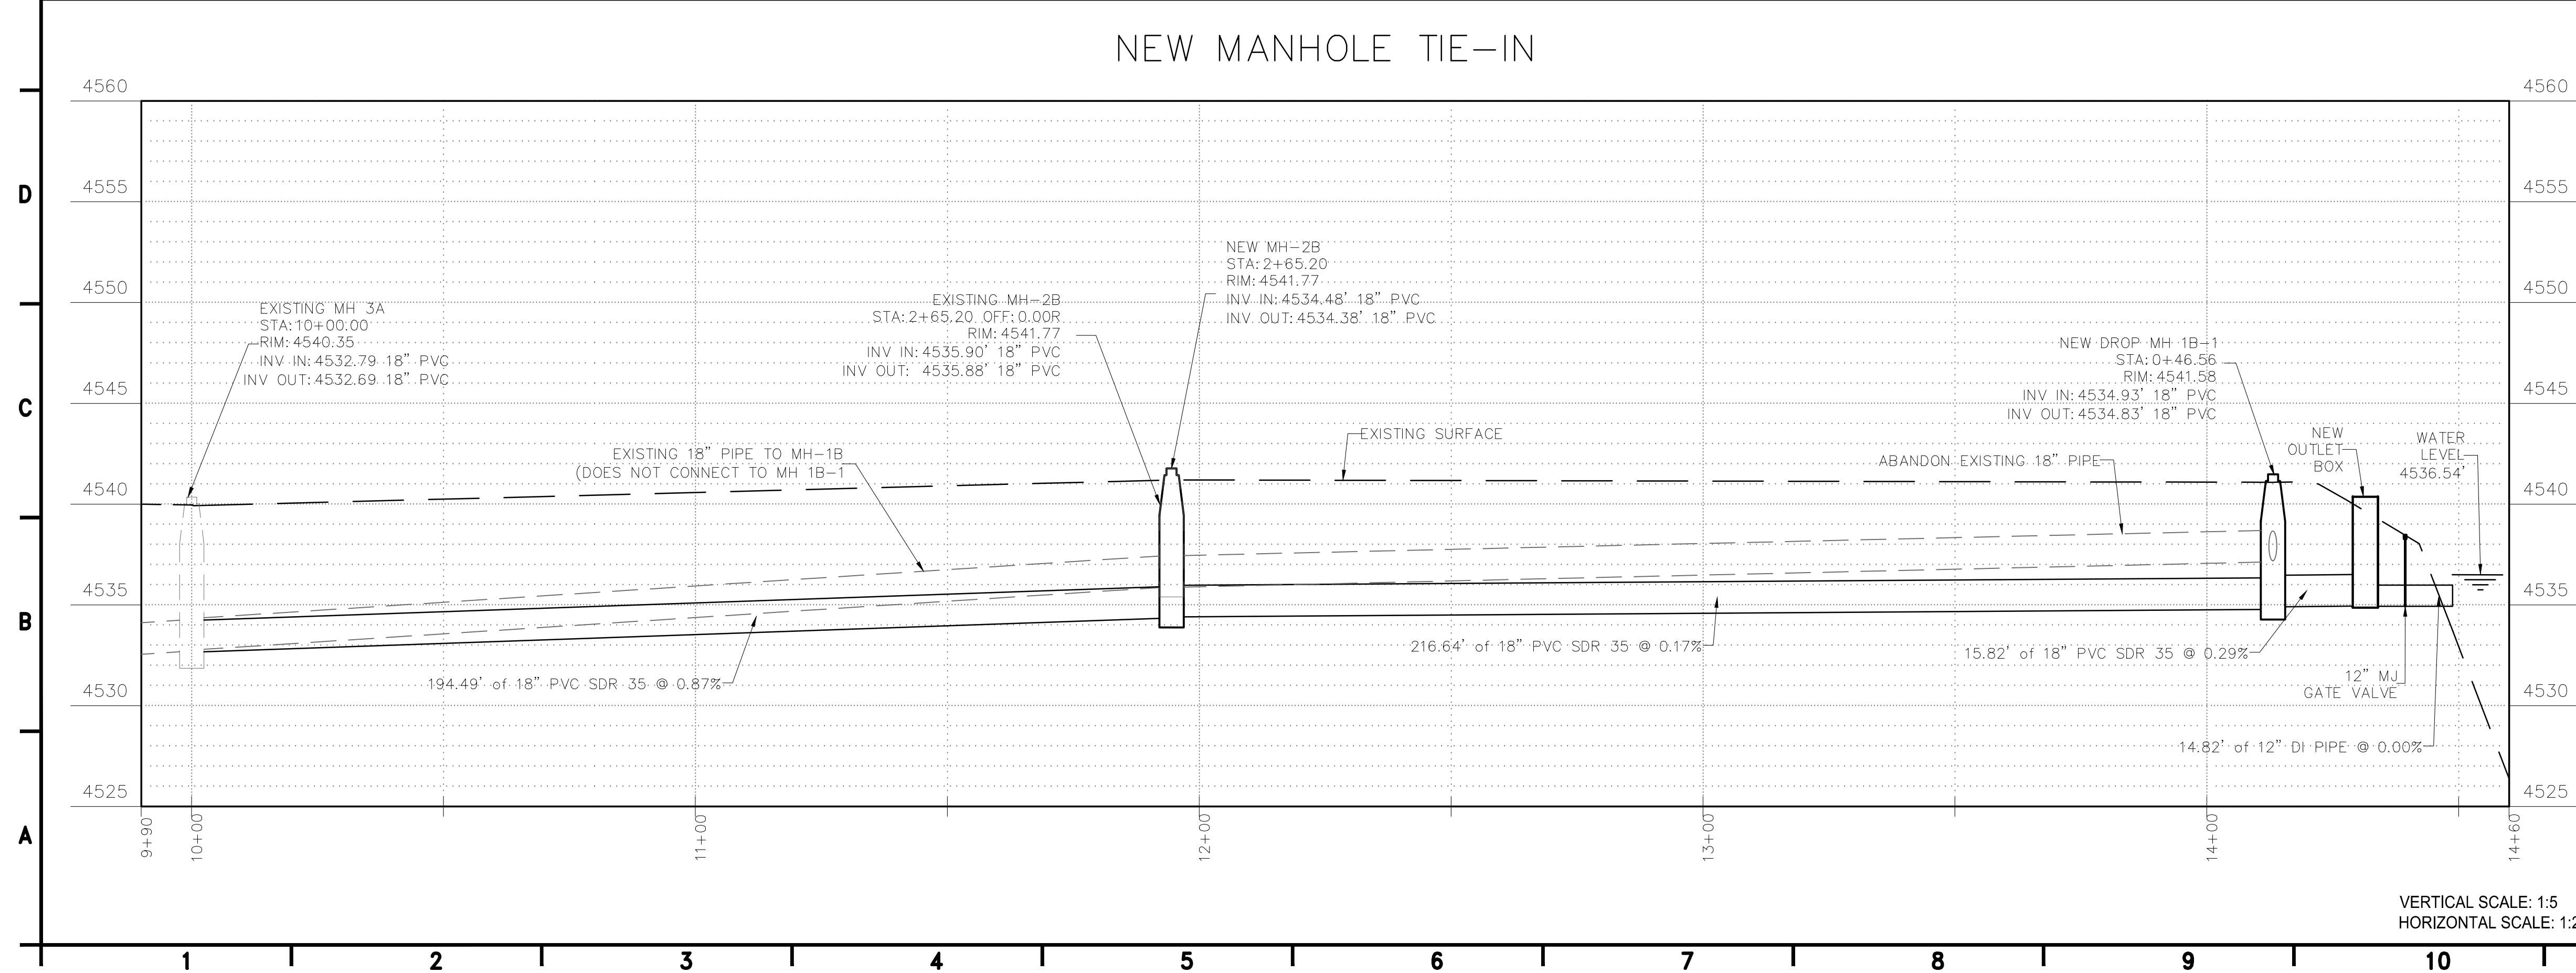


#### CONSTRUCTION NOTES:

- 1 FLOATING HORIZONTAL DREDGE (SLUDGE REMOVAL), SEE SHEET C-403.
- 2 HARNESS FOR HORIZONTAL DREDGE, SEE SHEET C-402.
- 3 BAFFLES (FLOATING SYNTHETIC), SEE SHEET C-401.
- 4 4'x3' WINDOW IN BAFFLE , SEE SHEET C-401.
- 5 BIOLAC DIFFUSED AIR SYSTEM, CAPACITY 3660 CFM, SEE SHEET C-404.
- 6 NEW MANHOLE TO REPLACE EXISTING.
- 7 NEW DROP MANHOLE (REPLACE EXISTING).
- 8 OUTLET BOX WITH WEIR, SEE SHEET C-301.
- 9 12-INCH DI SANITARY SEWER OUTLET WITH MJ GATE VALVE.
- 10 8-INCH DI PIPE WITH MJ GATE VALVE & PLUG (FOR FUTURE USE).
- 11 FLEXIBLE HOSE.
- 12 ANCHOR POST, SEE SHEET C-402.



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

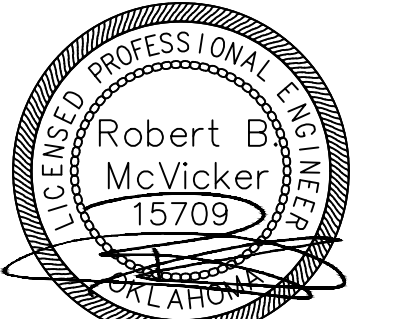

06/26/2023

# FINAL

PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC, AZ 86504

WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
**MANHOLE-TIE IN  
PLAN  
AND  
PROFILE**


SHEET NUMBER:	REV. #
<b>C-102</b>	
SHEET 5 OF 38 SHEETS	



P:\consulting\projects\22\22-517-00010\NTUA HPP Tuba City WWF\CAD\5.C-102 &103\_NEW SEWER P&P.dwg



### NEW 18-INCH PVC SEWER

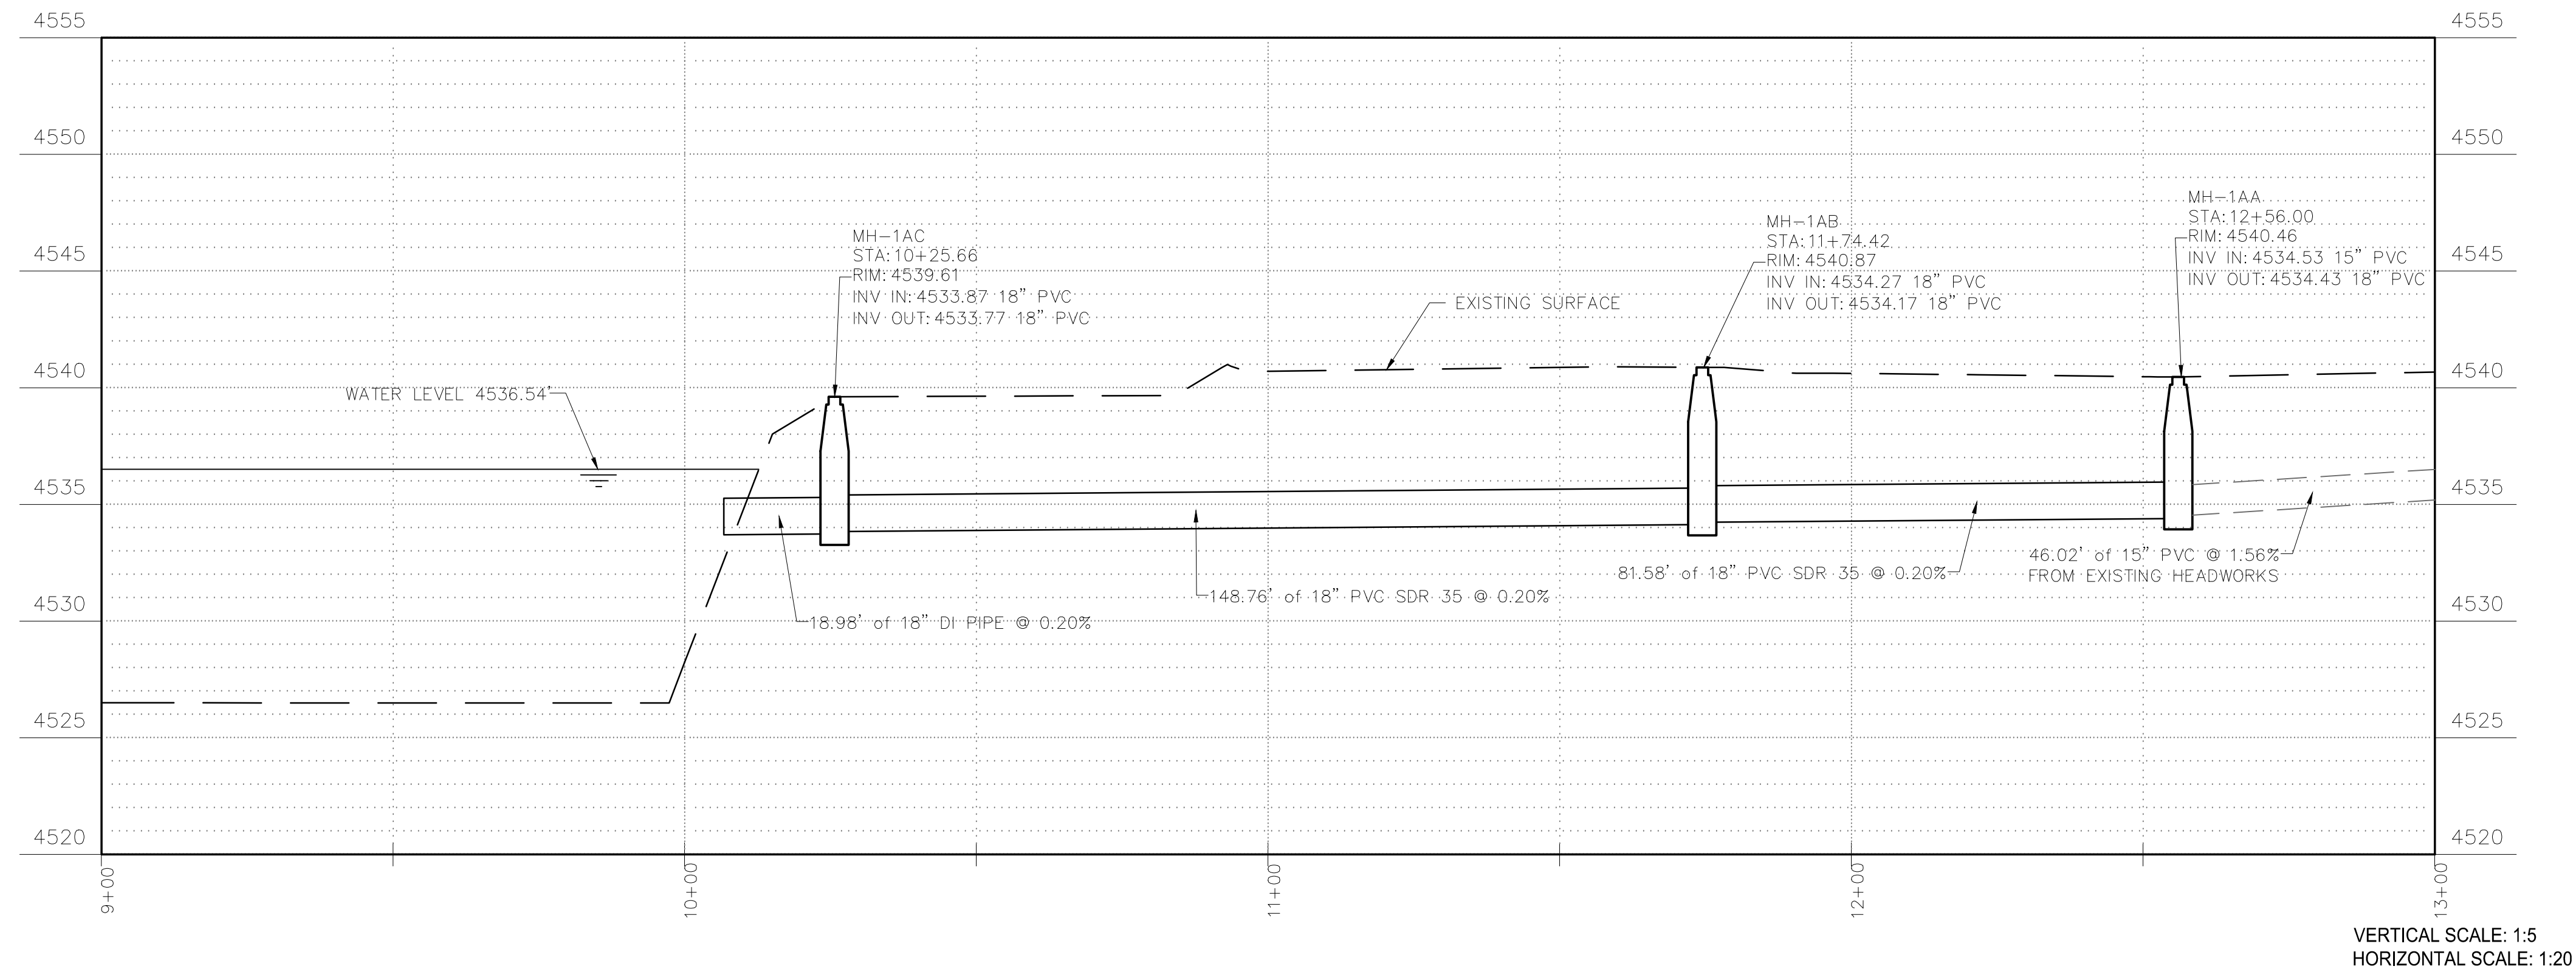


### CONSTRUCTION NOTES:

- 1 FLOATING HORIZONTAL DREDGE (SLUDGE REMOVAL), SEE SHEET C-403.
- 2 HARNESS FOR HORIZONTAL DREDGE, SEE SHEET C-402.
- 3 BAFFLES (FLOATING SYNTHETIC), SEE SHEET C-401.
- 4 BIOLAC DIFFUSED AIR SYSTEM, CAPACITY 3660 CFM, SEE SHEET C-404.
- 5 18-INCH DI SANITARY SEWER INFLUENT PIPE.
- 6 FLEXIBLE HOSE.
- 7 ANCHOR POST, SEE SHEET C-402.



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

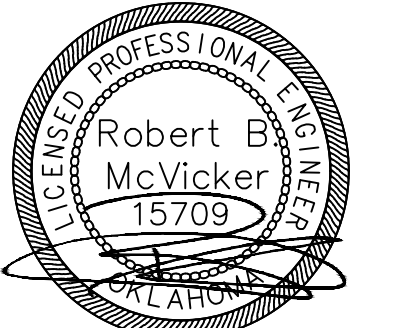

06/26/2023

# FINAL

PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC, AZ 86504

WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED


DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
**MANHOLE-TIE IN  
PLAN  
AND  
PROFILE**


SHEET NUMBER:	REV. #
<b>C-103</b>	
SHEET 6 OF 38 SHEETS	



P:\consulting\projects\22\22-517-00010.NTUA HPP Tuba City WWF\CAD\7 and 8.C-300 and 301-B\_DISCHARGE STRUCTURE DETAILS.dwg

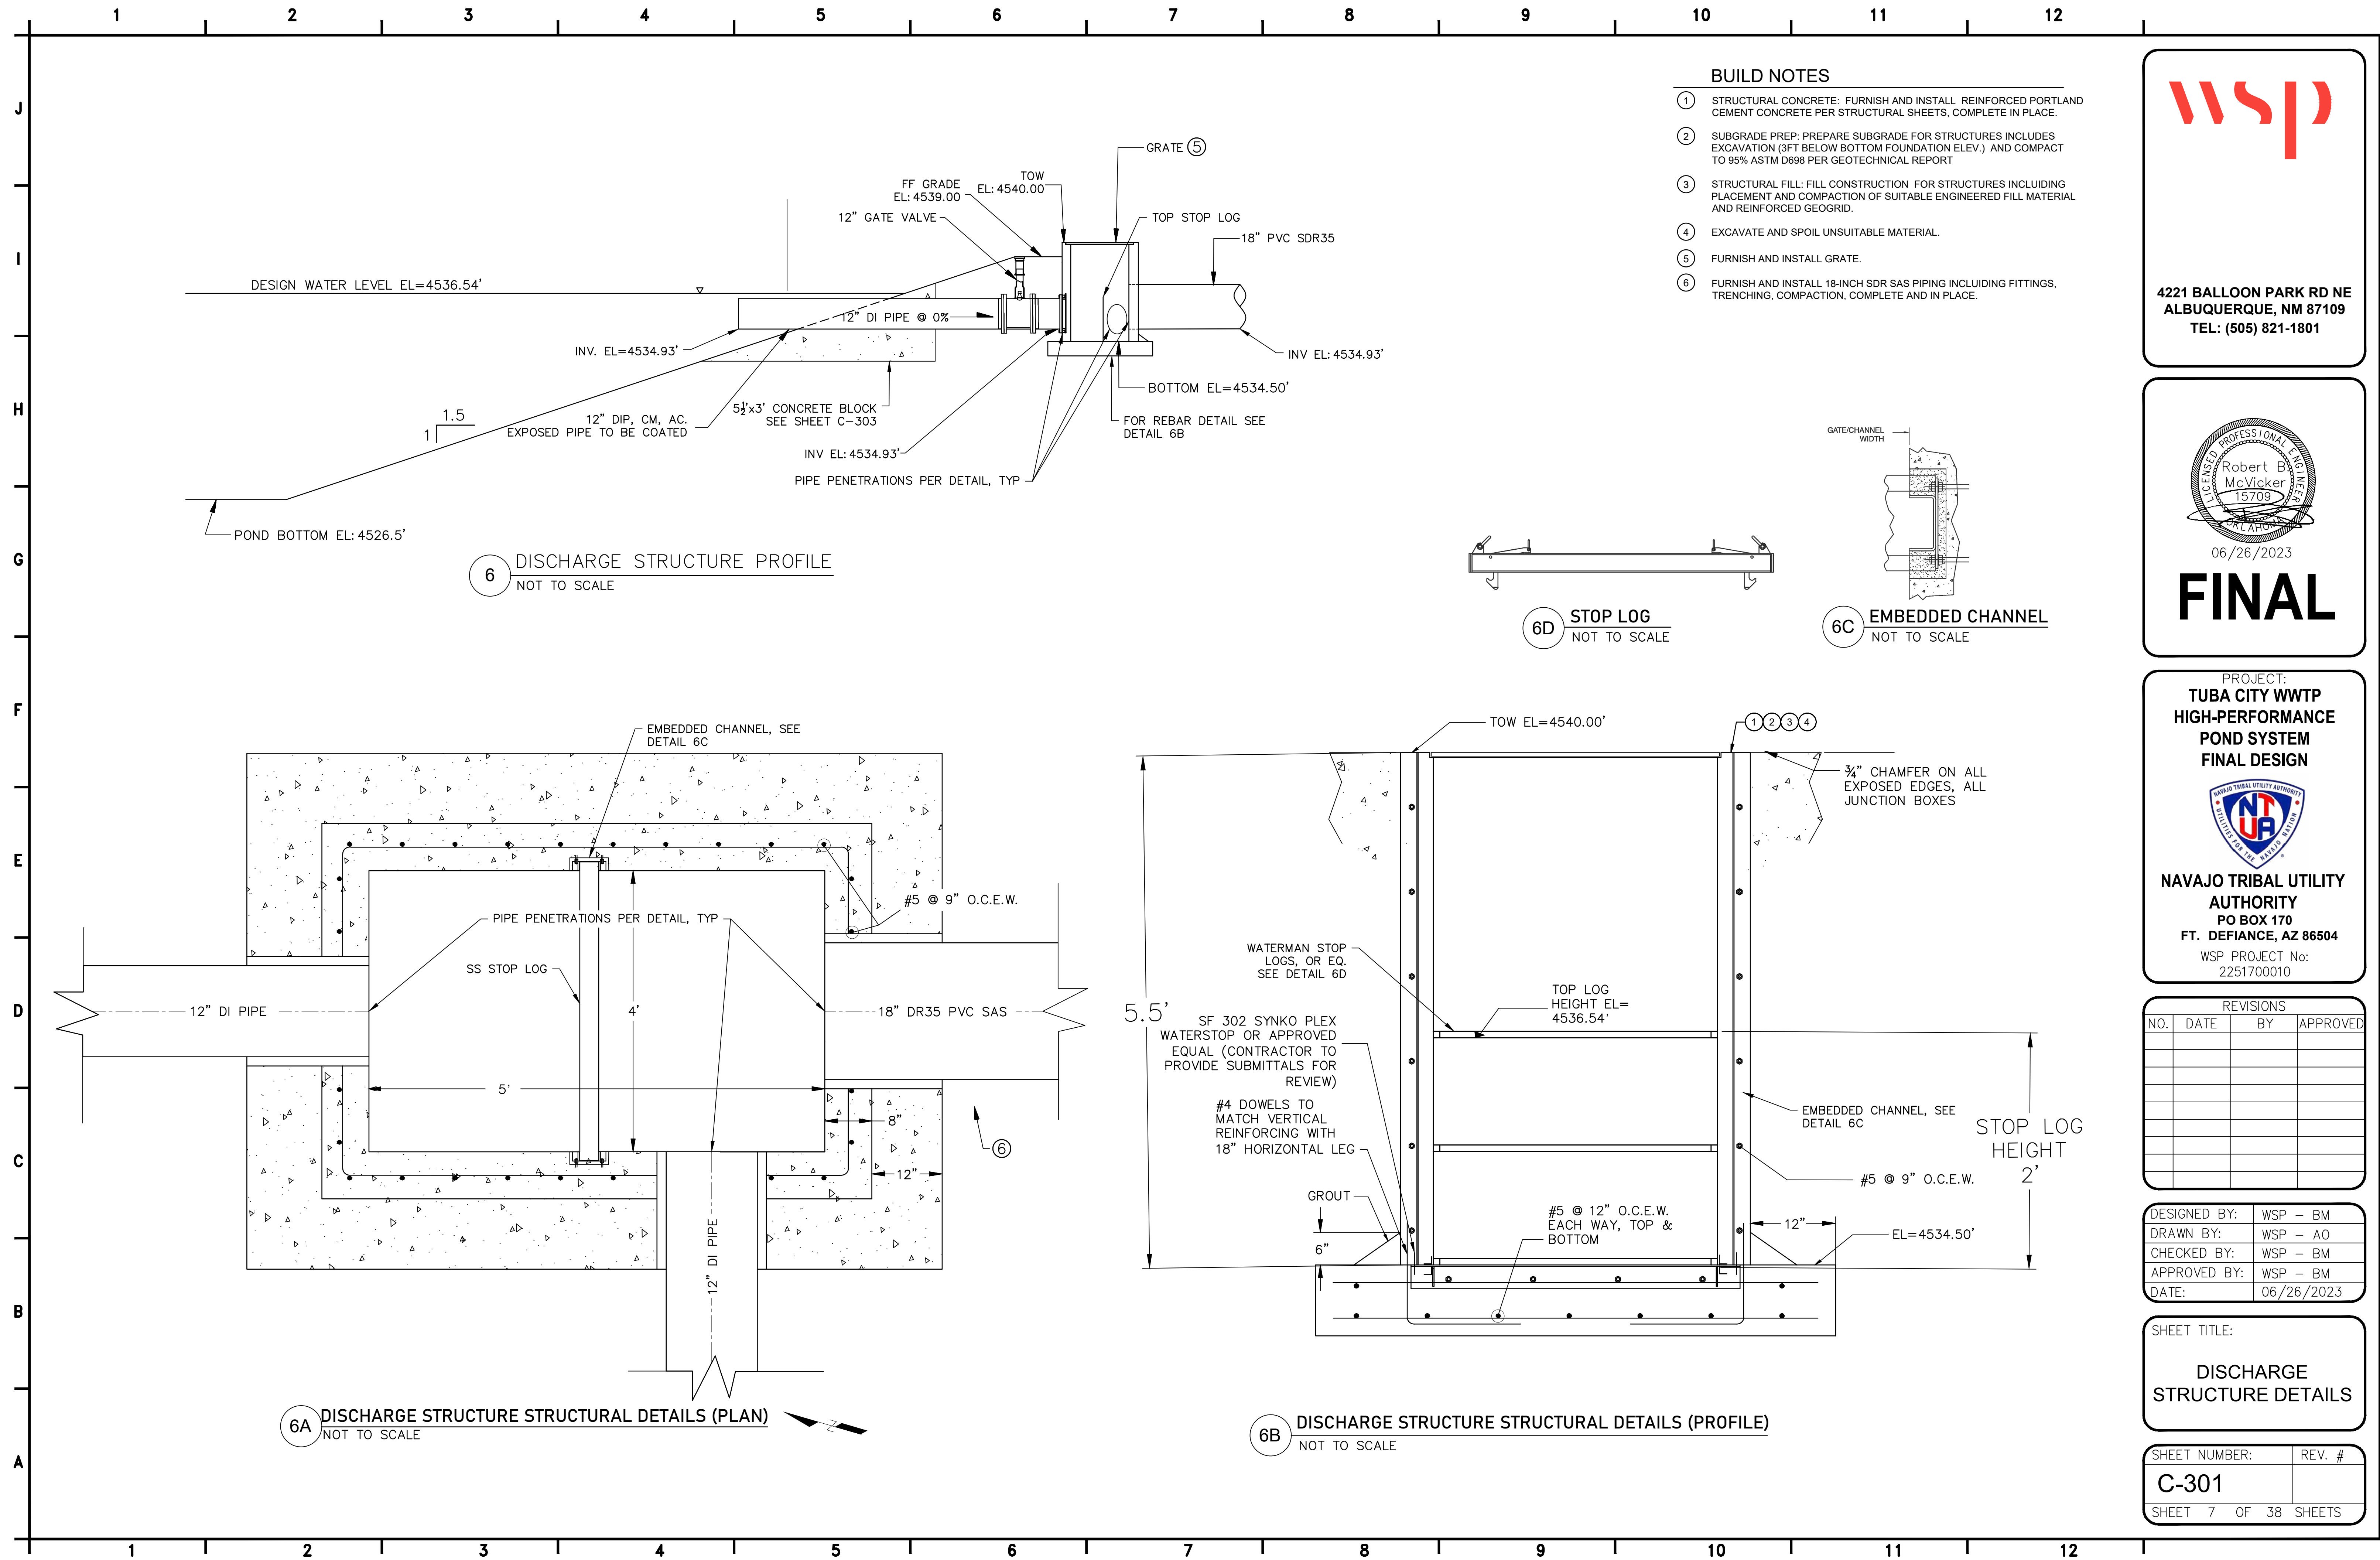

4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

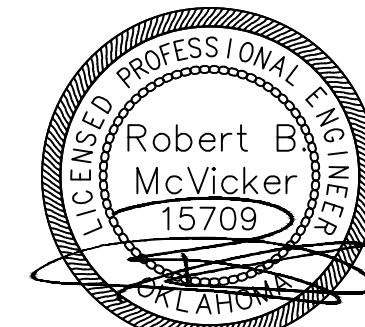

06/26/2023

**FINAL**

PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC, AZ 86504  
WSP PROJECT No:  
2251700010





REVISIONS			
NO.	DATE	BY	APPROVED

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023


SHEET TITLE:  
**DISCHARGE  
STRUCTURE DETAILS**

SHEET NUMBER:	REV. #
<b>C-301</b>	
SHEET 7 OF 38 SHEETS	



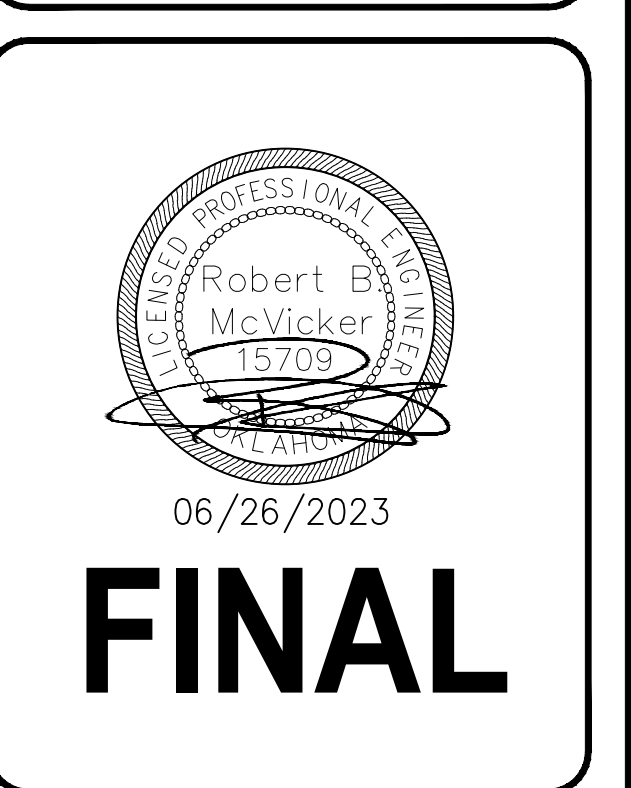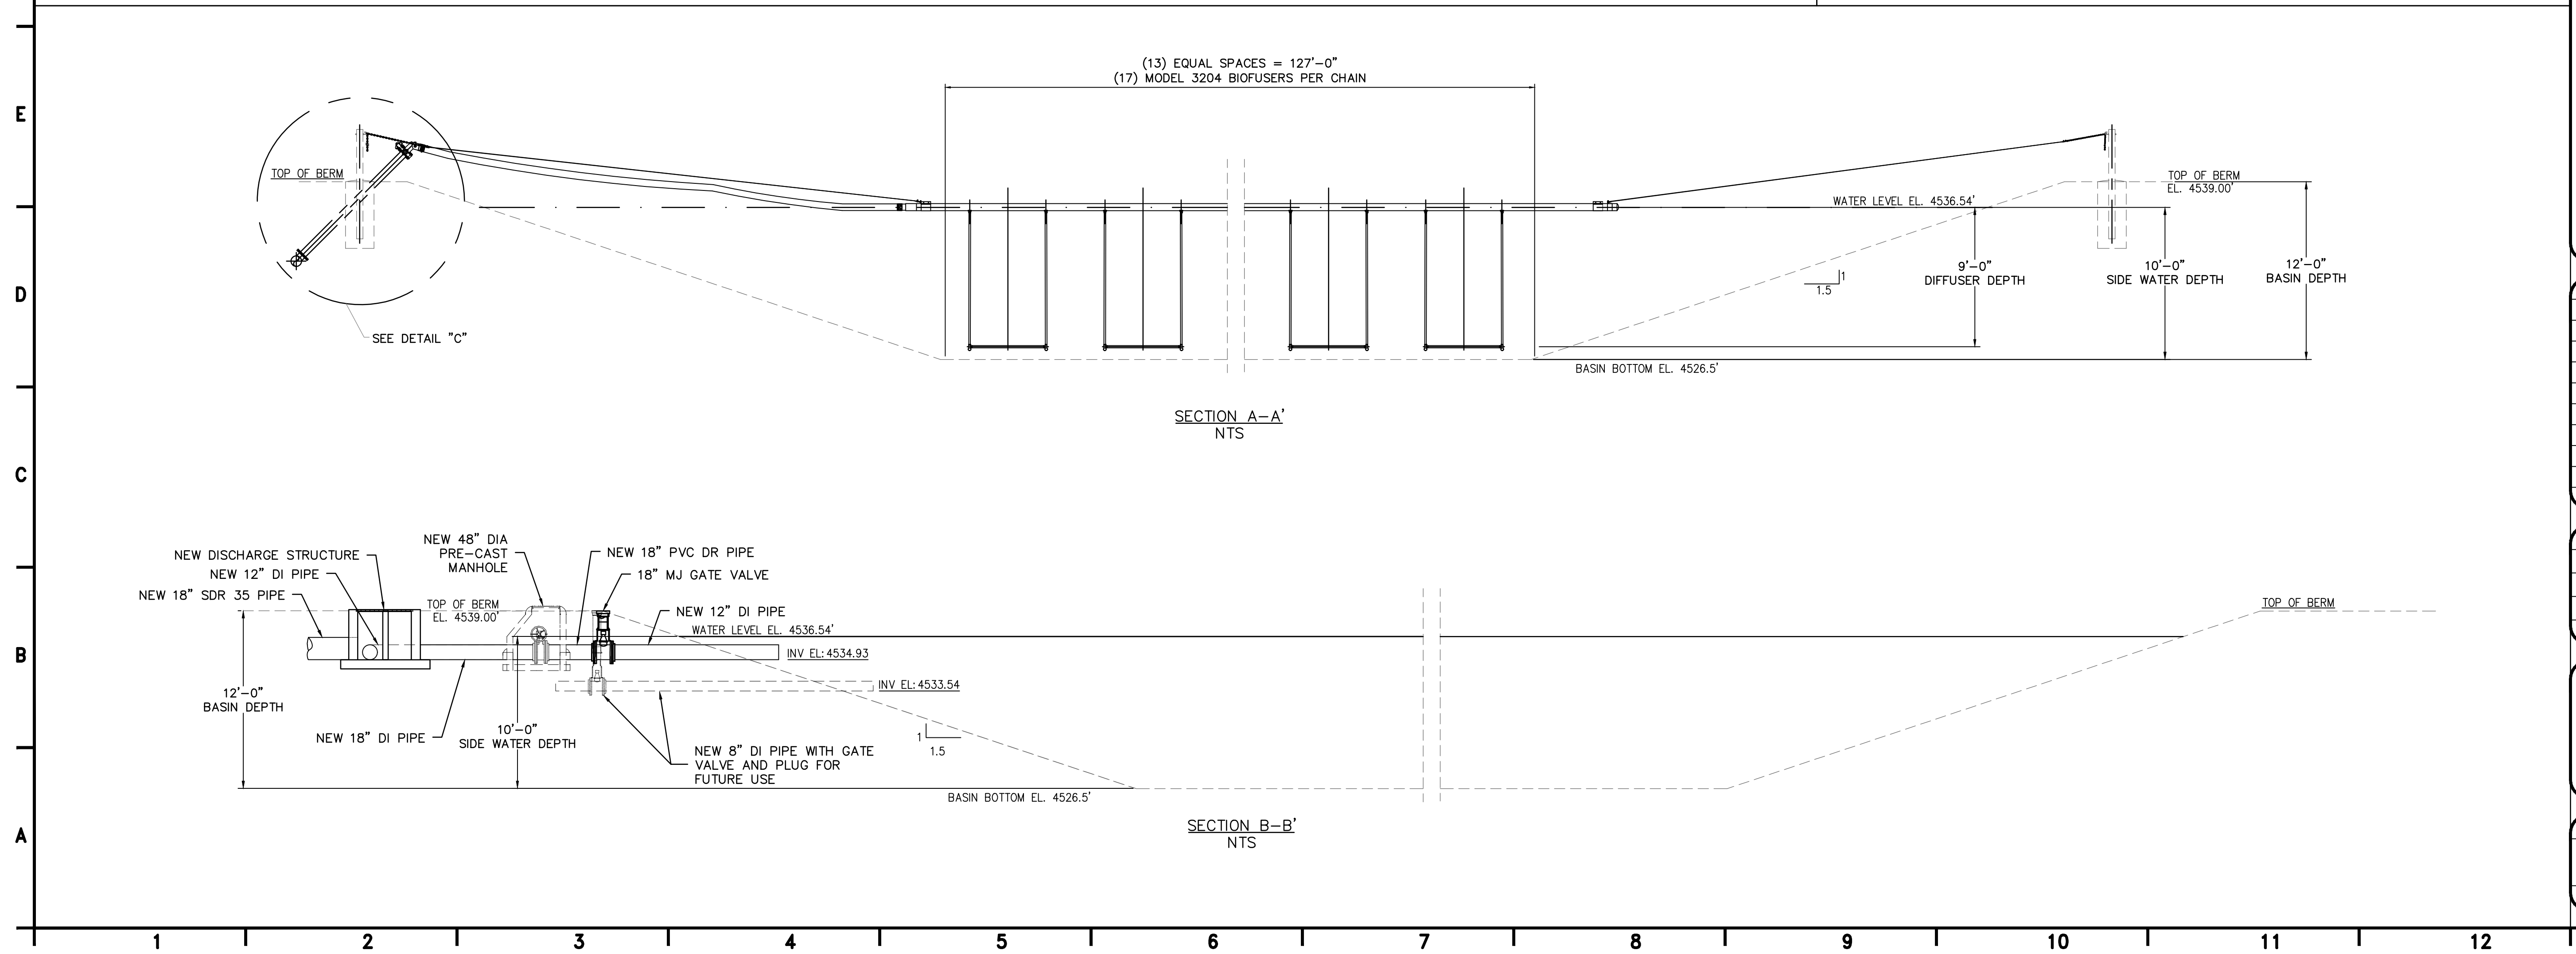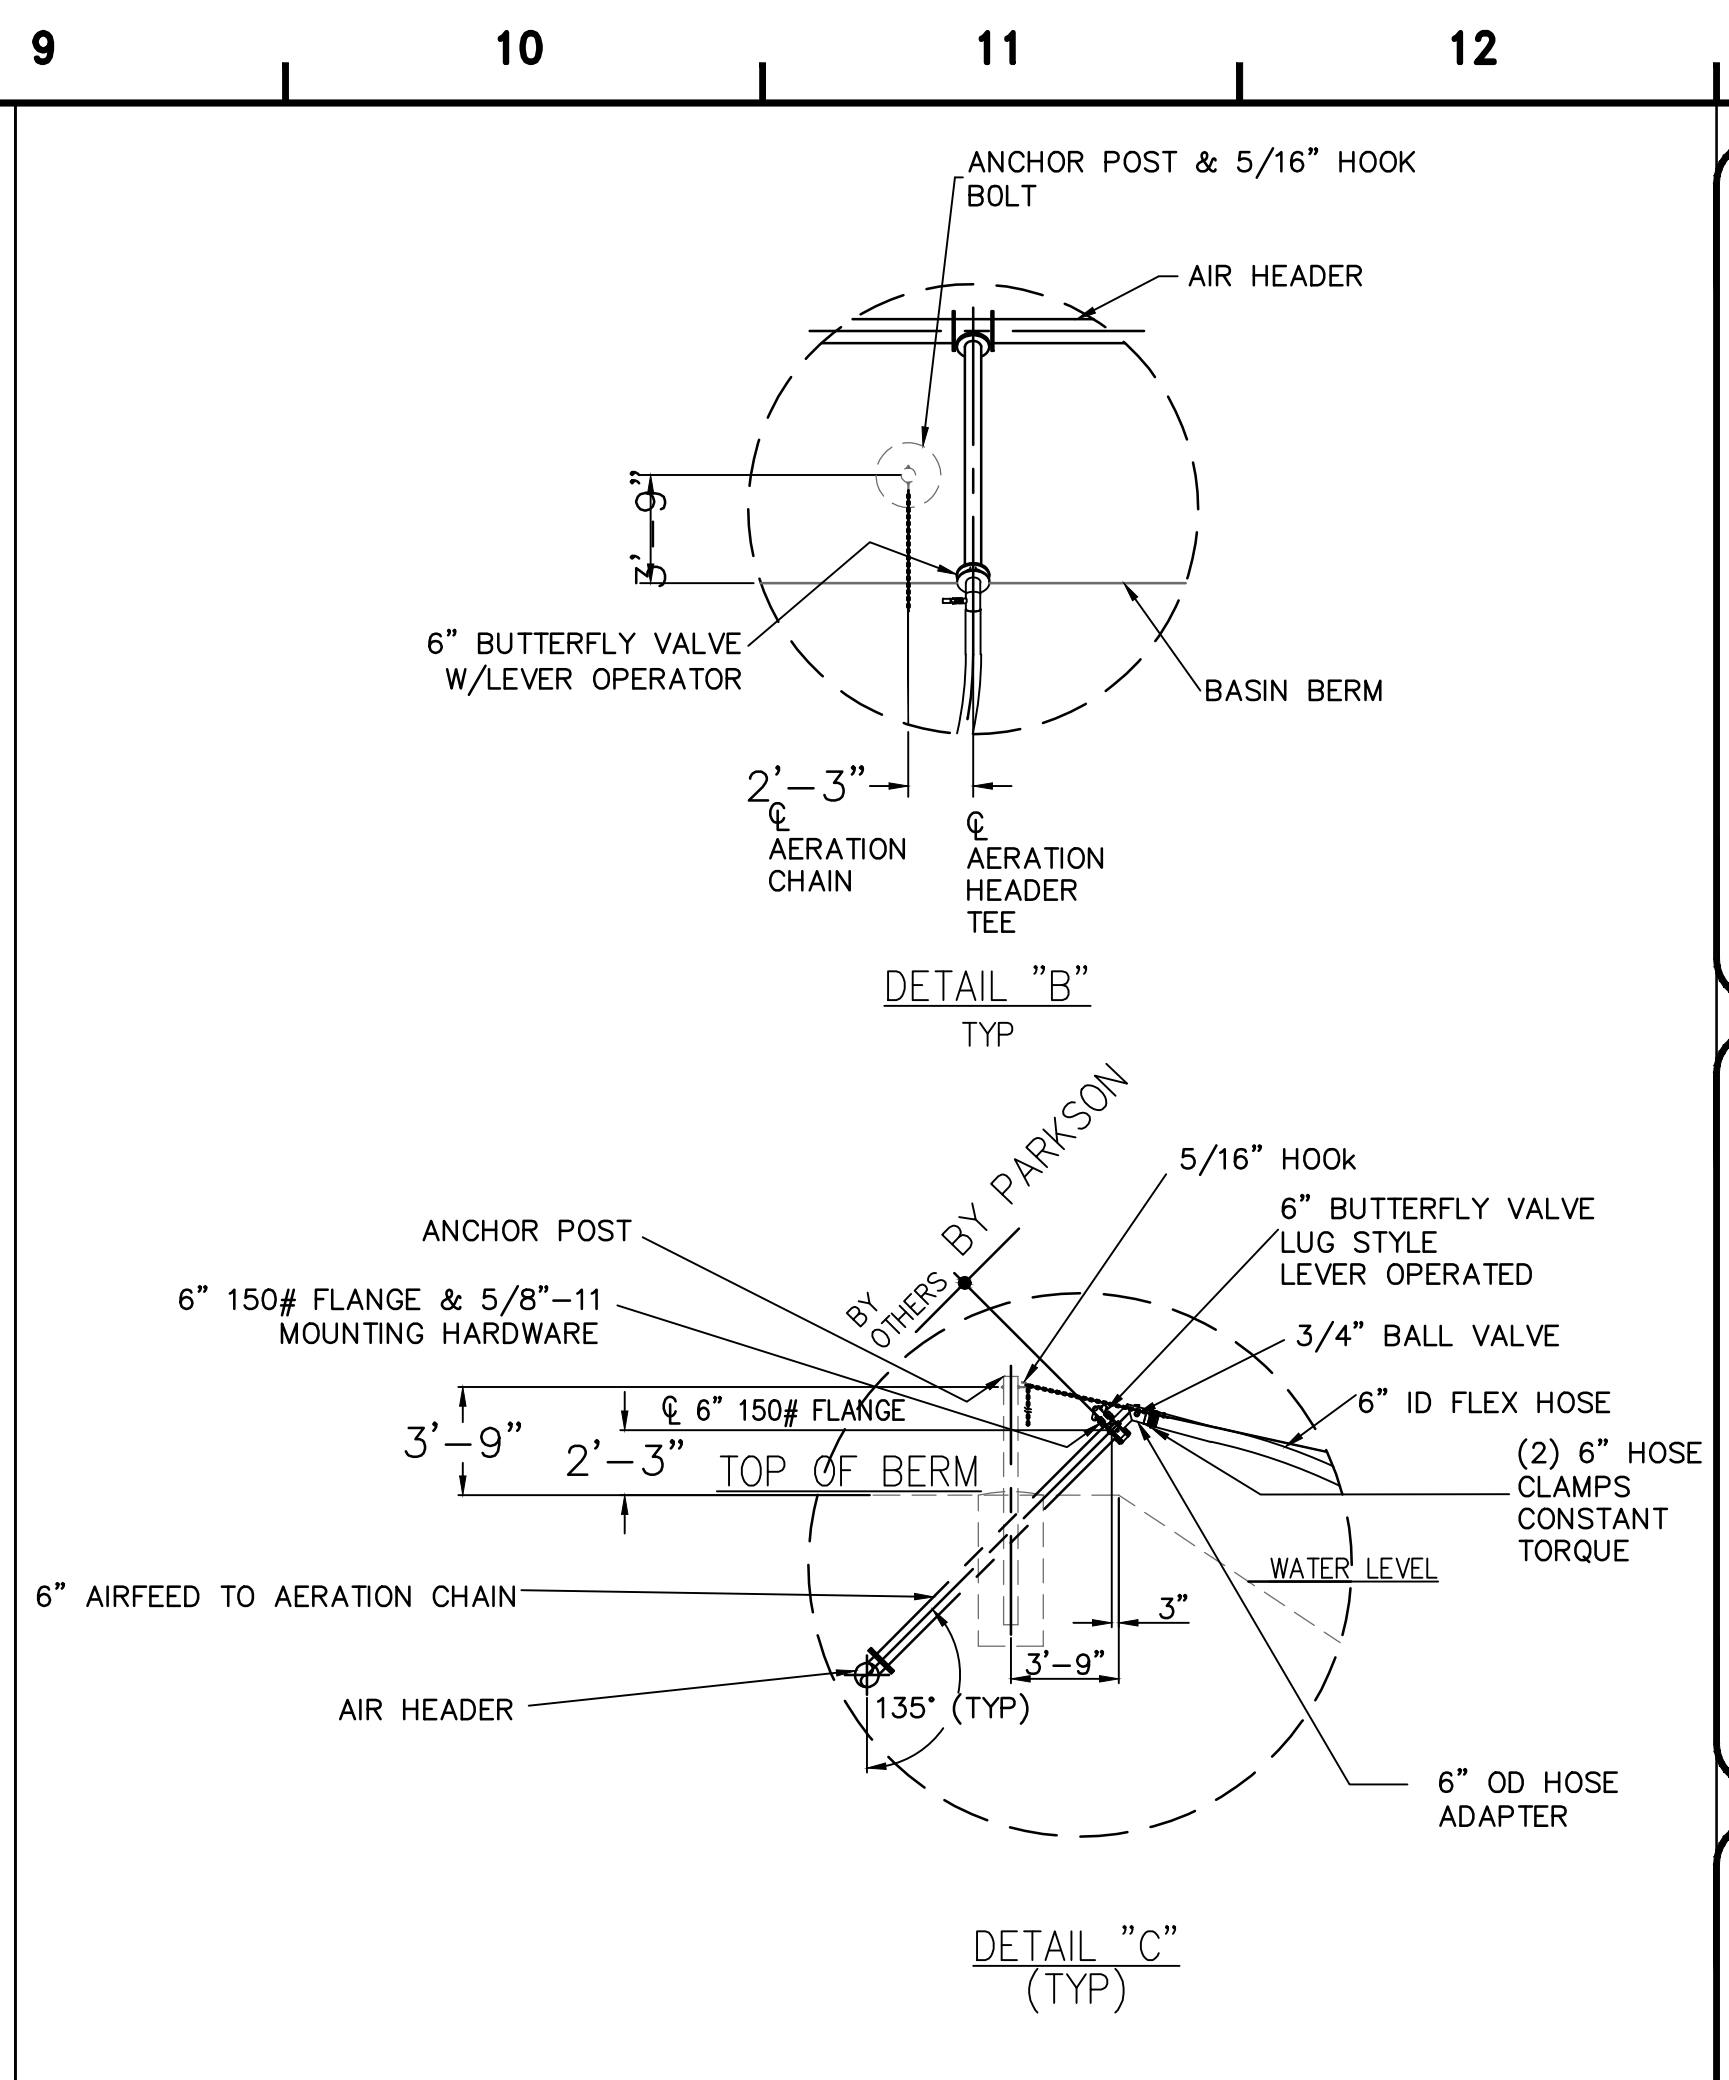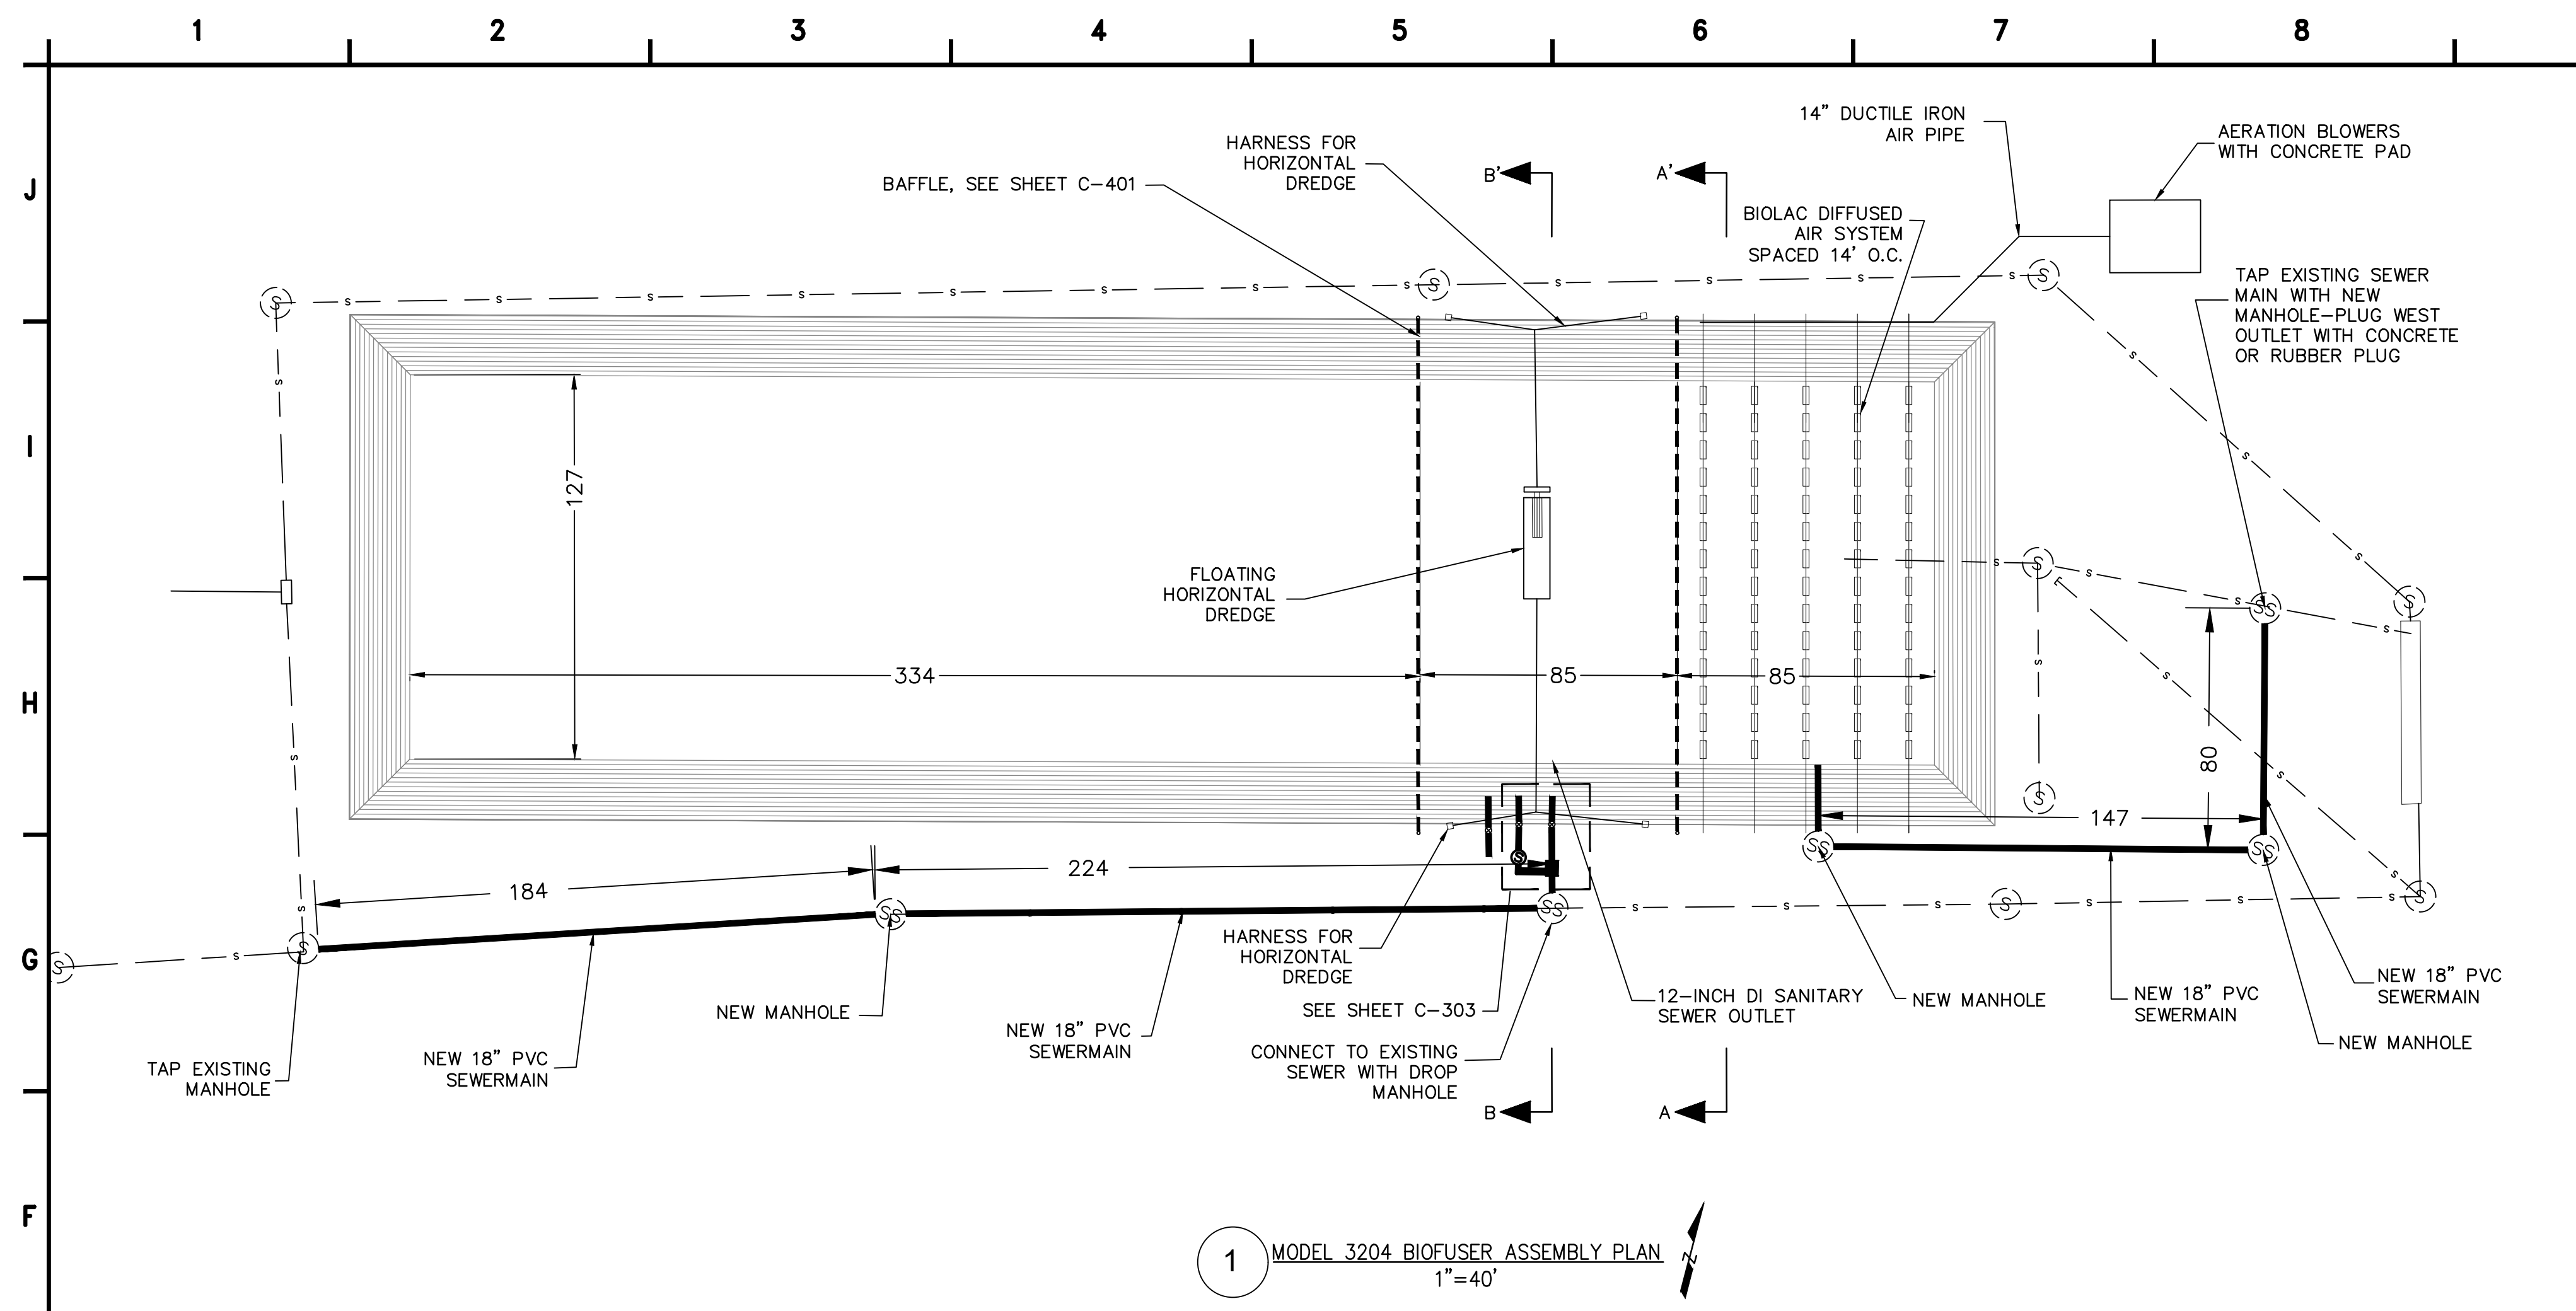

PROJECT:  
TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN

  
NAVAJO TRIBAL UTILITY  
AUTHORITY  
PO BOX 170  
FT. DEFIANC, AZ 86504

WSP PROJECT No:  
2251700010

[illegible]

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023


SHEET TITLE:

**DIFUSER  
DETAILS**


SHEET NUMBER:	REV. #
C-302	
SHEET 8 OF 38	SHEETS



P:\consulting\projects\22\22-517-00010.NTUA HPP Tuba City WMF\CAD\10.C-303\_DISCHARGE\_STRUCTURE\_DETAILS.dwg

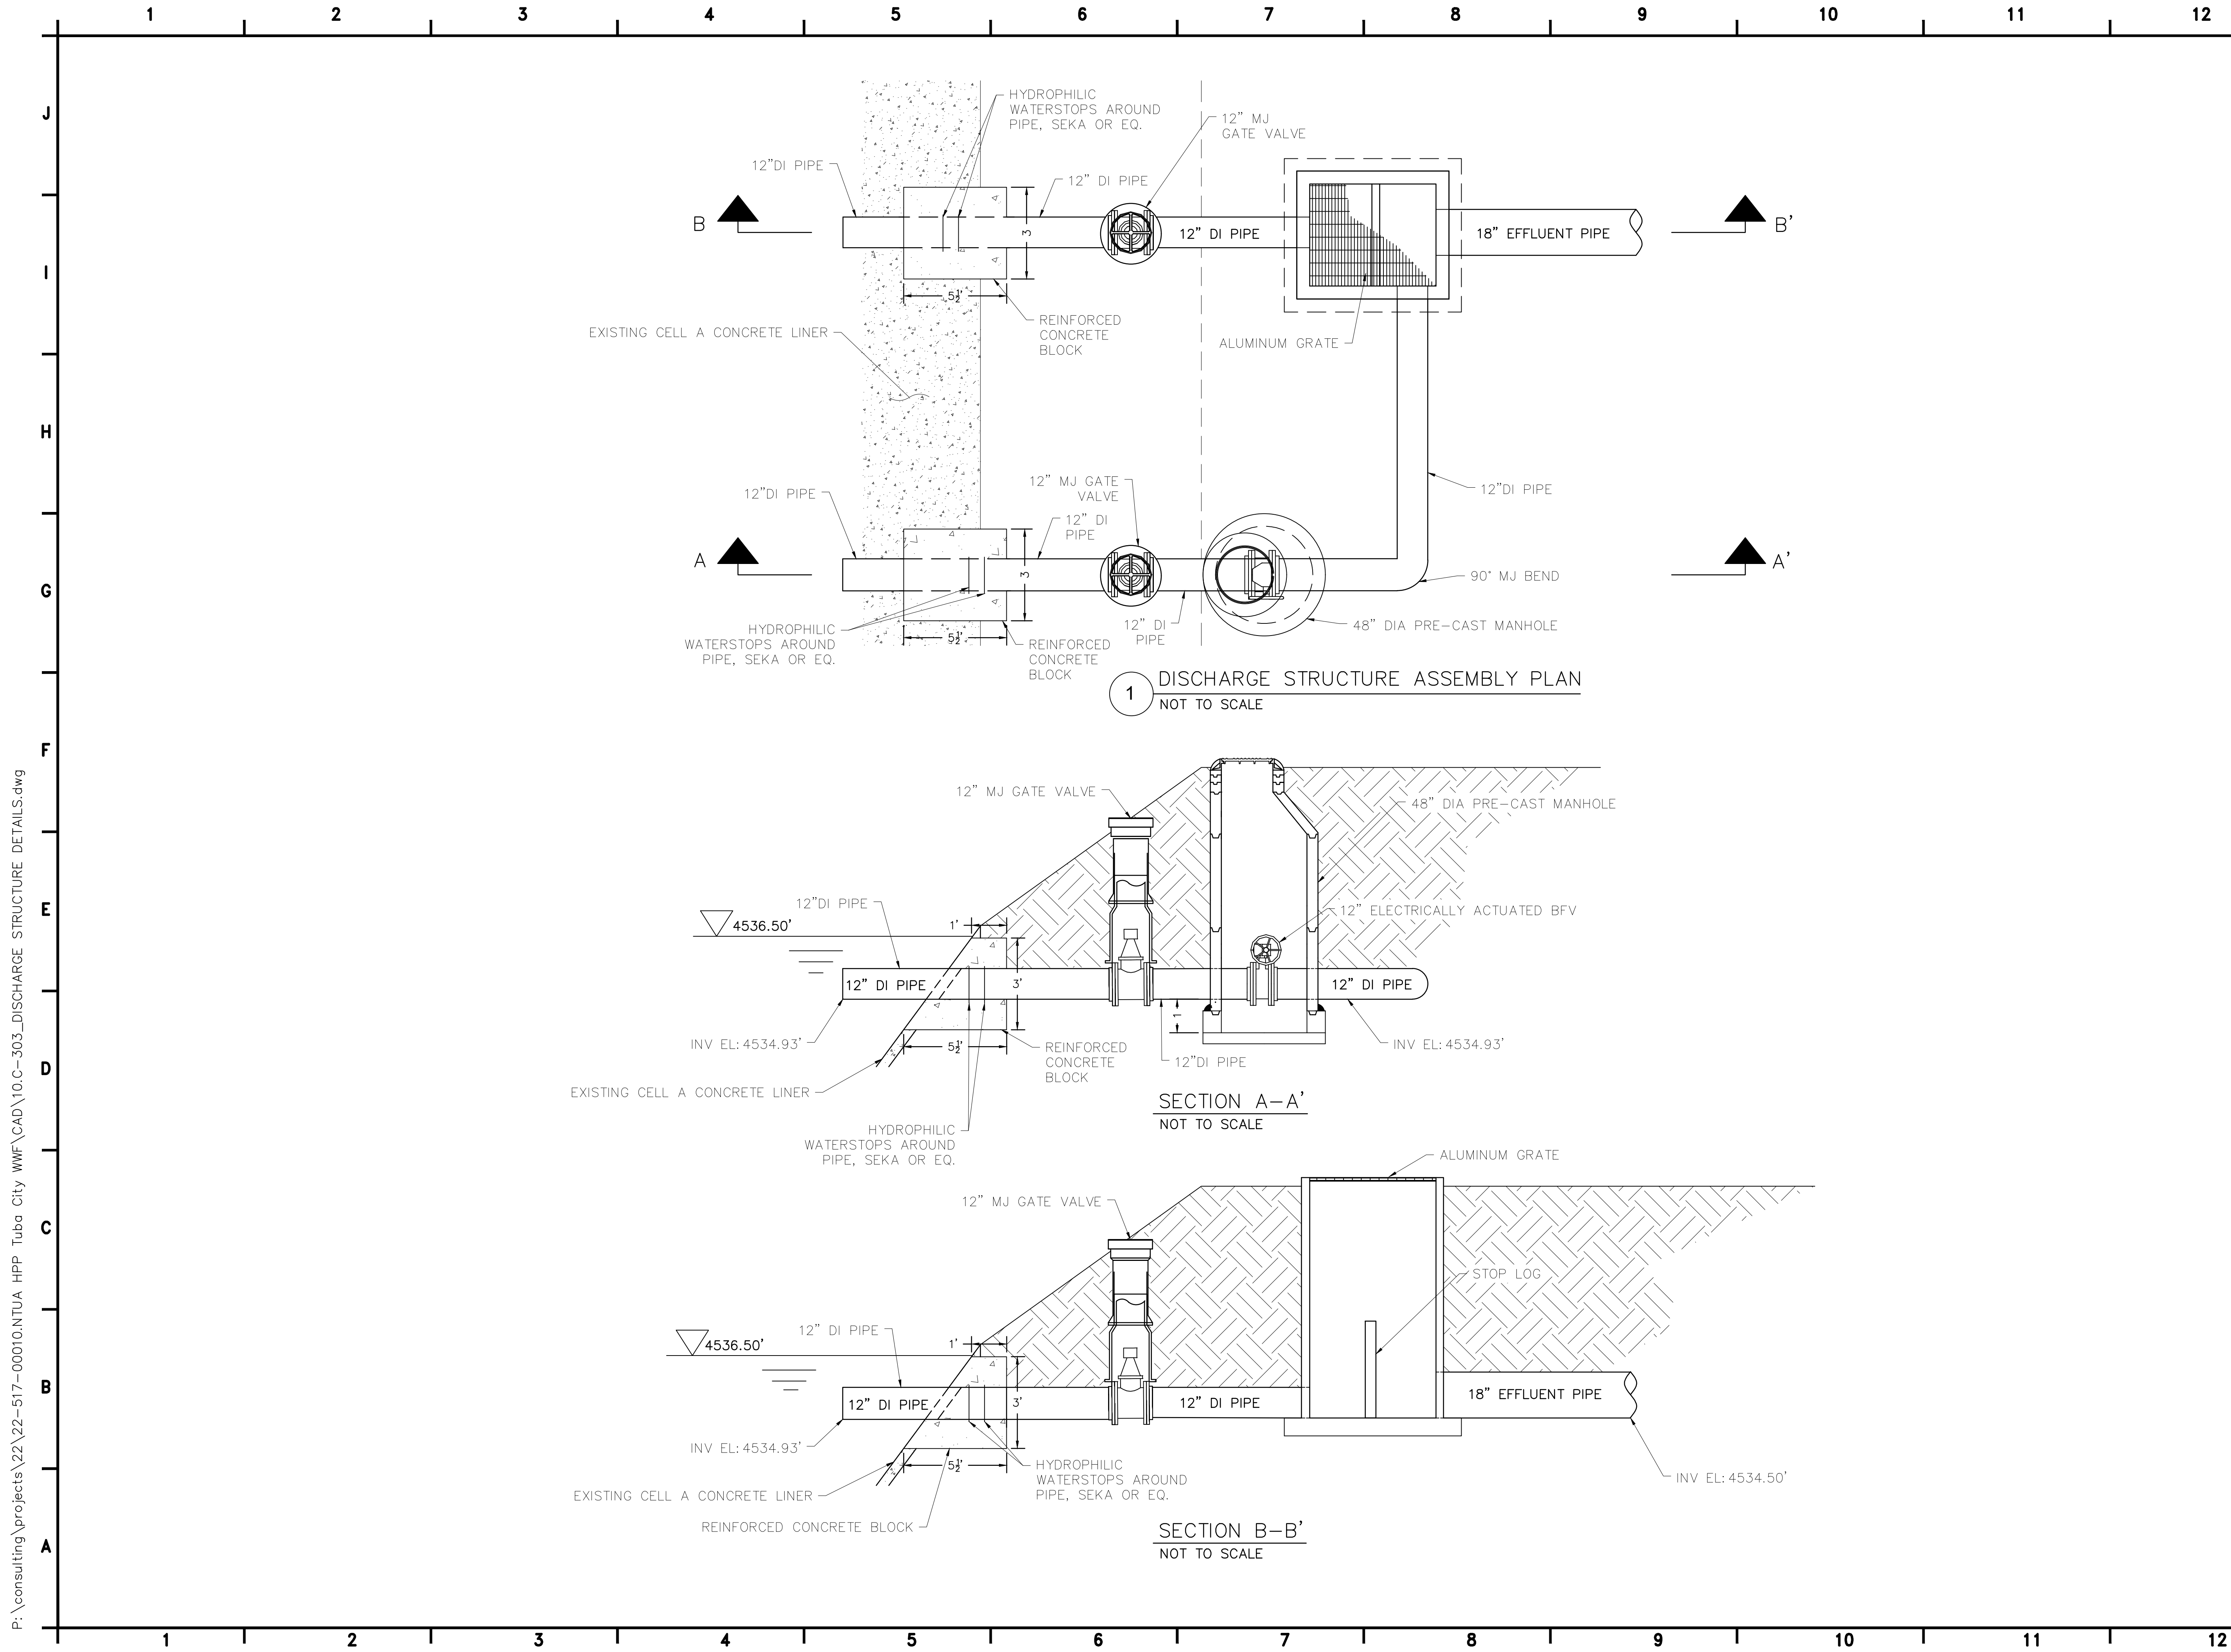

4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

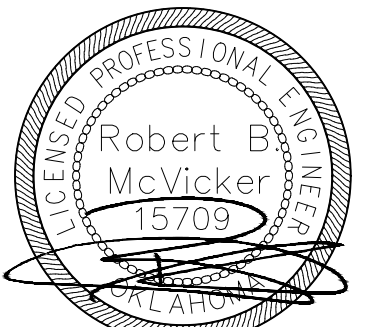

06/26/2023

**FINAL**

PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED


DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
**DISCHARGE  
STRUCTURE DETAILS**

SHEET NUMBER:	REV. #
<b>C-303</b>	
SHEET 9 OF 38 SHEETS	






P:\consulting\projects\22\22-517-00010.NTUA HPP Tuba City WWF\CAD\14.C-404\_BLOWER SYSTEM.dwg

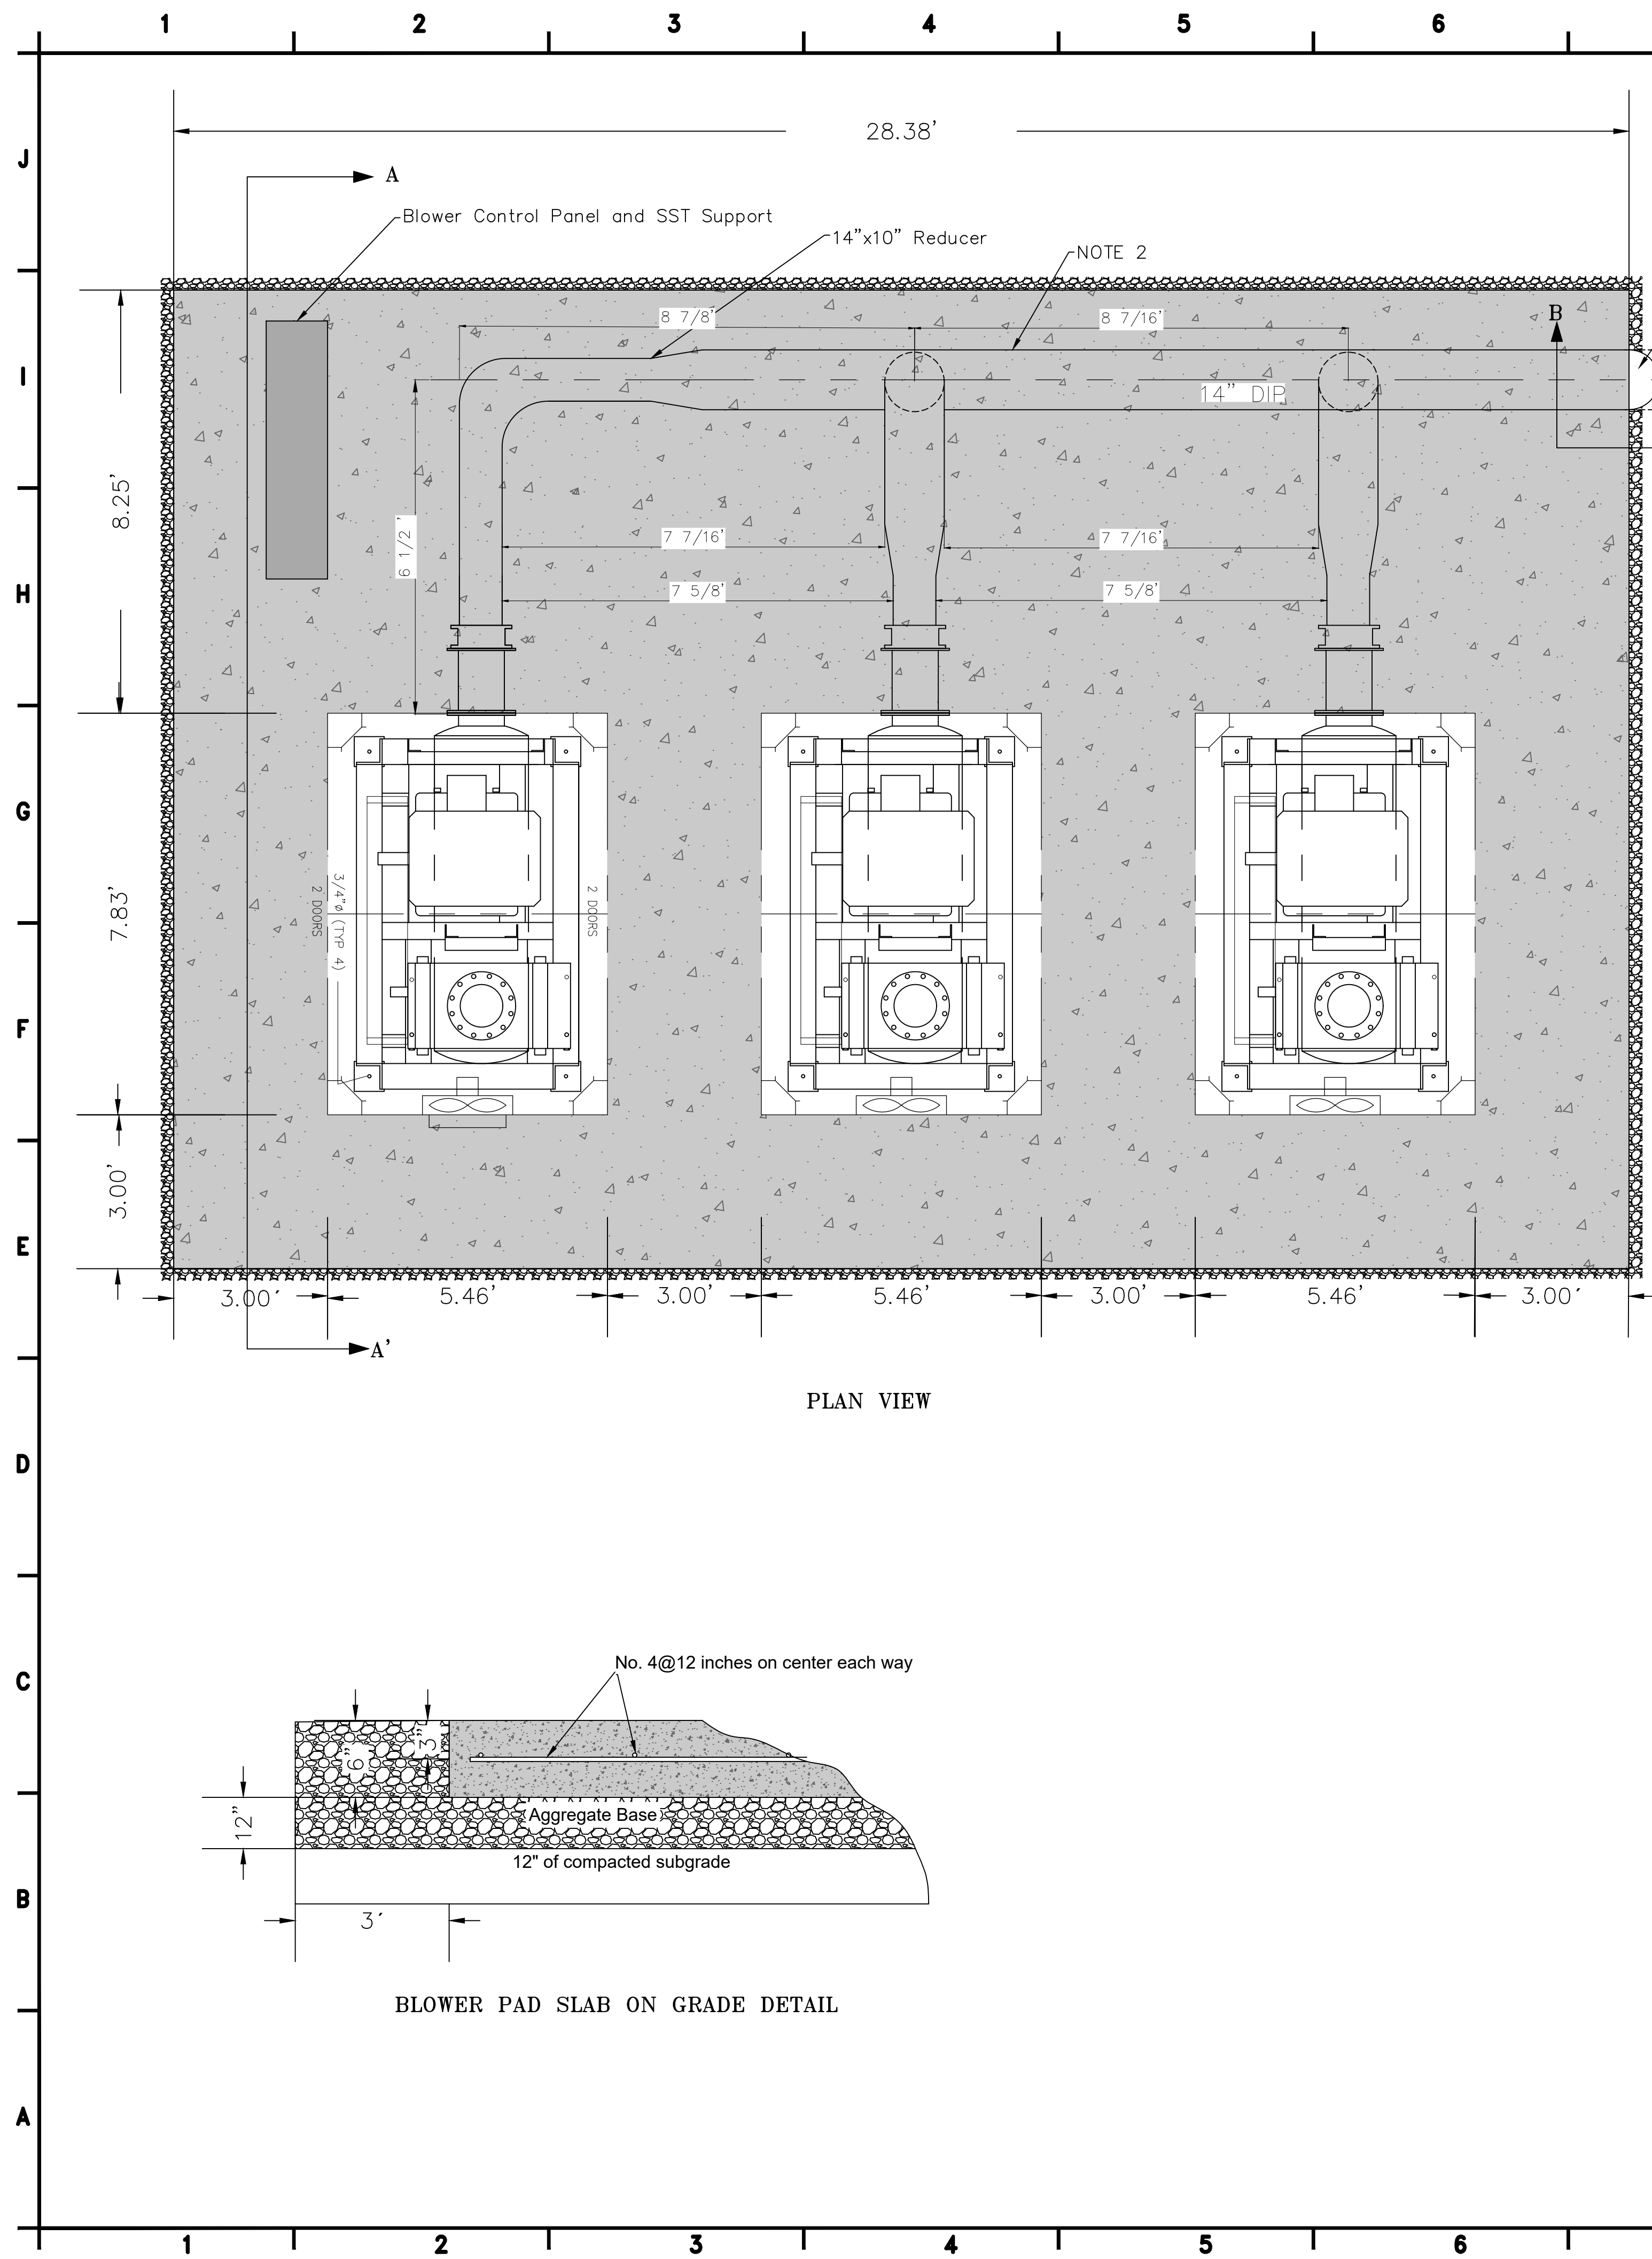


NOTES:

1. CONTRACTOR TO FIELD MEASURE AND CUT LENGTHS OF SPOOL PIECES NEEDED BETWEEN THE FLANGE AT BLOWER AND THE CENTERLINE OF AIR HEADER AS SHOWN IN THE PLANS.
2. CONTRACTOR SHALL DESIGN, SUPPLY AND INSTALL PIPE SUPPORT SYSTEM USING MANUFACTURER'S STANDARD AVAILABLE PIPE SUPPORT HARDWARE, COMPLYING WITH ANSI/MSS SP-69.
3. ALL EXPOSED PIPING AND SUPPORT ASSEMBLIES SHALL BE COATED PER MANUFACTURER'S RECOMMENDATIONS.
4. ALL EXPOSED AIR PIPING SHALL BE FLANGED CONNECTION
5. BLOWER MAKE/MODEL: GARDNER DENVER 624 "HELIFLOW" SERIES BY PARKSON CORPORATION OR EQUAL

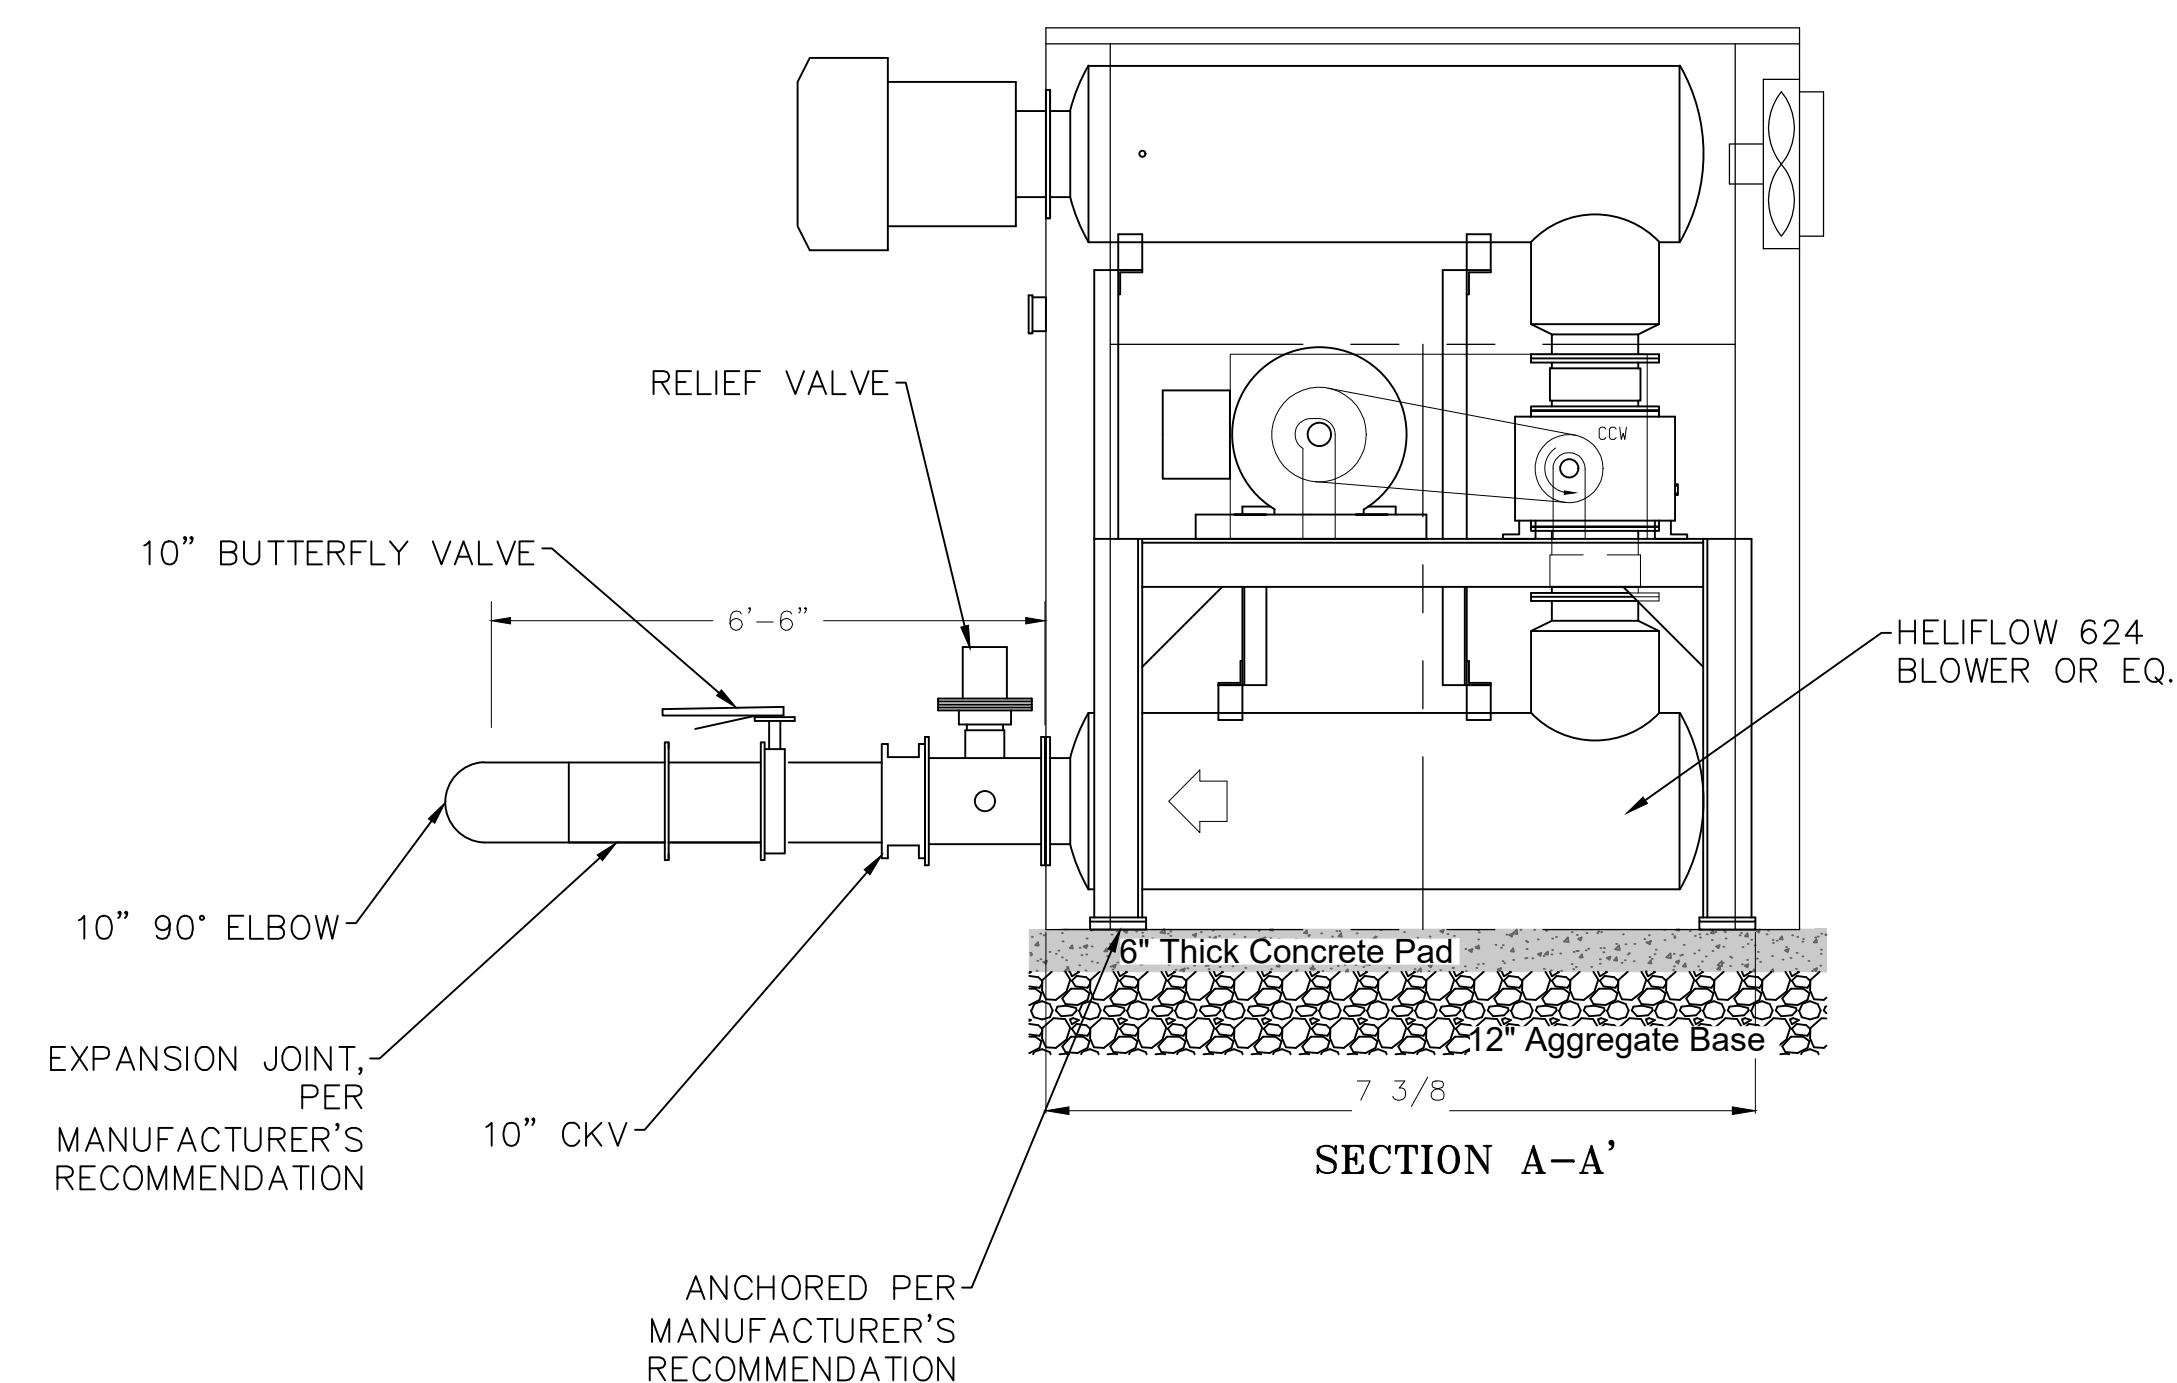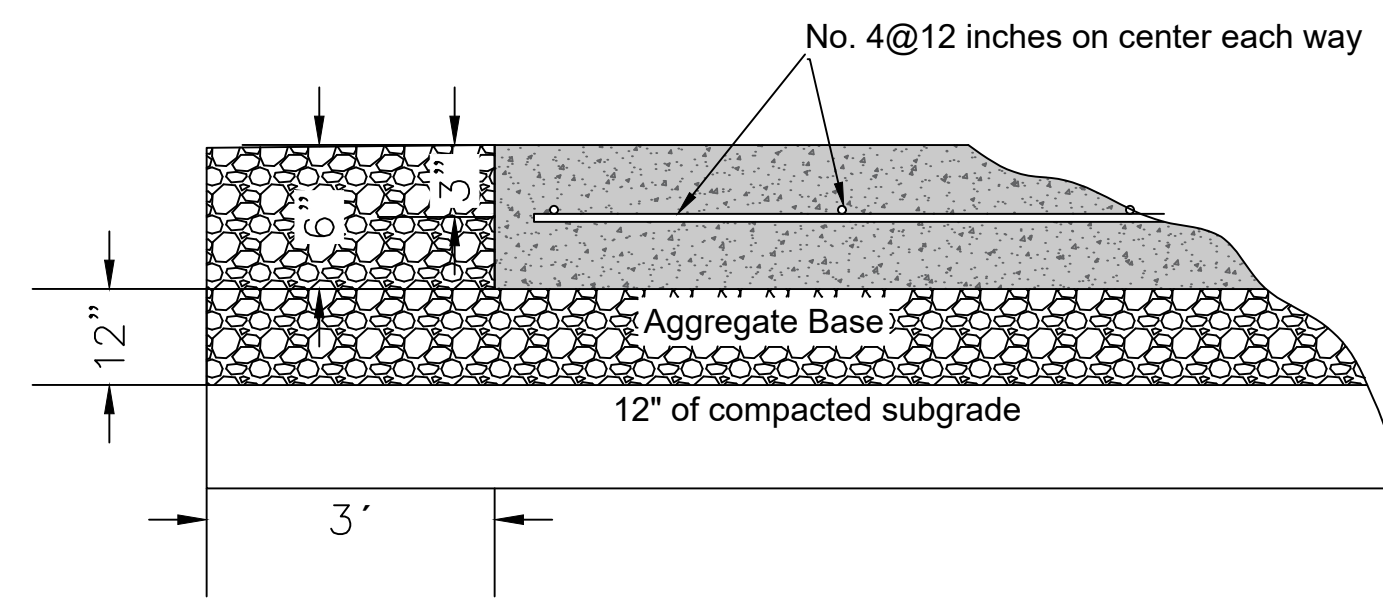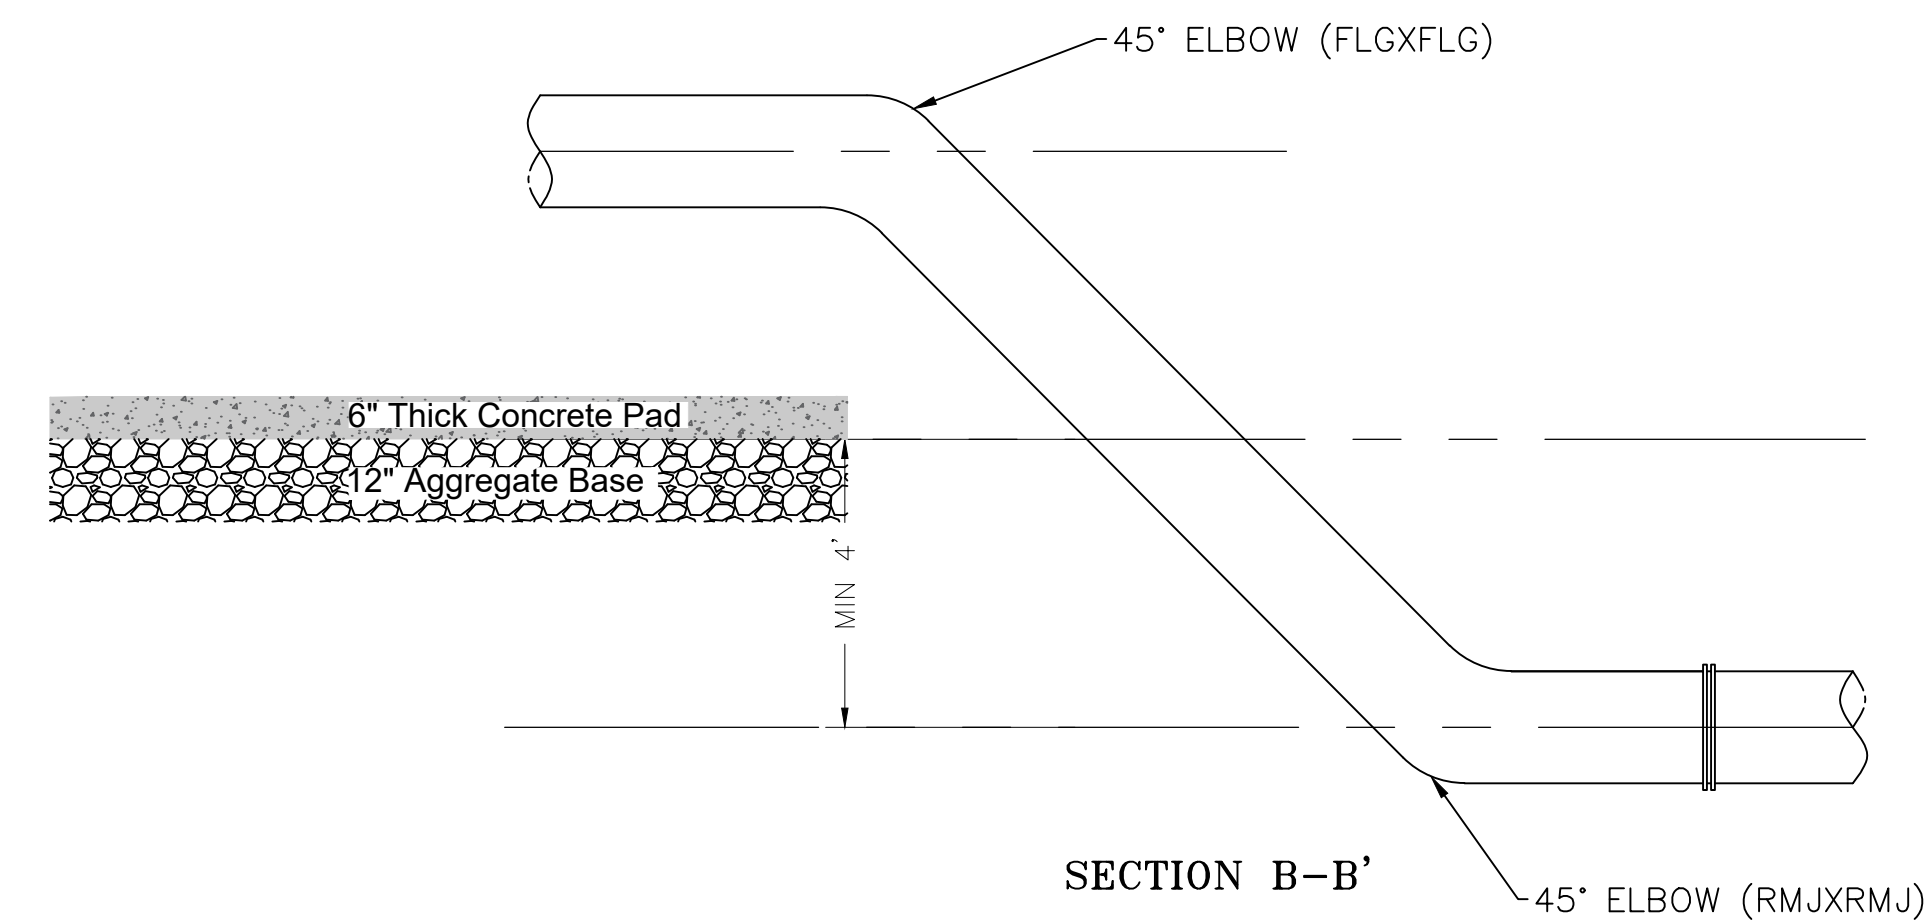

4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

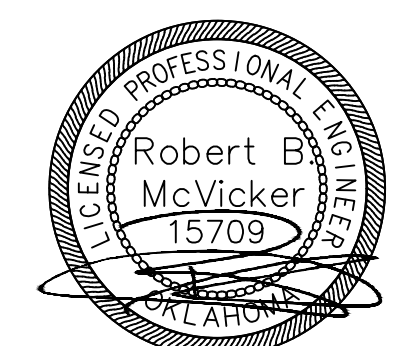

06/26/2023

**FINAL**

PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED


DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
**BLOWER SYSTEM**


SHEET NUMBER:	REV. #
<b>C-304</b>	
SHEET 10 OF 38 SHEETS	




P:\consulting\projects\22\22-517-00010.NTUA HPP Tuba City WWF\CAD\9.C-302\_BAFFLE CURTAIN DETAILS.dwg

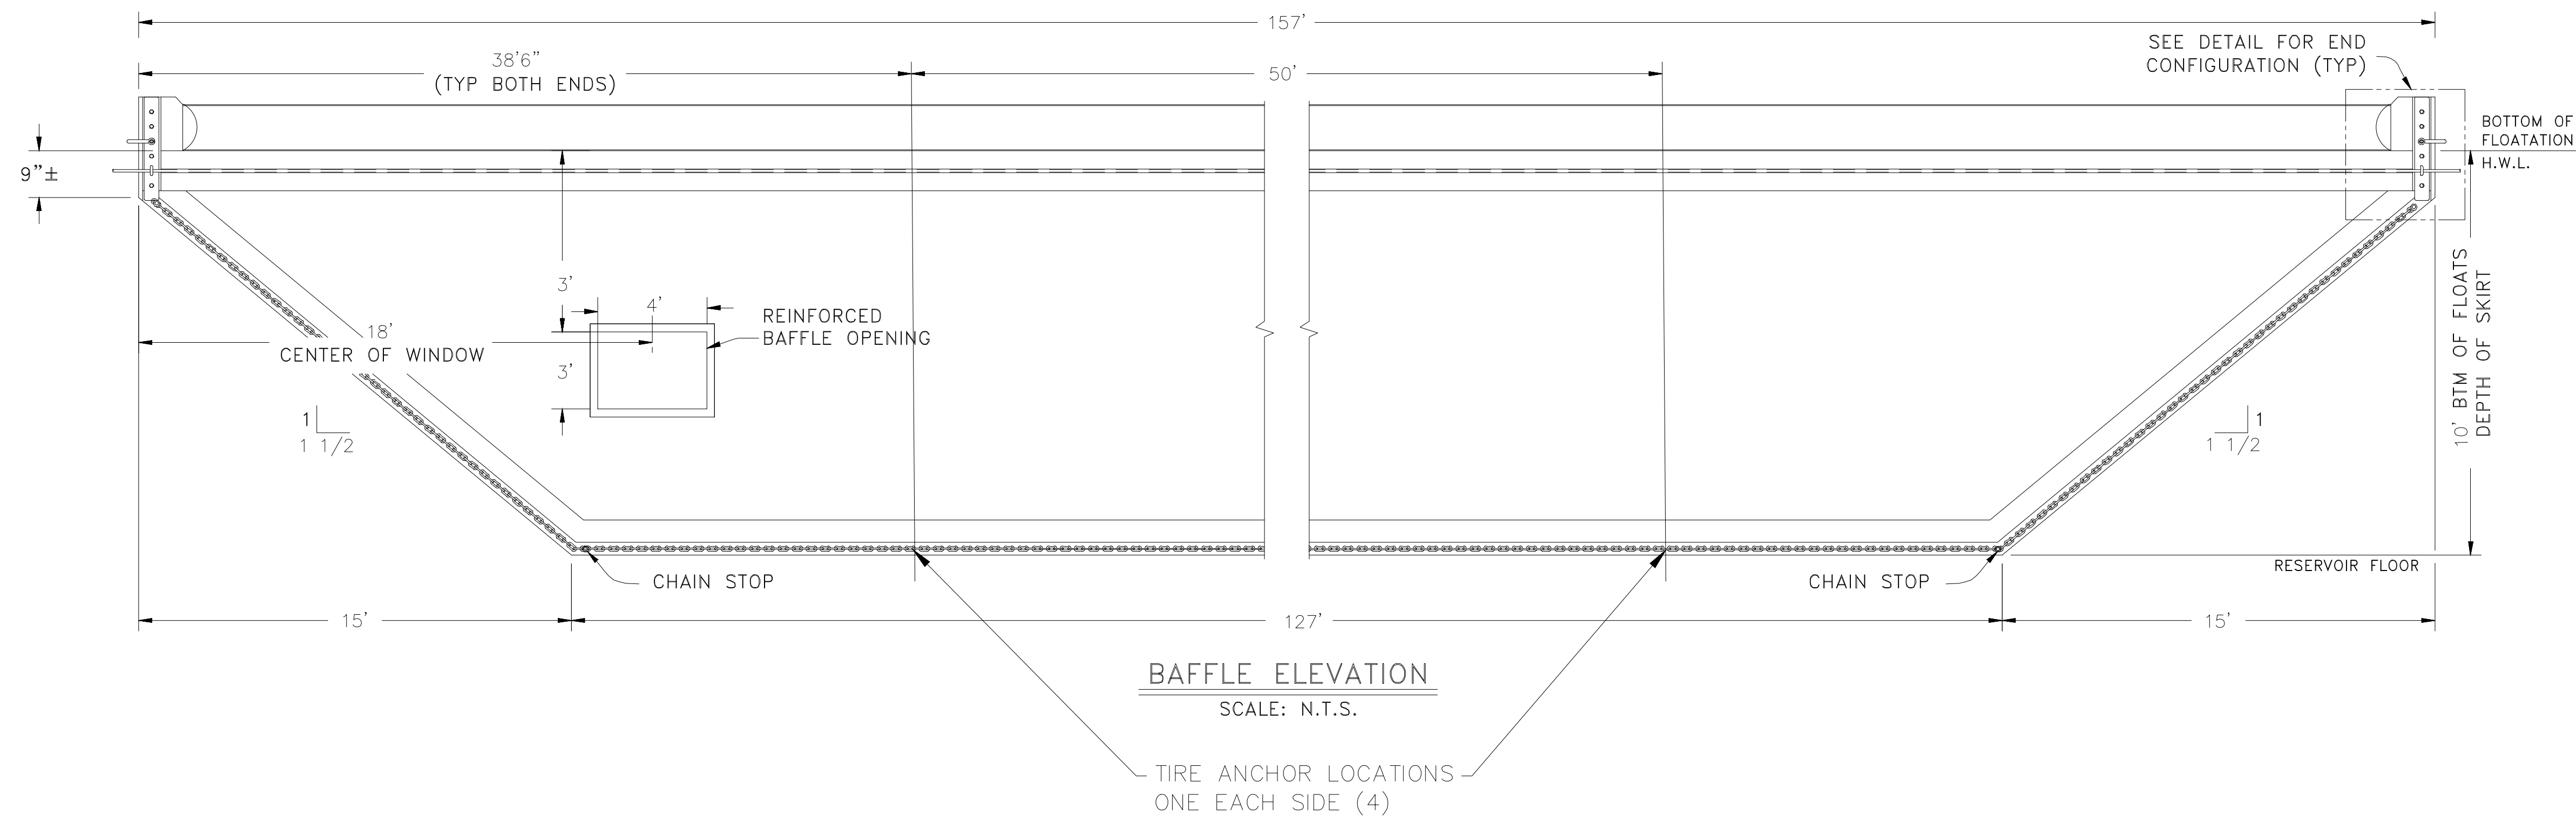


1 BAFFLE CURTAIN DETAIL PROFILE  
NOT TO SCALE

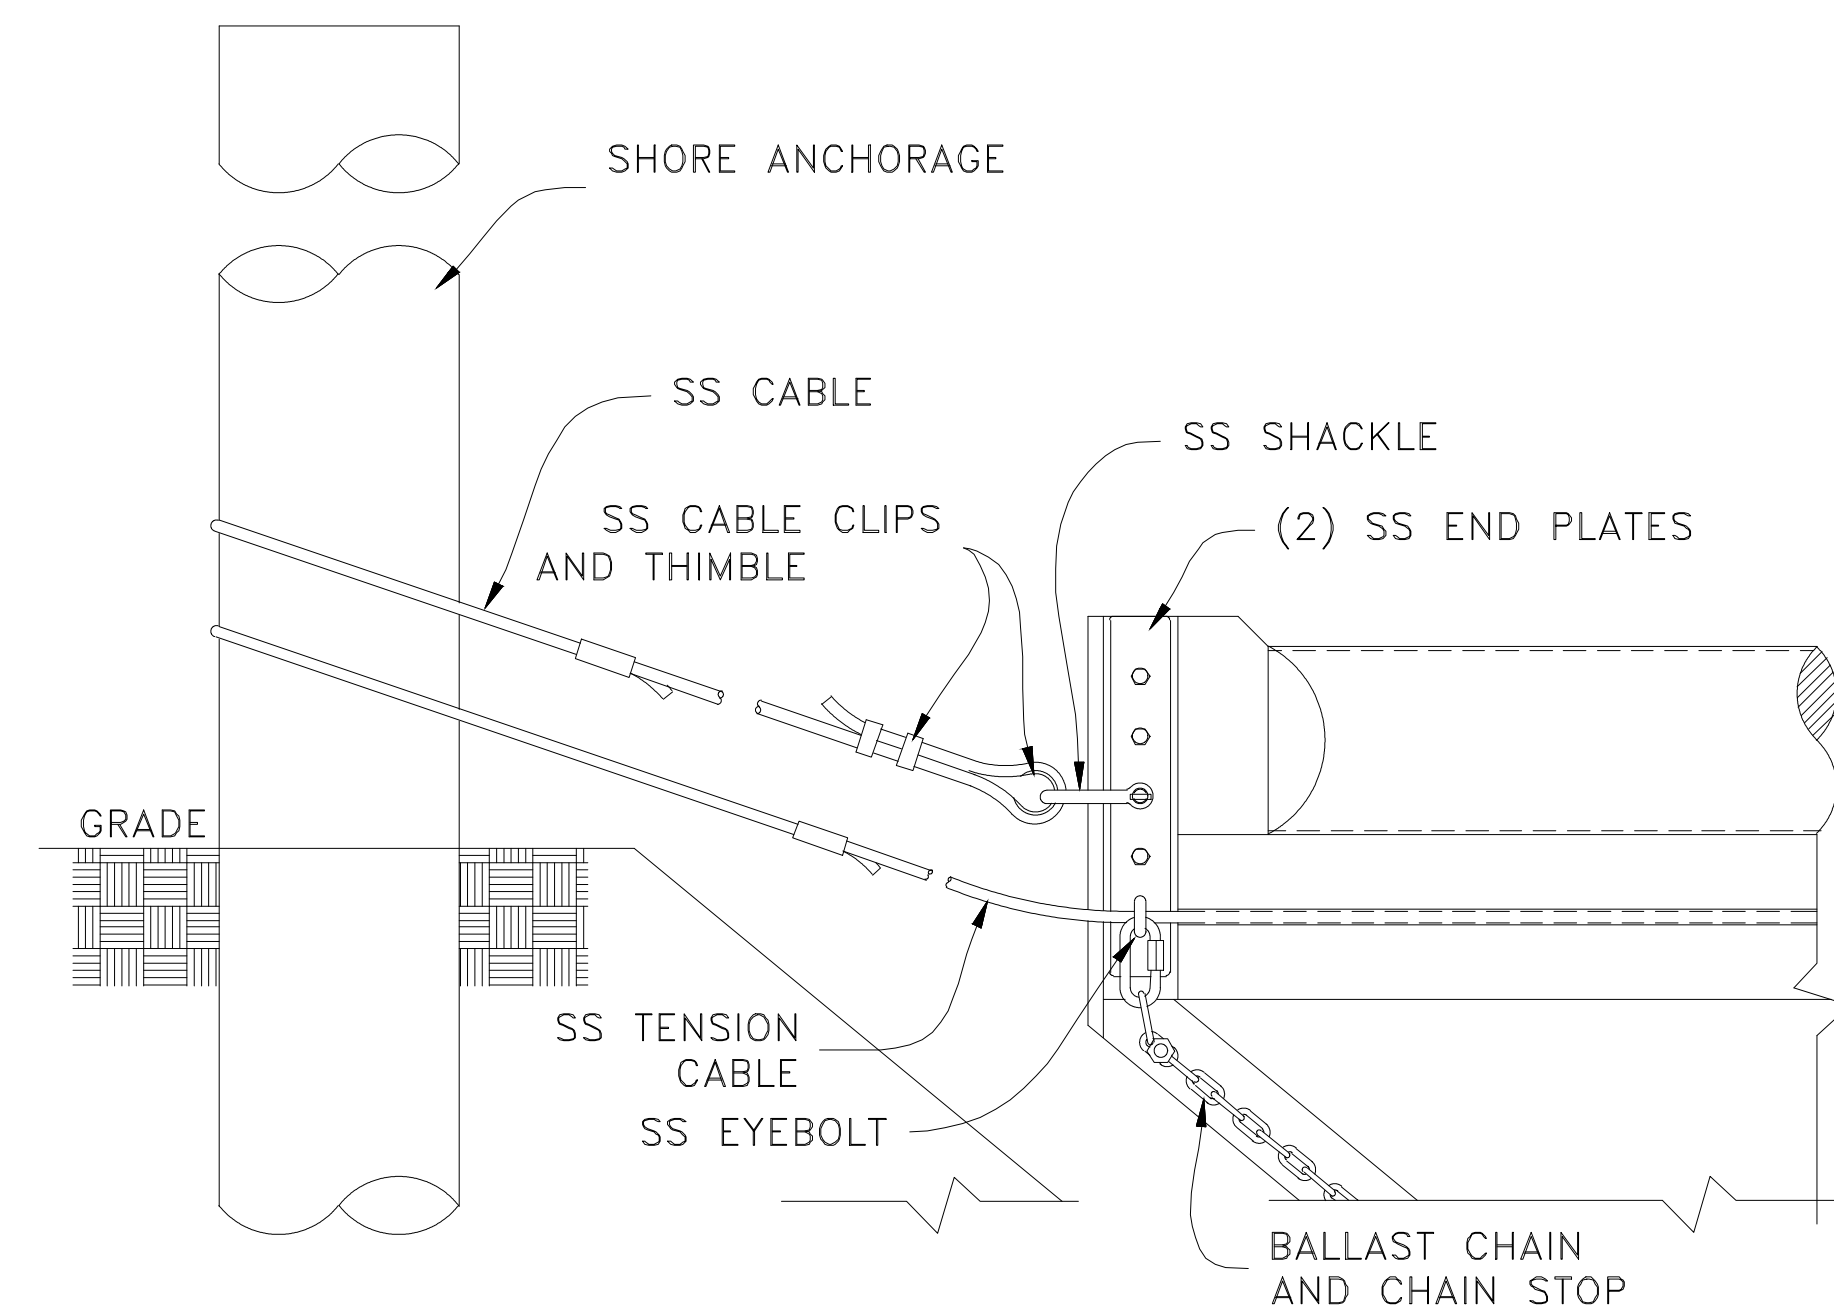

2 END CONNECTION DETAIL  
NOT TO SCALE

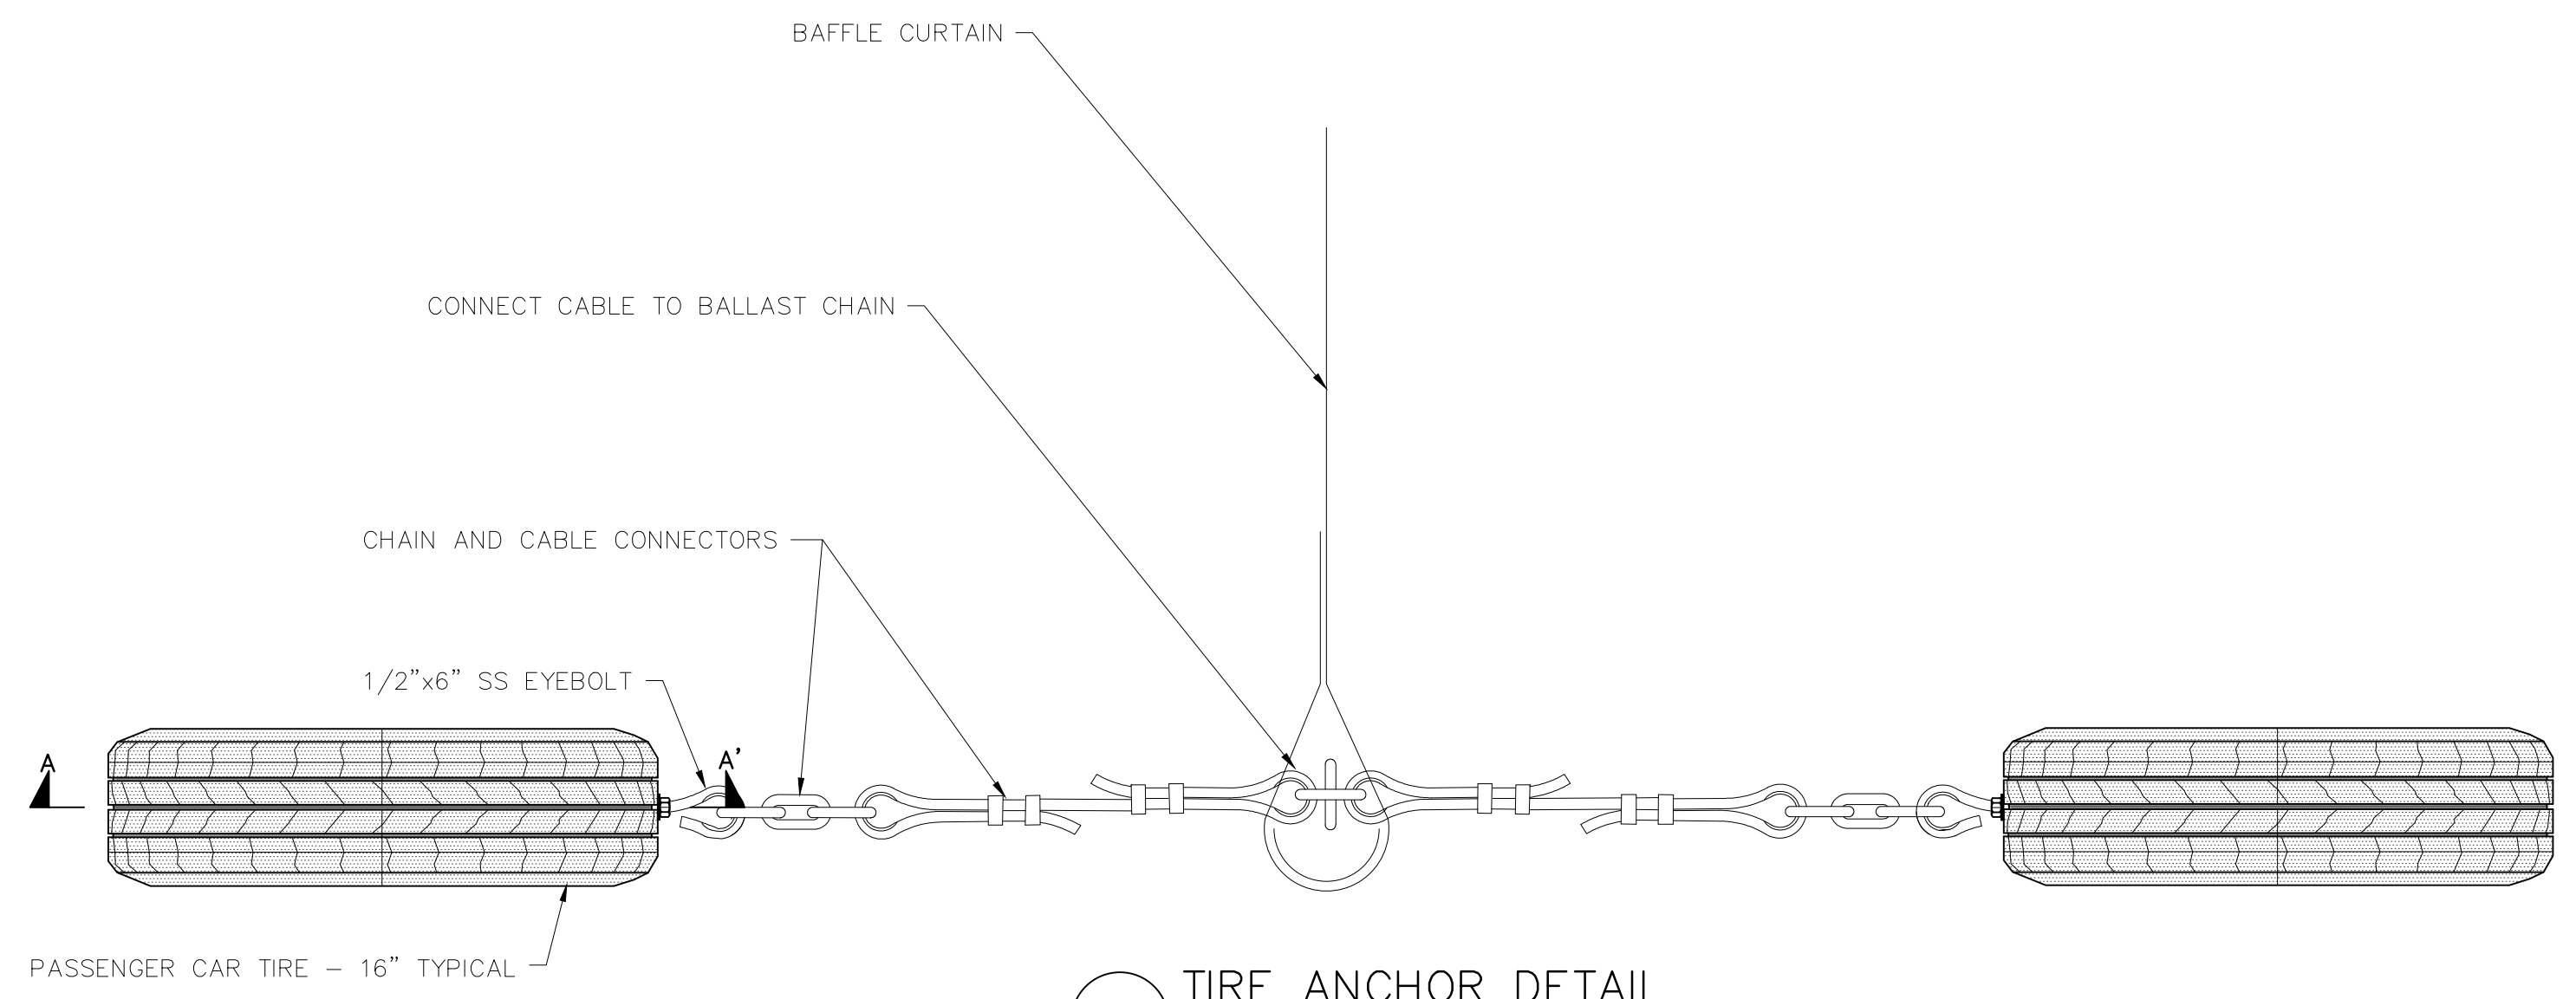


3 TIRE ANCHOR DETAIL  
NOT TO SCALE

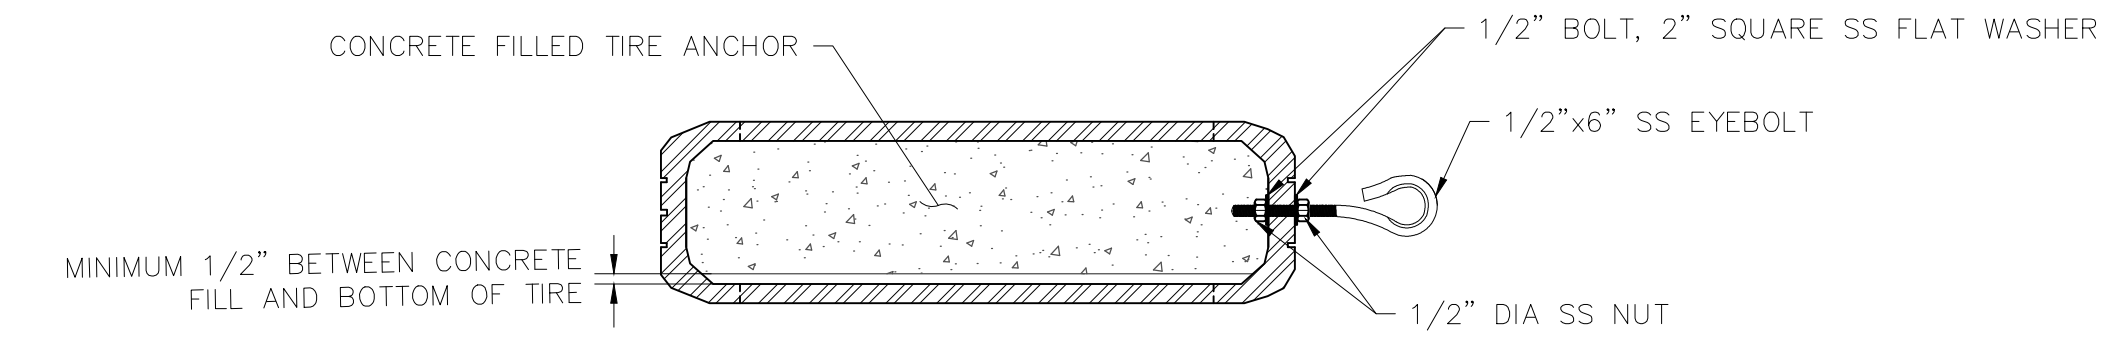

SECTION A-A'  
NOT TO SCALE



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

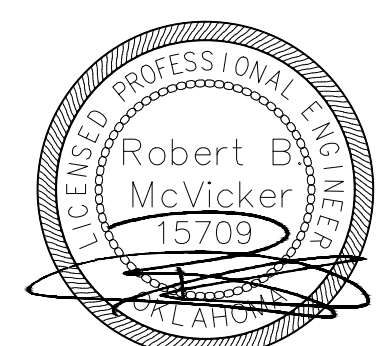

06/26/2023

**FINAL**

PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED


DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
**BAFFLE CURTAIN  
DETAILS**

SHEET NUMBER:	REV. #
<b>C-401</b>	
SHEET 11 OF 38 SHEETS	




P:\consulting\projects\22-517-00010.NTUA HPP Tuba City WWF\CAD\7 and 8.C-300 and 301-B\_DISCHARGE STRUCTURE DETAILS.dwg

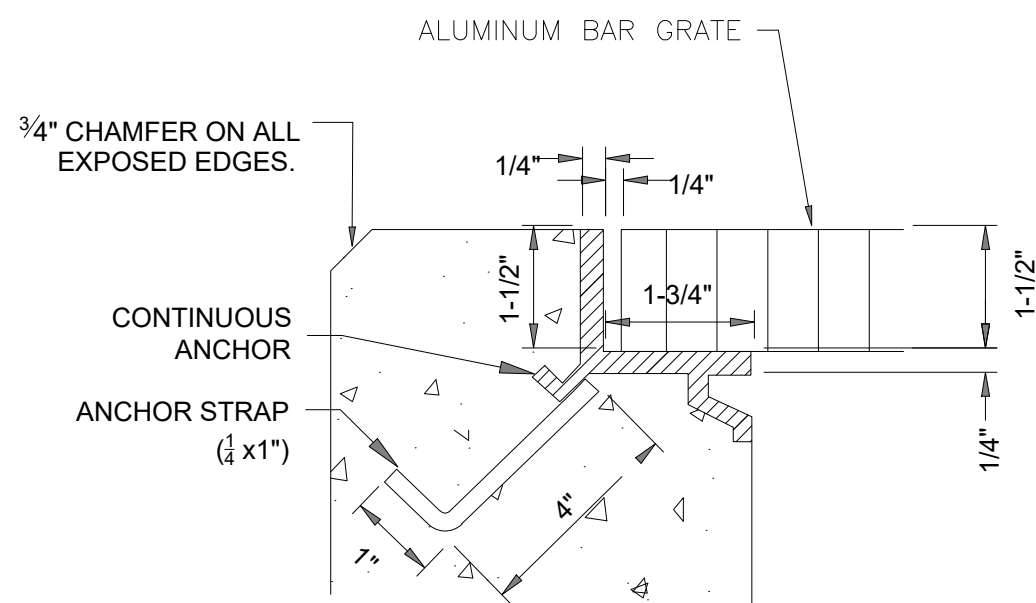

NOTES:

1. ALL NEW STRUCTURES WITH GRATING SHALL USED EMBEDDED GRATING FRAMES.
2. FRAMES SHALL HAVE MITRED CORNERS AND WELDED JOINTS AND SHALL BE SIZED TO MATCH GRATING DEPTHS.
3. VERTICAL AND HORIZONTAL LEGS OF THE FRAME SHAPE SHALL HAVE 1/4 -INCH WALL THICKNESS. FRAME SHALL BE DESIGNED TO PROVIDE CONTINUOUS EXTRUDED ANCHOR.
4. SURFACES COMING INTO CONTACT WITH CONCRETE SHALL BE PAINTED WITH ONE COAT OF BITUMINOUS PAINT.


1 TYPICAL GRATE INSET (NEW STRUCTURES)  
NOT TO SCALE

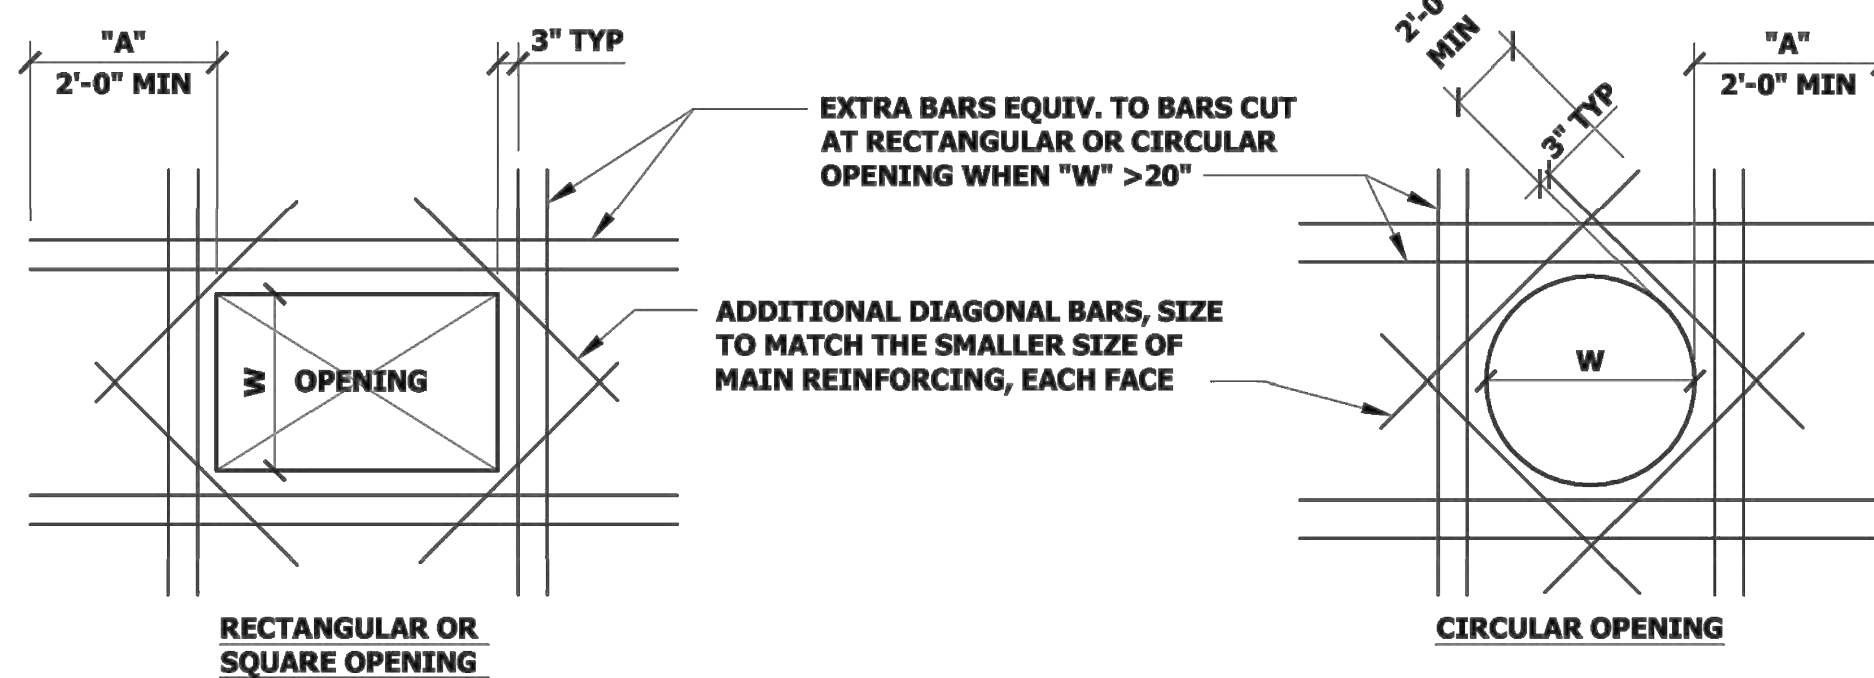


NOTES:

1. DISCONTINUE TYPICAL REINFORCING AT OPENING.
2. PLACE ADDITIONAL BARS IN SAME ORIENTATION AND POSITION AS BARS CUT BY OPENING. PROVIDE ONE SET OF BARS FOR EACH LAYER OF REINFORCING CUT.
3. "A" = TOP BAR EMBEDMENT LENGTH (24" MINIMUM). PROVIDE STANDARD HOOK IF FULL EMBEDMENT LENGTH IS NOT POSSIBLE.
4. REINFORCING STEEL IS TO BE CARRIED ACROSS ALL CONSTRUCTION JOINTS.
5. SEE MECHANICAL, ELECTRICAL, PLUMBING AND ARCHITECTURAL DRAWINGS FOR SLAB AND WALL OPENINGS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ADDITIONAL REINFORCING MAY BE OMITTED ONLY WHERE OPENING IS FRAMED BY BEAMS OR WALLS.
7. ADDITIONAL REINFORCING NOT REQUIRED WHEN SPECIFIED REINFORCING IS NOT CUT.


2 CONCRETE PIPE PENETRATION (OPENINGS 12" TO 48")  
NOT TO SCALE

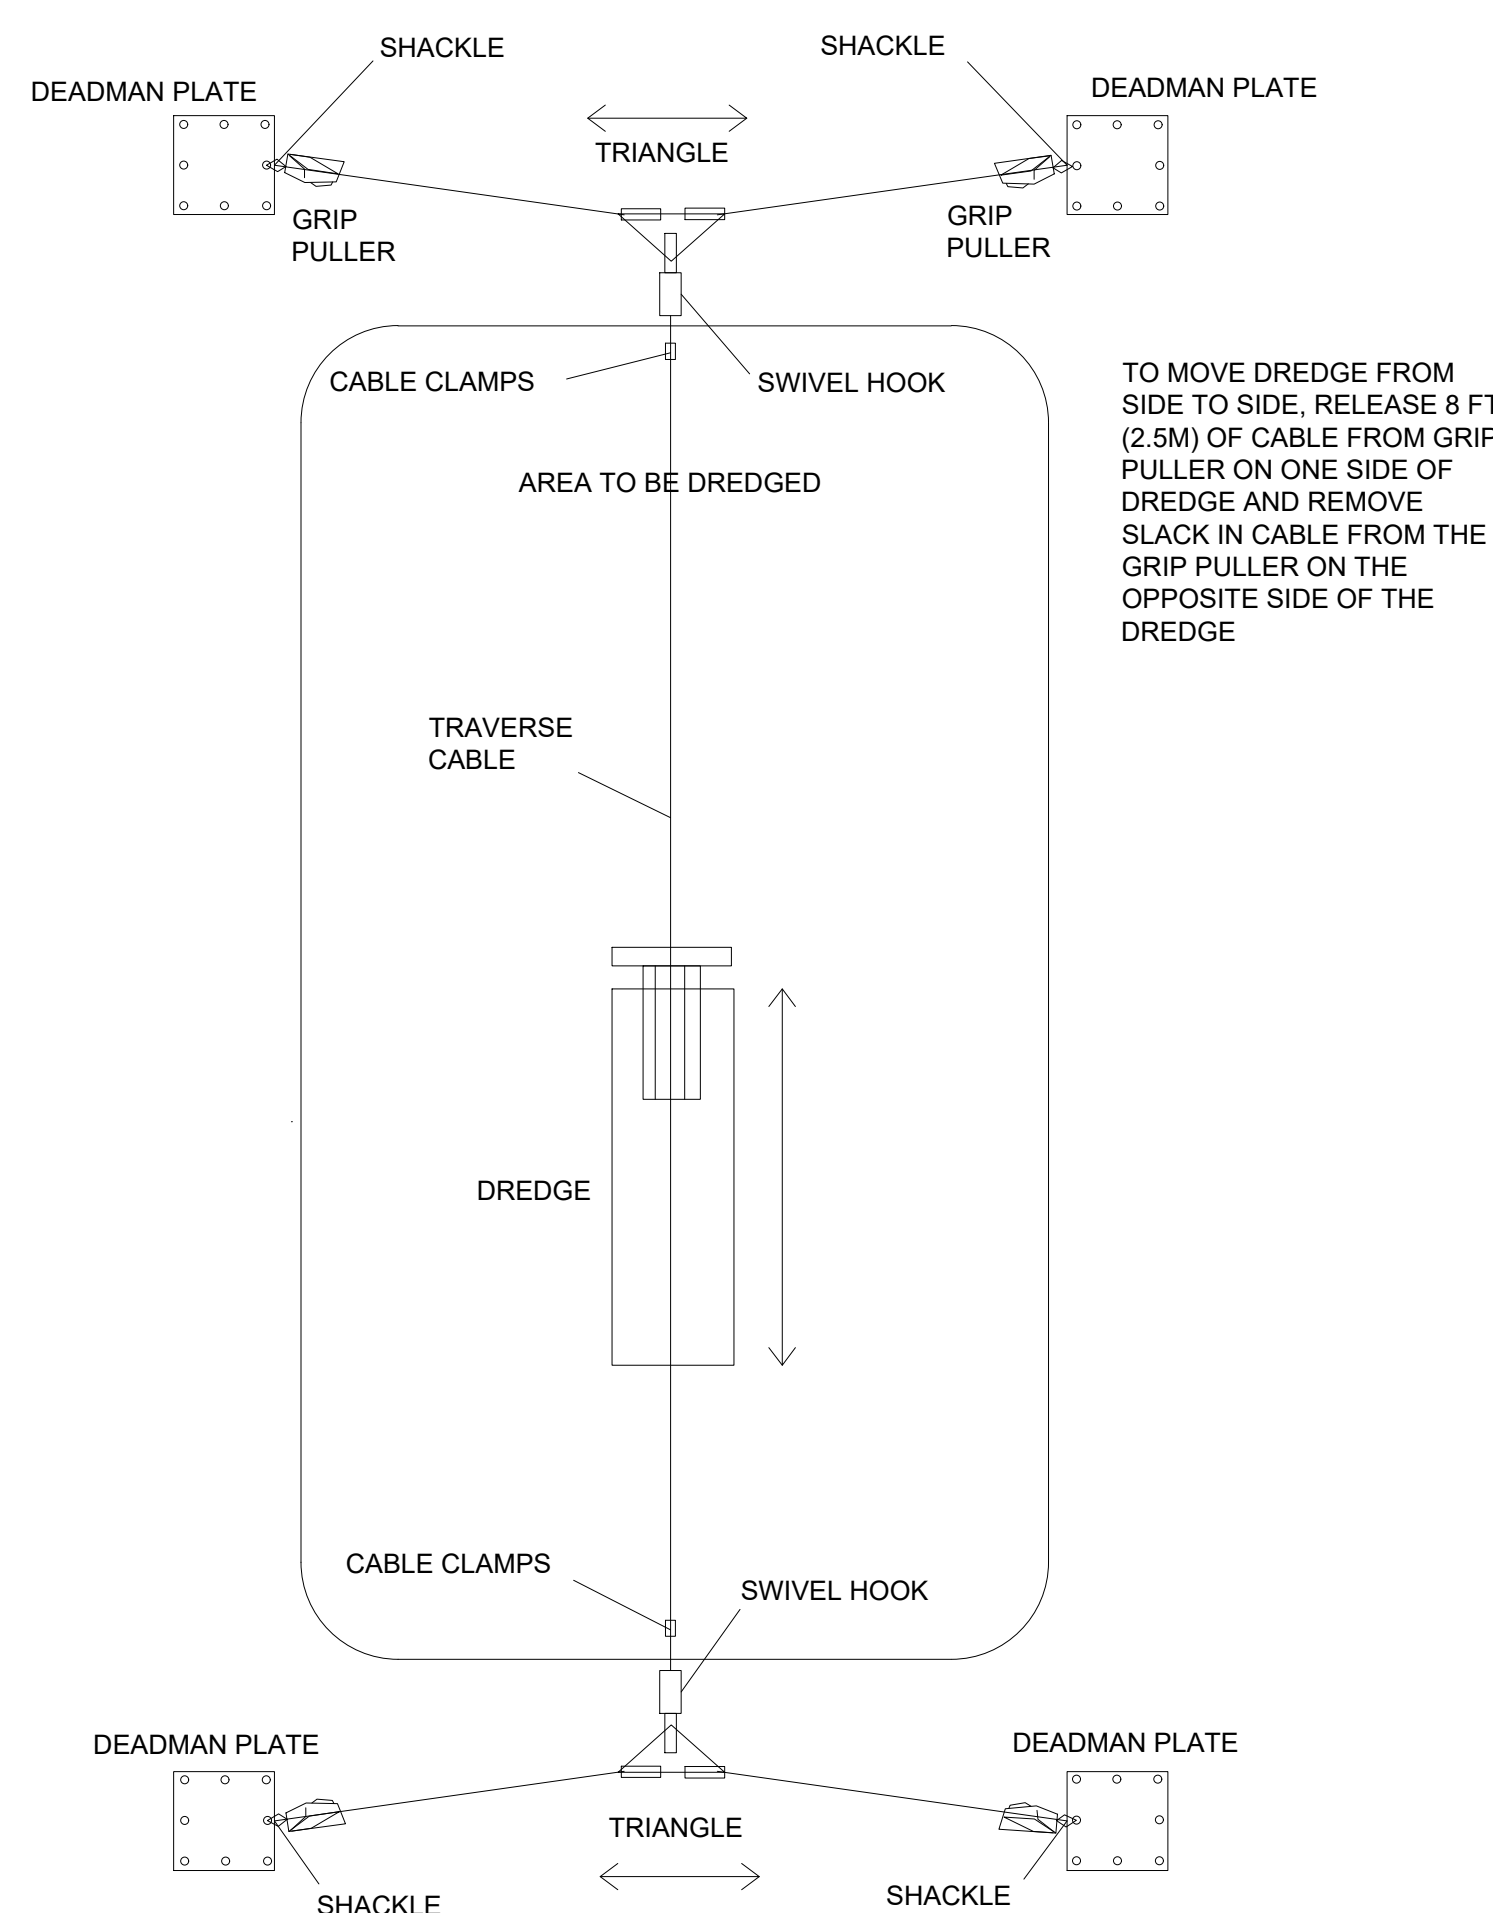

3 CABLE HARNESS DIAGRAM  
NOT TO SCALE

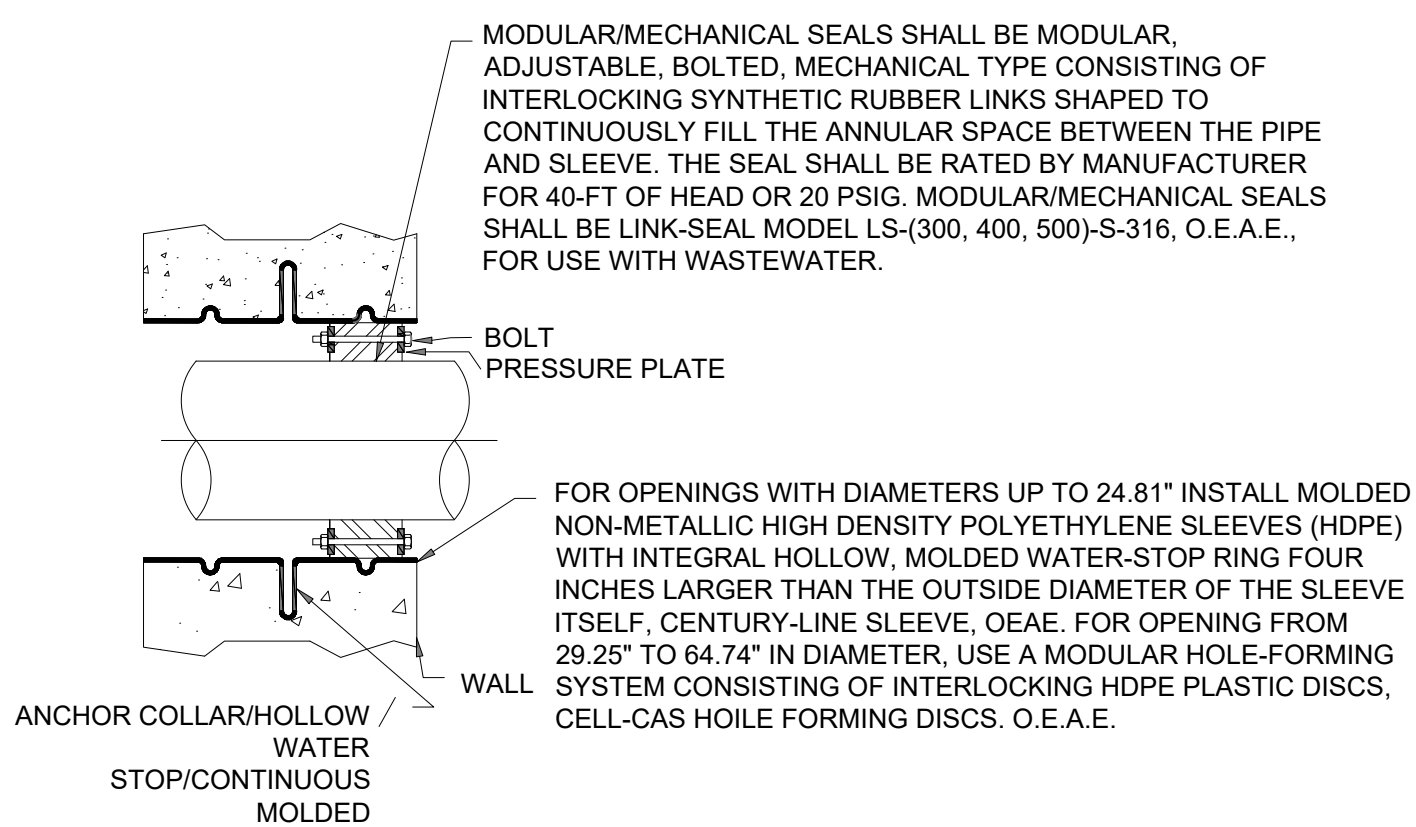

4 PIPE PENETRATION NEW WALLS OR FLOORS  
NOT TO SCALE

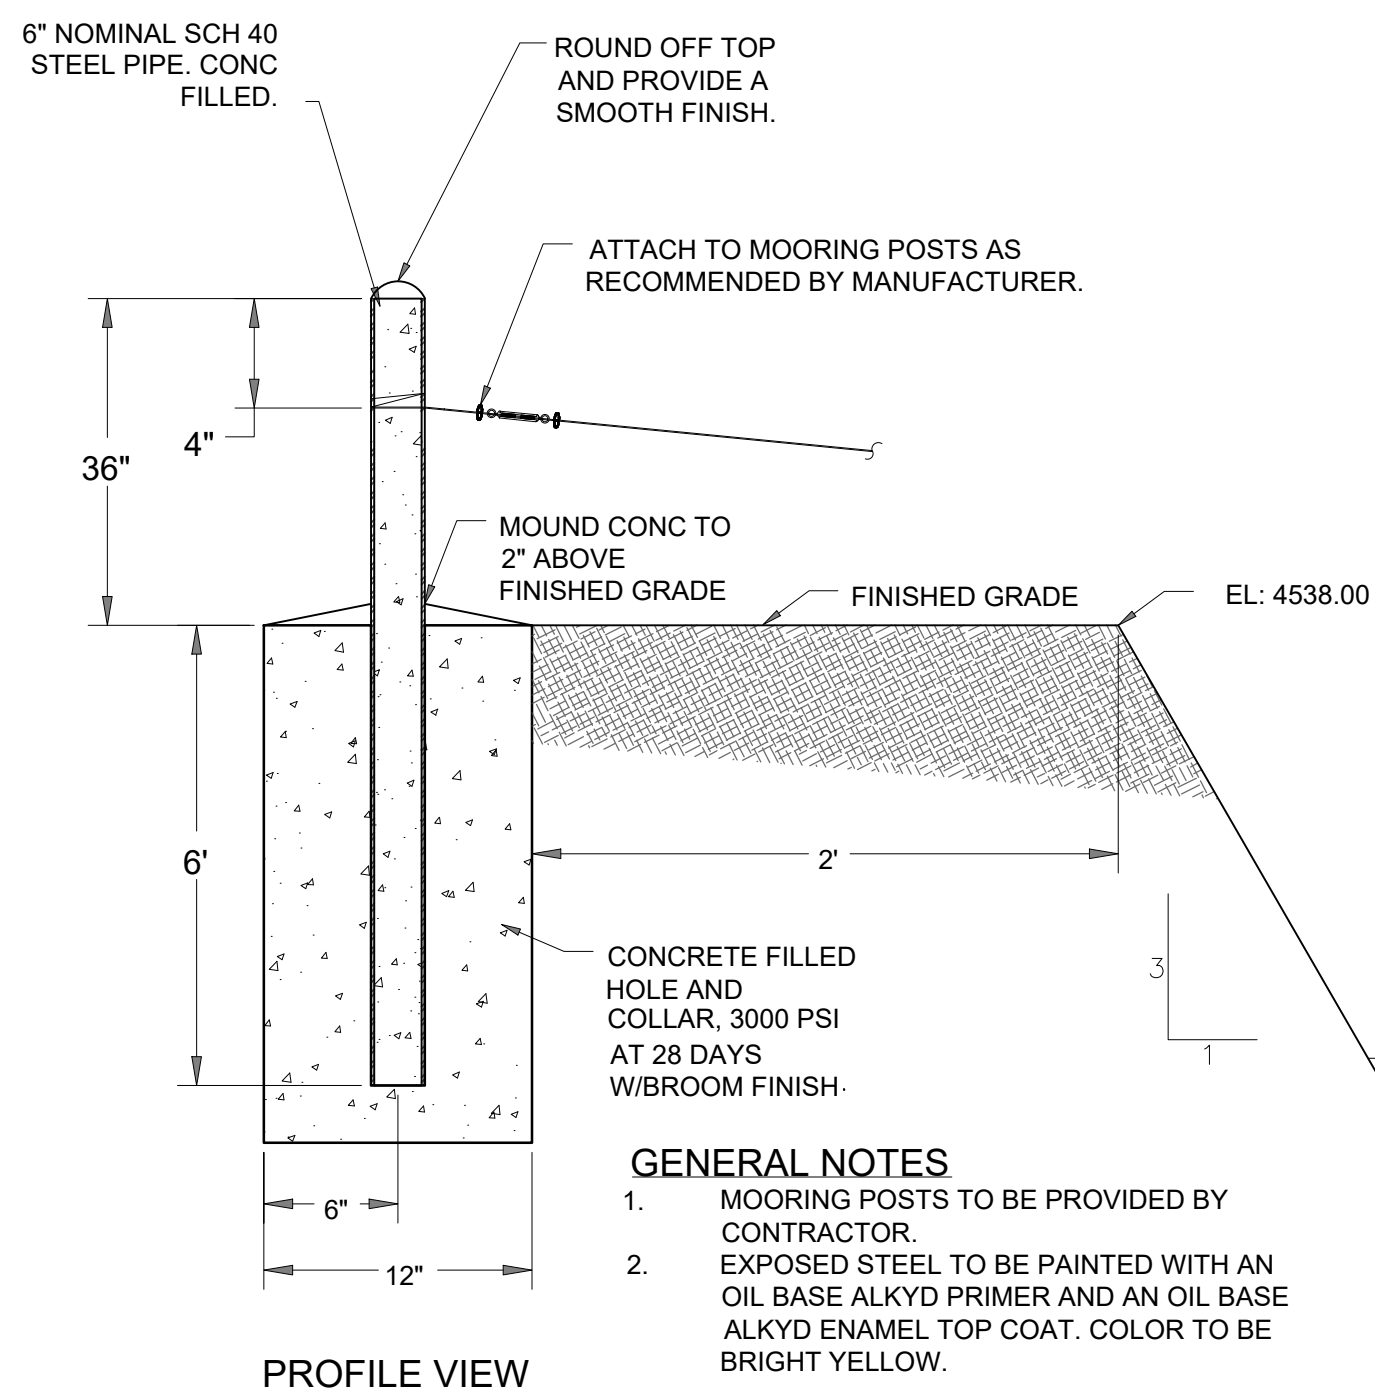

GENERAL NOTES

1. MOORING POSTS TO BE PROVIDED BY CONTRACTOR.
2. EXPOSED STEEL TO BE PAINTED WITH AN OIL BASE ALKYD PRIMER AND AN OIL BASE ALKYD ENAMEL TOP COAT. COLOR TO BE BRIGHT YELLOW.


5 ANCHOR POST  
NOT TO SCALE

TABLE 1	
DISTANCE BETWEEN MOORS (ANCHOR POSTS)	
ROW	DISTANCE (FT)
1	85 O.C.
2	85 O.C.

NOTE: DOES NOT INCLUDE ADDITIONAL LENGTHS FOR SLACKING OF CABLING OR FOR ATTACHING TO MOORING POSTS.



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

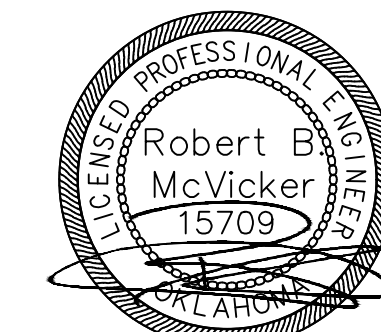

06/26/2023

FINAL

PROJECT:  
TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN



NAVAJO TRIBAL UTILITY  
AUTHORITY  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
  
DETAILS

SHEET NUMBER:	REV. #
C-402	
SHEET 12 OF 38 SHEETS	



P:\consulting\projects\22-517-00010.NTUA HPP Tuba City WWF\CAD\11.C-401\_BARGE COMPONENTS LAYOUT.dwg

Specifications			
	MD-415	MD-615	MD-815
<b>GENERAL</b>			
Length	33' 6" (10.21 m) O.A.		
Height (without A/C)	8' (2.44 m)		
Width	8' 6" (2.59 m) (transport)		
Weight (Approx.)	20,000 lbs (9,100 kg)		
Draft	22" (55.88 cm)		
Fuel Capacity	160 U.S. gallons (606 L)		
<b>ENGINE</b>			
Type	Cummins		
Model	Q58 6.7		
Power	173 BHP (129 kW) @ 2500 RPM		
<b>PUMP</b>			
Type		Hi-chrome cast iron, centrifugal, recessed impeller	
Impeller	18" (45.72 cm)		
Suction	4" (10.16 cm)		
Discharge	4" (10.16 cm)		
Capacity (water @ 68°F)	3.75" (95mm) Sphere - Variable to 1,000 GPM (3,785 L/min) @ 130' (39.6 m) head @ 1400 RPM		
<b>CUTTER ASSEMBLY</b>			
Type	Horizontal with full-width, flow-through suction (Paddle and cutting teeth available)		
Size	8' 6" (2.59 m) wide x 21" (53.34 cm) diameter		
Speed	Variable 0-80 RPM (forward and reverse)		
Torque	56,000 in.-lbs. (6,328 N-m)		
Operating Depth	Variable to 15' (4.57 m) maximum (optional depths available upon request)		
<b>PONTOONS</b>			
Dimensions	Two - 32" (81.28 cm) x 34" (86.36 cm) x 29' 6" (8.99 m)		
Description	10 gauge steel, integral bulkheads and stiffeners, formed for rigidity, core-foam filled		
<b>PROPULSION</b>			
Type	Trebble sheave hydraulic winch		
Transverse Speed	Variable 0-50 ft/min (0-15.2 m/min)		
Cutting Speed	0-15 ft/min (0-4.57 m/min)		
<b>HYDRAULIC SYSTEM</b>			
Pumps	Variable displacement, axial piston		
Motors	Fixed displacement		
Capacity	Total: 80 GPM (302.8 L/min) @ 2200 RPM		
Reservoir	100 U.S. gallons (378.5 L)		
<b>DRIVE</b>			
Description	Hydraulic pump drive, direct from engine		
<b>FILTERS</b>			
Description	Protected hydrostatic loop, high pressure suction & return		
<b>RELIEF SETTINGS</b>			
Centrifugal Pump	4000 psi (276 bar)		
Cutter Head	3000 psi (207 bar)		
Accessories	3000 psi (207 bar)		
Boom	1500 psi (103 bar)		
<b>ELECTRICAL SYSTEM</b>			
Alternator	Output - 100 amp		
Battery	Heavy Duty - 12 volt		
<b>PRIME FINISH</b>			
Lower Structure	Shear Tar Epoxy Paint		
Upper Structure	Blue and White Epoxy Paint		



www.vmi-dredges.com

VMI, Inc.  
1125 N. Maitlen Drive  
Cushing, Oklahoma 74023

Toll Free: (800) 762-2257  
Phone: (918) 225-7000  
info@vmi-dredges.com




# VMI, INC.




## HORIZONTAL DREDGES



MD-415 MD-615 MD-815

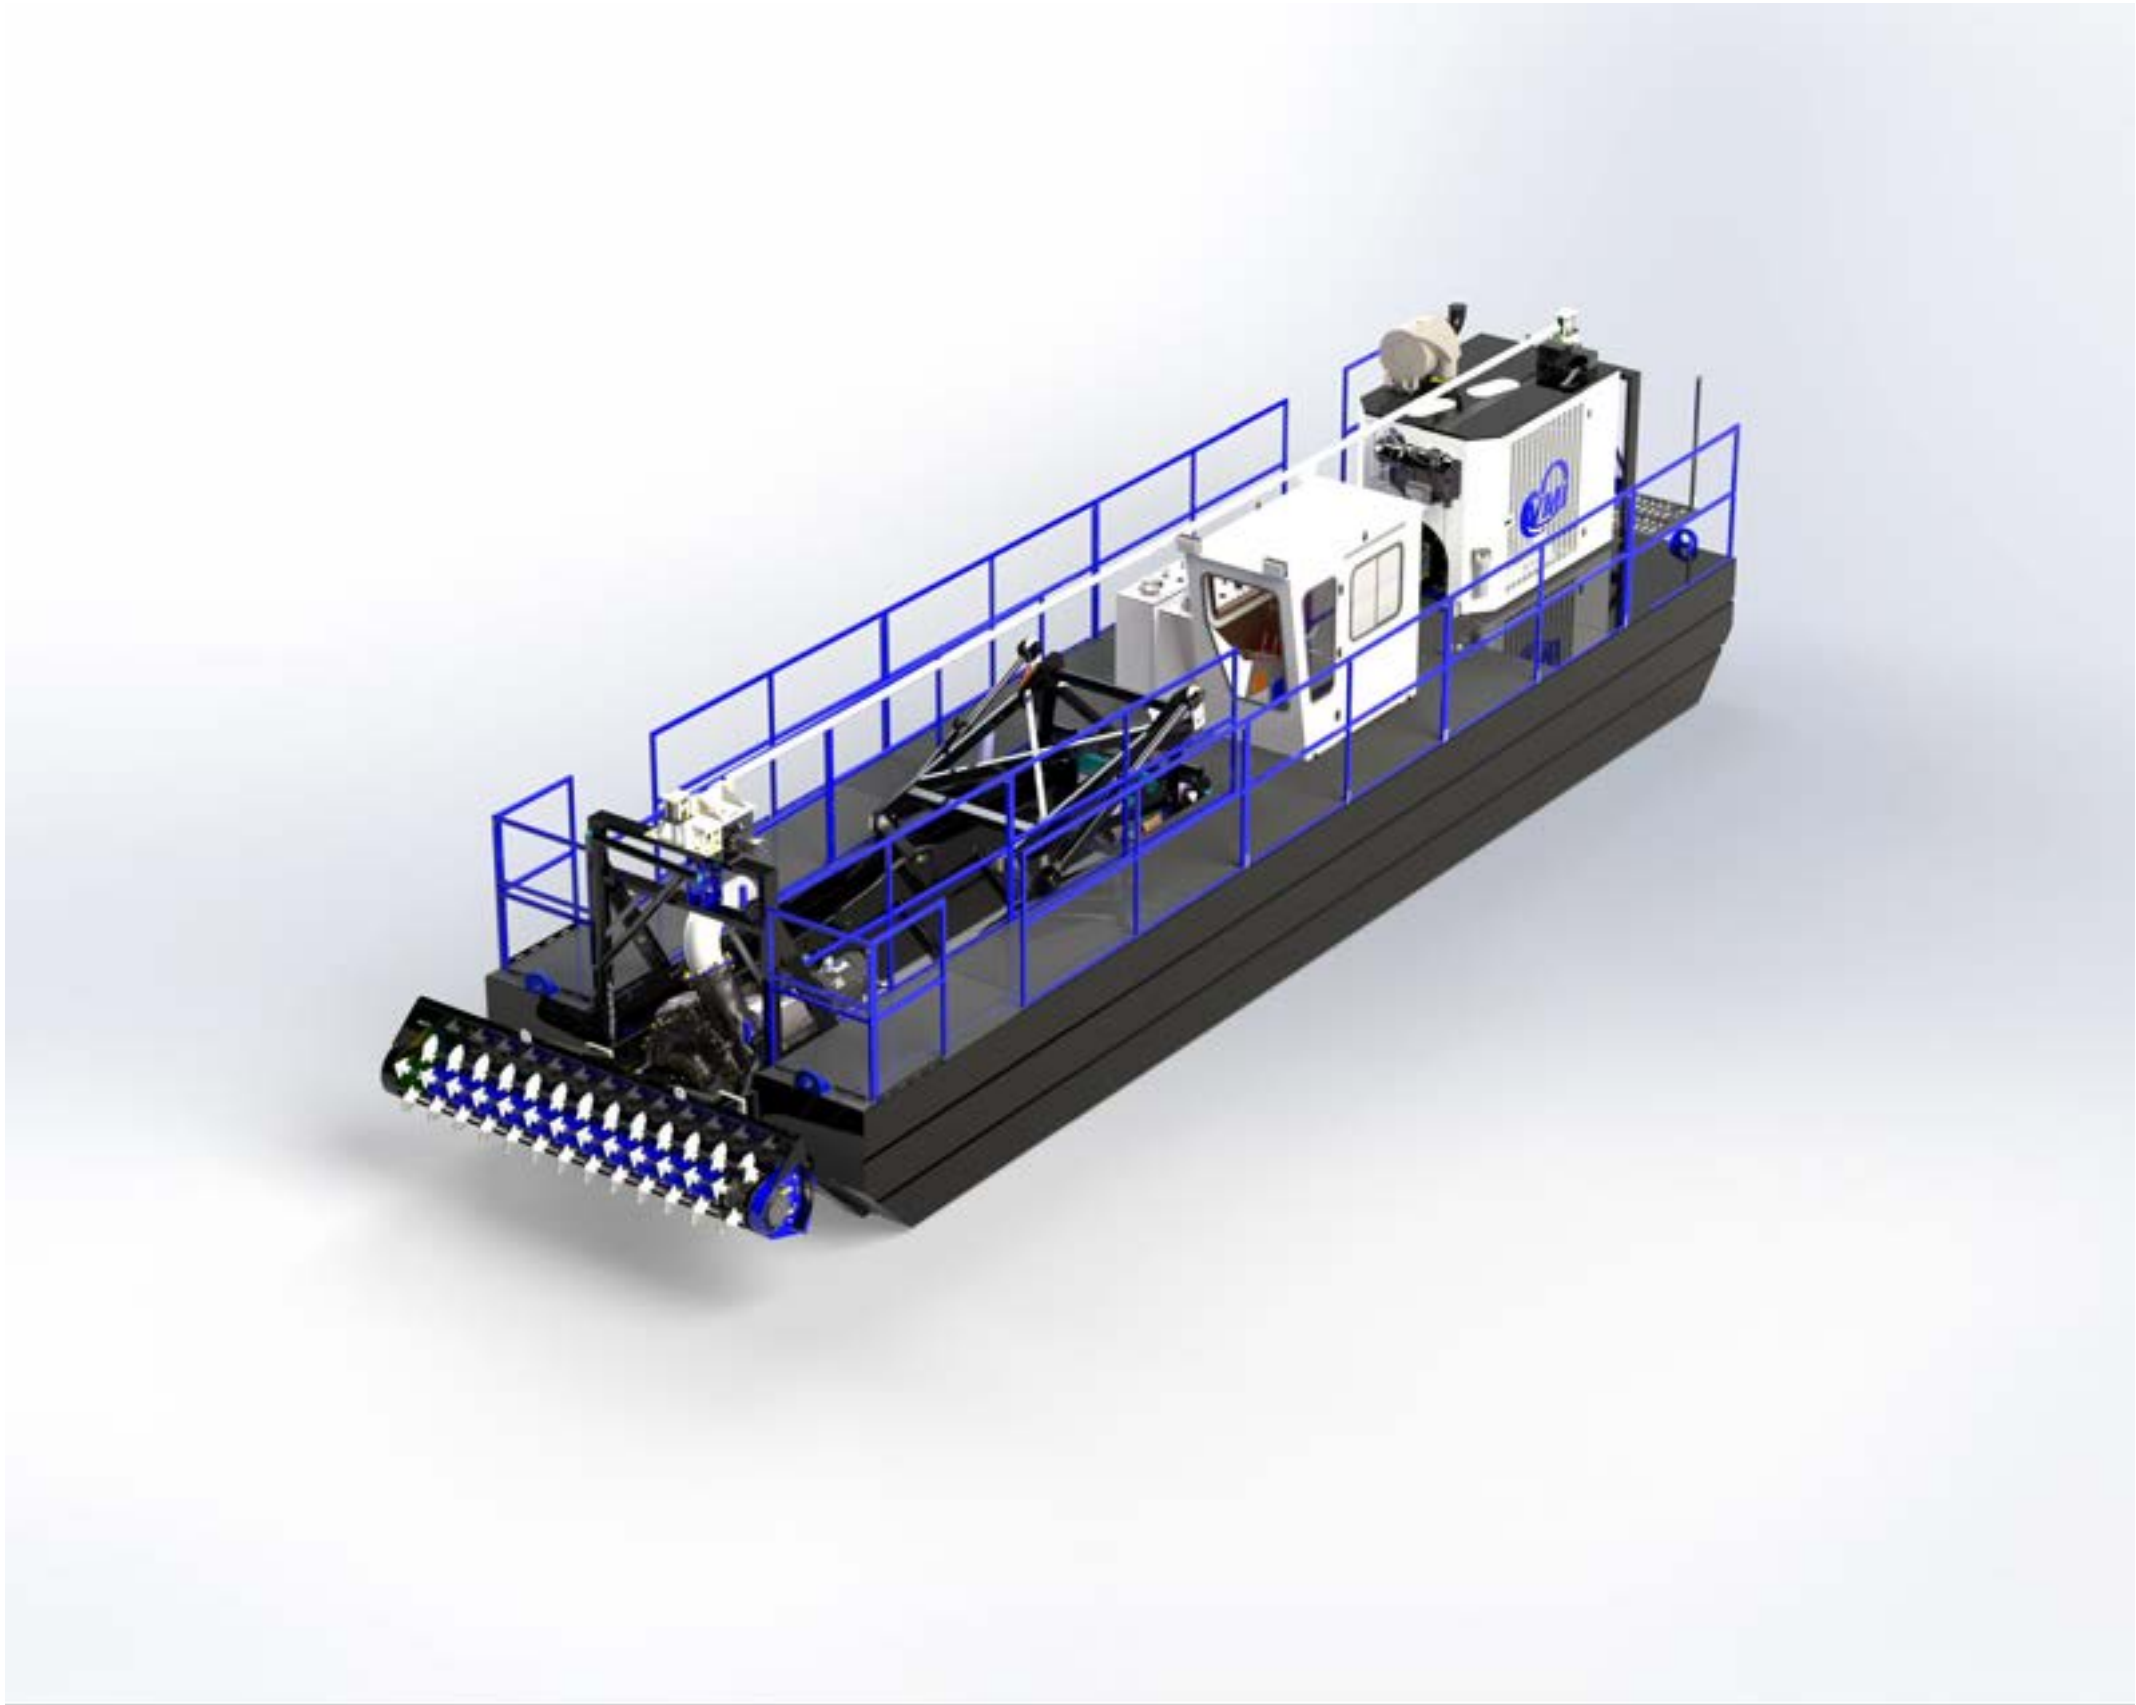

4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

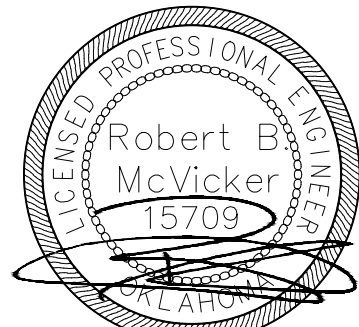

06/26/2023

FINAL

PROJECT:  
TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN



NAVAJO TRIBAL UTILITY  
AUTHORITY  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010


REVISIONS			
NO.	DATE	BY	APPROVED

DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:  
FLOATING DREDGE  
COMPONENTS  
LAYOUT

SHEET NUMBER:	REV. #
C-403	
SHEET 13 OF 38 SHEETS	



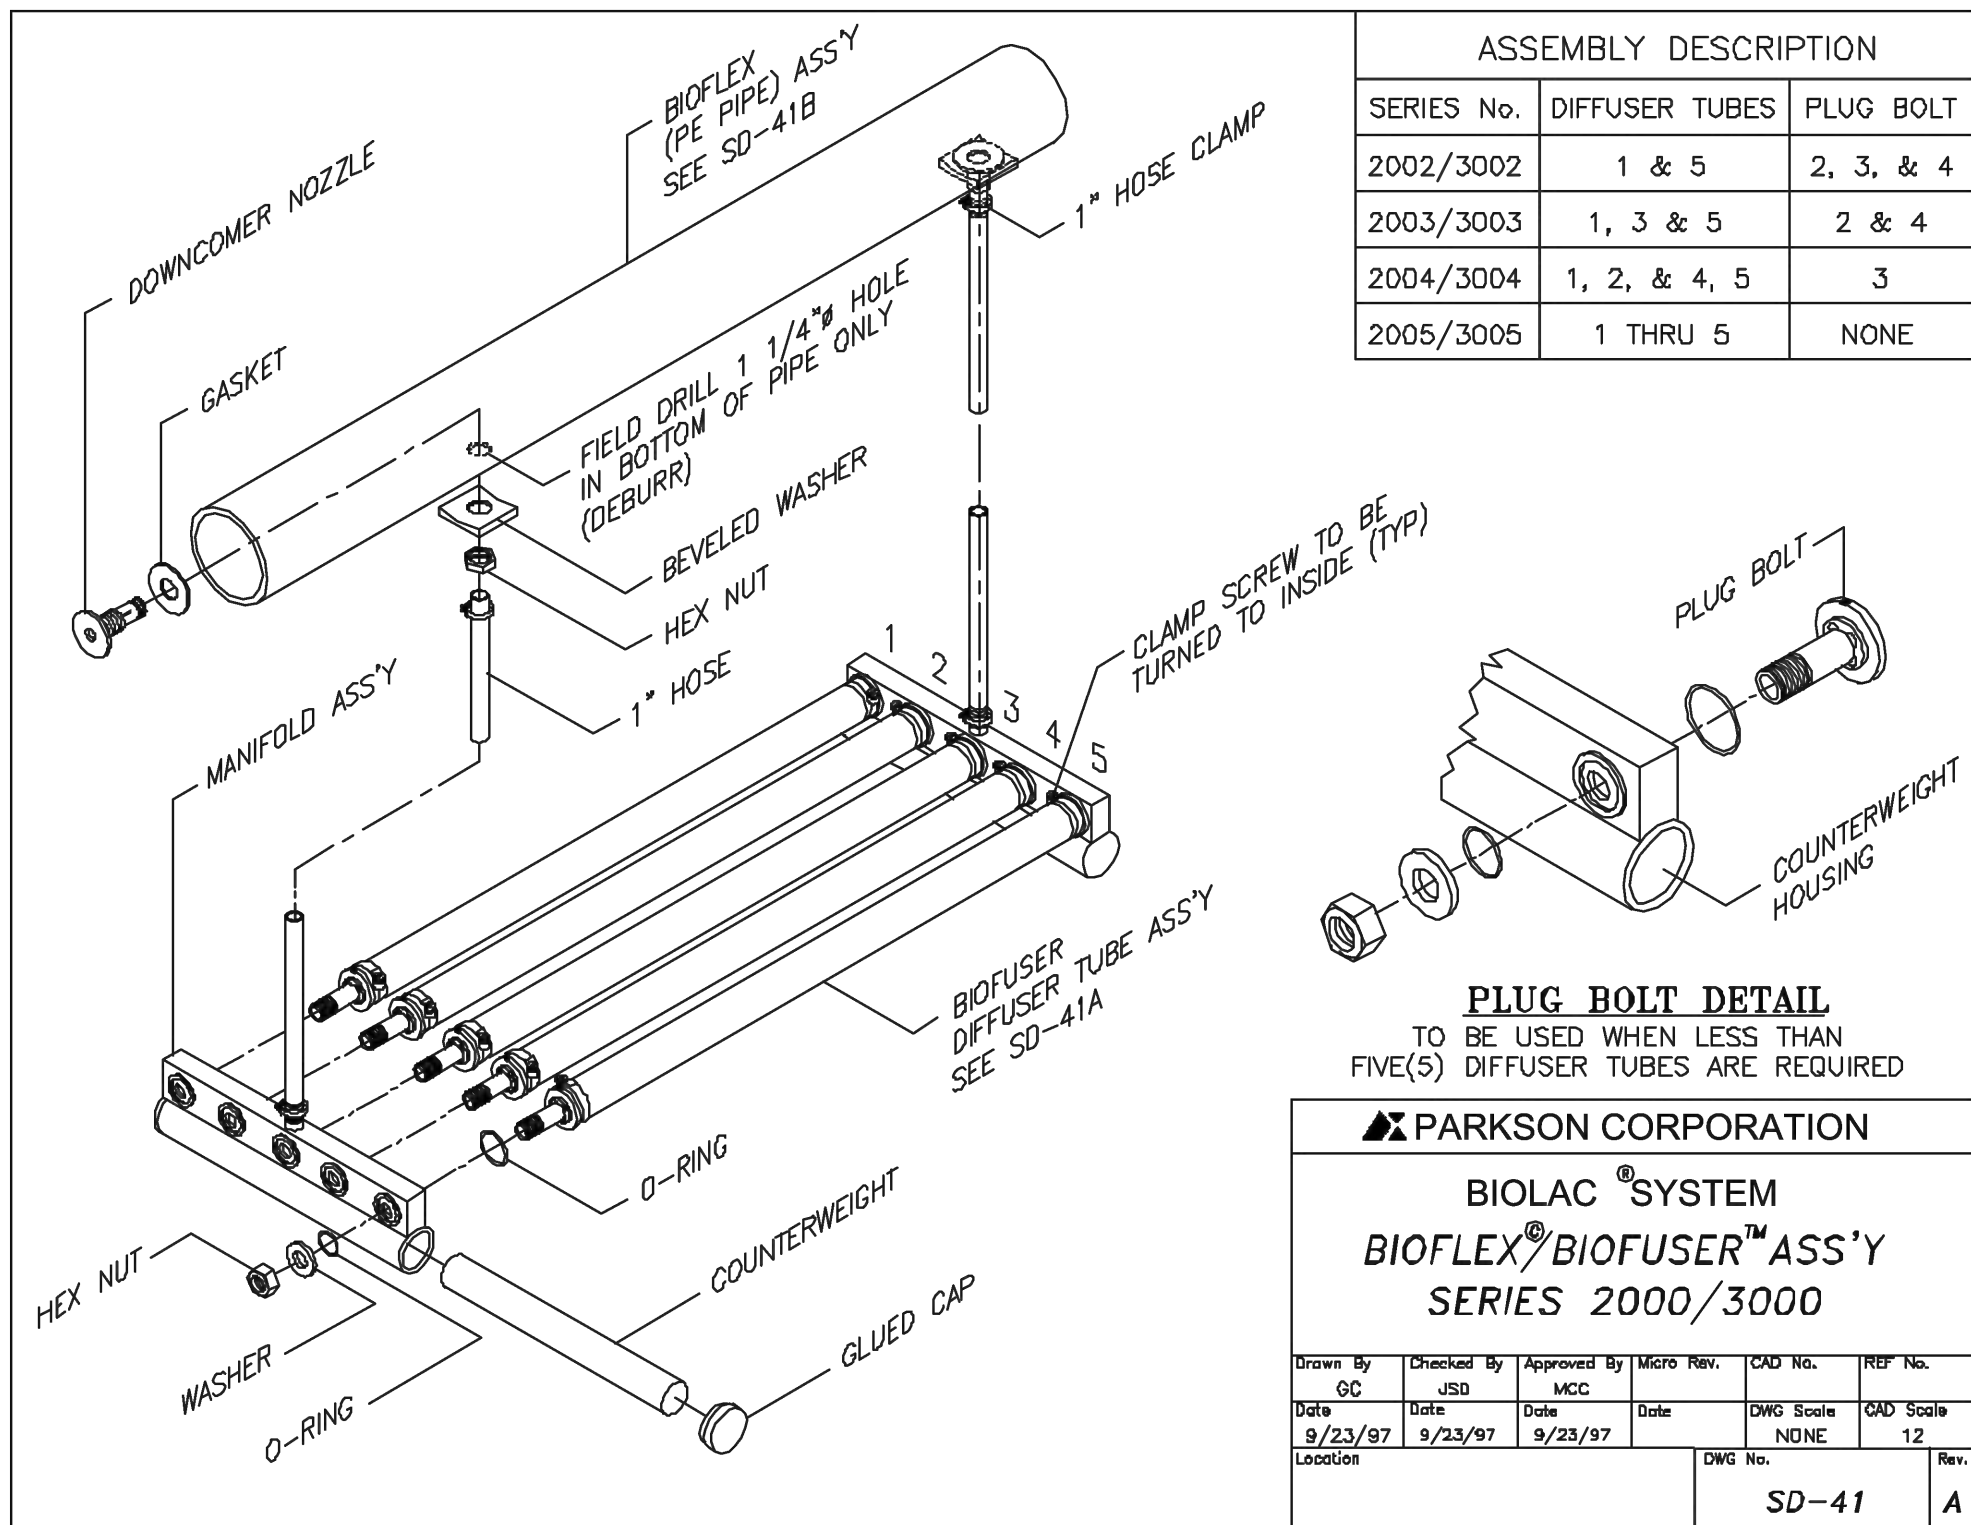

### BIOFUSER™ ASSEMBLY

THE BIOFUSER DIFFUSER ASSEMBLY IS SHIPPED LOOSE AND ASSEMBLED IN THE FIELD BY CONTRACTOR. THE BIOFUSER ASSEMBLY SHOULD BE ASSEMBLED BEFORE THE PE PIPE IS WELDED TOGETHER. THE COUNTERWEIGHT CAN BE INSTALLED AT THIS TIME, OR FOR HANDLING PURPOSES, INSTALLED JUST BEFORE THE DOWNCOMER HOSES ARE CONNECTED.

TO ASSEMBLE USE THIS WITH S.D. DRAWING SD-41

- A. TO ASSEMBLE THE DIFFUSER TUBES INTO THE MANIFOLD, SELECT A FLAT SURFACE (TABLE). MAKE SURE THE TABLE IS SMOOTH AND NO SHARP EDGES THAT COULD CUT THE DIFFUSER SHEATHS.
- B. PLACE TWO MANIFOLDS ON THE TABLE ONE AT EACH END AND AS MANY DIFFUSER TUBES AS REQUIRED PER APPROPRIATE DRAWING. PLACE TWO WOODEN 2x4's UNDER AND PERPENDICULAR TO THE TUBES TO RAISE THE TUBES OFF THE TABLE.
- C. SLIDE THE LARGE O-RING OVER THE BOSS ON THE END OF THE DIFFUSER TUBE. THEN INSERT ONE END OF THE DIFFUSER TUBE INTO THE MANIFOLD. MAKE SURE THE O-RING IS PROPERLY SEATED AND THE SCREW ON THE CLAMP IS FACING TO THE INSIDE.
- NEXT, INSTALL THE OUTSIDE(SMALL) O-RING AND PROPERLY SEAT INTO THE O-RING GROOVE IN THE MANIFOLD. THEN SLIDE THE WASHER OVER THE BOLT AND AGAINST THE O-RING. START THE NUT ONTO THE BOLT, APPLY MAX. TWO(2) DROPS LOCTITE #425 ON THE BOLT THREADS, OUTSIDE THE WASHER.

MAKE SURE THAT THE LOCATING GROOVES ON THE TUBES LINE UP WITH THE LOCATING PINS ON THE MANIFOLD. THEN SCREW THE NUT UNTIL HAND TIGHT.

INSTALL ALL THE DIFFUSER TUBES, AND PLUG BOLTS IF REQUIRED, INTO ONE MANIFOLD THEN INSTALL THE MANIFOLD ONTO THE OTHER END USING THE SAME PROCEDURE. AFTER THE TUBES ARE ASSEMBLED TO THE MANIFOLDS HAND TIGHT, TORQUE ALL NUTS TO 135 IN-LBS.

**CAUTION:** AFTER THE BIOFUSERS ARE ASSEMBLED, DO NOT STACK THE ASSEMBLIES ON TOP OF ONE ANOTHER, AS THIS CAN DAMAGE THE SHEATHS. LAY THE ASSEMBLIES ON THEIR SIDE, MAKING SURE THAT NOTHING MAKES CONTACT AGAINST THE DIFFUSER SHEATHS.

**PARKSON CORPORATION**

**BIOLAC® SYSTEM**  
**BIOFUSER™ DIFFUSER ASS'Y**  
**SERIES 2000**


Drawn By	Checked By	Approved By	Micro Rev.	CAD No.	REF No.
JSD	JSD	MCC			
Date	Date	Date	Date	DWG Scale	CAD Scale
10/10/98	10/16/98	10/16/98		NONE	12
Location			DWG No.		Rev.
			SD-41A		

### BIOFLEX® (PE PIPE) ASSEMBLY

The floating lateral consists of HDPE pipe, end fittings and downcomer fittings. The pipe will be shipped in 20 ft or 40 ft length (normally 40 ft), and must be field welded (fusion welded) together by installation contractor.

In order to inspect the integrity of the fusion welds, the following procedure should be followed: Each welder will be required to make one test sample weld at the start and end of each days welding. An additional test sample should be made for every twenty(20) welds. The samples should be least 6' long overall. Each weld sample should have three straps, 1" wide, cut lengthwise. Each strap is bent 90°. If there are any voids or gaps, the weld is unacceptable. These samples should then be sent back to Parkson for inspection.

- A. Field drill and match mark the PE pipe as per the pipe hole layout drawings furnished. Most of the pipe will have lettering in line full length of the pipe. This can be used as a hole centerline, as it is important that all the drilled holes be in line. Layout and drill the holes (1 1/4") using a hole saw. After drilling, deburr the hole inside and outside the pipe to provide a good seal. The downcomer fittings can be installed as they are drilled or as the pipe is being welded.
- B. To install the downcomer fittings use an electrician's steel fish tape or heavy wire of sufficient length to extend the full length of the unwelded pipe (max. 40 ft).
- Slide the nut and beveled washer onto the fish tape, then insert the fish tape into the hole in the pipe until it is accessible from the end of the pipe. Slide the downcomer fitting with rubber washer over the end of the fish tape and secure with a wire hook so the fitting will not slide off the fish tape. Pull the fish tape back through the hole until the downcomer fitting is pulled through the hole.
- Position the fitting so the two(2) raised bosses on the trough of the fitting are parallel to the length of the pipe. Then slide the washer over the fitting, apply Loctite Assure #425 to the threads on the fitting under the nut then screw the nut onto the fitting and torque to 135 in-lbs.
- C. The pipe should be welded together at the edge of the basin, starting with the closed end so it can be floated into the basin as it is welded together. Note a special hose adapter is to be welded to the open of the pipe. When the PE pipe has been completely welded together cut the Hi-temp hose to length as shown on drawings. Attach one end of hose to the PE pipe adapter and other end to hose adapter at the air header on shore. Assemble and attach the restraining cable/chain to both ends of the PE pipe as shown on the assembly drawing.
- D. The downcomer hose can be attached to the pipe downcomer fitting as the pipe is being welded together and before it enters the basin. Plug the end of the hose to prevent waste from entering the hose. Coil the hose and tie the hose to the PE pipe with twine. The diffuser assemblies can be attached to the downcomer hoses from a boat or could be attached to the downcomer hose then tied to the PE pipe on shore before it enters the basin. It is absolutely critical that the downcomer hoses are straight and free of twists and kinks. If it is attached on shore, special care must be taken so that the diffuser sheath does not drag on the ground and get damaged.

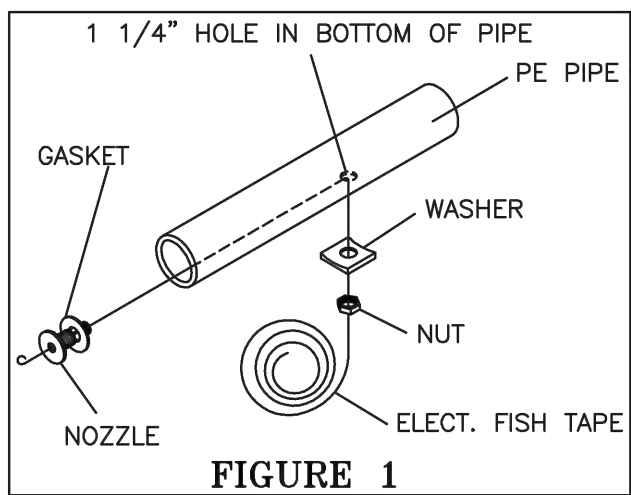

**PARKSON CORPORATION**

**BIOLAC® SYSTEM**  
**BIOFLEX® ASSEMBLY**


Drawn By	Checked By	Approved By	Micro Rev.	CAD No.	REF No.
JSD	JSD	MCC			
Date	Date	Date	Date	DWG Scale	CAD Scale
9/25/97	9/25/97	9/25/97		SD-41B	
Location			DWG No.		Rev.
			SD-41B		

- E. Pull the entire aeration chain into position in the basin by pulling the restraining chain. Make sure that you also pull and position the aeration chain hose. Attach the restraining chain to the hooks located on the sides of the basin. Repeat the above until all the aeration chains are
- F. Once the aeration chains are secured into position and the hose attached to the air header, they are ready to be tested for air leaks. Fully open all butterfly valves at each aeration chain connection. Turn on blowers, (refer to Part II Section 2 prior to starting blowers) and start checking for air bubbles and/or hissing sounds. The leak will be fairly easy to detect as bubbling at the leaks. Also check that all the diffuser assemblies have identical bubble patterns.
- G. If the basin has been dewatered, or if new construction, the chains can be assembled in the bottom of the basin. If the basin has a liner, special care must be taken so as not to damage or cut the liner. The PE pipe can be drilled and welded together in the bottom of the basin, but not recommended if basin is lined.
- Connect the downcomer hoses to the PE pipe then stretch the hose and connect to the diffuser assembly, making sure there are no twists or kinks in the hose. The diffuser assemblies should then be placed near the PE pipe.
- Connect one end of the air feed hose to the PE pipe. Plug the other end of the hose so it cannot fill with water. Attach a rope to the end of the hose and secure to shore.
- Attach the restraining chains to the PE pipe. Tie a rope to the end of the chain and secure to the anchor post on shore. As the basin is being filled with water occasionally retie the ropes to shore.
- When the water has reached the required side water (S.W.D.) per drawing, adjust and secure the restraining chains to the anchor post. Attach the air feed hose to the air adapter at shore. Adjust and cut hose if necessary at startup per Parkson Representative instruction.


**PARKSON CORPORATION**

**BIOLAC® SYSTEM**  
**BIOFLEX® ASSEMBLY**

Drawn By	Checked By	Approved By	Micro Rev.	CAD No.	REF No.
JSD	JSD	MCC			
Date	Date	Date	Date	DWG Scale	CAD Scale
9/25/97	9/25/97	9/25/97		SD-41C	
Location			DWG No.		Rev.
			SD-41C		

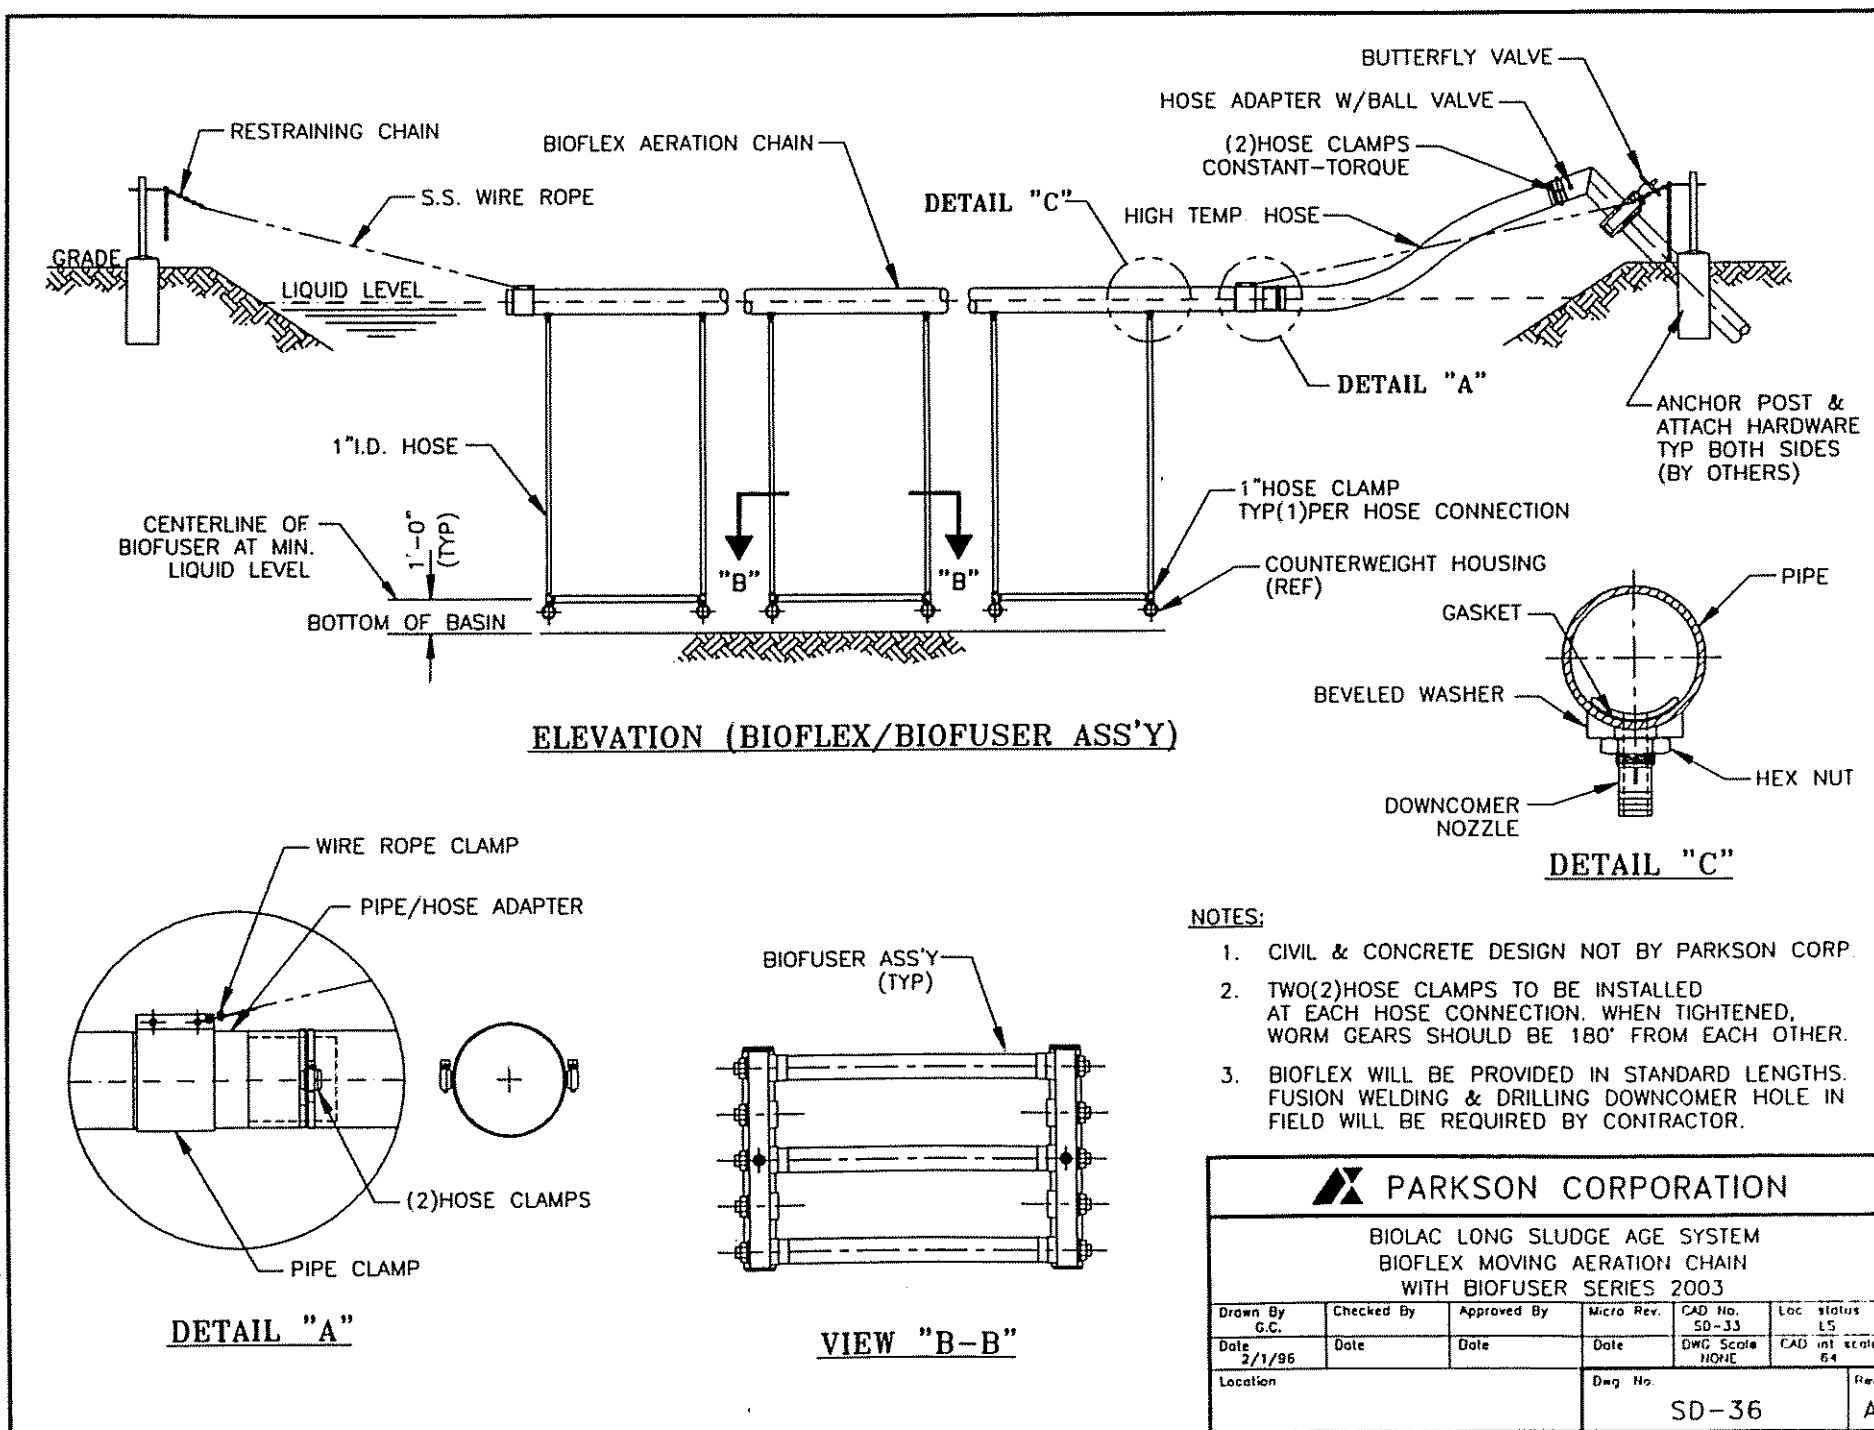

4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109  
TEL: (505) 821-1801

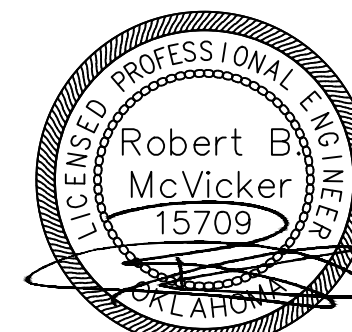

06/26/2023

**FINAL**

PROJECT:  
**TUBA CITY WWTP**  
**HIGH-PERFORMANCE**  
**POND SYSTEM**  
**FINAL DESIGN**



**NAVAJO TRIBAL UTILITY**  
**AUTHORITY**  
**PO BOX 170**  
**FT. DEFANCE, AZ 86504**  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED


DESIGNED BY:	WSP - BM
DRAWN BY:	WSP - AO
CHECKED BY:	WSP - BM
APPROVED BY:	WSP - BM
DATE:	06/26/2023

SHEET TITLE:

**BIOFUSER**  
**DETAILS**

SHEET NUMBER:	REV. #
<b>C-404</b>	
SHEET 14 OF 38 SHEETS	



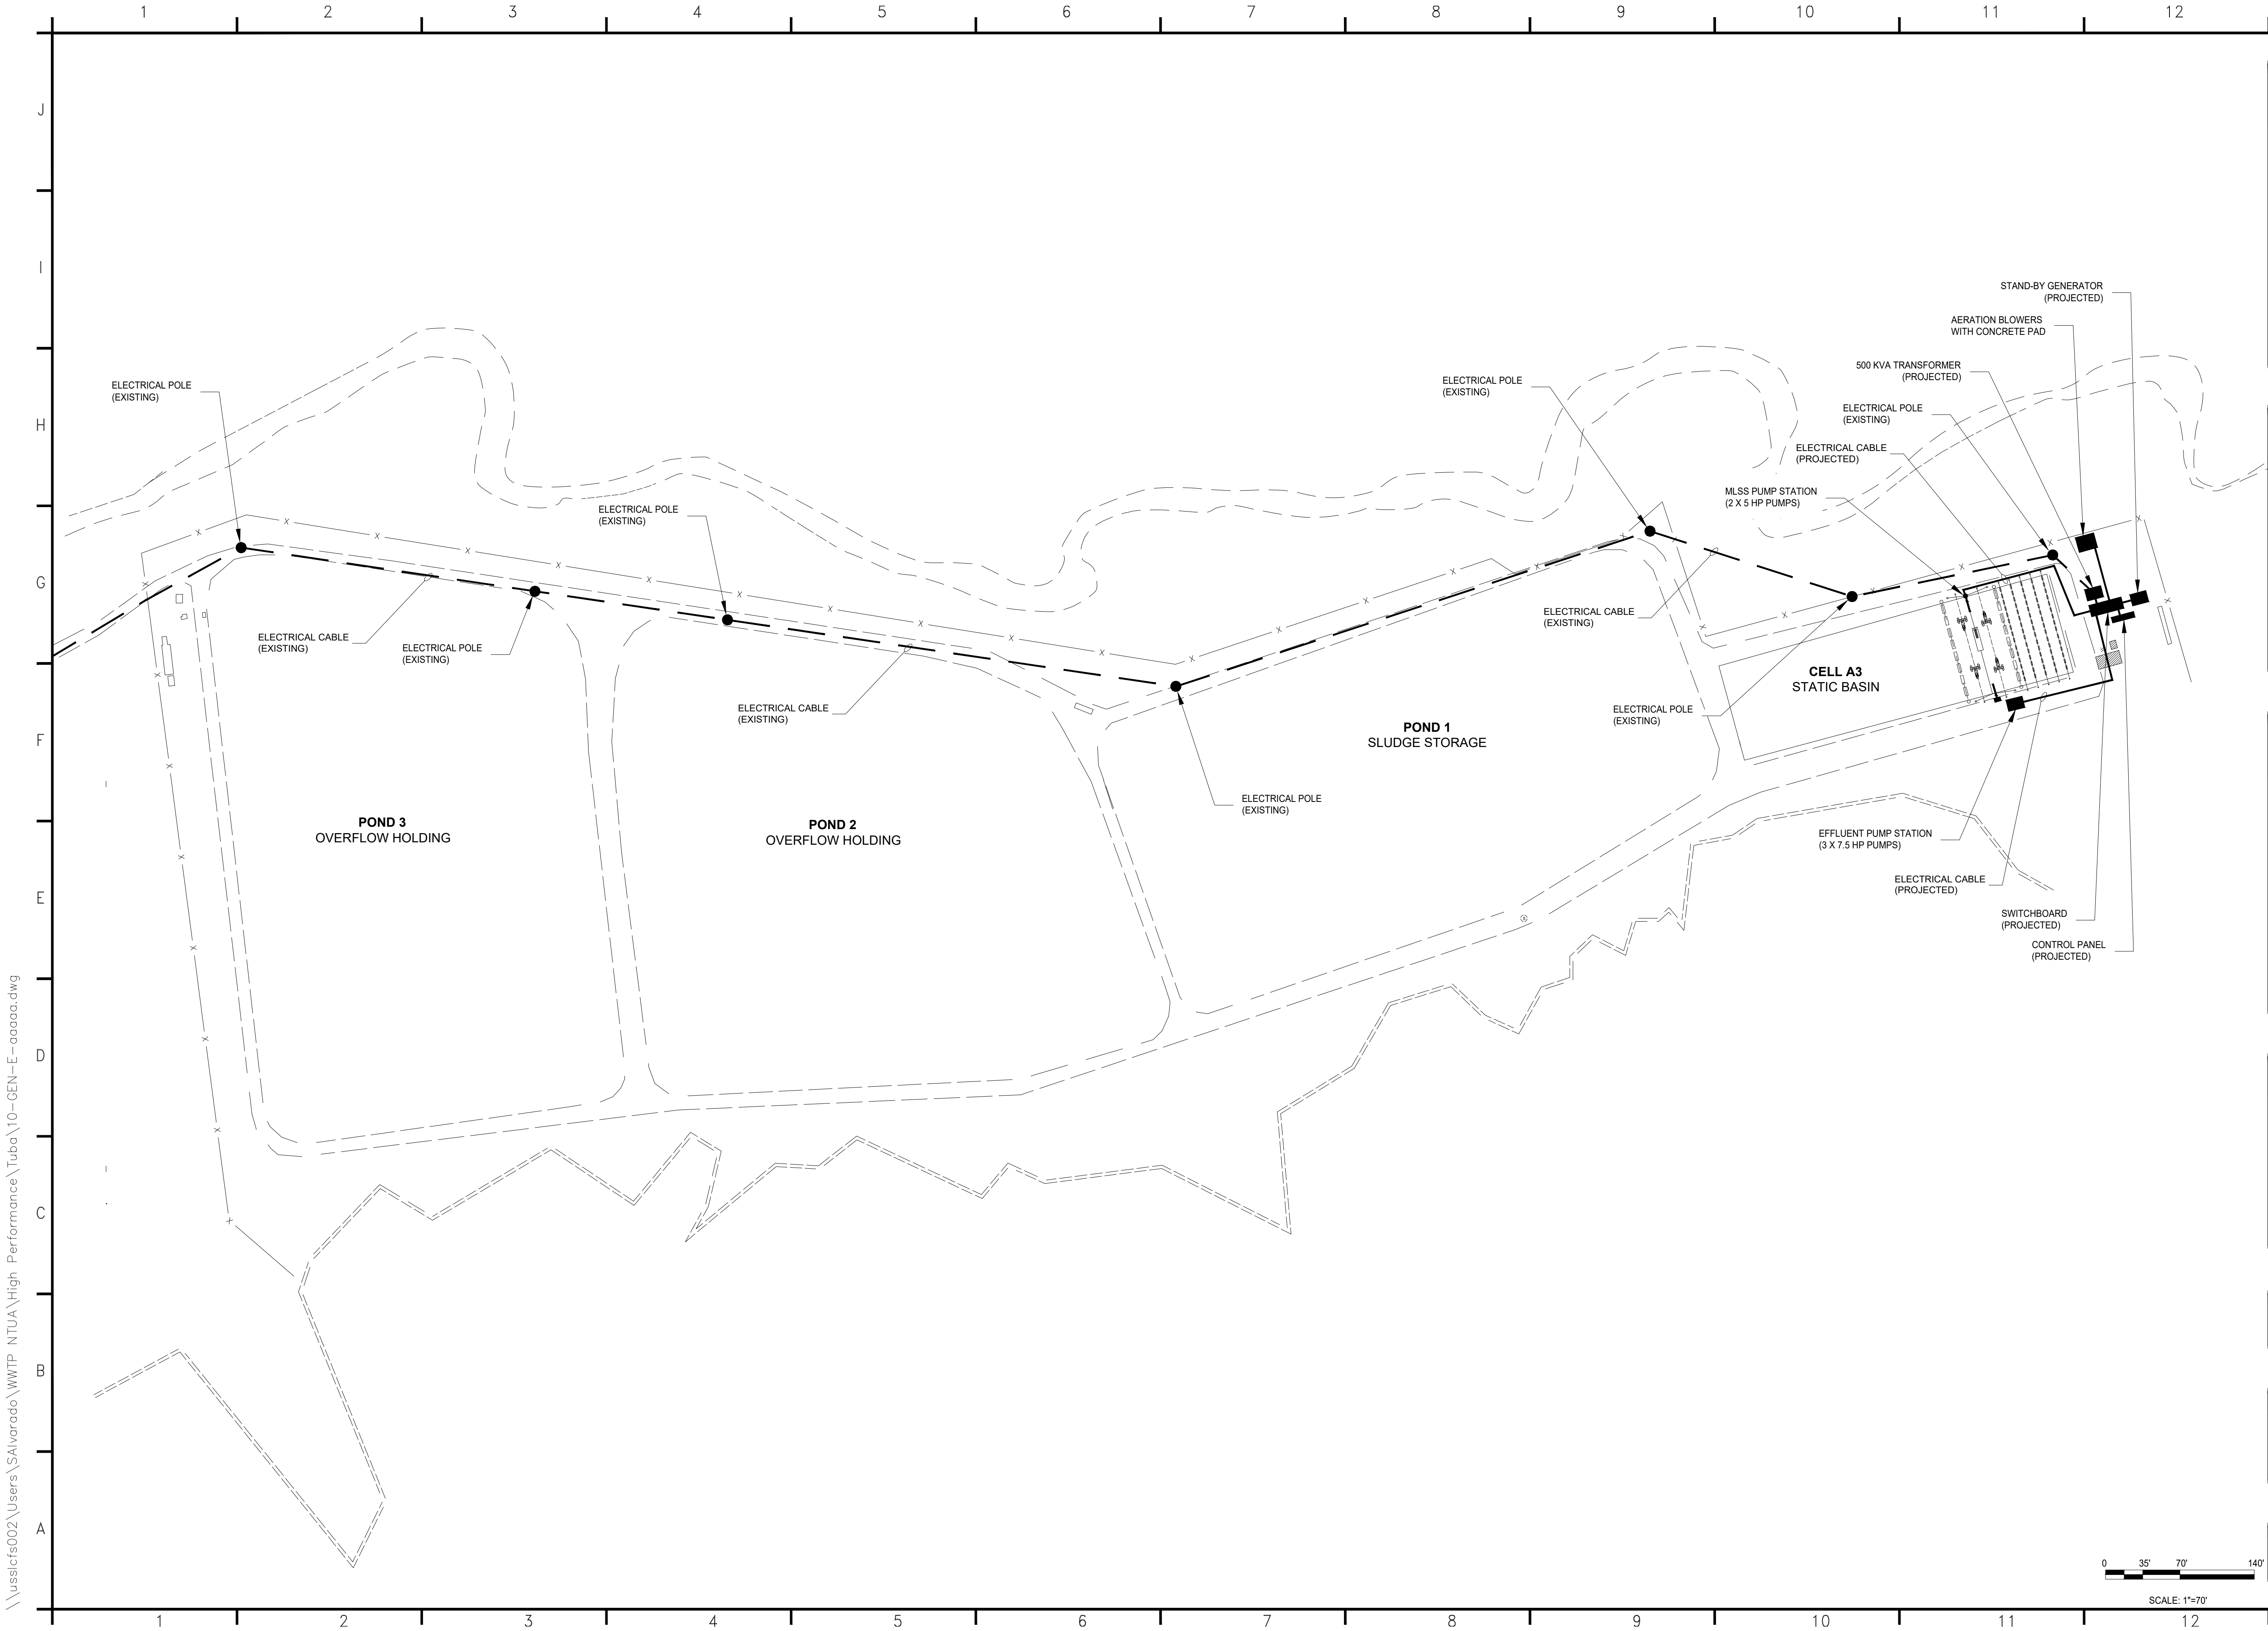

4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109



PROJECT:  
TUBA CITY WWTP  
CFID  
POND SYSTEM  
FINAL DESIGN



NAVAJO TRIBAL  
UTILITY AUTHORITY

PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2151700051

REVISIONS

NO.	DATE	DESCRIPTION


DESIGNED BY:	SA
DRAWN BY:	JJ
CHECKED BY:	JJ
DATE:	16JUN2023

SHEET TITLE:  
ELECTRICAL  
SITE LAYOUT  
DRAWING

SHEET NUMBER:	REV. #
E-100	
SHEET 15 OF 38	



\\ussicfs002\Users\SAIvarado\WWTP NTUA\High Performance\Tuba\10-cEN-E-xxxxx.dwg

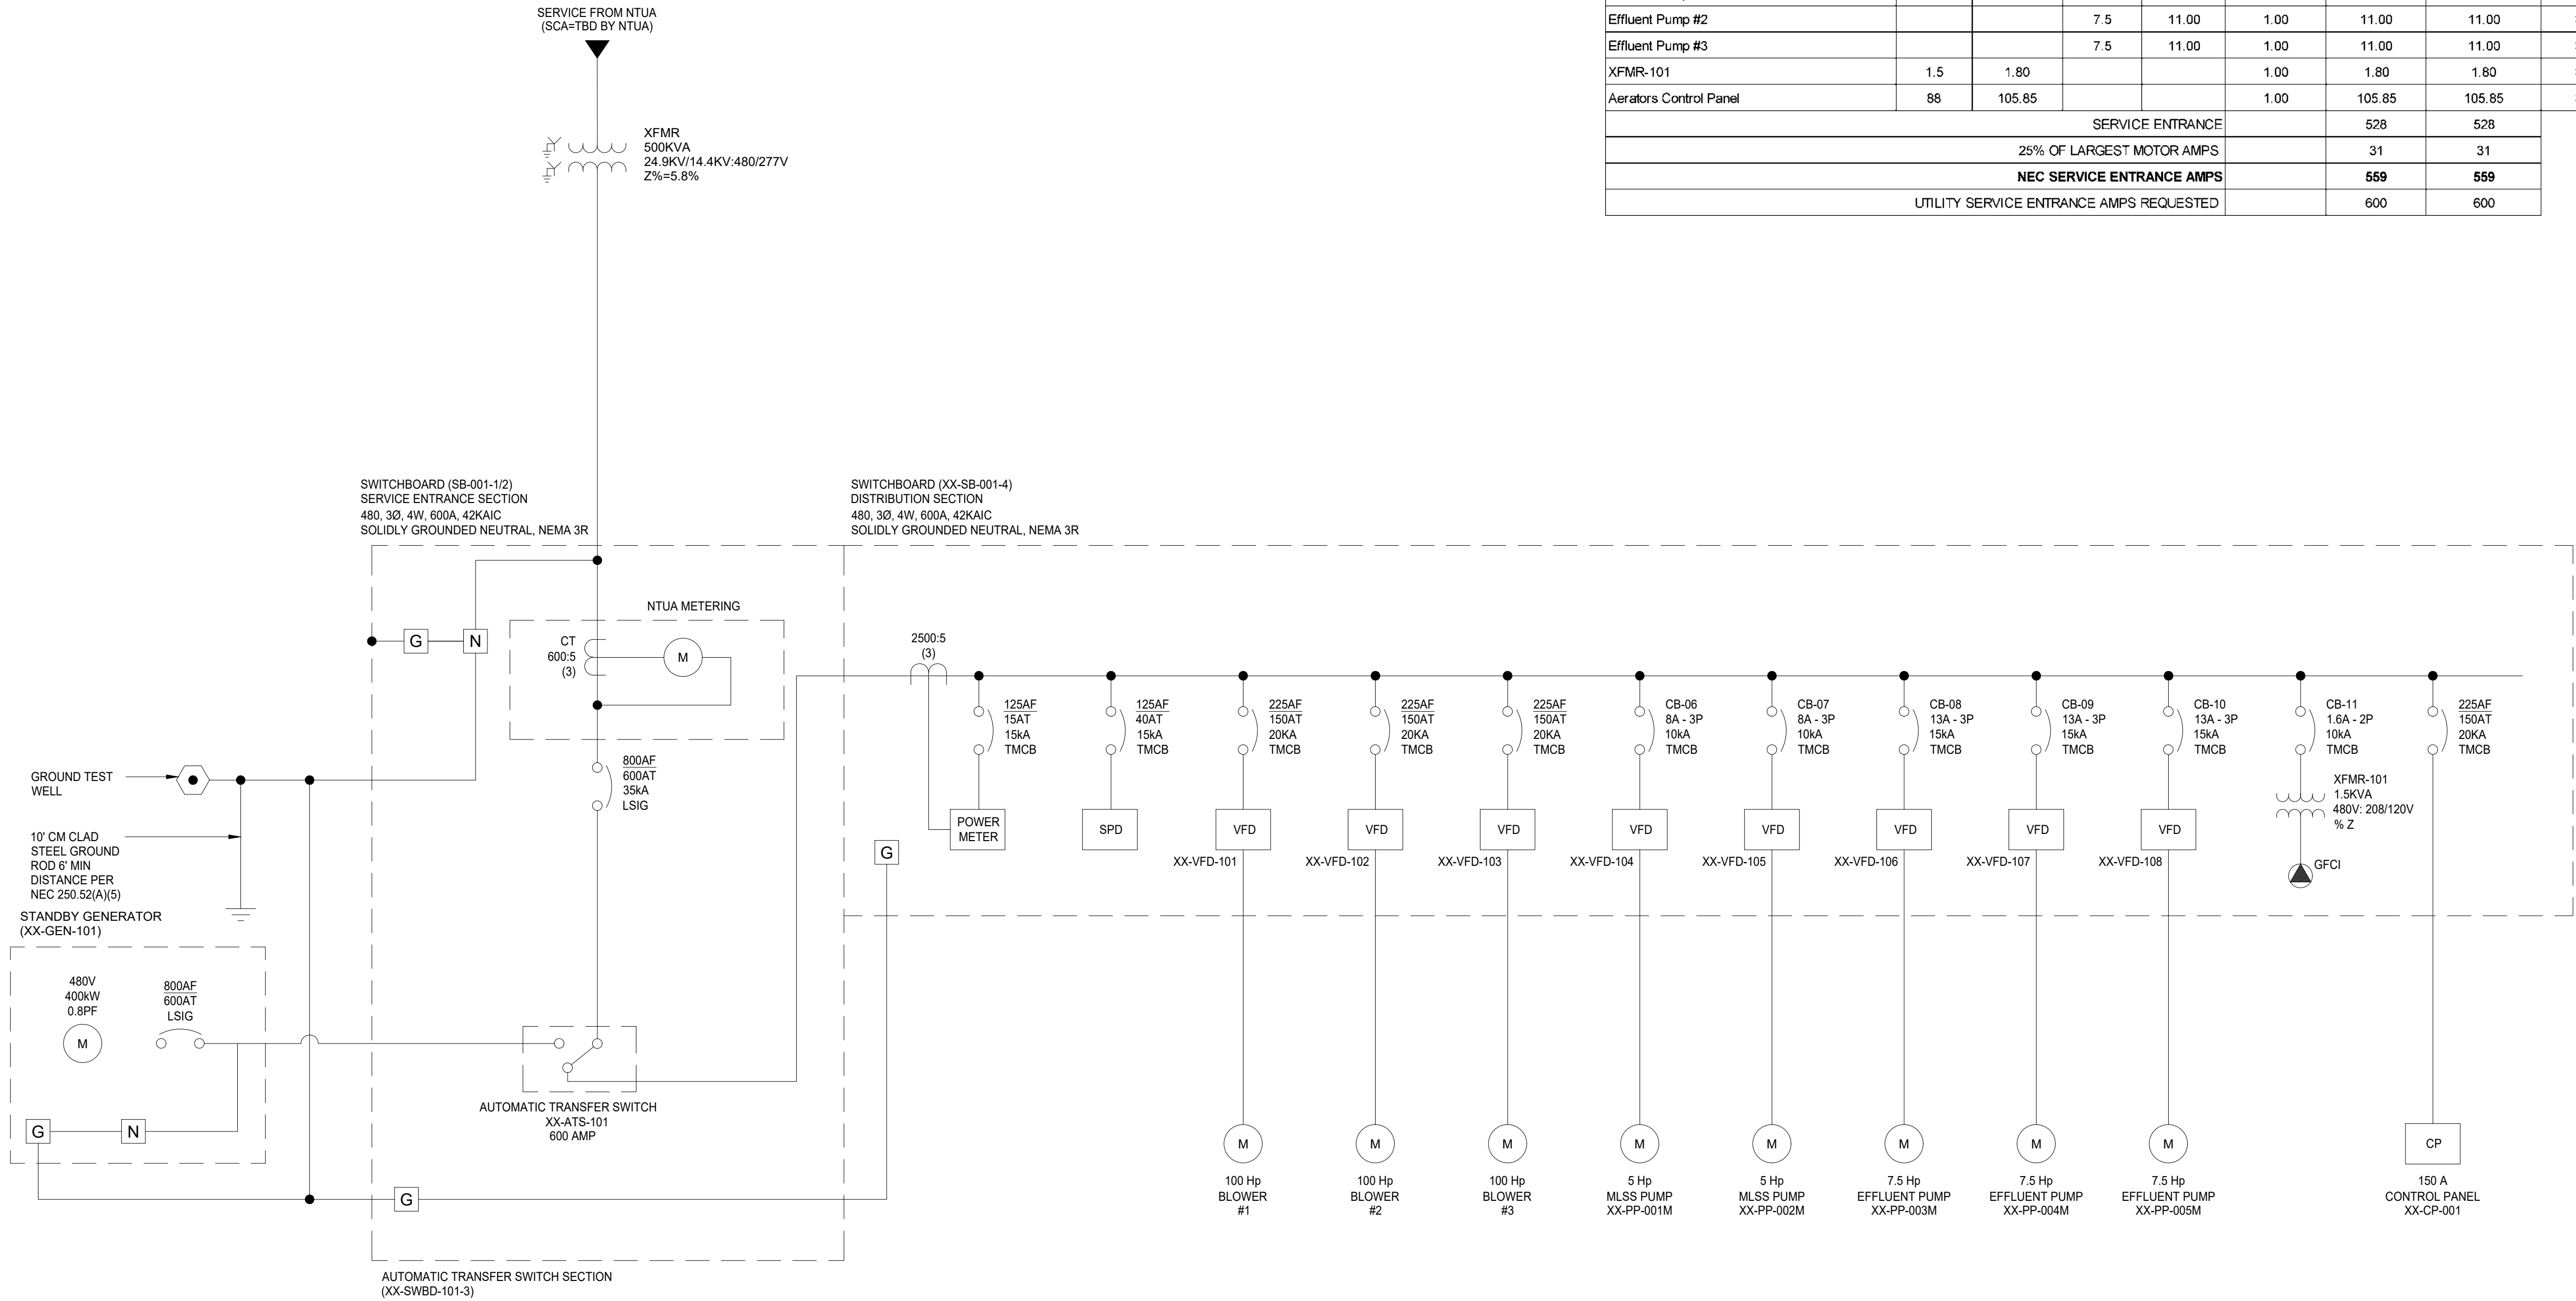

LOAD DESCRIPTION	NON MOTOR LOAD KVA	NON MOTOR LOAD AMPS	MOTOR HP	MOTOR AMPS	DEMAND FACTOR	DEMAND SERVICE ENTRANCE AMPS	CONNECTED SERVICE ENTRANCE AMPS	POWER SOURCE
Blower #1			100	124.00	1.00	124.00	124.00	SB-001
Blower #2			100	124.00	1.00	124.00	124.00	SB-001
Blower #3			100	124.00	1.00	124.00	124.00	SB-001
MLSS Pump #1			5	7.60	1.00	7.60	7.60	SB-001
MLSS Pump #2			5	7.60	1.00	7.60	7.60	SB-001
Effluent Pump #1			7.5	11.00	1.00	11.00	11.00	SB-001
Effluent Pump #2			7.5	11.00	1.00	11.00	11.00	SB-001
Effluent Pump #3			7.5	11.00	1.00	11.00	11.00	SB-001
XFMR-101	1.5	1.80			1.00	1.80	1.80	SB-001
Aerators Control Panel	88	105.85			1.00	105.85	105.85	SB-001
SERVICE ENTRANCE						528	528	
25% OF LARGEST MOTOR AMPS						31	31	
NEC SERVICE ENTRANCE AMPS						559	559	
UTILITY SERVICE ENTRANCE AMPS REQUESTED						600	600	



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109



PROJECT:  
TUBA CITY WWTP  
CFID  
POND SYSTEM  
FINAL DESIGN



NAVAJO TRIBAL  
UTILITY AUTHORITY

PO BOX 170  
FT. DEFIANC, AZ 86504  
WSP PROJECT No:  
2151700051

REVISIONS

NO.	DATE	DESCRIPTION


DESIGNED BY:	SA
DRAWN BY:	JJ
CHECKED BY:	JJ
DATE:	16JUN2023

SHEET TITLE:  
SWITCHBOARD  
SINGLE LINE  
DIAGRAM

SHEET NUMBER:	REV. #
E-101	
SHEET 16 OF 38	



\\ussicfs002\Users\SAIvarado\WWTP NTUA\High Performance\Tuba\10-GEN-E-xxxx.dwg

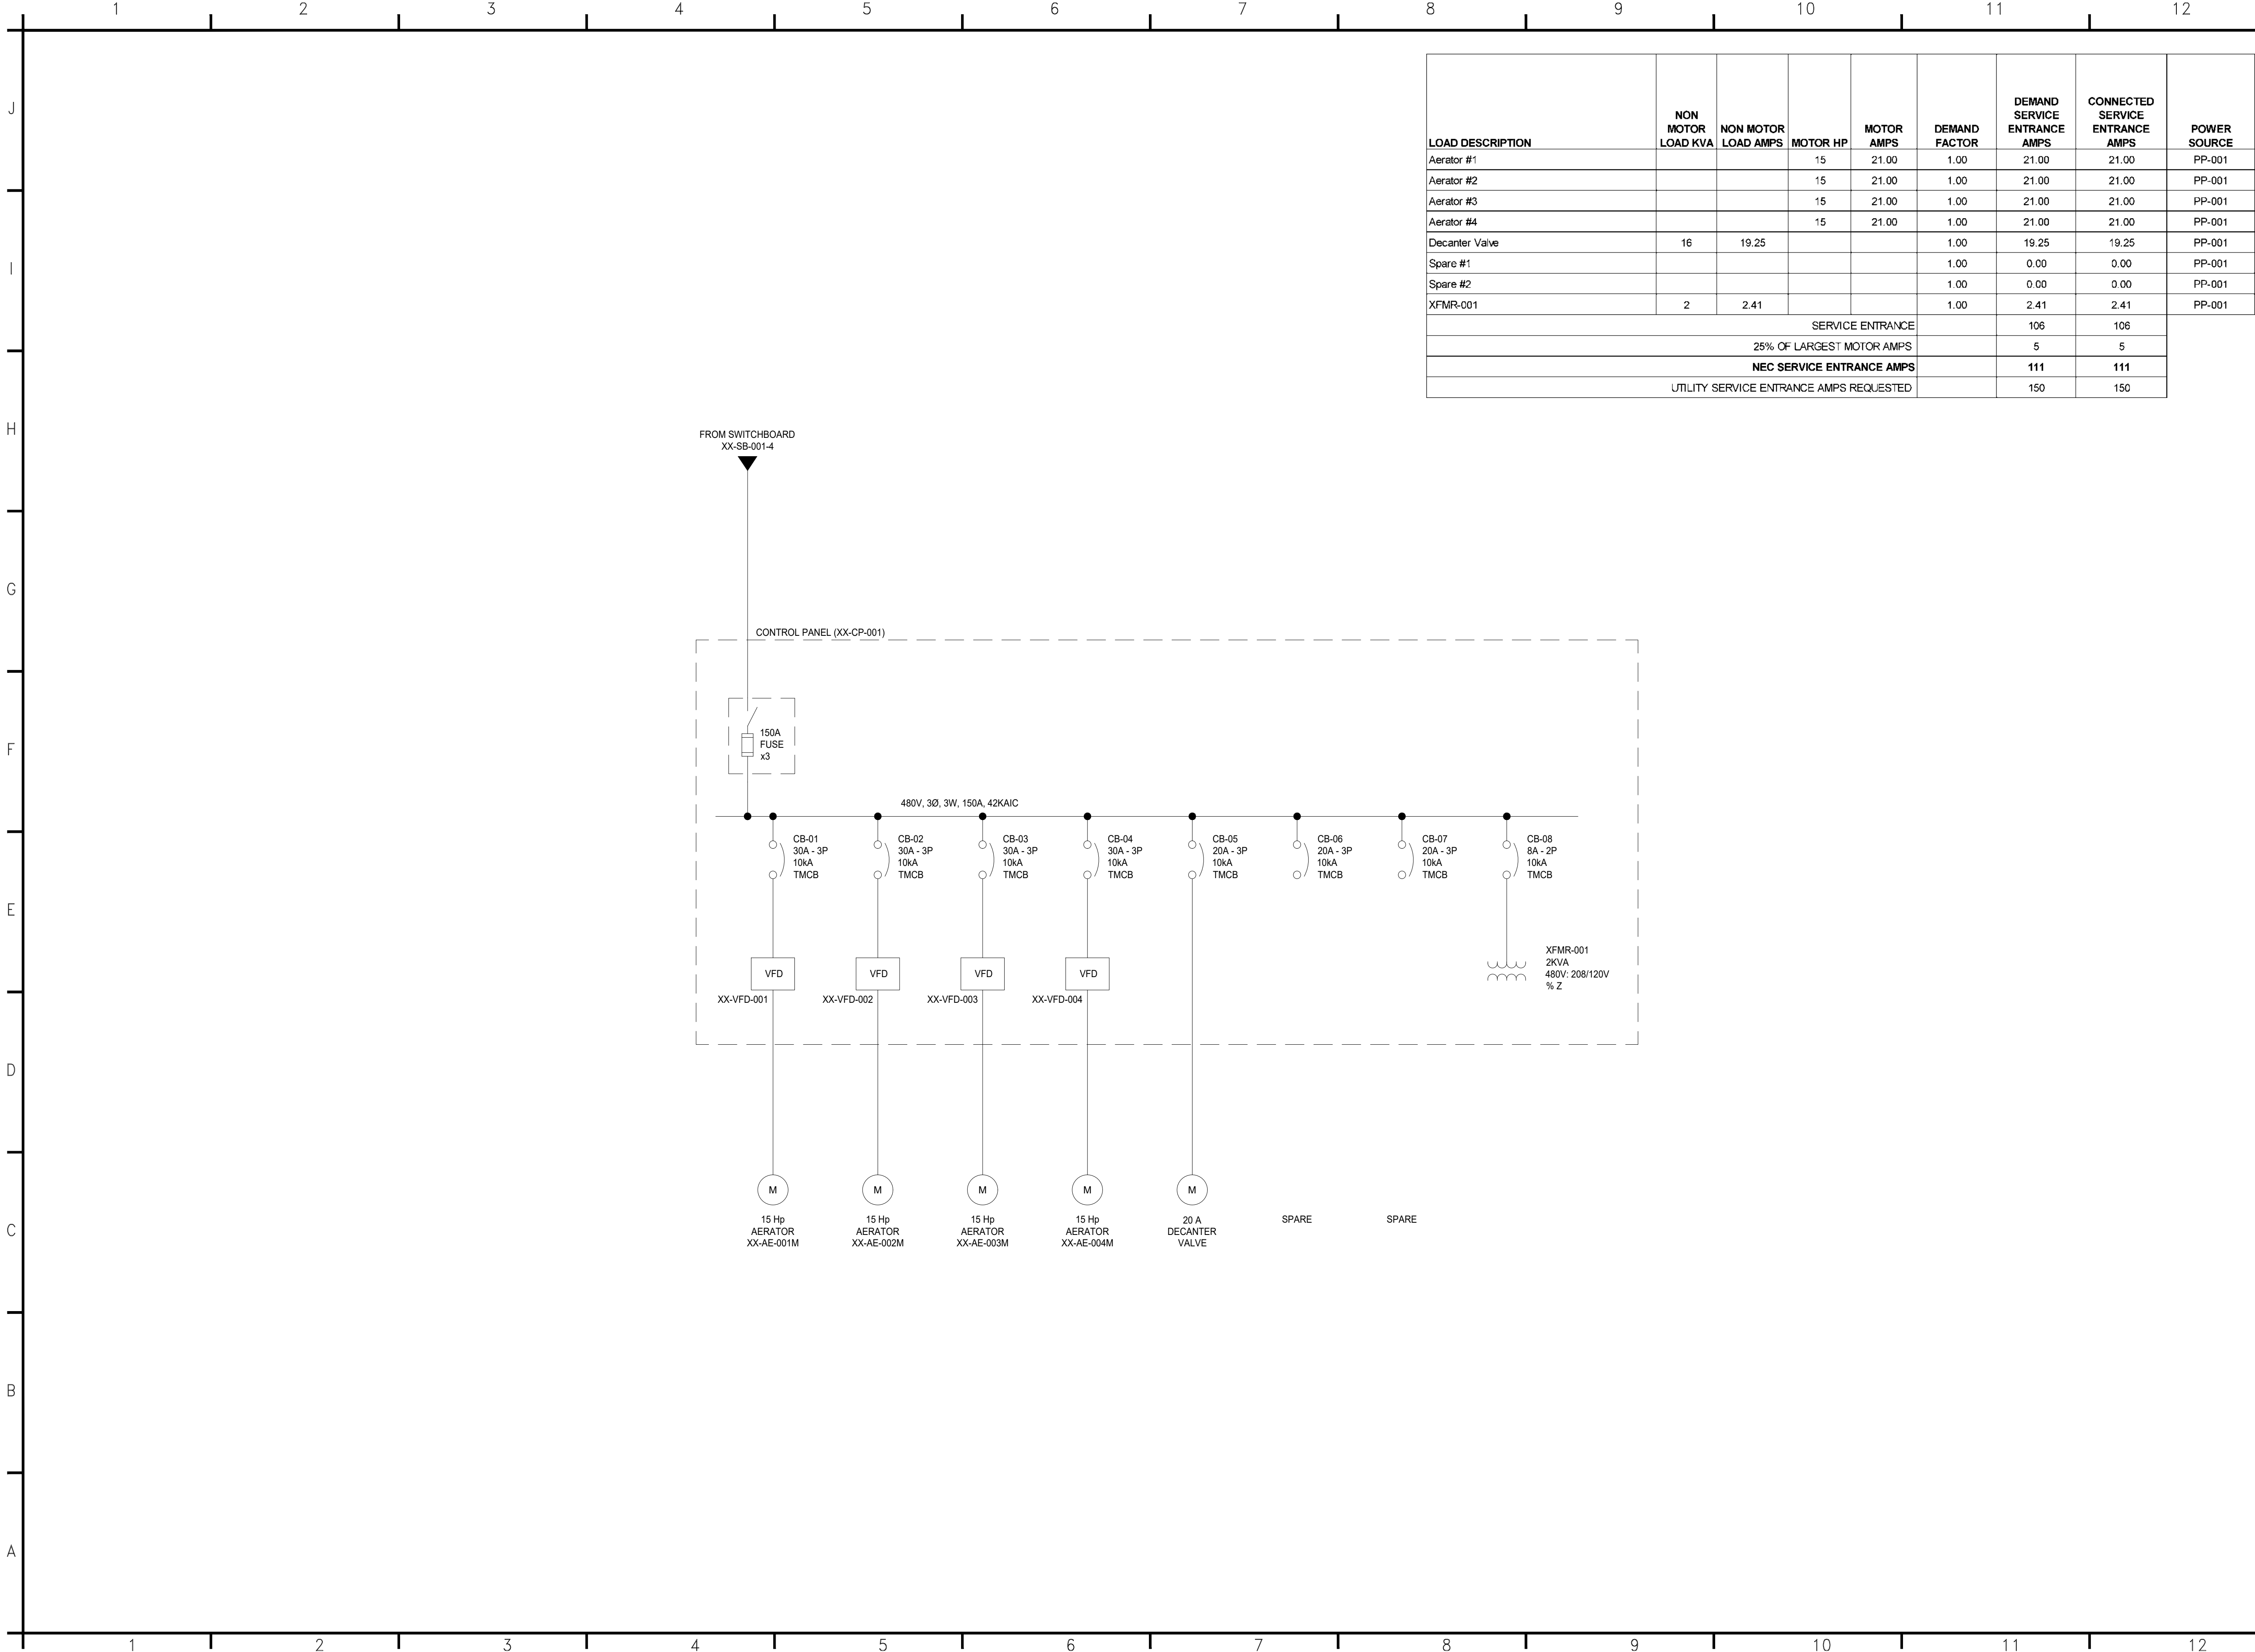

LOAD DESCRIPTION	NON MOTOR LOAD KVA	NON MOTOR LOAD AMPS	MOTOR HP	MOTOR AMPS	DEMAND FACTOR	DEMAND SERVICE ENTRANCE AMPS	CONNECTED SERVICE ENTRANCE AMPS	POWER SOURCE
Aerator #1			15	21.00	1.00	21.00	21.00	PP-001
Aerator #2			15	21.00	1.00	21.00	21.00	PP-001
Aerator #3			15	21.00	1.00	21.00	21.00	PP-001
Aerator #4			15	21.00	1.00	21.00	21.00	PP-001
Decanter Valve	16	19.25			1.00	19.25	19.25	PP-001
Spare #1					1.00	0.00	0.00	PP-001
Spare #2					1.00	0.00	0.00	PP-001
XFMR-001	2	2.41			1.00	2.41	2.41	PP-001
SERVICE ENTRANCE						106	106	
25% OF LARGEST MOTOR AMPS						5	5	
NEC SERVICE ENTRANCE AMPS						111	111	
UTILITY SERVICE ENTRANCE AMPS REQUESTED						150	150	



4221 BALLOON PARK RD NE  
ALBUQUERQUE, NM 87109



PROJECT:

TUBA CITY WWTP  
CFID  
POND SYSTEM  
FINAL DESIGN



NAVAJO TRIBAL  
UTILITY AUTHORITY

PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2151700051

REVISIONS

NO.	DATE	DESCRIPTION

DESIGNED BY:	SA
DRAWN BY:	JJ
CHECKED BY:	JJ
DATE:	16JUN2023

SHEET TITLE:  
CONTROL PANEL  
SINGLE LINE  
DIAGRAM

SHEET NUMBER:	REV. #
E-102	
SHEET 17 OF 38	




C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-A01.dwg

NAVAJO TRIVAL UTILITY AUTHORITY  
HIGH-PERFORMANCE POND SYSTEM - TUBA CITY

FOR: N.T.U.A.  
LOCATION: TUBA CITY, AZ  
PROJECT No.: 2251700010  
DRAWING PKG No.: 23-045\_TBCTY

TABLE OF CONTENTS		
DRAWING NO.	SEC	DRAWING TITLE
T-A01	A	TITLE PAGE
T-A02	A	PROCESS FLOW SYMBOLS & NOTES PG. 1 - P & ID
T-A03	A	PROCESS FLOW SYMBOLS & NOTES PG. 2 - P & ID
T-A04	A	PROCESS FLOW SYMBOLS & NOTES PG. 3 - P & ID
T-A05	A	PROCESS FLOW SYMBOLS & NOTES PG. 4 - P & ID
T-C01	C	AREA MAP AND CONSTRUCTION NOTES
T-C02	C	BLANK PAGE
T-D01	D	NETWORK AND CONDUIT DIAGRAM: PANEL AND FIELD
T-E00	E	480VAC THREE-LINE DIAGRAM
T-E01	E	480VAC THREE-LINE DIAGRAM
T-E02	E	480VAC THREE-LINE DIAGRAM
T-F01	F	120VAC SCHEMATIC
T-G01	G	24VDC SCHEMATIC
T-H00	H	PLC POWER AND COMMUNICATION - RACK 1 MODULE 00
T-H01	H	I/O SCHEMATIC PLC RACK 1 MODULES 01 & 02
T-H02	H	I/O SCHEMATIC PLC RACK 1 MODULE 03
T-H03	H	I/O SCHEMATIC PLC RACK 1 MODULE 04
T-H04	H	I/O SCHEMATIC PLC RACK 1 MODULE 05
T-M01	M	ASSEMBLY DRAWING ENCLOSURE
T-M02	M	ASSEMBLY DRAWING BACKPLATE
T-M03	M	BILL OF MATERIALS

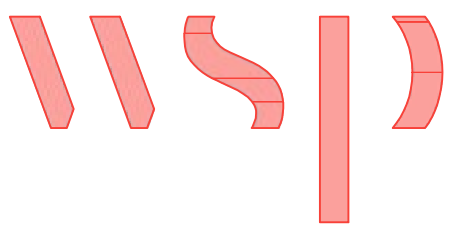

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
PROCESS FLOW SYMBOLS &  
NOTES PG. 2 - P & ID  
  
T-A01

SHEET NUMBER:	REV. #
T-A01	RCA
SHEET 1 OF 21 SHEETS	



ELECTRICAL SYMBOLS LEGEND				GENERAL ELECTRICAL NOTES	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	EXISTING REMOVE		EMERGENCY LIGHTING UNIT		MEDIUM VOLTAGE DISCONNECT SWITCH
	NEW WORK		CEILING MOUNTED EXIT SIGN - ARROW AS INDICATED		MEDIUM VOLTAGE DRAWOUT CIRCUIT BREAKER
	HIDDEN OR BURIED		TWO FACED EXIT SIGN		TRANSFORMER (DELTA-WYE CONN.)
	HOMERUN CONDUIT		WALL MOUNTED EXIT SIGN		SHIELDED TRANSFORMER
	GROUND		SWITCHBOARD, POWER PANELBOARD		DRAWOUT CIRCUIT BREAKER (TRIP FRAME)
	PHASE		LIGHTING PANELBOARD		CIRCUIT BREAKER (TRIP FRAME) WITH GROUND FAULT INTERRUPTER
	SWITCHED		TRANSFORMER		MOTOR CIRCUIT PROTECTOR
	NEUTRAL		NON-FUSIBLE SAFETY SWITCH (NUMBER INDICATES SWITCH SIZE)		FUSE
	ISOLATED GROUND		FUSED SAFETY SWITCH (NUMBERS INDICATE FUSE/SWITCH SIZES)		GENERATOR
	FLEXIBLE CONDUIT		MAGNETIC STARTER		CURRENT TRANSFORMER (NUMBERS INDICATE RATIO AND QUANTITY)
	CONDUIT TURNING DOWN		ADJUSTABLE SPEED DRIVE		POTENTIAL TRANSFORMER (NUMBER INDICATES QUANTITY)
	CONDUIT TURNING UP		MOTOR (NUMBER INDICATES HP)		AMMETER SWITCH
	CONDUIT UP AND DOWN		BELL		VOLTMETER SWITCH
	CONDUIT SEAL		BUZZER		VOLTMETER
	CONDUIT CAP		MANUAL PULL STATION		AMMETER
	BUSWAY WITH DESCRIPTION		FIRE ALARM HORN (V=VISUAL SIGNAL)		KILOWATT METER
	GROUNDING CONDUCTOR		PHOTOELECTRIC SMOKE DETECTOR		TRANSFER SWITCH
	CABLE TRAY WITH DESCRIPTION		IONIZATION SMOKE DETECTOR		CAPACITOR
	CEILING JUNCTION BOX		THERMAL DETECTOR		CONTROL RELAY #1
	WALL JUNCTION BOX		DUCT SMOKE DETECTOR (PHOTOELECTRIC)		BUS PLUG CIRCUIT BREAKER
	DUPLEX RECEPTACLE OUTLET		MAGNETIC DOOR HOLDER		THERMOSTAT
	SINGLE RECEPTACLE OUTLET		PRESSURE SWITCH		KEYED NOTE DESIGNATION
	DOUBLE DUPLEX RECEPTACLE OUTLET		FLOW SWITCH		ELECTRICAL EQUIPMENT DESIGNATION (SEE SCHEDULE)
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX OUTLET WITH WEATHERPROOF COVER		VALVE SUPERVISORY SWITCH		MECHANICAL EQUIPMENT DESIGNATION (SEE SCHEDULE)
	SPLIT WIRED DUPLEX RECEPTACLE		FIRE ALARM CONTROL PANEL		NAMEPLATE DESIGNATION (SEE SCHEDULE)
	DUPLEX ISOLATED GROUND		FIRE ALARM RACEWAY		WEATHERPROOF
	SPECIAL PURPOSE OUTLET - USE SUBSCRIPT TO IDENTIFY TYPE IN SPECS		CEILING SPEAKER		ABOVE FINISH FLOOR
	FLOOR RECEPTACLE OUTLET USE SUBSCRIPT TO IDENTIFY TYPE IN SPECS		WALL SPEAKER		
	RECEPTACLE RACEWAY		TELECOMMUNICATIONS OUTLET		
	SINGLE POLE SWITCH - USE SUBSCRIPT TO DESIGNATE CONTROL OF PARTICULAR OUTLETS		FLOOR MOUNTED TELECOMMUNICATIONS OUTLET		
	DOUBLE POLE SWITCH		INTERCOM OUTLET		
	THREE-WAY SWITCH		TELECOMMUNICATIONS RACEWAY		
	FOUR-WAY SWITCH		PROTECTED TRANSMISSION SYSTEM (PTS) DATA TERMINAL CONNECTION		
	WEATHERPROOF SWITCH		TELEVISION OUTLET		
	KEY OPERATED SWITCH		CARD READER		
	DIMMER SWITCH - NUMBER INDICATES WATTAGE		ELECTRIC DOOR STRIKE		
	OCCUPANCY SENSING SWITCH		REMOTE ACCESS PANEL		
	PHOTOCELL		HAND GEOMETRY UNIT		
	REMOTE CONTROL SWITCH 6 POLE, 30 AMPS		MOTION DETECTOR		
	FLUORESCENT LUMINAIRE		CLOSED CIRCUIT TV CAMERA		
	PROTECTED TRANSMISSION SYSTEM (PTS) DATA TERMINAL CONNECTION				
	FLUORESCENT STRIP LUMINAIRE				
	WALL MOUNTED FLUORESCENT LUMINAIRE				
	CEILING MOUNTED LUMINAIRE				
	WALL MOUNTED LUMINAIRE				
	EMERGENCY LUMINAIRE				
	LIGHT POLE WITH LUMINAIRE				

1. PERFORM INSTALLATION IN ACCORDANCE WITH THE CURRENT EDITION OF THE NATIONAL ELECTRICAL CODE (NEC), THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA), AND APPLICABLE DOE ORDERS. EQUIPMENT SHALL BE LISTED BY A NATIONALLY RECOGNIZED TESTING LABORATORY (NRTL).

2. PROVIDE AND MAINTAIN A CLEAR WORKING SPACE ABOUT ELECTRIC EQUIPMENT (SWITCHBOARDS,PANELBOARDS, ETC.) IN ACCORDANCE WITH NEC ARTICLES 110.26 AND 110.34.

3. USE 600 VAC CIRCUIT BREAKERS IN 480V AND 480Y/277V SWITCHBOARDS, PANELBOARDS AND MOTOR CONTROL CENTERS.

4. PROVIDE CIRCUIT BREAKERS WITH UL LISTED INTERRUPTING RATING (RMS SYMMETRICAL AMPERES) GREATER THAN THE AVAILABLE FAULT CURRENT SHOWN ON THE ELECTRICAL ONE-LINE DIAGRAM.

5. PROVIDE PADLOCKING PROVISIONS FOR EACH TWO- AND THREE-POLE CIRCUIT BREAKER.

6. BOND RACEWAYS AND THE FRAMES AND ENCLOSURES OF MOTORS, BREAKERS, SWITCHES, AND OTHER ELECTRICAL EQUIPMENT TO THE BUILDING GROUNDING SYSTEM. INSTALL AN INSULATED EQUIPMENT GROUND CONDUCTOR IN EACH RACEWAY OR CONDUIT. SIZE EQUIPMENT GROUND CONDUCTOR IN ACCORDANCE WITH NEC TABLE 250.122.

7. IDENTIFY NEW BRANCH CIRCUITS AT THE PANEL AND AT THE LOAD OUTLET, RECEPTACLE AND SWITCH. IDENTIFY THE PURPOSE OF INDIVIDUAL CIRCUIT BREAKERS, SAFETY SWITCHES AND MOTOR STARTERS BY MEANS OF NAMEPLATES AS INDICATED.

8. ROUTE CONDUITS TO SUIT EQUIPMENT AND BUILDING STRUCTURE. LIMIT THE USE OF ELECTRICAL METALLIC TUBING (EMT) TO AREAS WHERE IT WILL NOT BE SUBJECT TO PHYSICAL DAMAGE OR CORROSION. USE INTERMEDIATE METAL CONDUIT (IMC) OR RIGID GALVANIZED STEEL CONDUIT (RGS) FOR WORK EMBEDDED IN CONCRETE OR EXPOSED TO PHYSICAL DAMAGE. USE MINIMUM 3/4 INCH CONDUIT EXCEPT AS FOLLOWS: 1/2" CONDUIT MAY BE USED FOR 20 AMP GENERAL LIGHT AND POWER CIRCUITS AND FOR CONTROL CIRCUITS; 3/8" FLEXIBLE METAL CONDUIT MAY BE USED TO CONNECT LIGHT FIXTURES IN SUSPENDED CEILINGS. USE LIQUID-TIGHT FLEXIBLE METAL CONDUIT FOR FLEXIBLE CONNECTIONS TO EQUIPMENT IN MECHANICAL ROOMS OR OUTDOORS.

9. SEAL AROUND CONDUIT PENETRATIONS THROUGH INTERIOR WALLS AND FLOORS SEPARATING AREAS TO RESTORE ORIGINAL FIRE RATING; USE A UL CLASSIFIED FIRE SEALANT. SEAL PENETRATIONS THROUGH ROOF AND EXTERIOR WALLS TO MAKE WATERPROOF. REQUEST INSPECTION OF FIRE SEALS BY ELECTRICAL INSPECTOR FROM AUTHORITY HAVING JURISDICTION BEFORE AND AFTER PLACEMENT OF FIRE SEAL MATERIALS.

10. USE 12 AWG OR LARGER CONDUCTORS FOR POWER WIRING. USE 14 AWG STRANDED CONDUCTORS FOR CONTROL WIRING UNLESS OTHERWISE SPECIFIED OR SHOWN ON THE DRAWINGS.

11. USE ONLY COPPER CONDUCTORS ON CIRCUITS 600V AND LESS. CONDUCTORS 10 AWG AND SMALLER SHALL BE SOLID AND 8 AWG AND LARGER AWG SHALL BE STRANDED. PROVIDE TYPE THHN/THWN WIRE INSULATION; XHHW INSULATION MAY BE USED FOR 1 AWG AND LARGER.

12. USE THE FOLLOWING CONDUCTOR COLOR CODES:

	208Y/120 VOLT	480Y/277 VOLT
PHASE A	BLACK	BROWN
PHASE B	RED	ORANGE
PHASE C	BLUE	YELLOW
NEUTRAL	WHITE	GRAY
EQUIP. GROUND	GREEN	GREEN

ISOLATED GROUND SHALL BE GREEN WITH YELLOW TRACER.

13. ARRANGE CONNECTIONS FOR SINGLE PHASE CIRCUITS TO ACHIEVE THREE PHASE LOAD BALANCE WITHIN 20% OF THE AVERAGE PHASE LOAD CURRENT. UNGROUNDED CONDUCTORS USING A COMMON NEUTRAL MUST ORIGINATE FROM DIFFERENT PHASES.

14. INSTALL OUTDOOR EQUIPMENT TO BE WEATHERPROOF AND TO EXCLUDE BIRDS AND RODENTS WITH MAXIMUM 1/2" DIAMETER UNPROTECTED OPENINGS IN ENCLOSURES.

15. PROVIDE LIGHTNING PROTECTION IN ACCORDANCE WITH NFPA 780. PROVIDE MATERIAL THAT IS UL LABELED FOR LIGHTNING PROTECTION SERVICE. THE LIGHTNING PROTECTION SYSTEM DESIGN AND INSTALLATION SHALL FOLLOW THAT SHOWN ON THE DRAWINGS.

16. TEST CONDUCTORS FOR CONTINUITY AND FREEDOM FROM SHORTS AND UNINTENTIONAL GROUNDS.

17. ELECTRICAL EQUIPMENT SPECIFIED IN THIS DOCUMENT SHALL BE ACCEPTANCE TESTED AND INSPECTED IN ACCORDANCE WITH UL.

18. ELECTRICAL MATERIALS AND CONSTRUCTION SHALL CONFORM TO OWNERS/PROJECT MANAGERS STANDARD CONSTRUCTION SPECIFICATIONS WHERE APPLICABLE.

19. DISPOSE OF ITEMS REMOVED AS DIRECTED BY THE OWNER/PROJECT CONSTRUCTION INSPECTOR.

20. REPAIR AREAS DAMAGED DURING CONSTRUCTION TO MATCH ADJACENT AREAS WITH RESPECT TO BOTH COLOR AND FINISH.

21. KEEP JOB SITE IN AN ORDERLY CONDITION AND AT PROJECT COMPLETION, REMOVE ALL WASTE. LEAVE THE JOB SITE IN A CONDITION ACCEPTABLE TO THE OWNER/PROJECT CONSTRUCTION INSPECTOR.

22. IF A CONFLICT ARISES BETWEEN THE FIELD CONDITIONS AND THESE GENERAL ELECTRICAL REQUIREMENTS, CONTACT THE OWNER/PROJECT LEADER FOR DIRECTIONS.

23. TIE-INS TO EXISTING POWER SYSTEMS WILL BE PERFORMED BY THE PROJECT SUPPORT SERVICES SUB-CONTRACTOR.

DRAWING NOTES

1. DRAWINGS ARE MEANT TO BE A REPRESENTATION ONLY, DEVICES MAY LOOK DIFFERENT THAN WHAT WE HAVE SHOWN.

2. REFER TO PRODUCT SPECIFICATIONS FOR EXACT DIMENSIONS OF ENCLOSURE, BACK PANEL & ALL DEVICES DRAWN IN THESE DRAWINGS.

NOTING SYMBOLS & DESIGNATIONS


# CORRESPONDS TO A BILL OF MATERIALS #

55 CORRESPONDS TO A KEYED NOTE #

(INDICATES DETAIL DESIGNATION)

TITLE NOTATION & SEE DETAIL SYMBOL


(INDICATES SHEET NUMBER)

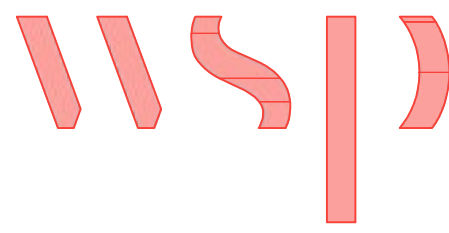

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCIE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324



































































































































**SHEET TITLE:**  
PROCESS FLOW SYMBOLS &  
NOTES PG. 1 - P & ID

T-A02

SHEET NUMBER:	REV. #
T-A02	RCA
SHEET 2 OF 21 SHEETS	



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-A03.dwg

	1	2	3	4	5	6	7	8	9	10	11	12																																																																												
J	SIGNAGE & LABELS KEY			PROCESS FLOW DIAGRAMS AND P&ID SYMBOLS																																																																																				
I				(GENERAL INSTRUMENT OR FUNCTION SYMBOLS) (NOT ALL SYMBOLS & NOTES WILL APPLY TO THIS PROJECT)																																																																																				
H				ACRONYMS	SYMBOL	DESCRIPTION	INSTRUMENT/FUNCTION SYMBOLS																																																																																	
G				<u>EQUIPMENT</u> AHU – AIR HANDLING UNIT ASV – AIR SWITCH VALVE CA – AIR COMPRESSOR CAE – COOLER, AIR EVAPORATIVE D – DAMPER DAD – DESICCANT AIR DRYER DAMD – DUCT AIR MONITOR DEVICE ES – EXHAUST STACK FAB – FILTER AIR BOX FANE – FAN EVALUATOR FAR – FILTER AIR REPLACEABLE FC – FAN CIRCULATING FD – FIRE DAMPER FE – FAN EXHAUST FRA – FAN, RETURN AIR FRL – FILTER AIR ROLL FS – FAN SUPPLY HEPA – HIGH EFFICIENCY PARTICULATE AIR FILTER HX – HEAT EXCHANGER MT – MOISTURE TRAP OIM – OPERATOR INTERFACE MODULE SST – SYSTEM STATIC TOTALIZER TCA – TANK COMPRESSED AIR TK – TANK T – TRAP V – VALVE VFD – VARIABLE FREQUENCY DRIVE/MOTOR CONTROLLER YS – PLC CONTROL OUTPUT	              	P=PURGE OR FLUSHING DEVICE R=RESET FOR LATCH-TYPE ACTUATOR I=UNDEFINED INTERLOCK LOGIC  S=SOLENOID D=DIGITAL P=PILOT T=TRAP M=MAGNETIC FLOWMETER SP=SET POINT  ROOT EXTRACTION BIAS MULTIPLY HIGH SELECTING LOW SELECTING HIGH LIMITING LOW LIMITING PROPORTIONAL REVERSE PROPORTIONAL SUMMING DIVIDING  EQUIPMENT TAG	<table><tr><th>PRIMARY LOCATION NORMALLY ACCESSIBLE TO OPERATOR</th><th>FIELD MOUNTED</th><th>AUXILIARY LOCATION NORMALLY ACCESSIBLE TO OPERATOR</th><th>AUXILIARY LOCATION NORMALLY INACCESSIBLE TO OPERATOR</th></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr></table>						PRIMARY LOCATION NORMALLY ACCESSIBLE TO OPERATOR	FIELD MOUNTED	AUXILIARY LOCATION NORMALLY ACCESSIBLE TO OPERATOR	AUXILIARY LOCATION NORMALLY INACCESSIBLE TO OPERATOR																																																																								
PRIMARY LOCATION NORMALLY ACCESSIBLE TO OPERATOR	FIELD MOUNTED	AUXILIARY LOCATION NORMALLY ACCESSIBLE TO OPERATOR	AUXILIARY LOCATION NORMALLY INACCESSIBLE TO OPERATOR																																																																																					
																																																																																								
																																																																																								
																																																																																								
																																																																																								
F				<u>MINOR EQUIPMENT</u>  <u>OPEN DRAIN ANNOTATIONS</u> RD – RADIOACTIVE DRAIN TO DRAIN HEADER ND – NONRADIOACTIVE DRAIN AW – ACID WASTE NW – NORMAL WASTE OW – OIL WASTE SW – SANITARY WASTE	    	PIPE OR WIRE IS CONTINUED ON DRAWING X (INCLUDING SHEET NUMBER), GRID COORDINATE (Y-#); FLOW IS TO THAT DRAWING.  PIPE OR WIRE IS CONTINUED ON DRAWING X (INCLUDING SHEET NUMBER), GRID COORDINATE (Y-#); FLOW IS FROM THAT DRAWING.  PIPE OR WIRE IS CONTINUED ON DRAWING X (INCLUDING SHEET NUMBER), GRID COORDINATE (Y-#); FLOW IS IN BOTH DIRECTIONS	<table><tr><th>SYMBOL</th><th>DESCRIPTION</th></tr><tr><td></td><td>FLOW INDICATOR TO BE USED IN CONJUNCTION WITH P016</td></tr><tr><td></td><td>INSTRUMENTS SHARING COMMON HOUSING</td></tr><tr><td></td><td>PANEL MOUNTED PATCHBOARD POINT 12</td></tr></table>						SYMBOL	DESCRIPTION		FLOW INDICATOR TO BE USED IN CONJUNCTION WITH P016		INSTRUMENTS SHARING COMMON HOUSING		PANEL MOUNTED PATCHBOARD POINT 12																																																																				
SYMBOL	DESCRIPTION																																																																																							
	FLOW INDICATOR TO BE USED IN CONJUNCTION WITH P016																																																																																							
	INSTRUMENTS SHARING COMMON HOUSING																																																																																							
	PANEL MOUNTED PATCHBOARD POINT 12																																																																																							
E	LINE TYPES			INSTRUMENTATION IDENTIFICATION																																																																																				
D	<table><tr><th>SYMBOL</th><th>LINE TYPE</th><th>DESCRIPTION</th></tr><tr><td></td><td>CONTINUOUS</td><td>PRIMARY PROCESS FLOW LINE</td></tr><tr><td></td><td>CONTINUOUS</td><td>SECONDARY PROCESS FLOW LINE</td></tr><tr><td></td><td>CONTINUOUS</td><td>INSTRUMENT SUPPLY OR CONNECTION TO PROCESS</td></tr><tr><td></td><td>CONTINUOUS</td><td>UNDEFINED SIGNAL</td></tr><tr><td></td><td>CONTINUOUS</td><td>PNEUMATIC SIGNAL *</td></tr><tr><td></td><td>HIDDENX2</td><td>ELECTRIC SIGNAL</td></tr><tr><td></td><td>CONTINUOUS</td><td>HYDRAULIC SIGNAL</td></tr><tr><td></td><td>CONTINUOUS</td><td>CAPILLARY TUBE</td></tr><tr><td></td><td>CONTINUOUS</td><td>ELECTROMAGNETIC OR SONIC SIGNAL** (GUIDED)</td></tr><tr><td></td><td>CONTINUOUS</td><td>ELECTROMAGNETIC OR SONIC SIGNAL** (NOT GUIDED)</td></tr><tr><td></td><td>CONTINUOUS</td><td>INTERNAL SYSTEM LINK (SOFTWARE OR DATA LINK</td></tr><tr><td></td><td>CONTINUOUS</td><td>MECHANICAL LINK</td></tr><tr><td></td><td>CONTINUOUS</td><td>PNEUMATIC BINARY SIGNAL</td></tr><tr><td></td><td>DASHED2</td><td>ELECTRIC BINARY SIGNAL</td></tr><tr><td></td><td>CONTINUOUS</td><td>ELECTRICAL HEAT TRACING</td></tr><tr><td></td><td>CONTINUOUS/DASHED2</td><td>STEAM HEAT TRACING</td></tr><tr><td></td><td>DASHED2</td><td>BURIED LINES</td></tr><tr><td></td><td>PHANTOM</td><td>EXISTING</td></tr><tr><td></td><td>CENTER</td><td>FP – FLOOR PENETRATION RP – ROOF PENETRATION WP – WALL PENETRATION SB – SYSTEM BREAK</td></tr></table>			SYMBOL	LINE TYPE	DESCRIPTION		CONTINUOUS	PRIMARY PROCESS FLOW LINE		CONTINUOUS	SECONDARY PROCESS FLOW LINE		CONTINUOUS	INSTRUMENT SUPPLY OR CONNECTION TO PROCESS		CONTINUOUS	UNDEFINED SIGNAL		CONTINUOUS	PNEUMATIC SIGNAL *		HIDDENX2	ELECTRIC SIGNAL		CONTINUOUS	HYDRAULIC SIGNAL		CONTINUOUS	CAPILLARY TUBE		CONTINUOUS	ELECTROMAGNETIC OR SONIC SIGNAL** (GUIDED)		CONTINUOUS	ELECTROMAGNETIC OR SONIC SIGNAL** (NOT GUIDED)		CONTINUOUS	INTERNAL SYSTEM LINK (SOFTWARE OR DATA LINK		CONTINUOUS	MECHANICAL LINK		CONTINUOUS	PNEUMATIC BINARY SIGNAL		DASHED2	ELECTRIC BINARY SIGNAL		CONTINUOUS	ELECTRICAL HEAT TRACING		CONTINUOUS/DASHED2	STEAM HEAT TRACING		DASHED2	BURIED LINES		PHANTOM	EXISTING		CENTER	FP – FLOOR PENETRATION RP – ROOF PENETRATION WP – WALL PENETRATION SB – SYSTEM BREAK	<table><tr><th colspan="4">TABLE</th></tr><tr><td>J-3</td><td>J-9</td><td>J-4</td><td>J-1</td></tr><tr><td>J-7</td><td>J-2</td><td>J-8</td><td>J-2A</td></tr><tr><td>J-6</td><td>J-5</td><td></td><td></td></tr></table> <u>NOTE:</u> INSTRUMENTATION FUNCTION IDENTIFIERS (J-1) AND FUNCTION SYMBOLS PER ANSI/ISA 55.1.									TABLE				J-3	J-9	J-4	J-1	J-7	J-2	J-8	J-2A	J-6	J-5		
SYMBOL	LINE TYPE	DESCRIPTION																																																																																						
	CONTINUOUS	PRIMARY PROCESS FLOW LINE																																																																																						
	CONTINUOUS	SECONDARY PROCESS FLOW LINE																																																																																						
	CONTINUOUS	INSTRUMENT SUPPLY OR CONNECTION TO PROCESS																																																																																						
	CONTINUOUS	UNDEFINED SIGNAL																																																																																						
	CONTINUOUS	PNEUMATIC SIGNAL *																																																																																						
	HIDDENX2	ELECTRIC SIGNAL																																																																																						
	CONTINUOUS	HYDRAULIC SIGNAL																																																																																						
	CONTINUOUS	CAPILLARY TUBE																																																																																						
	CONTINUOUS	ELECTROMAGNETIC OR SONIC SIGNAL** (GUIDED)																																																																																						
	CONTINUOUS	ELECTROMAGNETIC OR SONIC SIGNAL** (NOT GUIDED)																																																																																						
	CONTINUOUS	INTERNAL SYSTEM LINK (SOFTWARE OR DATA LINK																																																																																						
	CONTINUOUS	MECHANICAL LINK																																																																																						
	CONTINUOUS	PNEUMATIC BINARY SIGNAL																																																																																						
	DASHED2	ELECTRIC BINARY SIGNAL																																																																																						
	CONTINUOUS	ELECTRICAL HEAT TRACING																																																																																						
	CONTINUOUS/DASHED2	STEAM HEAT TRACING																																																																																						
	DASHED2	BURIED LINES																																																																																						
	PHANTOM	EXISTING																																																																																						
	CENTER	FP – FLOOR PENETRATION RP – ROOF PENETRATION WP – WALL PENETRATION SB – SYSTEM BREAK																																																																																						
TABLE																																																																																								
J-3	J-9	J-4	J-1																																																																																					
J-7	J-2	J-8	J-2A																																																																																					
J-6	J-5																																																																																							
C				GENERAL NOTES																																																																																				
B				xx																																																																																				
A																																																																																								



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-A04.dwg

PROCESS FLOW DIAGRAMS AND P&ID SYMBOLS (GENERAL INSTRUMENT OR FUNCTION SYMBOLS)												(NOT ALL SYMBOLS & NOTES WILL APPLY TO THIS PROJECT)																									
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	GENERAL NOTES																											
	ANGLE VALVE		RUPTURE DISK OR SAFETY HEAD FOR PRESSURE RELIEF		IN-LINE FILTER		AXIAL FAN		SINGLE DUCT VARIABLE VOLUME BOX	XX																											
	BUTTERFLY VALVE		PILOT LIGHT X=COLOR R=RED G=GREEN		ATMOSPHERIC FILTER		AXIAL FAN WITH VARIABLE INLET VANES		WING TYPE FACE AND BYPASS DAMPER																												
	ROTARY VALVE		FLEX CONNECTION (RUBBER)		DOUBLE BASKET STRAINER		2-STAGE RECIPROCATING AIR COMPRESSOR		HW HEATING WATER DX DIRECT EXPANSION CH CHILLED WATER STM STEAM	(A)																											
	3-WAY VALVE		FLEX CONNECTION (STEEL BRAIDED)		HOSE REEL		SINGLE STAGE RECIPROCATING AIR COMPRESSOR		HCL HEATING COIL CCL COOLING COIL																												
	4-WAY VALVE		SINGLE PITOT TUBE OR PITOT VENTURI TUBE		OPEN DRAIN (SHOWN)		COLLECTION BIN		CYCLONE SEPARATOR	(B)																											
	OS & Y VALVE		FLOW METER	XX	XX- DRAIN SYSTEM ANNOTATIONS DRAIN (PLAN VIEW)		FLUID RECOVERY PUMP		DUAL SERVICE HEAT EXCHANGER																												
	DIAPHRAGM VALVE		FLOW NOZZLE OR VENTURI		CLEANOUT (PLAN VIEW)		MULTI BLADE DAMPER		SINGLE BLADE DAMPER	MOTOR																											
	PRESSURE RELIEF		REDUCER		SANITARY VENT		TEST PORT		PILOT LIGHT																												
	DIAPHRAGM ACTUATOR		SCREWED CAP		SILENCER/MUFFLER		SEPARATOR		MIST ELIMINATOR	HEPA FILTER																											
	TWO-WAY VALVE, FAIL CLOSED		PIPE CAP		SPACE PENETRATIONS		CARBON ABSORBER FILTER		FILTER																												
	TWO-WAY VALVE, FAIL OPEN		HOSE CONNECTION		FIXED LOUVERS		SUCTION DIFFUSER																														
	3-WAY VALVE W/DIAPHRAM ACTUATOR		FLANGED CONNECTION (PIPING OR EQUIP)		TRAP XX ANNOTATES FUNCTION																																
	4-WAY VALVE W/DIAPHRAM ACTUATOR		FLOW ORIFICE FIXED		LUBRICATOR																																
	SPRING-OPPOSED SINGLE-ACTING ACTUATOR		STRAINER WITH VALVE		55 GALLON DRUM																																
	SPRING-OPPOSED DOUBLE-ACTING ACTUATOR		Y-STRAINER		THERMOSTATIC VENT																																
	ELECTROHYDRAULIC ACTUATOR		COMPRESSED AIR		SPRINKLER ALARM (WATER MOTOR GONG)																																
	HAND ACTUATOR OR HANDWHEEL		DUCTED AIR FLOW FROM SPACE		FLOW ALARM VALVE																																
	RESTRICTION ORIFICE IN PROCESS LINE		CAPPED AIR DUCT		COOLING TOWER																																
	RESTRICTION ORIFICE DRILLED IN VALVE		GATE VALVE (OPEN)		CHILLER																																
	FLOW STRAIGHTENING VANE		GATE VALVE (CLOSED)		HORIZONTAL CENTRIFUGAL PUMP																																
	DIAPHRAGM PRESSURE-BALANCED		GLOBE VALVE (OPEN)		CENTRIFUGAL FAN WITH VARIABLE INLET VANES																																
	PRESSURE-REDUCING REGULATOR, SELF-CONTAINED, WITH HANDWHEEL ADJUSTABLE SET POINT		GLOBE VALVE (CLOSED)		BLOWER/CENTRIFUGAL FAN																																
	PRESSURE-REDUCING REGULATOR WITH EXTERNAL PRESSURE TAP		NEEDLE VALVE (OPEN)		ROTARY PUMP																																
	DIFFERENTIAL-PRESSURE-REDUCING REGULATOR WITH INTERNAL AND EXTERNAL TAPS		NEEDLE VALVE (CLOSED)		VERTICAL WET PIT PUMP																																
	BACKPRESSURE REGULATOR, SELF-CONTAINED		PLUG VALVE (OPEN)		PROGRESSIVE CAVITY PUMP																																
	BACKPRESSURE REGULATOR WITH EXTERNAL PRESSURE TAP		PLUG VALVE (CLOSED)		VERTICAL SUMP PUMP																																
	PRESSURE-REDUCING REGULATOR WITH INTEGRAL OUTLET PRESSURE RELIEF VALVE, AND OPTIONAL PRESSURE INDICATOR		BALL VALVE (OPEN)		HEATER																																
	PRESSURE INDICATOR		BALL VALVE (CLOSED)		HEAT EXCHANGER																																
	FLOW DIRECTION		ALARM VALVE																																		
	PRESSURE RELIEF OR SAFETY VALVE		AIR INTAKE FILTER																																		
	VACUUM RELIEF VALVE		ALARM																																		
	PRESSURE RELIEF OR SAFETY VALVE, STRAIGHT-THROUGH PATTERN, SPRING- OR WEIGHT-LOADED, OR WITH INTEGRAL PILOT		BUBBLE GAUGE																																		
	RUPTURE DISK OR SAFETY HEAD FOR VACUUM RELIEF																																				

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801

03/21/23

PROJECT:  
TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN

NAVAJO TRIBAL UTILITY  
AUTHORITY  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP


DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
PROCESS FLOW SYMBOLS &  
NOTES PG. 3 - P & ID

T-A04

SHEET NUMBER:	REV. #
T-A04	RCA
SHEET 4 OF 21 SHEETS	

3/21/2023 2:25:29 AM, PDF CREATOR

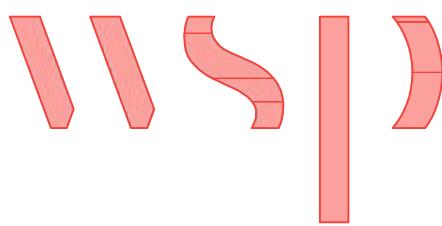

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
PROCESS FLOW SYMBOLS &  
NOTES PG. 3 - P & ID


T-A04

SHEET NUMBER:	REV. #
T-A04	RCA
SHEET 4 OF 21 SHEETS	



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-A05.dwg

	1	2	3	4	5	6	7	8	9	10	11	12										
J	VALVE & INSTRUMENTATION FUNCTION IDENTIFIERS (SELECTED)																					
	FIRST- LETTERS	INDICATING MEASURED OR CONTROLLED VARIABLE	CONTROLLERS			VALVES	READOUT DEVICE		SWITCHES AND * ALARM DEVICES			TRANSMITTERS			SOLENOIDS RELAYS COMPUTING DEVICES	PRIMARY ELEMENT	TEST POINT	WELL OR PROBE	VIEWING DEVICE GLASS	SAFETY DEVICE	FINAL ELEMENT	
I			RECORDING	INDICATING	BLIND		RECORDING	INDICATING			BLIND											
	A	ANALYSIS	ARC	AIC	AC		AR	AI	ASH	ASL	ASHL	ART	AIT	AT	AY	AE	AP	AW			AV	
	B	BURNER/ COMBUSTION	BRC	BIC	BC		BR	BI	BSH	BSL	BSHL	BRT	BIT	BT	BY	BE		BW	BG		BZ	
	C	CONDUCTIVITY		CIC	CC											CE						
	D	USER'S CHOICE																				
H	E	VOLTAGE	ERC	EIC	EC		ER	EI	ESH	ESL	ESHL	ERT	EIT	ET	EY	EE					EZ	
	F	FLOW RATE	FRC	FIC	FC	FCV FICV	FR	FI	FSH	FSL	FSHL	FRT	FIT	FT	FY	FE	FP		FG		FV	
	FQ	FLOW QUANTITY	FQRC	FQIC			FQR	FQI	FQSH	FQSL			FQIT	FQT	FQY	FQE					FQV	
	FF	FLOW RATIO	FFRC	FFIC	FFC		FFR	FFI	FFSH	FFSL						FE					FFV	
	G	USER'S CHOICE																				
	H	HAND		HIC	HC	HV					HS										HV	
	I	CURRENT	IRC	IIC			IR	II	ISH	ISL	ISHL	IRT	IIT	IT	IY	IE					IZ	
	J	POWER	JRC	JIC	ARC		JR	JI	JSH	JSL	JSHL	JRT	JIT	JT	JY	JE					JV	
	K	TIME	KRC	KIC	KC	KCV	KR	KI	KSH	KSL	KSHL	KRT	KIT	KT	KY	KE					KV	
	L	LEVEL	LRC	LIC	LC	LCV	LR	LI	LSH	LSL	LSHL	LRT	LIT	LT	LY	LE		LW	LG		LV	
	M	NOISTURE/ HUMIDITY						MI					MT									
	N	USER'S CHOICE																				
F	O	USER'S CHOICE																				
	P	PRESSURE VACUUM	PRC	PIC	PC	PCV	PR	PI	PSH	PSL	PSHL	PRT	PIT	PT	PY	PE	PTP			PSV PSE	PV	
	PD	PRESSURE DIFFERENTIAL	PDRC	PDIC	PDC	PDCV	PDR	PDI	PDSH	PDSL		PDRT	PDIT	PDT	PDY	PE	PTP				PDV	
	Q	QUALITY	QRC	QIC			QR	QI	QSH	QSL	QSHL	QRT	QIT	QT	QY	QE					QZ	
E	R	RADIATION	RRC	RIC	RC		RR	RI	RSH	RSL	RSHL	RRT	RIT	RT	RY	RE		RW			RZ	
	S	SPEED	SRC	SIC	SC	SCV	SR	SI	SSH	SSL	SSHL	SRT	SIT	ST	SY	SE					SV	
	T	TEMPERATURE	TRC	TIC	TC	TCV	TR	TI	TSH	TSL	TSHL	TRT	TIT	TT	TY	TE	TP	TW		TSE	TV	
	T	TEMPERATURE DIFFERENTIAL	TDRC	TDIC	TDC	TDCV	TDR	TDI	TDSH	TDSL		TDRT	TDIT	TDT	TDY	TDE	TDP TP	TDW TW			TDV	
	U	MULTIVARIABLE					UR	UI							UY						UV	
	V	MACHINERY VIBRATION ANALYSIS					VR	VI	VSH	VSL	VSHL	VRT	VIT	VT	VY	VE					VZ	
D	W	WEIGHT FORCE	WRC	WIC	WC	WCV	WR	WI	WSH	WSL	WSHL	WRT	WIT	WT	WY	WE					WZ	
	WD	WEIGHT FORCE DIFFERENTIAL	WDRC	WDIC	WDC	WDCV	WDR	WDI	WDSH	WDSL		WDRT	WDIT	WDT	WDY	WDE WE					WDZ	
	X	USER'S CHOICE																				
	Y	EVENT STATE PRESENCE		YIC	YC		YR	YI	YSH	YSL				YT	YY	YE					YZ	
C	Z	POSITION DIMENSION	ZRC	ZIC	ZC	ZCV	ZR	ZI	ZSH	ZSL	ZSHL	ZRT	ZIT	ZT	ZY	ZE					ZV	
	ZD	GAUGING DEVIATION	ZDRC	ZDIC	ZDC	ZDCV	ZDR	ZDI	ZDSH	ZDSL		ZDRT	ZDIT	ZDT	ZDY	ZDE					ZDV	
	GENERAL NOTES																					
B	xx																					
	THIS TABLE IS NOT ALL-INCLUSIVE, SEE ANSI/ISA STANDARD ISA-S5.1-1984 (R 1992)																					
	*A, ALARM, THE ANNUNCIATING DEVICE, MAY BE USED IN THE SAME FASHION AS, SWITCH, THE ACTING DEVICE.																					
	** THE LETTERS H AND L MAY BE OMITTED IN THE UNDEFINED CASE.																					
	OTHER POSSIBLE COMBINATIONS:																					
	FO (RESTRICTION ORIFICE) PFR (RATIO)																					
	FRK, HIK (CONTROL STATIONS) KQI (RUNNING TIME INDICATOR)																					
	FX (ACCESSORIES) QQI (INDICATING COUNTER)																					
	TJR (SCANNING RECORDER) WKIC (RATE-OF-WEIGHT-LOSS CONTROLLER)																					
	LLH (PILOT LIGHT) HMS (HAND MOMENTARY SWITCH)																					
A																						
	1	2	3	4	5	6	7	8	9	10	11	12										

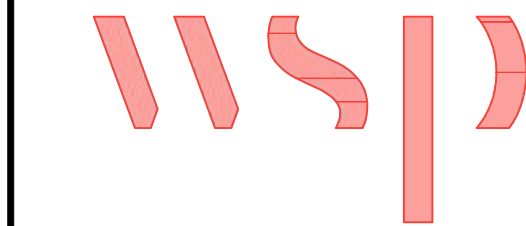

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**

**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCIE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP


DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
PROCESS FLOW SYMBOLS &  
NOTES PG. 4 - P & ID


T-A05

SHEET NUMBER:	REV. #
T-A05	RCA
SHEET 5 OF 21 SHEETS	



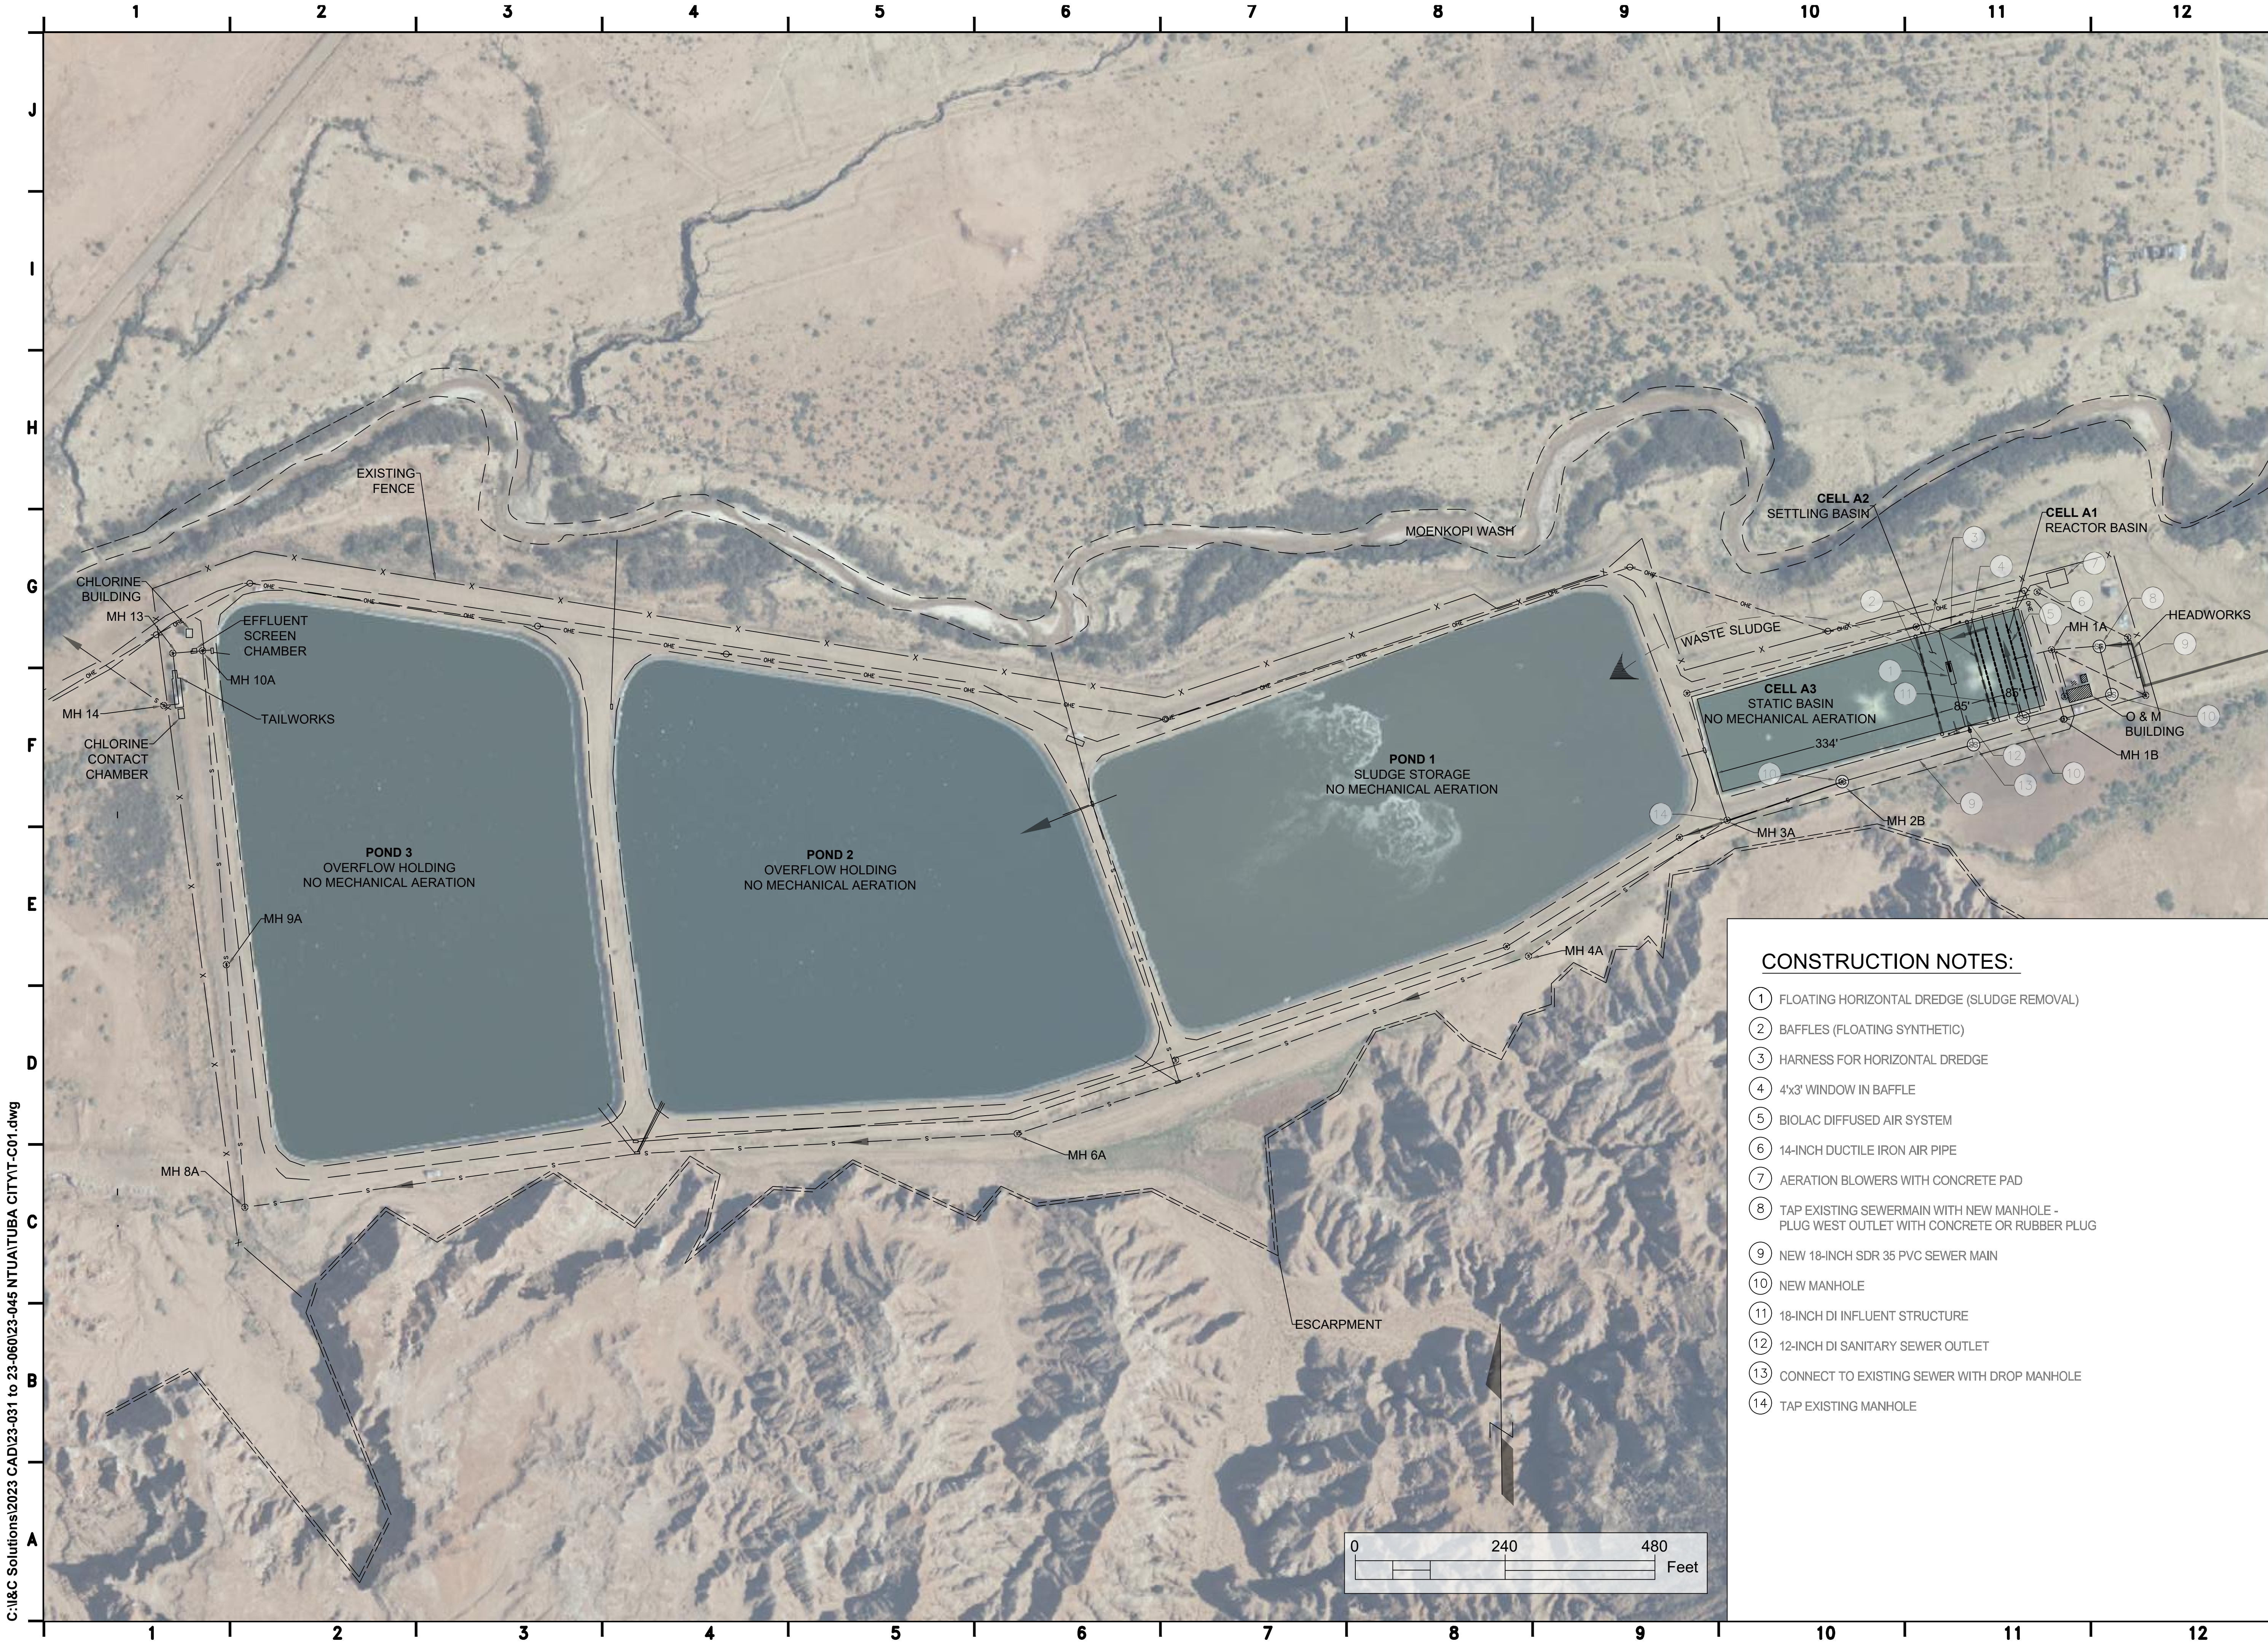


C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-C01.dwg

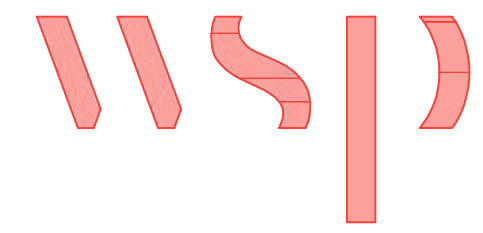

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC, AZ 86504  
WSP PROJECT No:  
2251700010

**CONSTRUCTION NOTES:**

- 1 FLOATING HORIZONTAL DREDGE (SLUDGE REMOVAL)
- 2 BAFFLES (FLOATING SYNTHETIC)
- 3 HARNESS FOR HORIZONTAL DREDGE
- 4 4'x3' WINDOW IN BAFFLE
- 5 BIOLAC DIFFUSED AIR SYSTEM
- 6 14-INCH DUCTILE IRON AIR PIPE
- 7 AERATION BLOWERS WITH CONCRETE PAD
- 8 TAP EXISTING SEWERMAIN WITH NEW MANHOLE - PLUG WEST OUTLET WITH CONCRETE OR RUBBER PLUG
- 9 NEW 18-INCH SDR 35 PVC SEWER MAIN
- 10 NEW MANHOLE
- 11 18-INCH DI INFLUENT STRUCTURE
- 12 12-INCH DI SANITARY SEWER OUTLET
- 13 CONNECT TO EXISTING SEWER WITH DROP MANHOLE
- 14 TAP EXISTING MANHOLE

**REVISIONS**

NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP



DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

**SHEET TITLE:**  
AREA MAP AND  
CONSTRUCTION  
NOTES  
  
T-C01

SHEET NUMBER:	REV. #
T-C01	RCA
SHEET 6 OF 21 SHEETS	



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-C02.dwg

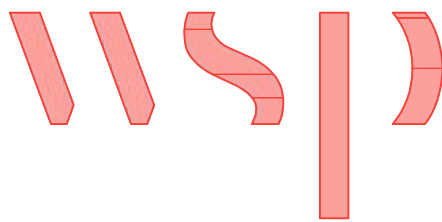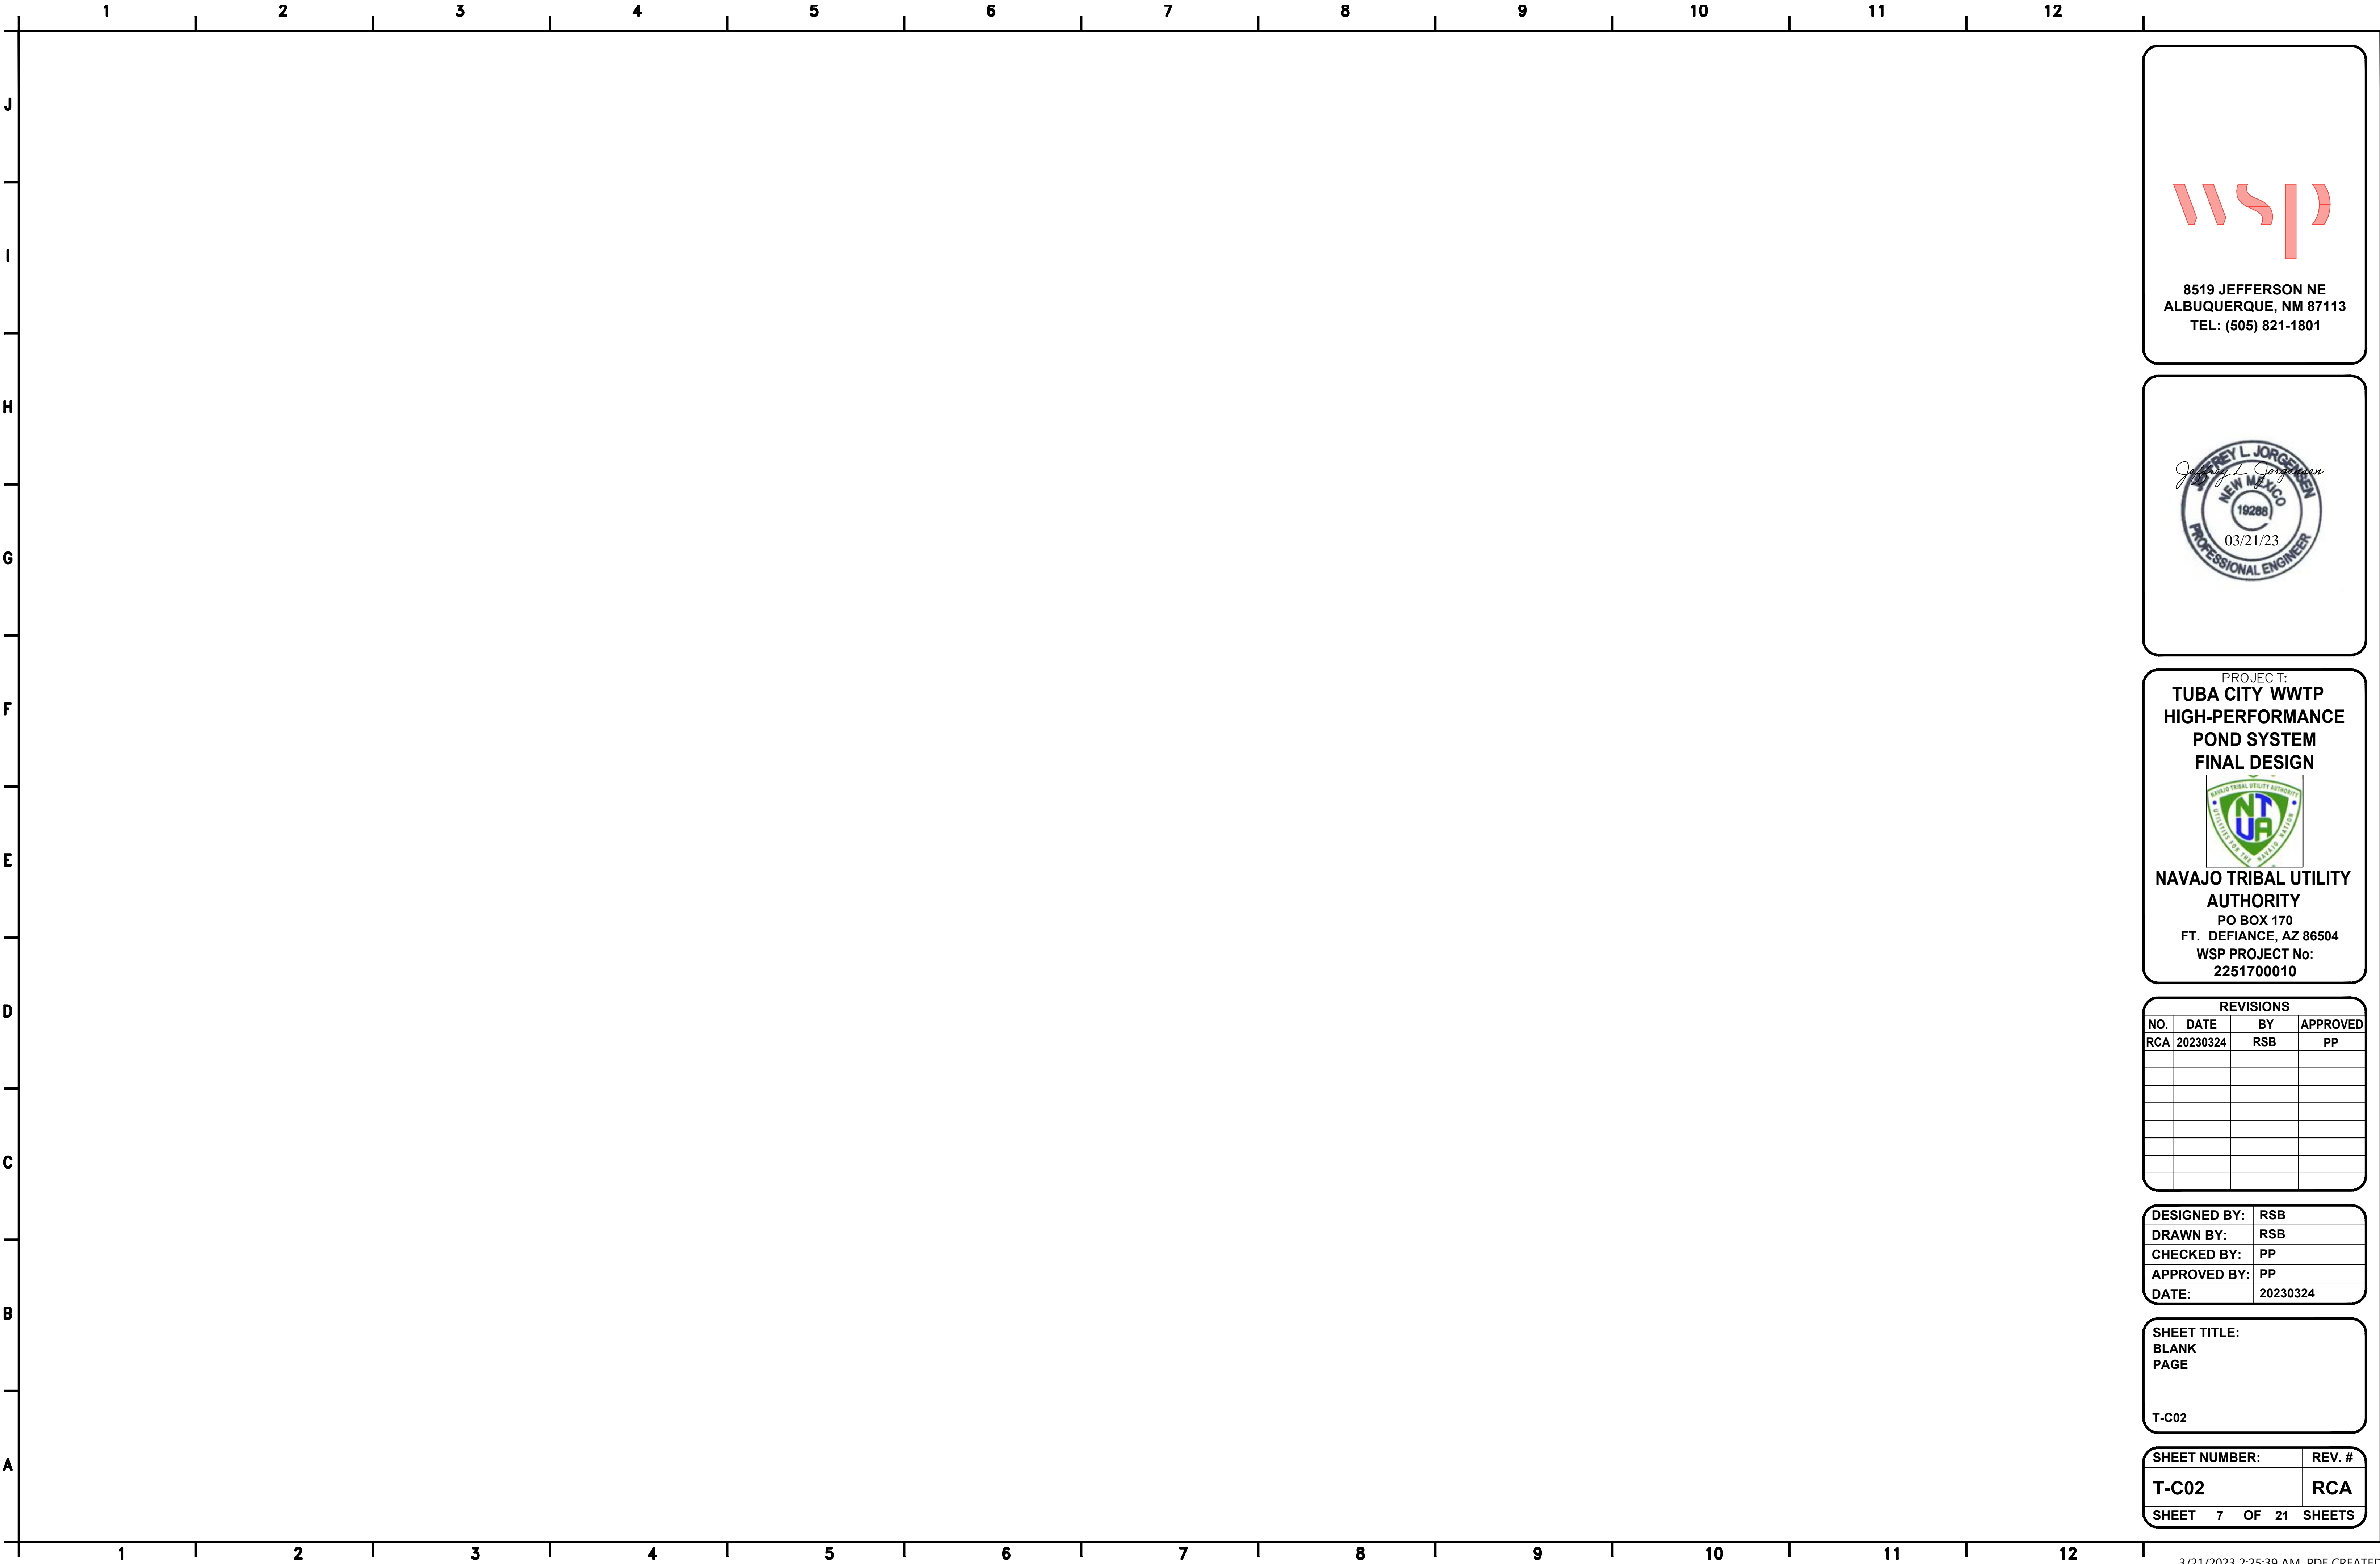

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP



DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
BLANK  
PAGE  
  
T-C02

SHEET NUMBER:	REV. #
T-C02	RCA
SHEET 7 OF 21 SHEETS	



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-D01.dwg

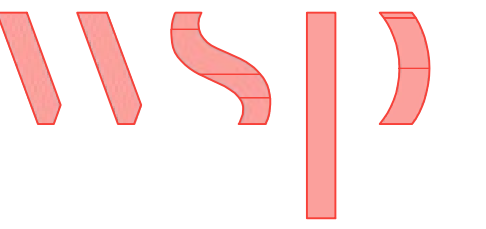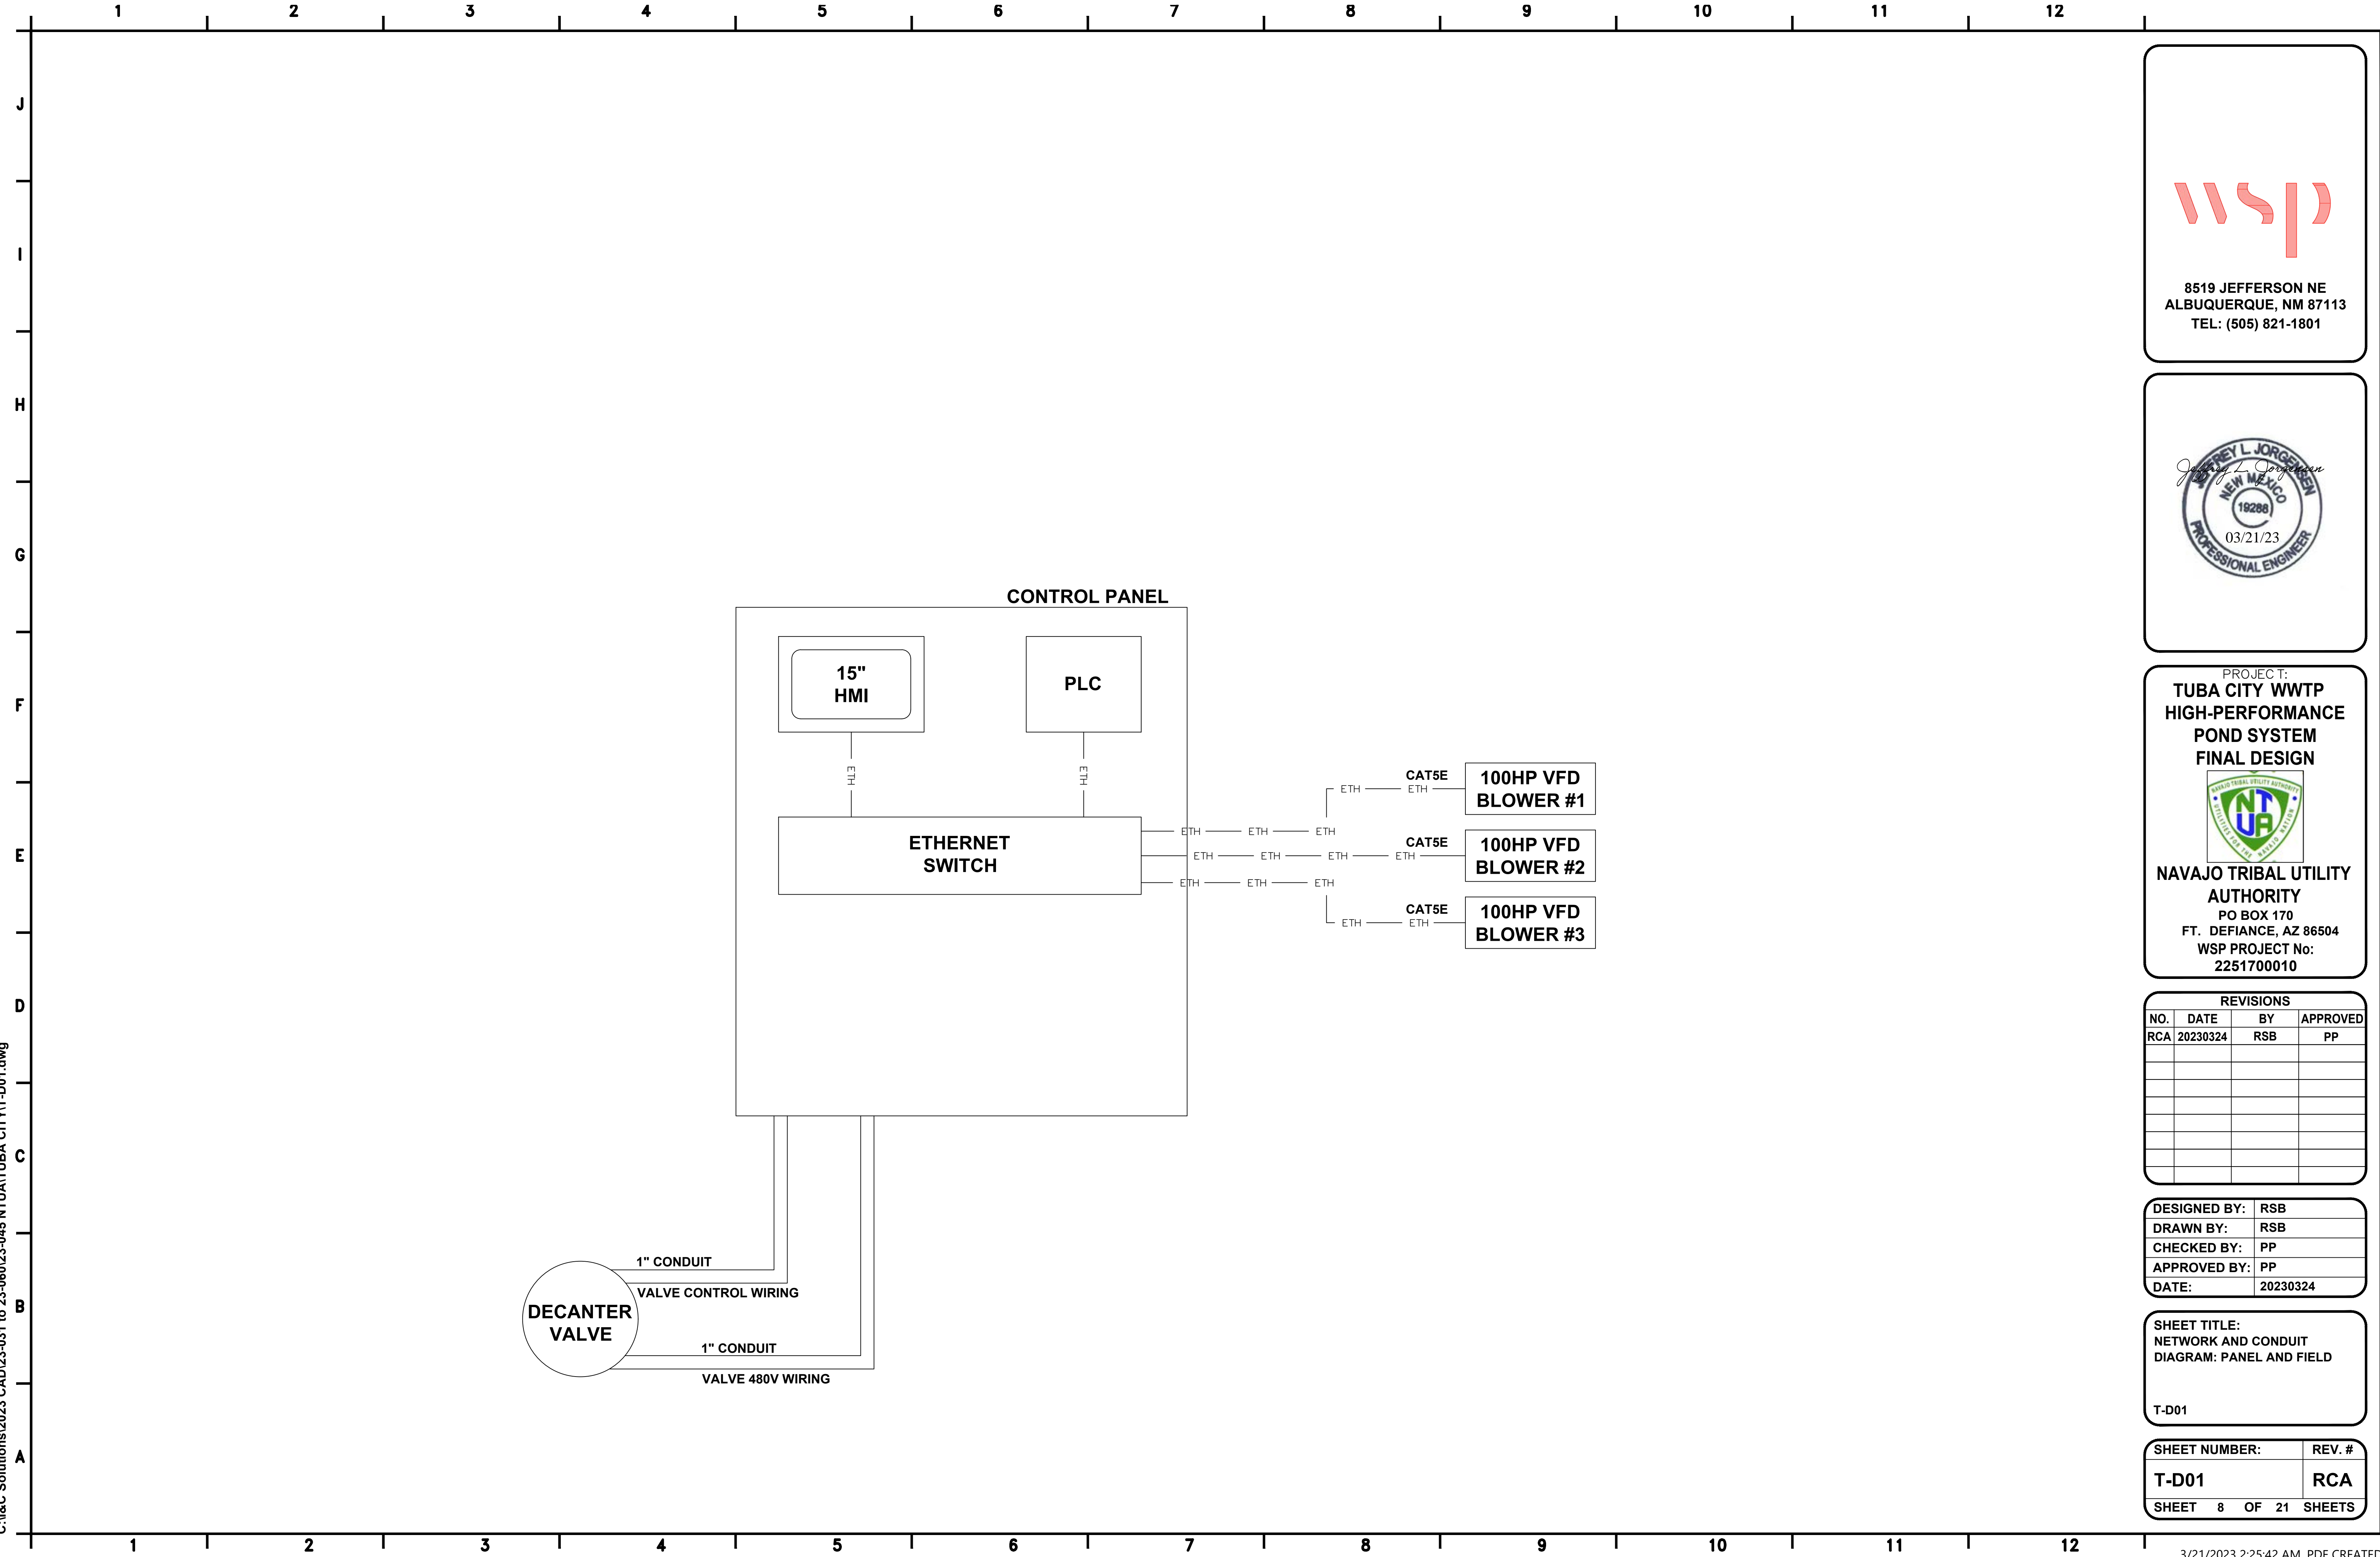

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324



SHEET TITLE:  
NETWORK AND CONDUIT  
DIAGRAM: PANEL AND FIELD

T-D01

SHEET NUMBER:	REV. #
T-D01	RCA
SHEET 8 OF 21 SHEETS	




C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-TUBA CITY-T-E00.dwg

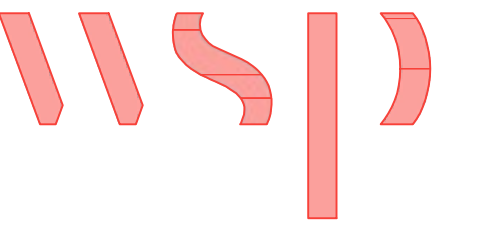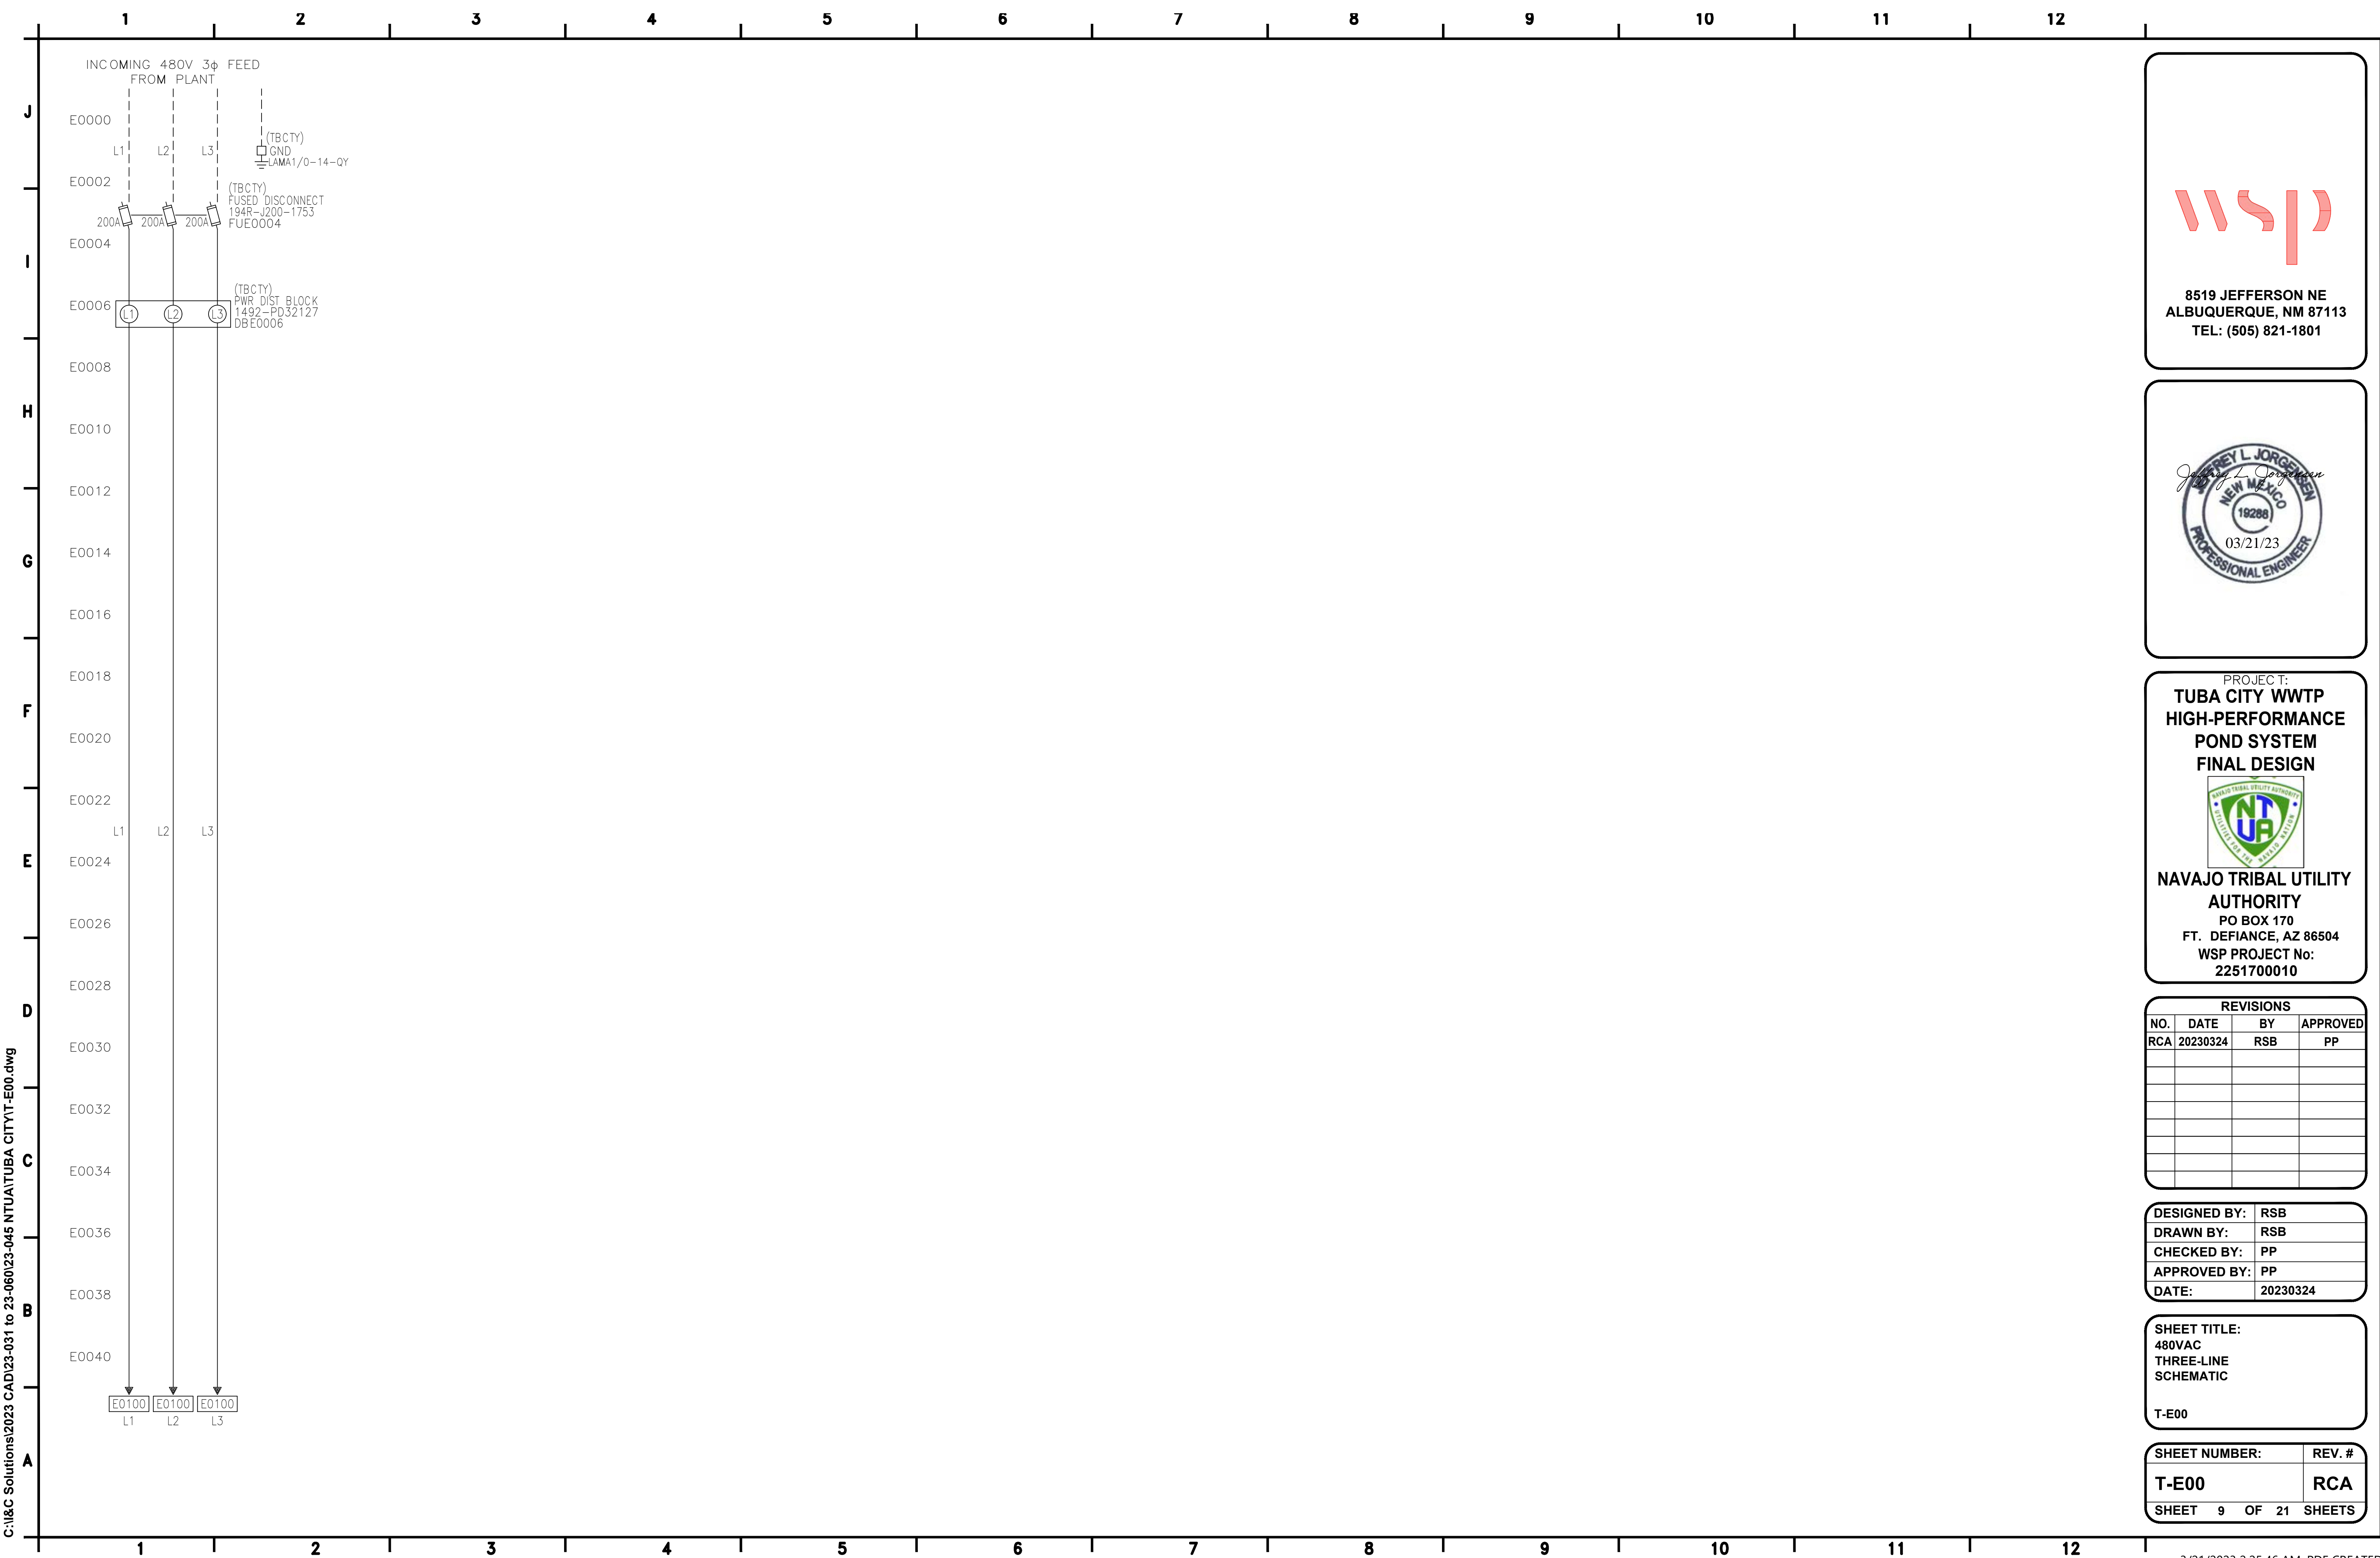

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324



SHEET TITLE:  
480VAC  
THREE-LINE  
SCHEMATIC

T-E00

SHEET NUMBER:	REV. #
T-E00	RCA
SHEET 9 OF 21 SHEETS	



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-E01.dwg

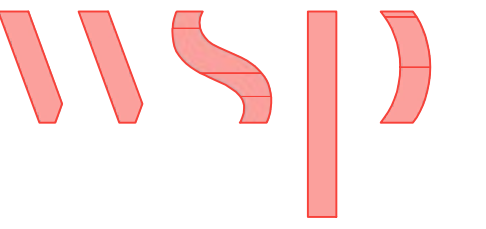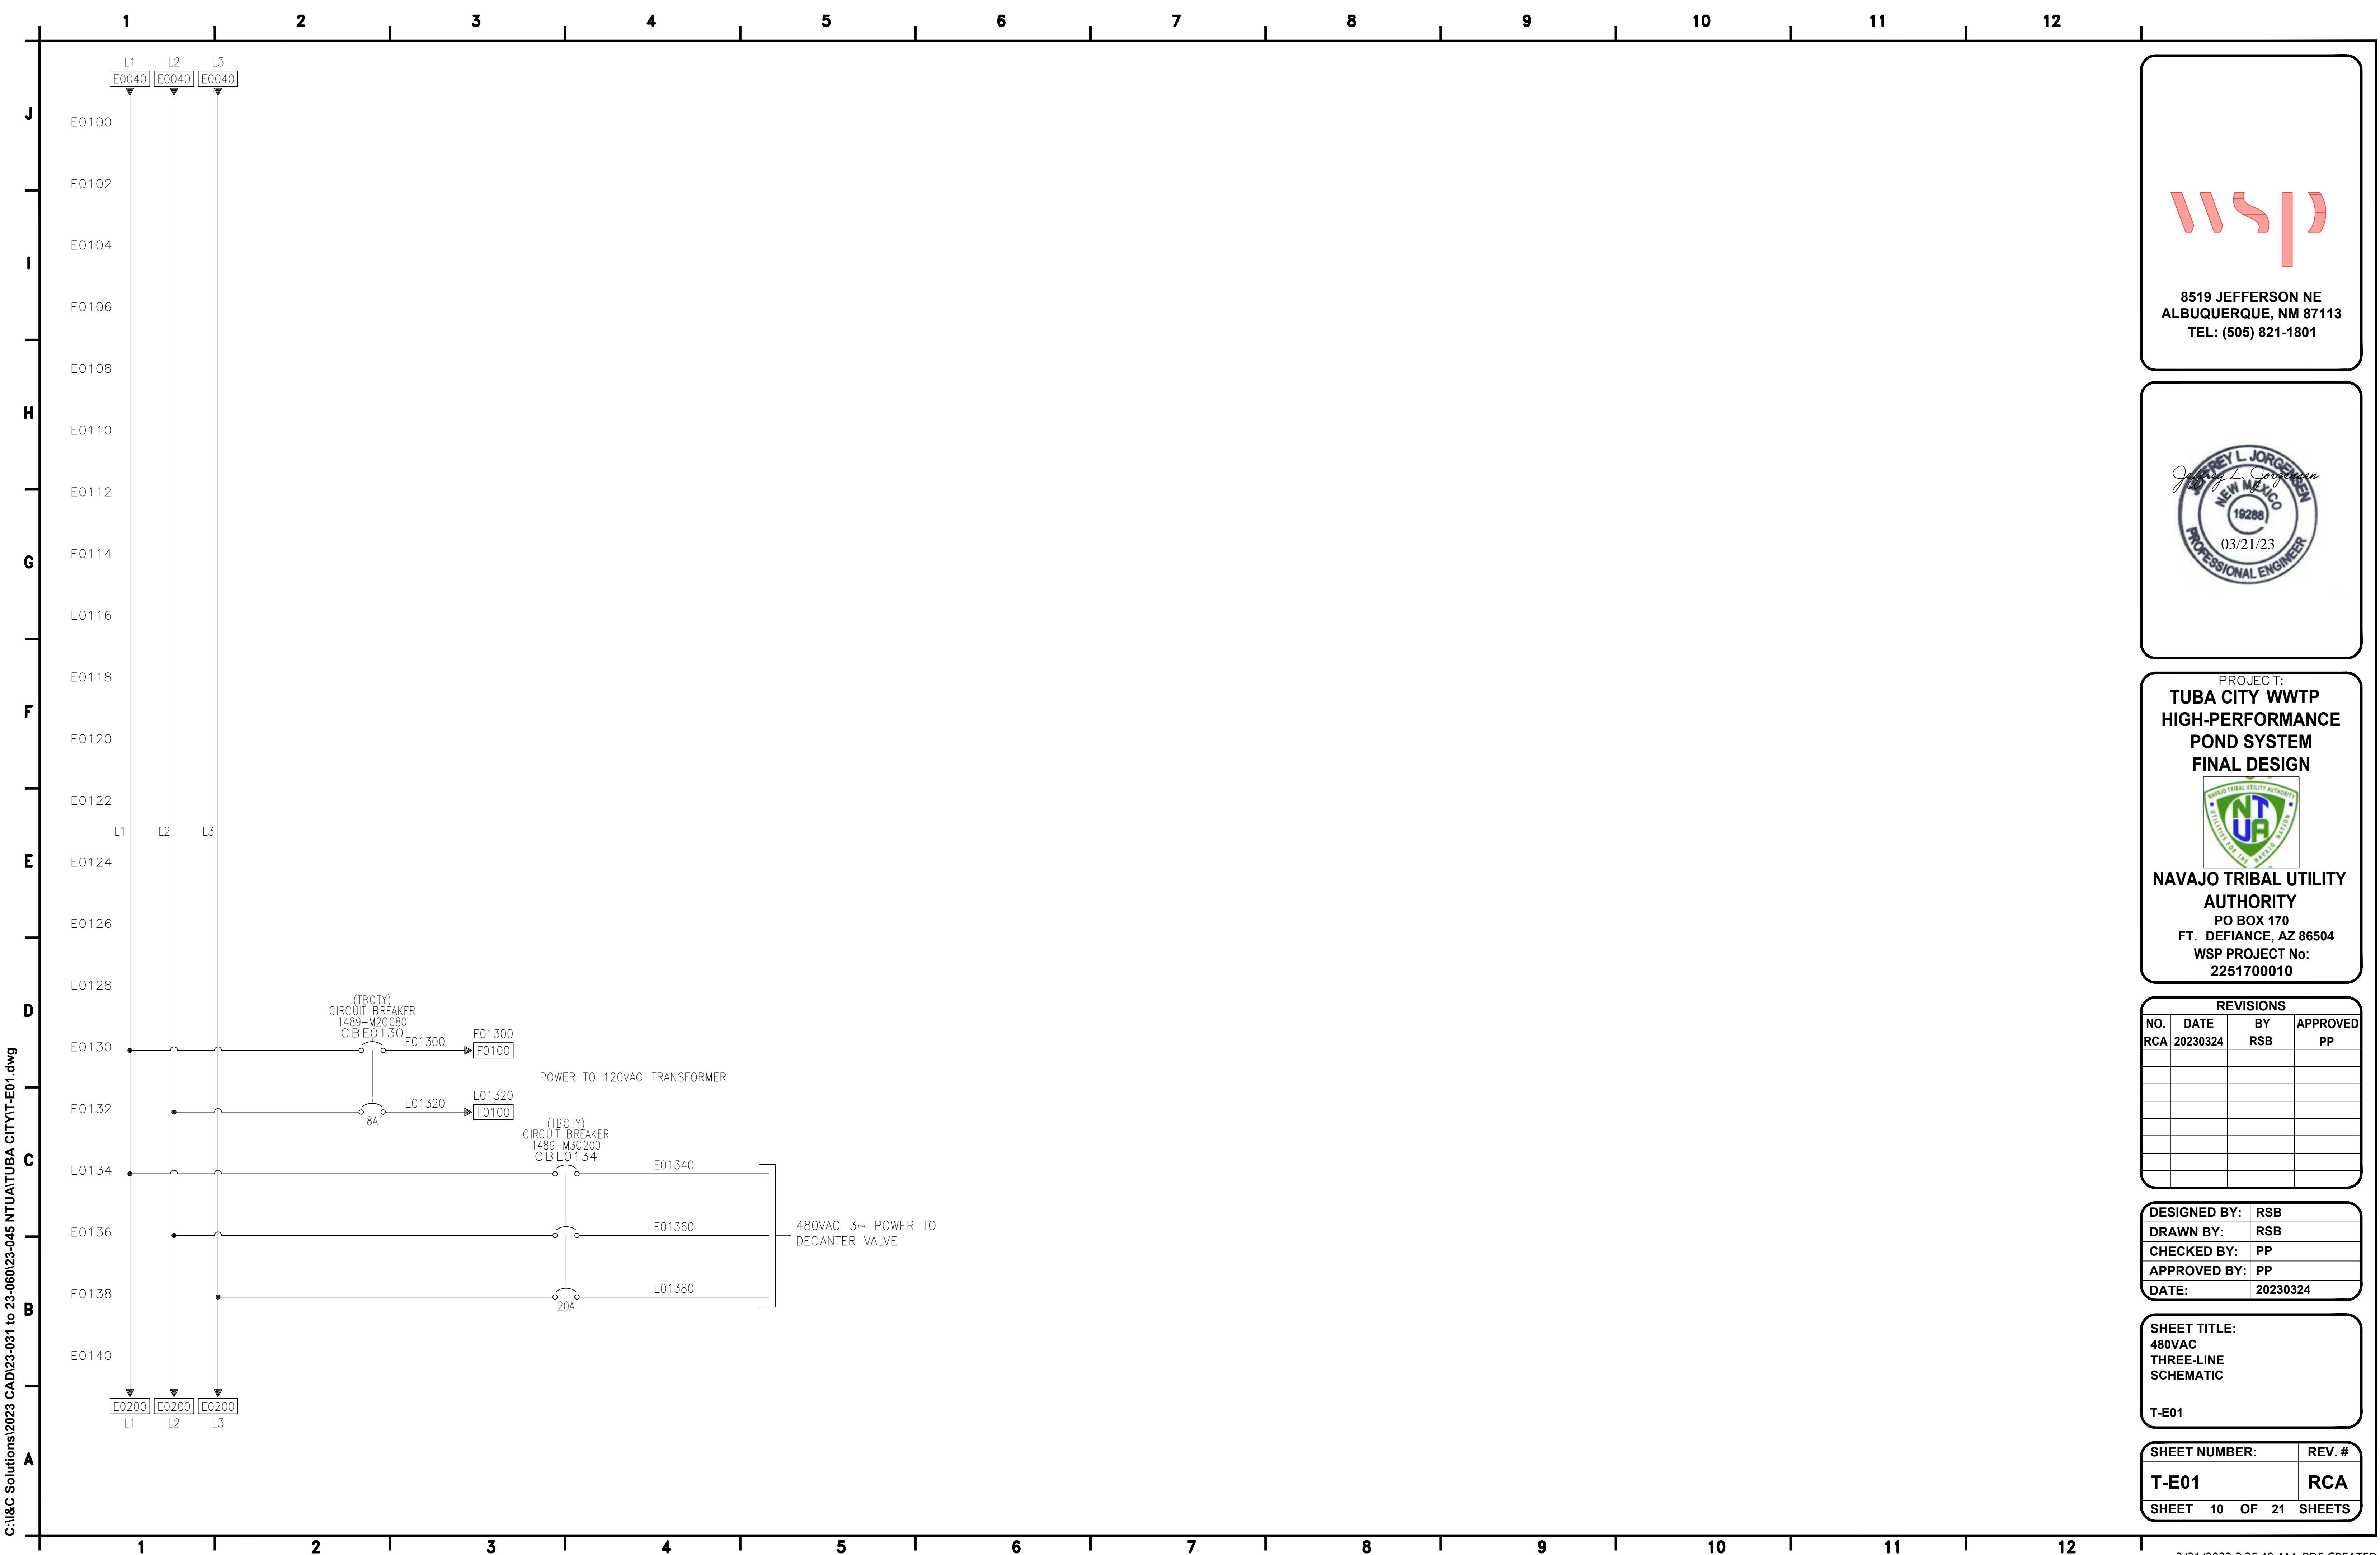

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324



**SHEET TITLE:**  
480VAC  
THREE-LINE  
SCHEMATIC

T-E01

SHEET NUMBER:	REV. #
T-E01	RCA
SHEET 10 OF 21 SHEETS	




C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-E02.dwg

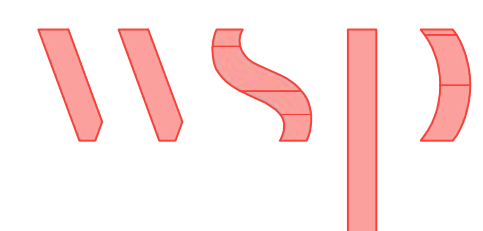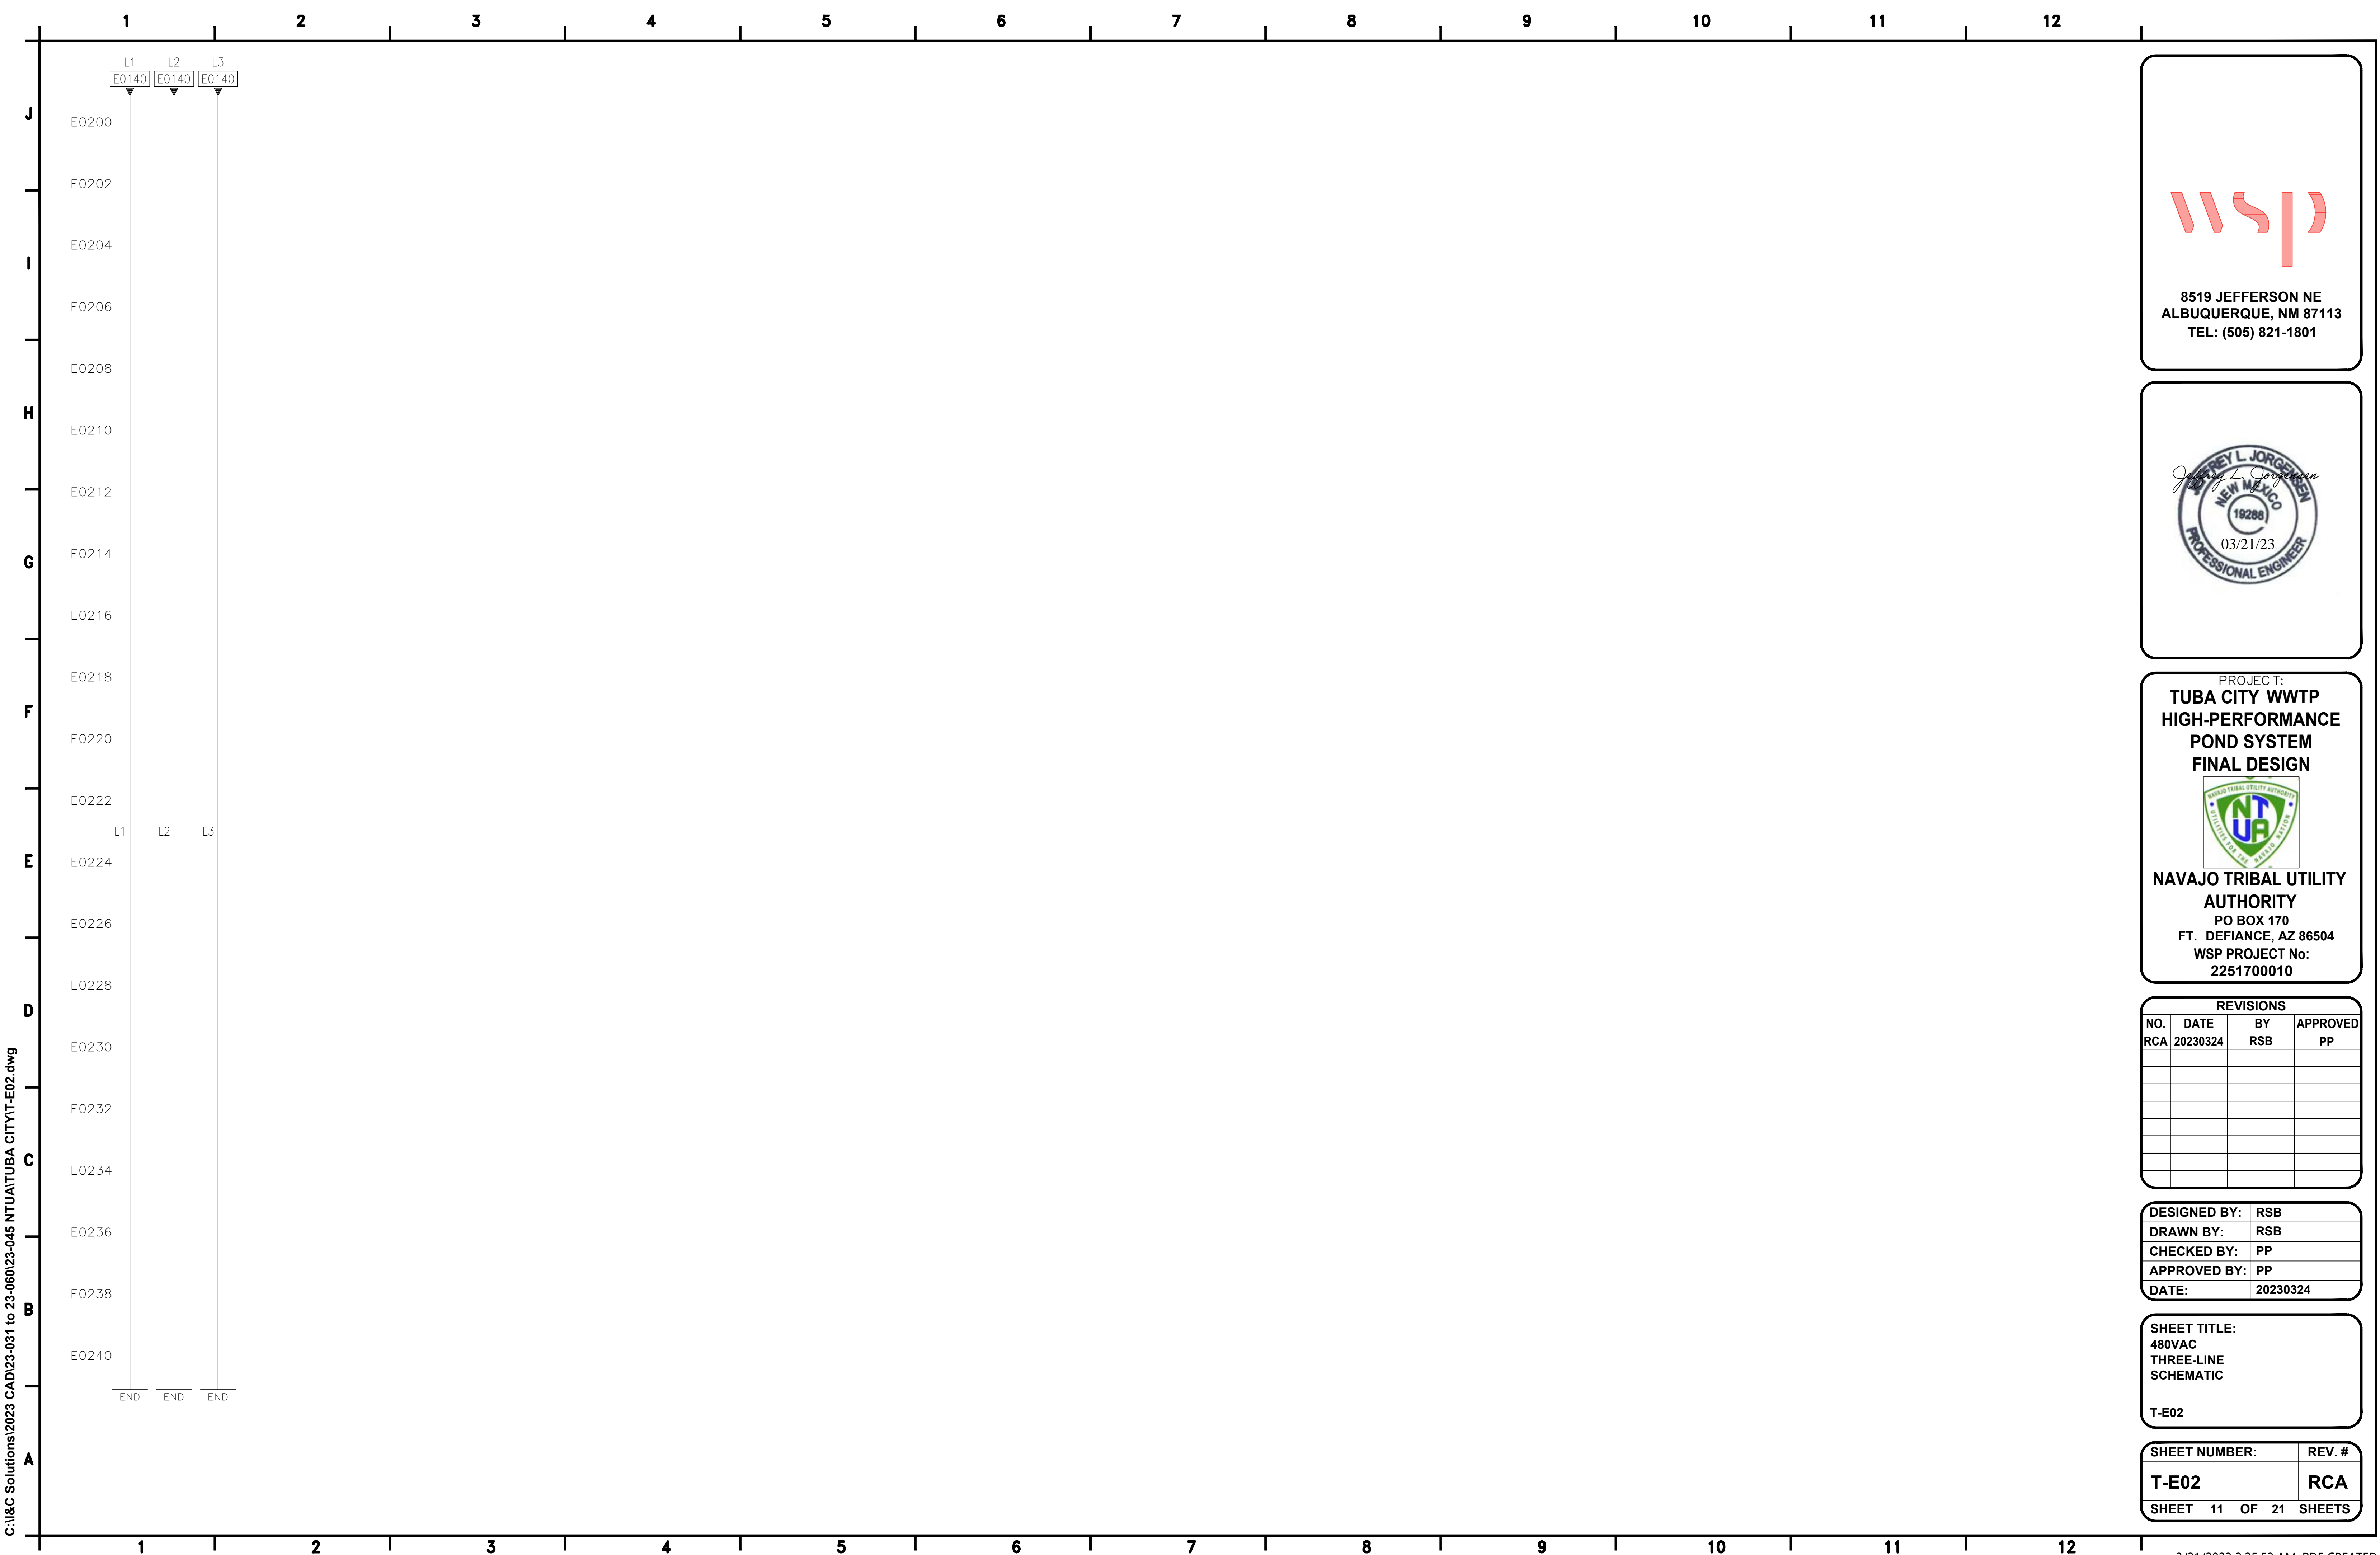

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
480VAC  
THREE-LINE  
SCHEMATIC

T-E02



SHEET NUMBER:	REV. #
T-E02	RCA
SHEET 11 OF 21 SHEETS	







C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-G01.dwg

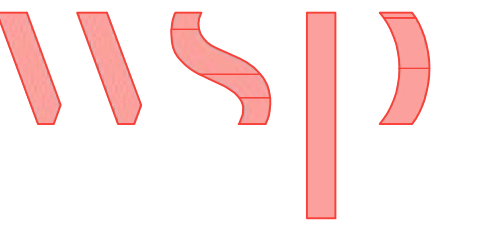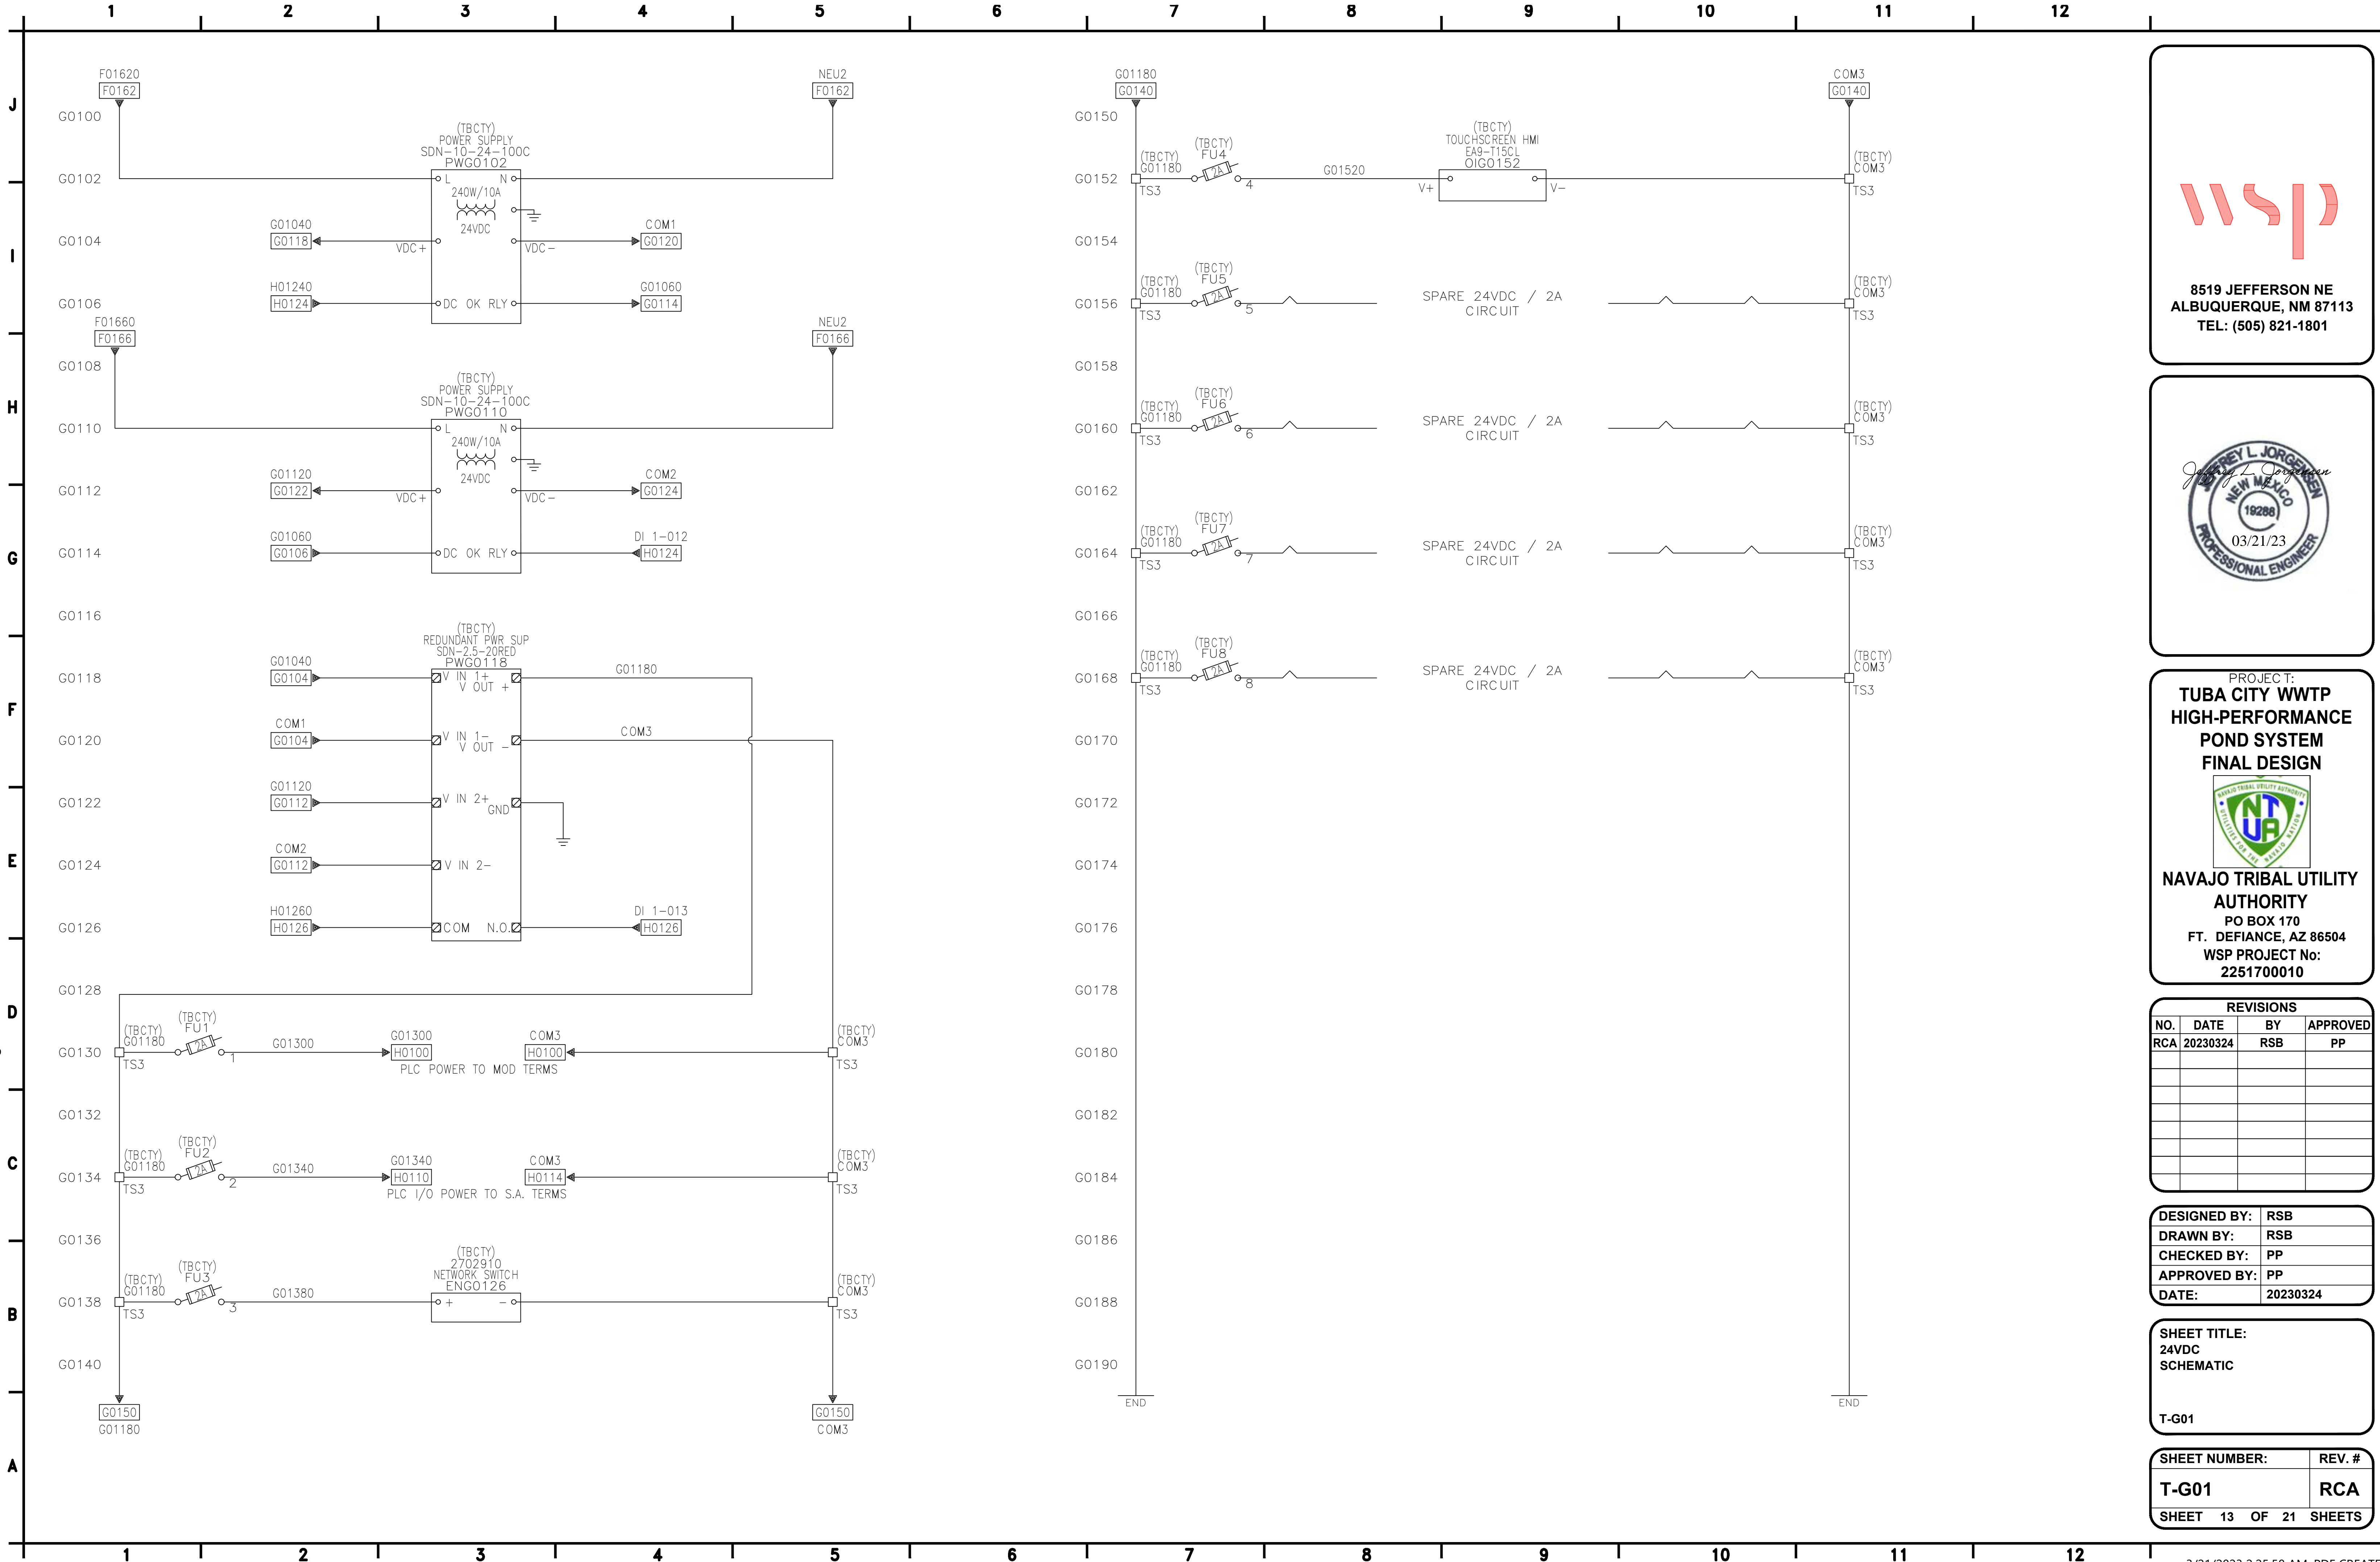

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**

**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324


SHEET TITLE:  
24VDC  
SCHEMATIC

T-G01


SHEET NUMBER:	REV. #
T-G01	RCA
SHEET 13 OF 21 SHEETS	



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-H00.dwg


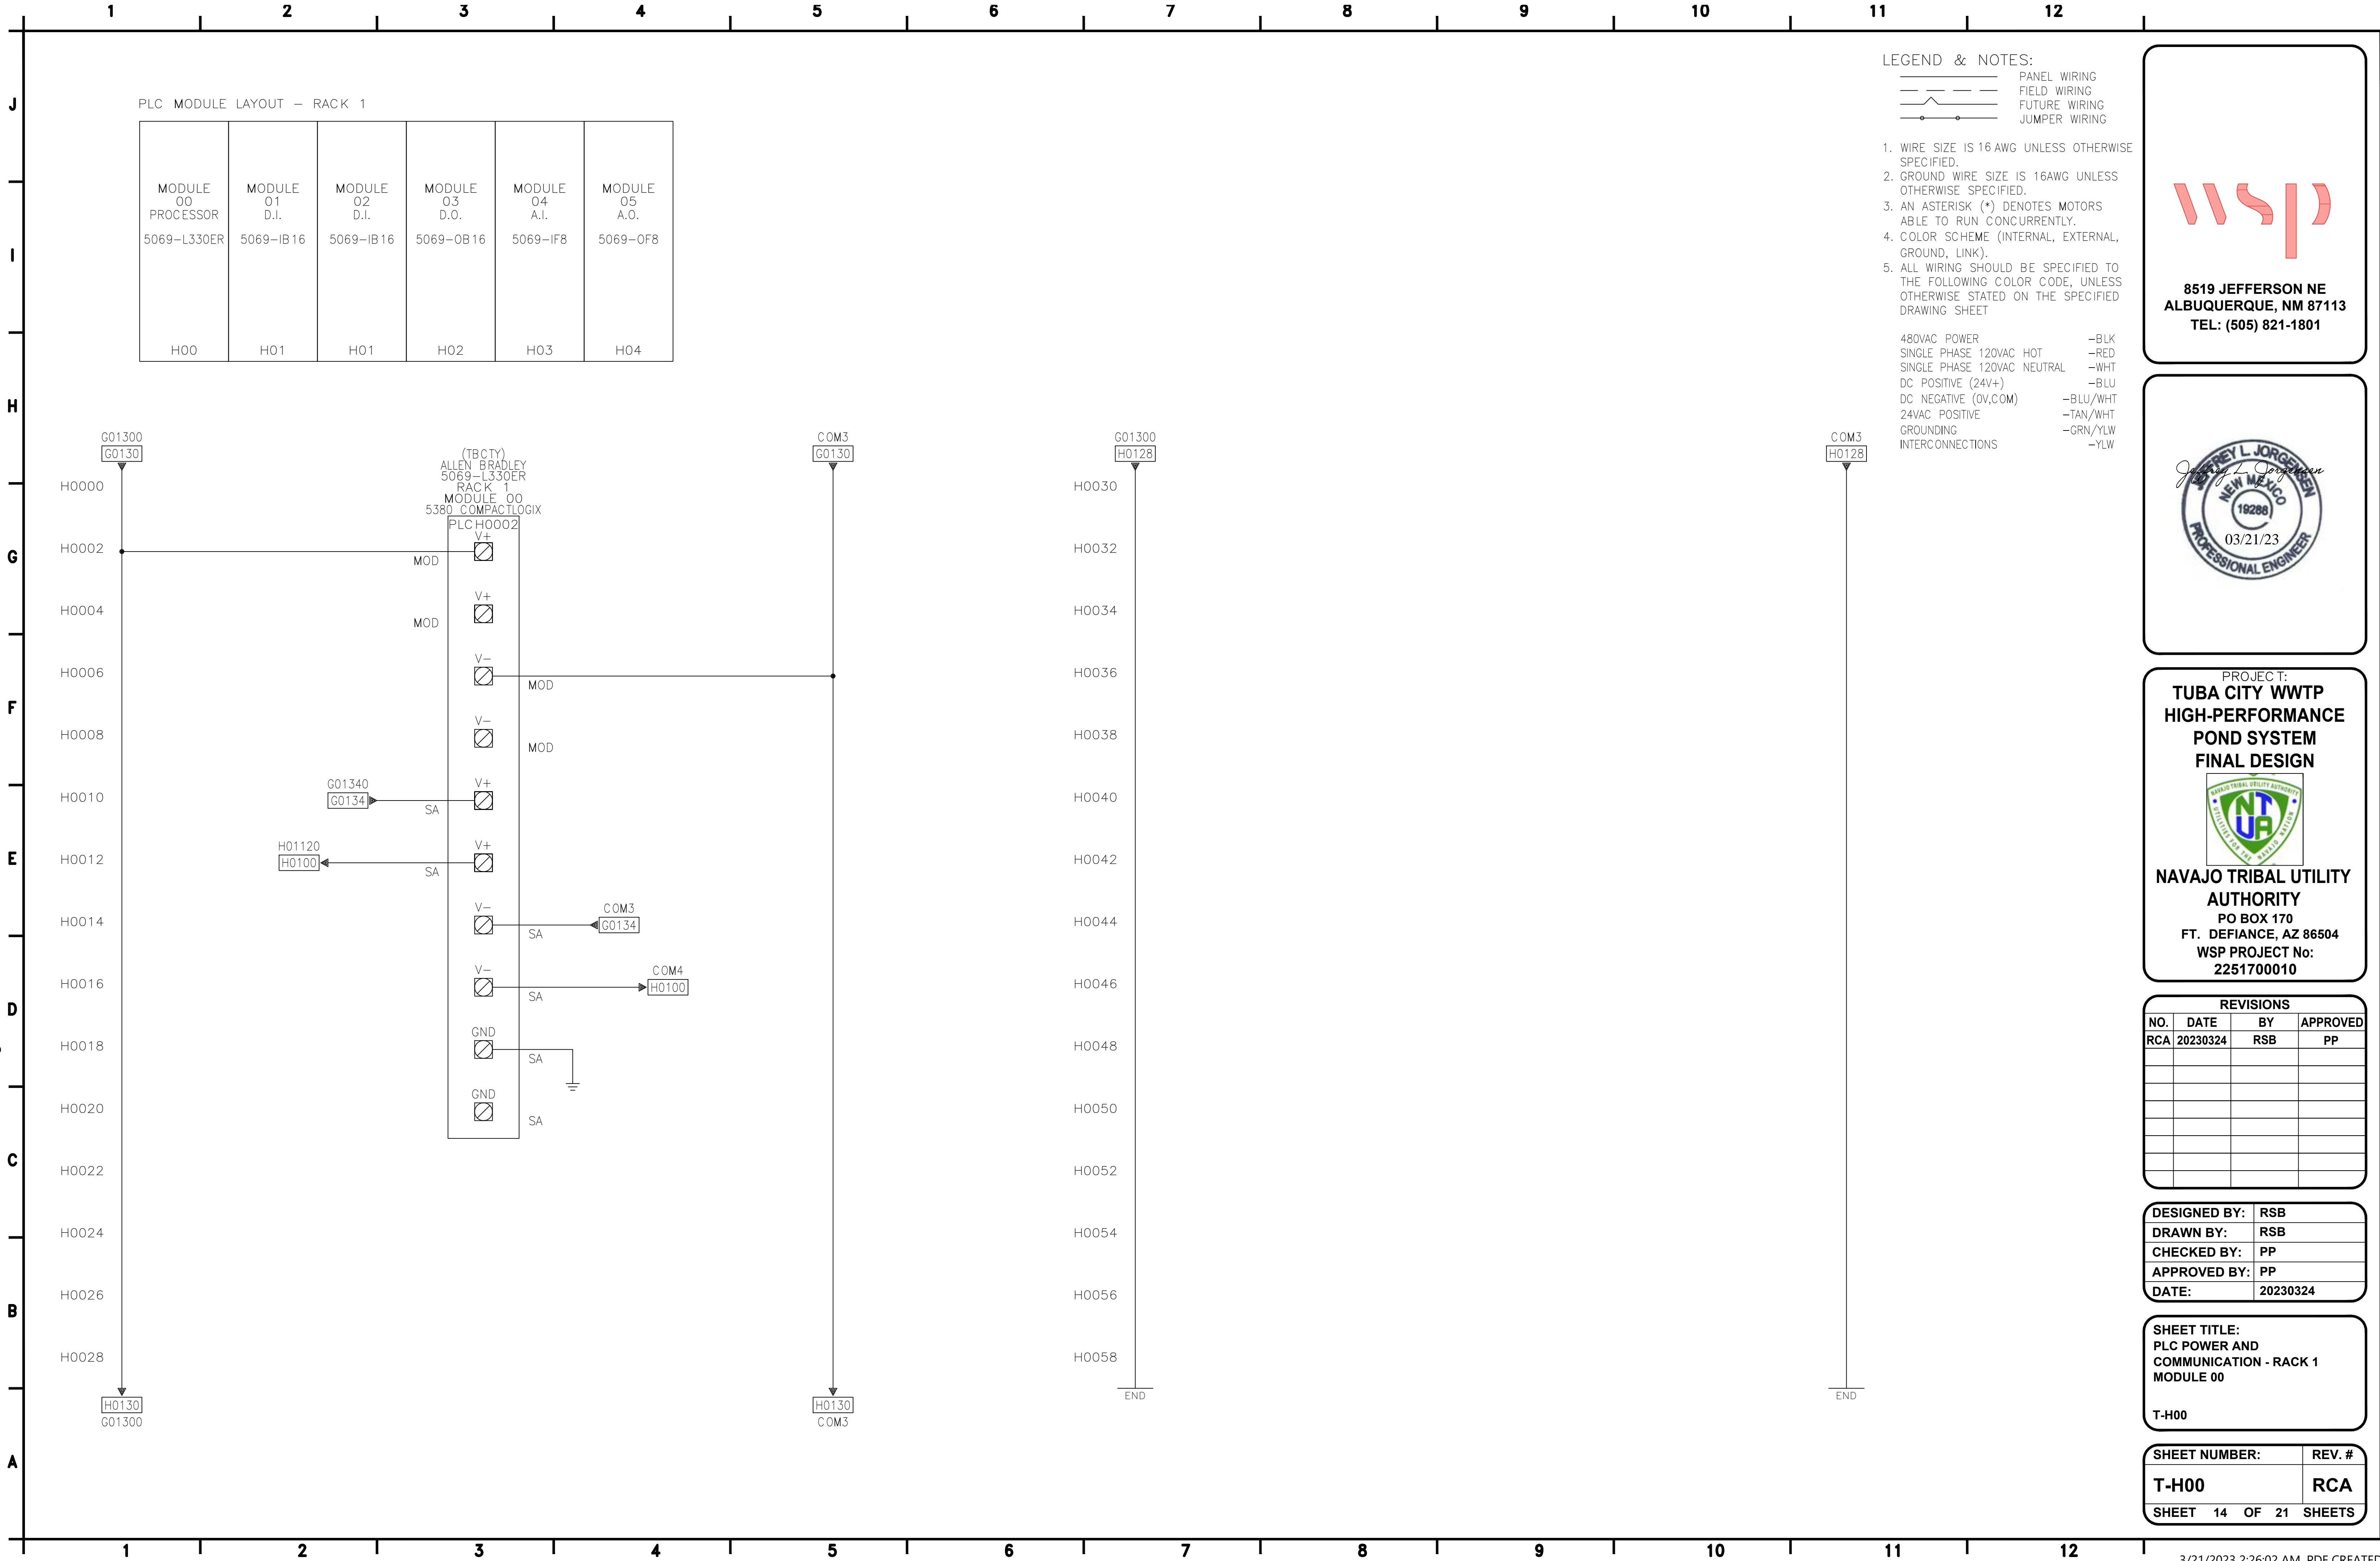




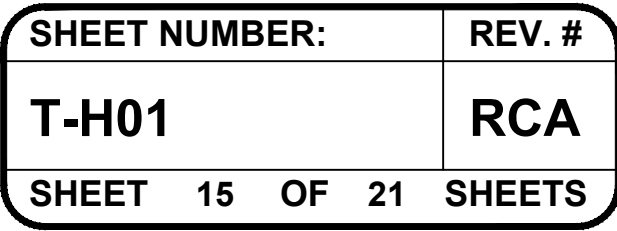



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-H02.dwg

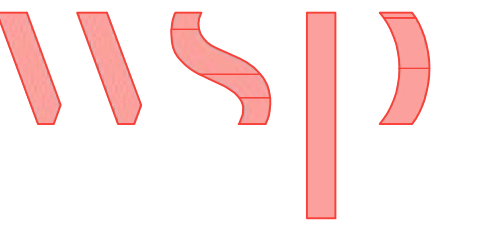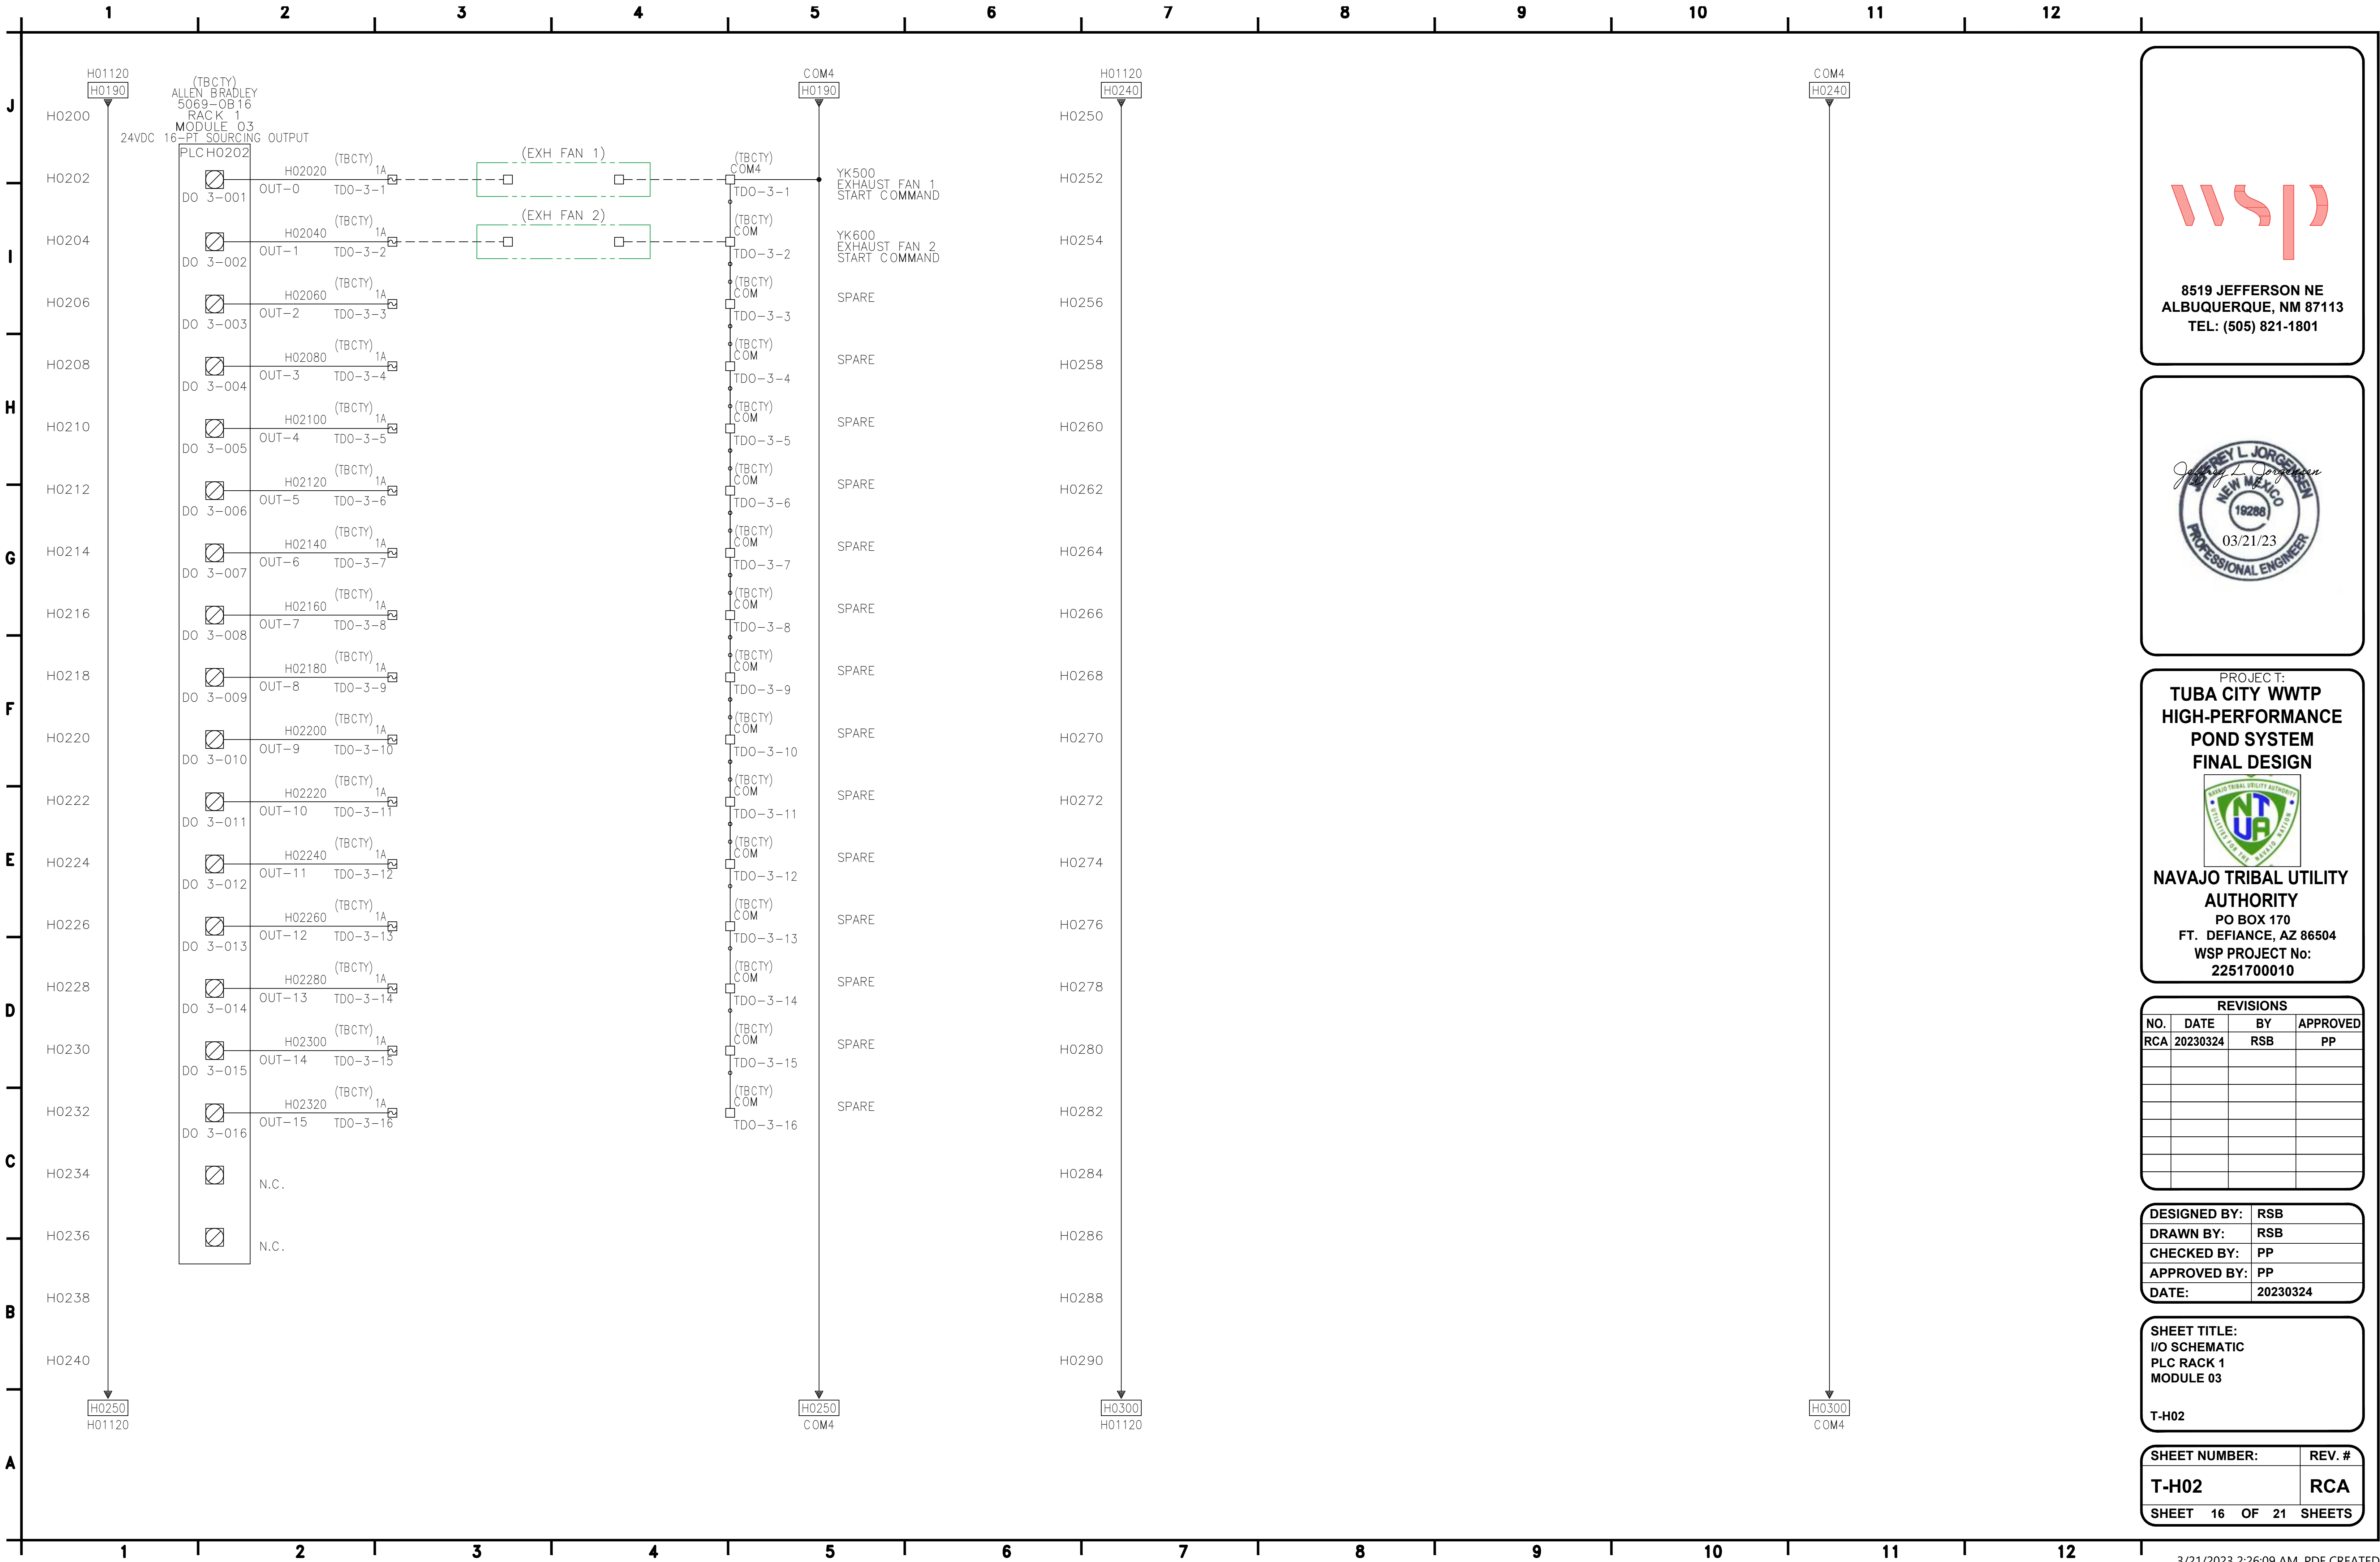

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC, AZ 86504  
WSP PROJECT No:  
2251700010


REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324


SHEET TITLE:  
I/O SCHEMATIC  
PLC RACK 1  
MODULE 03  
  
T-H02

SHEET NUMBER:	REV. #
T-H02	RCA
SHEET 16 OF 21 SHEETS	




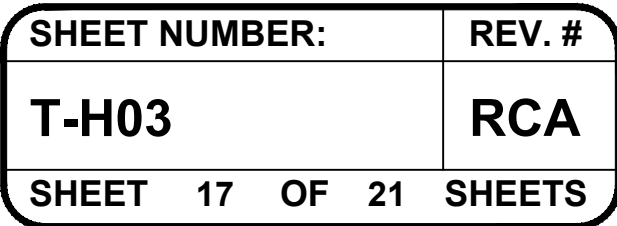




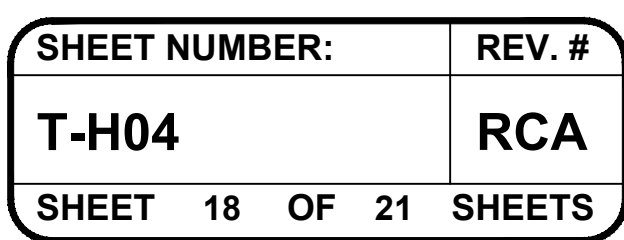



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-M01.dwg

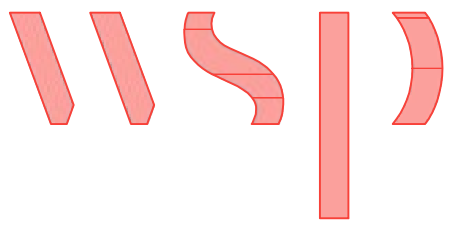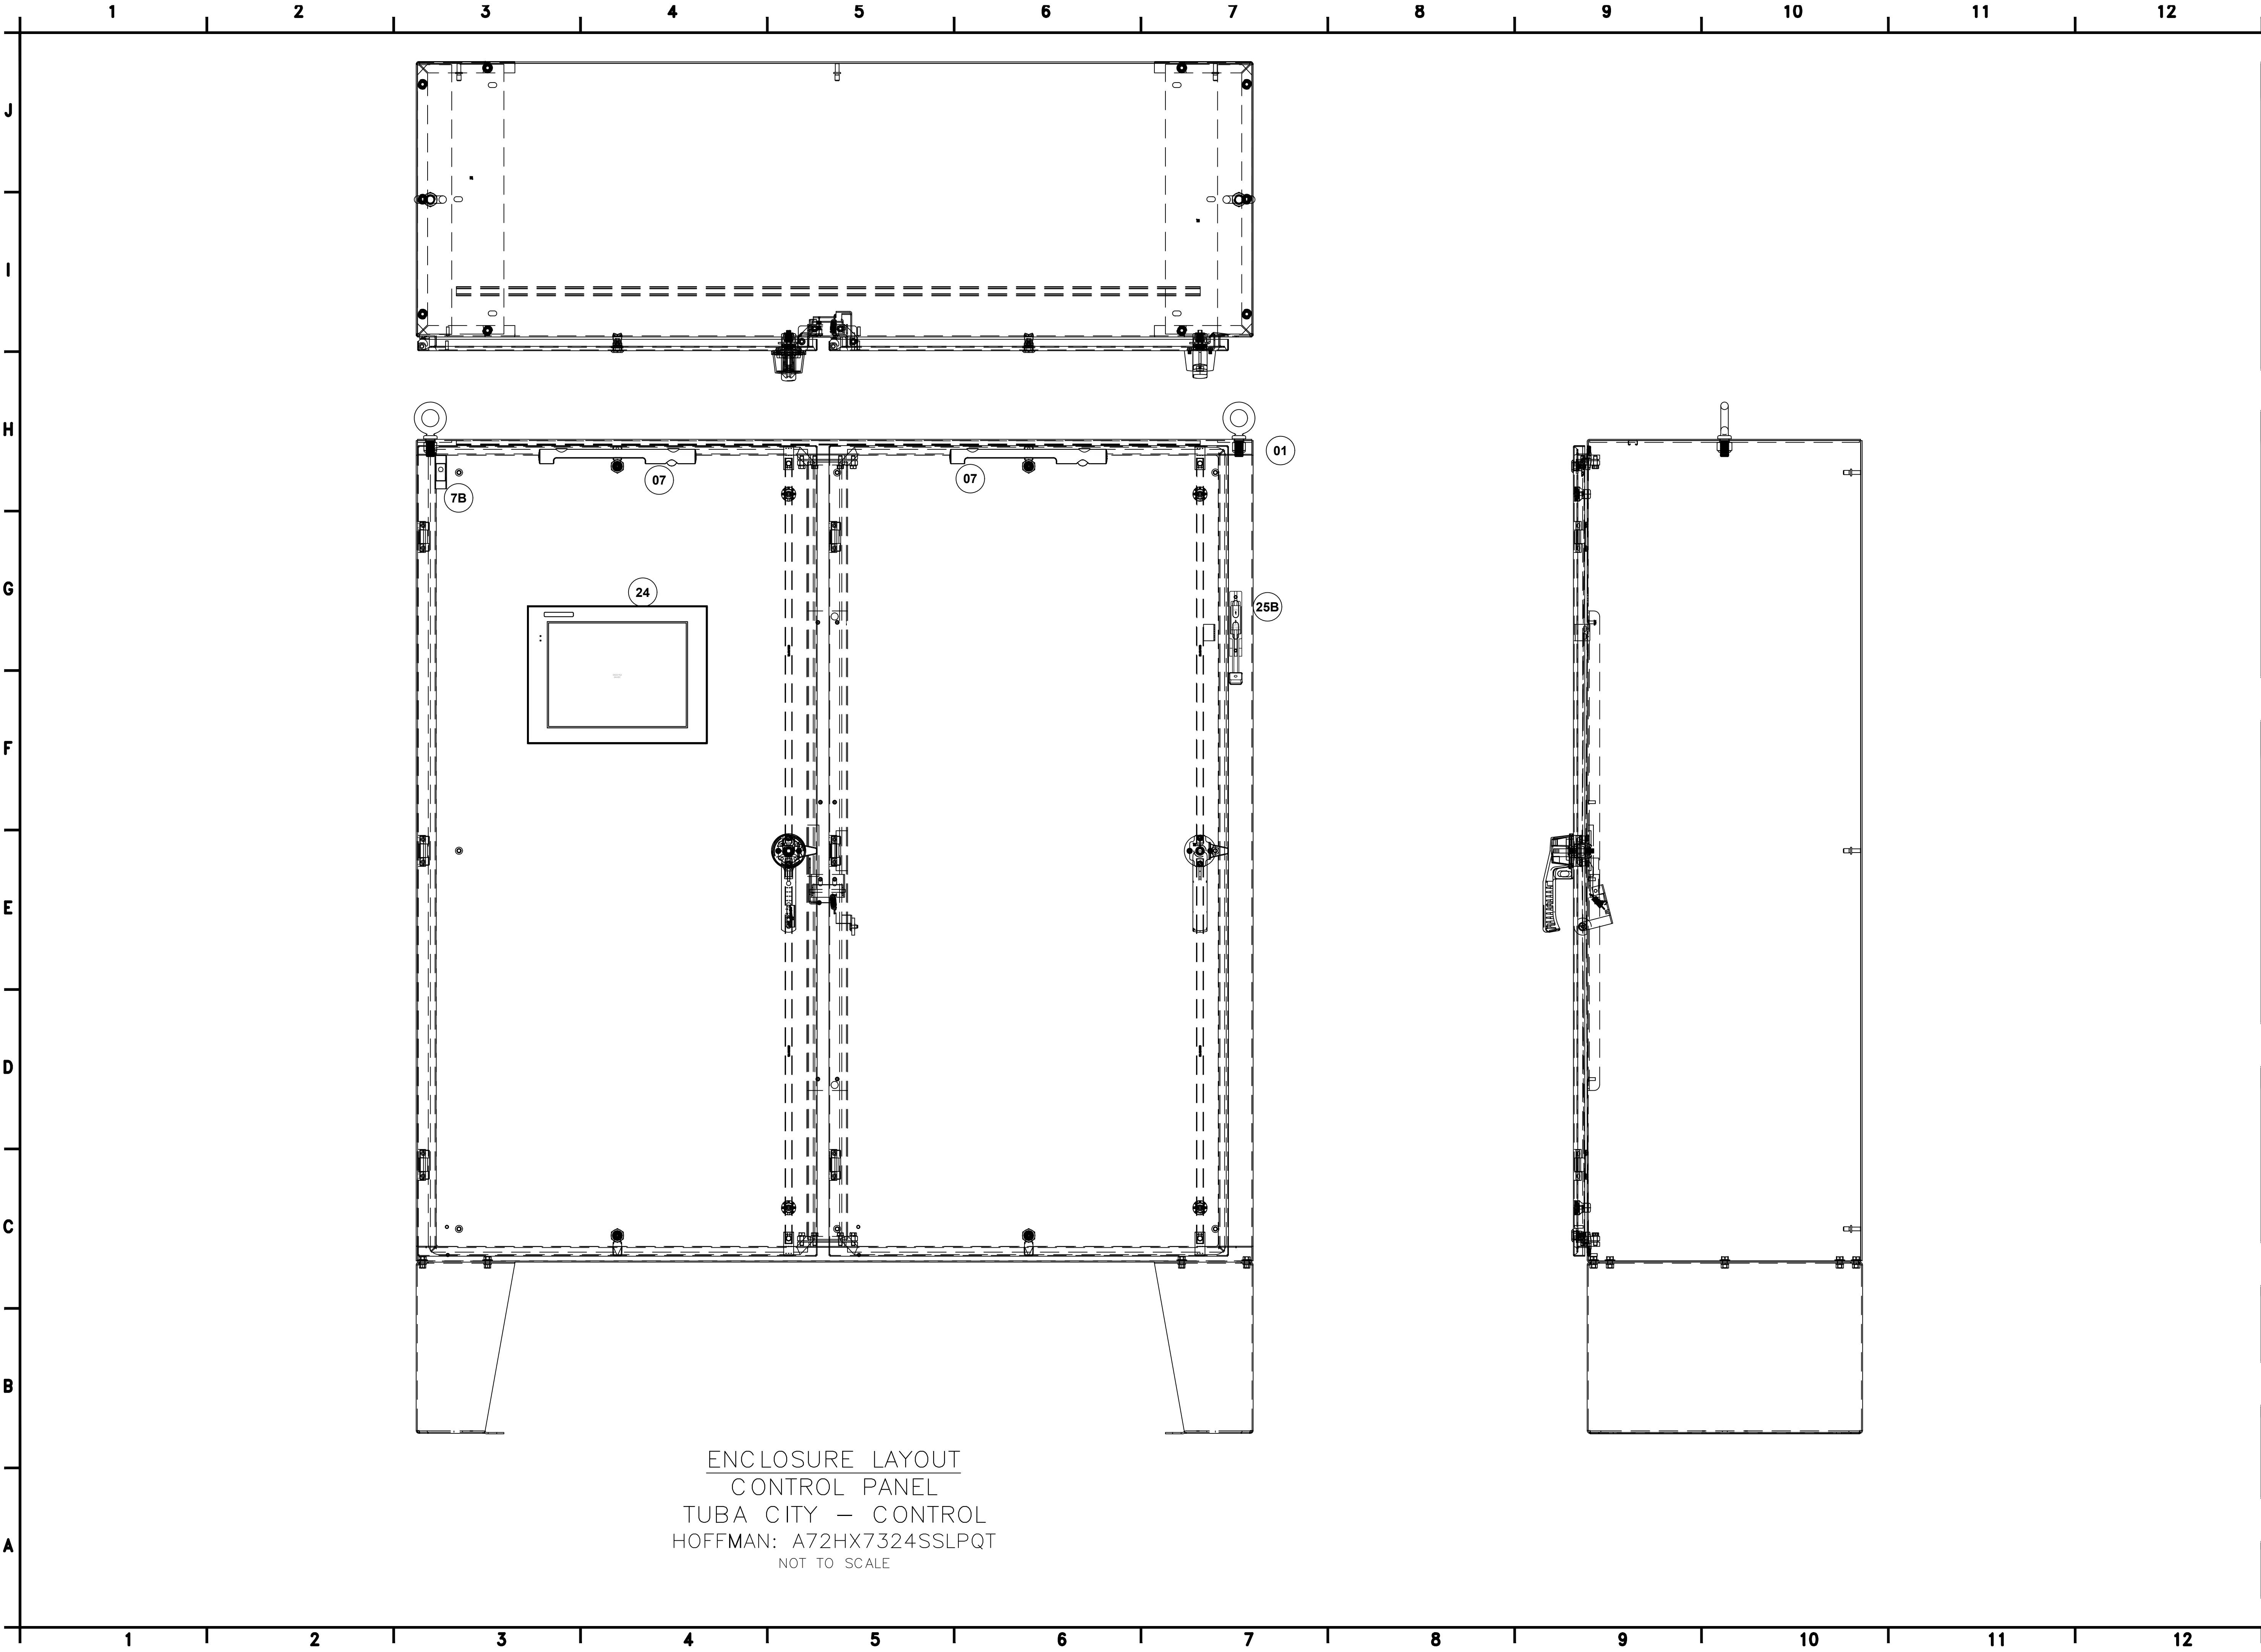

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANCE, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP


DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
ASSEMBLY DRAWING  
ENCLOSURE

T-M01

SHEET NUMBER:	REV. #
T-M01	RCA
SHEET 19 OF 21 SHEETS	



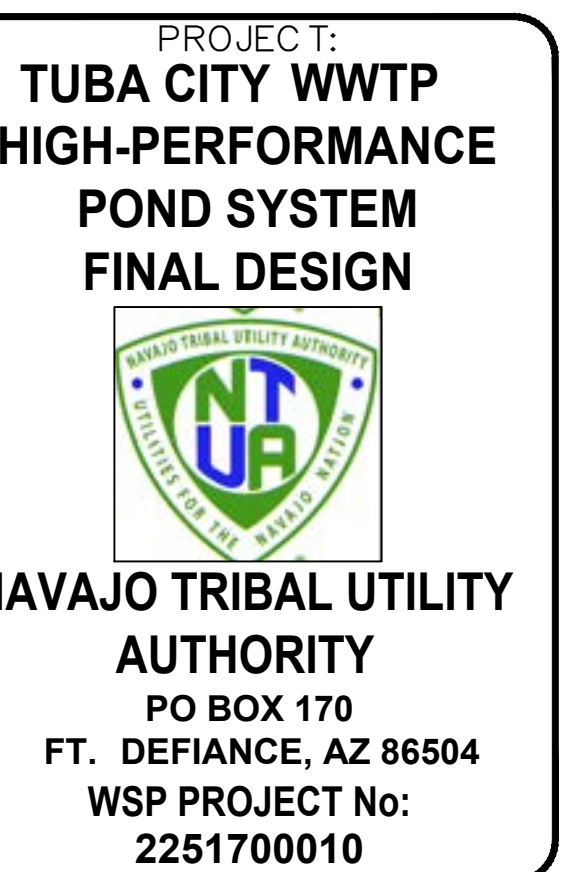

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

T-M02

SHEET NUMBER:	REV. #
T-M02	RCA
SHEET 20 OF 21	SHEETS



C:\I&C Solutions\2023 CAD\23-031 to 23-060\23-045 NTUA\TUBA CITY\T-M03.dwg

J

I

H

G

F

E

D

C

B

A

ITEM	QTY	CATALOG	MFG	DESC	TAGS
01	1	A72HX7324SSLPQT	HOFFMAN	FLOOR-MOUNT DISCONNECT, 2-DOOR ENCLOSURE, 3-PT LATCH, TYPE 4X, 72x74x24, BRUSHED, SS304	
02	1	A72P72	HOFFMAN	BACKPLATE, 68x68, MILD STEEL, PAINTED	
03	A/R	0801733	PHOENIX CONTACT	DIN RAIL (35mm X 7.5mm X 1m)	
03A	A/R	XUS001736	ENTRELEC	DIN RAIL, RAISED, (35mm X 50mm X 1m)	
04	A/R	3022276	PHOENIX CONTACT	DIN RAIL ANCHOR, CLIP-FIX 35-5	(not shown)
05	A/R	0800307	PHOENIX CONTACT	DIN RAIL MARKER, UBE-D	
07	2	EL1200M	HOFFMAN	ENCLOSURE LAMP KIT, LED, MOTION SENSOR	ILF0122,ILF0124
7B	1	ALFSWD	HOFFMAN	DOOR SWITCH, ENCLOSURE	ZS100
08	2	PK15GTA	SCHNEIDER ELECTRIC	GROUND BAR KIT, 10 POSITION, #14-#4AWG	
09	1	0916612	PHOENIX CONTACT	120VAC CIRCUIT BREAKER 15A RATED (UT 6-TMC M 15A)	CBF0114
9A	1	0916610	PHOENIX CONTACT	120VAC CIRCUIT BREAKER 10A RATED (UT 6-TMC M 10A)	CBF0118
9B	1	0916607	PHOENIX CONTACT	120VAC CIRCUIT BREAKER 5A RATED (UT 6-TMC M 5A)	CBF0122
9C	3	0916606	PHOENIX CONTACT	120VAC CIRCUIT BREAKER 4A RATED (UT 6-TMC M 4A)	CBF0126,CBF0162,CBF0166
10	1	3211775	PHOENIX CONTACT	FEED THRU TERMINAL BLOCK, 32A, BLUE (PT4-TWIN-BU)	TS1
10A	1	3211780	PHOENIX CONTACT	FEED THRU TERMINAL BLOCK, 32A, GND (PT4-TWIN-PE)	TS1
11	11	3211771	PHOENIX CONTACT	FEED THRU TERMINAL BLOCK, 32A, GRAY (PT4-TWIN)	TS2,TS3
12	8	3211903	PHOENIX CONTACT	FUSE MODULAR TERMINAL BLOCK, LED (PT4-HESILED 24)	TS3
13	48	3213961	PHOENIX CONTACT	DI/DO TERMINAL BLOCK	TDI-1,TDI-2,TDO-3
13A	16	3213960	PHOENIX CONTACT	AI/AO TERMINAL BLOCK	TAI-4,TAO-5
13B	5	3213976	PHOENIX CONTACT	END PLATE FOR I/O TERMINAL BLOCK	TDI-1,TDI-2,TDO-3,TAI-4,TAO-5
15	64	3209248	PHOENIX CONTACT	5x20 24VDC FUSE HOLDER (P-FU 5X20 LED 24-5)	TDI-1,TDI-2,TDO-3,TAI-4,TAO-5
15A	8	GMA-2-R	BUSSMAN	2A FUSE, 5mm X 20mm	TS3
15B	16	GMA-1-R	BUSSMAN	1A FUSE, 5mm X 20mm	TDO-3
15C	32	GMA-500-R	BUSSMAN	500mA FUSE, 5mm X 20mm	TDI-1,TDI-2
15D	16	GMA-250-R	BUSSMAN	250mA FUSE, 5mm X 20mm	TAI-4,TAO-5
16	2	SDN-10-24-100C	SOLA	24VDC POWER SUPPLY, 10A/240W RATED	PWG0102,PWG0110
17	1	SDU500A	SOLA	UNINTERRUPTIBLE POWER SUPPLY, 500W	UPSFO152
18	1	0804155	PHOENIX CONTACT	120VAC DIN RAIL MOUNT RECEPTACLE	RECPTFO118
19	1	STV25K	SOLA	SURGE PROTECTION DEVICE	SUF0102
20	1	SDN-2.5-20RED	SOLA	TVSS DEVICE	PWG0118
21	1	2702910	PHOENIX CONTACT	ETHERNET SWITCH, 10x RJ45	ENG0126
23	1	5069-L330ER	ALLEN BRADLEY	COMPACTLOGIX 5380 SERIES PLC, 60 NODE, 3MB MEM, 3 IO RACK	PLCH0002
23A	2	5069-IB16	ALLEN BRADLEY	COMPACT 5000 I/O DIGITAL 16-POINT SINKING INPUT MODULE 24VDC	PLCH0102,PLCH0152
23B	1	5069-OB16	ALLEN BRADLEY	COMPACT 5000 I/O DIGITAL 16-POINT OUTPUT MODULE 24VDC	PLCH0202
23C	1	5069-IF8	ALLEN BRADLEY	COMPACT 5000 I/O ANALOG 8-POINT INPUT MODULE	PLCH0302
23D	1	5069-OF8	ALLEN BRADLEY	COMPACT 5000 I/O ANALOG 8-POINT OUTPUT MODULE	PLCH0402
23E	1	5069-ECR	ALLEN BRADLEY	COMPACT 5000 I/O END CAP, RIGHT	
23F	1	5069-RTB64-SPRING	ALLEN BRADLEY	COMPACT 5000, 4&6 POS, SPRING TERMINAL	PLCH0002
23G	5	5069-RTB18-SPRING	ALLEN BRADLEY	COMPACT 5000, 18 POS, SPRING TERMINAL	PLCH0102,PLCH0152,PLCH0202,PLCH0302,PLCH0402
24	1	EA9-T15CL	AUTOMATION DIRECT	15" TOUCHSCREEN HMI	OIG0152
25A	1	194R-J200-1753	ALLEN BRADLEY	3PH FUSED DISCONNECT, 200A RATED	FUE0004
25B	1	194R-HM4	ALLEN BRADLEY	DISCONNECT HANDLE KIT, WITH CABLE	FUE0004
25C	3	JTD200ID	LITTELFUSE	J-SERIES FUSE, 200A RATED	FUE0004
26	1	LAMA1/0-14-QY	PANDUIT	GROUND LUG, #14-1/0AWG	
27	1	1492-PD32127	ALLEN BRADLEY	POWER DISTRIBUTION BLOCK, 3PH, 760A RATED, AL, (2) 1/0AWG LINE, (14)#14-#4AWG LOAD	DBE0006
27A	1	1492-PBC3	ALLEN BRADLEY	COVER KIT FOR 1492-PD32127	DBE0006
28	1	1489-M2C080	ALLEN BRADLEY	CIRCUIT BREAKER, MINIATURE, 2-POLE, 8A, 480/277VAC, C-TRIP, NO NEUTRAL	CBE0130
29	1	Y2000	SOLA	CONTROL XFMR, 240X480V PRI, 120V SEC, 2KVA, SBE SERIES, OPEN STYLE, COPPER WOUND	XFF0102
30		NOT USED			
31	1	1489-M3C200	ALLEN BRADLEY	CIRCUIT BREAKER, MINIATURE, 3-POLE, 20A, 480/277VAC, C-TRIP, NO NEUTRAL	CBE0134
32		NOT USED			
33		NOT USED			

WSP

8519 JEFFERSON NE

ALBUQUERQUE, NM 87113

TEL: (505) 821-1801

JEFFREY L. JORGENSEN

NEW MEXICO

19288

PROFESSIONAL ENGINEER

03/21/23

PROJEC T:

TUBA CITY WWTP

HIGH-PERFORMANCE

POND SYSTEM

FINAL DESIGN

NAVAJO TRIBAL UTILITY AUTHORITY

PO BOX 170

FT. DEFIANC E, AZ 86504

WSP PROJECT No:

2251700010

REVISIONS

NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:

DRAWN BY:

CHECKED BY:

APPROVED BY:

DATE:

RSB

RSB

PP

PP

20230324

SHEET TITLE:

BILL OF

MATERIALS

T-M03

SHEET NUMBER:

T-M03

SHEET 21 OF 21 SHEETS

REV. #

RCA

1

2

3

4

5

6

7

8


9

10

11

12

3/21/2023 2:26:28 AM PDF CREATOR

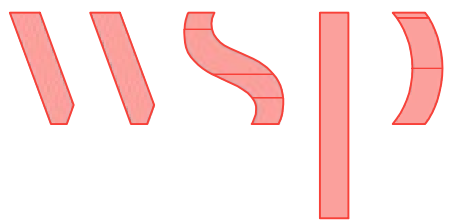

8519 JEFFERSON NE  
ALBUQUERQUE, NM 87113  
TEL: (505) 821-1801



PROJECT:  
**TUBA CITY WWTP  
HIGH-PERFORMANCE  
POND SYSTEM  
FINAL DESIGN**



**NAVAJO TRIBAL UTILITY  
AUTHORITY**  
PO BOX 170  
FT. DEFIANC E, AZ 86504  
WSP PROJECT No:  
2251700010

REVISIONS			
NO.	DATE	BY	APPROVED
RCA	20230324	RSB	PP

DESIGNED BY:	RSB
DRAWN BY:	RSB
CHECKED BY:	PP
APPROVED BY:	PP
DATE:	20230324

SHEET TITLE:  
BILL OF  
MATERIALS

T-M03

SHEET NUMBER:	REV. #
T-M03	RCA
SHEET 21	OF 21 SHEETS