


LOCATION MAP

Not to Scale



COALMINE
SITE LATITUDE: 35°59'17"N
LONGITUDE: 111°1'55"W
VICINITY MAP

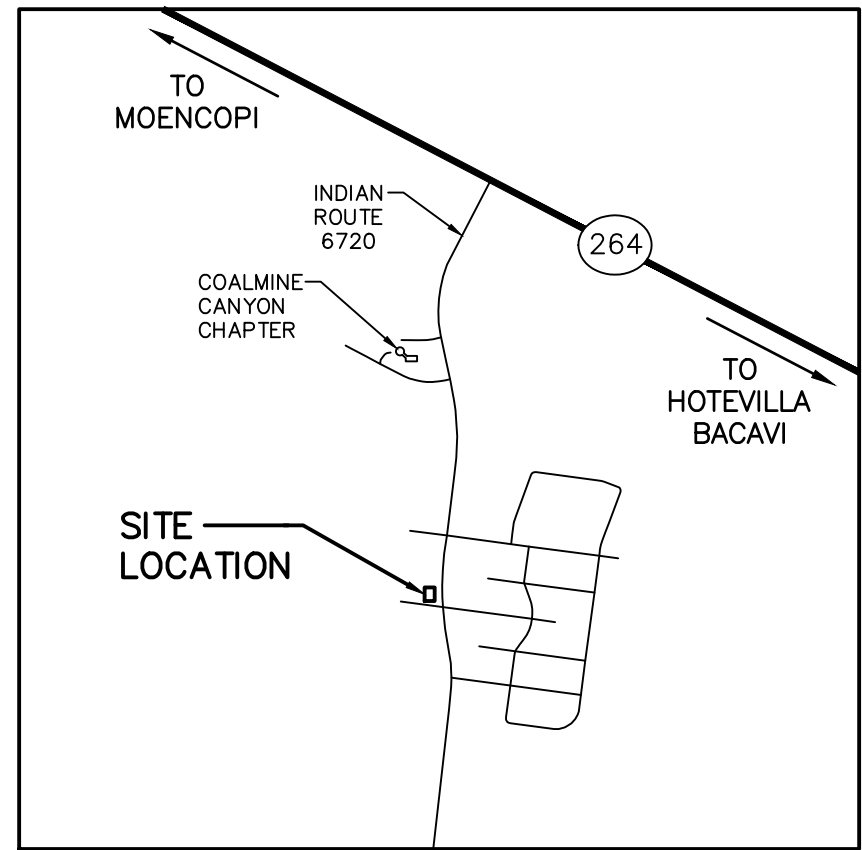

DESIGN AND CONSTRUCTION OF
COALMINE LIFT STATION FACILITIES
NAVAJO TRIBAL UTILITY AUTHORITY
CONSTRUCTION DOCUMENTS
MAY 24, 2023

APPROVAL

ENGINEERING AND TECHNICAL SERVICES DIVISION

DATE


CIVIL ENGINEER

DATE

No.	Revision	Note	Date	Drawn	Check

NAVAJO TRIBAL UTILITY AUTHORITY
DESIGN AND CONSTRUCTION OF COALMINE LIFT STATION FACILITY

COVER SHEET AND VICINITY MAPS

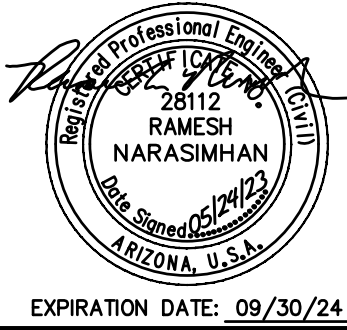

Drawn by:	KWB
Design by:	LAH
Approved by:	RN
Date:	05/24/23
Project No.	2338
Sheet No.	G-01

GENERAL NOTES

1. ALL WORK AND MATERIALS SHALL CONFORM TO THE DRAWINGS AND SPECIFICATIONS AS WELL AS NAVAJO NATION STANDARD DETAILS. SPECIFICATIONS, AND REGULATIONS. ALL WORK AND MATERIALS NOT IN CONFORMANCE WITH THESE STANDARDS ARE SUBJECT TO REMOVAL AND REPLACEMENT AT THE CONTRACTORS EXPENSE.
2. CONTRACTOR SHALL OBTAIN AND PAY FOR ANY PERMITS REQUIRED UNLESS OTHERWISE INDICATED. THE CONTRACTOR IS ADVISED THAT AN EXCAVATIONS AND DIRT MOVING PERMIT MAY BE REQUIRED BY THE NAVAJO NATION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN THIS PERMIT, IF NECESSARY, AND COMPLY WITH ITS REQUIREMENTS. CONTRACTOR TO PROVIDE APPROPRIATE DUST CONTROL MEASURES DURING CONSTRUCTION. NTUA AND ENGINEER WILL OBTAIN NAVAJO NATION ENVIRONMENTAL PROTECTION AGENCY CONSTRUCTION PERMIT.
3. NOT USED
4. EXISTING PIPING, ELECTRICAL, AND UTILITIES ARE BASED ON EXISTING RECORDS AND FIELD OBSERVATIONS BY NTUA AND ENGINEER. CONTRACTOR IS RESPONSIBLE FOR VERIFYING LOCATIONS OF ALL EXISTING PIPING, ELECTRICAL, AND UTILITIES AND AVOIDING DAMAGE TO THE SAME. PRIOR TO ANY CONSTRUCTION ACTIVITY, THE CONTRACTOR SHALL CONTACT NTUA AT (928)729-5721 AND THE NTUA PROJECT MANAGER. CONTRACTOR SHALL CONFIRM LOCATION OF ALL UNDERGROUND UTILITIES PRIOR TO ANY EXCAVATION AND SHALL BE RESPONSIBLE FOR:
- a. DAMAGE WORK TO SUCH UTILITIES CAUSED AS A RESULT OF THE WORK.
- b. DAMAGES TO EXISTING WALKS, WALLS, CURBS, DRIVES, TREES, LANDSCAPING, AND PAVING.
5. CONTRACTOR SHALL POTHOLE EXISTING UTILITIES AHEAD OF CONSTRUCTION, TO ALLOW FOR ANY NECESSARY ADJUSTMENT IN GRADE LINE AND TO VERIFY PIPE TYPES FOR ORDERING PROPER TRANSITION, AND/OR TIE-IN FITTINGS WHICH MAY BE REQUIRED.
6. CONTRACTOR IS RESPONSIBLE FOR REVIEWING ALL PLANS FOR DEMOLITION ITEMS.
7. ALL UTILITIES SHALL BE PROTECTED FROM DAMAGE AS A RESULT OF THE WORK. THE CONTRACTOR SHALL RELOCATE, REPAIR OR REPLACE AT HIS EXPENSE, ANY AFFECTED UTILITIES TO THE SATISFACTION OF NTUA.
8. PROVIDE TEMPORARY THRUST RESTRAINT FOR EXISTING PIPING WHENEVER THE WORK REQUIRES. CONTRACTOR SHALL REPLACE OR RESTORE THE EXISTING RESTRAINT SYSTEM TO LIKE-NEW CONDITION.
9. CONTRACTOR SHALL PROTECT THE ADJACENT PROPERTY AND IMPROVEMENTS THERETO FROM ANY DAMAGE DURING CONSTRUCTION. ANY DAMAGE TO ADJACENT PROPERTY OR IMPROVEMENTS MUST BE REPAIRED OR REPLACED TO THE PROPERTY OWNER'S SATISFACTION, AT THE CONTRACTOR'S EXPENSE.
10. DIMENSIONS AND ELEVATIONS FOR EQUIPMENT INSTALLATION TO BE VERIFIED BASED UPON EQUIPMENT MANUFACTURER SELECTED.
11. ALL, DIMENSIONS AND ELEVATIONS SHALL BE FIELD VERIFIED.
12. EXISTING EQUIPMENT TO BE REMOVED AND SALVAGED SHALL BE MARKED BY ENGINEER OR OWNER PRIOR TO WORK, UNLESS OTHERWISE NOTED ON THE CONTRACT DOCUMENTS.
13. ALTHOUGH SUCH WORK MAY NOT BE SPECIFICALLY INDICATED, FURNISH AND INSTALL SUPPLEMENTARY OR MISCELLANEOUS ITEMS, APPURTENANCES AND DEVICES INCIDENTAL TO, OR NECESSARY FOR A SOUND, SECURE AND COMPLETE INSTALLATION.
14. THE CONTRACTOR SHALL ADJUST ALL EXISTING MANHOLES, VALVE BOXES, CLEANOUTS, BLIND FLANGED PIPING, AND FIRE HYDRANTS WITHIN WORK LIMITS REQUIRED TO MATCH ACTUAL FINAL GRADE.
15. GOVERNING BUILDING CODES:
2009 INTERNATIONAL BUILDING CODE
2011 NATIONAL ELECTRICAL CODE
16. CONTRACTOR TO MAINTAIN ACCESS FOR EMERGENCY RESPONSE VEHICLES DURING CONSTRUCTION.
17. CONTRACTOR SHALL COORDINATE WORK SCHEDULES WITH NTUA, CREWS TO PREVENT ANY CONFLICTING WORK CONDITIONS. LOCATIONS OF TEMPORARY FACILITIES, PARKING AND WORK WITHIN ANY RIGHT-OF-WAY, ETC. SHALL BE COORDINATED WITH THE NTUA.
18. CONTRACTOR SHALL PROVIDE TEMPORARY SAFETY AND SECURITY FENCING AND SITE IMPROVEMENTS AS NEEDED AT NO EXTRA COST.
19. CONSTRUCTION DEBRIS SHALL BE REMOVED FROM THE SITE AND LEGALLY DISPOSED OF AT LEAST WEEKLY BY THE CONTRACTOR. KEEP SITE AREA CLEAN.
20. EXCAVATED SOIL IS TO BE USED TO FILL IN LOW SPOTS PRIOR TO BEING HAULED OFF SITE. CONTRACTOR SHALL ESTABLISH A SUITABLE STAGING AREA FOR STORAGE OF EXCAVATED SOIL.
21. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SECURITY AT THE SITE WHILE CONSTRUCTION IS IN PROGRESS. CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING THE PUBLIC FROM ANY HAZARDS ARISING FROM CONSTRUCTION OPERATIONS AND PROTECTING EXISTING AND NEW IMPROVEMENTS FROM DAMAGE DUE TO ACCIDENT OR VANDALISM.
22. THESE LIFT STATION SITES ARE ACTIVE. CONTRACTOR TO MAINTAIN ACCESS TO LIFT STATION FACILITIES FOR MAINTAINING OPERATIONS DURING CONSTRUCTION. IF THE WORK REQUIRES INTERRUPTION OF EXISTING ACCESS TO OPERATING FACILITIES, THE CONTRACTOR SHALL PROVIDE TEMPORARY ACCESS (APPROVED BY NTUA) TO THESE FACILITIES. LIFT STATIONS ARE CRITICAL TO NTUA OPERATIONS AND A SHUT DOWN WILL NOT BE PERMITTED WITHOUT AN APPROVED MOPO PLAN.
23. WHERE GROUND SURFACE IS DISTURBED, FINISH GRADE WITH UNIFORM SLOPE.
24. PROPERTY LINES AND DIMENSIONS WHERE SHOWN ARE BASED ON NTUA AND NAVAJO NATION RECORDS.
25. MAINTAIN, RELOCATE, OR REPLACE EXISTING SURVEY MONUMENTS, CONTROL POINTS, AND STAKES WHICH ARE DISTURBED OR DESTROYED. PERFORM THE WORK TO PRODUCE THE SAME LEVEL OF ACCURACY AS THE ORIGINAL MONUMENT(S) IN A TIMELY MANNER, AND AT THE CONTRACTOR'S EXPENSE.
26. NOT USED.
27. NOT USED.
28. UNLESS SHOWN ON THE DRAWINGS, ALL DISTURBED AREAS NOT RECEIVING A HARD SURFACE OR GRAVEL SURFACE SHALL BE GRADED SMOOTH AND COMPACTED AS SPECIFIED.
29. CONTRACTOR SHALL BE RESPONSIBLE FOR IMPLEMENTING AND MAINTAINING EROSION CONTROL DEVICES DURING CONSTRUCTION. EROSION CONTROL DEVICES, SILT FENCING, RUNOFF CONTAINMENT BERMS, AND STRAW BALES ARE THE MINIMUM REQUIRED.
30. CONTRACTOR SHALL TAKE ALL OTHER MEASURES TO POSITIVELY PRECLUDE EROSION MATERIALS FROM LEAVING THE SITE.
31. WHERE WATERLINES, RECLAIMED WATERLINES OR SANITARY SEWER LINES (NEW OR EXISTING) CROSS OVER OR UNDER EACH OTHER WITHIN THE RIGHT OF WAY, PIPE LINE ENCASEMENTS SHALL BE PROVIDED AS NECESSARY IN ACCORDANCE WITH NAVAJO NATION REQUIREMENTS.
32. WHERE ALUMINUM IS TO BE EMBEDDED IN CONCRETE, THE ALUMINUM SHALL FIRST BE COATED WITH COAL TAR EPOXY.
33. BACKFILLING OF PIPING AND STRUCTURES SHALL NOT BE STARTED UNTIL INSTALLATION IS APPROVED BY THE OWNER.
34. UNLESS OTHERWISE NOTED, ALL PVC INSTALLED ABOVE GROUND SHALL BE PAINTED WITH UV PROTECTIVE COATING.

ABBREVIATION

DESCRIPTION

/	PER
o	DEGREES
ø	DIAMETER
°	INCHES OR SECONDS
'	FEET OR MINUTES
=	EQUALS
%	PERCENT
#	NUMBER OR POUND
@	AT
&	AND
AASHTO	AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS
AB	AGGREGATE BASE
ABAN	ABANDON
ABC	AGGREGATE BASE COURSE
AC	ASPHALT CONCRETE, ASBESTOS CEMENT
ACB	ASPHALT CONCRETE BASE
ACI	AMERICAN CONCRETE INSTITUTE
ACP	ASBESTOS CEMENT PIPE
ACPA	AMERICAN CONCRETE PIPE ASSOCIATION
ADDL	ADDITIONAL
ADOT	ARIZONA DEPARTMENT OF TRANSPORTATION
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISH GRADE
AGC	ASSOCIATED GENERAL CONTRACTORS OF AMERICA, INC.
AGG	AGGREGATE
AIEE	AMERICAN INSTITUTE OF ELECTRICAL ENGINEERS
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
ALT	ALTERNATE
ALUM	ALUMINUM
AMB	AMBIENT
AMPS	AMPERES
ANB	ANCHOR BOLT
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
APPROX	APPROXIMATE OR APPROXIMATELY
APWA	AMERICAN PUBLIC WORKS ASSOCIATION
ASCE	AMERICAN SOCIETY OF CIVIL ENGINEERS
ASME	AMERICAN SOCIETY OF MECHANICAL ENGINEERS
ASP	ASPHALTIC PAVEMENT
ASPH	ASPHALT
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AVC	AVERAGE
AWSC	AMERICAN WELDING SOCIETY CODE
BC	BRASS CAP
BCR	BEGINNING OF CURB RETURN
BE	BASE ELEVATION
BEG	BEGINNING
BF	BLIND FLANGE
BFV	BUTTERFLY VALVE
BHP	BRAKE HORSEPOWER
BLD	BLIND
BLDG	BUILDING
BM	BENCHMARK OR BEAM
BOC	BEGINNING OF CURVE
BOF	BOTTOM OF FOOTING
BOT	BOTTOM
BOW	BOTTOM OF WALL
BRG	BEARING
BST	BITUMINOUS SURFACE TREATMENT
BTB	BITUMINOUS TREATED BASE
BTWN	BETWEEN
BUSH	BUSHING
BVC	BEGINNING OF VERTICAL CURVE
BV	BALL VALVE
C	CONDUIT
CB	CATCH BASIN
CBF&C	CATCH BASIN FRAME & COVER
CC OR C/C	CENTER TO CENTER
CEM	CEMENT
CF	CURB FACE
CFM	CUBIC FEET PER MINUTE
CF5	CUBIC FEET PER SECOND
CI	CAST IRON
CIPP	CAST-IN-PLACE CONCRETE PIPE
CISP	CAST IRON SOIL PIPE
CJP	CONSTRUCTION JOINT
CL	CENTERLINE
CLR	CLEAR OR CLEARANCE
CM	CENTIMETER
CMP	CORRUGATED METAL PIPE
CMU	CEMENT MASONRY UNIT
CO	CLEAN OUT
COOP	CLEAN OUT DECK PLATE
COEF	COEFFICIENT
COL	COLUMN
COMP	COMPRESSION
CONC	CONCRETE
CONN	CONNECTION
CONST	CONSTRUCTION
CONT	CONTINUATION
CORP	CORPORATION
CP	CONTROL PANEL
CPLG	COUPLING
CTB	CEMENT TREATED BASE
CTR'D	CENTERED
CTW	COMBINED TREATED WATER
CU	CUBIC
CV	CHECK VALVE
DBL	DOUBLE
DCS	DISTRIBUTED CONTROL SYSTEM
DEG	DEGREE
DG	DECOMPOSED GRANITE
DI	DUCTILE IRON
DIA	DIAMETER
DIM	DIMENSION
DIP	DUCTILE IRON PIPE
DISCH	DISCHARGE
DJ	DISMANTLING JOINT
DIV	DIVISION
DL	DRAIN LINE
DR	DRIVE
DRWG	DRAWING
DTL	DETAIL
DTS	DETAILS
DV	DRAIN VALVE
DWL	DOWEL
DWY	DRIVEWAY
ELEC	ELECTRIC
E	EAST
EA	EACH
EASE	EASEMENT
EC	END OF CURVE
ECC	EOCENTRIC
ECR	END OF CURB RETURN
EDB	ELECTRIC DUCT BANK
EF	EACH FACE
EG	EXISTING GRADE
EJ	EXPANSION JOINT
EL	ELEVATION
EMBED	EMBEDMENT
EMER	EMERGENCY
EMH	ELECTRICAL MANHOLE
EOP	EDGE OF PAVEMENT

ABBREVIATION

DESCRIPTION

EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
ETC	ETCETERA
EVC	END OF VERTICAL CURVE
EWS	EYEWASH STATION
EXIST	EXISTING
F & C	FRAME & COVER
F	FAHRENHEIT
FB	FIELD BOOK
FC	FLEXIBLE CONNECTOR
FCA	FLANGED COUPLING ADAPTER
FDL	FLOOR DRAIN LINE
FDN	FOUNDATION
FE	FLOW ELEMENT
FF	FINISHED FLOOR
FG	FINISHED GRADE
FH	FIRE HYDRANT
FIN	FINISHED
FL	FLOW LINE
FL EL	FLOOR ELEVATION
FLG	FLANGE
FLGD	FLANGED
FLTR	FILTER
FM	FLOW METER, FORCE MAIN
FND	FOUND
FOC	FACE OF CONCRETE
FFM	FEET PER MINUTE
FFS	FEET PER SECOND
FRB	FLOOR REINFORCED BOTTOM
FRP	FIBERGLASS REINFORCED POLYVINYL
FRT	FLOOR REINFORCED TOP
FS	FLOW SWITCH
FSS	FEDERAL SPECIFICATIONS AND STANDARDS
FT	FOOT OR FEET
FTG	FOOTING
FNTP	FEMALE NATIONAL PIPE THREAD
G	GUTTER
GA	GAGE
GAL	GALLON
GALV	GALVANIZED
GB	GRADE BREAK
GL	GROUND LINE
GPM	GALLONS PER MINUTE
GR	GRADE
GRV	GROOVED
GSN	GENERAL STRUCTURAL NOTES
H	HIGH OR HEIGHT
H2O	WATER
HCS	HOUSE CONNECTION
HCP	HORIZONTAL CONTROL POINT
HD	HEAD
HDWL	HEADWALL
HEX	HEXAGONAL
HG	HIGH
HORIZ	HORIZONTAL
HSS	HOLLOW STRUCTURAL SHAPE
HT	HEIGHT
HTR	HEATER
HWY	HIGHWAY
HZ	HERTZ
I	MOMENT OF INERTIA
IBC	INTERNATIONAL BUILDING CODE
ID	INSIDE DIAMETER
IE	INVERT ELEVATION
IEEE	INSTITUTE OF ELECTRICAL AND ELECTRONIC ENGINEERS
IHS	INDIAN HEALTH SERVICE
IMC	INTERNATIONAL MECHANICAL CODE
IN	INCH
INA	INSTRUMENT AIR
INSUL	INSULATION
INV	INVERT
IP	IRON PIPE
IPS	IRON PIPE SIZE
IR	INNER RADIUS
IRRIG	IRRIGATION
IV	ISOLATION VALVE
JB	JUNCTION BOX
JCT	JUNCTION
JS	JUNCTION STRUCTURE
JT	JOINT
KSI	KIPS PER SQUARE INCH
L	LENGTH
LB	POUND
LF	LINEAR FEET/FOOT
LI	LEVEL INDICATOR
LIN	LINEAR
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
LOC	LOCATION
LONG	LONGITUDINAL
LP	LOW POINT
LS	LEVEL SENSOR
LSH	LEVEL SWITCH HIGH
LSHH	LEVEL SWITCH HIGH HIGH
LSL	LEVEL SWITCH LOW
LT	LEVEL TRANSMITTER
LW	LONG WAY
M	MAP OR MAPS
MAX	MAXIMUM
MAG	MARICOPA ASSOCIATION OF GOVERNMENTS
MCC	MOTOR CONTROL CENTER
MCJ	MASONRY CONTROL JOINT
MEAS	MEASURED
MECH	MECHANICAL
MG	MILLION GALLON
MFR	MANUFACTURER
MID	MIDDLE
MIN	MINUTES OR MINIMUM
MISC	MISCELLANEOUS
MJ	MECHANICAL JOINT
ML	MONUMENT LINE
MM	MILLIMETER
MOPO	MAINTENANCE OF PLANT OPERATION
MON	MONOLITHIC OR MONUMENT
MPH	MILES PER HOUR
MTD	MOUNTED
MVC	MID POINT VERTICAL CURVE
MxPE	MECHANICAL JOINT x PLAIN END
N	NORTH
NBS	NATIONAL BUREAU OF STANDARDS
NC	NORMALLY CLOSED
NE	NORTHEAST
NEC	NATIONAL ELECTRIC CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NIC	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NPT	NATIONAL PIPE THREAD
NSC	NATIONAL SAFETY COUNCIL

ABBREVIATION

DESCRIPTION


NTS	NOT TO SCALE
NTUA	NAVAJO TRIBAL UTILITY AUTHORITY
NW	NORTHWEST
OC	ON CENTER
OD	OUTSIDE DIAMETER
OF	OVERFLOW
OHE	OVERHEAD ELECTRIC POWER LINES
OPNG	OPENING
OR	OUTER RADIUS
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
OZ	OUNCES
P	PRESSURE GAUGE
P&TP	POWER AND TELEPHONE POLE
PB	PULL BOX
PC	POINT OF CURVATURE
PCC	PORTLAND CEMENT CONCRETE
PDL	PROCESS DRAIN LINE
PI	POINT OF INTERSECTION
PL	PROPERTY LINE OR PLATE
PLC	PROGRAMMABLE LOGIC CONTROL
POS	POINT OF SPIRAL
PP	POWER POLE
PPM	PARTS PER MILLION
PRC	POINT OF REVERSE CURVE
PRES	PRESSURE
PREFAB	PREFABRICATED
PROD	PRODUCED
PROP	PROPERTY
PRD	PRESSURE RELIEF DRAIN
PSF	POUNDS PER SQUARE FOOT
PSH	PRESSURE SWITCH HIGH
PSI	POUNDS PER SQUARE INCH
PSIG	POUNDS PER SQUARE INCH GAGE
PT	POINT OF TANGENT
PV	PLUG VALVE
PVC	POLY VINYL CHLORIDE
PVMT	PAVEMENT
Q	RATE OF FLOW
R	RADIUS
R/W	RIGHT-OF-WAY
RC	REINFORCED CONCRETE
RD	ROAD
RDWY	ROADWAY
RED	REDUCER OR REDUCING
REINF	REINFORCED, REINFORCING, REINFORCEMENT
REQ'D	REQUIRED
RF	ROOF
RFB	RIGHT FACE OF BEAM
RGCRP	RUBBER GASKETED REINFORCED CONCRETE PIPE
RMR	RESTRAINED MECHANICAL JOINT
RO	ROUGH OPENING OR ROUGH OPENING
ROW	RIGHT OF WAY
RPM	REVOLUTIONS PER MINUTE
RT	RIGHT
RTB	REMOTE TERMINAL BOARD
S	SOUTH OR SLOPE OR SECTION MODULES
SAN	SANITARY
SAS	SANITARY SEWER
SC	SPIRAL TO CURVE
SCADA	SUPERVISORY CONTROL & DATA ACQUISITION
SCH	SCHEDULE
SD	STORM DRAIN
SDL	SADDLE
SE	SOUTHEAST
SEC	SECONDS
SECT	SECTION
SHP	SOLIDS HANDLING PUMP
SHT	SHEET
SIM	SIMILAR
SPEC	SPECIFICATIONS
SP'G	SPACING
SPL	SAMPLE LINE
SPR	SPARE LINE
SQ	SQUARE
SQ FT YD	SQUARE FOOT YARD
SSD	SANITARY SEWER DRAIN
SST	STAINLESS STEEL
ST	STATION
STA	STATION
STD	STANDARD
STL	STEEL
STR GR	STRUCTURAL GRADE
STRUCT	STRUCTURE OR STRUCTURAL
SV-#	SOLENOID VALVE AND NUMBER (#=NUMBER)
SW	SOUTHWEST
T/	TOP OF
T	TANGENT DISTANCE
T&B	TOP AND BOTTOM
TBM	TEMPORARY BENCHMARK
TBOC	TOP BACK OF CURB
TEL	TELEPHONE
TEMP	TEMPERATURE OR TEMPORARY
TH	TEST HOLE
THK	THICK
THRU	THROUGH
TMH	TELEPHONE MANHOLE
TNK	TANK
TOC	TOP OF CURB
TOF	TOP OF FOOTING
TOG	TOP OF GRATING
TOT	TOP OF PAVEMENT
TOT	TOTAL
TOS	TOP OF SLAB
TOW	TOP OF WALL
TP	TELEPHONE POLE
TRANS	TRANSITION
TYP	TYPICAL
UL	UNDERWRITERS' LABORATORIES INC.
UON & UNO	UNLESS OTHERWISE NOTED
V	VOLTS
VAC	VACUUM
VB	VALVE BOX
VC	VERTICAL CURVE
VEL	VELOCITY
VERT	VERTICAL
VES	VESSEL
VFD	VARIABLE FREQUENCY DRIVE
VG	VALLEY GUTTER

DRAWING INDEX

GENERAL	DESCRIPTION
G-01	COVER SHEET AND VICINITY MAPS
G-02	GENERAL NOTES, ABBREVIATIONS, AND DRAWING INDEX
G-03	GENERAL SITE NOTES, SYMBOLS AND CIVIL LEGEND
G-04	GENERAL STRUCTURAL NOTES
CIVIL	
C-01	COALMINE SITE DEMOLITION PLAN AND SITE IMPROVEMENTS PLAN
C-02	SHADE CANOPY PLAN AND SECTIONS
C-03	CIVIL DETAILS AND SPECIFICATIONS
MECHANICAL	
M-01	EQUIPMENT SCHEDULES AND SPECIFICATIONS
M-02	WETWELL REMOVALS AND IMPROVEMENTS
M-03	VALVE VAULT REMOVALS AND IMPROVEMENTS
M-04	MISCELLANEOUS DETAILS
ELECTRICAL	
E-01	ELECTRICAL NOTES, SYMBOLS, AND LEGEND
E-02	COALMINE SINGLE LINE DIAGRAM AND LOAD CALCULATIONS
E-03	COALMINE ELECTRICAL SCHEDULES
E-04	COALMINE DEMOLITION AND SITE IMPROVEMENT PLANS
E-05	COALMINE SCHEMATIC/ CONNECTION DIAGRAMS AND CONDUIT BLOCK DIAGRAM
E-22	ELECTRICAL DETAILS SHEET 1
INSTRUMENTATION	
I-01	PROCESS AND INSTRUMENTATION DIAGRAM SYMBOLS AND LEGEND
I-02	TYPICAL PROCESS AND INSTRUMENTATION DIAGRAM

NAVAJO TRIBAL UTILITY AUTHORITY
TOWN OF GANADO - WASTEWATER TREATMENT IMPROVEMENTS

GENERAL NOTES, ABBREVIATIONS,
AND DRAWING INDEX

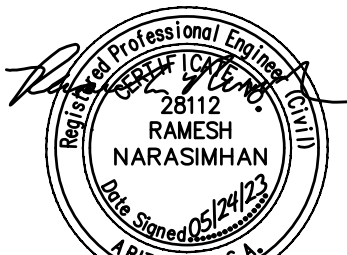

Drawn by: KWB

Design by: LAH

Approved by: RN

Date
05/24/23

Project No.
2338

Sheet No.
G-02

GENERAL SITE NOTES:

1. SOURCE OF TOPOGRAPHY SHOWN ON THE CIVIL PLANS IS A BASE MAP PREPARED BY ENGINEER USING A CLOTH TAPE, AUGUST 2020. VERTICAL ELEVATIONS NOT OBTAINED. EXISTING CONDITIONS MAY VARY FROM THOSE SHOWN ON THESE PLANS. THE CONTRACTOR SHALL VERIFY EXISTING CONDITIONS AND ADJUST WORK PLAN ACCORDINGLY PRIOR TO BEGINNING CONSTRUCTION.
2. EXISTING TOPOGRAPHY, STRUCTURES, AND SITE FEATURES ARE SHOWN SCREENED AND/OR LIGHT-LINED. NEW FINISH GRADE, STRUCTURES, AND SITE FEATURES ARE SHOWN HEAVY-LINED.
3. HORIZONTAL DATUM: NOT USED
VERTICAL DATUM: NOT USED

GENERAL YARD PIPING AND UTILITIES NOTES:

1. EXISTING UNDERGROUND UTILITIES OBTAINED FROM AS-BUILTS AND DRAWINGS PROVIDED BY NTUA, FIELD OBSERVATIONS BY NTUA AND ENGINEER, AND FROM FIELD MEASUREMENTS. CONTRACTOR SHALL FIELD VERIFY DEPTH AND LOCATION PRIOR TO EXCAVATION. PROTECT ALL EXISTING UTILITIES DURING CONSTRUCTION.
2. EXISTING PIPING AND EQUIPMENT ARE SHOWN SCREENED AND/OR LIGHT-LINED. NEW PIPING AND EQUIPMENT ARE SHOWN HEAVY-LINED.
3. UNLESS OTHERWISE SHOWN, ALL PIPING SHALL HAVE A MINIMUM OF 4' COVER.
4. ALL PIPES SHALL HAVE A CONSTANT SLOPE BETWEEN INVERT ELEVATIONS UNLESS A FITTING IS SHOWN.
5. RESTORE DIRT AND/OR GRAVEL ROADS TO CONDITIONS THAT EXISTED BEFORE START OF CONSTRUCTION.

CIVIL LEGEND

	CONTOUR LINE		SANITARY VALVE, FORCEMAIN OR GRAVITY SEWER
	EMBANKMENT AND SLOPE		VEGETATION
	DRAINAGEWAY OR DITCH		UTILITY, WATER VALVE
	CATCH BASIN		IRRIGATION VALVE
	DROP INLET		STORM DRAIN MANHOLE
	MANHOLE OR VAULT		PROPERTY CORNER PIN
	TREE		LIGHT
	BRUSH/TREE LINE		ELECTRIC BOX
	STRUCTURE, BUILDING OR FACILITY		WATER LINE
	DEMOLISH OR REMOVE		SANITARY SEWER LINE
	GRAVEL OR ABC SURFACING		UNDERGROUND GAS LINE
	CONCRETE		UNDERGROUND CABLE TV LINE
	RIP RAP		RIGHT OF WAY
	CURB		WELL PUMPOUT DRAIN LINE
	CURB AND GUTTER		UNDERGROUND ELECTRICAL LINE
	SINGLE SWING GATE		OVERHEAD ELECTRIC LINE
	DOUBLE SWING GATE		UNDERGROUND TELEPHONE LINE
	CANTILEVERED GATE		SANITARY FORCEMAIN
	GUARD RAIL		PROPANE GAS LINE
	CULVERT		BRASS CAP
	PROPERTY LINE		FIRE HYDRANT
	BUILDING, ROAD, ETC.		SANITARY SEWER MANHOLE
	CENTER LINE		SAFETY POST (NEW BOLLARD)
	EASEMENT		TELEPHONE RISER
	STAGING OR WORK AREA LIMITS		GUY WIRE
	STRUCTURE, BUILDING OR FACILITY LOCATION POINT - COORDINATES		VALVE PIT
			WATERLINE MARKER
			UTILITY, WATER MANHOLE
			WATER FAUCET
			WATER METER
			UTILITY, WATER WELL
			SPRINKLER CONTROL BOX
			GASLINE MARKER
			GAS VALVE
			GAS METER
			INDICATES FLOW DIRECTION

YARD PIPING LEGEND

	PIPING. SEE PIPE TAG DESCRIPTION ON THIS SHT
	HIDDEN PIPING THROUGH WALLS AND UNDER SLABS
	PIPING $\geq 24''\varnothing$ WHEN DRAWING SCALE IS 1" = 20' 12'' \varnothing WHEN DRAWING SCALE IS 1" = 10'
	FLEXIBLE COUPLING
	90° ELBOW DOWN
	CONCENTRIC REDUCER
	CAP OR PLUG
	CLEANOUT

SYMBOLS	
ELBOWS / FLANGED	ELBOWS / WELDED
REDUCERS / FLANGED	REDUCERS / WELDED
TEES / FLANGED	TEES / WELDED
VALVES / FLANGED	RESTRAINED EXPANSION JOINT (BELLOWS TYPE)
	DISMANTLING JOINT WITH RESTRAINING RODS
	DIAPHRAGM VALVE, PROFILE
	PRESSURE SUSTAINING VALVE, PROFILE
MECHANICAL JOINT	DIAPHRAGM VALVE, PLAN
	MAGNETIC FLOW METER
90 DEGREE BENDS / PVC	PRESSURE RELIEF VALVE
	AIR RELIEF VALVE
	SAFETY POST (BOLLARD)
	SAMPLE TAP
TEES / PVC	PRESSURE SWITCH LOW
	PRESSURE SWITCH HIGH
	FLOW SWITCH
	PRESSURE GAUGE
GENERAL SYMBOLS	
	OBJECT LINE, EXISTING
	OBJECT LINES, NEW OR RELOCATED
	FUTURE
	CENTER LINE
	HIDDEN LINE
	SURFACE BREAK LINE
	MATCH LINE
	BASE LINE OR DATUM LINE
	DIAMETER OR ROUND
	EXISTING OBJECT TO BE REMOVED
	WATER SURFACE
	EARTH
	CONCRETE

MARKERS	
	DETAIL INDICATOR
	DETAIL SCALE
	TYPICAL DETAIL
(SECTIONS ARE LETTERED, DETAILS ARE NUMBERED)	

EQUIPMENT TAG	
	EQUIPMENT TAG OR PIPE SYSTEM
	EQUIPMENT OR VALVE NUMBER
PIPE TAG	
	PIPE SIZE
	PIPING SYSTEM
	PIPE MATERIAL

PIPE MATERIAL	
1	DUCTILE IRON
2	STEEL
3	C-900 PVC
4	SCHEDULE 80 PVC
5	SDR 35 PVC SEWER PIPE
6	COPPER
7	STAINLESS STEEL
8	SCH 80 BLACK STEEL
9	CAST IRON
10	PVC-SEWER PIPE

SHEET CATEGORY	
G	GENERAL
C	CIVIL
M	MECHANICAL PROCESS
E	ELECTRICAL
I	INSTRUMENTATION

COPYRIGHT © 2012

Check					
Drawn					
Date					
Revision					
Note					
No.					

NAVAJO TRIBAL UTILITY AUTHORITY
TOWN OF GANADO - WASTEWATER TREATMENT IMPROVEMENTS

GENERAL SITE NOTES, SYMBOLS
AND CIVIL LEGEND

NCS
Engineers
202 E. Earll Drive Suite 110
Phoenix, AZ 85012
Phone (602)629-0206
www.ncseng.com

Professional Engineer
28112
RAMESH
NARASIMHAN
Arizona, U.S.A.
EXPIRATION DATE: 09/30/24

Drawn by:	KWB
Design by:	LAH
Approved by:	RN
Date	05/24/23
Project No.	2338
Sheet No.	G-03

GENERAL STRUCTURAL NOTES

(IN CASE OF CONFLICT WITH DRAWINGS STRICTER REQUIREMENTS SHALL GOVERN.)

GENERAL REQUIREMENTS

CODE: SEE GENERAL NOTES

LOADS:

LIVE LOADS:

CONCRETE WALKWAYS	300 PSF
STAIRS	300 PSF
STAIR TREADS	300 LB POINT LOAD
PLATFORMS (GRATING, CHECKERED PLATE)	300 PSF

WIND: 90 MPH BASIC WIND. EXPOSURE "C". IMPORTANCE FACTOR 1.15

SEISMIC: SITE CLASS: AS THE LIMITED GEOTECHNICAL INVESTIGATION DID NOT INCLUDE IDENTIFICATION OF SEISMIC FACTORS, USE SITE CLASS E FOR IYANBITO. FOR OTHER SITES USE D. IMPORTANCE FACTOR = 1.25

SNOW: IMPORTANCE FACTOR 1.10

EARTHWORK AND FOUNDATION

- FOUNDATION DESIGN IS BASED ON THE FOLLOWING SOIL BEARING CAPACITIES:
BEARING – ALL DEPTHS 1,000 PSF
- DESIGN LATERAL AT–REST PRESSURES:
NOT APPLICABLE
- PLACE FOUNDATION CONCRETE ONLY ON SUBGRADE PREPARED PER RECOMMENDATIONS OF THE DRAWINGS AND SPECIFICATIONS. VERIFY THE SUITABILITY OF THE BEARING MATERIAL WITH THE ENGINEER. BEFORE PLACING FOUNDATIONS. ENGINEERED FILL SHALL MEET THE REQUIREMENT STATED IN THE DRAWINGS AND SPECIFICATIONS.
- PLACE DOWELS AND ANCHOR BOLTS BFORE POURING CONCRETE. USE TEMPLATES TO ENSURE PROPER PLACEMENT.

REINFORCED CONCRETE:

- CONCRETE SHALL HAVE MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3,500 PSI FOR STRUCTURES, FOUNDATIONS, AND SLABS ONGRADE UNLESS NOTED OTHERWISE ON DRAWINGS. ASTM C 150 TYPE II LOW ALKALI CEMENT. AIR CONTENT SHALL BE 5.5% PLUS OR MINUS 1%.
- ALL CONCRETE CONSTRUCTION, INCLUDING BENDING OF BARS, SHALL COMPLY WITH CURRENT ACI "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" (CURRENT ACI 318).
- UNLESS SHOWN OTHERWISE, MINIMUM REINFORCEMENT OF CONCRETE WALLS OR SLABS SHALL BE:
LESS THAN 10" THICKNESS – USE #5 @ 12" EW. SEE DRAWINGS FOR LOCATION OF REINFORCEMENT. MORE THAN 10" THICK – USE #5 @ 12" EW EF.
- ALL WALL REINFORCEMENT AT CORNERS OR JUNCTIONS OF WALLS SHALL BE CONTINUOUS. LAPPED, OR TERMINATED IN AN ACI STANDARD 90 DEGREE HOOK. LAP SPLICES SHALL CONFORM WITH NOTE 12.
- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, ALL HORIZONTAL AND VERTICAL BARS SHALL BE DOWELED. DOWELS LAP AND MATCH LARGER DIAMETER BAR.
- ALL SLABS, BEAMS, AND COLUMN REINFORCING BARS SHALL HAVE A MINIMUM EXTENSION OR ANCHORAGE INTO SUPPORTS IN ACCORDANCE WITH ACI 318.
- STIRRUP SUPPORT BARS SHALL BE PROVIDED BETWEEN ENDS OF TOP BARS AS REQUIRED.
- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, CONCRETE COVER FOR #11 AND SMALLER REINF BARS SHALL BE AS FOLLOWS:

A. SLABS AND JOISTS:
FORMED CONCRETE SURFACES FOR DRY CONDITIONS.....3/4"
FORMED CONCRETE SURFACES EXPOSED TO EARTH, WATER, OR WEATHER, OR LOCATED OVER WATER
#5 BARS AND SMALLER.....1 1/2"
#6 BARS AND LARGER.....2"

B. BEAMS AND COLUMNS:
FORMED CONCRETE SURFACES FOR DRY CONDITIONS
STIRRUPS, SPIRALS, AND TIES.....2"
PRINCIPAL REINFORCEMENT.....2 1/2"
FORMED CONCRETE SURFACES EXPOSED TO EARTH, WATER, OR WEATHER, OR BEAMS LOCATED OVER WATER
STIRRUPS AND TIES.....2"
PRINCIPAL REINFORCEMENT.....2 1/2"

C. WALLS:
FORMED CONCRETE SURFACES FOR DRY CONDITIONS....3/4"
FORMED CONCRETE SURFACES EXPOSED TO EARTH, WATER, OR WEATHER.....2"

D. FOOTINGS AND BASE SLABS AND FOUNDATIONS FOR SHADE CANOPIES, GENERATORS, AND FUEL TANKS FOR GENERATORS:
FORMED VERTICAL CONCRETE SURFACES.....2"
AT UNFORMED SURFACES AND BOTTOMS IN CONTACT WITH EARTH OR CONCRETE WORK MATS.....3"
TOP OF FOOTINGS.....SAME AS SLABS

E. REINFORCEMENT SHALL BE PLACED WITHIN A TOLERANCE OF ±1/4" OF POSITION SPECIFIED.
- KEYWAYS AND WATERSTOPS SHALL END 3" BELOW THE TOP OF WALLS, UNLESS THERE IS A SLAB ON TOP OF THE WALL, IN WHICH CASE IT SHALL END AT THE BOTTOM OF THE SLAB. IN JOINTS WHERE WATERSTOP TERMINATES AT ADJOINING SLAB OR WALL, WATERSTOP SHALL BE EMBEDDED IN ADJOINING SLAB OR WALL A MINIMUM OF 6".
- WATERSTOP SHALL BE PLACED IN ALL CONSTRUCTION, CONTRACTION, AND EXPANSION JOINTS IN ALL WATER BEARING SLABS AND WALLS UNLESS OTHERWISE INDICATED ON THE DRAWINGS, AND IN ALL WALLS AND SLABS SUBJECTED TO EARTH BACKFILL. WATERSTOP IN THE WALLS SHALL BE CARRIED INTO SLABS AND SHALL BE SPLICED WITH THE WATERSTOP IN THE SLABS.
- NO BACKFILL SHALL BE PLACED AGAINST WALLS UNTIL CONCRETE HAS REACHED THE SPECIFIED STRENGTH AND THE CONNECTING SLABS AND BEAMS HAVE BEEN CAST AND HAVE REACHED THE SPECIFIED STRENGTH.

12. LAP SPLICES:

- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, THE LENGTH OF THE LAP SPlice SHALL BE CLASS "A" WHEN NO MORE THAN 1/2 THE BARS ARE LAP SPLICED WITHIN THE TABULATED LENGTH AND CLASS "B" WHEN MORE THAN 1/2 THE BARS ARE LAP SPLICED WITHIN THE TABULATED LENGTH.
- VALUES TABULATED BELOW FOR SPLICES ARE APPLICABLE ONLY WHEN THE COVER IS EQUAL TO ONE BAR DIAMETER OR MORE.
- WHEN MULTIPLE BARS ARE SPLICED AT THE SAME SECTION, THE CLEAR BAR SPACING IS THE MINIMUM CLEAR DISTANCE BETWEEN THE BARS OUTSIDE THE SPlice LENGTH MINUS ONE BAR DIAMETER.
- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, THE BARS AT A LAP SPlice SHALL BE IN CONTACT WITH EACH OTHER.
- FOLLOWING TABULATED VALUES ARE CALCULATED FOR:
Fy = 60,000 PSI
Fc = 4,000 PSI
- TOP BARS ARE ALL HORIZONTAL REINFORCEMENT SO PLACED THAT MORE THAN 12 INCHES OF FRESH CONCRETE IS CAST IN THE MEMBER BELOW THE BAR.
- HORIZONTAL BARS IN CIRCULAR WALLS OF HYDRAULIC STRUCTURES SHALL BE SPLICED WITH CLASS "B" TOP BAR LAP SPLICES WITH THE SPLICES IN EACH LAYER OF REINFORCEMENT STAGGERED ONE SPlice LENGTH.
- WHERE HORIZONTAL BARS IN WALL CORNERS OR JUNCTIONS ARE LAPPED, LARGER BAR DIAMETER GOVERNS THE LENGTH ON DOWEL SEGMENTS.

REINFORCING BAR LAP SPlice					
BAR #	MINIMUM CLEAR BAR SPACING (BAR DIA)	LAP SPlice LENGTH (INCHES)			
		TOP BARS		OTHER BARS	
		CLASS "A"	CLASS "B"	CLASS "A"	CLASS "B"
REQUIREMENT FOR WALLS AND SLABS *					
#4	MORE THAN 2	18	24	14	18
#5	MORE THAN 2	23	30	18	23
#6	MORE THAN 2	31	40	23	31
	5	28	36	21	28
#7	MORE THAN 2	42	54	32	42
	5	33	43	26	33
#8	MORE THAN 2	54	71	42	54
	5	43	56	33	43
#9	MORE THAN 2	69	89	53	69
	5	55	71	42	55
#10	MORE THAN 2	88	114	67	88
	5	70	91	54	70
#11	MORE THAN 2	108	140	83	108
	5	86	112	66	86

* FOR INNER LAYER OF REINFORCEMENT IN WALLS AND SLABS, THE LAP SPlice LENGTH OF #9, #10, AND #11 BARS MAY BE REDUCED BY 25 PERCENT IF CLEAR SPACING IS THREE BAR DIAMETERS OR MORE.

13. REFER TO MECHANICAL PROCESS SHEETS FOR CONCRETE WALL AND SLAB PENETRATIONS. ADDITIONAL REINFORCING SHALL BE PROVIDED AT CONCRETE WALL AND SLAB PENETRATIONS PER

TYP310

INCLUDE IN REINFORCING SHOP DRAWINGS REINFORCING DETAILS FOR CONCRETE WALL AND SLAB PENETRATIONS THAT ARE 6 INCH AND LARGER IN DIAMETER.

14. IN CASE ANY CONSTRUCTION JOINT IS REQUIRED FOR WALLS OF STRUCTURE, CONTRACTOR MAY PROPOSE LOCATION FOR REVIEW AND APPROVAL BY ENGINEER OF RECORD PRIOR TO CONSTRUCTION.

15. CONCRETE MIX DESIGNS SHALL BE SUBMITTED FOR ALL CONCRETE USED. CONCRETE MIX DESIGNS SHALL BE FURNISHED BY EITHER THE CONCRETE SUPPLIER OR AN INDEPENDENT TESTING LABORATORY, BASED ON THE CONCRETE SUPPLIER'S CURRENT PRODUCTION FACILITIES RECORD OF STRENGTH TESTS. THESE TESTS SHALL BE EVALUATED AND MIX DESIGNS PROPORTIONED TO MEET THE REQUIREMENTS BASED ON THE STANDARD DEVIATIONS AS OUTLINED IN ACI 318–89, SECTION 5.2. RESULTS OF CONCRETE CYLINDER COMPRESSION BREAK TESTS FOR PROPOSED DESIGN MIX SHALL BE INCLUDED IN THE SUBMITTAL. POZZOLAN "F" (FLY-ASH) SHALL BE USED PROVIDED THE CEMENT CONTENT OF THE ORIGINAL MIX WITHOUT FLY-ASH IS NOT REDUCED BY MORE THAN 20% BY WEIGHT AND THE FLY-ASH ADDED DOES NOT EXCEED 1.3 POUNDS FOR EACH POUND OF CEMENT REMOVED. OTHER ADMIXTURES MAY BE USED; HOWEVER, THEY SHALL NOT BE CONSIDERED AS REPLACING ANY PART OF THE CEMENT CONTENT FOR THE SPECIFIED CONCRETE STRENGTH. NO ALUMINUM CONDUITS OR PIPES SHALL BE EMBEDDED IN OR ATTACHED TO THE CONCRETE. COLD WEATHER AND HOT WEATHER CONCRETING SHALL BE PLACED ACCORDING TO RECOMMENDED PRACTICES IN ACI 306 AND ACI 305, RESPECTIVELY.

REINFORCING STEEL:
ALL REINFORCING STEEL FOR THE PROJECT SHALL BE DEFORMED BARS AND SHALL CONFORM TO THE FOLLOWING ASTM STANDARD DESIGNATIONS:

#4 BAR AND LARGER IN CONCRETE.....A–615 GRADE 60
MASONRY REINFORCING.....A–615 GRADE 60

CHAIRS AND SUPPORT BARS SHALL BE PROVIDED IN ACCORDANCE WITH ACI STANDARDS. REINFORCEMENT SHALL BE DETAILED TO MEET ACI 315 STANDARDS. SHOP DRAWINGS SHALL BE SUBMITTED SHOWING ALL REINFORCEMENT TO BE PLACED. SHOP DRAWINGS SHALL INCLUDE PLAN AND ELEVATIONS PERTAINING TO BAR LOCATION AND PLACEMENT WITHIN FOUNDATIONS, SLABS, BEAMS, COLUMNS AND WALLS.

METALS

- STRUCTURAL STEEL: STRUCTURAL STEEL SHALL BE ASTM A 36 GRADE. BOLTS A 307. TUBE STEEL AND PIPE STEEL SHALL BE ASTM A 500 GRADE B, FY = 46 KSI FOR TUBE STEEL AND 42 KSI FOR PIPE STEEL AND WELDABLE PER AWS D1.4. LATEST AISC AND AWS CODES APPLY. FABRICATOR SHALL SUBMIT SHOP DRAWINGS FOR REVIEW BEFORE FABRICATION. MINIMUM EMBEDMENT OF ALL HORIZONTAL BOLTS IN GROUT OR CONCRETE SHALL BE 6" WITH 3" HOOK. VERTICAL BOLTS SHALL HAVE 10" EMBEDMENT WITH HEAVY HEX NUT AT EMBEDDED END, UNO.
- WELDING: ALL CONSTRUCTION AND TESTING SHALL BE PER AWS CODES AND RECOMMENDATIONS. WELDING SHALL BE DONE IN SHOP UNLESS SHOWN OTHERWISE ON PLANS. FIELD WELDS SHALL BE APPROVED BY THE ENGINEER. ALL WELDING SHALL BE BY WELDERS HOLDING CURRENT VALID CERTIFICATES ISSUED BY AN ACCEPTED TESTING AGENCY AND HAVING EXPERIENCE IN THE TYPE OF WELD CALLED FOR.
- ALUMINUM: ALUMINUM FOR THIS PROJECT SHALL BE OF TYPE 6063. ALUMINUM TO BE CAST INTO CONCRETE SHALL RECEIVE COATING OF COAL TAR EPOXY OR SIMILAR.
- STAINLESS STEEL: STAINLESS STEEL SHALL BE 316 GRADE UNLESS NOTED OTHERWISE.

PRECAST WETWELL FLAT TOP SLAB:

- DESIGN LOADINGS: 1,500 POUND POINT LOAD AT CENTER OF SLAB OR 150 PSF, WHICHEVER RESULTS IN THE HIGHER LOADING CONDITION.

SUPPLEMENTARY NOTES:

- PROVIDE TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO AVOID EXCESSIVE STRESSES AND TO HOLD STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION.
- ANY MEMBERS REQUIRED TO SUPPORT EQUIPMENT FROM THE FRAMING SHOWN SHALL BE DESIGNED AND PROVIDED BY THE CONTRACTOR.
- FOR CONNECTIONS SEE DETAILS. IF NOT SHOWN OR NOTED, MINIMUM CONNECTIONS TO BE INCLUDED IN BID SHALL BE TWO 5/8" DIA. BOLTS OR 3/16" FILLET WELD 4" LONG USING 1/4" CONNECTION MATERIAL AND DETAILED TO MINIMIZE BENDING IN CONNECTION. PROCEED AFTER CLARIFICATION THROUGH SHOP DRAWING SUBMITTAL.
- ANY ENGINEERING DESIGN PROVIDED BY OTHERS AND SUBMITTED FOR REVIEW SHALL BE BY A STRUCTURAL ENGINEER REGISTERED IN ARIZONA WITH CONTINUOUS FIVE YEARS EXPERIENCE IN THE TYPE OF DESIGN SUBMITTED.
- UNLESS NOTED OTHERWISE, DETAILS ON STRUCTURAL DRAWINGS ARE TYPICAL AS INDICATED BY CUTS, REFERENCES OR TITLES.
- IN CASE OF CONFLICTS, MORE COSTLY REQUIREMENTS GOVERN FOR BIDDING. SUBMIT CLARIFICATION REQUEST PRIOR TO PROCEEDING WITH WORK.
- VERIFY ALL DIMENSIONS WITH OTHER DISCIPLINE DRAWINGS.
- CONTRACTOR SHALL ESTABLISH AND VERIFY IN THE FIELD ALL EXISTING CONDITIONS AFFECTING NEW CONSTRUCTION.
- DO NOT SCALE DRAWINGS. IN CASE OF ANY CONFLICT VERIFY WITH ENGINEER PRIOR TO CONSTRUCTION.
- "TYP" INDICATES DETAIL OCCURS MORE THAN ONCE. CONTRACTOR SHALL DETAIL ALL SUCH OCCURRENCES ON SHOP DRAWINGS SUBMITTALS.
- SHOP DRAWINGS INVOLVING STRUCTURAL CALCULATIONS SHALL BE STAMPED AND SIGNED BY CIVIL OR STRUCTURAL ENGINEER REGISTERED IN THE STATE OF ARIZONA.
- A. SPECIAL INSPECTION IS REQUIRED PER CODE FOR ALL STRUCTURAL REINFORCED CONCRETE WORK.
B. SPECIAL INSPECTION IS ALSO REQUIRED FOR FIELD WELDING, AND INSTALLATION OF EPOXY BOLTS.
C. PER BUILDING CODES CH. 17 NOTE: SPECIAL INSPECTIONS DO NOT PRECLUDE ANY NTUA INSPECTIONS.

COPYRIGHT © 2012


Check					
Drawn					
Date					
Revision					
Note					
No.					

NAVAJO TRIBAL UTILITY AUTHORITY
TOWN OF GANADO - WASTEWATER TREATMENT IMPROVEMENTS

GENERAL STRUCTURAL NOTES




Drawn by:	KWB
Design by:	LAH
Approved by:	RN
Date	05/24/23
Project No.	2338
Sheet No.	G-04

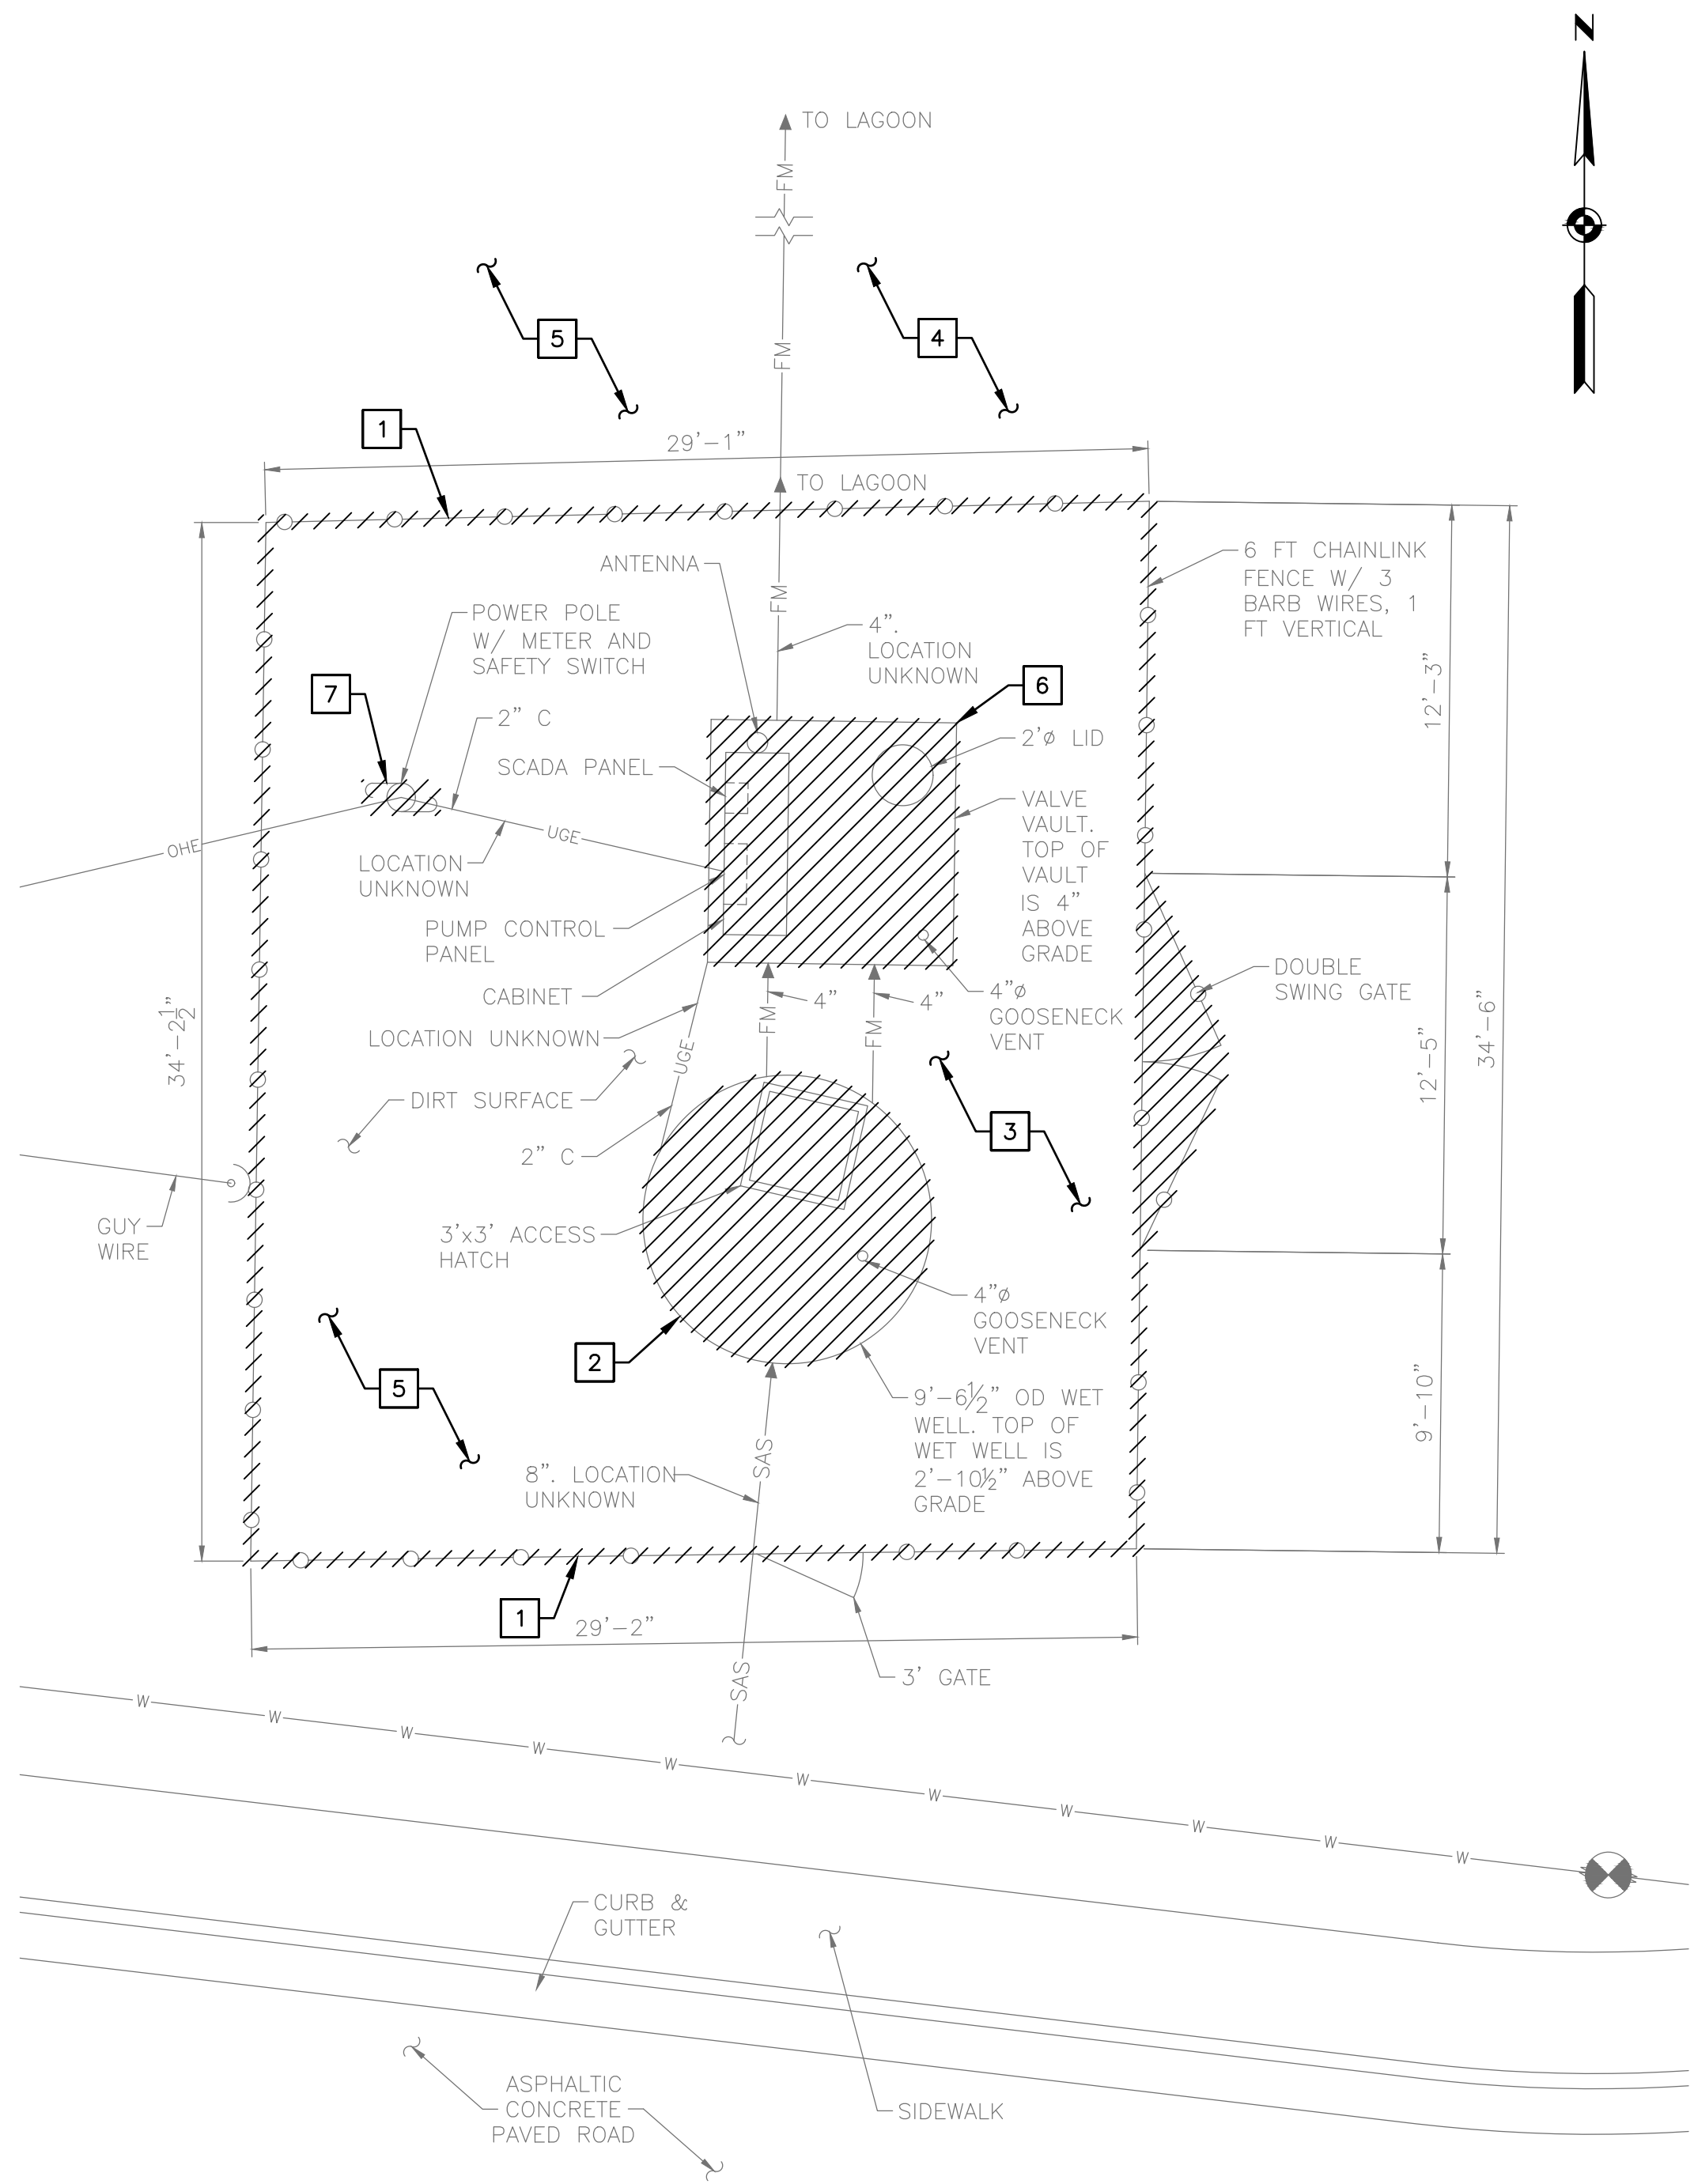

SITE DEMOLITION PLAN

SCALE: 1"=5'-0"

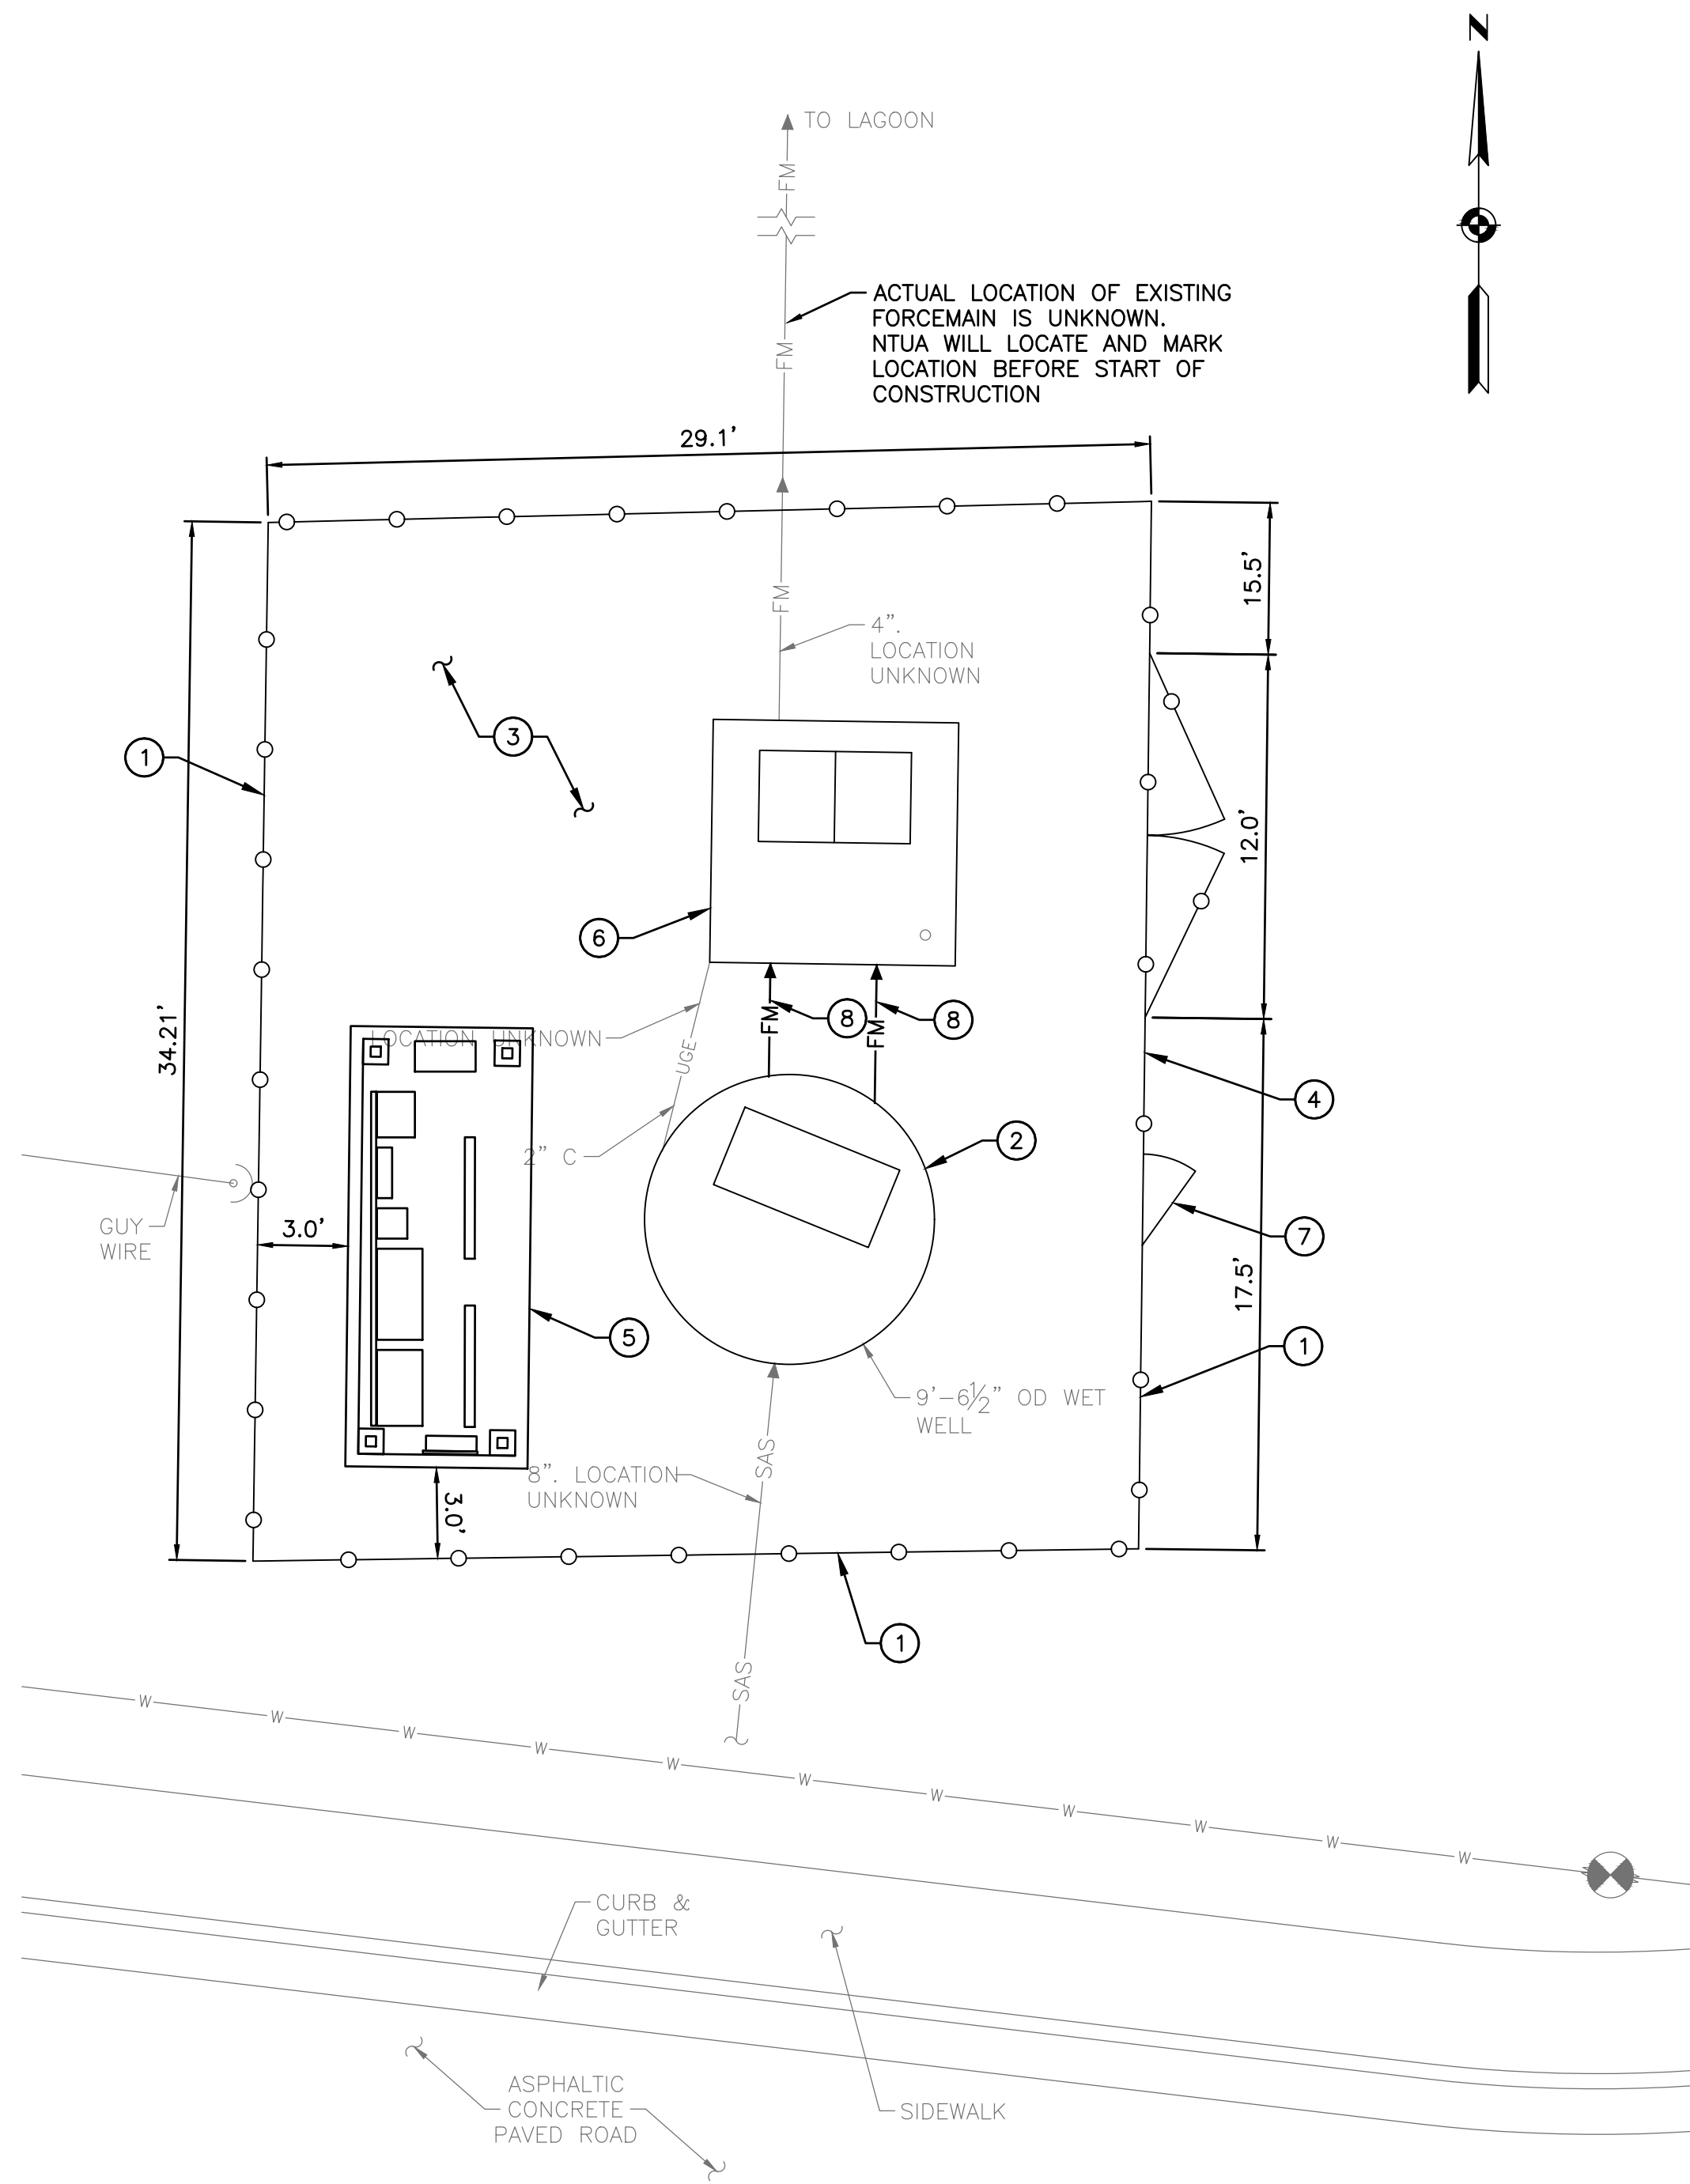

SITE IMPROVEMENTS PLAN

SCALE: 1"=5'-0"



REMOVALS NOTES	
1	REMOVE CHAINLINK FENCE INCLUDING POSTS, FABRIC, BARBED WIRE, AND RELOCATE TO EXPANDED SITE NORTH FENCE LINE.
2	FOR REMOVALS, SEE SHT M-02
3	ADD ALTERNATE A1: REMOVE 4 INCHES OF SOIL WITHIN EXISTING FENCED AREA AND DISPOSE OF.
4	ADD ALTERNATE A1: REMOVE 4 INCHES OF SOIL IN EXPANDED FENCED AREA AND DISPOSE OF. SEE SITE IMPROVEMENTS PLAN FOR NEW FENCE LIMITS.
5	REMOVE WEEDS AND DISPOSE OF, AND PROVIDE NON-HAZARDOUS PRE-EMERGENT HERBICIDE FOR EXISTING AND EXPANDED SITE AREA.
6	FOR REMOVALS, SEE SHT M-03
7	FOR REMOVALS, SEE ELECTRICAL SHEETS
CONSTRUCTION NOTES	
1	6 FT CHAINLINK FENCE WITH 3 BARBED WIRES TO MATCH EXISTING FENCE AND PER SHT C-11. WHERE DEVIATIONS, EXISTING FENCE CONFIGURATION AND MATERIALS SHALL TAKE PRECEDENCE OVER FENCING REQUIREMENTS ON SHT C-03.
2	FOR MODIFICATIONS, SEE SHT M-02.
3	ADD ALTERNATE A1: 4 INCH DEPTH OF 3/4" AGGREGATE BASE COURSE PER MAG 702 WITHIN FENCED AREA. COMPACT TO 95% PER ASTM D1557.
4	SIGN. SEE DETAIL ON SHT M-04. ATTACH TO FENCE W/ NON-CORRODING HARDWARE.
5	SHADE CANOPY, SEE SHT C-02.
6	FOR MODIFICATIONS, SEE SHT M-03.
7	3'-0" WIDE MANGATE
8	4" DIP FORCEMAIN
GENERAL NOTES	
1. POTHOLE EXISTING BURIED PIPING AND ELECTRICAL BEFORE BEGINNING ANY EXCAVATION OR TRENCHING FOR PIPE INSTALLATION.	
2. POTHOLE AND DETERMINE DEPTH, LOCATION, AND PIPE MATERIAL FOR EXISTING BURIED PIPING BEFORE ORDERING PIPE MATERIALS AND BEGINNING TRENCHING.	
3. SEE ELECTRICAL SHEETS FOR ELECTRICAL ITEM REMOVALS.	
4. FOR NEW ELECTRICAL, SEE ELECTRICAL SHEETS.	
5. PROPERTY BOUNDARIES NOT AVAILABLE AND NOT SHOWN. NTUA TO ACQUIRE ADDITIONAL PROPERTIES AS REQUIRED.	

COPYRIGHT © 2012

No.

Revision

Note

Date

Drawn

Check

NAVAJO TRIBAL UTILITY AUTHORITY
DESIGN AND CONSTRUCTION OF FIVE LIFT STATION FACILITIES

COALMINE SITE DEMOLITION PLAN
AND SITE IMPROVEMENTS PLAN

NCS
Engineers
202 E. Earll Drive Suite 110
Phoenix, AZ 85012
Phone (602)629-0206
www.ncseng.com

Professional Engineer
RAMESH NARASIMHAN
28112
ARIZONA, U.S.A.
EXPIRATION DATE: 09/30/24

Drawn by: KWB

Design by: LAH

Approved by: RN

Date: 05/24/23


Project No.: 2338

Sheet No.: C-01

No.	Revision	Note	Date	Drawn	Check

NAVAJO TRIBAL UTILITY AUTHORITY
DESIGN AND CONSTRUCTION OF FIVE LIFT STATION FACILITIES

SHADE CANOPY PLAN AND SECTIONS

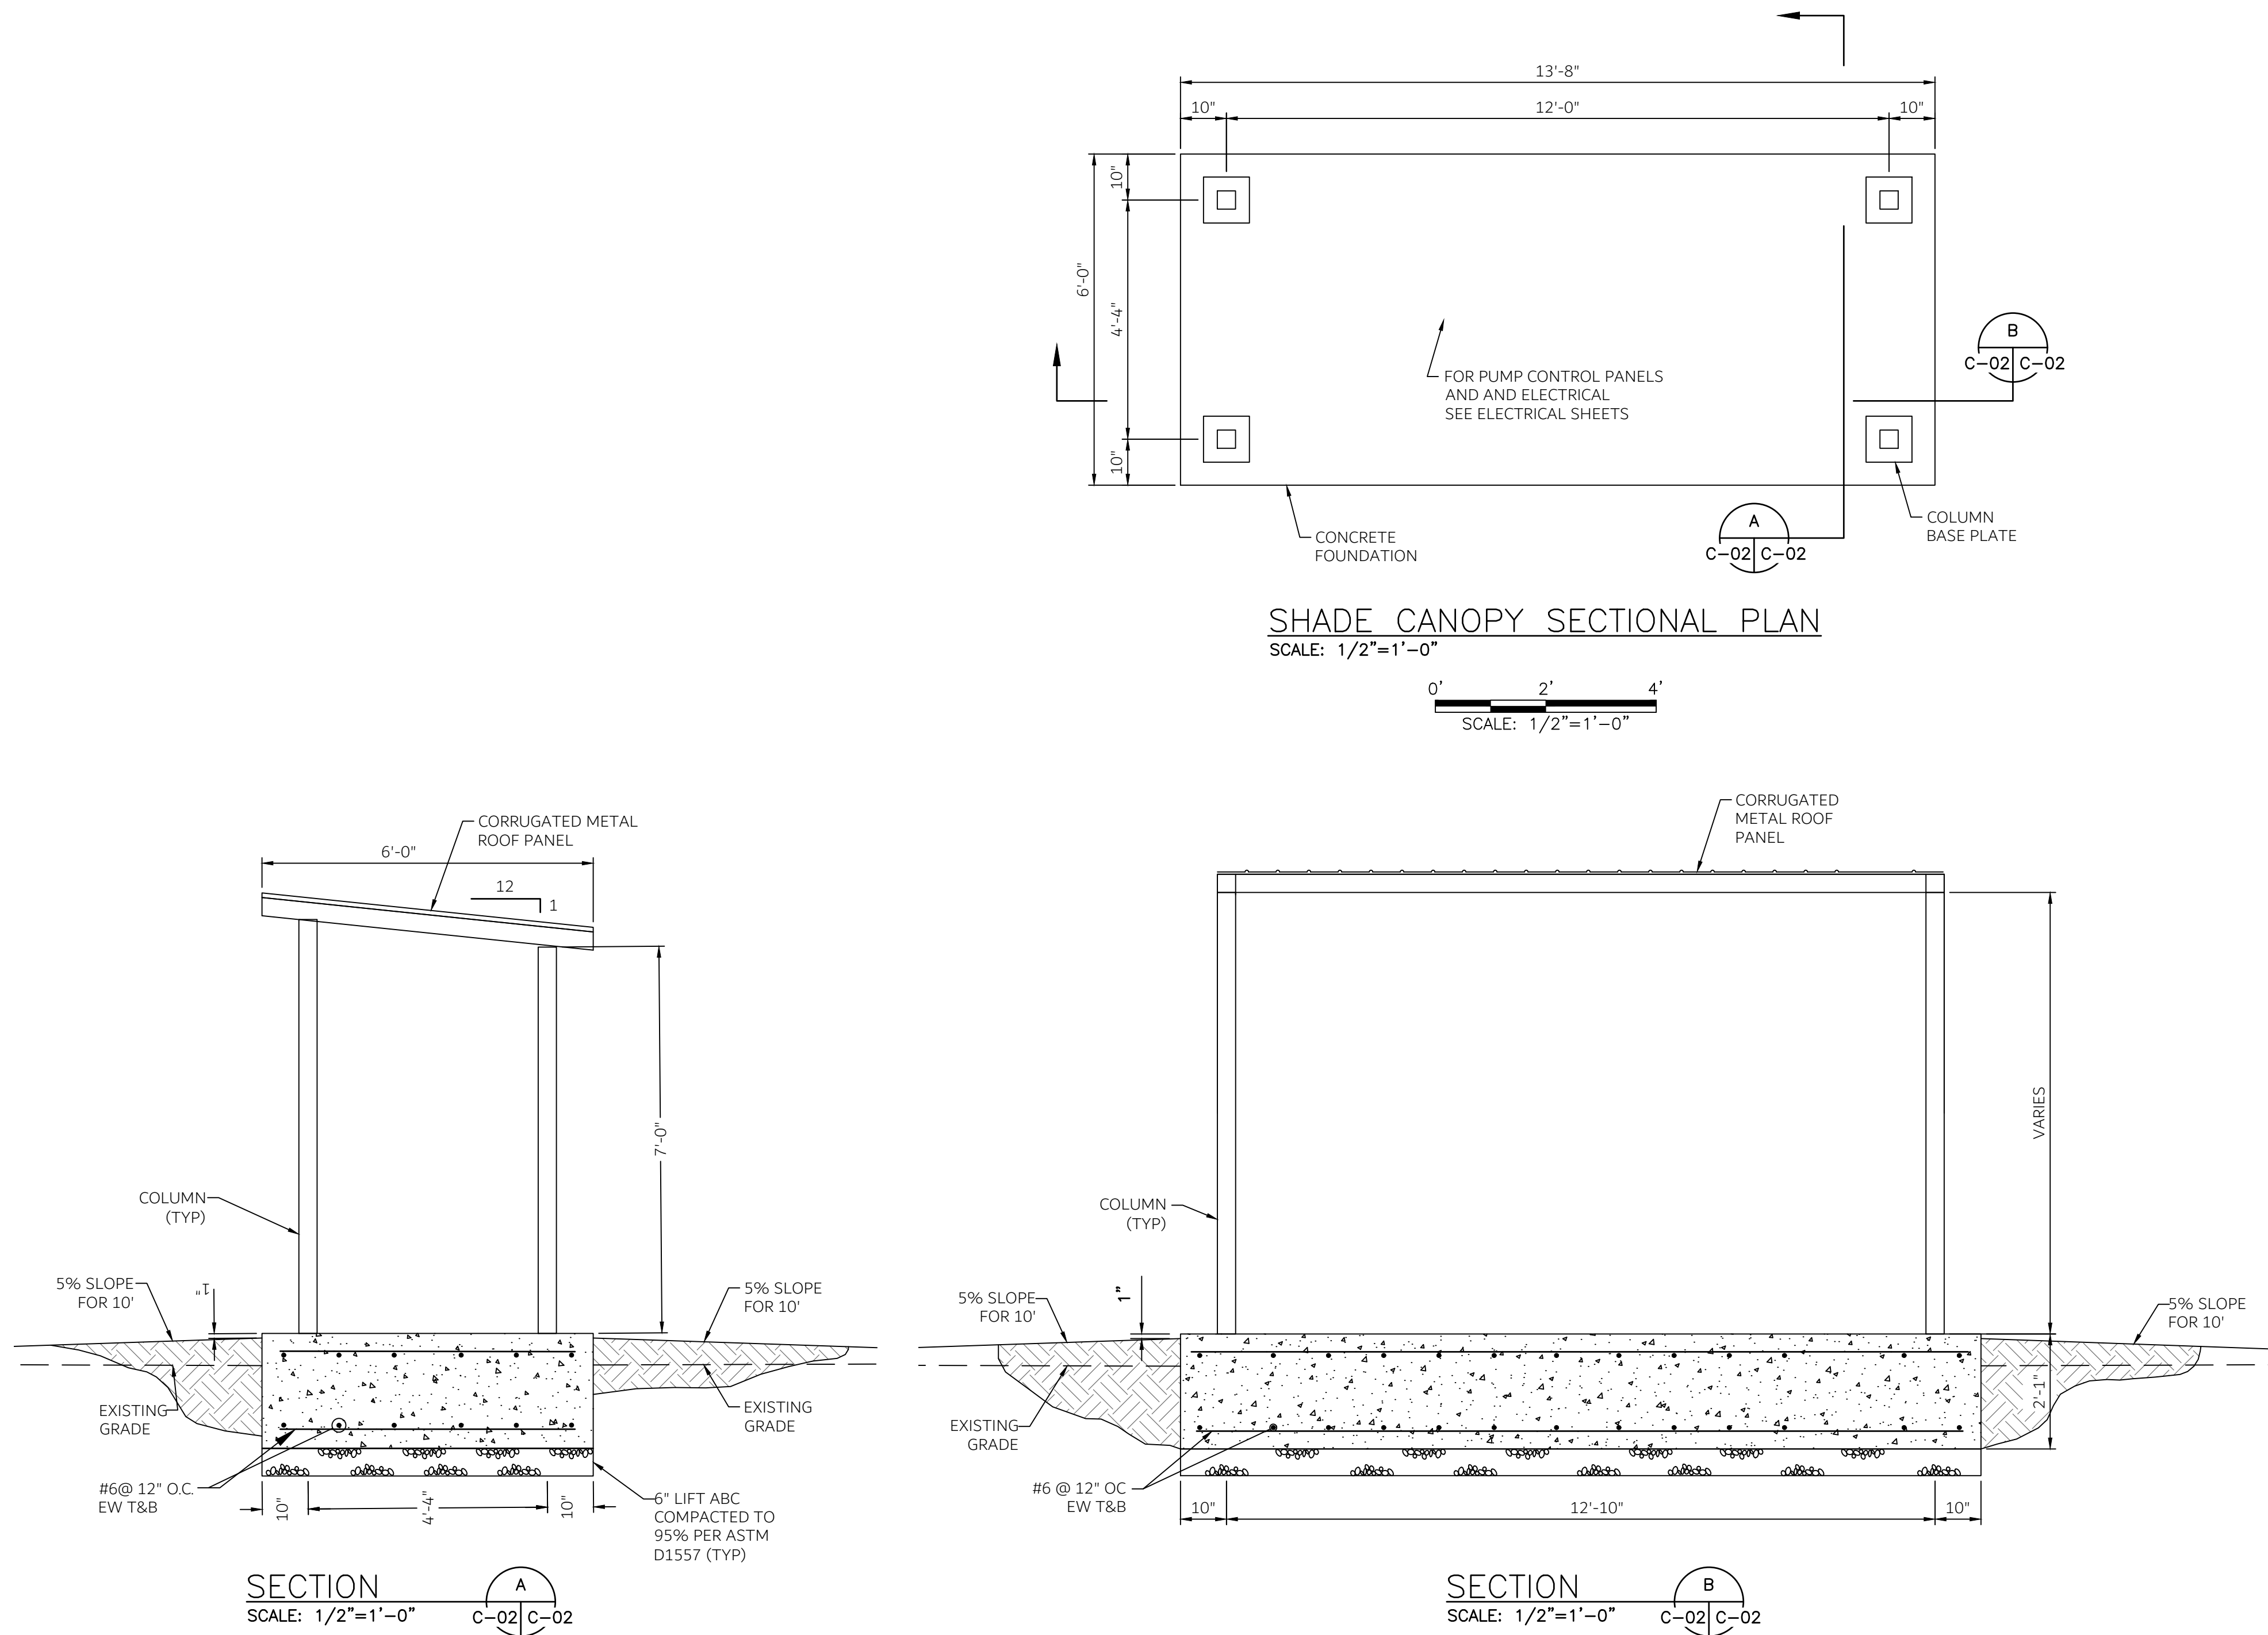


NOTES:




- SHADE CANOPIES STRUCTURAL DESIGN AND ANCHORAGE SYSTEM TO FOUNDATION SHALL BE BY ALUMA-LINE (PHOENIX, AZ) INC OR APPROVED EQUAL. SHADE CANOPY MANUFACTURER SHALL DESIGN AND PROVIDE SHOP DRAWING FOR CANOPIES. DESIGN CALCULATION AND SHOP DRAWINGS SHALL BE SEALED BY AN ARIZONA LICENSED PROFESSIONAL ENGINEER.
- CORRUGATED STEEL ROOF PANELS SHALL BE BY MBCI OR APPROVED EQUAL. COATING SHALL BE SIGNATURE 200 FACTORY APPLIED AND BAKED-ON OVER GALVALUME. COLOR WILL BE SELECTED BY NTUA.
- FASTENERS SHALL BE NON-CORRODING MATERIAL.
- EPOXY ANCHOR BOLTS DESIGN BY ALUMA-LINE'S STRUCTURAL DESIGNER.
- SEE SHT G-04 FOR GENERAL STRUCTURAL NOTES. THE SCADA ANTENNA POLE SHALL BE MOUNTED ON THE SHADE CANOPY. SEE DETAIL ON SHT E-22.



202 E. Earll Drive Suite 110
Phoenix, AZ 85012
Phone (602)629-0206
www.ncseng.com

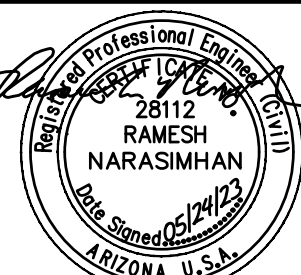

Drawn by: JJC
Design by: LAH
Approved by: RN
Date: 05/24/23
Project No. 2338
Sheet No. C-02

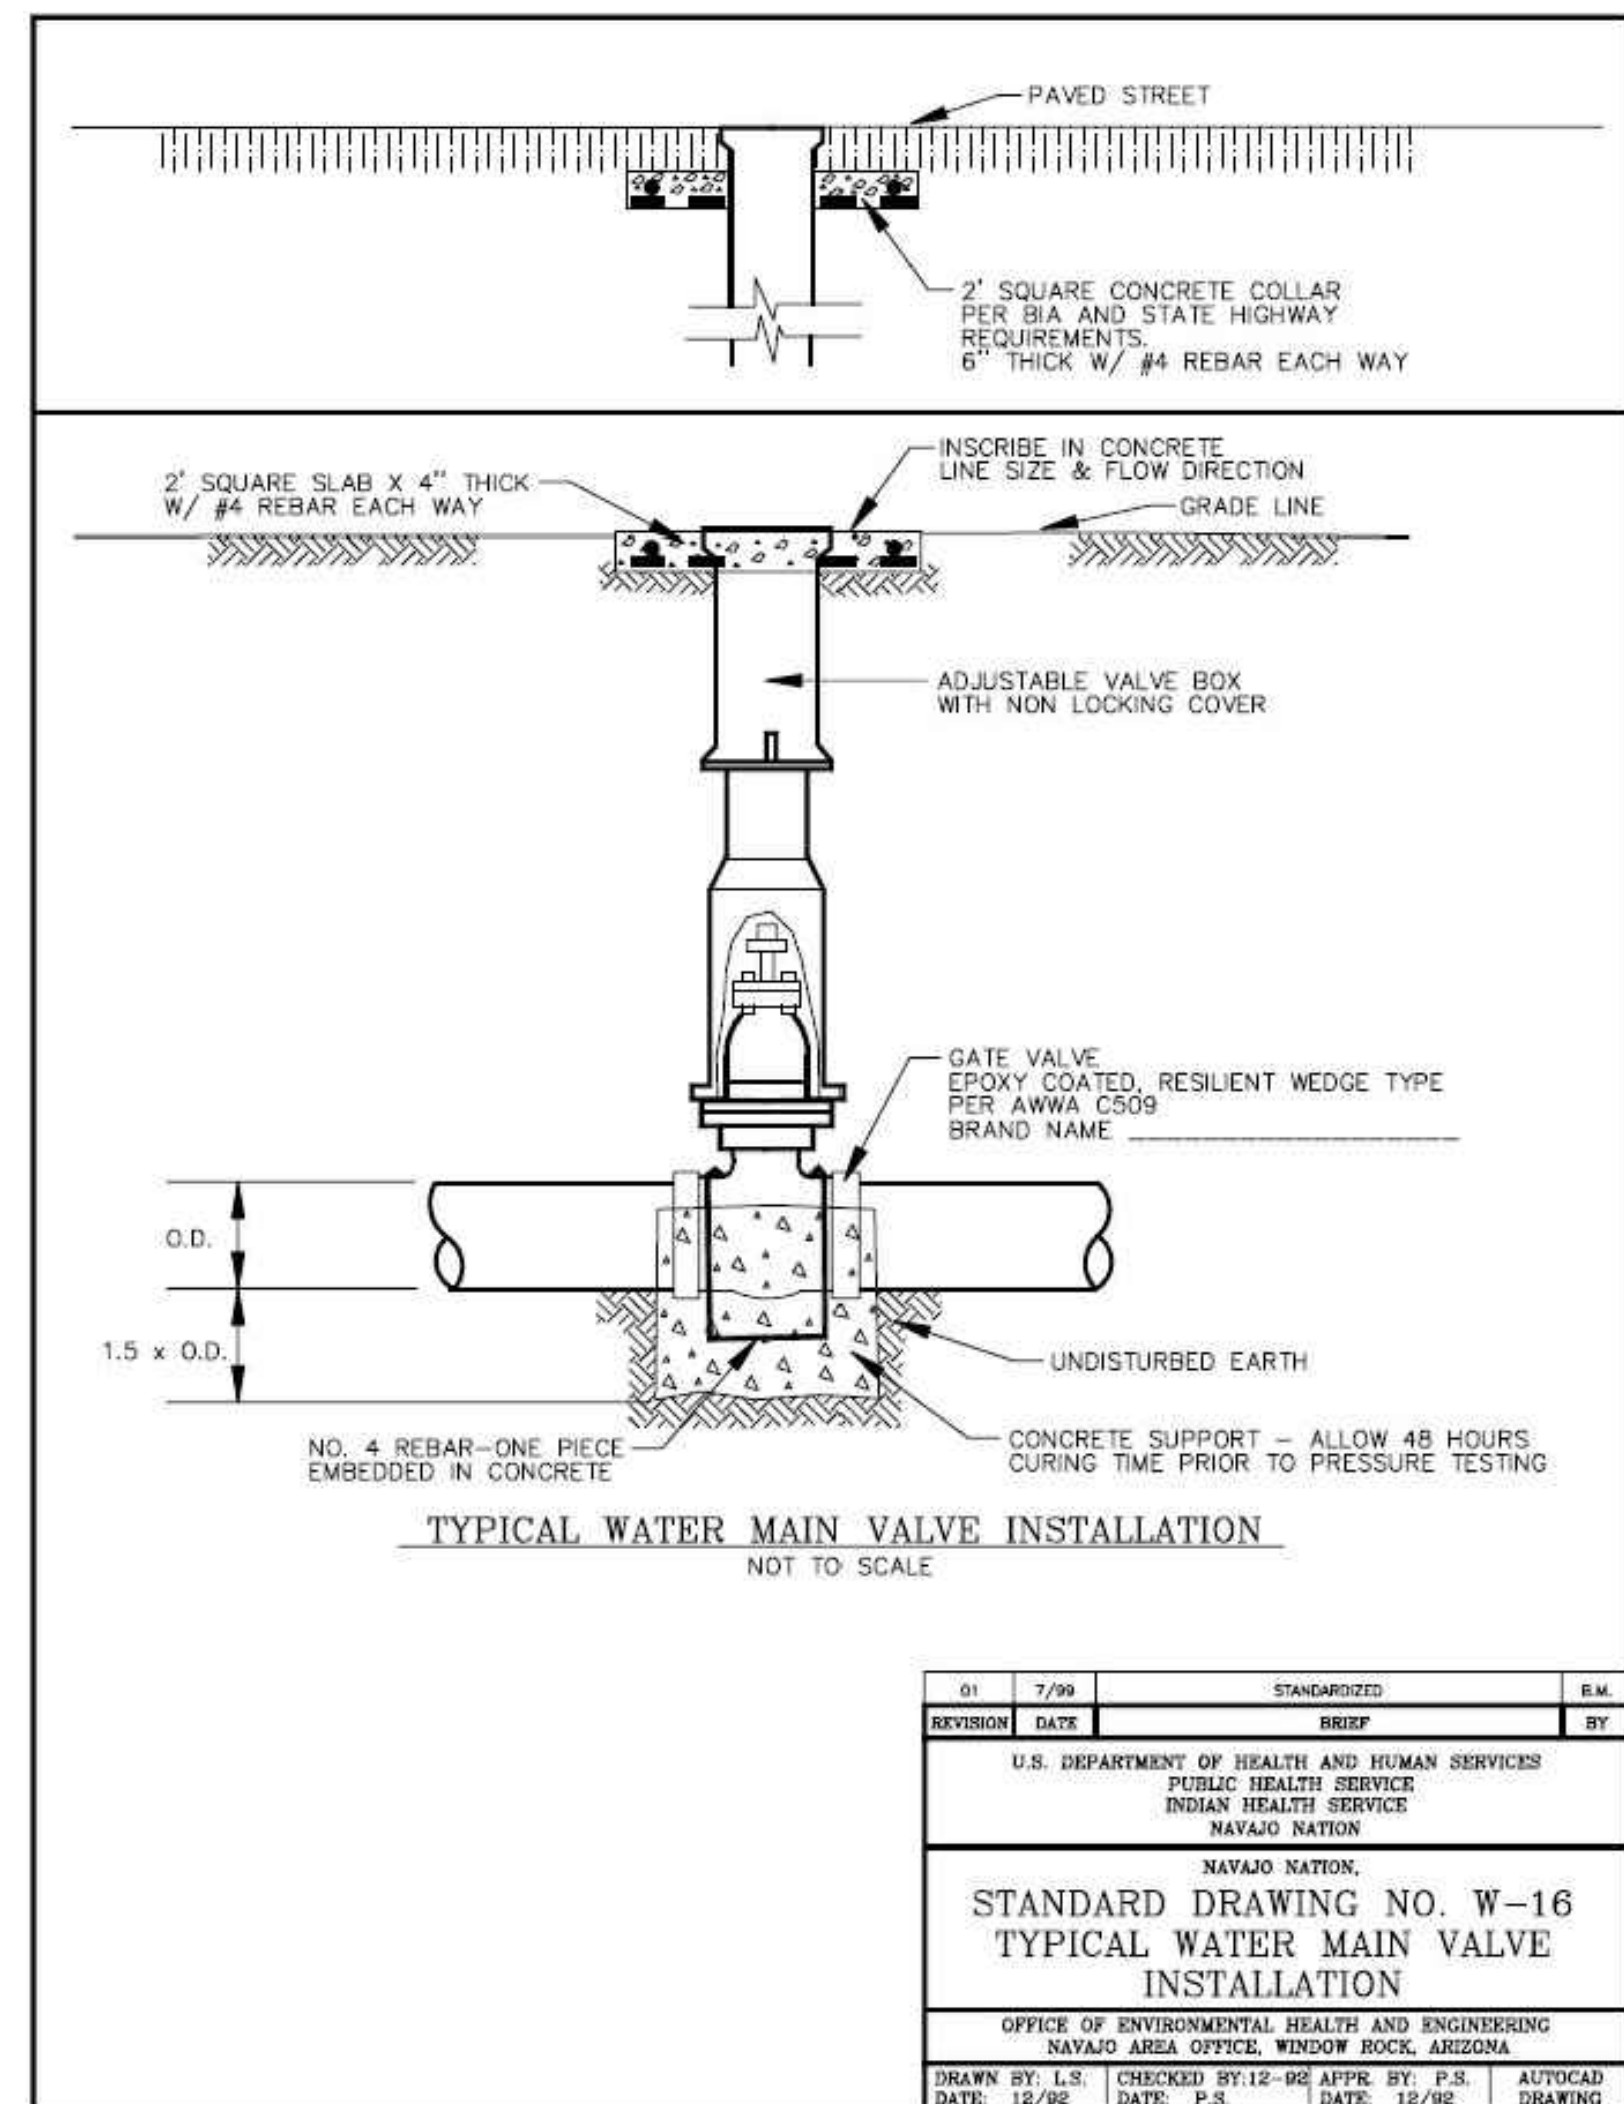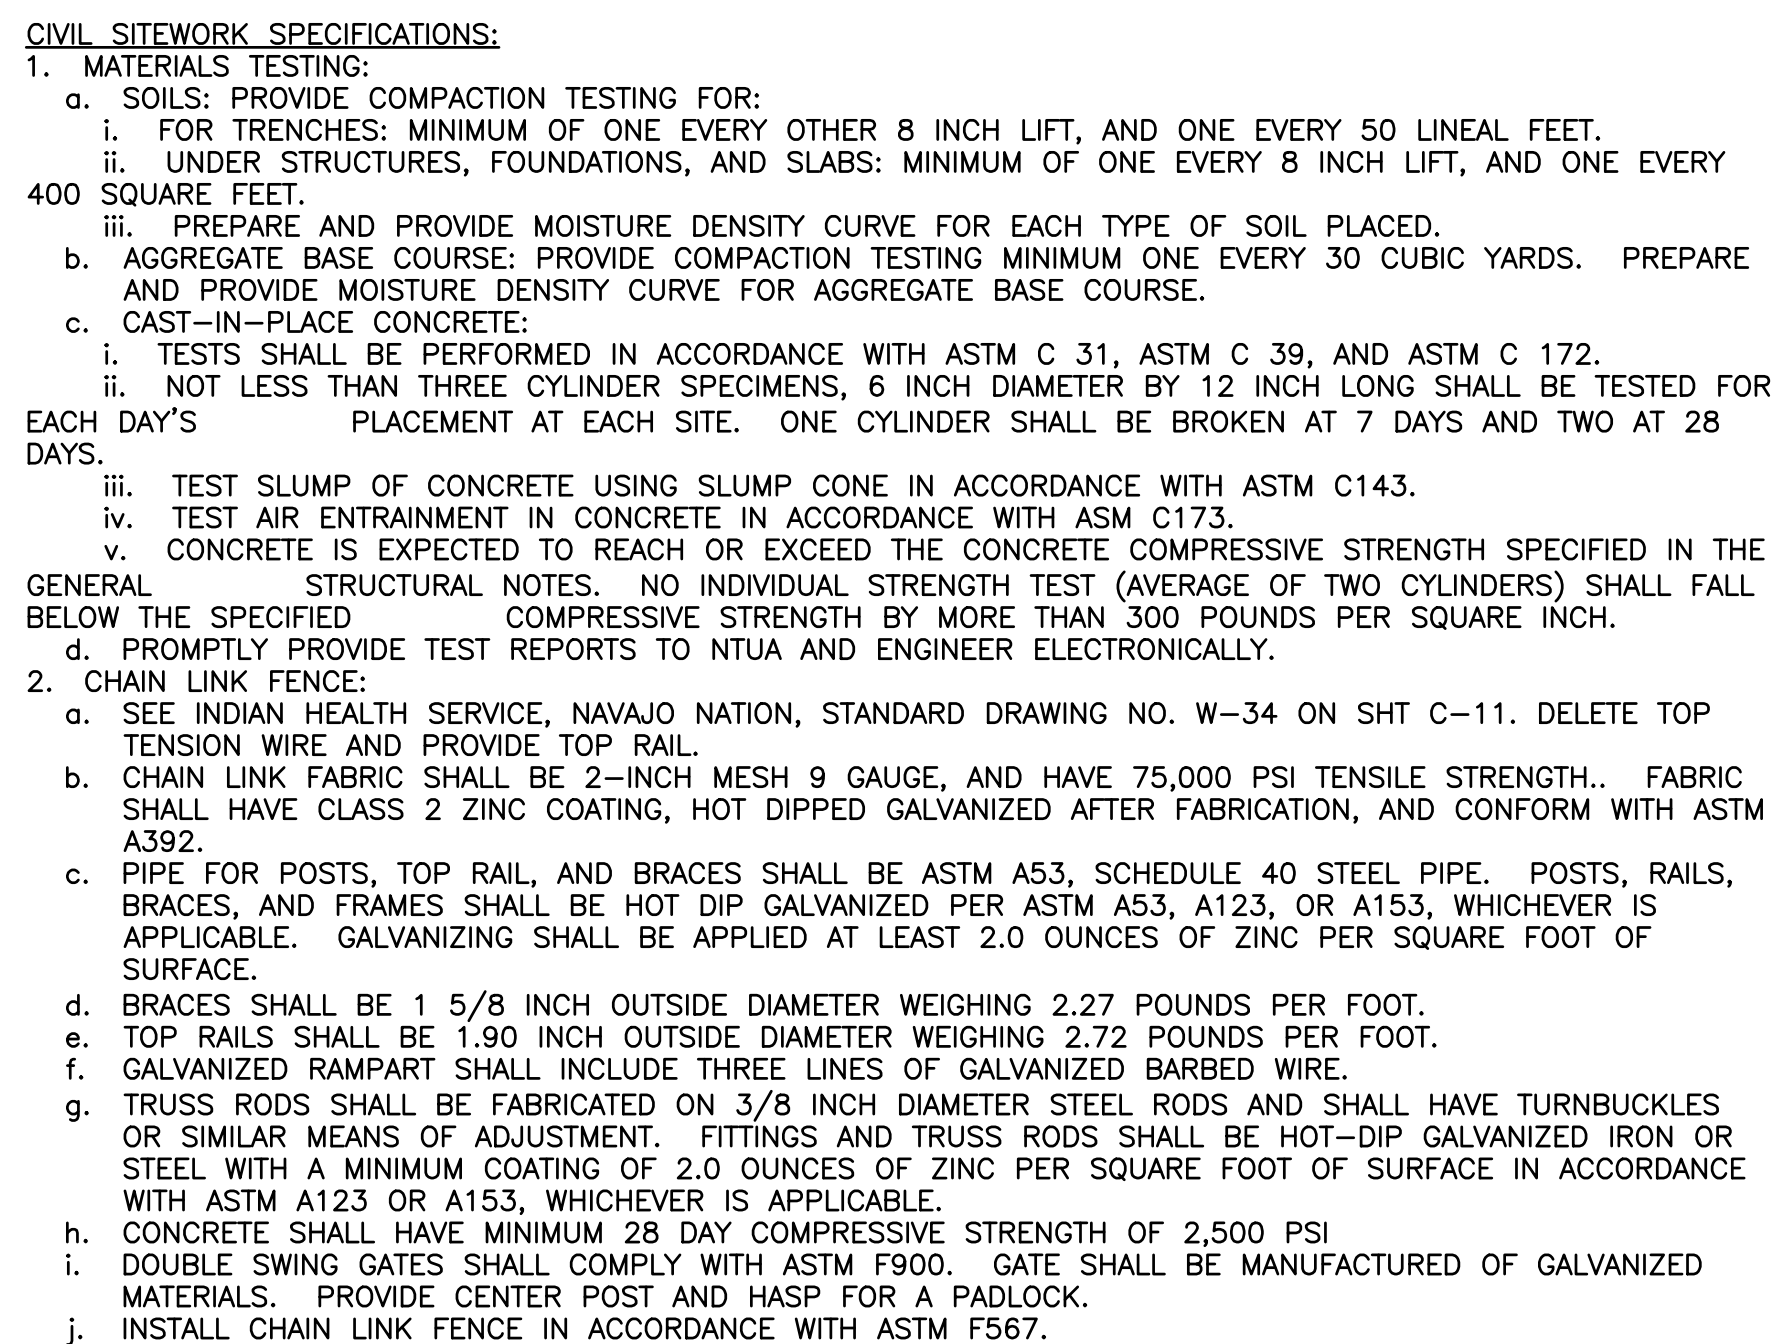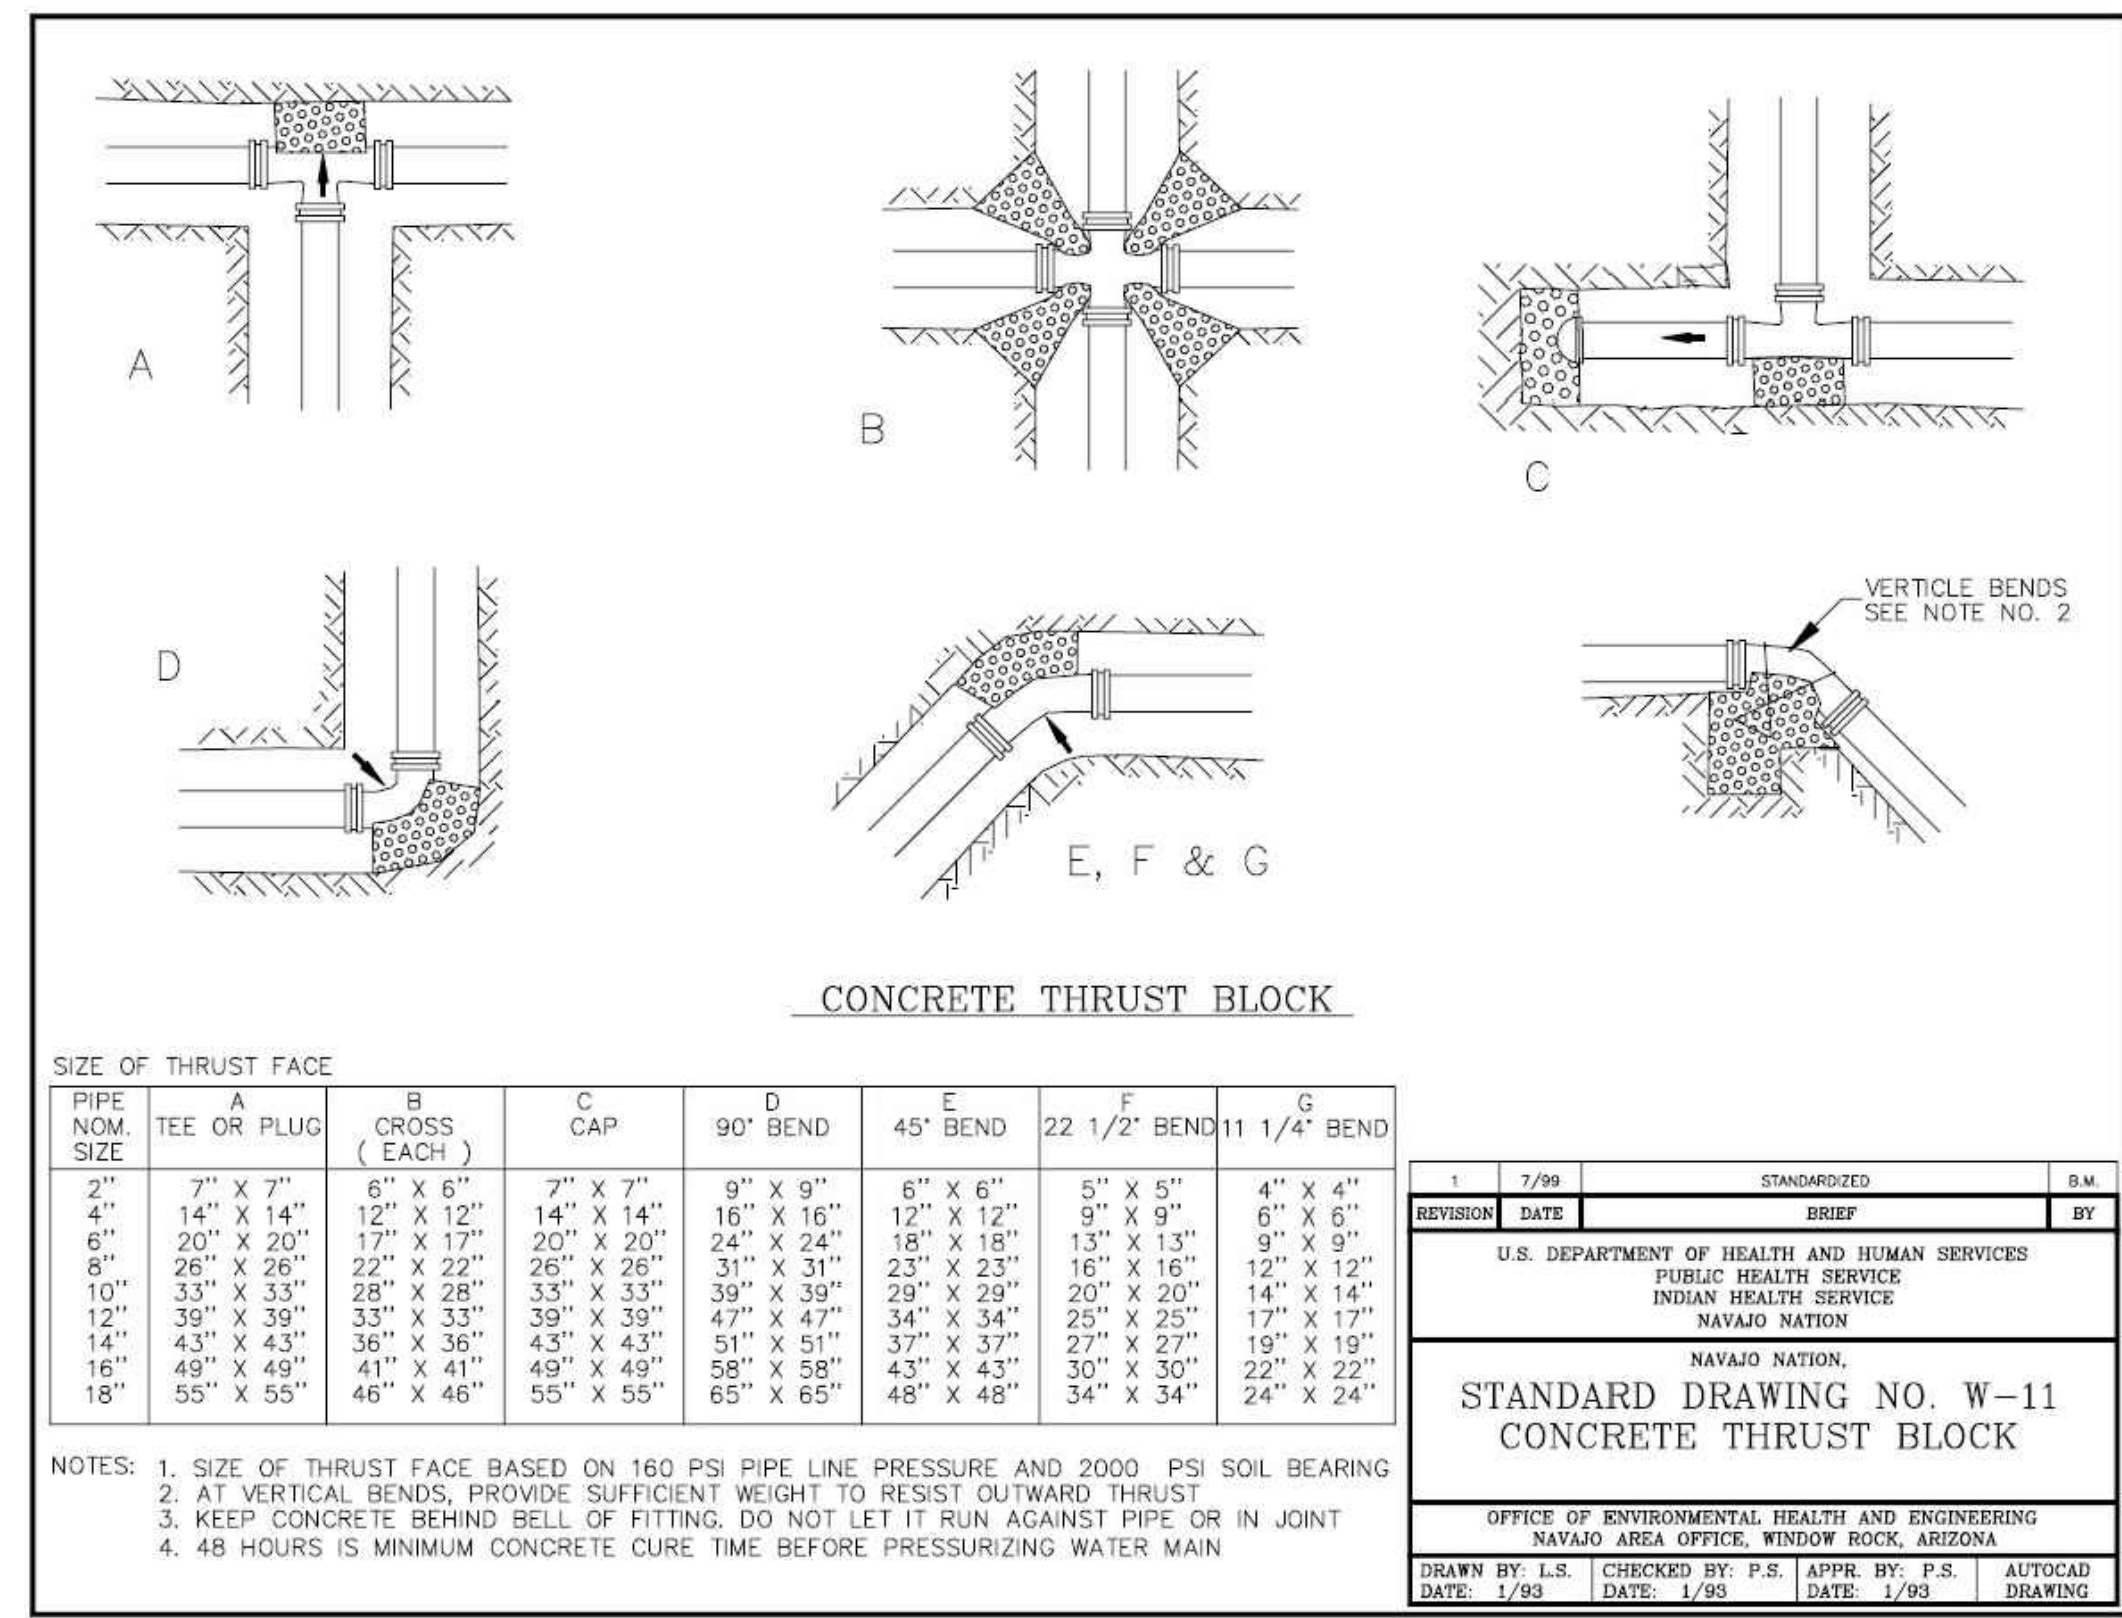

Pump Schedule							
Site	Design Capacity (gpm)	Design Head (ft)	Shut off Head (ft)	Pump Configuration	Max Pump Speed (rpm)	Nameplate driver horsepower	Drive Type
Coal Mine	160	80	75	Submersible	1801	7.5 HP, 460V, three phase, explosion proof	Constant Speed

EQUIPMENT AND MATERIALS SPECIFICATIONS

DUCTILE IRON PIPE AND FITTINGS:
PIPE SHALL BE IN ACCORDANCE WITH ANSI/AWWA C-151/A21.51.
FITTINGS SHALL BE IN ACCORDANCE WITH AWWA C-153/ANSI A21.53, AND AWWA C-115/ANSI A21.15 FOR FLANGED PIPE AND AWWA C-111/ANSI A21.11 FOR MECHANICAL JOINT PIPE.
FOR PUMP-AROUND PORT SYSTEM: FITTINGS SHALL HAVE FUSION BONDED EPOXY INTERIOR COATING PER AWWA C116/ANSI A21.16. PIPE SHALL HAVE CERAMIC AMINE CURED NOVALAC EPOXY INTERIOR COATING, 40 MILS.
MEGA-LUG OR APPROVED EQUAL FOR RESTRAINING JOINTS.
BURIED PIPING SHALL BE PROVIDED WITH POLYETHYLENE ENCASEMENT PER ASTM A674.

PVC PRESSURE PIPE:
PIPE SHALL BE IN ACCORDANCE WITH AWWA C-900. WHERE APPLICABLE, PIPE SHALL MATCH THE SDR OF EXISTING PIPE IT IS CONNECTING TO.

PVC GRAVITY SEWER PIPE:
PIPE SHALL BE SDR 35 IN ACCORDANCE WITH ASTM D-3024.

STAINLESS STEEL PIPE AND MISCELLANEOUS SUPPORTS:
PIPE SHALL BE SCHEDULE 40 IN ACCORDANCE WITH ANSI 36.19.
MISCELLANEOUS SUPPORT BRACKETS SHALL BE IN ACCORDANCE WITH ASTM A-276.
FASTENERS SHALL BE IN ACCORDANCE WITH ASTM A320: BOLTS GRADE L7, NUTS A194 GRADE 7 AND WASHERS F436.

STEEL PIPE:
PIPE SHALL BE SCHEDULE 40 IN ACCORDANCE WITH AWWA C-200/ASTM A53 AND AWWA C-206.

PLUG VALVES:
VALVES SHALL BE DEZURIK BULLETIN 12.00-1C OR APPROVED EQUAL; IN ACCORDANCE WITH AWWA C-517 AND C-111. CLASS 150 FLANGES SHALL BE IN ACCORDANCE WITH ANSI B16.5 VALVES SHALL BE FOR BURIED SERVICE WITH NUT OPERATOR.

ALUMINUM ACCESS HATCHES:
HATCHES SHALL BE HALLIDAY SERIES SERIES S, ALL STANDARD FEATURES WITH FALL THROUGH PROTECTION GRATING OR APPROVED EQUAL. HATCH DIMENSIONS SHALL BE AS SHOWN ON THE DRAWINGS. FOR FALL THROUGH PROTECTION PROVIDE HASP FOR NTUA TO UTILIZE PADLOCK.

PORTABLE PUMP LIFTING HOISTS:
HOISTS SHALL BE HALLIDAY SERIES DB WITH ALL STANDARD FEATURES OR APPROVED EQUAL. HOIST CAPACITY SHALL BE 1,330 LBS MINIMUM WITH THE DAVIT ARM EXTENDED PERPENDICULAR TO THE MAST, PARALLEL TO TOP OF WET WELL. PROVIDE HOISTS AS SHOWN FOR EACH LIFT STATION SITE (5 TOTAL).

POLYURETHANE COATINGS FOR WET WELLS:
COATING FOR INTERIOR OF LIFT STATIONS: REMOVE SEWERAGE FROM WETWELLS, CLEAN SURFACES, AND PREPARE SURFACES FOR COATING. SURFACE PREPARATION SHALL BE PER COATING MANUFACTURER'S RECOMMENDATIONS AND SHALL INCLUDE AT MINIMUM, ABRASIVE BLAST AND HIGH PRESSURE CLEANING. INCLUDE IN BID A MORTAR REPAIR OF TWO SQUARE FEET FOR EACH WETWELL TO RECEIVE COATING. PROVIDE ZEBRON PRIME (MIST) COAT AT 3 TO 5 WET MILS. PROVIDE TOP COAT OF ZEBRON SERIES 386 100% POLYURETHANE COATING AT MINIMUM OF 125 MILS. COATING SHALL BE APPLIED PER MANUFACTURER'S RECOMMENDATIONS. NTUA WILL SELECT THE COLOR OF THE TOP COAT.

PIPE PRESSURE TEST:
FOR PUMP-AROUND SYSTEM: BEFORE BACKFILLING THE PIPING, THE PIPING SYSTEM SHALL BE EXPOSED TO SYSTEM PRESSURE (THE PRESSURE IN THE FORCEMAIN). CONDUCT VISUAL EXAMINATION TO CONFIRM THERE IS NO LEAKAGE. FOR DISCHARGE PIPE REPLACEMENT IN WETWELL; CONDUCT VISUAL EXAMINATION TO CONFIRM THERE IS NO LEAKAGE.

COMBINATION AIR VALVE:
COMBINATION AIR VALVE SHALL BE SINGLE BODY STYLE AND SPECIFICALLY MANUFACTURED FOR WASTEWATER APPLICATIONS. THE BODY AND COVER OF THE VALVE SHALL BE CONSTRUCTED OF HEAVY-DUTY CAST IRON. BOLTS, NIPPLES, PLUGS SHALL BE TYPE 316 STAINLESS STEEL. FLOAT SHALL BE STAINLESS STEEL. VALVE SHALL BE DESIGNED FOR NO SPILLS AND NO SPURTS. STATIC PRESSURE IN THE PIPELINE AT LOCATION OF PROPOSED VALVE IS APPROXIMATE 22 PSI, PROVIDE APPROPRIATE SEAT. PROVIDE BACKFLUSHING ATTACHMENT. EXTERIOR PAINT SHALL BE SELECTED FOR A DAMP VAULT APPLICATION.
COMBINATION AIR VALVE SHALL BE VALMATIC VMC-301A OR APPROVED EQUAL.

PAINTING:
FOR FERROUS METALS, PRIMED OR UNPRIMED, SUCH AS BUT NOT LIMITED TO WETWELL VENT PIPES, ANTENNA POLE. PAINT MANUFACTURER SHALL BE SHERWIN-WILLIAMS OR APPROVED EQUAL.
PRIMER: ALKYD METAL PRIMER, ONE COAT, 1.3-1.5 DRY MILS.
GLOSS FINISH: URETHANE ALKYD GLOSS ENAMEL, TWO COATS, 2.0-2.2 DRY MILS.

EQUIPMENT COATINGS:
ALL PUMPS, FITTINGS, PIPING ETC. SUPPLIED BY PUMP SYSTEM PACKAGE VENDOR SHALL HAVE MANUFACTURER'S STANDARD EPOXY INTERIOR AND EXTERIOR COATING. COATING SHALL BE DESIGNED FOR WASTEWATER APPLICATION.

RADAR LEVEL SENSOR:
SENSOR SHALL BE MICRO PILOT FMR20, 80MM WITH FLOOD PROTECTION TUBE AND PIVOT-TYPE MOUNTING ARM PART NO. 919790-002, BY EDRESS-HOUSER OR APPROVED EQUAL.

NAVAJO TRIBAL UTILITY AUTHORITY
DESIGN AND CONSTRUCTION OF FIVE LIFT STATION FACILITIES
EQUIPMENT SCHEDULES AND SPECIFICATIONS



EXPIRATION DATE: 09/30/24

Drawn by: JJC

Design by: LAH

Approved by: RN

Date


05/24/23

Project No.


2338

Sheet No.


M-01

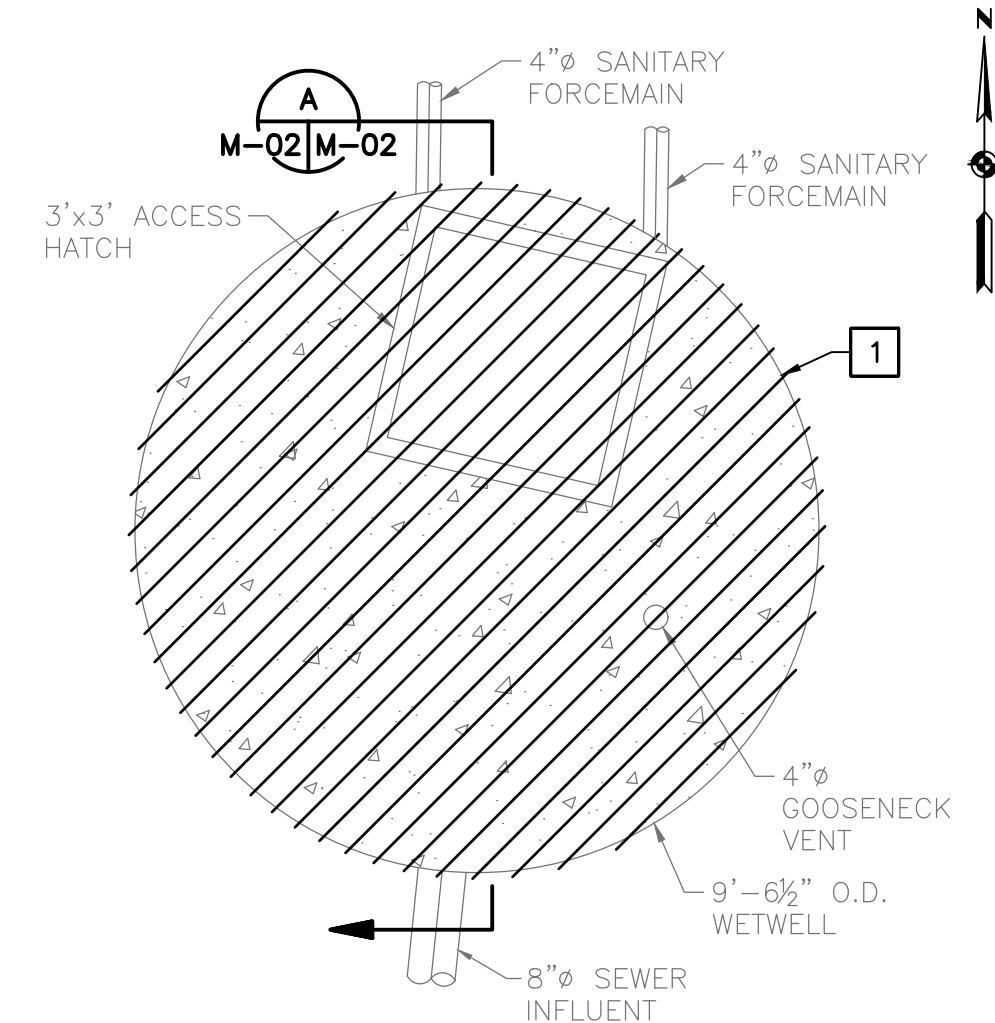

REMOVALS TOP PLAN
SCALE: 3/8"=1'-0"

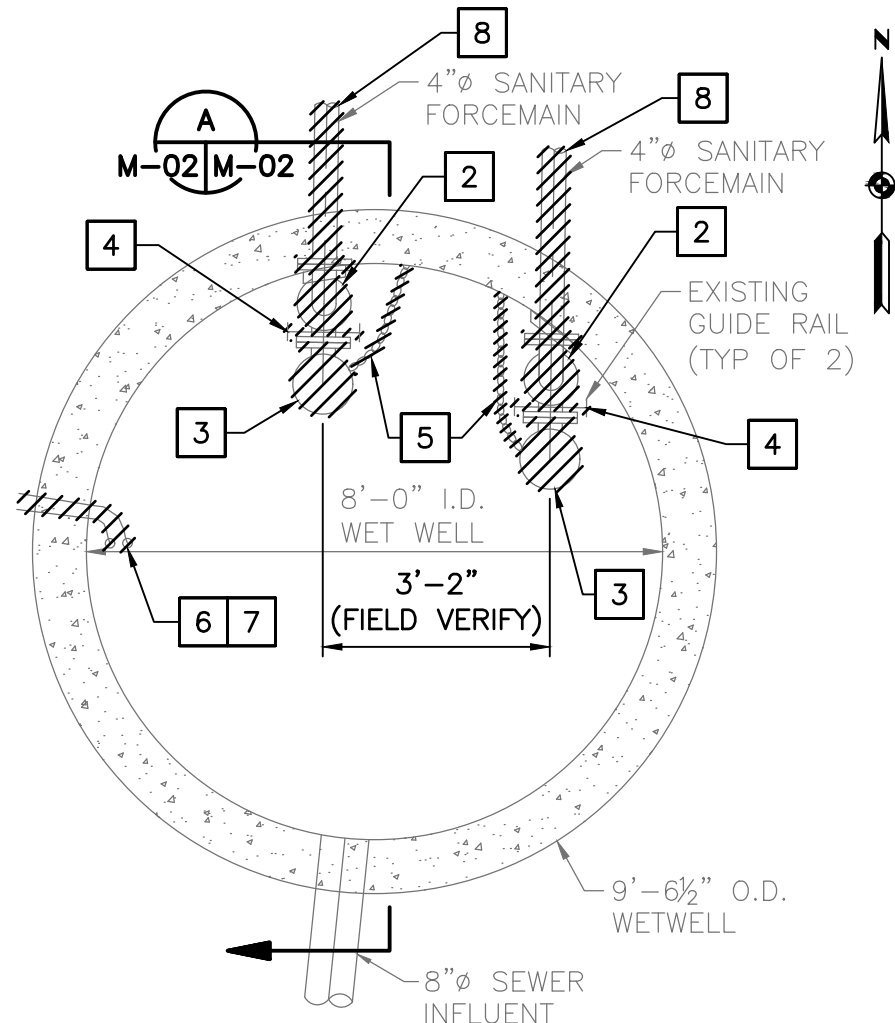


REMOVALS SECTIONAL PLAN
SCALE: 3/8"=1'-0"

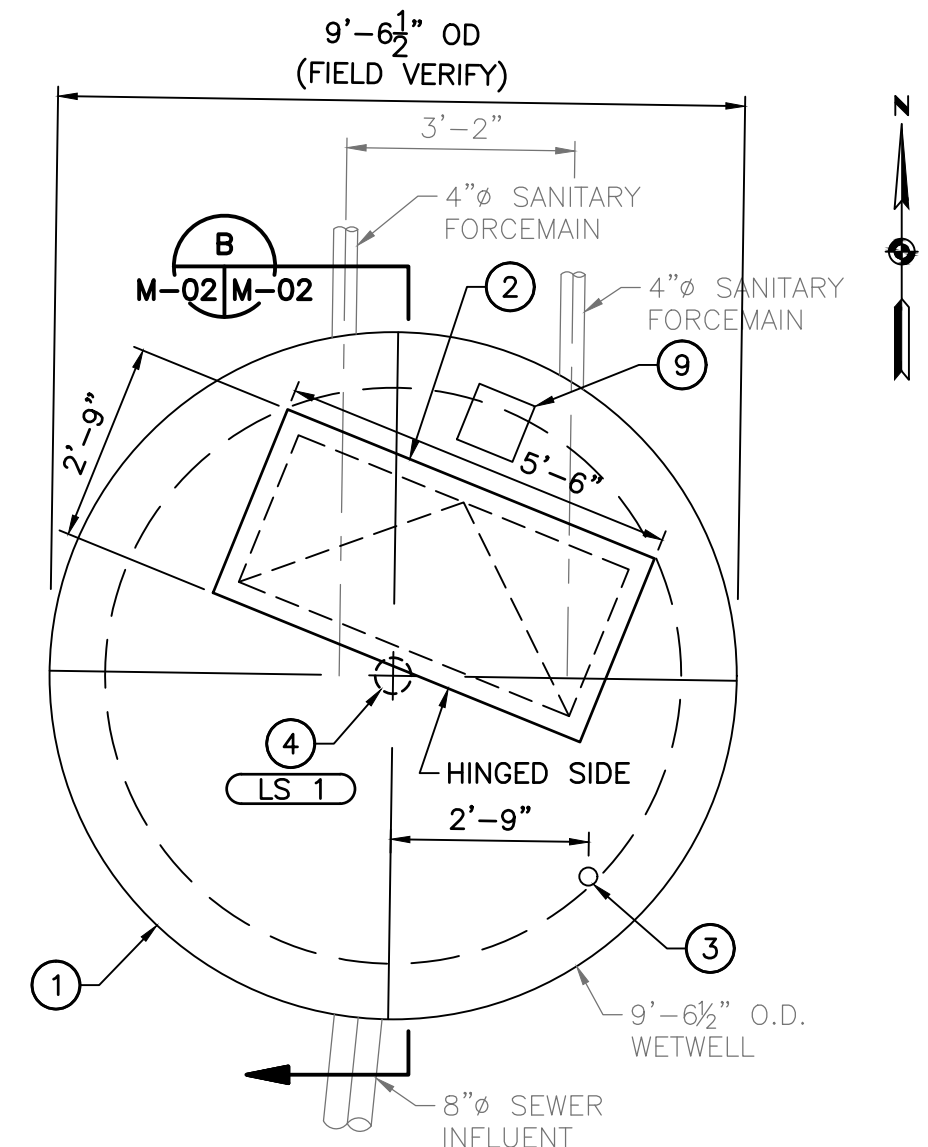


IMPROVEMENTS TOP PLAN
SCALE: 3/8"=1'-0"


- NOTES:
1. FIELD VERIFY DIMENSIONS. CONFIRM LOCATION OF HATCHES FOR PUMP REMOVAL BEFORE MANUFACTURE OF TOP SLAB.
 2. FIELD VERIFY LOCATION OF HOIST BRACKETS.

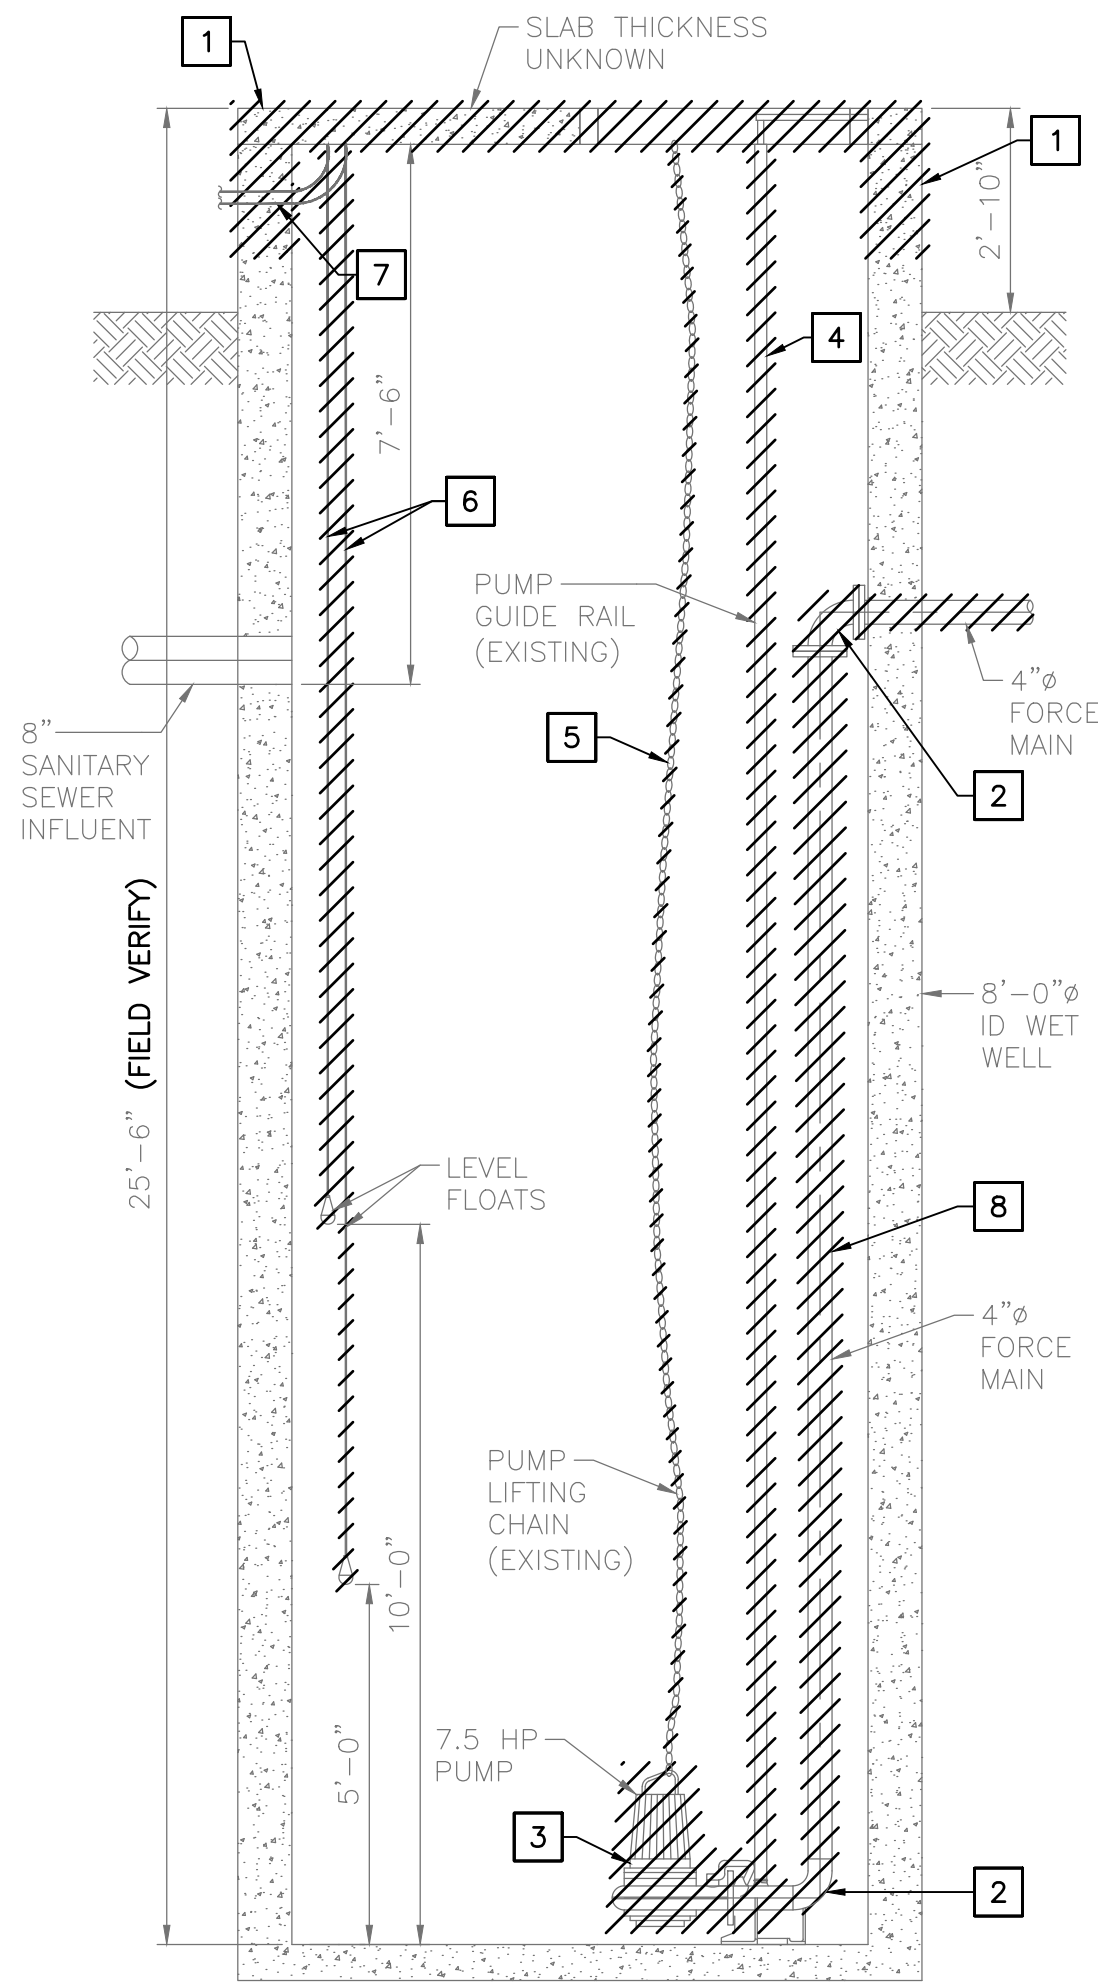

REMOVALS SECTION
SCALE: 3/8"=1'-0"

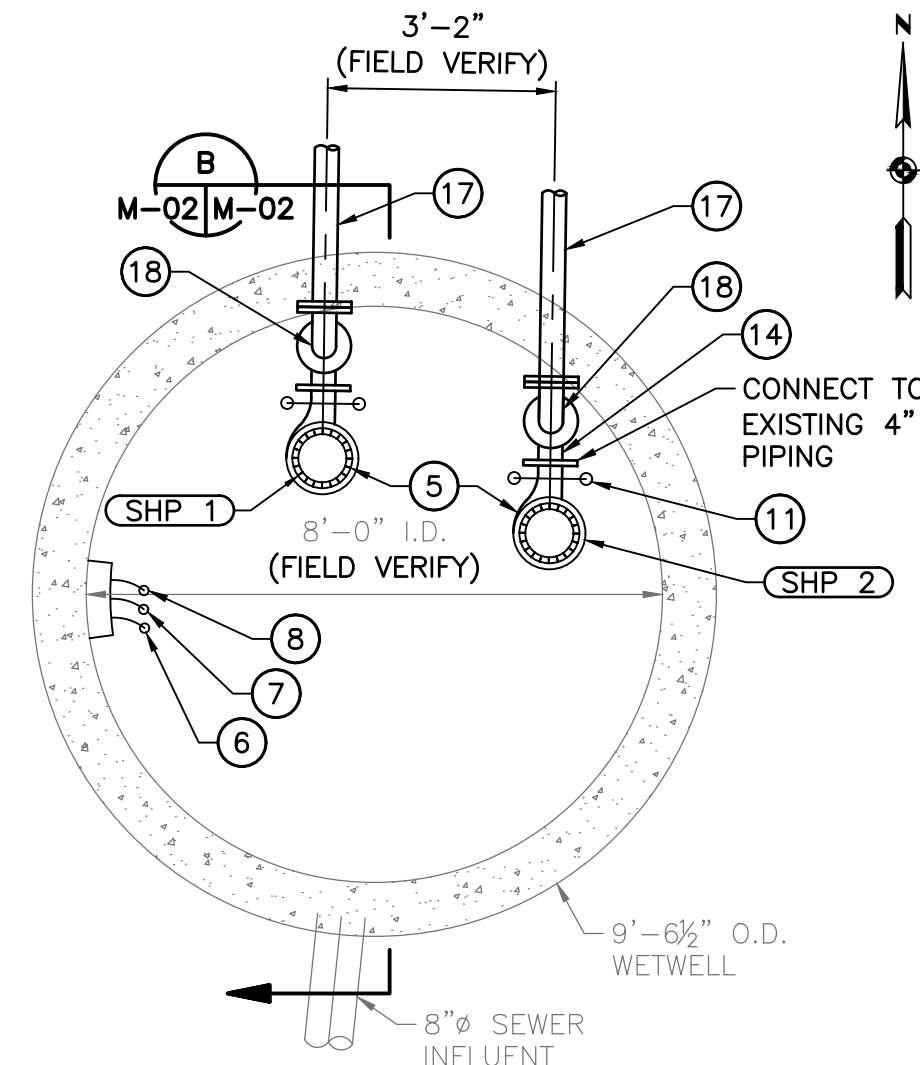

IMPROVEMENTS SECTIONAL PLAN
SCALE: 3/8"=1'-0"

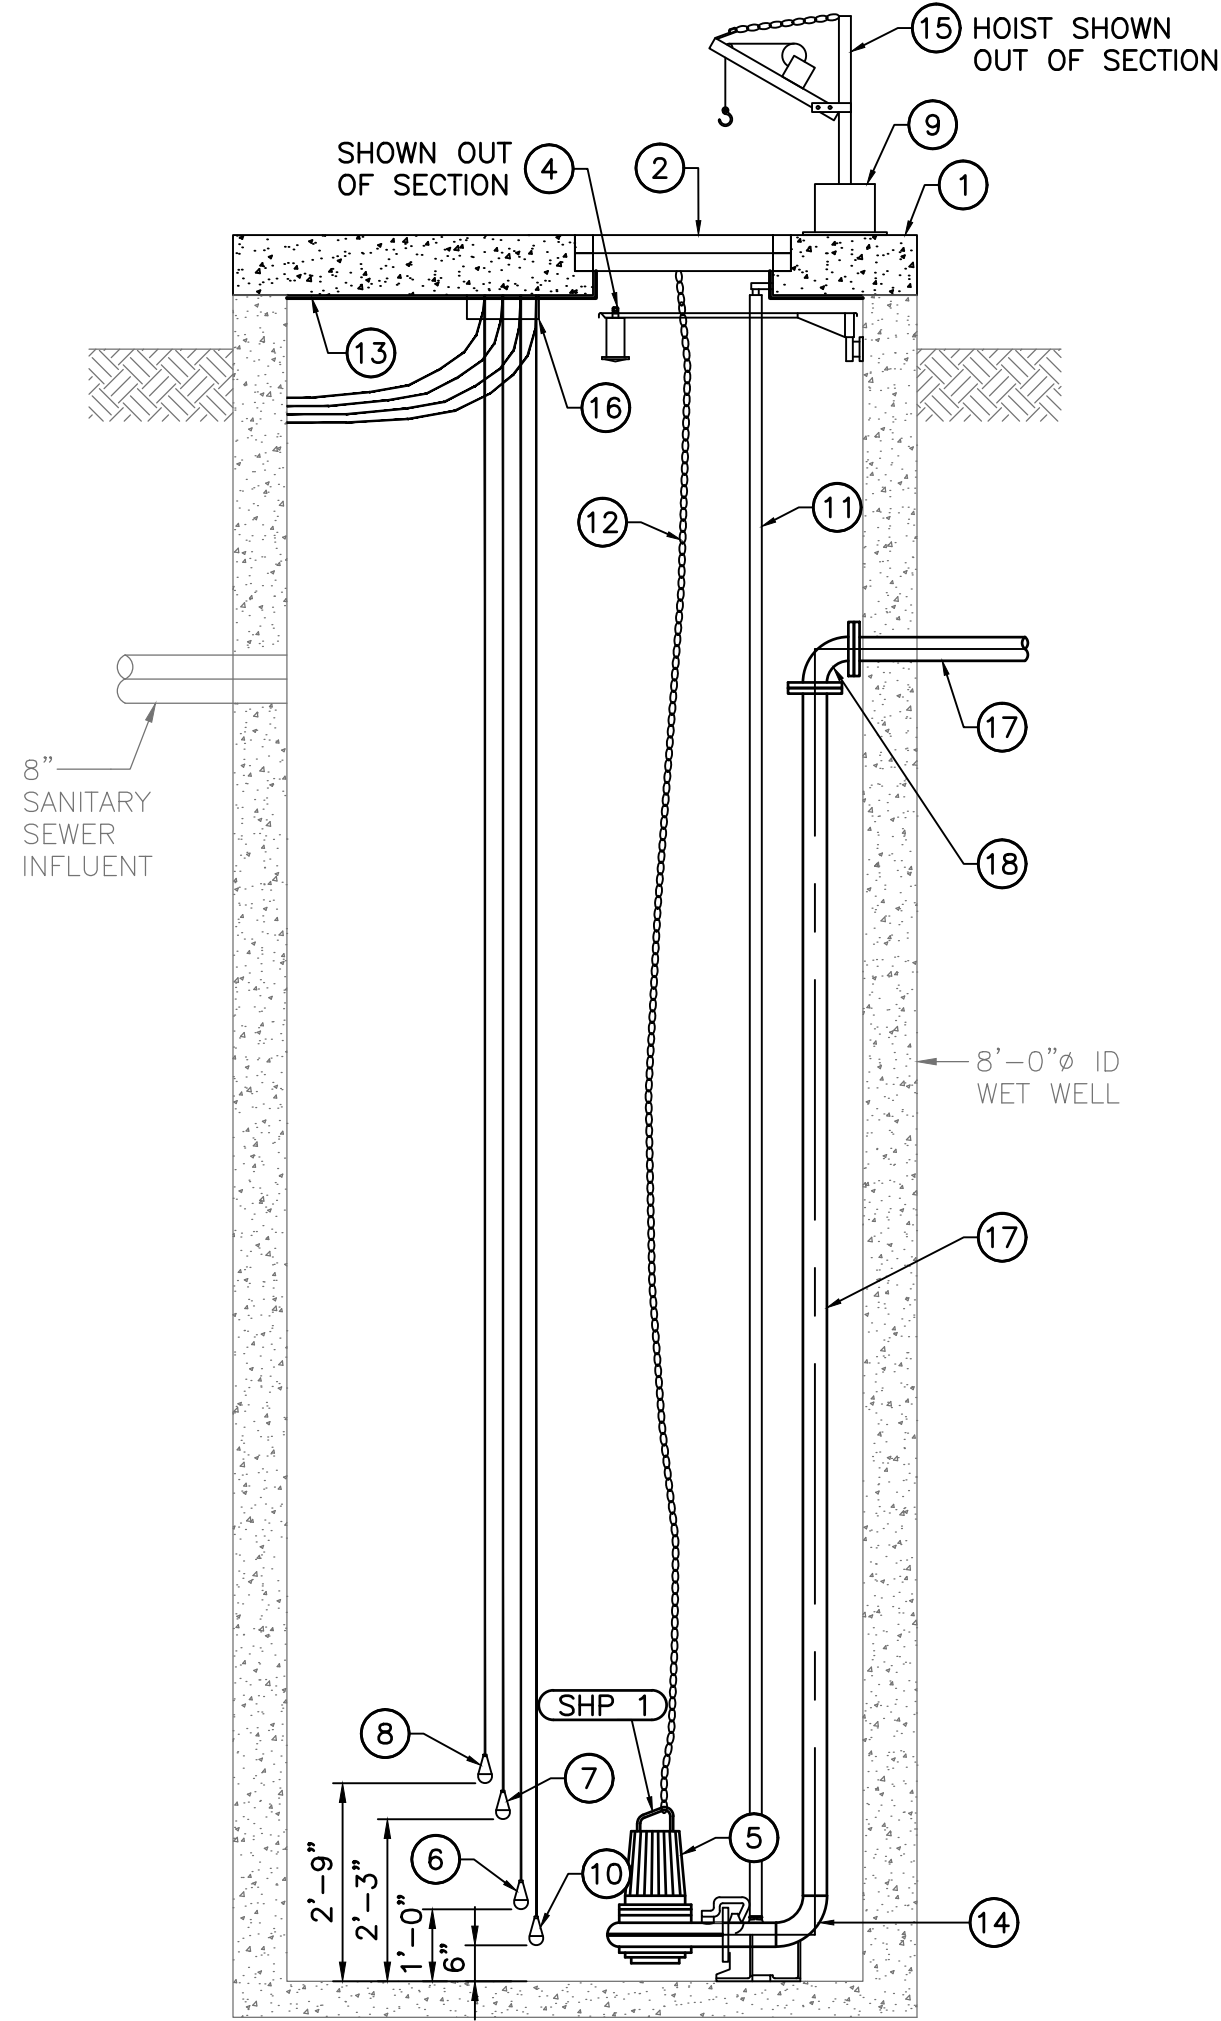



IMPROVEMENTS SECTION
SCALE: 3/8"=1'-0"























































































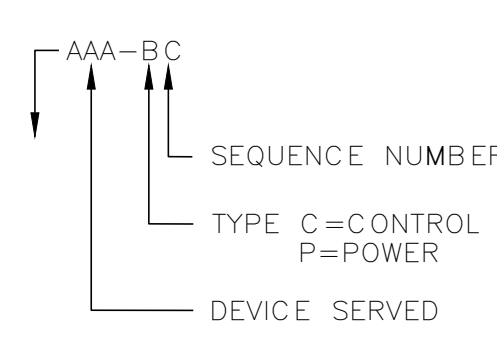



- NOTE:
1. FLOAT LEVELS INDICATED ARE INITIAL SETTINGS. FLOAT LEVELS SHOULD BE ADJUSTED PER FIELD OPERATING CONDITIONS DURING START UP ACTIVITIES.

REMOVALS NOTES	
1	REMOVE CONCRETE TOP SLAB INCLUDING ACCESS HATCH, VENT. REMOVE THE APPROXIMATE 19" TOP BARREL SECTION FROM WETWELL, REPAIR TROWELLED CORROSION COATING AT THE BARREL TO BARREL JOINT.
2	REMOVE DISCHARGE ELBOW.
3	REMOVE 7.5 HP PUMPS.
4	REMOVE PUMP GUIDE RAILS.
5	REMOVE PUMP LIFTING CHAIN.
6	REMOVE LEVEL FLOATS.
7	REMOVE LEVEL FLOATS CABLES, HOLDER AND JUNCTION BOX.
8	REMOVE 4" FORCEMAIN PIPING
CONSTRUCTION NOTES	
1	TOP SLAB, FOR DESIGN LOADING SEE SHT G-04.
2	ACCESS HATCH W/ FALL PROTECTIVE GRATING, HALLIDAY PRODUCTS, MODEL S1S3060. CENTER HATCH OVER PUMPS. SEE NOTE 1.
3	4" VENT. SEE DETAIL ON SHT M-04.
4	RADAR LEVEL SENSOR. FOR MOUNTING DETAIL, SEE SHT M-04.
5	7.5 HP SOLIDS HANDLING PUMPS.
6	LOW LEVEL FLOAT.
7	HIGH LEVEL FLOAT.
8	HIGH HIGH LEVEL FLOAT.
9	HOIST BRACKET FOR (PORTABLE) PUMP LIFTING HOIST.
10	LOW LOW LEVEL FLOAT
11	PUMP GUIDE RAILS, 2" DIAMETER STAINLESS STEEL WITH MOUNTING BRACKETS.
12	STAINLESS STEEL LIFTING CHAIN.
13	POLYURETHANE COATING. SEE SPECIFICATIONS ON SHT M-01.
14	DISCHARGE ELBOW.
15	PORTABLE HOIST INCLUDED IN PUMP PRE-PURCHASE PACKAGE. POSITION HOIST TO PROVIDE REACH TO BOTH PUMPS.
16	CABLE HOLDER.
17	4" DIP FORCE MAIN
18	4" DIP 90° BEND
GENERAL NOTES	
1. FOR ELECTRICAL SEE ELECTRICAL SHEETS.	
2. WHEN INSTALLING EQUIPMENT AND MATERIALS IN WETWELL, MAINTAIN SPACE FOR RADAR LEVEL SENSOR BEAM DIAMETER.	


0' 1' 2' 5'
SCALE: 3/8"=1'-0"



- 0' 1' 2'
- 
- SCALE: $\frac{3}{4}" = 1'-0"$

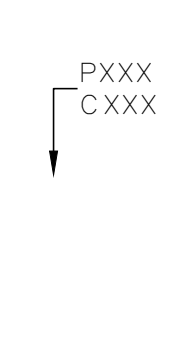SCHEMATIC DIAGRAM SYMBOLS				POWER SINGLE LINE DIAGRAM SYMBOLS				ELECTRICAL ABBREVIATIONS					
	CONTROL RELAY		2 POSITION SELECTOR SWITCH POSITION LEGEND: X=CLOSED O=OPEN		JUNCTION BOX WITH POWER DISTRIBUTION BLOCK OR LUGS		CIRCUIT BREAKER, SHOWN WITH TRIP RATING AND NUMBER OF POLES	A AMPERE AFD ADJUSTABLE FREQUENCY DRIVE AFF ABOVE FINISHED FLOOR AFG ABOVE FINISHED GRADE AI ANALOG INPUT AIC AMPS INTERRUPTING CAPACITY AO ANALOG OUTPUT AS AIR SUPPLY ATS AUTOMATIC TRANSFER SWITCH BC BYPASS CONTACTOR C CONDUIT CB CIRCUIT BREAKER CCW COUNTER CLOCKWISE CL2 CHLORINE CON CONTACTOR CPB CONTROL PULLBOX CU COPPER, BARE CV CONTROL VALVE CW CLOCKWISE DCS DISTRIBUTED CONTROL SYSTEM DI DISCRETE INPUT DO DISCRETE OUTPUT DP DISTRIBUTION PANEL DV/DT DIFFERENTIAL VOLTAGE/TIME DWG DRAWING ETM ELAPSED TIME METER EOL ELECTRONIC OVERLOAD EXIST EXISTING FA FOUL AIR FC FAIL CLOSED FE FLOW ELEMENT FLA FULL LOAD AMPS FS FLOW SWITCH FVNR FULL VOLTAGE NON-REVERSING FW FINISHED WATER GFCI GROUND FAULT CIRCUIT INTERRUPTER GFP GROUND FAULT PROTECTION GND GROUND GPD GALLONS PER DAY GPH GALLONS PER HOUR GPM GALLONS PER MINUTE GRS GALVANIZED RIGID STEEL H, HI HIGH H2S HYDROGEN SULFIDE HMI HUMAN-MACHINE INTERFACE HOA HAND-OFF-AUTO HOR HAND-OFF-REMOTE IC INSTRUMENTATION CABLE ICR INTERMITTENT CYCLE REACTOR IO INPUT/OUTPUT ISC SHORT CIRCUIT CURRENT		CONDUIT SEALOFF		MOTOR CIRCUIT PROTECTOR WITH TRIP RATING AND NUMBER OF POLES	JB JUNCTION BOX LO LOW LAN LOCAL AREA NETWORK LC LOOP CONTROLLER LCL LEVEL CONTROL, LOW LCP LOCAL CONTROL PANEL LOS LOCK-OUT-STOP LOR LOCAL/OFF-REMOTE LS LEVEL FLOAT SWITCH LTC LIQUIDTIGHT FLEXIBLE METAL CONDUIT M MOTOR MA MANUAL/AUTO mA MILLIAMPS MAX MAXIMUM MC MANUFACTURER'S CABLE MCB MAIN CIRCUIT BREAKER MCC MOTOR CONTROL CENTER MCP MOTOR CIRCUIT PROTECTOR MFR(S) MANUFACTURER(S) MGD MILLION GALLONS PER DAY MGL MILLIGRAMS PER LITER MH MANHOLE MIN MINIMUM MOV MOTOR OPERATED VALVE MMR MOTOR MANAGEMENT RELAY MTU MASTER TELEMETRY UNIT NEC NATIONAL ELECTRICAL CODE NECA NATIONAL ELECTRICAL CONTRACTOR ASSOCIATION N.C. NORMALLY CLOSED N.O. NORMALLY OPEN NIC NOT IN CONTRACT NOTC NORMALLY OPEN TIMED CLOSED NPW NON-POTABLE WATER NS NITROGEN SUPPLY NTS NOT TO SCALE NTU TURBIDITY OIT OPERATOR INTERFACE TERMINAL OL OVERLOAD OLR OVERLOAD RELAY OO ON/OFF (MAINTAINED) OR OFF-REMOTE OSC OPEN/STOP/CLOSE P PHASE PB PULL BOX PCP PROCESS CONTROL PANEL PCV PRESSURE CONTROL VALVE PFR PHASE/POWER FAILURE RELAY PI PULSE INPUT PLC PROGRAMMABLE LOGIC CONTROLLER PLI PLANT INFLUENT PMP PUMP
	TIME DELAY RELAY		3 POSITION SELECTOR SWITCH HAND - OFF - AUTO POSITION LEGEND: X=CLOSED O=OPEN		LTC CONNECTION		DISCONNECT SWITCH SHOWN WITH RATING AND NUMBER OF POLES	PNL PANEL PO PULSE OUTPUT PPB POWER PULLBOX PPG POUNDS PER GALLON PPH POUNDS PER HOUR PPM PARTS PER MILLION PR PAIR PRES PRESSURE PS PRESSURE SWITCH PSH PRESSURE SWITCH, HIGH PSI POUNDS PER SQUARE INCH PV PROCESS VARIABLE RAS RETURN ACTIVATED SLUDGE RW RAW WATER RF RADIO FREQUENCY RIO REMOTE INPUT OUTPUT RS RAW SEWAGE RSP RAW SEWAGE PUMP RST RESET RTD RESISTANCE TEMPERATURE DETECTOR RTU REMOTE TELEMETRY UNIT RWT REFLECTED WAVE TRAP SCA SHORT CIRCUIT AMPS SCCR SHORT CIRCUIT CURRENT RATING SEQ SERVICE ENTRANCE EQUIPMENT SES SERVICE ENTRANCE SECTION SLC SINGLE LOOP CONTROLLER SLOS START-LOCK-OUT-STOP SMC SUBMERSIBLE MANUFACTURER CABLE SO2 SULFUR DIOXIDE SP SET POINT SPC SPARE CONDUIT SPR SPARE SS START/STOP SSS SOLID STATE STARTER (SOFT START) ST SHUNT TRIP TC TELEPHONE CABLE TS TEMPERATURE SWITCH TVSS TRANSIENT VOLTAGE SURGE SUPPRESSOR TYP TYPICAL UG UNDERGROUND UL UNDERWRITERS LABORATORIES UM UTILITY METER UNO UNLESS NOTED OTHERWISE V VOLT VFD VARIABLE FREQUENCY DRIVE W WATT, WIRE WAS WASTE ACTIVATED SLUDGE WP WEATHERPROOF XFMR TRANSFORMER XMR TRANSFORMER XMTR TRANSMITTER ZS POSITION (i.e., LIMIT) SWITCH					
	ALARM RELAY		NORMALLY CLOSED PUSH BUTTON		MC CONNECTION		MOTOR MANAGEMENT RELAY						
	ELAPSED TIME METER		LOCKOUT STOP PUSH BUTTON		BOND TO METALLIC WATER PIPE		SURGE PROTECTIVE DEVICE						
	MOTOR STARTER OR CONTACTOR COIL		NORMALLY OPEN PUSH BUTTON		UTILITY METER		SOLID STATE STARTER						
	PHOTO CELL		EMERGENCY STOP PUSH BUTTON (MAINTAINED)		MOTOR, NUMBER DESIGNATES NEMA HORSEPOWER SIZE		HARMONIC FILTER						
	BEACON ALARM LIGHT LETTER INDICATES COLOR R=RED, A=AMBER, B=BLUE, G=GREEN		DISCONNECT SWITCH SHOWN WITH RATING AND NUMBER OF POLES		FUSE		ELECTRONIC OVERLOAD RELAY						
	PILOT LIGHT LETTER INDICATES COLOR R=RED, A=AMBER, B=BLUE, G=GREEN		LIMIT OR POSITION SWITCH		FUSEHOLDER OR FUSEBLOCK		GROUND CONNECTION						
	OUTPUT DV/DT FILTER		PRESSURE SWITCH HIGH		GENERATOR		TRANSFORMER						
	HEATING ELEMENT		PRESSURE SWITCH LOW		CONTACTOR								
	TRANSFORMER		FLOW SWITCH	SITE PLAN SYMBOLS				ELECTRICAL LINETYPES	GENERAL NOTES				
	CURRENT TRANSFORMER		LEVEL FLOAT SWITCH		TELEPHONE OUTLET		FIELD DEVICE		1. THE COMPLETED INSTALLATION SHALL COMPLY WITH LATEST REVISION OF APPLICABLE FEDERAL, STATE, AND LOCAL CODES, ORDINANCES, AND REGULATIONS. THE CONTRACTOR SHALL OBTAIN NECESSARY PERMITS AND INSPECTIONS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION. ALL WORK SHALL BE COMPLETED IN A NEAT, WORKMANLIKE MANNER IN ACCORDANCE WITH THE LATEST NECA STANDARDS OF INSTALLATION UNDER COMPETENT SUPERVISION. INSTALL GROUNDING PER NEC.				
	GROUND CONNECTION		TIMER RELAY CONTACT INSTANTANEOUS CLOSE TIME DELAY OPEN		SINGLE POLE SWITCH		GROUND ROD		2. VISIT THE SITE PRIOR TO BIDDING TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND OTHER FACTORS, WHICH MAY AFFECT THE EXECUTION OF THE WORK. INCLUDE ALL RELATED COSTS IN THE INITIAL BID PROPOSAL.				
	GENERATOR		TIMER RELAY CONTACT NORMALLY OPEN TIME DELAY CLOSE		3 WAY SWITCH		DUPLEX RECEPTACLE		3. THE CONTRACTOR SHALL COORDINATE WORK WITH THE UTILITIES PROVIDING SERVICES ON THIS PROJECT, AND SHALL COMPLY WITH ALL THEIR INSTALLATION REQUIREMENTS.				
	HORN		TEMPERATURE SWITCH		4-WAY SWITCH		ANTENNA MAST		4. ALL MATERIALS SHALL BE NEW AND OF THE BEST QUALITY, MANUFACTURED IN ACCORDANCE WITH THE LATEST REVISION OF NEMA, ANSI, UL, OR OTHER APPLICABLE STANDARDS. THE USE OF MANUFACTURERS' NAMES, MODELS, AND NUMBERS IS INTENDED TO ESTABLISH STYLE, QUALITY, APPEARANCE, USEFULNESS, AND BID PRICE.				
	FULL VOLTAGE NON-REVERSING (FVNR) MOTOR STARTER OR CONTACTOR NUMBER DESIGNATES NEMA SIZE		FUSE		MANUAL MOTOR STARTER		CONDUIT SEALOFF		5. PROTECT ALL ELECTRICAL MATERIAL AND EQUIPMENT INSTALLED AGAINST DAMAGE BY OTHER TRADES, WEATHER CONDITIONS, OR ANY OTHER PREVENTABLE CAUSES. EQUIPMENT DAMAGED DURING SHIPPING OR CONSTRUCTION, PRIOR TO ACCEPTANCE BY THE ENGINEER OR THE OWNER, WILL BE REJECTED AS DEFECTIVE.				
	NORMALLY OPEN CONTACT		FUSEHOLDER OR FUSEBLOCK		SPECIAL PURPOSE OR WELDING OUTLET		DISCONNECT SWITCH		6. LEAVE THE SITE CLEAN. REMOVE ALL DEBRIS, EMPTY CARTONS, TOOLS, CONDUIT, WIRE SCRAPS AND ALL MISCELLANEOUS SPARE EQUIPMENT AND MATERIALS USED IN THE WORK DURING CONSTRUCTION. ALL COMPONENTS SHALL BE FREE OF DUST, GRIT AND FOREIGN MATERIALS, LEFT AS NEW BEFORE FINAL ACCEPTANCE OF WORK. DAMAGED PAINT AND FINISHES SHALL BE TOUCHED UP OR REPAINTED WITH MATCHING COLOR PAINT AND FINISH.				
	NORMALLY CLOSED CONTACT		THERMAL OVERLOAD RELAY		SMOKE DETECTOR		MOTOR		7. CIRCUIT CONDUCTORS #6 AWG OR SMALLER SHALL BE THWN STRANDED COPPER. #4 AWG THROUGH #2 AWG SHALL BE XHHW STRANDED COPPER. #1 AWG OR LARGER SHALL BE XHHW-2 STRANDED COPPER. MINIMUM POWER CONDUCTOR SIZE SHALL BE #12 AWG WITH #12 AWG GROUND.				
	RTU OR PLC CONTACT		TERMINAL BLOCK		THERMOSTAT		CONDUIT TURN UP		8. UNDERGROUND CONDUITS SHALL BE SCHEDULE 40 PVC. MINIMUM CONDUIT DEPTH SHALL BE 24 INCHES. MINIMUM UNDERGROUND CONDUIT SIZE SHALL BE 1 INCH.				
	DEVICE LOCATED AT REMOTE LOCATION		CONDUIT SEALOFF	CIRCUIT SCHEDULE LEGEND					9. CONDUITS SHALL BE MARKED AT EACH END WITH MATCHING NUMBERED BRASS TAGS. SPARE CONDUITS SHALL HAVE A PULL STRING INSTALLED, SECURED, AND CAPPED.				
					AAA-BC SEQUENCE NUMBER TYPE C=CONTROL P=POWER DEVICE SERVED		CONDUIT TURN DOWN		10. EXPOSED CONDUITS SHALL BE PVC COATED GALVANIZED RIGID STEEL (GRS). MINIMUM SIZE 3/4 INCH, UNLESS OTHERWISE NOTED ON THE PLANS.				
									11. SAFETY SWITCHES, ELECTRICAL DISTRIBUTION EQUIPMENT, CONTROL PANELS, AND OTHER ELECTRICAL DEVICES SHALL BE UL LISTED, AND RATED FOR HEAVY DUTY SERVICE.				
									12. WIRING DEVICES SHALL BE SPECIFICATION GRADE.				
									13. THE CONTRACTOR IS RESPONSIBLE FOR MANAGING, SCHEDULING, DOCUMENTING, AND PERFORMING THE WORK SO THAT A COMPLETE ELECTRICAL, INSTRUMENTATION AND CONTROL SYSTEM FOR THE FACILITY IS PROVIDED. ACCURATE SHOP AND RECORD DRAWINGS, AND O&M MANUALS SHALL BE SUBMITTED PRIOR TO FINAL ACCEPTANCE OF THE WORK.				
									14. TYPICAL DETAILS SHALL APPLY IN ALL CASES, WHETHER SPECIFICALLY REFERRED TO OR NOT.				
				100% SUBMITTAL – ISSUED FOR CONSTRUCTION									

May 25, 2023 - 12:53pm
X:\2500\A\02338\23 NTUA Coalmine Lift Station\CAD Files\02338\23_E02.dwg

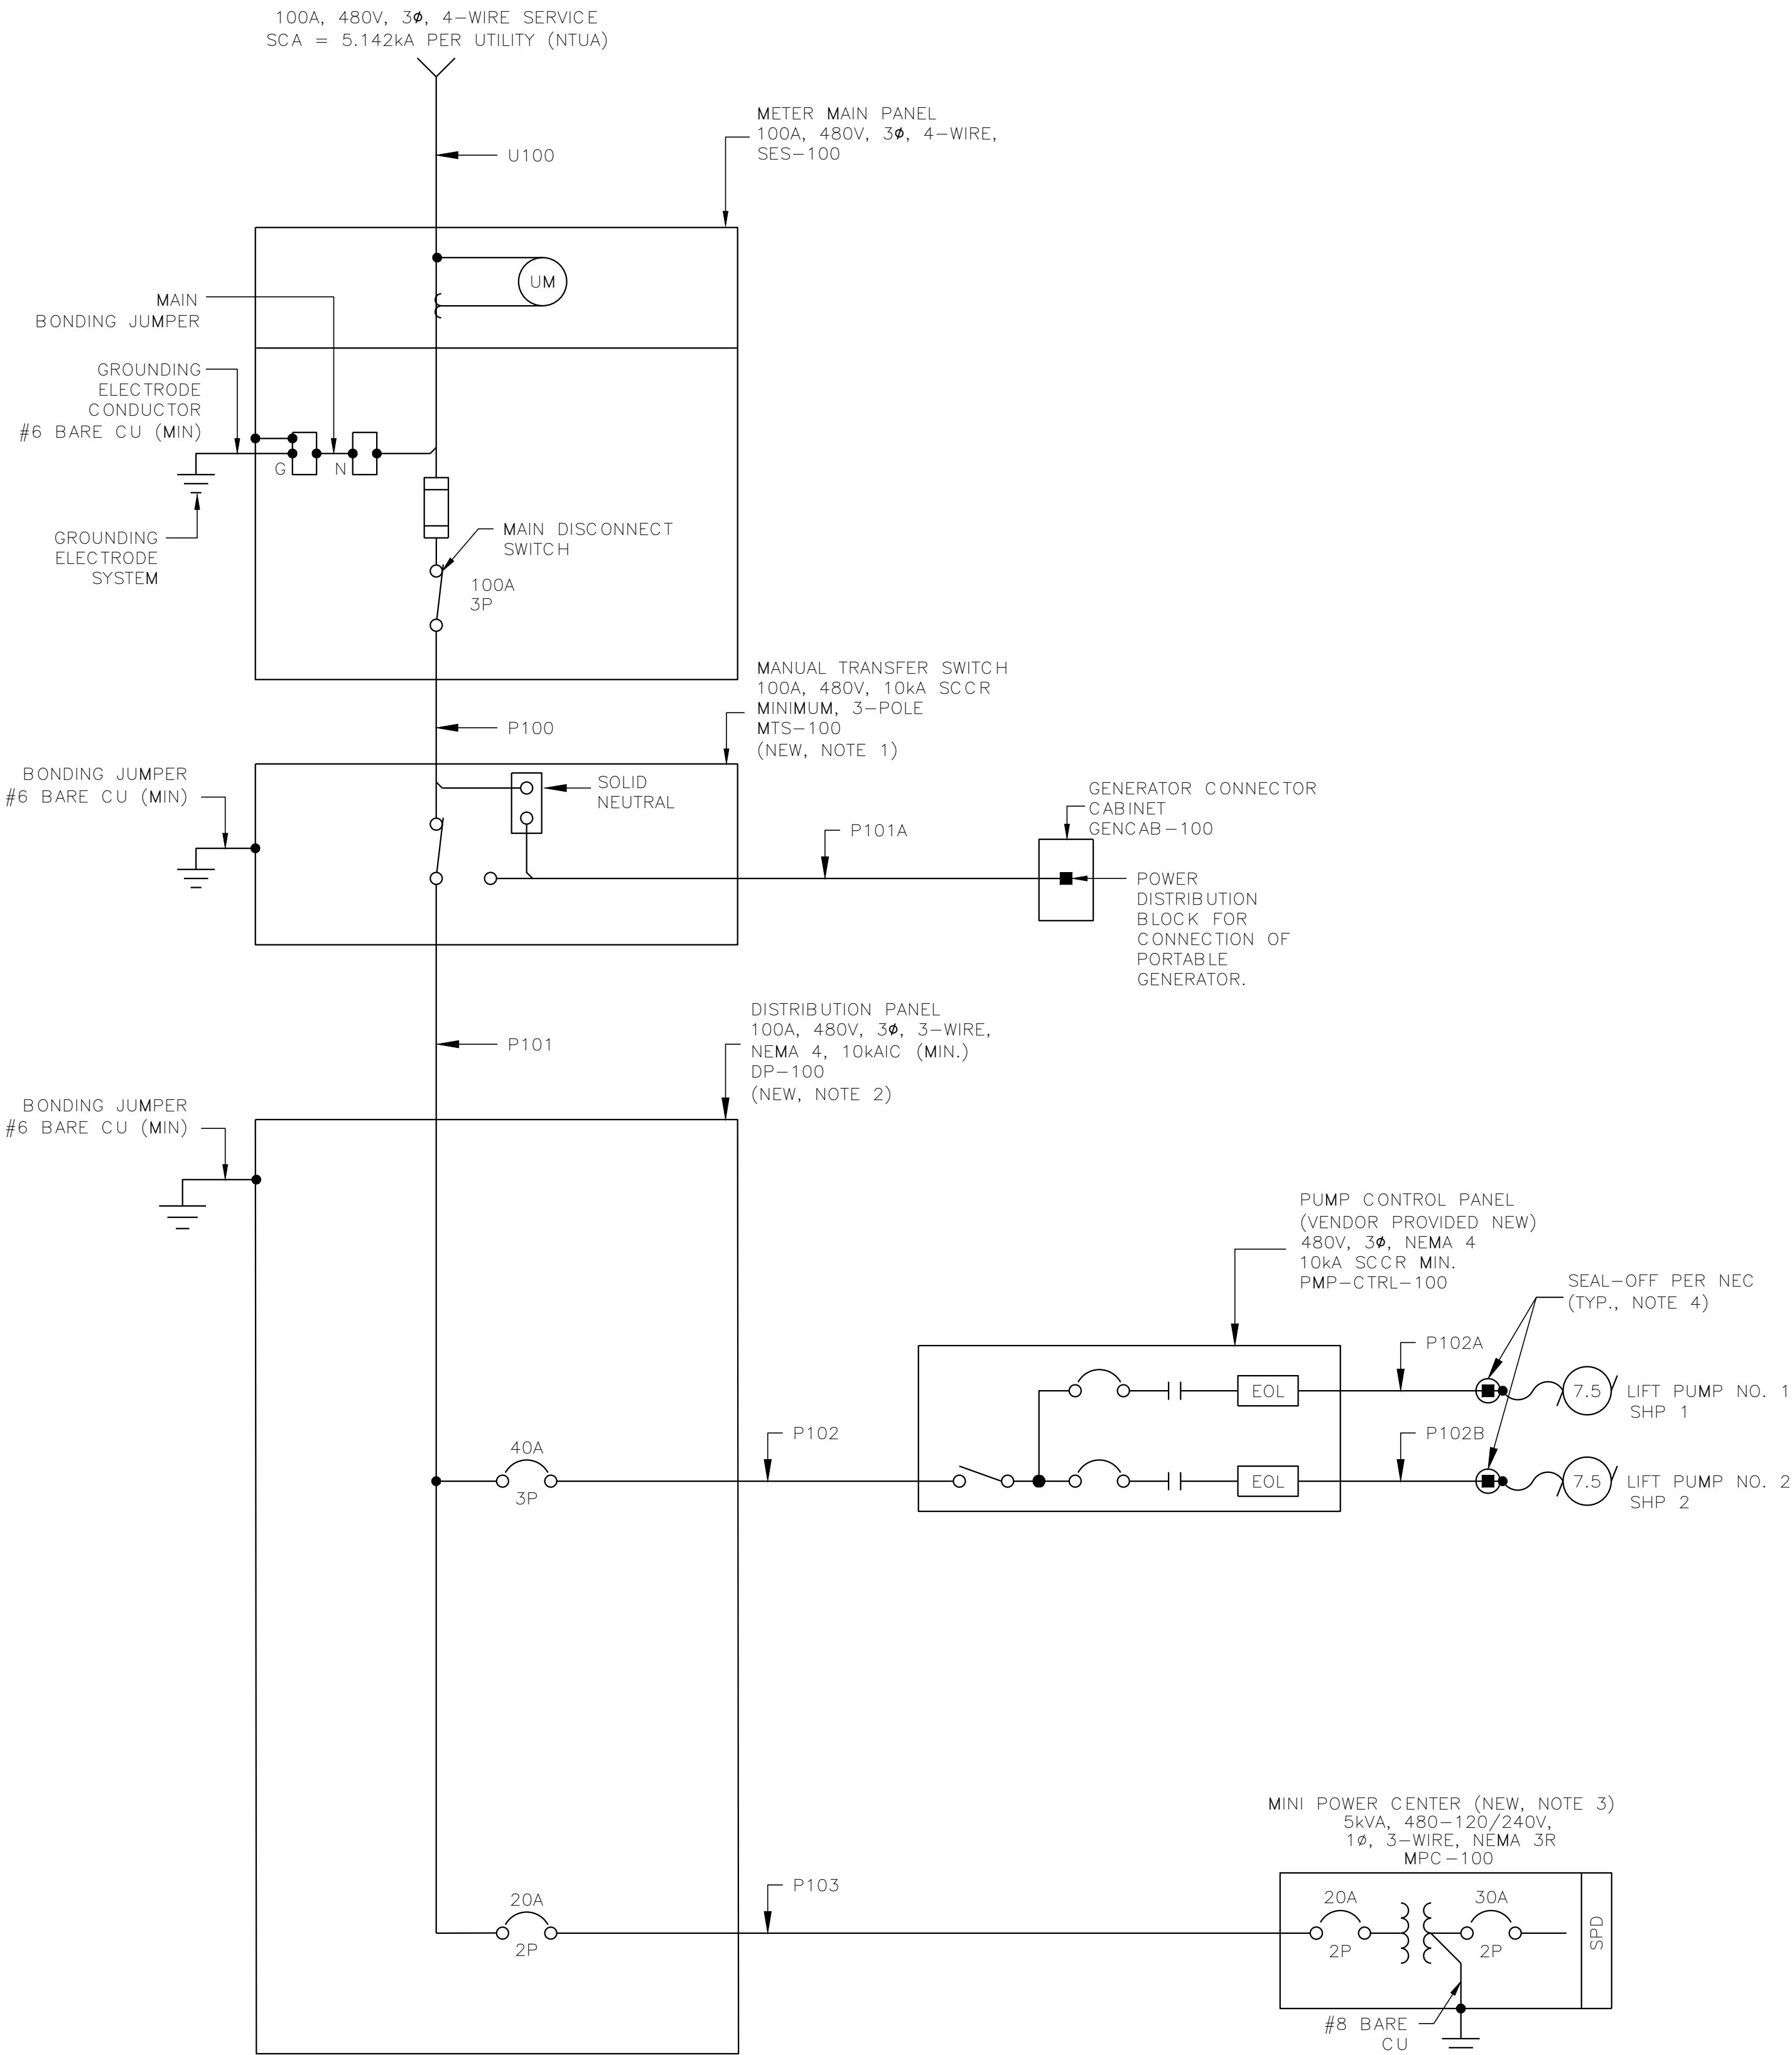

A SINGLE LINE DIAGRAM

CIRCUIT/DESCRIPTION	KVA	HP	FLA
MOTOR LOADS			
LIFT PUMP NO. 1 SHP 1		7.5	11.0
LIFT PUMP NO. 2 SHP 2		7.5	11.0
NON-MOTOR LOADS			
MINI POWER CENTER MPC-100	5.0		10.4
SUBTOTAL			
+ 25% OF LARGEST MOTOR			
TOTAL AMPS @ 480V/3PHASE			
SERVICE SIZE (AMPS)			

B LOAD CALCULATIONS

CALLOUT NO.	NO. SETS	CONDUIT SIZE	CIRCUIT CONDUCTORS	CIRCUIT NO.'s
U100	PER UTILITY	PER UTILITY	PROVIDED BY UTILITY	SES100-P1
P100	1	1 1/2"	3 - #1, #1 NEUT, #8 GND	MTS100-P1
P101	1	1 1/2"	3 - #1, #8 GND	DP100-P1
P101A	1	1"	3 - #6, #6 NEUT, #10 GND	GENCAB100-P1
P102	1	1"	3 - #10, #10 GND	PMPCTRL100-P1
P102A	1	1"	3 - #12, #12 GND	SHP1-P1
P102B	1	1"	3 - #12, #12 GND	SHP2-P1
P103	1	1"	2 - #12, #12 GND	MPC100-P1

C CALLOUT SCHEDULE

NOTES:

- CONTRACTOR SHALL REUSE AND RELOCATE EXISTING MANUAL TRANSFER SWITCH IF POSSIBLE. IF EXISTING TRANSFER SWITCH IS DEEMED NOT SUITABLE FOR USE BY CONTRACTOR, PROVIDE SQUARE D, OR EQUIVALENT, DOUBLE THROW MANUAL TRANSFER SWITCH WITH NEMA 3R, PAD-LOCKABLE ENCLOSURE.. SEE DWG E-04 FOR LOCATION.
- PROVIDE SQUARE D, OR EQUAL, PANELBOARD RATED AS SHOWN ON DRAWING. PROVIDE SHOP DRAWING SUBMITTAL FOR APPROVAL BY ENGINEER.
- PROVIDE MINI POWER CENTER BY SQUARE D, OR EQUAL. MINI POWER CENTER SHALL HAVE TWO 5% FULL CAPACITY PRIMARY TAPS BELOW NORMAL. MINI POWER CENTER SHALL BE RATED FOR 115 DEGREE FAHRENHEIT TEMPERATURE RISE ABOVE 40 DEGREE FAHRENHEIT AMBIENT TEMPERATURE(MINIMUM). MINI POWER CENTER SHALL INCLUDE INTEGRALLY MOUNTED AND WIRED PRIMARY AND SECONDARY MAIN CIRCUIT BREAKERS IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE. PROVIDE SHOP DRAWING SUBMITTAL FOR APPROVAL BY ENGINEER.
- PROVIDE CROUSE-HINDS SEAL-OFF AND CHICO SEALING COMPOUND.

COPYRIGHT © 2023

Check					
Drawn					
Date					
Revision					
No.					

NAVAJO TRIBAL UTILITY AUTHORITY
DESIGN AND CONSTRUCTION OF FIVE LIFT STATION FACILITIES

COALMINE SINGLE LINE DIAGRAM
AND LOAD CALCULATIONS

CELEBRATING
25
YEARS

Professional Engineer
AARON G. ARMENTA
74459
Arizona, U.S.A.

EXPIRATION DATE: 12/31/24

Drawn by: GAR

Design by: GAR

Approved by: AGA

Date: 05/25/23

Project No.: 2338


Sheet No.: E-02

100% SUBMITTAL — ISSUED FOR CONSTRUCTION

May 25, 2023 - 12:53pm
X:\2500\1\233823 NTUA Coalmine Lift Station\100 - E&I Design\CAD Files\233823_E03.dwg

PANEL TAG No.		MPC-100										NEMA TYPE/MOUNTING		3R/SURFACE									
LOCATION		ELECTRICAL EQUIPMENT PAD										MAIN DEVICE		30A MCB									
BUS AMPACITY		100A										AIC RATING		10k (MIN)									
VOLTS, PHASE, WIRE		240 V/1-PHASE/3-WIRE										FED FROM		DP-100									
REMARKS												ACCESSORIES											
LOAD VA		PHASE A	PHASE B	LOAD DESCRIPTION	WIRE SIZE	DEMAND	BKR	BKR. NO.		BKR	DEMAND	WIRE SIZE	LOAD DESCRIPTION	LOAD VA									
														PHASE A	PHASE B								
200				SITE LTG	#12	1.25	20/1	1	2	20/1	1.25	#12	RTU-100	200									
	0			SPARE			20/1	3	4	20/1	1.00	#12	RECEPTACLE		180								
0				SPARE			20/1	5	6	20/1			SPARE	0									
	0			SPARE			20/1	7	8	20/1			SPARE		0								
0				SPARE			20/1	9	10	20/1			SPARE	0									
	0			SPARE			20/1	11	12	20/1			SPARE		0								
0				SPARE			20/1	13	14	20/1			SPARE	0									
	0			SPARE			20/1	15	16	20/1			SPARE		0								
0				SPACE				17	18				SPACE	0									
	0			SPACE				19	20				SPACE		0								
200	0	CONNECTED VA												200	180								
250	0	DEMAND VA												250	180								
* - Each branch circuit shall have an equipment grounding conductor sized per N.E.C. Article 250							VA		AMPS		TOTAL CONNECTED VA - PER PHASE					400	180						
							TOTAL PANEL CONNECTED LOAD		580		TOTAL DEMAND VA - PER PHASE					500	180						
							TOTAL PANEL DEMAND LOAD		680		TOTAL DEMAND PHASE AMPS					4.2	1.5						
							PANEL DEMAND FACTOR		117%														

A MPC – 100 PANEL SCHEDULE

LIGHTING FIXTURE SCHEDULE					
SYMBOL	DESCRIPTION	MOUNTING	MANUFACTURER	LAMPS	REMARKS
	120V, 4' LED FIXTURE, NARROW LENSED STRIPLIGHT, UL LISTED FOR DAMP LOCATIONS.	SURFACE/ PENDANT	EATON METALUX SNLED LENSED LED OR EQUAL	5K–6K LUMEN OUTPUT, 4000K LED, WIDE DISTRIBUTION	E = FIXTURE TO BE PROVIDED WITH BATTERY BACKUP

C FIXTURE SCHEDULE

SHEET NO.	CIRCUIT	CONDUCTORS
E-05	ANT100-C1	1 - ANTENNA CABLE
E-05	PMPCTRL100-C1	30 - #14, #14 GND
E-05	PMPCTRL100-C2	1 - MODBUS CABLE
E-05	LIT101-C2	1 - IC, #14 GND
E-05	MTS100-C1	4 - #14, #14 GND
E-05	TSH102-C1	2 - #14, #14 GND
E-05	YS102-C1	2 - #14, #14 GND
E-05	TSH103-C1	2 - #14, #14 GND
E-05	YS103-C1	2 - #14, #14 GND
E-05	LSLL101-C1	2 - #14, #14 GND
E-05	LSL101-C1	2 - #14, #14 GND
E-05	LSH101-C1	2 - #14, #14 GND
E-05	LSHH101-C1	2 - #14, #14 GND
E-05	LIT101-C1	1 - IC, #14 GND

B CIRCUIT SCHEDULE



EXPIRATION DATE: 12/31/24

Drawn by: GAR

Design by: GAR


Approved by: AGA

Date
05/25/23

Project No.
2338


Sheet No.
E-03

May 25, 2023 -- 12:53pm
X:\2300\3\2338\23 NTUA Coalmine Lift Station\100 - E&I Design\CAD Files\02338.23 E04.dwg

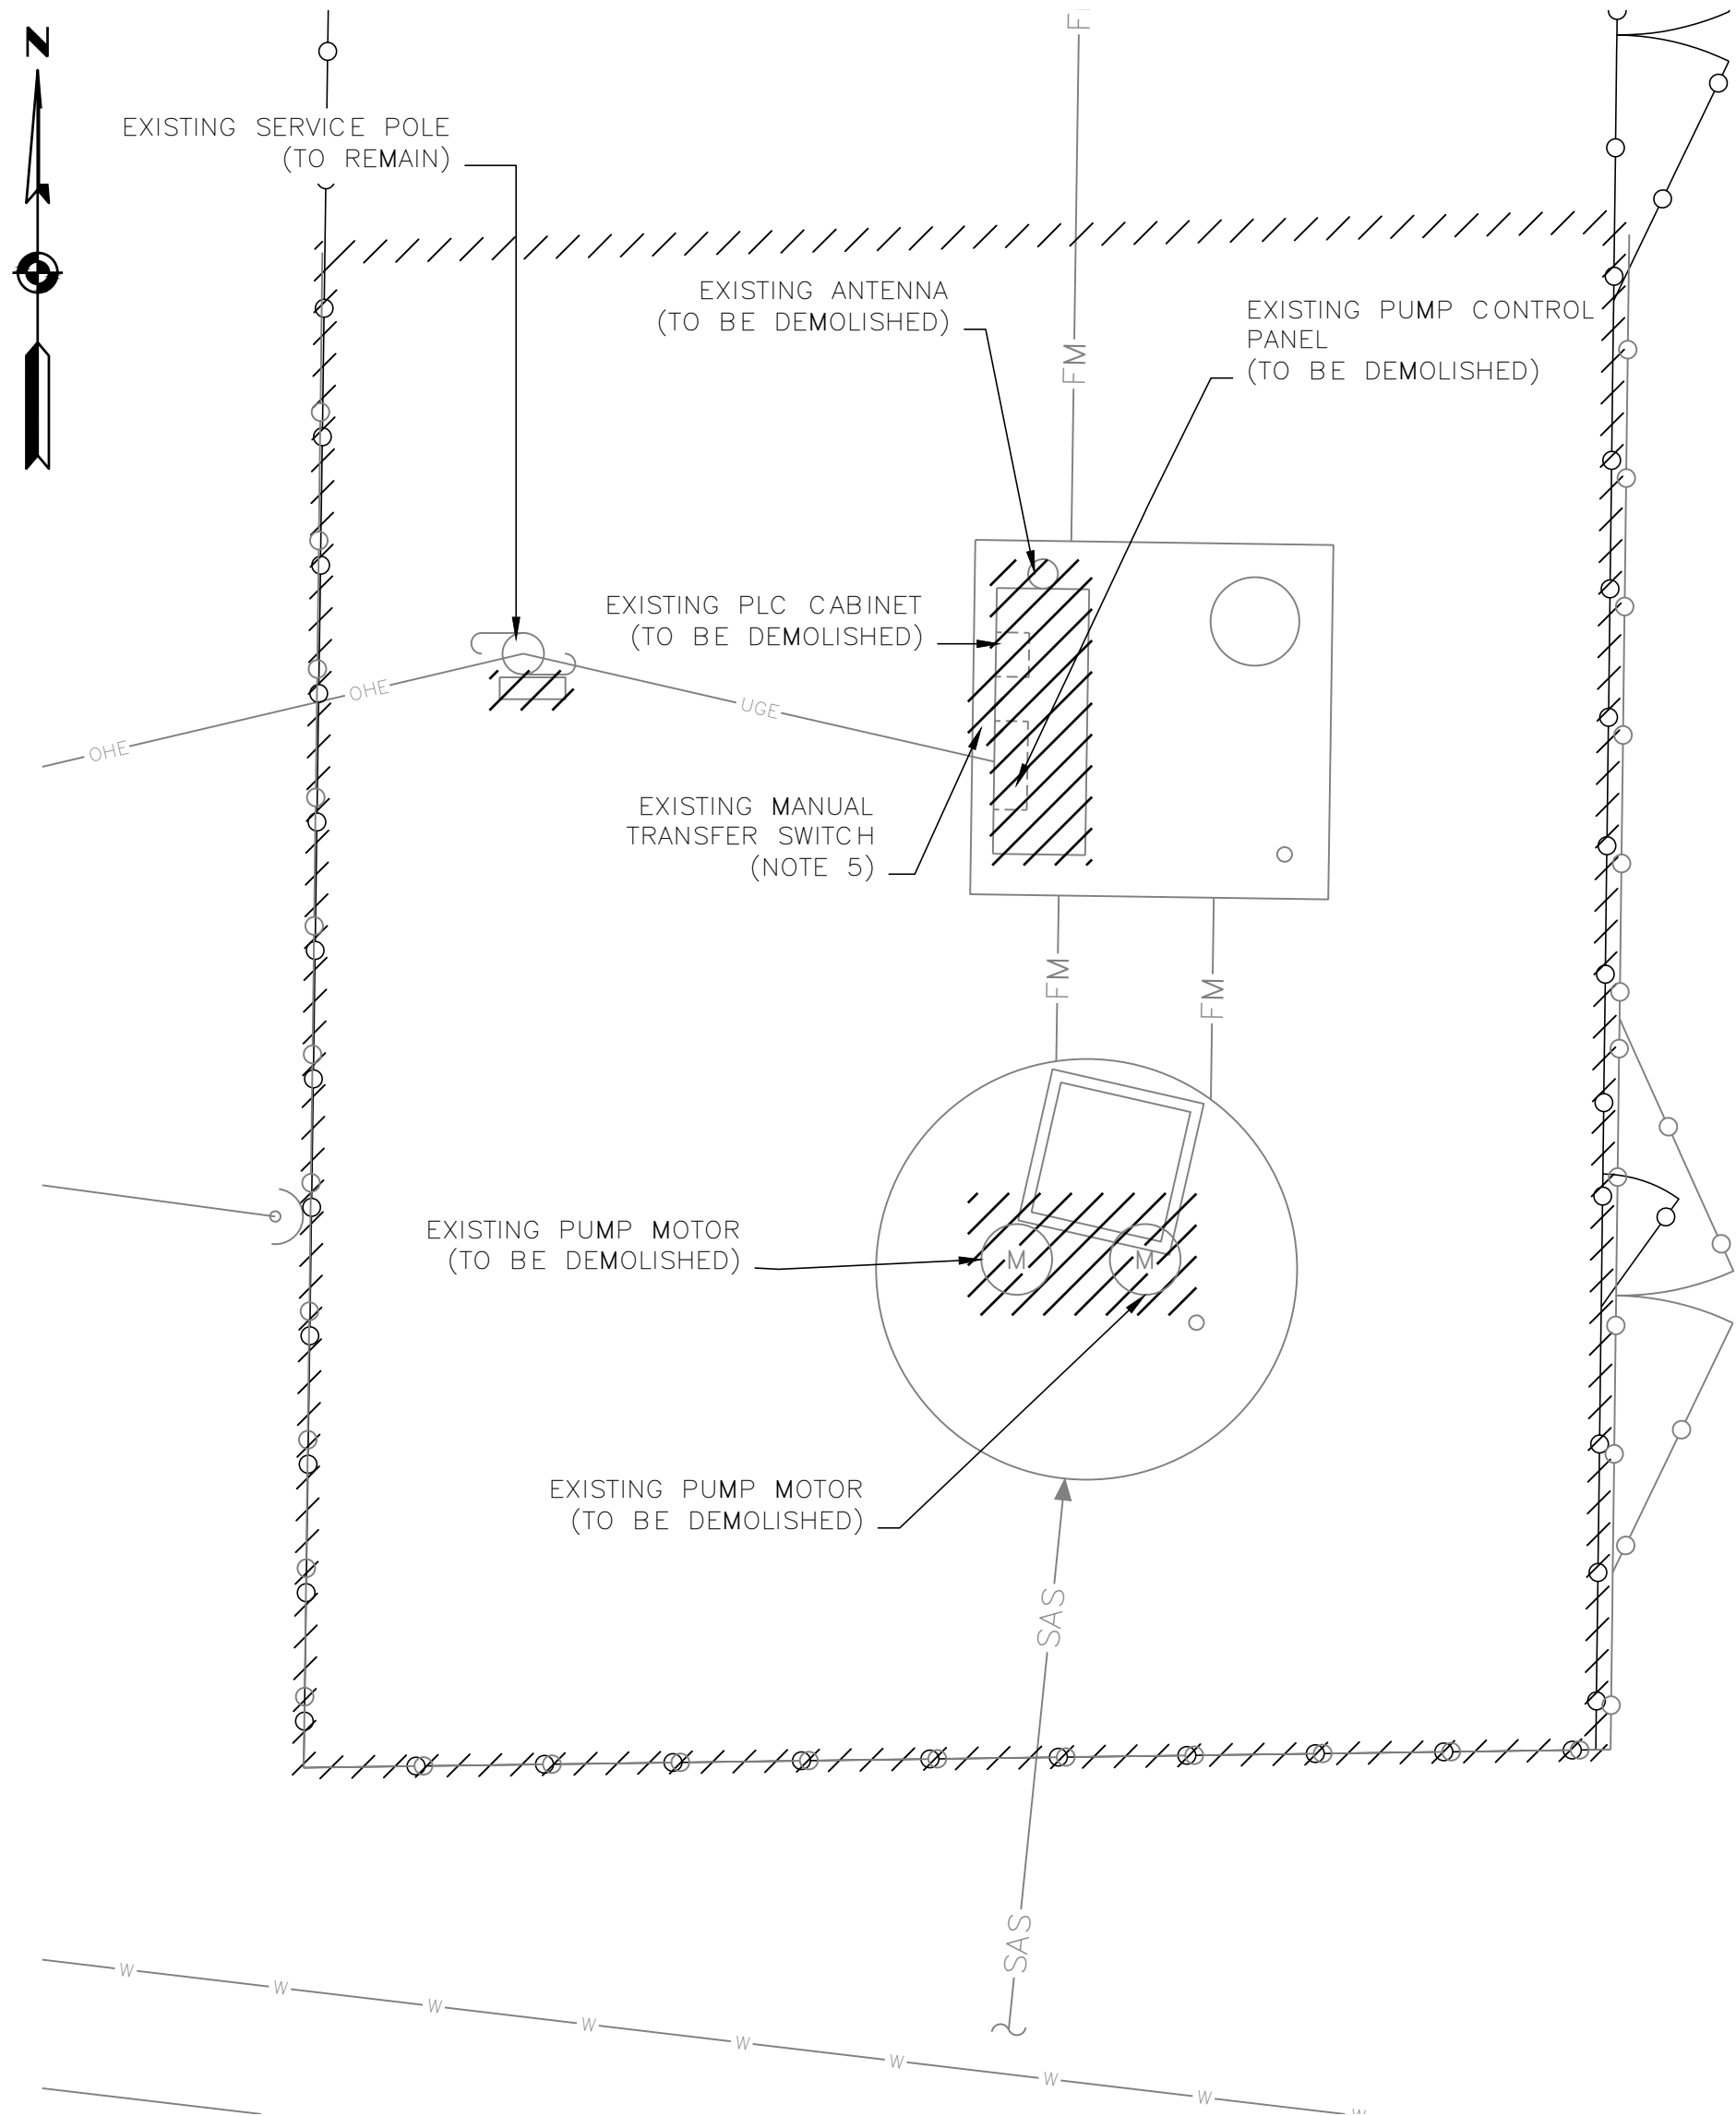

A COALMINE ELECTRICAL DEMOLITION PLAN
(NOTE 1)

4 3 2 1 0 2 4
SCALE: 1/4" = 1'-0"

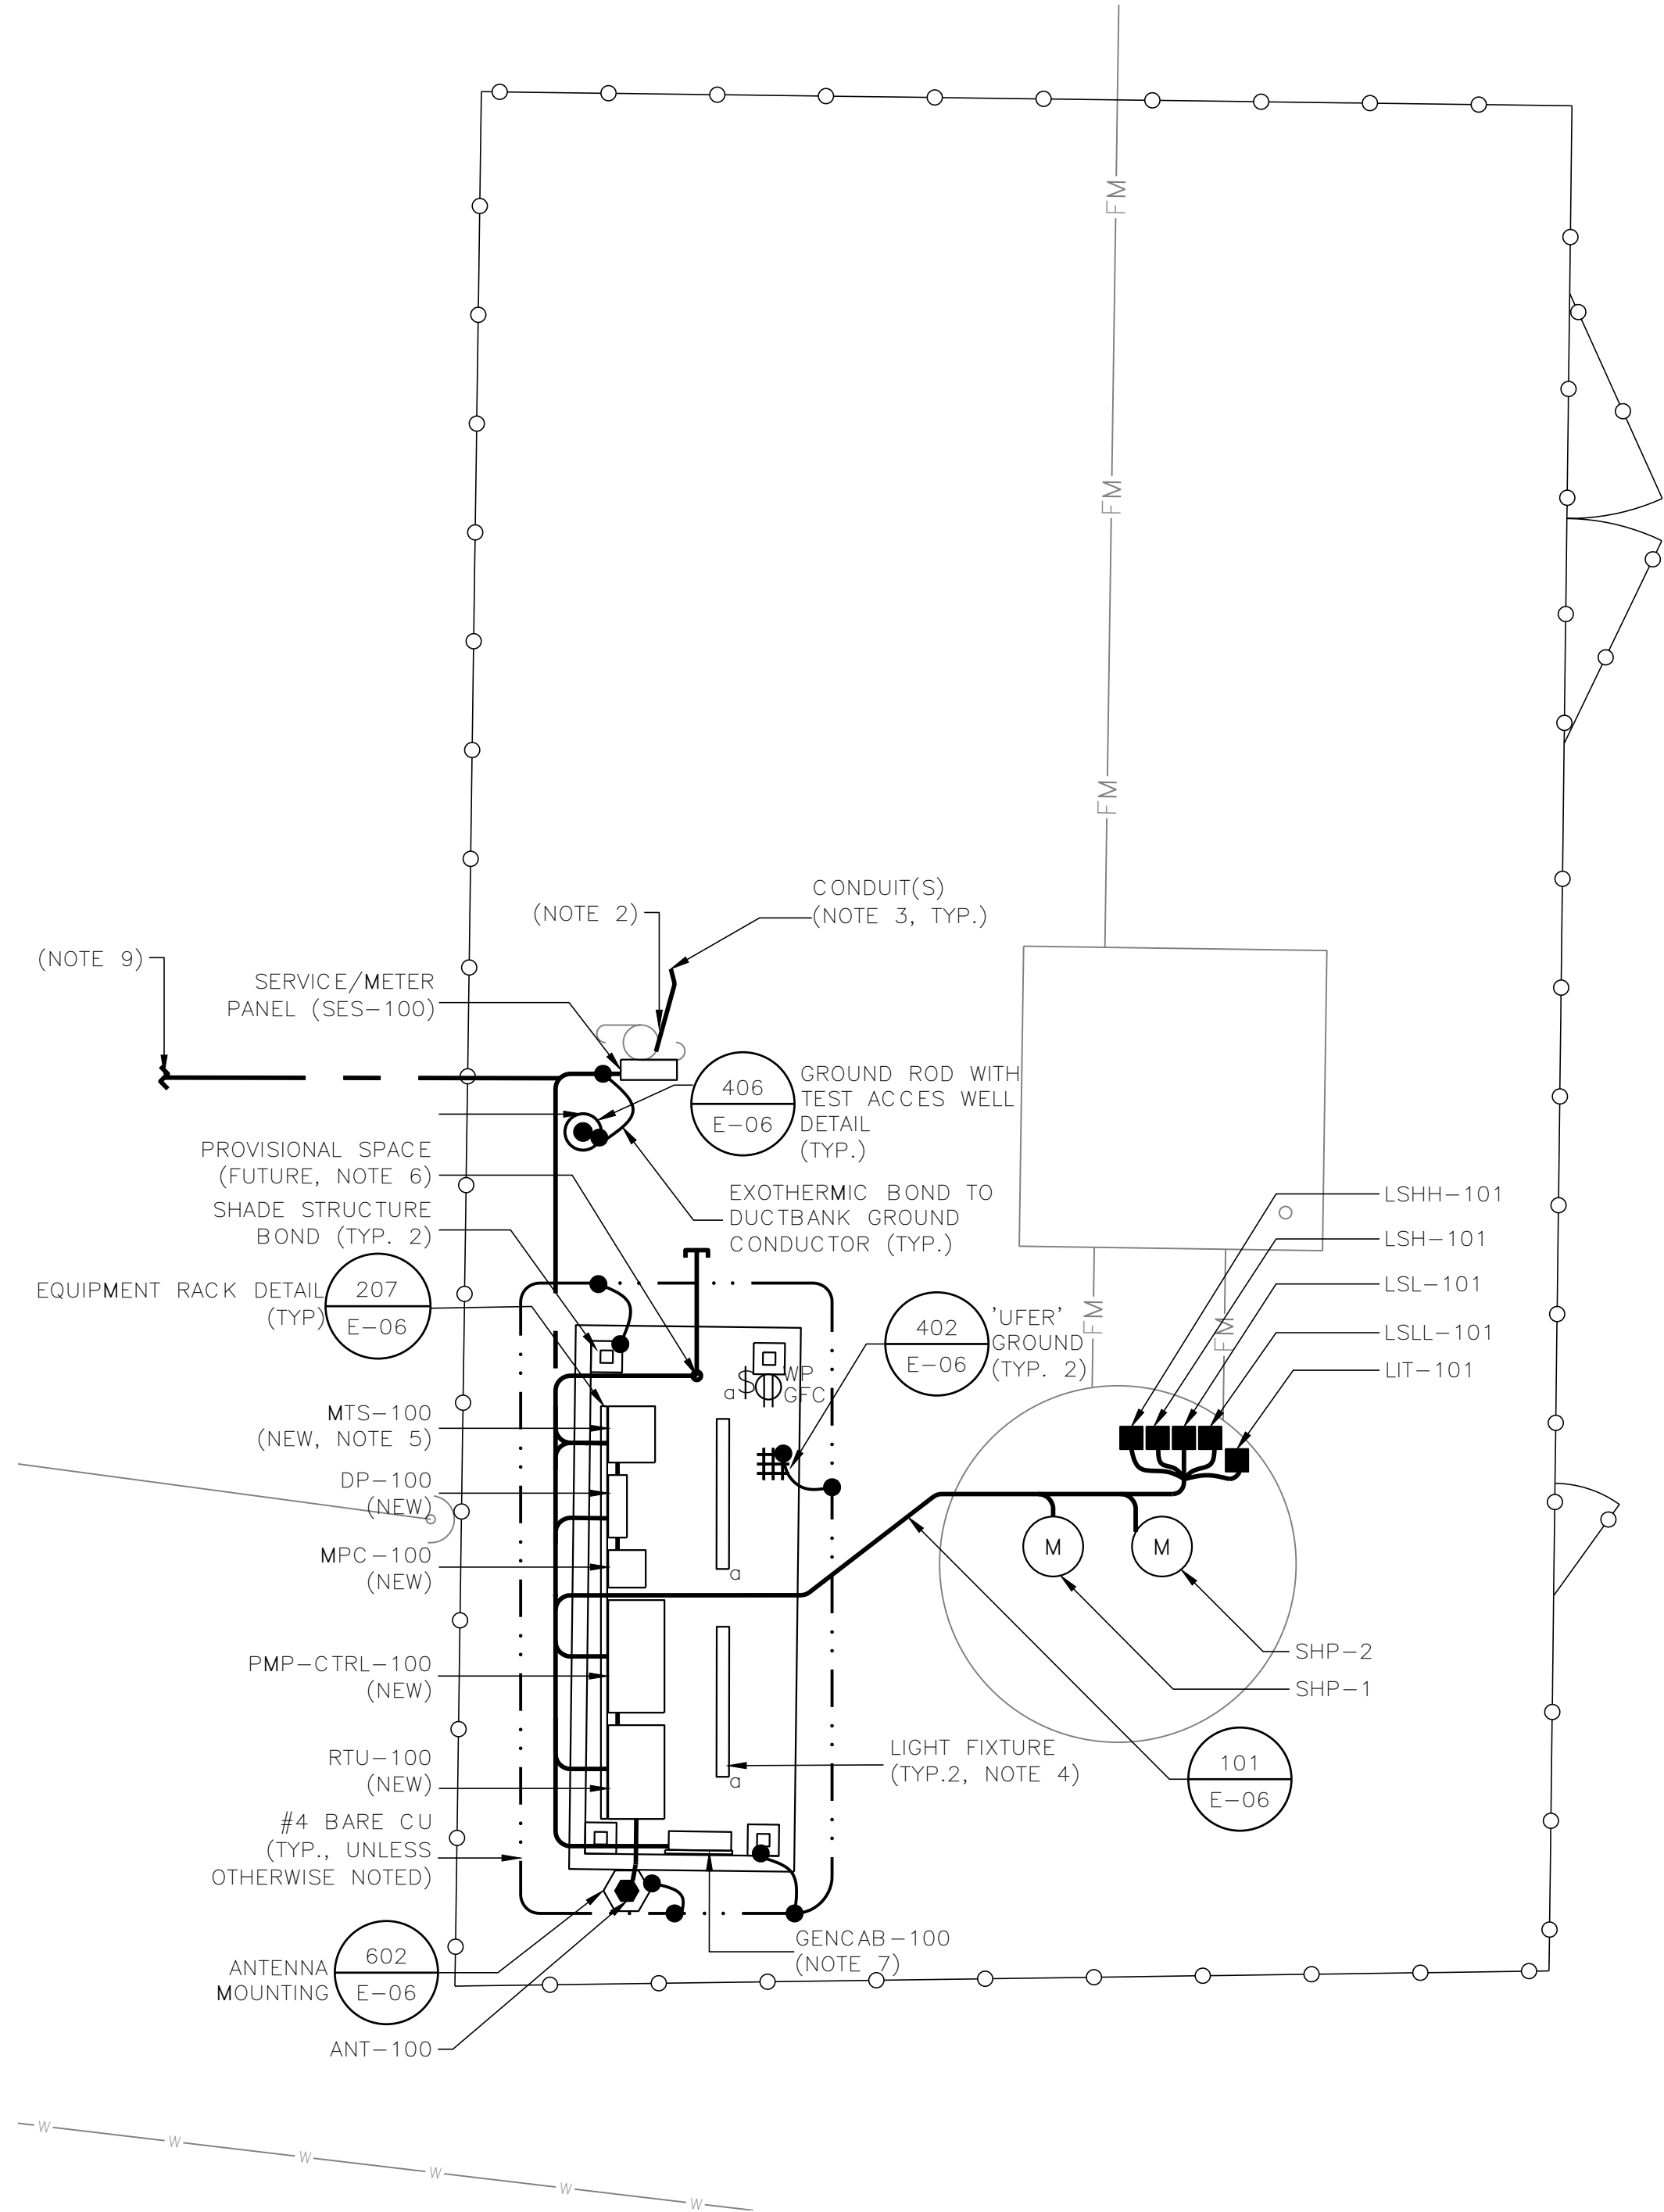

B COALMINE ELECTRICAL INSTALLATION PLAN


4 3 2 1 0 2 4
SCALE: 1/4" = 1'-0"

NOTES:

- DEMOLISHED EQUIPMENT INCLUDING ASSOCIATED WIRE AND ABOVE GROUND CONDUITS SHALL BE EITHER RETURNED TO OWNER OR PROPERLY DISPOSED OF AS DIRECTED BY OWNER.
- PROVIDE CONDUIT STUB UP FOR OWNER UTILIZATION IN INSTALLATION OF SITE LIGHT.
- REFER TO CONDUIT BLOCK DIAGRAM ON SHEET E-05 FOR SYSTEM CONDUIT INFORMATION/REQUIREMENTS (I.E. TO/FROM INFO, SIZES, TAG#'S, CONTENTS ETC.).
- REFER TO LIGHTING FIXTURE SCHEDULE ON SHEET E-03.
- FIELD SHALL VERIFY CONDITION OF EXISTING MANUAL TRANSFER SWITCH AND REUSE IF POSSIBLE. IF REUSE IS NOT SUITABLE, REFER TO SHEET E-02 FOR REPLACEMENT CRITERIA.
- PROVIDE 2" CONDUIT STUB UP, CAPPED AT FINISHED FLOOR LEVEL FOR FUTURE USE BY OWNER. CONDUIT SHALL BE STUBBED AND CAPPED BELOW GRADE 5'-0" NORTH OF THE ELECTRICAL EQUIPMENT PAD.
- PROVIDE GENERATOR TERMINATION CABINET, NEMA 4. SIZE AS REQUIRED.
- ALL INSTALLATIONS WITHIN WETWELL SHALL BE CLASS 1, DIVISION 1 COMPLIANT AND SHALL COMPLY WITH ALL REQUIREMENTS FOR CLASSIFIED AREAS AS DEFINED IN ARTICLE 500 OF THE NATIONAL ELECTRICAL CODE.
- COORDINATE WITH UTILITY FOR NEW UNDERGROUND ELECTRICAL SERVICE FEED.

COPYRIGHT © 2023

NAVAJO TRIBAL UTILITY AUTHORITY
DESIGN AND CONSTRUCTION OF FIVE LIFT STATION FACILITIES
COALMINE DEMOLITION AND
SITE IMPROVEMENT PLANS



EXPIRATION DATE: 12/31/24

Drawn by: GAR

Design by: GAR

Approved by: AGA

Date

05/25/23

Project No.

2338

Sheet No.

E-04


100% SUBMITTAL -- ISSUED FOR CONSTRUCTION




- [illegible]

EXPIRATION DATE: <u>12/31/24</u>	
Drawn by:	GAR
Design by:	GAR
Approved by:	AGA
Date <u>05/25/23</u>	
Project No. <u>2338</u>	
Sheet No. <u>E-05</u>	


May 25, 2023 - 12:53pm
X:\2500\2502338\23 NTUA Code\mine Lift Station\100 - E&I Design\CAD Files\2338\23_E06.dwg

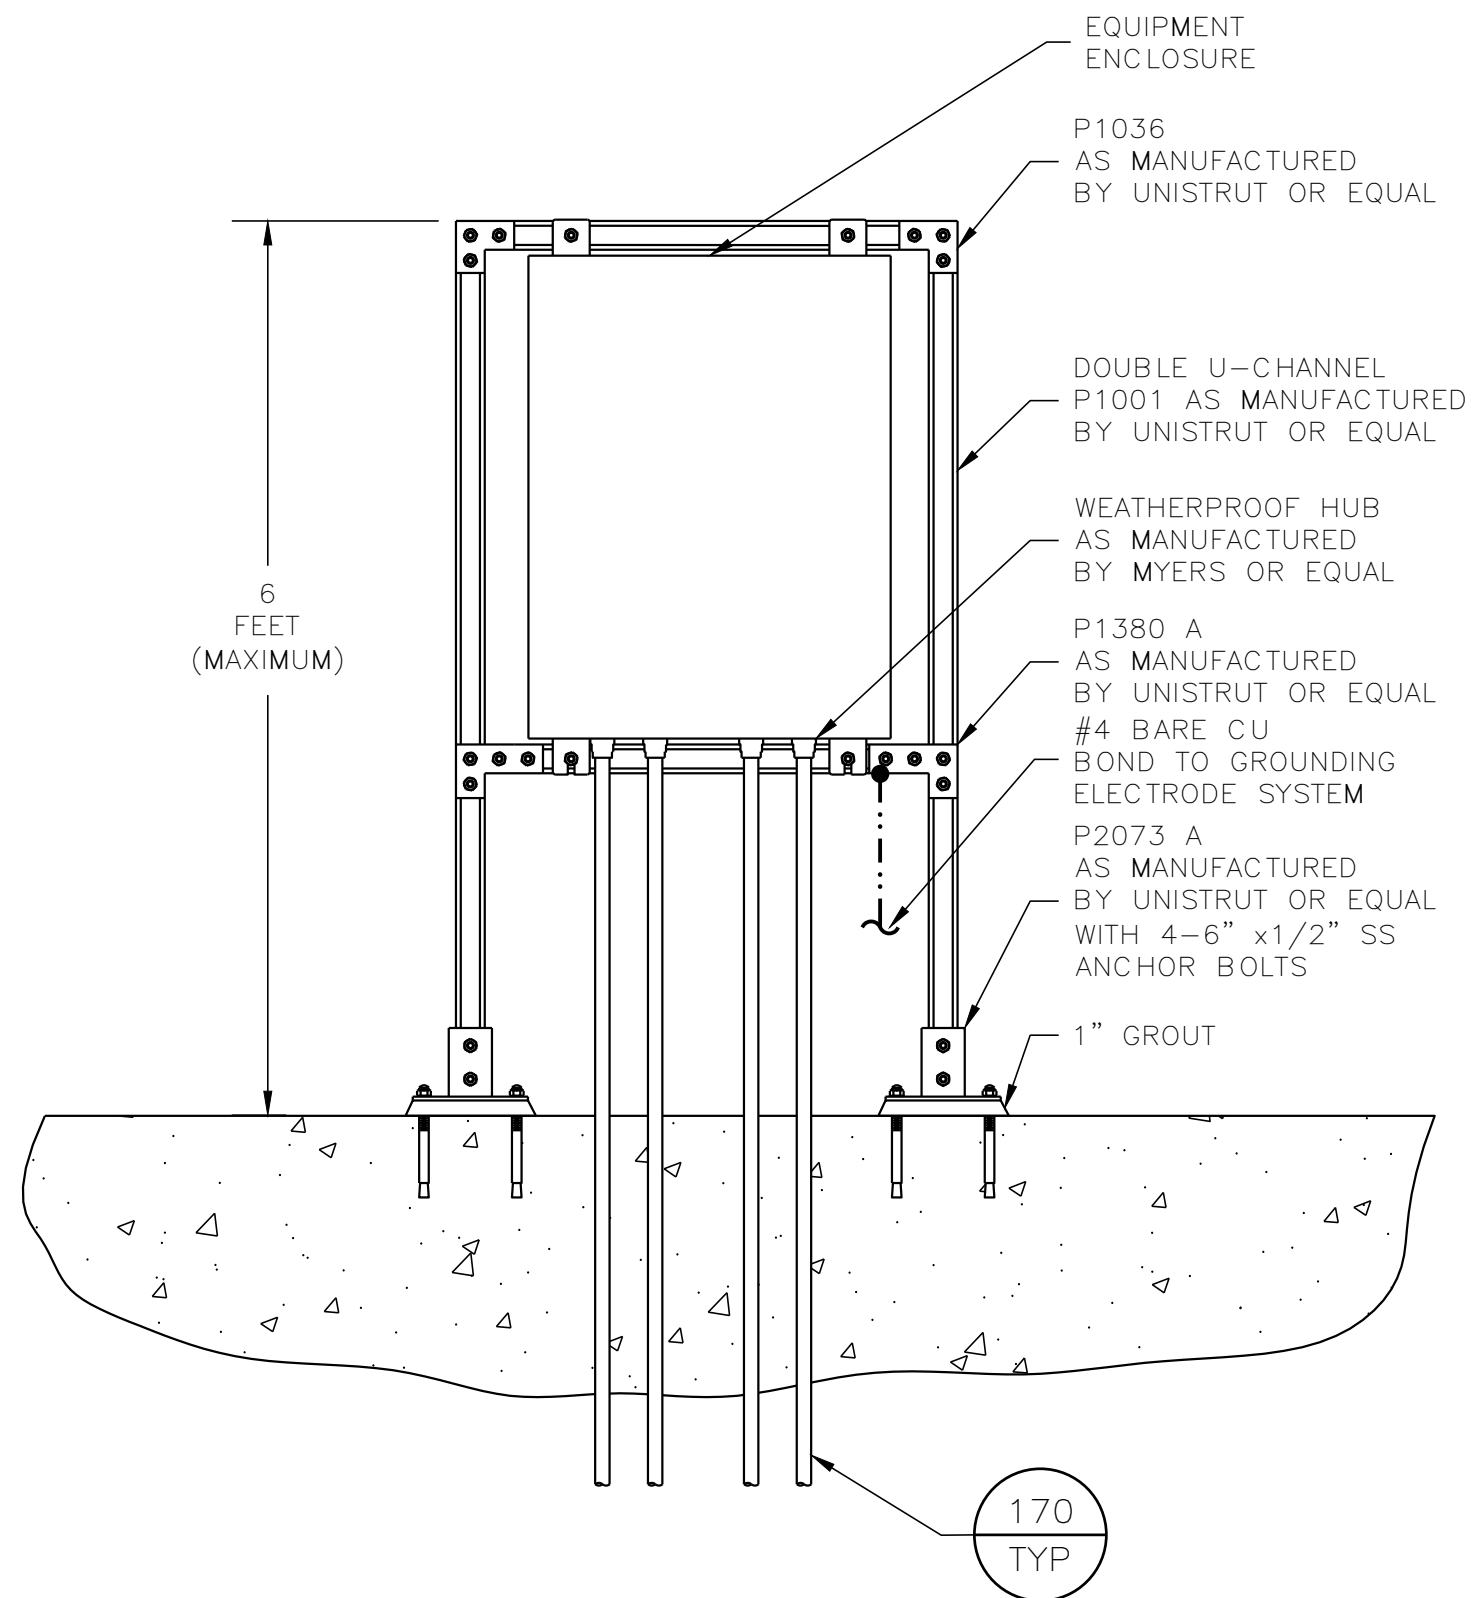

207 TYP EQUIPMENT RACK DETAIL - NON-CLASSIFIED AREAS
NOT TO SCALE

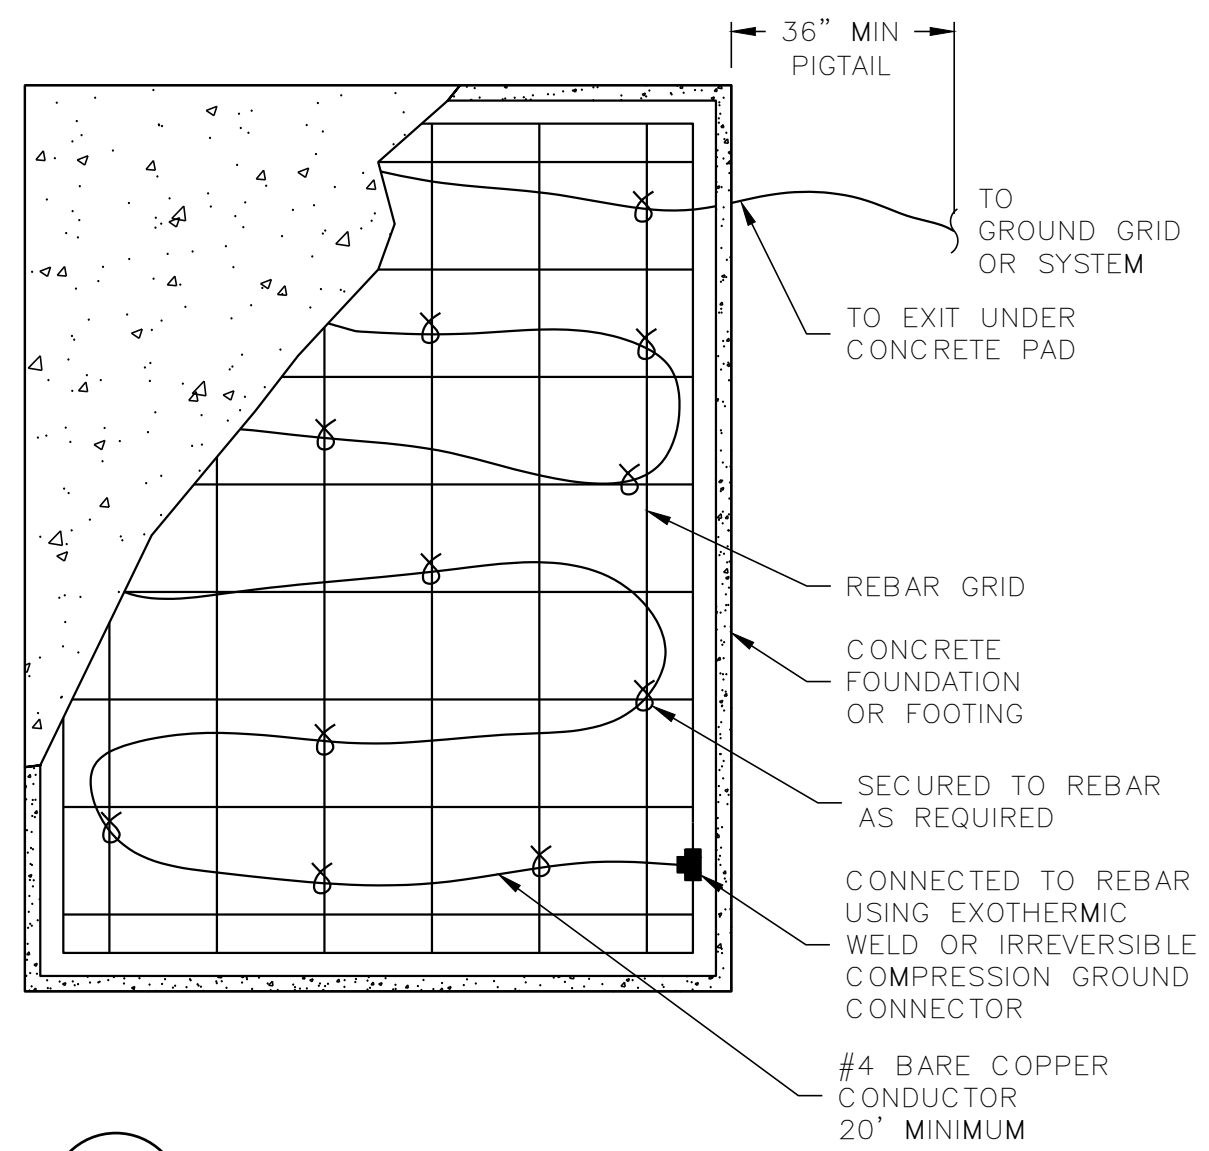


402 TYP "UFER" GROUNDING DETAIL
NOT TO SCALE

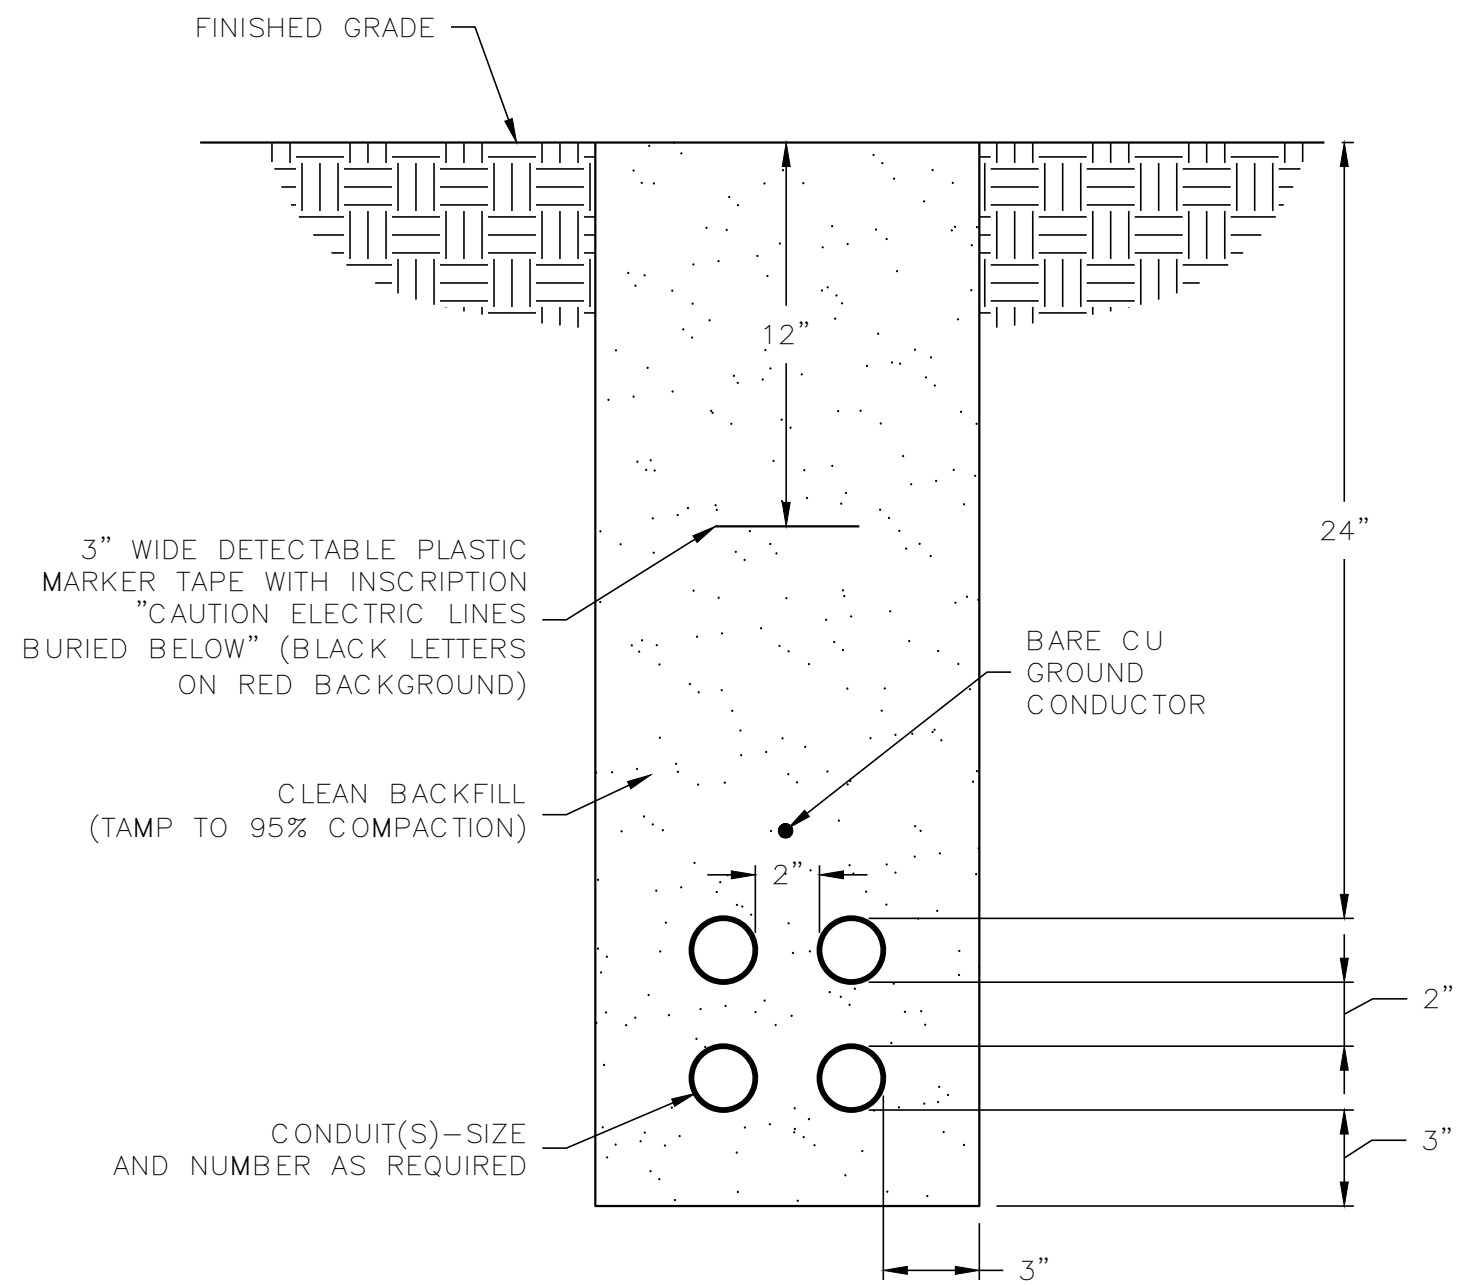


- NOTES:
- GROUND CONDUCTOR SHALL RUN CONTINUOUSLY THROUGH MANHOLES AND SHALL CONTINUE FROM DUCTBANK INTO SWITCHGEAR OR BUILDING GROUNDING SYSTEM AND SHALL BE BONDED TO EACH RIGID METAL CONDUIT. SIZE TO BE #4 (MIN.) UNLESS OTHERWISE INDICATED ON PLANS.
 - ALL DIMENSIONS ARE MINIMUM.

101 TYP DUCTBANK - DIRECT BURIED
NOT TO SCALE

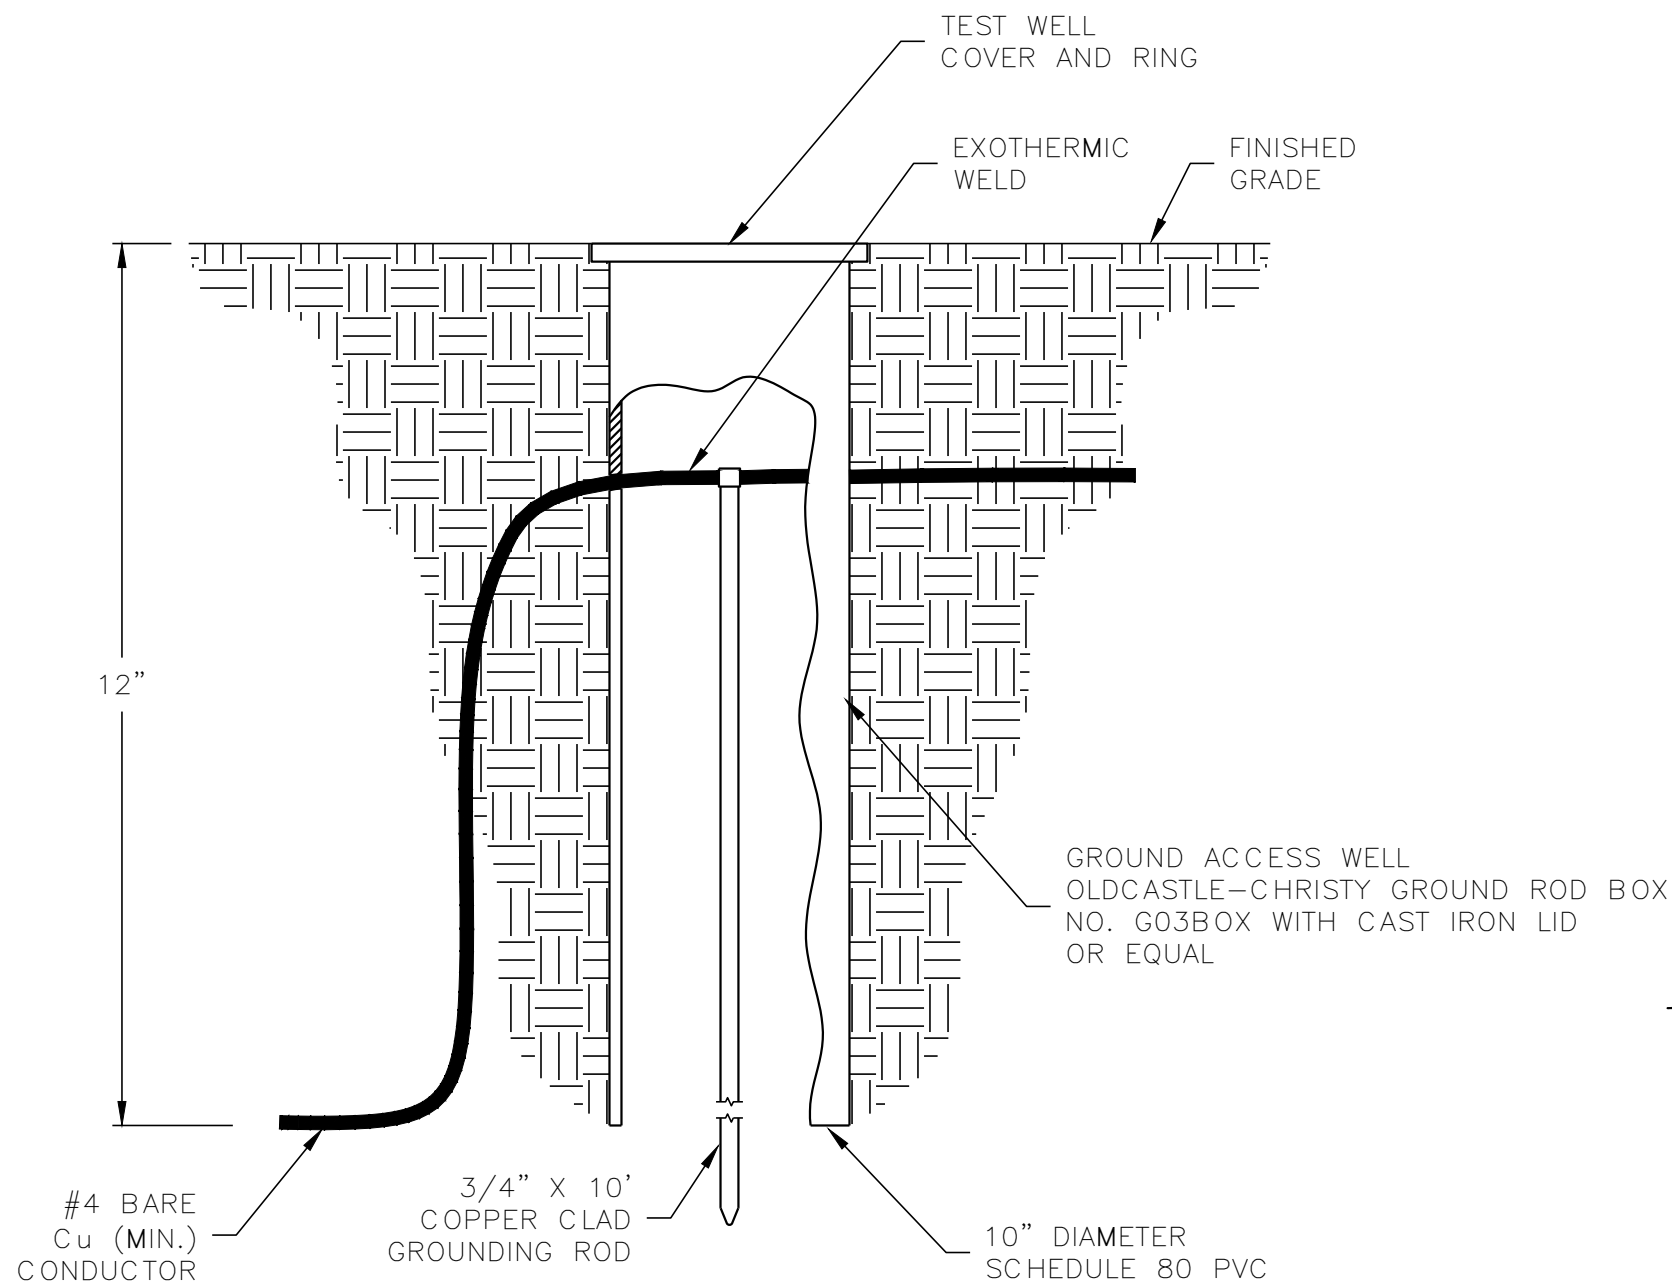


406 TYP GROUND ROD WITH TEST ACCESS WELL
NOT TO SCALE

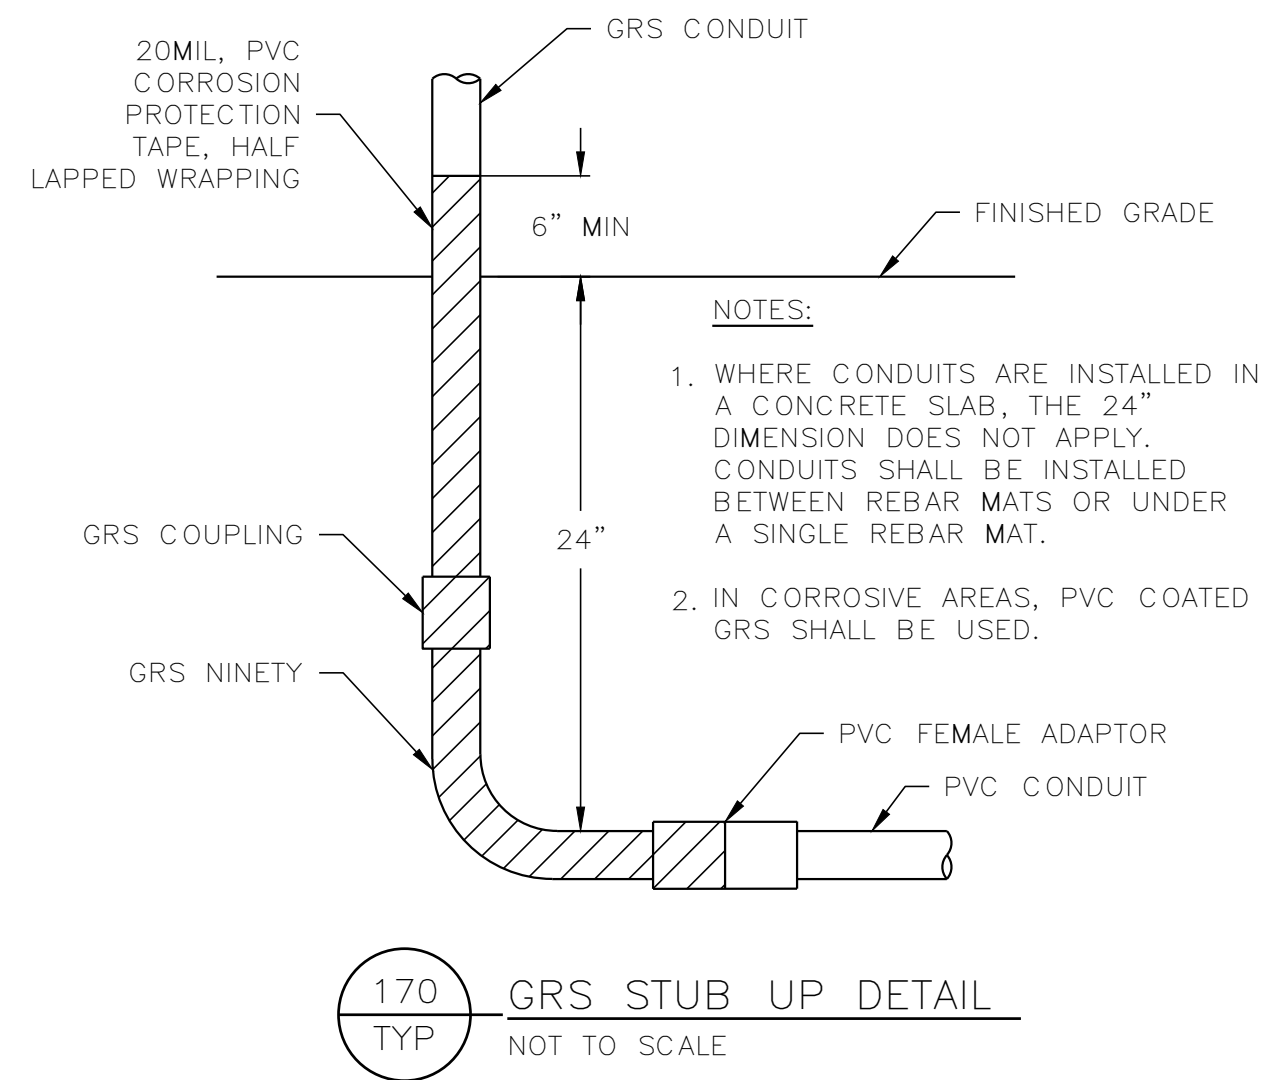

- NOTES:
- WHERE CONDUITS ARE INSTALLED IN A CONCRETE SLAB, THE 24" DIMENSION DOES NOT APPLY. CONDUITS SHALL BE INSTALLED BETWEEN REBAR MATS OR UNDER A SINGLE REBAR MAT.
 - IN CORROSIVE AREAS, PVC COATED GRS SHALL BE USED.

170 TYP GRS STUB UP DETAIL
NOT TO SCALE

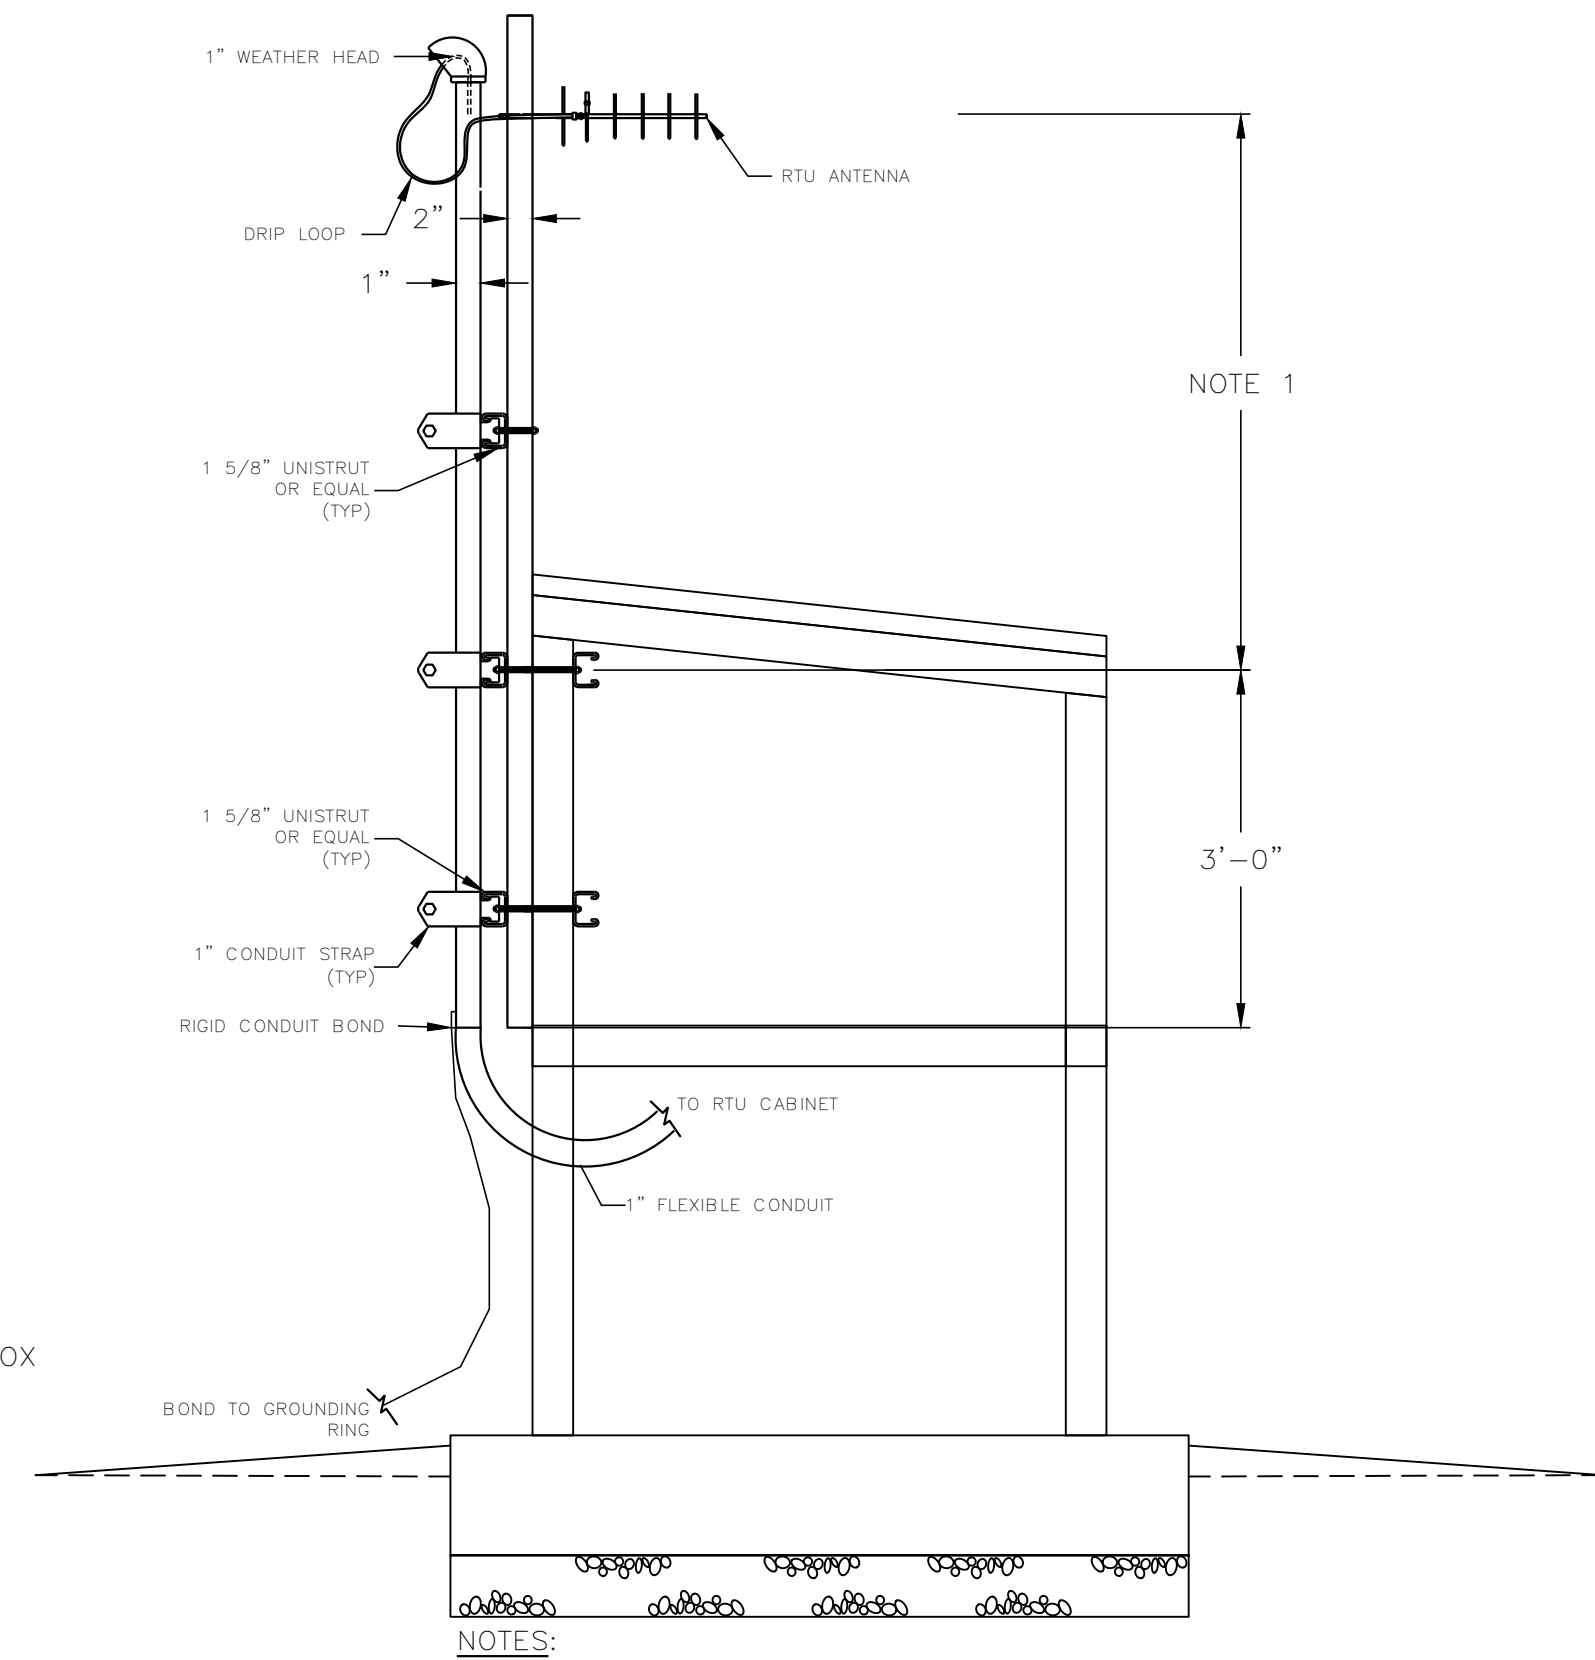

- NOTES:
- CONTRACTOR SHALL COORDINATE WITH OWNER FOR MOUNTING HEIGHT OF ANTENNA.

602 TYP ANTENNA POLE MOUNTING
NOT TO SCALE

May 25, 2023 -- 12:56pm
X:\2309\02309-23 NTAU Coalmine Lift Station\100 - E&I Design\CAD Files\02309-23_01.dwg

ISA INSTRUMENT IDENTIFICATION TABLE					P&ID ABBREVIATIONS					TAG NUMBERS AND DESIGNATIONS		LINE SYMBOLS		COPYRIGHT © 2023					
FIRST LETTERS		SUCCEEDING LETTERS																	
MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER															
A	ANALYZER		ALARM	AUTO	A	AMPERE	KW	KILOWATT	PRES	PRESSURE									
B	BURNER, COMBUSTION				AE	ANALYZER ELEMENT	LAN	LOCAL AREA NETWORK	PS	PRESSURE SWITCH									
C	CONDUCTIVITY			CLOSED	AFD	ADJUSTABLE FREQUENCY DRIVE	LC	LOCAL CONTROL PANEL	PSI	POUNDS PER SQUARE INCH									
D	DENSITY	DIFFERENTIAL			AI	ANALOG INPUT	LCP	LOCAL CONTROL PANEL	PV	PROCESS VARIABLE									
E	VOLTAGE		ELEMENT		AIC	AMPS INTERRUPTING CAPACITY	LI	LEVEL INDICATE	RAS	RETURN ACTIVATED SLUDGE									
F	FLOW	RATIO			ARV	AIR RELIEF VALVE	LOS	LOCK-OFF-STOP	RAW	RAW WATER									
G	GAUGE		GLASS, VIEWING DEVICE		AO	ANALOG OUTPUT	LR	LOCAL/REMOTE	REM	REMOTE									
H	HAND			HIGH	AS	AIR SUPPLY	LS	LEVEL (i.e., FLOAT) SWITCH	RF	RADIO FREQUENCY									
I	CURRENT		INDICATE		ATS	AUTOMATIC TRANSFER SWITCH	LSL	LEVEL SWITCH (LOW)	RIO	REMOTE INPUT OUTPUT									
J	POWER	SCAN			AUTO	AUTOMATIC	LSLL	LEVEL SWITCH (LOW LOW)	RS	RAW SEWAGE									
K	TIME, TIME SCHED.	TIME RATE OF CHANGE		CONTROL STATION	CB	CIRCUIT BREAKER	LSHH	LEVEL SWITCH (HIGH HIGH)	RSP	RAW SEWAGE PUMP									
L	LEVEL		LIGHT	LOW	CL2	CHLORINE	LT	LEVEL TRANSMITTER	RST	RESET									
M	MOTION			MIDDLE	CON	CONTACTOR	M	MOTOR	RTD	RESISTANCE TEMPERATURE DETECTOR									
N	INTRUSION			NORMAL	CU	COPPER	MA	MANUAL/AUTO	RTU	REMOTE TELEMETRY UNIT									
O	TORQUE		ORIFICE, RESTRICTION	OPEN	CV	CONTROL VALVE	mA	MILLIAMPERE	RUNF	RUN (FAST SPEED)									
P	PRESSURE		POINT CONNECTION	STOP	DCS	DISTRIBUTED CONTROL SYSTEM	MC	MANUFACTURE CABLE	RUNS	RUN (SLOW SPEED)									
Q	QUANTITY	INTEGRATE, TOTALIZE			DI	DISCRETE INPUT	MCC	MOTOR CONTROL CENTER	SB	SLUDGE BLANKET									
R	RADIATION		RECORD, OR PRINT	RUN OR REMOTE	DO	DISSOLVED OXYGEN, DISCRETE OUTPUT	MCP	MOTOR CIRCUIT PROTECTOR	SEQ	SERVICE ENTRANCE EQUIPMENT									
S	SPEED, FREQUENCY	SAFETY		START	DP	DIFFERENTIAL PRESSURE	MFR(S)	MANUFACTURER(S)	SES	SERVICE ENTRANCE SECTION									
T	TEMPERATURE			TRANSMIT	DWG	DRAWING	MGD	MILLION GALLONS PER DAY	SLC	SINGLE LOOP CONTROLLER									
U	MULTIVARIABLE		MULTIFUNCTION	MULTIFUNCTION	ETM	ELAPSED TIME METER	MGL	MILLIGRAMS PER LITER	SLOS	START-LOCK-OFF-STOP									
V	VIBRATION			VALVE, LOUVER	ETMF	ELAPSED TIME METER (FAST SPEED)	MH	MANHOLE	SO2	SULFUR DIOXIDE									
W	WEIGHT		WELL		ETMs	ELAPSED TIME METER (SLOW SPEED)	MLR	MIXED LIQUOR RETURN	SOV	SOLENOID OPERATED VALVE									
X	MOTOR	X-AXIS	UNCLASSIFIED	UNCLASSIFIED	EOL	ELECTRONIC OVERLOAD	MOD	MODULATED	SP	SET POINT									
Y	EVENT, STATE, OR PRESENCE	Y-AXIS		RELAY, COMPUTE, CONVERT	EXIST	EXISTING	MTU	MASTER TELEMETRY UNIT	SPD	SPEED									
Z	POSITION	Z-AXIS		DRIVER, ACTUATOR, FINAL CONTROL ELEMENT	FA	FOUL AIR	NPW	NON-POTABLE WATER	SS	START/STOP (MAINTAINED)									
					FC	FAIL CLOSED	NS	NITROGEN SUPPLY	SSS	SOLID STATE STARTER (SOFT START)									
					FE	FINAL EFFLUENT	NTU	TURBIDITY	STR	MOTOR STARTER									
					FIT	FLOW INDICATING TRANSMITTER	O/C	OPEN / CLOSE	TAH	TEMPERATURE ALARM HIGH									
					FR	FORWARD-REVERSE	OCA	OPEN-CLOSE-AUTO	T/M	TEMPERATURE AND/OR MOISTURE									
					FS	FLOAT SWITCH	OCR	OPEN-CLOSE-REMOTE	TEMP	TEMPERATURE									
					FVNR	FULL VOLTAGE NON-REVERSING	OIT	OPERATOR INTERFACE TERMINAL	TIT	TEMPERATURE INDICATING									
					FW	FINISHED WATER	OL	OVERLOAD	TSH	TRANSMITTER									
					GND	GROUND	OO	ON/OFF (MAINTAINED)	TSS	TEMPERATURE SWITCH HIGH									
					GAL	GALLONS	OOA	ON-OFF-AUTO	UG	UNDERGROUND									
					GPD	GALLONS PER DAY	OOR	ON-OFF-REMOTE	UPS	UNINTERRUPTIBLE POWER SUPPLY									
					GPH	GALLONS PER HOUR	OSC	OPEN-STOP-CLOSE	USO	UNINTERRUPTIBLE POWER SUPPLY									
					GPM	GALLONS PER MINUTE	PAH	PRESSURE ALARM HIGH	VAC	UP/STOP/DOWN									
					H, HI	HIGH	PER	PERMISSIVE	VDC	VOLTAGE ALTERNATING CURRENT									
					H2S	HYDROGEN SULFIDE	pH	POWER OF HYDROGEN	VFD	VOLTAGE DIRECT CURRENT									
					HMI	HUMAN MACHINE INTERFACE	PIT	PRESSURE INDICATING TRANSMITTER	W	VARIABLE FREQUENCY DRIVE									
					HOA	HAND-OFF-AUTO	PLC	PROGRAMMABLE LOGIC CONTROLLER	WAS	WATER									
					I	CURRENT	PNL	PANEL	WW	WASTE ACTIVATED SLUDGE									
					IO	INPUT/OUTPUT	PO	PULSE OUTPUT	XMTR	WASTEWATER									
					IOE	INTERNAL-OFF-EXTERNAL	POS	POSITION	YA	TRANSMITTER									
					ISA	INTERNATIONAL SOCIETY OF AUTOMATION	POT	POTENTIOMETER	YC	EVENT ALARM									
					JB	JUNCTION BOX	PPG	POUNDS PER GALLON	YCR	EVENT CONTROL REMOTE									
					JI	POWER INDICATE	PPH	POUNDS PER HOUR	YI	EVENT INDICATION									
					JIN	POWER INDICATE NORMAL	PPM	PARTS PER MILLION	YIA	EVENT INDICATION									
							PR	PAIR	ZS	POSITION (i.e. LIMIT) SWITCH									

P&ID VALVE SYMBOLS					P&ID EQUIPMENT AND PROCESS SYMBOLS					SENSING, INDICATION, AND CONTROL SYMBOLS					P&ID INTERFACE SYMBOLS				

