





# DESIGN AND CONSTRUCTION OF SAWMILL LIFT STATION FACILITIES NAVAJO TRIBAL UTILITY AUTHORITY 100% FOR CONSTRUCTION SEPTEMBER, 2025

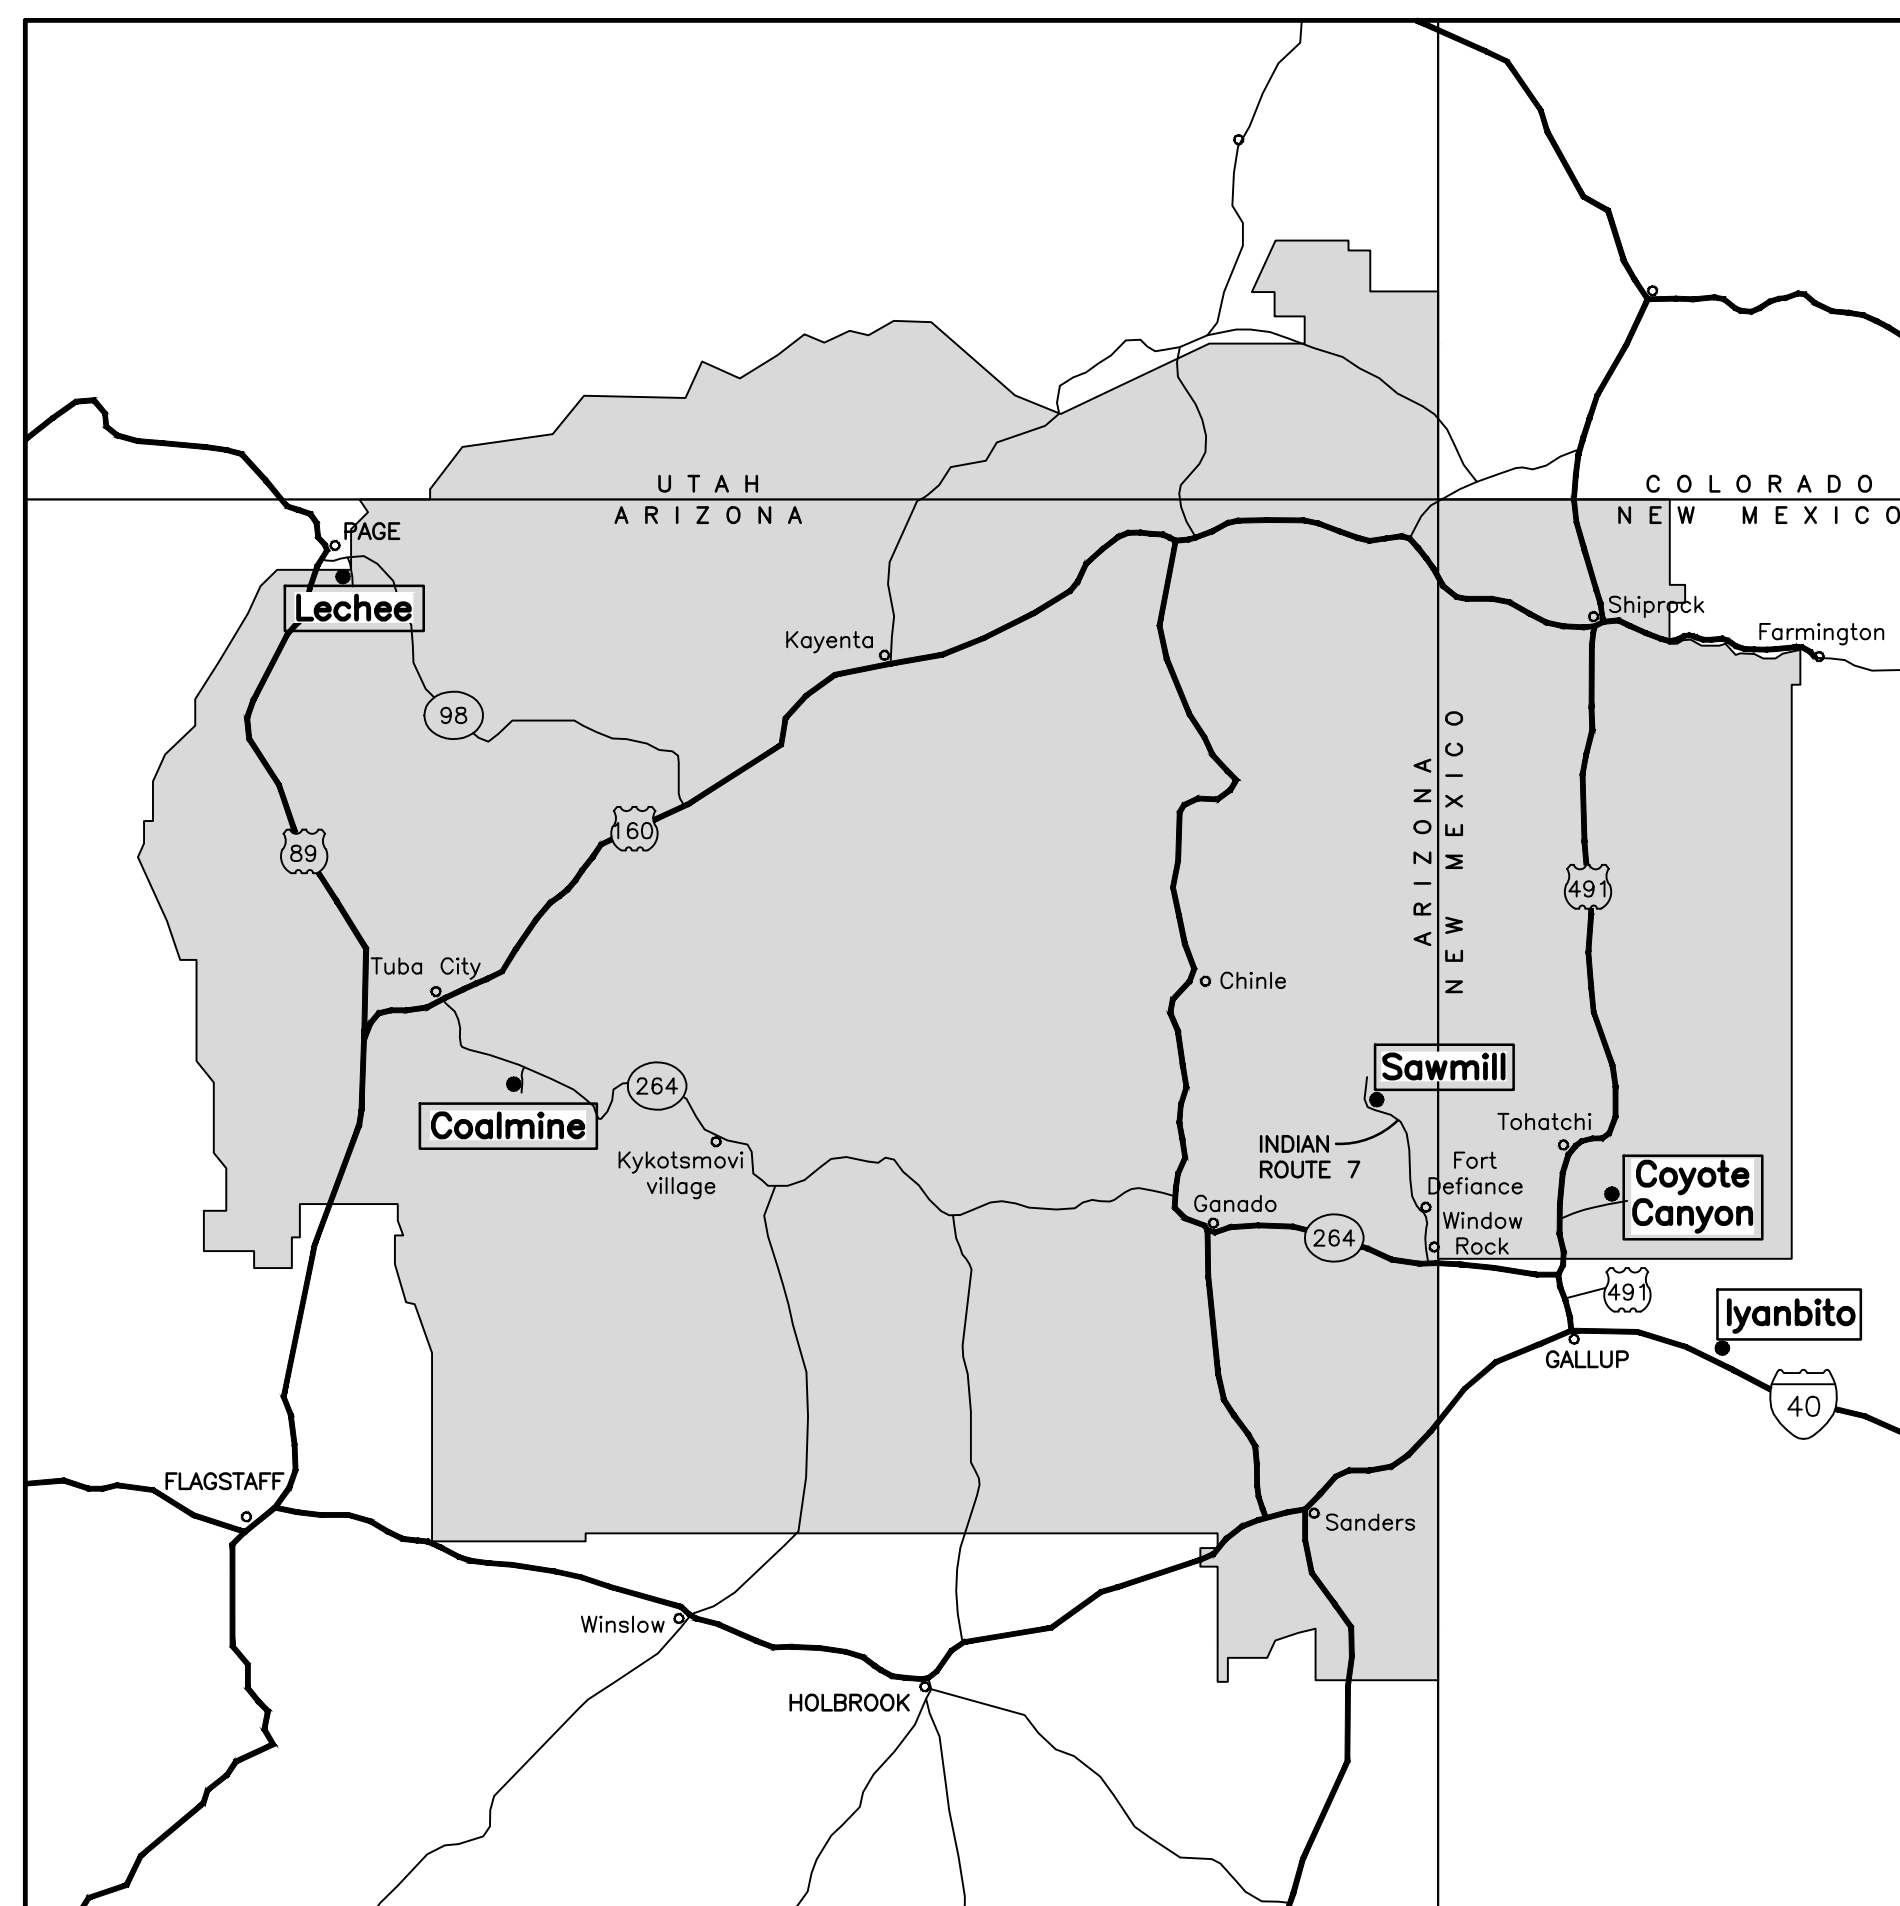

**LOCATION MAP**

N  
↑  
Not to Scale

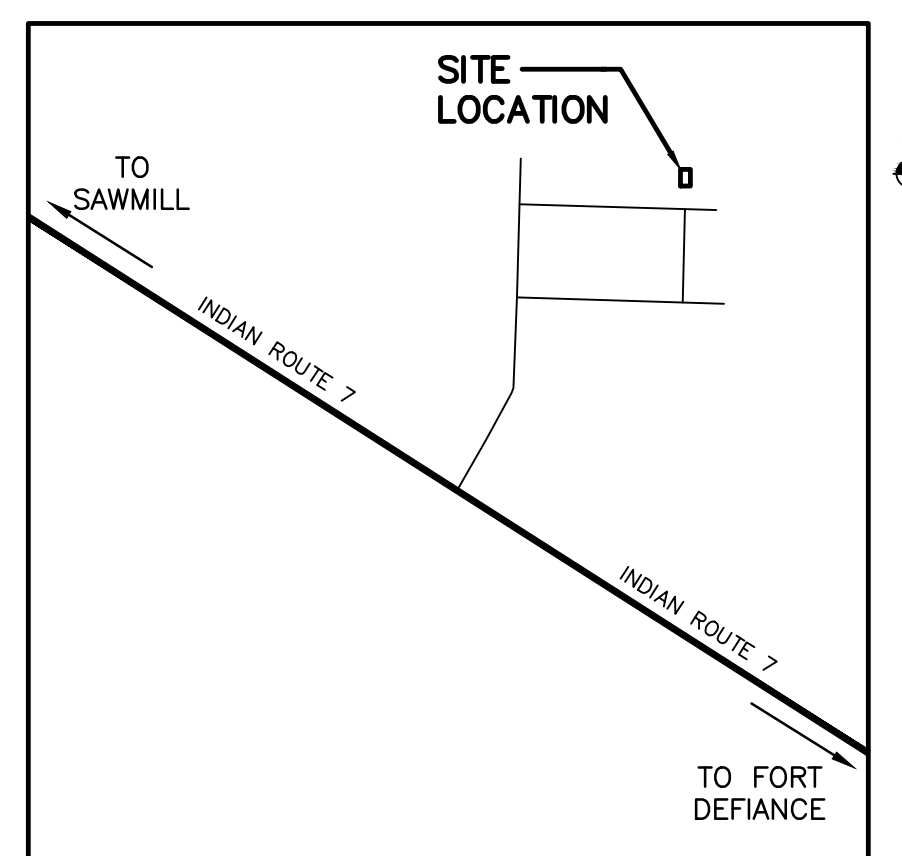

**SAWMILL**  
SITE LATITUDE: 35°53'51"N  
LONGITUDE: 109°8'56"W  
**VICINITY MAPS**

**APPROVAL**

\_\_\_\_\_  
NTUA ENGINEERING AND TECHNICAL SERVICES DIVISION

\_\_\_\_\_  
DATE

\_\_\_\_\_  
NTUA CIVIL ENGINEER

\_\_\_\_\_  
10/08/2025

\_\_\_\_\_  
DATE


Sheet List Table

Sheet Number	Sheet Title
GENERAL	
G-01	COVER SHEET AND VICINITY MAPS
G-02	GENERAL NOTES, ABBREVIATIONS, AND DRAWING INDEX
G-03	GENERAL SITE NOTES, SYMBOLS AND CIVIL LEGEND
G-04	GENERAL STRUCTURAL NOTES
CIVIL	
C-04	SAWMILL SITE DEMOLITION PLAN AND SITE IMPROVEMENTS PLAN
C-08	SHADE CANOPY PLAN AND SECTIONS
C-11	CIVIL DETAILS AND SPECIFICATIONS
MECHANICAL	
M-01	EQUIPMENT SCHEDULES AND SPECIFICATIONS
M-04	SAWMILL WETWELL REMOVALS AND IMPROVEMENTS
M-07	MISCELLANEOUS DETAILS
ELECTRICAL	
E-01	ELECTRICAL NOTES, SYMBOLS, AND LEGEND
E-02	SINGLE LINE DIAGRAM
E-03	ELECTRICAL SCHEDULES
E-04	DEMOLITION AND SITE IMPROVEMENT PLANS
E-05	CONNECTION DIAGRAM
E-06	RTU POWER DISTRIBUTION SCHEMATIC
E-07	CONDUIT BLOCK DIAGRAM
E-08	ELECTRICAL DETAILS SHEET
INSTRUMENTATION	
I-01	P&ID NOTES, SYMBOLS, AND LEGEND
I-02	P&ID

NAVAJO TRIBAL UTILITY AUTHORITY  
DESIGN AND CONSTRUCTION OF SAWMILL LIFT STATION FACILITIES

COVER SHEET AND VICINITY MAPS

No.	Revision	Note	Date	Drawn	Check

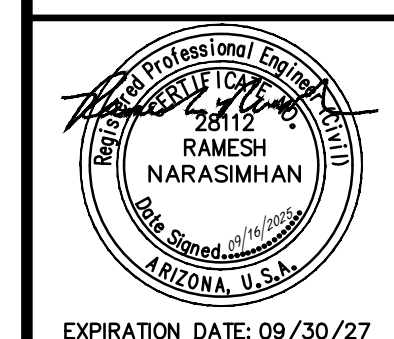

Drawn by: KWB  
Design by: LAH  
Approved by: RN  
Date: 09/16/2025  
Project No.: 2496  
Sheet No.: G-01





**GENERAL STRUCTURAL NOTES**

(IN CASE OF CONFLICT WITH DRAWINGS STRICTER REQUIREMENTS SHALL GOVERN.)

**GENERAL REQUIREMENTS**

CODE: SEE GENERAL NOTES

LOADS:

LIVE LOADS:

CONCRETE WALKWAYS	300 PSF
STAIRS	300 PSF
STAIR TREADS	300 LB POINT LOAD
PLATFORMS (GRATING, CHECKERED PLATE)	300 PSF

WIND: 90 MPH BASIC WIND. EXPOSURE "C". IMPORTANCE FACTOR 1.15

SEISMIC: SITE CLASS: AS THE LIMITED GEOTECHNICAL INVESTIGATION DID NOT INCLUDE IDENTIFICATION OF SEISMIC FACTORS, USE SITE CLASS E FOR IYANBITO. FOR OTHER SITES USE D. IMPORTANCE FACTOR = 1.25

SNOW: IMPORTANCE FACTOR 1.10

**EARTHWORK AND FOUNDATION**

- FOUNDATION DESIGN IS BASED ON THE FOLLOWING SOIL BEARING CAPACITIES:  
BEARING - ALL DEPTHS 1,000 PSF
- DESIGN LATERAL AT-REST PRESSURES:  
NOT APPLICABLE
- PLACE FOUNDATION CONCRETE ONLY ON SUBGRADE PREPARED PER RECOMMENDATIONS OF THE DRAWINGS AND SPECIFICATIONS. VERIFY THE SUITABILITY OF THE BEARING MATERIAL WITH THE ENGINEER. BEFORE PLACING FOUNDATIONS. ENGINEERED FILL SHALL MEET THE REQUIREMENT STATED IN THE DRAWINGS AND SPECIFICATIONS.
- PLACE DOWELS AND ANCHOR BOLTS BEFORE POURING CONCRETE. USE TEMPLATES TO ENSURE PROPER PLACEMENT.

**REINFORCED CONCRETE:**

- CONCRETE SHALL HAVE MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3,500 PSI FOR STRUCTURES, FOUNDATIONS, AND SLABS ONGRADE UNLESS NOTED OTHERWISE ON DRAWINGS. ASTM C 150 TYPE II LOW ALKALI CEMENT. AIR CONTENT SHALL BE 5.5% PLUS OR MINUS 1%.
- ALL CONCRETE CONSTRUCTION, INCLUDING BENDING OF BARS, SHALL COMPLY WITH CURRENT ACI "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" (CURRENT ACI 318).
- UNLESS SHOWN OTHERWISE, MINIMUM REINFORCEMENT OF CONCRETE WALLS OR SLABS SHALL BE:  
LESS THAN 10" THICKNESS - USE #5 @ 12" EW. SEE DRAWINGS FOR LOCATION OF REINFORCEMENT. MORE THAN 10" THICK - USE #5 @ 12" EW EF.
- ALL WALL REINFORCEMENT AT CORNERS OR JUNCTIONS OF WALLS SHALL BE CONTINUOUS, LAPPED, OR TERMINATED IN AN ACI STANDARD 90 DEGREE HOOK. LAP SPLICES SHALL CONFORM WITH NOTE 12.
- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, ALL HORIZONTAL AND VERTICAL BARS SHALL BE DOWELED. DOWELS LAP AND MATCH LARGER DIAMETER BAR.
- ALL SLABS, BEAMS, AND COLUMN REINFORCING BARS SHALL HAVE A MINIMUM EXTENSION OR ANCHORAGE INTO SUPPORTS IN ACCORDANCE WITH ACI 318.
- STIRRUP SUPPORT BARS SHALL BE PROVIDED BETWEEN ENDS OF TOP BARS AS REQUIRED.
- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, CONCRETE COVER FOR #11 AND SMALLER REINF BARS SHALL BE AS FOLLOWS:  
A. SLABS AND JOISTS:  
FORMED CONCRETE SURFACES FOR DRY CONDITIONS.....3/4"  
FORMED CONCRETE SURFACES EXPOSED TO EARTH, WATER, OR WEATHER, OR LOCATED OVER WATER  
#5 BARS AND SMALLER.....1 1/2"  
#6 BARS AND LARGER.....2"  
B. BEAMS AND COLUMNS:  
FORMED CONCRETE SURFACES FOR DRY CONDITIONS  
STIRRUPS, SPIRALS, AND TIES.....2"  
PRINCIPAL REINFORCEMENT.....2 1/2"  
FORMED CONCRETE SURFACES EXPOSED TO EARTH, WATER, OR WEATHER, OR BEAMS LOCATED OVER WATER  
STIRRUPS AND TIES.....2"  
PRINCIPAL REINFORCEMENT.....2 1/2"  
C. WALLS:  
FORMED CONCRETE SURFACES FOR DRY CONDITIONS....3/4"  
FORMED CONCRETE SURFACES EXPOSED TO EARTH, WATER, OR WEATHER.....2"  
D. FOOTINGS AND BASE SLABS AND FOUNDATIONS FOR SHADE CANOPIES, GENERATORS, AND FUEL TANKS FOR GENERATORS:  
FORMED VERTICAL CONCRETE SURFACES.....2"  
AT UNFORMED SURFACES AND BOTTOMS IN CONTACT WITH EARTH OR CONCRETE WORK MATS.....3"  
TOP OF FOOTINGS.....SAME AS SLABS  
E. REINFORCEMENT SHALL BE PLACED WITHIN A TOLERANCE OF ±1/4" OF POSITION SPECIFIED.
- KEYWAYS AND WATERSTOPS SHALL END 3" BELOW THE TOP OF WALLS, UNLESS THERE IS A SLAB ON TOP OF THE WALL, IN WHICH CASE IT SHALL END AT THE BOTTOM OF THE SLAB. IN JOINTS WHERE WATERSTOP TERMINATES AT ADJOINING SLAB OR WALL, WATERSTOP SHALL BE EMBEDDED IN ADJOINING SLAB OR WALL A MINIMUM OF 6".
- WATERSTOP SHALL BE PLACED IN ALL CONSTRUCTION, CONTRACTION, AND EXPANSION JOINTS IN ALL WATER BEARING SLABS AND WALLS UNLESS OTHERWISE INDICATED ON THE DRAWINGS, AND IN ALL WALLS AND SLABS SUBJECTED TO EARTH BACKFILL. WATERSTOP IN THE WALLS SHALL BE CARRIED INTO SLABS AND SHALL BE SPLICED WITH THE WATERSTOP IN THE SLABS.
- NO BACKFILL SHALL BE PLACED AGAINST WALLS UNTIL CONCRETE HAS REACHED THE SPECIFIED STRENGTH AND THE CONNECTING SLABS AND BEAMS HAVE BEEN CAST AND HAVE REACHED THE SPECIFIED STRENGTH.

**12. LAP SPLICES:**

- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, THE LENGTH OF THE LAP SPICE SHALL BE CLASS "A" WHEN NO MORE THAN 1/2 THE BARS ARE LAP SPLICED WITHIN THE TABULATED LENGTH AND CLASS "B" WHEN MORE THAN 1/2 THE BARS ARE LAP SPLICED WITHIN THE TABULATED LENGTH.
- VALUES TABULATED BELOW FOR SPLICES ARE APPLICABLE ONLY WHEN THE COVER IS EQUAL TO ONE BAR DIAMETER OR MORE.
- WHEN MULTIPLE BARS ARE SPLICED AT THE SAME SECTION, THE CLEAR BAR SPACING IS THE MINIMUM CLEAR DISTANCE BETWEEN THE BARS OUTSIDE THE SPlice LENGTH MINUS ONE BAR DIAMETER.
- UNLESS OTHERWISE INDICATED ON THE DRAWINGS, THE BARS AT A LAP SPICE SHALL BE IN CONTACT WITH EACH OTHER.
- FOLLOWING TABULATED VALUES ARE CALCULATED FOR:  
Fy = 60,000 PSI  
Fc = 4,000 PSI
- TOP BARS ARE ALL HORIZONTAL REINFORCEMENT SO PLACED THAT MORE THAN 12 INCHES OF FRESH CONCRETE IS CAST IN THE MEMBER BELOW THE BAR.
- HORIZONTAL BARS IN CIRCULAR WALLS OF HYDRAULIC STRUCTURES SHALL BE SPLICED WITH CLASS "B" TOP BAR LAP SPLICES WITH THE SPLICES IN EACH LAYER OF REINFORCEMENT STAGGERED ONE SPlice LENGTH.
- WHERE HORIZONTAL BARS IN WALL CORNERS OR JUNCTIONS ARE LAPPED, LARGER BAR DIAMETER GOVERNS THE LENGTH ON DOWEL SEGMENTS.

REINFORCING BAR LAP SPICE					
BAR #	MINIMUM CLEAR BAR SPACING (BAR DIA)	LAP SPICE LENGTH (INCHES)			
		TOP BARS		OTHER BARS	
		CLASS "A"	CLASS "B"	CLASS "A"	CLASS "B"
REQUIREMENT FOR WALLS AND SLABS *					
#4	MORE THAN 2	18	24	14	18
#5	MORE THAN 2	23	30	18	23
	5	28	36	21	28
#7	MORE THAN 2	42	54	32	42
	5	33	43	26	33
#8	MORE THAN 2	54	71	42	54
	5	43	56	33	43
#9	MORE THAN 2	69	89	53	69
	5	55	71	42	55
#10	MORE THAN 2	88	114	67	88
	5	70	91	54	70
#11	MORE THAN 2	108	140	83	108
	5	86	112	66	86

\* FOR INNER LAYER OF REINFORCEMENT IN WALLS AND SLABS, THE LAP SPICE LENGTH OF #9, #10, AND #11 BARS MAY BE REDUCED BY 25 PERCENT IF CLEAR SPACING IS THREE BAR DIAMETERS OR MORE.

- REFER TO MECHANICAL PROCESS SHEETS FOR CONCRETE WALL AND SLAB PENETRATIONS. ADDITIONAL REINFORCING SHALL BE PROVIDED AT CONCRETE WALL AND SLAB PENETRATIONS PER <sup>(TYP)</sup> 310

INCLUDE IN REINFORCING SHOP DRAWINGS REINFORCING DETAILS FOR CONCRETE WALL AND SLAB PENETRATIONS THAT ARE 6 INCH AND LARGER IN DIAMETER.

- IN CASE ANY CONSTRUCTION JOINT IS REQUIRED FOR WALLS OF STRUCTURE, CONTRACTOR MAY PROPOSE LOCATION FOR REVIEW AND APPROVAL BY ENGINEER OF RECORD PRIOR TO CONSTRUCTION.

- CONCRETE MIX DESIGNS SHALL BE SUBMITTED FOR ALL CONCRETE USED. CONCRETE MIX DESIGNS SHALL BE FURNISHED BY EITHER THE CONCRETE SUPPLIER OR AN INDEPENDENT TESTING LABORATORY, BASED ON THE CONCRETE SUPPLIER'S CURRENT PRODUCTION FACILITIES RECORD OF STRENGTH TESTS. THESE TESTS SHALL BE EVALUATED AND MIX DESIGNS PROPORTIONED TO MEET THE REQUIREMENTS BASED ON THE STANDARD DEVIATIONS AS OUTLINED IN ACI 318-89, SECTION 5.2. RESULTS OF CONCRETE CYLINDER COMPRESSION BREAK TESTS FOR PROPOSED DESIGN MIX SHALL BE INCLUDED IN THE SUBMITTAL. POZZOLAN "F" (FLY-ASH) SHALL BE USED PROVIDED THE CEMENT CONTENT OF THE ORIGINAL MIX WITHOUT FLY-ASH IS NOT REDUCED BY MORE THAN 20% BY WEIGHT AND THE FLY-ASH ADDED DOES NOT EXCEED 1.3 POUNDS FOR EACH POUND OF CEMENT REMOVED. OTHER ADMIXTURES MAY BE USED; HOWEVER, THEY SHALL NOT BE CONSIDERED AS REPLACING ANY PART OF THE CEMENT CONTENT FOR THE SPECIFIED CONCRETE STRENGTH. NO ALUMINUM CONDUITS OR PIPES SHALL BE EMBEDDED IN OR ATTACHED TO THE CONCRETE. COLD WEATHER AND HOT WEATHER CONCRETING SHALL BE PLACED ACCORDING TO RECOMMENDED PRACTICES IN ACI 306 AND ACI 305, RESPECTIVELY.

**REINFORCING STEEL:**  
ALL REINFORCING STEEL FOR THE PROJECT SHALL BE DEFORMED BARS AND SHALL CONFORM TO THE FOLLOWING ASTM STANDARD DESIGNATIONS:

#4 BAR AND LARGER IN CONCRETE.....A-615 GRADE 60  
MASONRY REINFORCING.....A-615 GRADE 60

CHAIRS AND SUPPORT BARS SHALL BE PROVIDED IN ACCORDANCE WITH ACI STANDARDS. REINFORCEMENT SHALL BE DETAILED TO MEET ACI 315 STANDARDS. SHOP DRAWINGS SHALL BE SUBMITTED SHOWING ALL REINFORCEMENT TO BE PLACED. SHOP DRAWINGS SHALL INCLUDE PLAN AND ELEVATIONS PERTAINING TO BAR LOCATION AND PLACEMENT WITHIN FOUNDATIONS, SLABS, BEAMS, COLUMNS AND WALLS.

**METALS**

- STRUCTURAL STEEL:** STRUCTURAL STEEL SHALL BE ASTM A 36 GRADE. BOLTS A 307. TUBE STEEL AND PIPE STEEL SHALL BE ASTM A 500 GRADE B, FY = 46 KSI FOR TUBE STEEL AND 42 KSI FOR PIPE STEEL AND WELDABLE PER AWS D1.4. LATEST AISC AND AWS CODES APPLY. FABRICATOR SHALL SUBMIT SHOP DRAWINGS FOR REVIEW BEFORE FABRICATION. MINIMUM EMBEDMENT OF ALL HORIZONTAL BOLTS IN GROUT OR CONCRETE SHALL BE 6" WITH 3" HOOK. VERTICAL BOLTS SHALL HAVE 10" EMBEDMENT WITH HEAVY HEX NUT AT EMBEDDED END, UNO.
- WELDING:** ALL CONSTRUCTION AND TESTING SHALL BE PER AWS CODES AND RECOMMENDATIONS. WELDING SHALL BE DONE IN SHOP UNLESS SHOWN OTHERWISE ON PLANS. FIELD WELDS SHALL BE APPROVED BY THE ENGINEER. ALL WELDING SHALL BE BY WELDERS HOLDING CURRENT VALID CERTIFICATES ISSUED BY AN ACCEPTED TESTING AGENCY AND HAVING EXPERIENCE IN THE TYPE OF WELD CALLED FOR.
- ALUMINUM:** ALUMINUM FOR THIS PROJECT SHALL BE OF TYPE 6063. ALUMINUM TO BE CAST INTO CONCRETE SHALL RECEIVE COATING OF COAL TAR EPOXY OR SIMILAR.
- STAINLESS STEEL:** STAINLESS STEEL SHALL BE 316 GRADE UNLESS NOTED OTHERWISE.

**PRECAST WETWELL FLAT TOP SLAB:**

- DESIGN LOADINGS: 1,500 POUND POINT LOAD AT CENTER OF SLAB OR 150 PSF, WHICHEVER RESULTS IN THE HIGHER LOADING CONDITION.


**SUPPLEMENTARY NOTES:**

- PROVIDE TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO AVOID EXCESSIVE STRESSES AND TO HOLD STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION.
- ANY MEMBERS REQUIRED TO SUPPORT EQUIPMENT FROM THE FRAMING SHOWN SHALL BE DESIGNED AND PROVIDED BY THE CONTRACTOR.
- FOR CONNECTIONS SEE DETAILS. IF NOT SHOWN OR NOTED, MINIMUM CONNECTIONS TO BE INCLUDED IN BID SHALL BE TWO 5/8" DIA. BOLTS OR 3/16" FILLET WELD 4" LONG USING 1/4" CONNECTION MATERIAL AND DETAILED TO MINIMIZE BENDING IN CONNECTION. PROCEED AFTER CLARIFICATION THROUGH SHOP DRAWING SUBMITTAL.
- ANY ENGINEERING DESIGN PROVIDED BY OTHERS AND SUBMITTED FOR REVIEW SHALL BE BY A STRUCTURAL ENGINEER REGISTERED IN ARIZONA WITH CONTINUOUS FIVE YEARS EXPERIENCE IN THE TYPE OF DESIGN SUBMITTED.
- UNLESS NOTED OTHERWISE, DETAILS ON STRUCTURAL DRAWINGS ARE TYPICAL AS INDICATED BY CUTS, REFERENCES OR TITLES.
- IN CASE OF CONFLICTS, MORE COSTLY REQUIREMENTS GOVERN FOR BIDDING. SUBMIT CLARIFICATION REQUEST PRIOR TO PROCEEDING WITH WORK.
- VERIFY ALL DIMENSIONS WITH OTHER DISCIPLINE DRAWINGS.
- CONTRACTOR SHALL ESTABLISH AND VERIFY IN THE FIELD ALL EXISTING CONDITIONS AFFECTING NEW CONSTRUCTION.
- DO NOT SCALE DRAWINGS. IN CASE OF ANY CONFLICT VERIFY WITH ENGINEER PRIOR TO CONSTRUCTION.
- "TYP" INDICATES DETAIL OCCURS MORE THAN ONCE. CONTRACTOR SHALL DETAIL ALL SUCH OCCURRENCES ON SHOP DRAWINGS SUBMITTALS.
- SHOP DRAWINGS INVOLVING STRUCTURAL CALCULATIONS SHALL BE STAMPED AND SIGNED BY CIVIL OR STRUCTURAL ENGINEER REGISTERED IN THE STATE OF ARIZONA.
- A. SPECIAL INSPECTION IS REQUIRED PER CODE FOR ALL STRUCTURAL REINFORCED CONCRETE WORK.  
B. SPECIAL INSPECTION IS ALSO REQUIRED FOR FIELD WELDING, AND INSTALLATION OF EPOXY BOLTS.  
C. PER BUILDING CODES CH. 17 NOTE: SPECIAL INSPECTIONS DO NOT PRECLUDE ANY NTUA INSPECTIONS.

No.	Revision	Note	Date	Drawn	Check

NAVAJO TRIBAL UTILITY AUTHORITY  
DESIGN AND CONSTRUCTION OF SAWMILL LIFT STATION FACILITIES

GENERAL STRUCTURAL NOTES

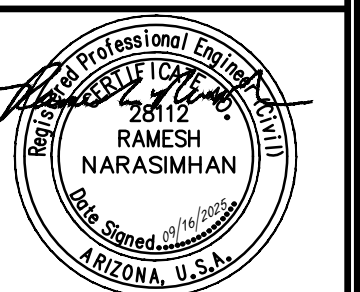


EXPIRATION DATE: 09/30/27

Drawn by:	KWB
Design by:	LAH
Approved by:	RN
Date	09/16/2025
Project No.	2496
Sheet No.	G-04




NOTES:

1. SHADE CANOPIES STRUCTURAL DESIGN AND ANCHORAGE SYSTEM TO FOUNDATION SHALL BE BY ALUMA-LINE (PHOENIX, AZ) INC OR APPROVED EQUAL. SHADE CANOPY MANUFACTURER SHALL DESIGN AND PROVIDE SHOP DRAWING FOR CANOPIES. DESIGN CALCULATION AND SHOP DRAWINGS SHALL BE SEALED BY AN ARIZONA LICENSED PROFESSIONAL ENGINEER.
2. CORRUGATED STEEL ROOF PANELS SHALL BE BY MBCI OR APPROVED EQUAL. COATING SHALL BE SIGNATURE 200 FACTORY APPLIED AND BAKED-ON OVER GALVALUME. COLOR WILL BE SELECTED BY NTUA.
3. FASTENERS SHALL BE NON-CORRODING MATERIAL.
4. EPOXY ANCHOR BOLTS DESIGN BY ALUMA-LINE'S STRUCTURAL DESIGNER.
5. SEE SHT G-04 FOR GENERAL STRUCTURAL NOTES. THE SCADA ANTENNA POLE SHALL BE MOUNTED ON THE SHADE CANOPY. SEE DETAIL ON SHT E-22.

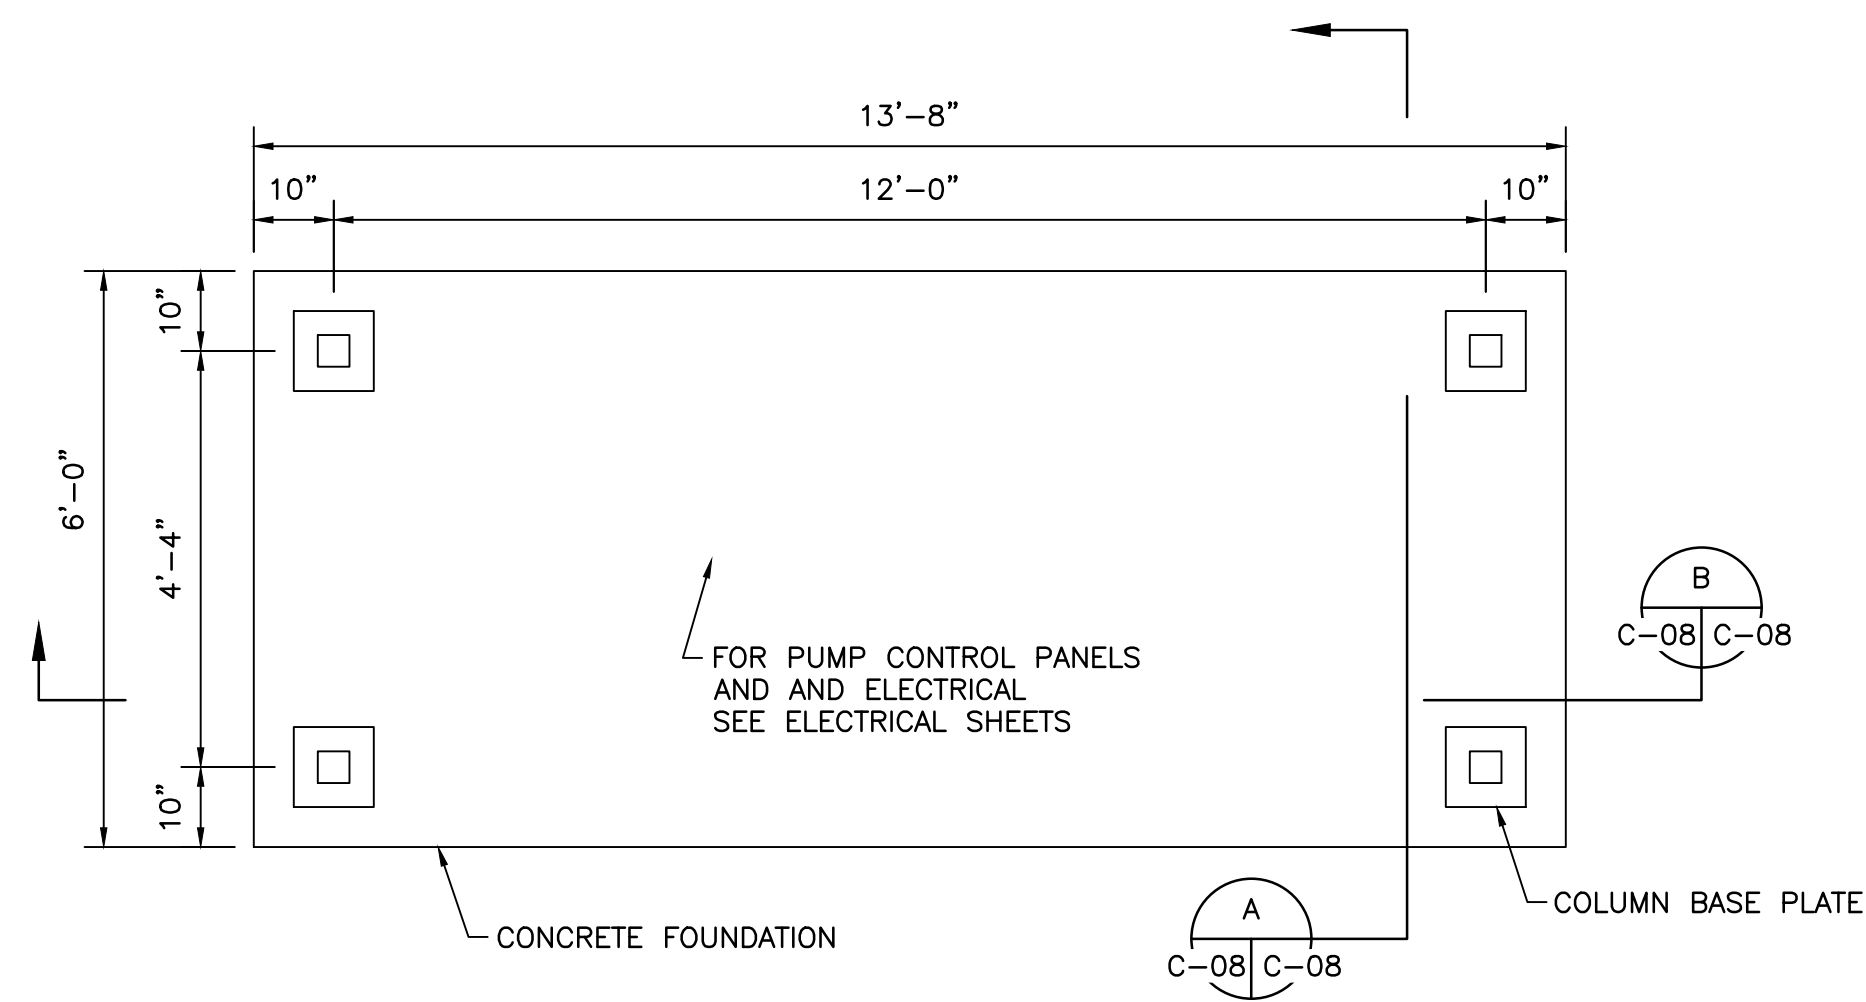


SHADE CANOPY SECTIONAL PLAN

SCALE: 1/2"=1'-0"

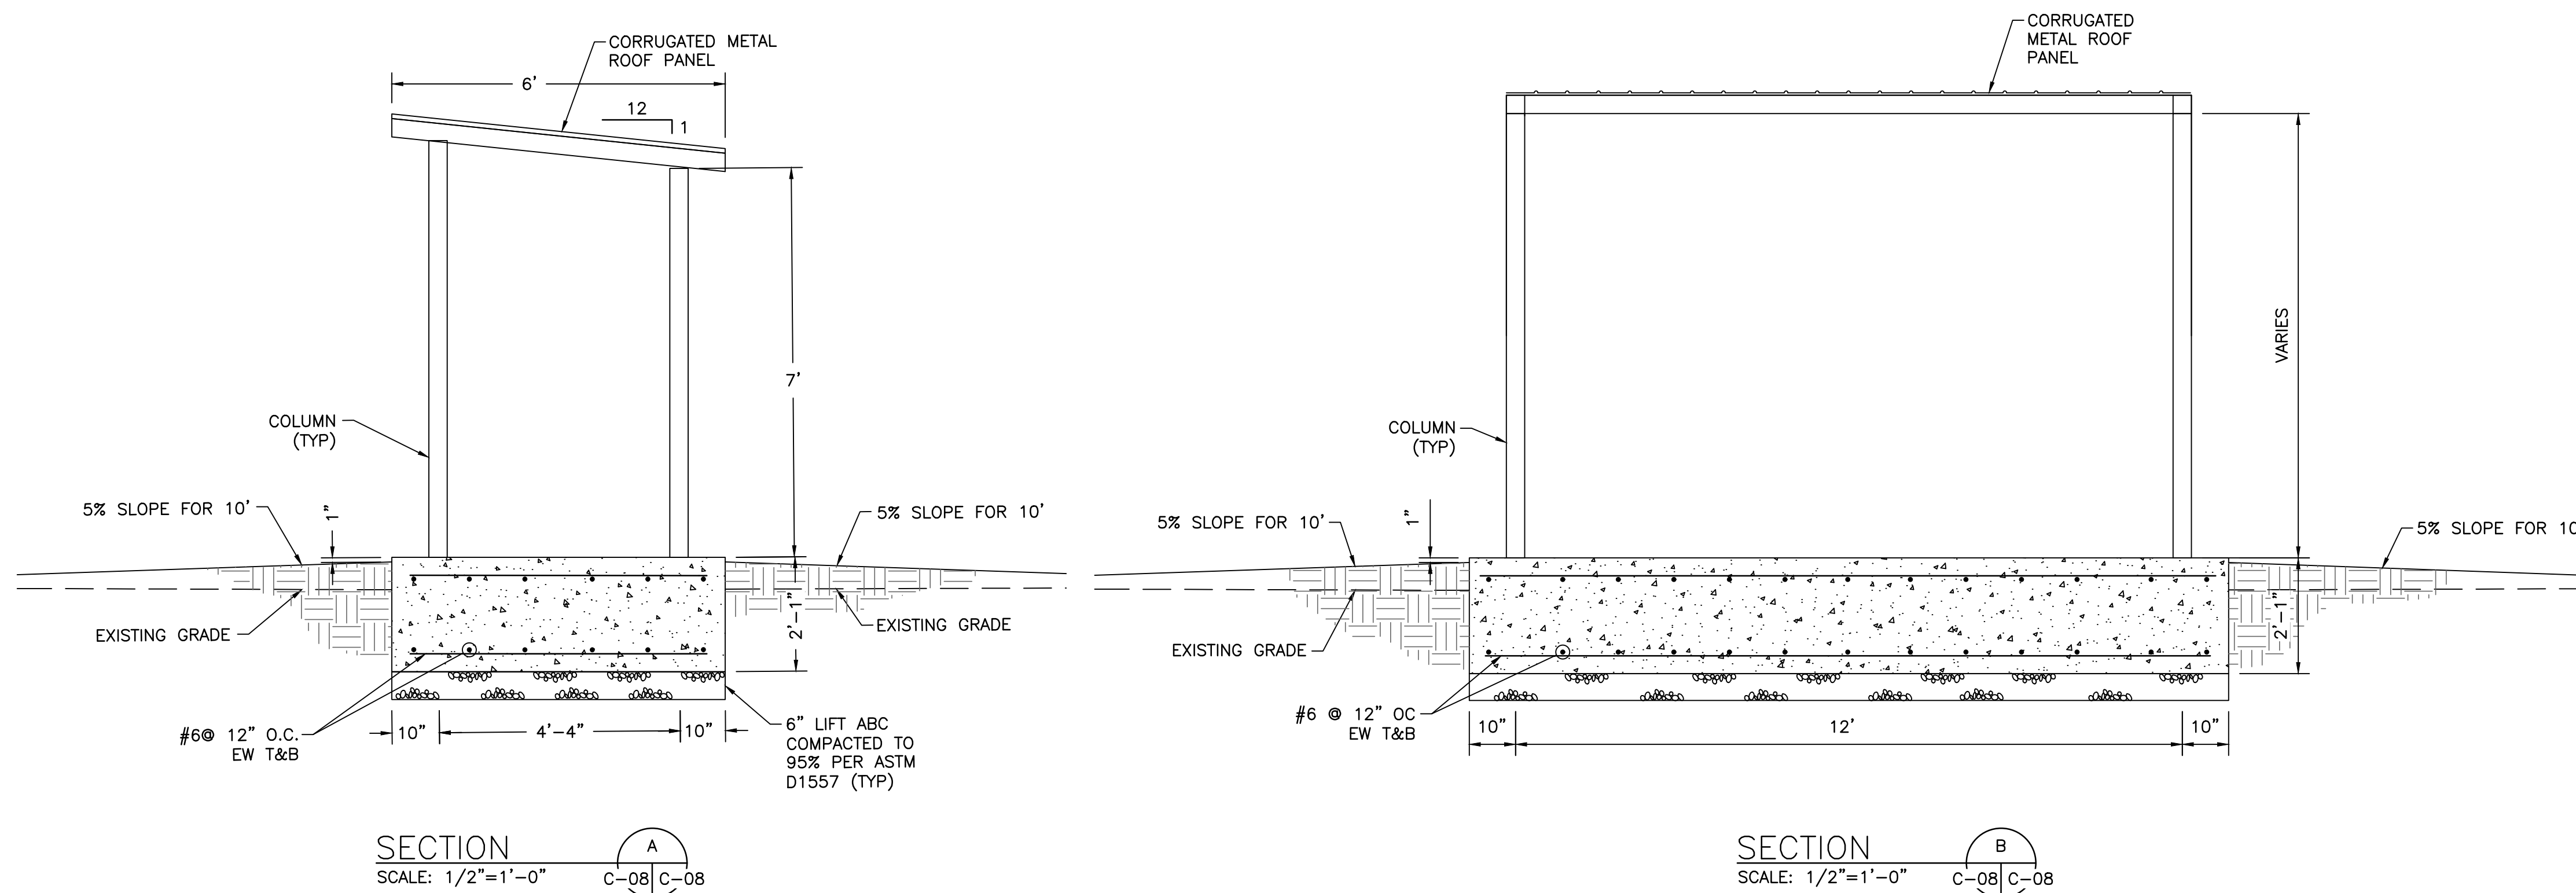

NAVAJO TRIBAL UTILITY AUTHORITY  
DESIGN AND CONSTRUCTION OF SAWMILL LIFT STATION FACILITIES

SHADE CANOPY PLAN AND SECTIONS

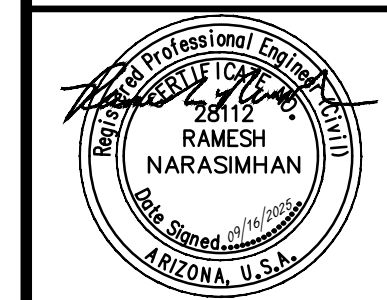

EXPIRATION DATE: 09/30/27

Drawn by: KWB

Design by: LAH

Approved by: RN

Date  
09/16/2025

Project No.  
2496

Sheet No.  
C-08



Pump Schedule							
Site	Design Capacity (gpm)	Design Head (ft)	Shut off Head (ft)	Pump Configuration	Max Pump Speed (rpm)	Nameplate driver horsepower	Drive Type
Sawmill	125	70	70	Submersible	1800	5 HP, 208V, three phase, explosion proof	Variable speed

**EQUIPMENT AND MATERIALS SPECIFICATIONS**

DUCTILE IRON PIPE AND FITTINGS:

PIPE SHALL BE IN ACCORDANCE WITH ANSI/AWWA C-151/A21.51.  
 FITTINGS SHALL BE IN ACCORDANCE WITH AWWA C-153/ANSI A21.53, AND AWWA C-115/ANSI A21.15 FOR FLANGED PIPE AND AWWA C-111/ANSI A21.11 FOR MECHANICAL JOINT PIPE.  
 FOR PUMP-AROUND PORT SYSTEM: FITTINGS SHALL HAVE FUSION BONDED EPOXY INTERIOR COATING PER AWWA C116/ANSI A21.16. PIPE SHALL HAVE CERAMIC AMINE CURED NOVALAC EPOXY INTERIOR COATING, 40 MILS.  
 MEGA-LUG OR APPROVED EQUAL FOR RESTRAINING JOINTS.  
 BURIED PIPING SHALL BE PROVIDED WITH POLYETHYLENE ENCASEMENT PER ASTM A674.

PVC PRESSURE PIPE:

PIPE SHALL BE IN ACCORDANCE WITH AWWA C-900. WHERE APPLICABLE, PIPE SHALL MATCH THE SDR OF EXISTING PIPE IT IS CONNECTING TO.

PVC GRAVITY SEWER PIPE:

PIPE SHALL BE SDR 35 IN ACCORDANCE WITH ASTM D-3024.

STAINLESS STEEL PIPE AND MISCELLANEOUS SUPPORTS:

PIPE SHALL BE SCHEDULE 40 IN ACCORDANCE WITH ANSI 36.19.  
 MISCELLANEOUS SUPPORT BRACKETS SHALL BE IN ACCORDANCE WITH ASTM A-276.  
 FASTENERS SHALL BE IN ACCORDANCE WITH ASTM A320: BOLTS GRADE L7, NUTS A194 GRADE 7 AND WASHERS F436.

STEEL PIPE:

PIPE SHALL BE SCHEDULE 40 IN ACCORDANCE WITH AWWA C-200/ASTM A53 AND AWWA C-206.

PLUG VALVES:

VALVES SHALL BE DEZURIK BULLETIN 12.00-1C OR APPROVED EQUAL; IN ACCORDANCE WITH AWWA C-517 AND C-111. CLASS 150 FLANGES SHALL BE IN ACCORDANCE WITH ANSI B16.5 VALVES SHALL BE FOR BURIED SERVICE WITH NUT OPERATOR.

ALUMINUM ACCESS HATCHES:

HATCHES SHALL BE HALLIDAY SERIES SERIES S, ALL STANDARD FEATURES WITH FALL THROUGH PROTECTION GRATING OR APPROVED EQUAL. HATCH DIMENSIONS SHALL BE AS SHOWN ON THE DRAWINGS. FOR FALL THROUGH PROTECTION PROVIDE HASP FOR NTUA TO UTILIZE PADLOCK.

PORTABLE PUMP LIFTING HOISTS:

HOISTS SHALL BE HALLIDAY SERIES DB WITH ALL STANDARD FEATURES OR APPROVED EQUAL. HOIST CAPACITY SHALL BE 1,330 LBS MINIMUM WITH THE DAVIT ARM EXTENDED PERPENDICULAR TO THE MAST, PARALLEL TO TOP OF WET WELL. PROVIDE HOISTS AS SHOWN FOR EACH LIFT STATION SITE (5 TOTAL).

POLYURETHANE COATINGS FOR WET WELLS:

COATING FOR INTERIOR OF LIFT STATIONS: REMOVE SEWERAGE FROM WETWELLS, CLEAN SURFACES, AND PREPARE SURFACES FOR COATING. SURFACE PREPARATION SHALL BE PER COATING MANUFACTURER'S RECOMMENDATIONS AND SHALL INCLUDE AT MINIMUM, ABRASIVE BLAST AND HIGH PRESSURE CLEANING. INCLUDE IN BID A MORTAR REPAIR OF TWO SQUARE FEET FOR EACH WETWELL TO RECEIVE COATING. PROVIDE ZEBRON PRIME (MIST) COAT AT 3 TO 5 WET MILS. PROVIDE TOP COAT OF ZEBRON SERIES 386 100% POLYURETHANE COATING AT MINIMUM OF 125 MILS. COATING SHALL BE APPLIED PER MANUFACTURER'S RECOMMENDATIONS. NTUA WILL SELECT THE COLOR OF THE TOP COAT.

PIPE PRESSURE TEST:

FOR PUMP-AROUND SYSTEM: BEFORE BACKFILLING THE PIPING, THE PIPING SYSTEM SHALL BE EXPOSED TO SYSTEM PRESSURE (THE PRESSURE IN THE FORCEMAIN). CONDUCT VISUAL EXAMINATION TO CONFIRM THERE IS NO LEAKAGE. FOR DISCHARGE PIPE REPLACEMENT IN WETWELL; CONDUCT VISUAL EXAMINATION TO CONFIRM THERE IS NO LEAKAGE.

COMBINATION AIR VALVE:

COMBINATION AIR VALVE SHALL BE SINGLE BODY STYLE AND SPECIFICALLY MANUFACTURED FOR WASTEWATER APPLICATIONS. THE BODY AND COVER OF THE VALVE SHALL BE CONSTRUCTED OF HEAVY-DUTY CAST IRON. BOLTS, NIPPLES, PLUGS SHALL BE TYPE 316 STAINLESS STEEL. FLOAT SHALL BE STAINLESS STEEL. VALVE SHALL BE DESIGNED FOR NO SPILLS AND NO SPURTS. STATIC PRESSURE IN THE PIPELINE AT LOCATION OF PROPOSED VALVE IS APPROXIMATE 22 PSI, PROVIDE APPROPRIATE SEAT. PROVIDE BACKFLUSHING ATTACHMENT. EXTERIOR PAINT SHALL BE SELECTED FOR A DAMP VAULT APPLICATION.

COMBINATION AIR VALVE SHALL BE VALMATIC VMC-301A OR APPROVED EQUAL.

PAINTING:

FOR FERROUS METALS, PRIMED OR UNPRIMED, SUCH AS BUT NOT LIMITED TO WETWELL VENT PIPES, ANTENNA POLE. PAINT MANUFACTURER SHALL BE SHERWIN-WILLIAMS OR APPROVED EQUAL.

PRIMER: ALKYD METAL PRIMER, ONE COAT, 1.3-1.5 DRY MILS.

GLOSS FINISH: URETHANE ALKYD GLOSS ENAMEL, TWO COATS, 2.0-2.2 DRY MILS.

EXISTING GENERATOR AT SAWMILL:

RETAIN GENERATOR MANUFACTURER OR MANUFACTURER'S REPRESENTATIVE TO CONDUCT FIELD INSPECTION, CHECK-OUT, AND EVALUATION OF GENERATOR SYSTEM. PREPARE AND SUBMIT BRIEF WRITTEN REPORT WITH SUMMARY OF FIELD OBSERVATIONS AND EVALUATION, AND RECOMMENDATIONS FOR EQUIPMENT REPAIRS AND REPLACEMENTS FOR RETURNING GENERATORS TO OPERATING ORDER. STARTUP THE GENERATORS AND PROVIDE MINIMUM OF ONE HOUR OF ON-SITE TRAINING OF NTUA STAFF AT EACH SITE. EQUIPMENT REPAIRS AND REPLACEMENTS IF ANY, WILL BE AUTHORIZED BY CHANGE ORDER.

EQUIPMENT COATINGS:

ALL PUMPS, FITTINGS, PIPING ETC. SUPPLIED BY PUMP SYSTEM PACKAGE VENDOR SHALL HAVE MANUFACTURER'S STANDARD EPOXY INTERIOR AND EXTERIOR COATING. COATING SHALL BE DESIGNED FOR WASTEWATER APPLICATION.

RADAR LEVEL SENSOR:

SENSOR SHALL BE MICRO PILOT FMR20, 80MM WITH FLOOD PROTECTION TUBE AND PIVOT-TYPE MOUNTING ARM PART NO. 919790-002, BY EDRESS-HOUSER OR APPROVED EQUAL.

**PROPANE TANKS**


FOR EXISTING PROPANE TANKS (TO REMAIN AND BE REUSED) AT SAWMILL AND IYANBITO:

FILL TANKS FOR TROUBLESHOOTING AND STARTUP PURPOSES OF GENERATORS. REFILL TANKS AS NEEDED FOR STARTUP PHASE. INSPECT AND (IF NECESSARY) BRING PROPANE TANK, FUEL LINES, REGULATORS, ETC. UP TO CURRENT CODE. PRIOR TO TURNOVER, FILL TANK TO ITS CAPACITY.

NAVAJO TRIBAL UTILITY AUTHORITY  
 DESIGN AND CONSTRUCTION OF SAWMILL LIFT STATION FACILITIES

EQUIPMENT SCHEDULES AND SPECIFICATIONS


No.	Revision	Note	Date	Drawn	Check

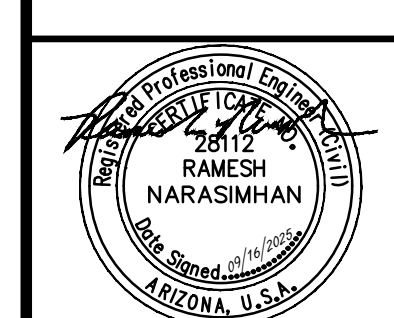


EXPIRATION DATE: 09/30/27

Drawn by:	KWB
Design by:	LAH
Approved by:	RN
Date	09/16/2025
Project No.	2496
Sheet No.	M-01


Sep 23, 2025 - 9:51am  
 z:\\_cad data transfer\2496 - ntua - sawmill, az lift station design & cm\CAD\M-01.dwg

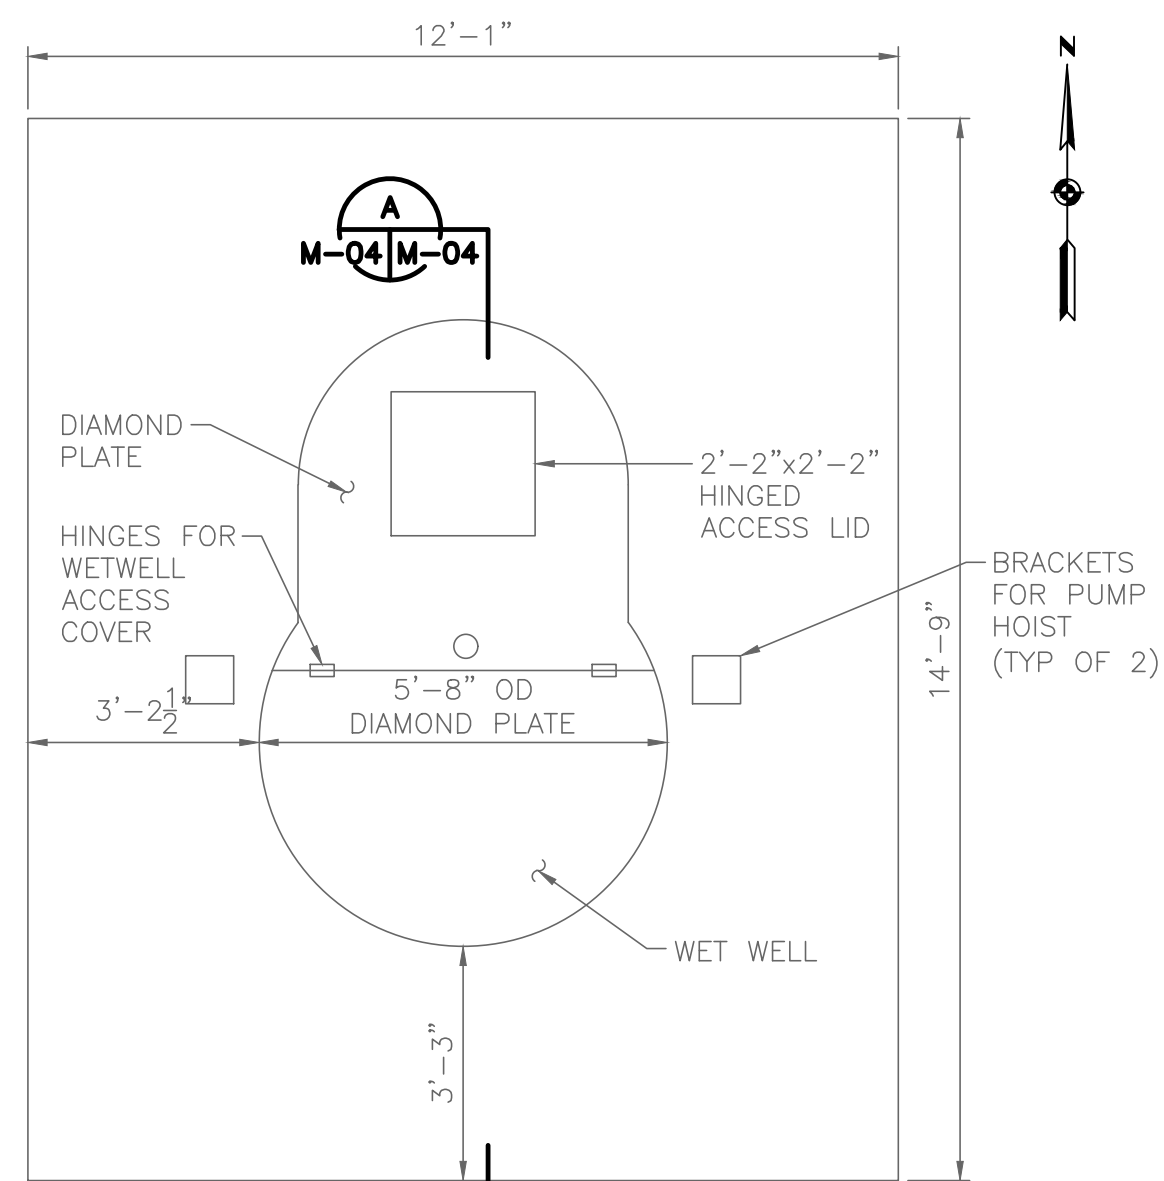


REMOVALS TOP PLAN  
SCALE: 3/8"=1'-0"

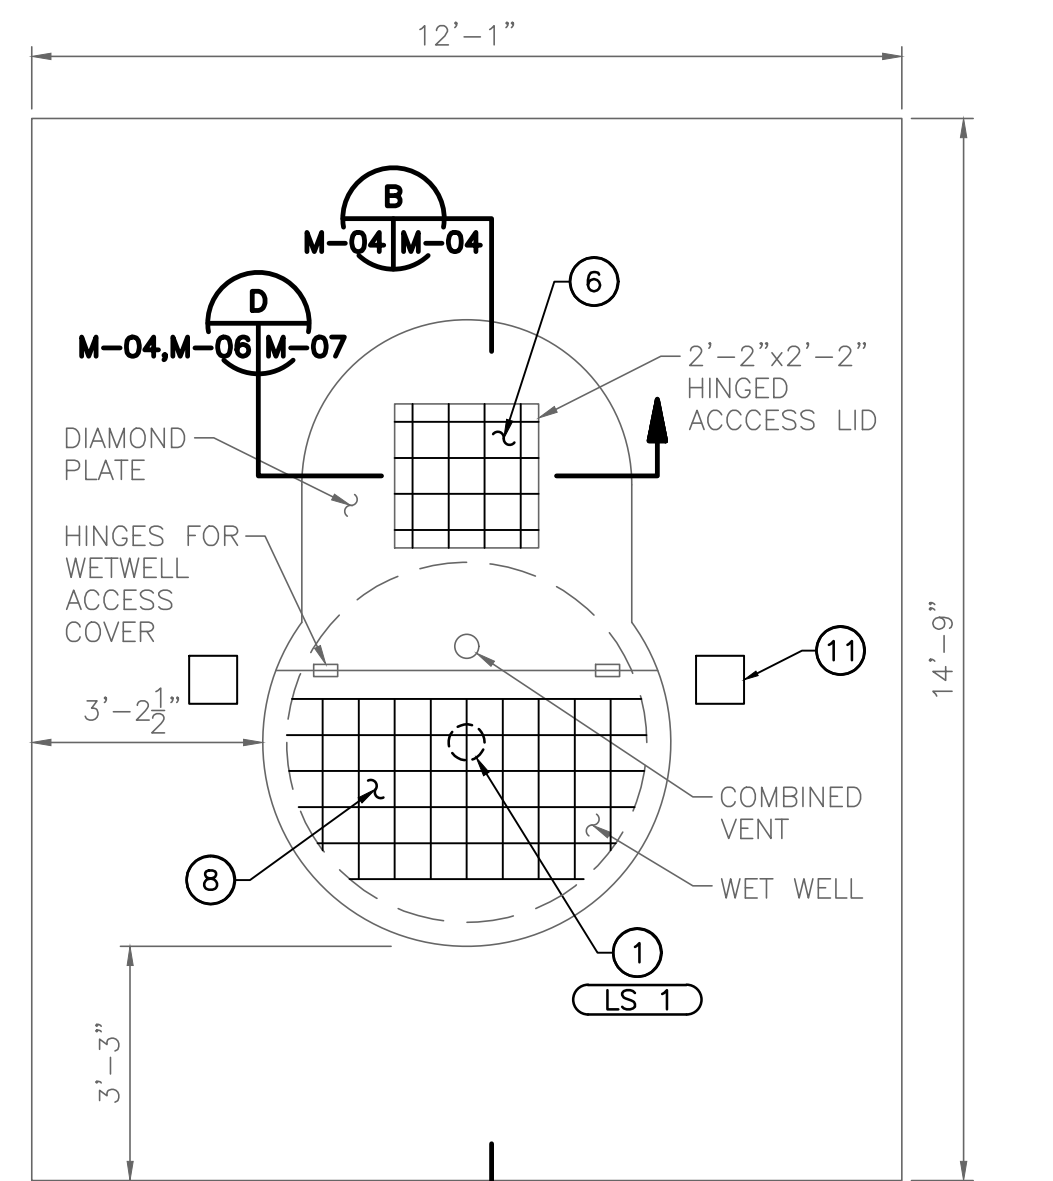


IMPROVEMENTS TOP PLAN  
SCALE: 3/8"=1'-0"

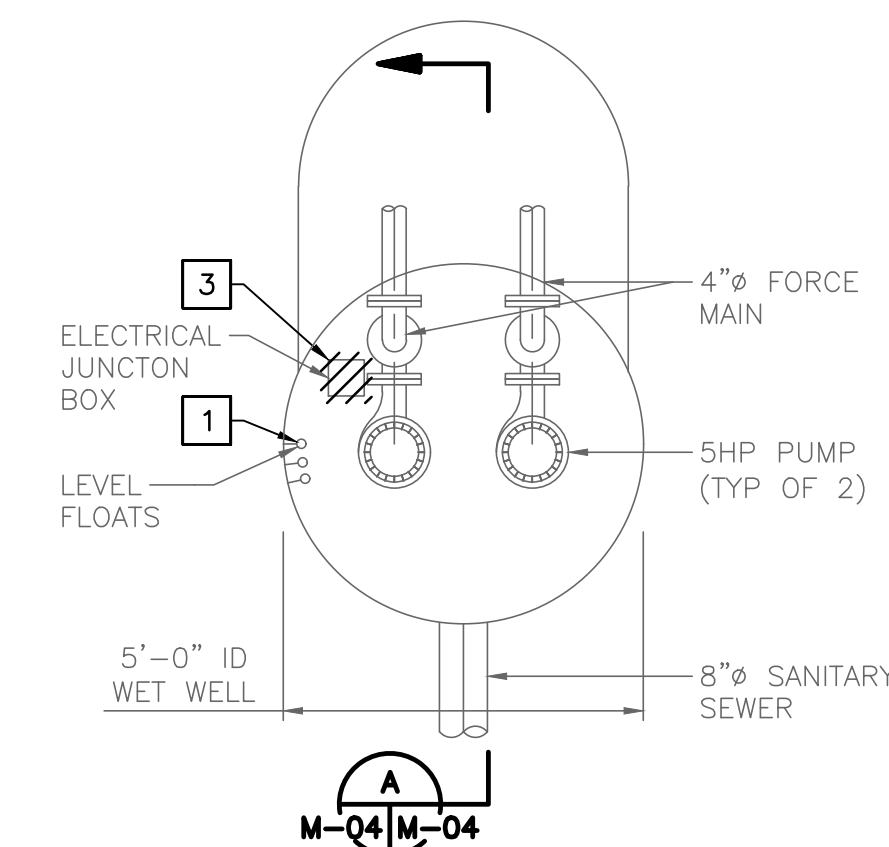


REMOVALS SECTIONAL PLAN  
SCALE: 3/8"=1'-0"

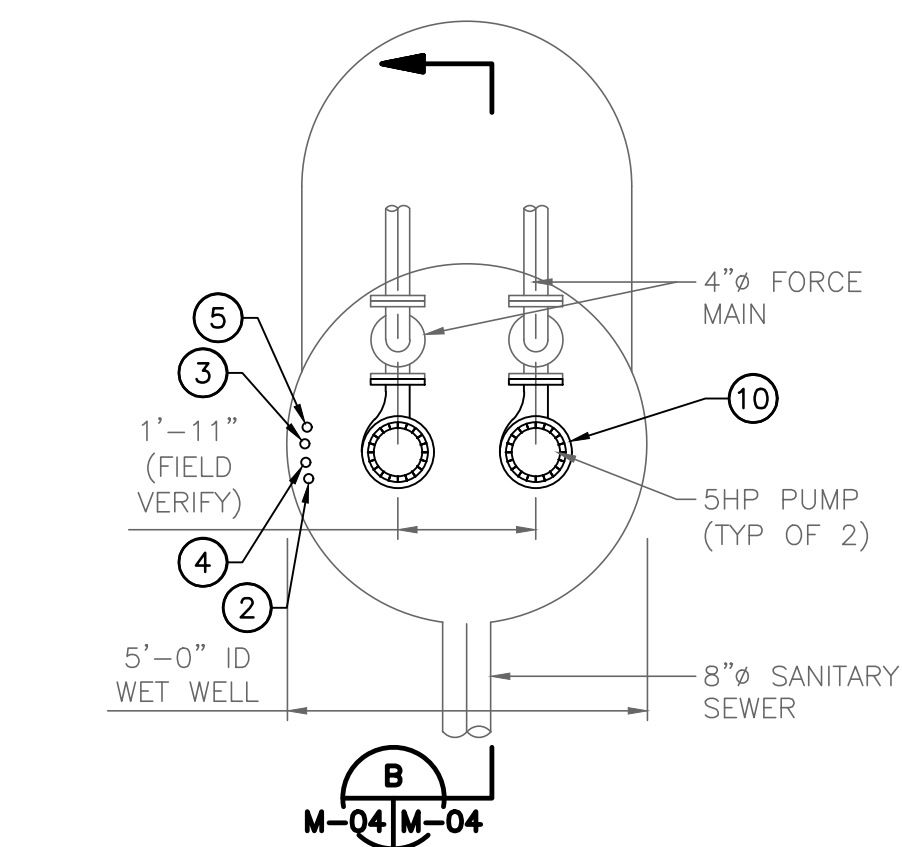

IMPROVEMENTS SECTIONAL PLAN  
SCALE: 3/8"=1'-0"

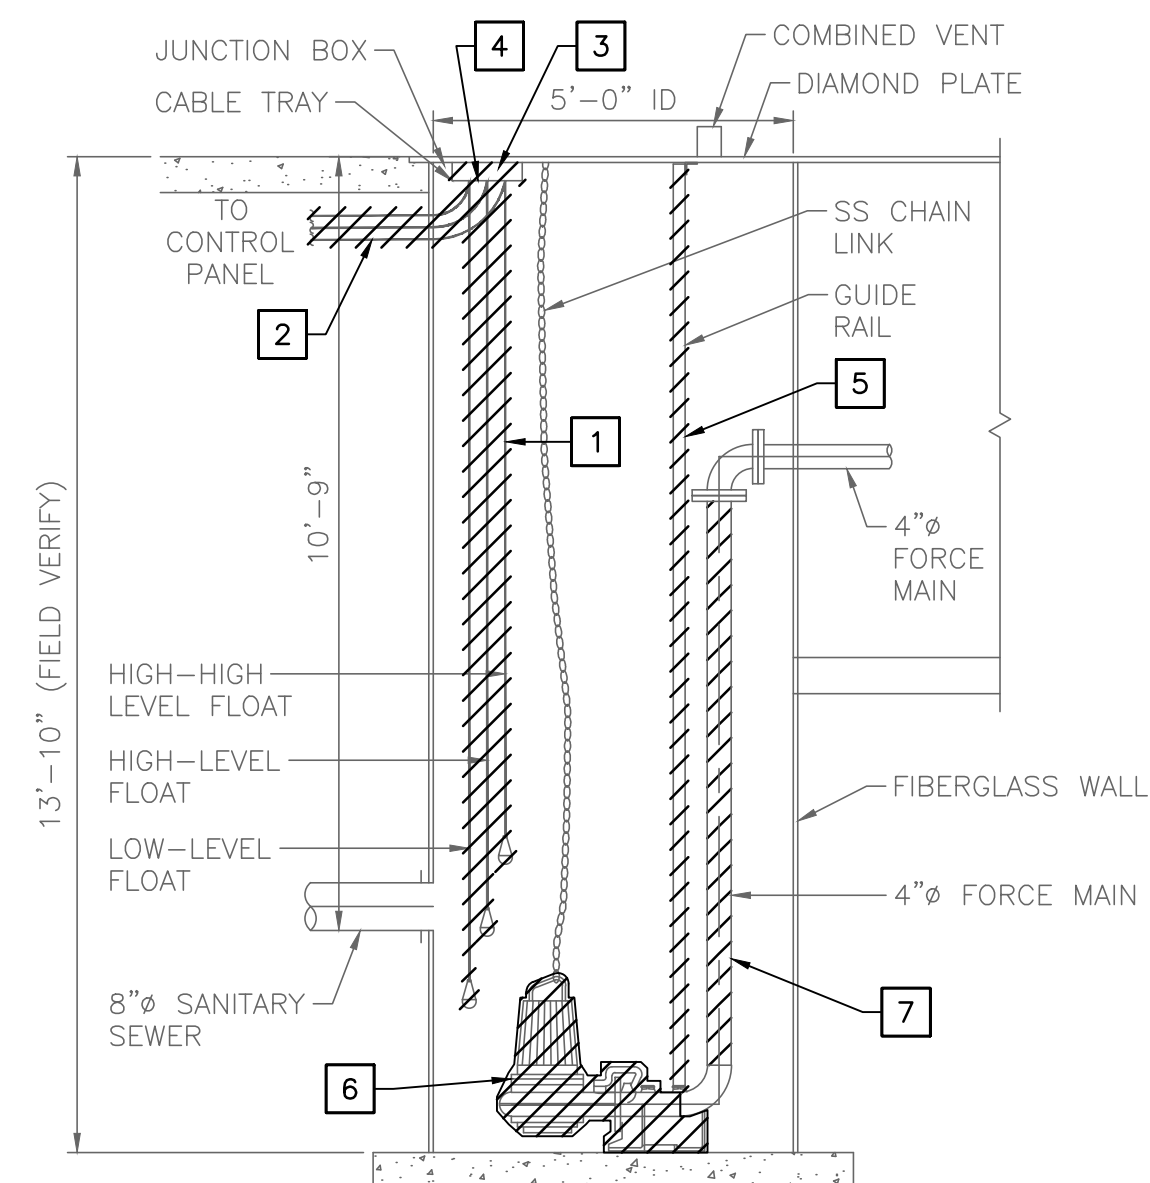

REMOVALS SECTION  
SCALE: 3/8"=1'-0"

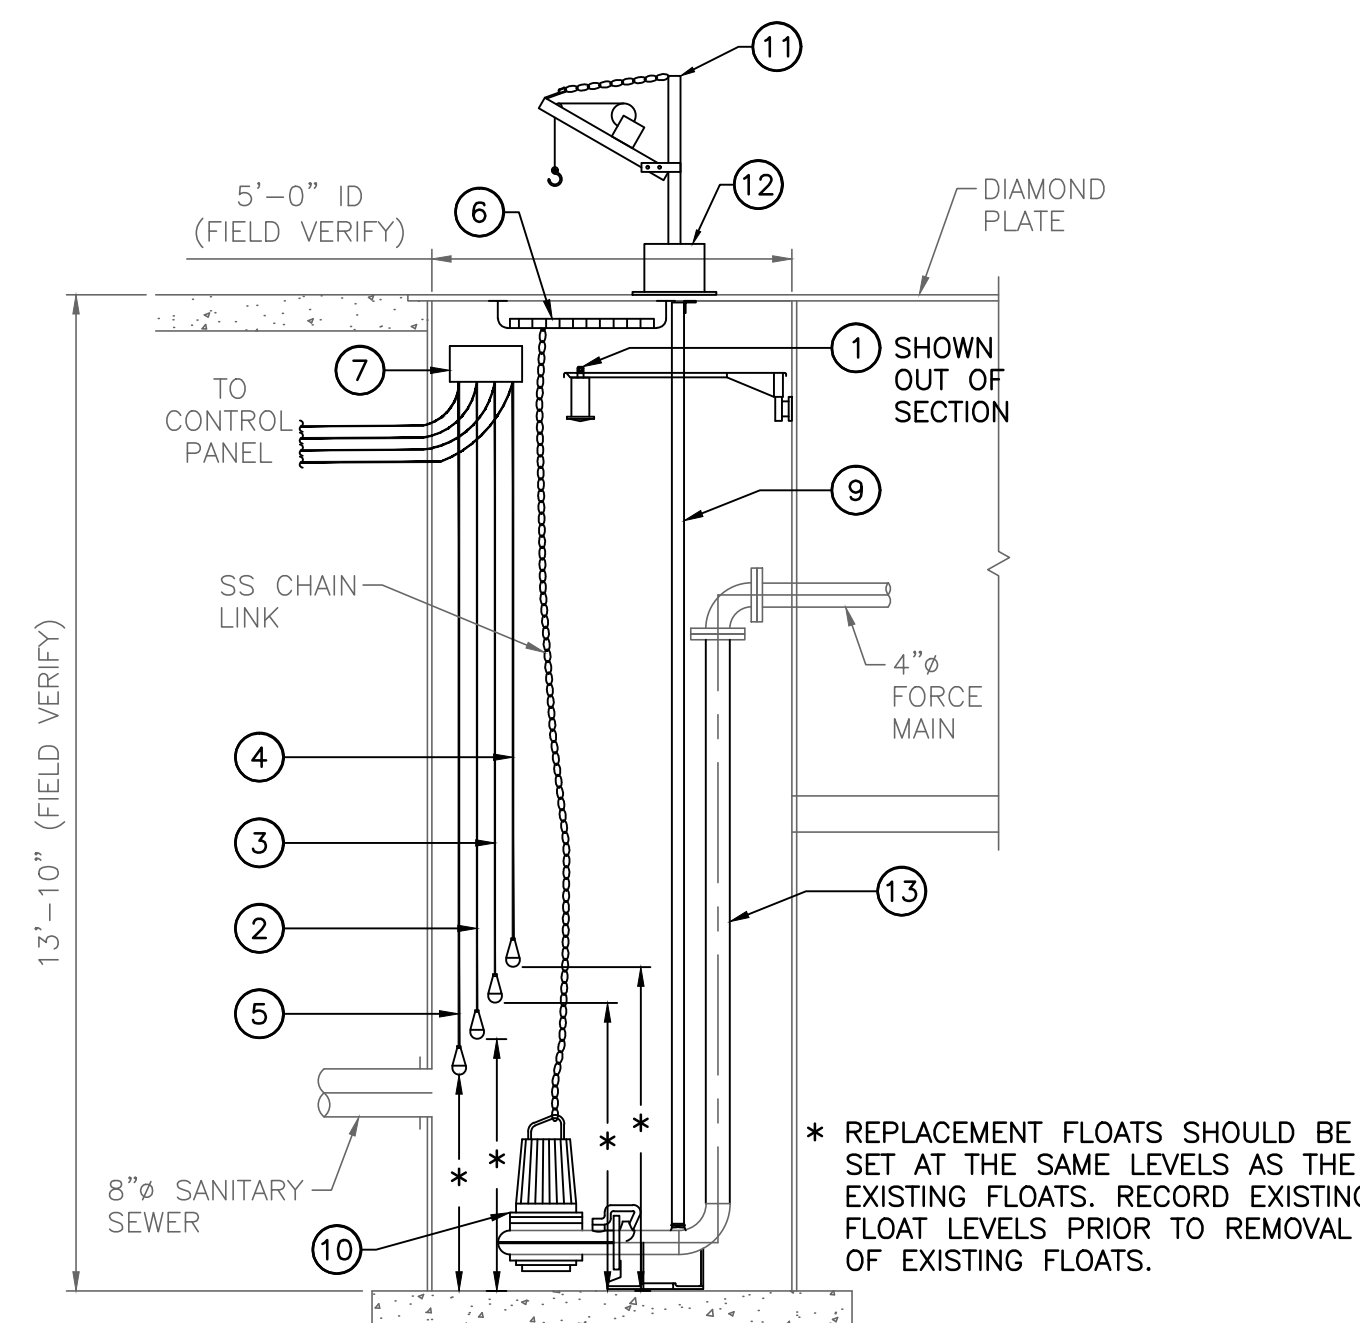

IMPROVEMENTS SECTION  
SCALE: 3/8"=1'-0"

REMOVAL NOTES	
1	REMOVE LEVEL FLOATS.
2	REMOVE ELECTRICAL ASSOCIATED W/ EXISTING LEVEL FLOATS.
3	REMOVE ELECTRICAL JUNCTION BOX.
4	REMOVE CABLE, JUNCTION BOX AND HOLDER.
5	REMOVE GUIDE RAIL
6	REMOVE SUBMERSIBLE PUMP
7	REMOVE 4"Ø FORCE MAIN
CONSTRUCTION NOTES	
1	RADAR LEVEL SENSOR. MOUNT LEVEL SENSOR ON WALL OF FIBERGLASS WET WELL. FOR MOUNTING DETAIL SEE SHT M-07.
2	LOW LEVEL FLOAT.
3	HIGH LEVEL FLOAT.
4	HIGH HIGH LEVEL FLOAT.
5	LOW LOW LEVEL FLOAT.
6	FALL PROTECTION. GRATING SERIES X RETRO-GRATING BY HALLIDAY PRODUCTS. HASP FOR PADLOCK. STRUCTURAL SUPPORTS BY MFR. CONTRACTOR SHALL FIELD VERIFY AND PROVIDE ACCURATE DIMENSIONS FOR EXISTING HATCH OPENING TO HALLIDAY FOR THE FABRICATION OF UNDER-LID MOUNTING TYPE OF FALL PROTECTION GRATING.
7	CABLE HOLDER.
8	FALL PROTECTION. GRATING SERIES X RETRO-GRATING BY HALLIDAY PRODUCTS. HASP FOR PADLOCK. STRUCTURAL SUPPORTS BY MFR. CONTRACTOR SHALL FIELD VERIFY AND PROVIDE ACCURATE DIMENSIONS FOR EXISTING WET WELL INTERIOR DIMENSIONS TO HALLIDAY FOR THE FABRICATION OF WALL MOUNT TYPE OF FALL PROTECTION GRATING.
9	STAINLESS STEEL GUIDE RAIL. MFR GRUNDFOS
10	SUBMERSIBLE PUMP. MFR: GRUNDFOS
11	PORTABLE HOIST. POSITION HOIST TO PROVIDE REACH TO BOTH PUMPS.
12	HOIST BRACKET FOR (PORTABLE) PUMP LIFTING HOIST.
13	4"Ø FORCE MAIN
GENERAL NOTES	
1. FOR ELECTRICAL, SEE ELECTRICAL SHEETS.	
2. WHEN INSTALLING EQUIPMENT AND MATERIALS IN WET WELL. MAINTAIN SPACE FOR RADAR LEVEL SENSOR BEAM DIAMETER.	

COPYRIGHT © 2012

NAVAJO TRIBAL UTILITY AUTHORITY  
DESIGN AND CONSTRUCTION OF SAWMILL LIFT STATION FACILITIES


SAWMILL WETWELL REMOVALS AND IMPROVEMENTS


**NCS ENGINEERS**  
EST. 1998  
202 EAST EARL DRIVE, STE 110  
PHOENIX, AZ 85012  
(602) 629-0206

Professional Engineer  
29512  
RAMESH NARASIMHAN  
Arizona, U.S.A.

EXPIRATION DATE: 09/30/27

Drawn by: KWB  
Design by: LAH  
Approved by: RN  
Date: 09/16/2025  
Project No. 2496  
Sheet No. M-04



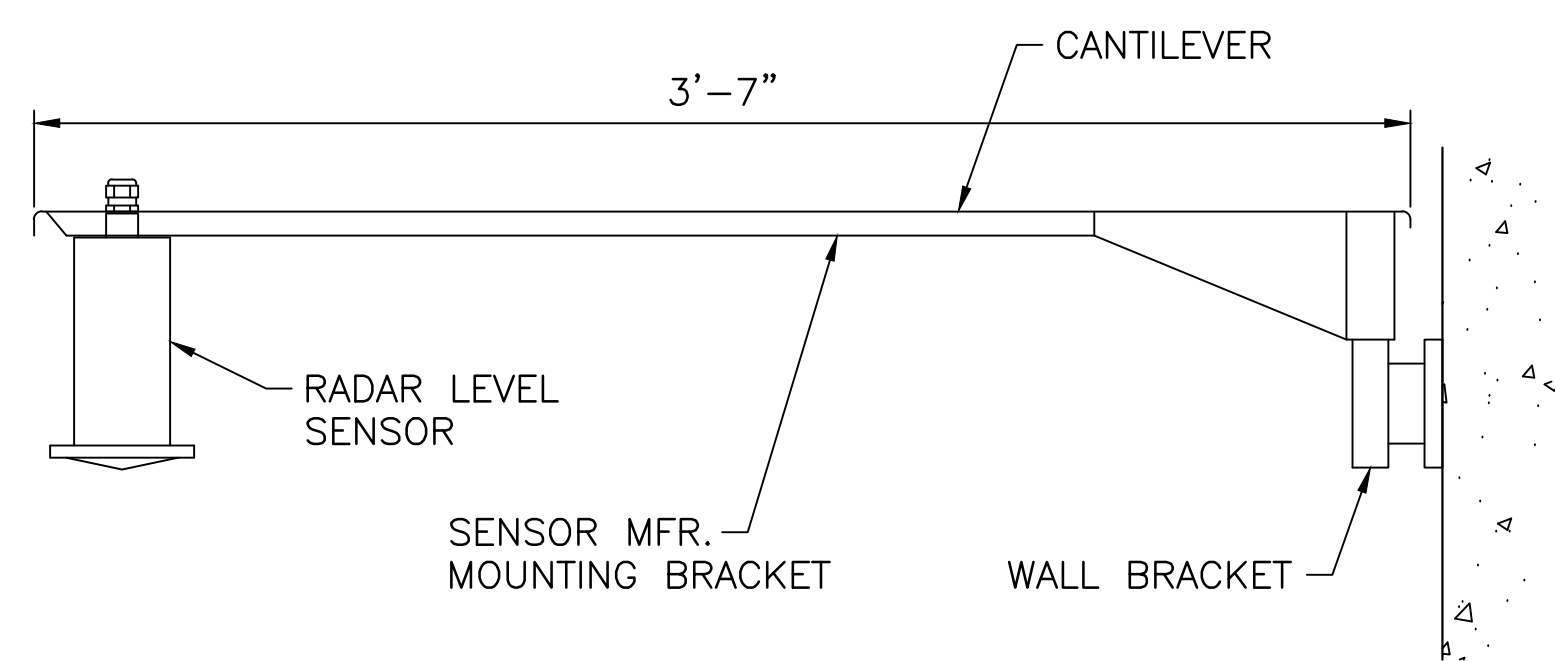


**RADAR LEVEL SENSOR MOUNTING DETAIL**

SCALE: 1-1/2"=1'-0"

**NOTES:**


1. WET WELL WALLS FOR COYOTE CANYON, COALMINE AND LECHEE ARE PRECAST CONCRETE. WET WELL WALLS FOR SAWMILL AND IYANBITO ARE FIBERGLASS. USE STAINLESS STEEL ANCHORS OR CONNECTORS AS APPROPRIATE.
2. MOUNTING SYSTEM SHALL BE FABRICATED FROM STAINLESS STEEL.

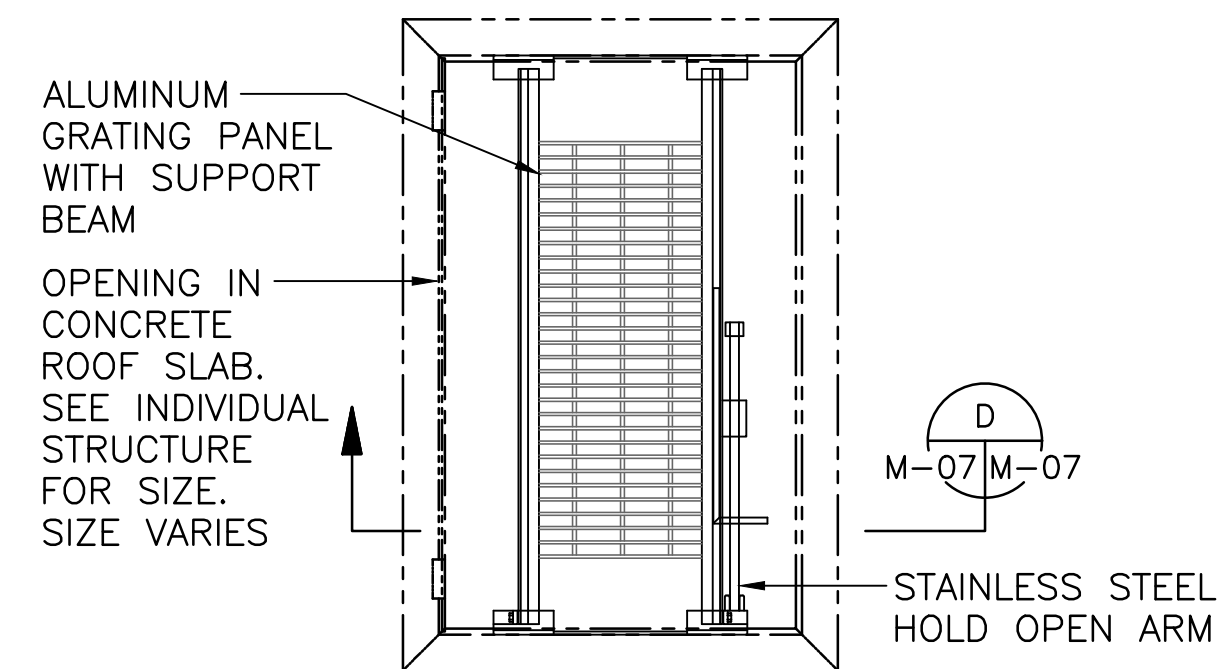

**FALL PROTECTION GRATING DETAIL**

SCALE: NTS

2  
M-07 M-07

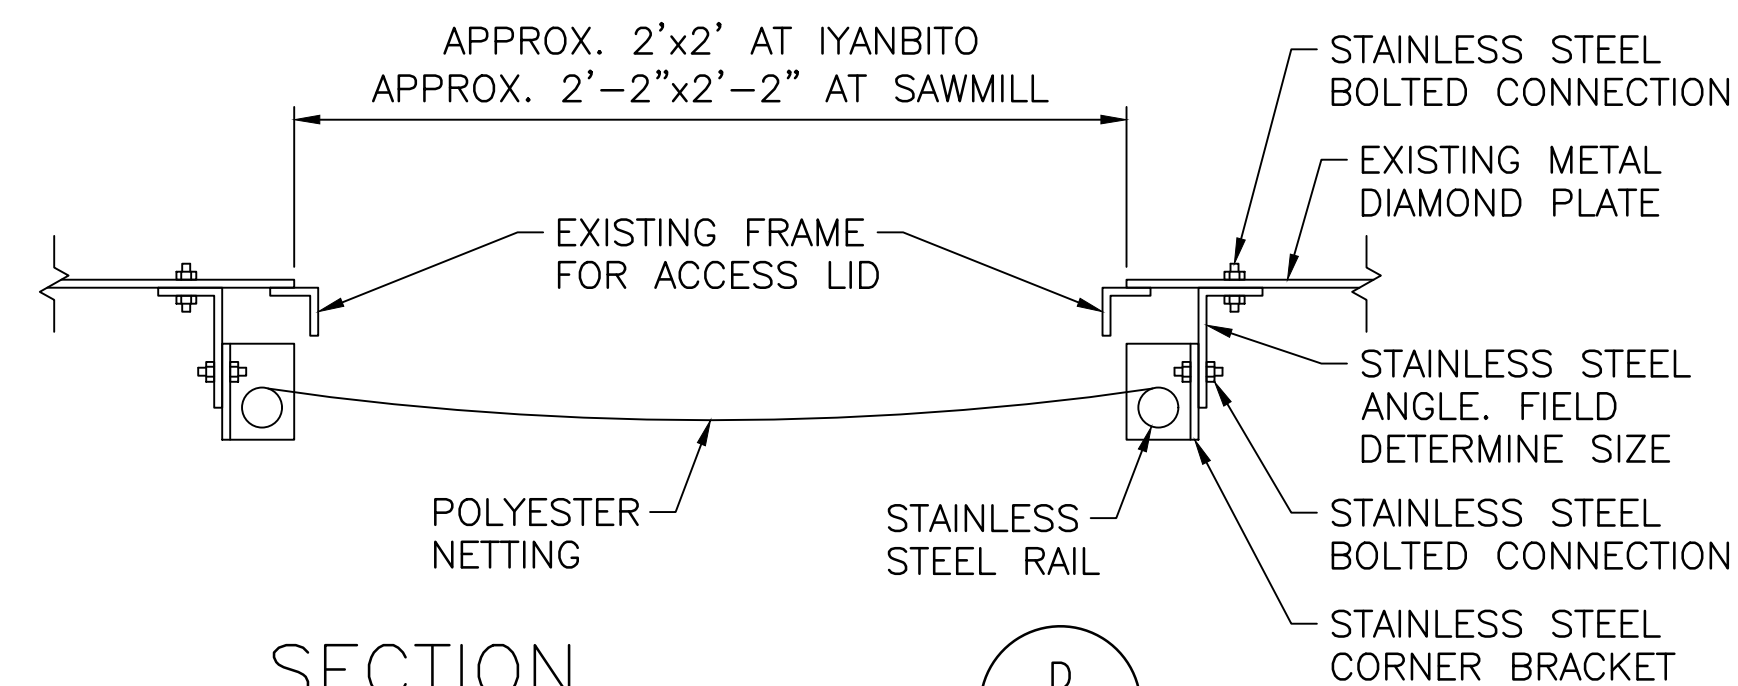

**SECTION**

SCALE: 1-1/2"=1'-0"

M-04, M-05 M-07

**NOTES:**

1. FALL THROUGH PROTECTION SYSTEM, SAFE APPROACH, HATCH 120S, OR APPROVED EQUAL.
2. PROVIDE STAINLESS FRAMING AND BOLTS AS NEEDED TO SUPPORT FALL THROUGH PROTECTION SYSTEM FROM VALVE VAULT TOP PLATE.
3. FIELD DETERMINE ALL DIMENSIONS.
4. HINGED VALVE VAULT ACCESS LID NOT SHOWN FOR CLARITY.

NAVAJO TRIBAL UTILITY AUTHORITY  
DESIGN AND CONSTRUCTION OF SAWMILL LIFT STATION FACILITIES

MISCELLANEOUS DETAILS

No.	Revision Note	Date	Drawn	Check

**NCS ENGINEERS**  
EST. 1998  
202 EAST EARLL DRIVE, STE 110  
PHOENIX, AZ 85012  
(602) 629-0206

EXPIRATION DATE: 09/30/27

Drawn by:	KWB
Design by:	LAH
Approved by:	RN
Date:	09/16/2025
Project No.:	2496
Sheet No.:	M-07

SCHEMATIC DIAGRAM SYMBOLS

	CONTROL RELAY		2 POSITION SELECTOR SWITCH POSITION LEGEND: X=CLOSED O=OPEN
	TIME DELAY RELAY		3 POSITION SELECTOR SWITCH HAND - OFF - AUTO POSITION LEGEND: X=CLOSED O=OPEN
	ALARM RELAY		NORMALLY CLOSED PUSH BUTTON
	ELAPSED TIME METER		LOCKOUT STOP PUSH BUTTON
	MOTOR STARTER OR CONTACTOR COIL		NORMALLY OPEN PUSH BUTTON
	PHOTO CELL		EMERGENCY STOP PUSH BUTTON (MAINTAINED)
	BEACON ALARM LIGHT LETTER INDICATES COLOR R=RED, A=AMBER, B=BLUE, G=GREEN		DISCONNECT SWITCH SHOWN WITH RATING AND NUMBER OF POLES
	PILOT LIGHT LETTER INDICATES COLOR R=RED, A=AMBER, B=BLUE, G=GREEN		LIMIT OR POSITION SWITCH
	OUTPUT DV/DT FILTER		PRESSURE SWITCH HIGH
	HEATING ELEMENT		PRESSURE SWITCH LOW
	TRANSFORMER		FLOW SWITCH
	CURRENT TRANSFORMER		LEVEL FLOAT SWITCH
	GROUND CONNECTION		TIMER RELAY CONTACT INSTANTANEOUS CLOSE TIME DELAY OPEN
	GENERATOR		TIMER RELAY CONTACT NORMALLY OPEN TIME DELAY CLOSE
	HORN		TEMPERATURE SWITCH
	FULL VOLTAGE NON-REVERSING (FVNR) MOTOR STARTER OR CONTACTOR NUMBER DESIGNATES NEMA SIZE		FUSE
	NORMALLY OPEN CONTACT		FUSEHOLDER OR FUSEBLOCK
	NORMALLY CLOSED CONTACT		THERMAL OVERLOAD RELAY
	RTU OR PLC CONTACT		TERMINAL BLOCK
			DEVICE LOCATED AT REMOTE LOCATION
			CONDUIT SEALOFF


POWER SINGLE LINE DIAGRAM SYMBOLS

	JUNCTION BOX WITH POWER DISTRIBUTION BLOCK OR LUGS		CIRCUIT BREAKER, SHOWN WITH TRIP RATING AND NUMBER OF POLES
	CONDUIT SEALOFF		MOTOR CIRCUIT PROTECTOR WITH TRIP RATING AND NUMBER OF POLES
	LTC CONNECTION		DISCONNECT SWITCH SHOWN WITH RATING AND NUMBER OF POLES
	MC CONNECTION		MOTOR MANAGEMENT RELAY
	BOND TO METALLIC WATER PIPE		SURGE PROTECTIVE DEVICE
	UTILITY METER		SOLID STATE STARTER
	MOTOR, NUMBER DESIGNATES NEMA HORSEPOWER SIZE		VARIABLE FREQUENCY DRIVE
	FUSE		LINE/LOAD REACTOR
	FUSEHOLDER OR FUSEBLOCK		ELECTRONIC OVERLOAD RELAY
	GENERATOR		GROUND CONNECTION
			TRANSFORMER
			CONTACTOR

SITE PLAN SYMBOLS

	TELEPHONE OUTLET		FIELD DEVICE
	SINGLE POLE SWITCH		GROUND ROD
	3 WAY SWITCH		DUPLEX RECEPTACLE
	4-WAY SWITCH		ANTENNA MAST
	MANUAL MOTOR STARTER		CONDUIT SEALOFF
	SPECIAL PURPOSE OR WELDING OUTLET		DISCONNECT SWITCH
	SMOKE DETECTOR		MOTOR
	THERMOSTAT		CONDUIT TURN UP
			CONDUIT TURN DOWN

CIRCUIT SCHEDULE LEGEND

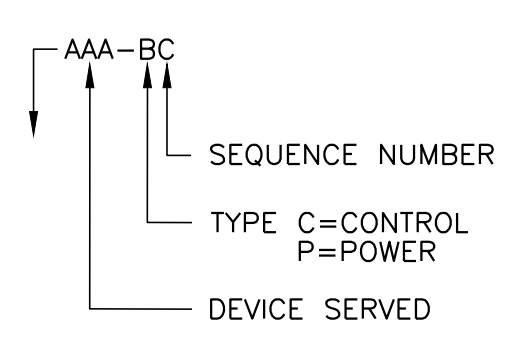

ELECTRICAL ABBREVIATIONS

A	AMPERE	JB	JUNCTION BOX	PNL	PANEL
AFD	ADJUSTABLE FREQUENCY DRIVE	LO	LOW	PO	PULSE OUTPUT
AF	ABOVE FINISHED FLOOR	LAN	LOCAL AREA NETWORK	PPB	POWER PULLBOX
AFG	ABOVE FINISHED GRADE	LC	LOOP CONTROLLER	PPG	POUNDS PER GALLON
AI	ANALOG INPUT	LCL	LEVEL CONTROL, LOW	PPH	POUNDS PER HOUR
AIC	AMPS INTERRUPTING CAPACITY	LCP	LOCAL CONTROL PANEL	PPM	PARTS PER MILLION
AO	ANALOG OUTPUT	LOS	LOCK-OUT-STOP	PR	PAIR
AS	AIR SUPPLY	LOR	LOCAL/OFF/REMOTE	PRES	PRESSURE
ATS	AUTOMATIC TRANSFER SWITCH	LS	LEVEL (i.e., FLOAT) SWITCH	PS	PRESSURE SWITCH
BC	BYPASS CONTACTOR	LTC	LIQUIDTIGHT FLEXIBLE METAL CONDUIT	PSH	PRESSURE SWITCH, HIGH
C	CONDUIT	M	MOTOR	PSI	POUNDS PER SQUARE INCH
CB	CIRCUIT BREAKER	MA	MANUAL/AUTO	PV	PROCESS VARIABLE
CCW	COUNTER CLOCKWISE	mA	MILLIAMPERE	RAS	RETURN ACTIVATED SLUDGE
CL2	CHLORINE	MAX	MAXIMUM	RW	RAW WATER
CMP	COMPRESSOR	MC	MANUFACTURER'S CABLE	RF	RADIO FREQUENCY
CON	CONTACTOR	MCB	MAIN CIRCUIT BREAKER	RIO	REMOTE INPUT OUTPUT
CPB	CONTROL PULLBOX	MCC	MOTOR CONTROL CENTER	RS	RAW SEWAGE
CU	COPPER, BARE	MCP	MOTOR CIRCUIT PROTECTOR	RSP	RAW SEWAGE PUMP
CV	CONTROL VALVE	MFR(S)	MANUFACTURER(S)	RST	RESET
CW	CLOCKWISE	MGD	MILLION GALLONS PER DAY	RTD	RESISTANCE TEMPERATURE DETECTOR
DCS	DISTRIBUTED CONTROL SYSTEM	MGL	MILLIGRAMS PER LITER	RTU	REMOTE TELEMETRY UNIT
DI	DISCRETE INPUT	MH	MANHOLE	RWT	REFLECTED WAVE TRAP
DO	DISCRETE OUTPUT	MIN	MINIMUM	SCA	SHORT CIRCUIT AMPS
DP	DISTRIBUTION PANEL	MOV	MOTOR OPERATED VALVE	SCCR	SHORT CIRCUIT CURRENT RATING
DW/DT	DIFFERENTIAL VOLTAGE/TIME DRAWING	MMR	MOTOR MANAGEMENT RELAY	SEQ	SERVICE ENTRANCE EQUIPMENT
ETM	ELAPSED TIME METER	MTU	MASTER TELEMETRY UNIT	SES	SERVICE ENTRANCE SECTION
EOL	ELECTRONIC OVERLOAD	NEC	NATIONAL ELECTRICAL CODE	SLC	SINGLE LOOP CONTROLLER
EXIST	EXISTING	NECA	NATIONAL ELECTRICAL CONTRACTOR ASSOCIATION	SLOS	START-LOCK-OUT-STOP
FA	FOUL AIR	N.C.	NORMALLY CLOSED	SMC	SUBMERSIBLE MANUFACTURER CABLE
FC	FAIL CLOSED	N.O.	NORMALLY OPEN	SO2	SULFUR DIOXIDE
FE	FLOW ELEMENT	NIC	NOT IN CONTRACT	SP	SET POINT
FLA	FULL LOAD AMPS	NOTC	NORMALLY OPEN TIMED CLOSED	SPC	SPARE CONDUIT
FS	FLOW SWITCH	NPW	NON-POTABLE WATER	SPD	SURGE PROTECTOR DEVICE
FVNR	FULL VOLTAGE NON-REVERSING FINISHED WATER	NS	NITROGEN SUPPLY	SPR	SPARE
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	NTS	NOT TO SCALE	SS	START/STOP
GFP	GROUND FAULT PROTECTION	NTU	TURBIDITY	SSS	SOLID STATE STARTER (SOFT START)
GND	GROUND	OF	OFF	ST	SHUNT TRIP
GPD	GALLONS PER DAY	OIT	OPERATOR INTERFACE TERMINAL	TS	TEMPERATURE SWITCH
GPH	GALLONS PER HOUR	OL	OVERLOAD	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
GPM	GALLONS PER MINUTE	OLR	OVERLOAD RELAY	TYP	TYPICAL
GRS	GALVANIZED RIGID STEEL	OO	ON/OFF (MAINTAINED)	UG	UNDERGROUND
H, HI	HIGH	OR	OFF-REMOTE	UL	UNDERWRITERS LABORATORIES
H2S	HYDROGEN SULFIDE	OSC	OPEN/STOP/CLOSE	UM	UTILITY METER
HMI	HUMAN MACHINE INTERFACE	P	PHASE	UNO	UNLESS NOTED OTHERWISE
HOA	HAND-OFF-AUTO	PB	PULL BOX	V	VARIABLE FREQUENCY DRIVE
HOR	HAND-OFF-REMOTE CURRENT	PCP	PROCESS CONTROL PANEL	VFD	VARIABLE FREQUENCY DRIVE
I	INSTRUMENTATION CABLE	PCV	PRESSURE CONTROL VALVE	W	WATT, WIRE
ICR	INTERMITTENT CYCLE REACTOR	PFR	PHASE/POWER FAILURE RELAY	WAS	WASTE ACTIVATED SLUDGE
IO	INPUT/OUTPUT	PI	PULSE INPUT	WP	WEATHERPROOF
ISC	SHORT CIRCUIT CURRENT	PLC	PROGRAMMABLE LOGIC CONTROLLER	XFMR	TRANSFORMER
		PLI	PLANT INFLUENT	XMR	TRANSFORMER
		PMP	PUMP	XMT	TRANSMITTER
				ZS	POSITION (i.e., LIMIT) SWITCH

ELECTRICAL LINETYPES

	EXPOSED CONDUIT
	EXISTING EXPOSED CONDUIT
	UNDERGROUND CONDUIT
	EXISTING UNDERGROUND CONDUIT
	BARE COPPER GROUND CONDUCTOR
	EXISTING OR FUTURE
	NEW ELECTRICAL EQUIPMENT
	DEMOLITION
	DETAIL VIEW OR MATCHING
	CAPPED CONDUIT STUB OUT
	GROUPED CONDUIT AND CIRCUIT IDENTIFICATION TAGS. REFER TO THE POWER SINGLE-LINE, SCHEMATIC CONNECTION DIAGRAMS AND CIRCUIT SCHEDULE FOR CONDUIT SIZES AND CONTENTS.  P=POWER C=CONTROL

GENERAL NOTES

1. THE COMPLETED INSTALLATION SHALL COMPLY WITH LATEST REVISION OF APPLICABLE FEDERAL, STATE, AND LOCAL CODES, ORDINANCES, AND REGULATIONS. THE CONTRACTOR SHALL OBTAIN NECESSARY PERMITS AND INSPECTIONS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION. ALL WORK SHALL BE COMPLETED IN A NEAT, WORKMANLIKE MANNER IN ACCORDANCE WITH THE LATEST NECA STANDARDS OF INSTALLATION UNDER COMPETENT SUPERVISION. INSTALL GROUNDING PER NEC.
2. VISIT THE SITE PRIOR TO BIDDING TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND OTHER FACTORS, WHICH MAY AFFECT THE EXECUTION OF THE WORK. INCLUDE ALL RELATED COSTS IN THE INITIAL BID PROPOSAL.
3. THE CONTRACTOR SHALL COORDINATE WORK WITH THE UTILITIES PROVIDING SERVICES ON THIS PROJECT, AND SHALL COMPLY WITH ALL THEIR INSTALLATION REQUIREMENTS.
4. ALL MATERIALS SHALL BE NEW AND OF THE BEST QUALITY, MANUFACTURED IN ACCORDANCE WITH THE LATEST REVISION OF NEMA, ANSI, UL, OR OTHER APPLICABLE STANDARDS. THE USE OF MANUFACTURERS' NAMES, MODELS, AND NUMBERS IS INTENDED TO ESTABLISH STYLE, QUALITY, APPEARANCE, USEFULNESS, AND BID PRICE.
5. PROTECT ALL ELECTRICAL MATERIAL AND EQUIPMENT INSTALLED AGAINST DAMAGE BY OTHER TRADES, WEATHER CONDITIONS, OR ANY OTHER PREVENTABLE CAUSES. EQUIPMENT DAMAGED DURING SHIPPING OR CONSTRUCTION, PRIOR TO ACCEPTANCE BY THE ENGINEER OR THE OWNER, WILL BE REJECTED AS DEFECTIVE.
6. LEAVE THE SITE CLEAN. REMOVE ALL DEBRIS, EMPTY CARTONS, TOOLS, CONDUIT, WIRE SCRAPS AND ALL MISCELLANEOUS SPARE EQUIPMENT AND MATERIALS USED IN THE WORK DURING CONSTRUCTION. ALL COMPONENTS SHALL BE FREE OF DUST, GRIT AND FOREIGN MATERIALS, LEFT AS NEW BEFORE FINAL ACCEPTANCE OF WORK. DAMAGED PAINT AND FINISHES SHALL BE TOUCHED UP OR REPAINTED WITH MATCHING COLOR PAINT AND FINISH.
7. CIRCUIT CONDUCTORS #6 AWG OR SMALLER SHALL BE THWN STRANDED COPPER. #4 AWG THROUGH #2 AWG SHALL BE XHHW STRANDED COPPER. #1 AWG OR LARGER SHALL BE XHHW-2 STRANDED COPPER. MINIMUM POWER CONDUCTOR SIZE SHALL BE #12 AWG WITH #12 AWG GROUND.
8. UNDERGROUND CONDUITS SHALL BE SCHEDULE 40 PVC. MINIMUM CONDUIT DEPTH SHALL BE 24 INCHES. MINIMUM UNDERGROUND CONDUIT SIZE SHALL BE 1 INCH.
9. CONDUITS SHALL BE MARKED AT EACH END WITH MATCHING NUMBERED BRASS TAGS. SPARE CONDUITS SHALL HAVE A PULL STRING INSTALLED, SECURED, AND CAPPED.
10. EXPOSED CONDUITS SHALL BE PVC COATED GALVANIZED RIGID STEEL (GRS). MINIMUM SIZE 3/4 INCH, UNLESS OTHERWISE NOTED ON THE PLANS.
11. SAFETY SWITCHES, ELECTRICAL DISTRIBUTION EQUIPMENT, CONTROL PANELS, AND OTHER ELECTRICAL DEVICES SHALL BE UL LISTED, AND RATED FOR HEAVY DUTY SERVICE.
12. WIRING DEVICES SHALL BE SPECIFICATION GRADE.
13. THE CONTRACTOR IS RESPONSIBLE FOR MANAGING, SCHEDULING, DOCUMENTING, AND PERFORMING THE WORK SO THAT A COMPLETE ELECTRICAL, INSTRUMENTATION AND CONTROL SYSTEM FOR THE FACILITY IS PROVIDED. ACCURATE SHOP AND RECORD DRAWINGS, AND O&M MANUALS SHALL BE SUBMITTED PRIOR TO FINAL ACCEPTANCE OF THE WORK.
14. TYPICAL DETAILS SHALL APPLY IN ALL CASES, WHETHER SPECIFICALLY REFERRED TO OR NOT.

NAVAJO TRIBAL UTILITY AUTHORITY  
SAWMI LIFT STATION DESIGN ADDITION

ELECTRICAL NOTES, SYMBOLS, AND LEGEND



Drawn by:	ML
Design by:	CAR
Approved by:	BDD
Date:	09/19/25
Project No.:	2496
Sheet No.:	E-01



**NOTES:**

1. SHORT CIRCUIT CALCULATIONS SHALL BE VERIFIED ONCE FAULT CURRENT DATA FROM UTILITY BECOMES AVAILABLE.

SHEET NO.	CIRCUIT	CONDUCTORS
E-05	ANT300-C1	1 - ANTENNA CABLE
E-05	LCP301-C1	36 - #14, #14 GND
E-05	LCP301-C2	1 - CAT6 CABLE
E-05	LIT301-C2	1 - IC, #14 GND
E-05	ATS300-C1	4 - #14, #14 GND
E-05	TSH302-C1	2 - #14, #14 GND
E-05	YS302-C1	2 - #14, #14 GND
E-05	TSH301-C1	2 - #14, #14 GND
E-05	YS301-C1	2 - #14, #14 GND
E-05	LSLL301-C1	2 - #14, #14 GND
E-05	LSL301-C1	2 - #14, #14 GND
E-05	LSH301-C1	2 - #14, #14 GND
E-05	LSHH301-C1	2 - #14, #14 GND
E-05	LIT301-C1	1 - IC, #14 GND
E-05	GEN300-C2	2 - #14, #14 GND
E-05	GEN300-C1	8 - #14, #14 GND
E-05	LCP301-C3	1 - CAT6 CABLE

**A**  
~  
CIRCUIT SCHEDULE

SHORT CIRCUIT CALCULATIONS	
DEFINITIONS	FORMULAS
ISC = SHORT CIRCUIT CURRENT (AMPS)	3 PH: $f = \frac{1.732 \times L \times I_{sc}}{N \times C \times V_{L-L}}$
N = NUMBER OF CONDUCTORS/PHASE	
L = LENGTH OF CONDUCTOR (FEET)	
C = CONSTANT FROM TABLE OF "C"	1 PH: $f = \frac{2 \times L \times I_{sc}}{N \times C \times V_{L-L}}$
I <sub>sc</sub> = AVAILABLE SHORT-CIRCUIT AMPS	
V <sub>L-L</sub> = LINE TO LINE VOLTAGE (VOLTS)	
V <sub>P</sub> = PRIMARY VOLTAGE	1 PH XFMR: $f = \frac{I_{sc} \times V_P \times \% Z}{100,000 \times KVA}$
V <sub>S</sub> = SECONDARY VOLTAGE	
% Z = TRANSFORMER % IMPEDANCE	

ISC(1)	
$f1 = \frac{2 \times 15 \times 8,890}{1 \times 13923 \times 240} = 0.0798$	
$M = \frac{1}{1 + 0.0798} = 0.9261$	
ISC(1) = 8,890 x 0.9261 = 8,233 A	
ISC(2)	
$f2 = \frac{2 \times 15 \times 8,233}{1 \times 13923 \times 240} = 0.0739$	
$M = \frac{1}{1 + 0.0739} = 0.9312$	
ISC(2) = 8,233 x 0.9312 = 7,667 A	
ISC(3)	
$f3 = \frac{2 \times 15 \times 7,667}{1 \times 3825 \times 240} = 0.2505$	
$M = \frac{1}{1 + 0.2505} = 0.7997$	
ISC(3) = 7,667 x 0.7997 = 6,131 A	

NOTE 1

**B**  
~  
SHORT CIRCUIT CALCULATIONS

LIGHTING FIXTURE SCHEDULE					
SYMBOL	DESCRIPTION	MOUNTING	MANUFACTURER	LAMPS	REMARKS
□	120V, 4', ENCLOSED AND GASKETED LED FIXTURE.	SURFACE OR SUSPENDED	COLUMBIA LIGHTING LXEM SERIES OR EQUAL	3.5K LUMEN OUTPUT (MIN.), 4000K COLOR TEMP.	50' C RATED, DAMP LOCATIONS, UL LISTED

**C**  
~  
LIGHTING FIXTURE SCHEDULE

**NAVAJO TRIBAL UTILITY AUTHORITY**  
**SAWMILL LIFT STATION DESIGN ADDITION**  
 ELECTRICAL SCHEDULES


No.	Revision	Note	Date	Drawn	Check



Drawn by: ML  
 Design by: CAR  
 Approved by: BDD  
 Date: 09/19/25  
 Project No.: 2496  
 Sheet No.: E-03




Sep 23, 2025 11:52am  
 X:\2400's\N2496 NTUA\_Sawmill Lift Station Design Additions\100 - E&I Design\CAD Files\02496.25\_E05.dwg

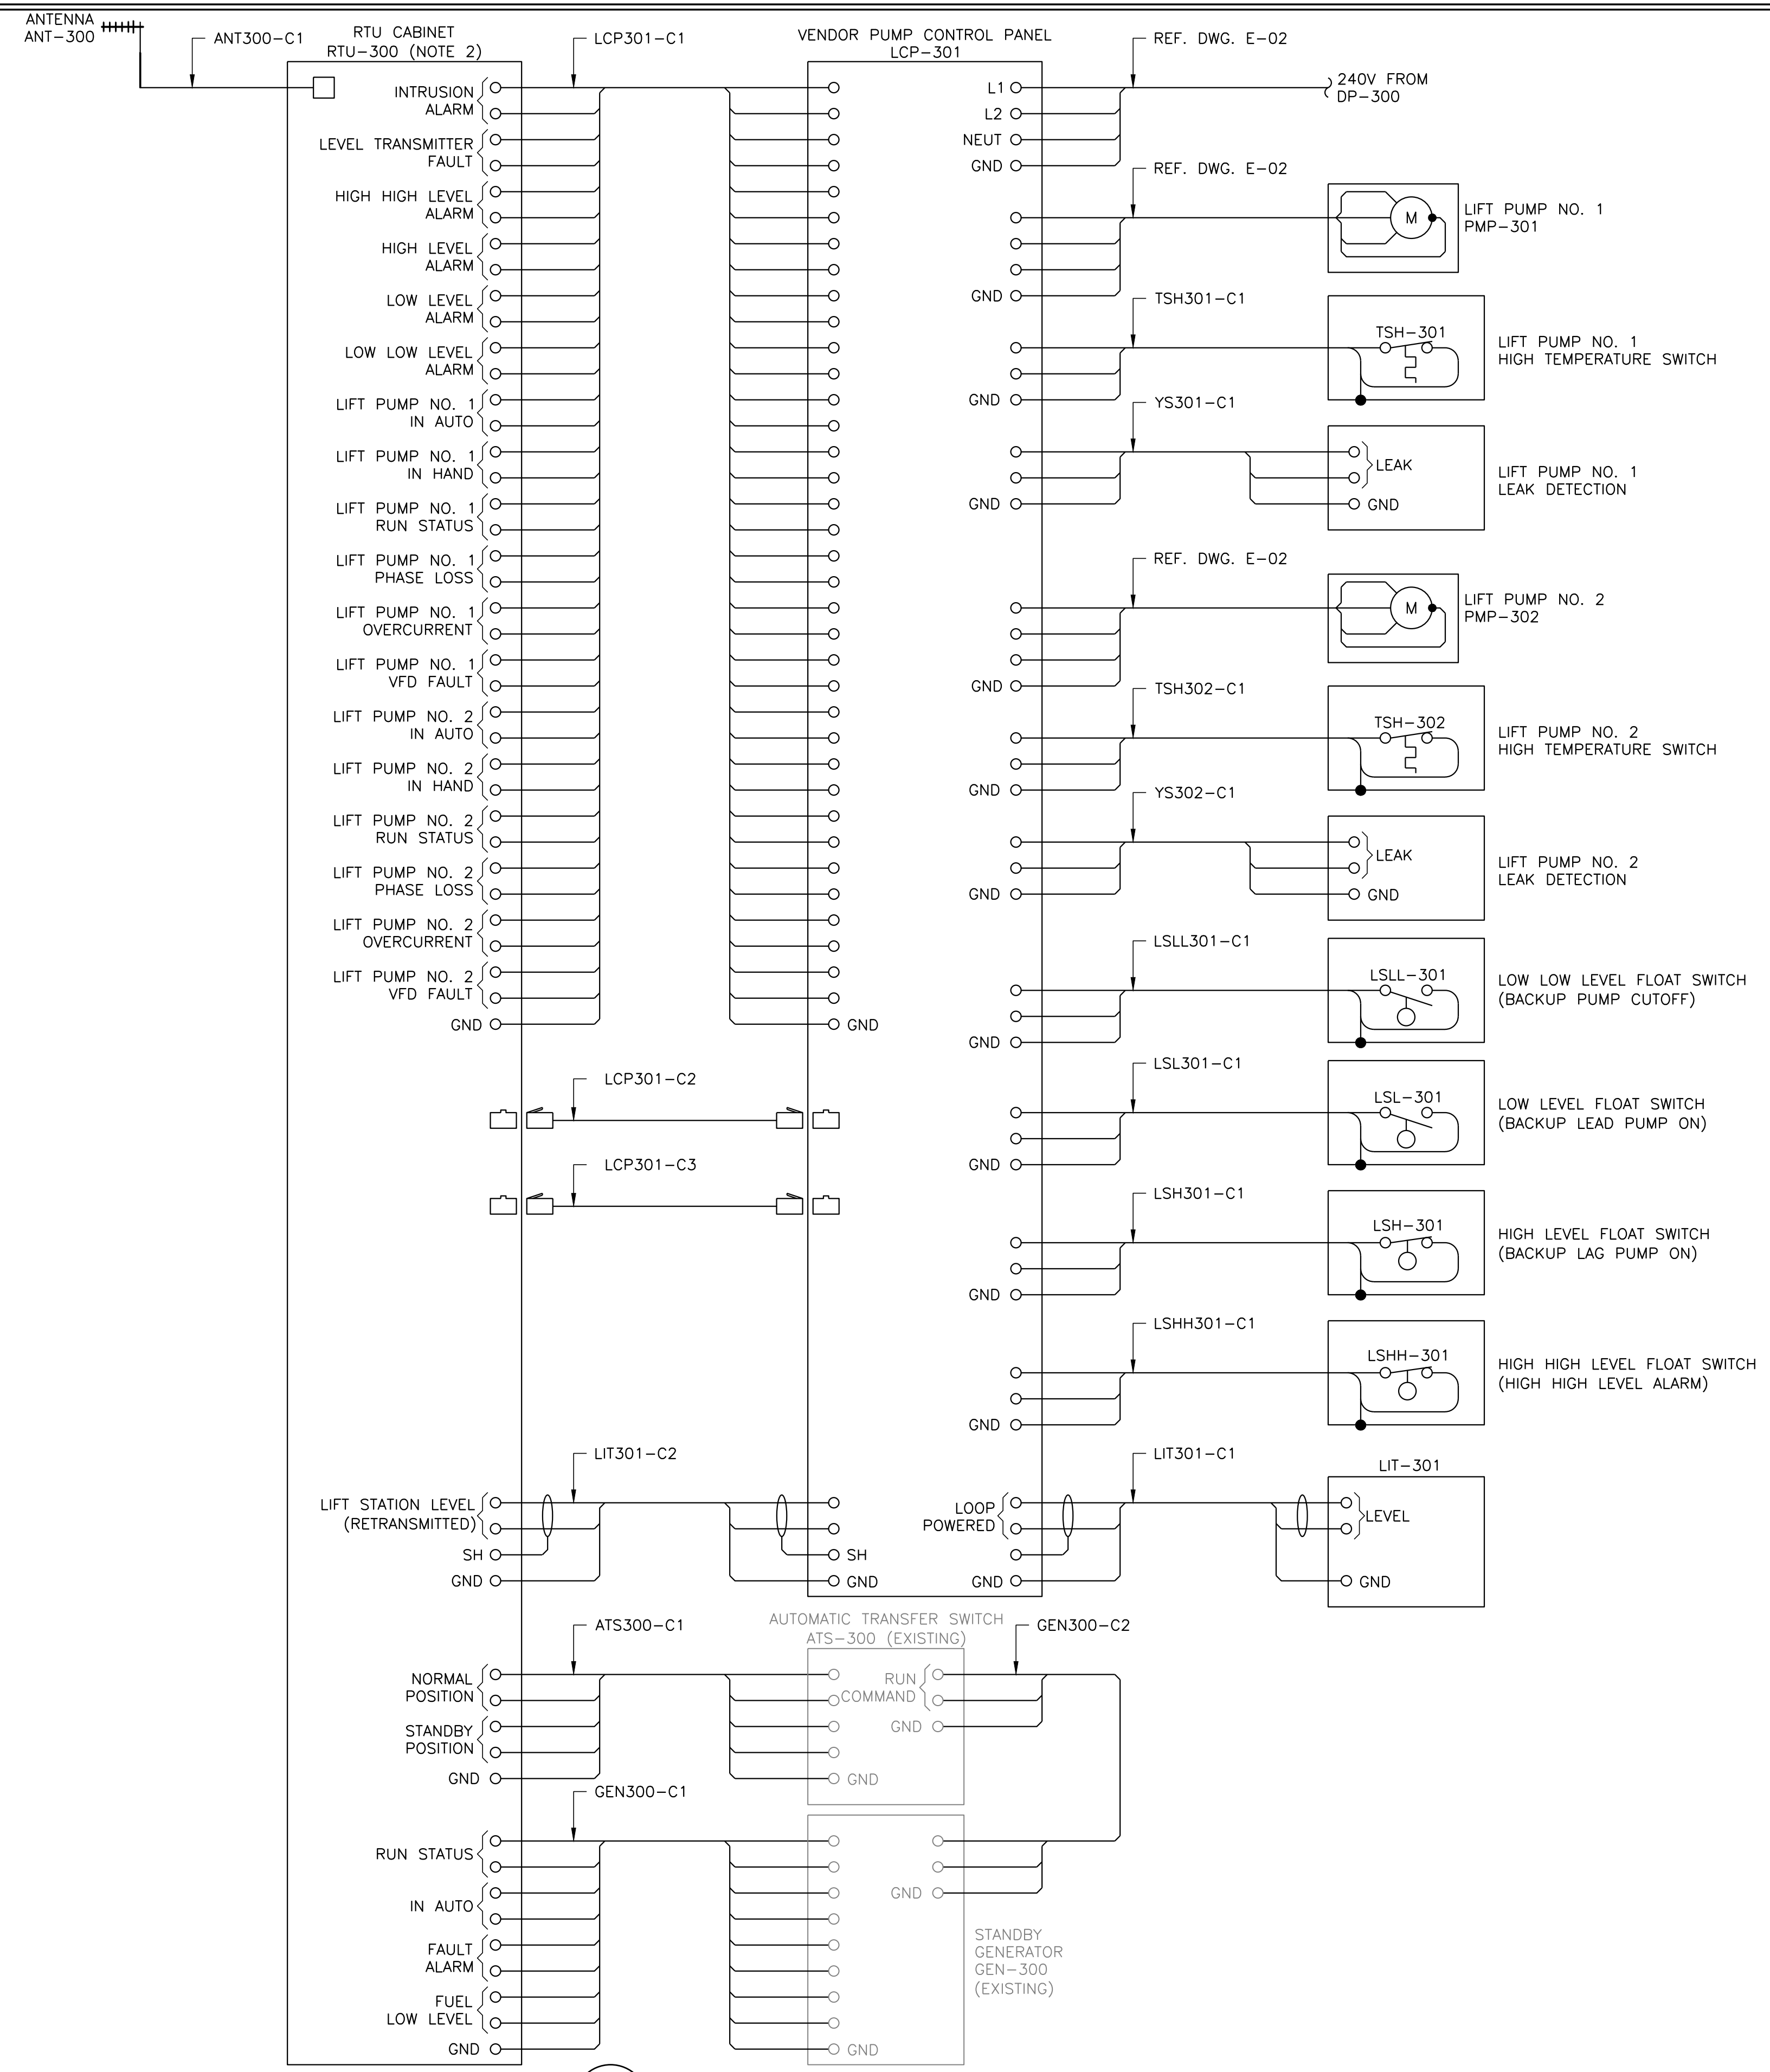

**NOTES:**

1. REFERENCE E-03 FOR MASTER CIRCUIT SCHEDULE
2. CONTRACTOR SHALL UTILIZE NTUA STANDARD PUMP STATION PLC CONTROL PANEL DESIGN AS A TEMPLATE TO DEVELOP DESIGN FOR NEW RTU CABINET. ENSURE RTU IS EQUIPPED WITH ANALOG OUTPUT CARD.

**LEGEND:**

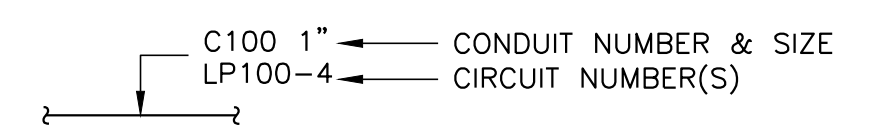


COPYRIGHT © 2025

No.	Revision	Note	Date	Drawn	Check

NAVAJO TRIBAL UTILITY AUTHORITY  
 SAWMILL LIFT STATION DESIGN ADDITION

CONNECTION DIAGRAM


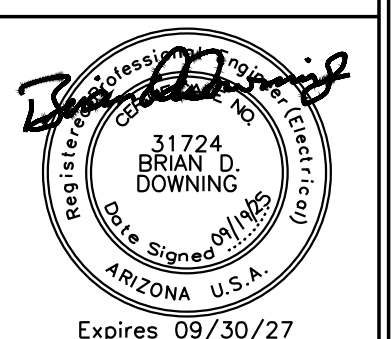


Drawn by:	ML
Design by:	CAR
Approved by:	BDD
Date:	09/19/25
Project No.:	2496
Sheet No.:	E-05

**NOTES:**


1. CONTRACTOR SHALL DEVELOP DESIGN/SHOP DRAWINGS FOR RTU PANEL. CONTRACTOR SHALL UTILIZE NTUA RTU STANDARD AND FORMAT. PLC AND SCADA PROGRAMMING SHALL BE BY OWNER UNLESS OTHERWISE SPECIFIED.
2. PANEL SHALL INCLUDE A UPS SIZED IN ACCORDANCE WITH NTUA RTU PANEL STANDARDS

**LEGEND:**

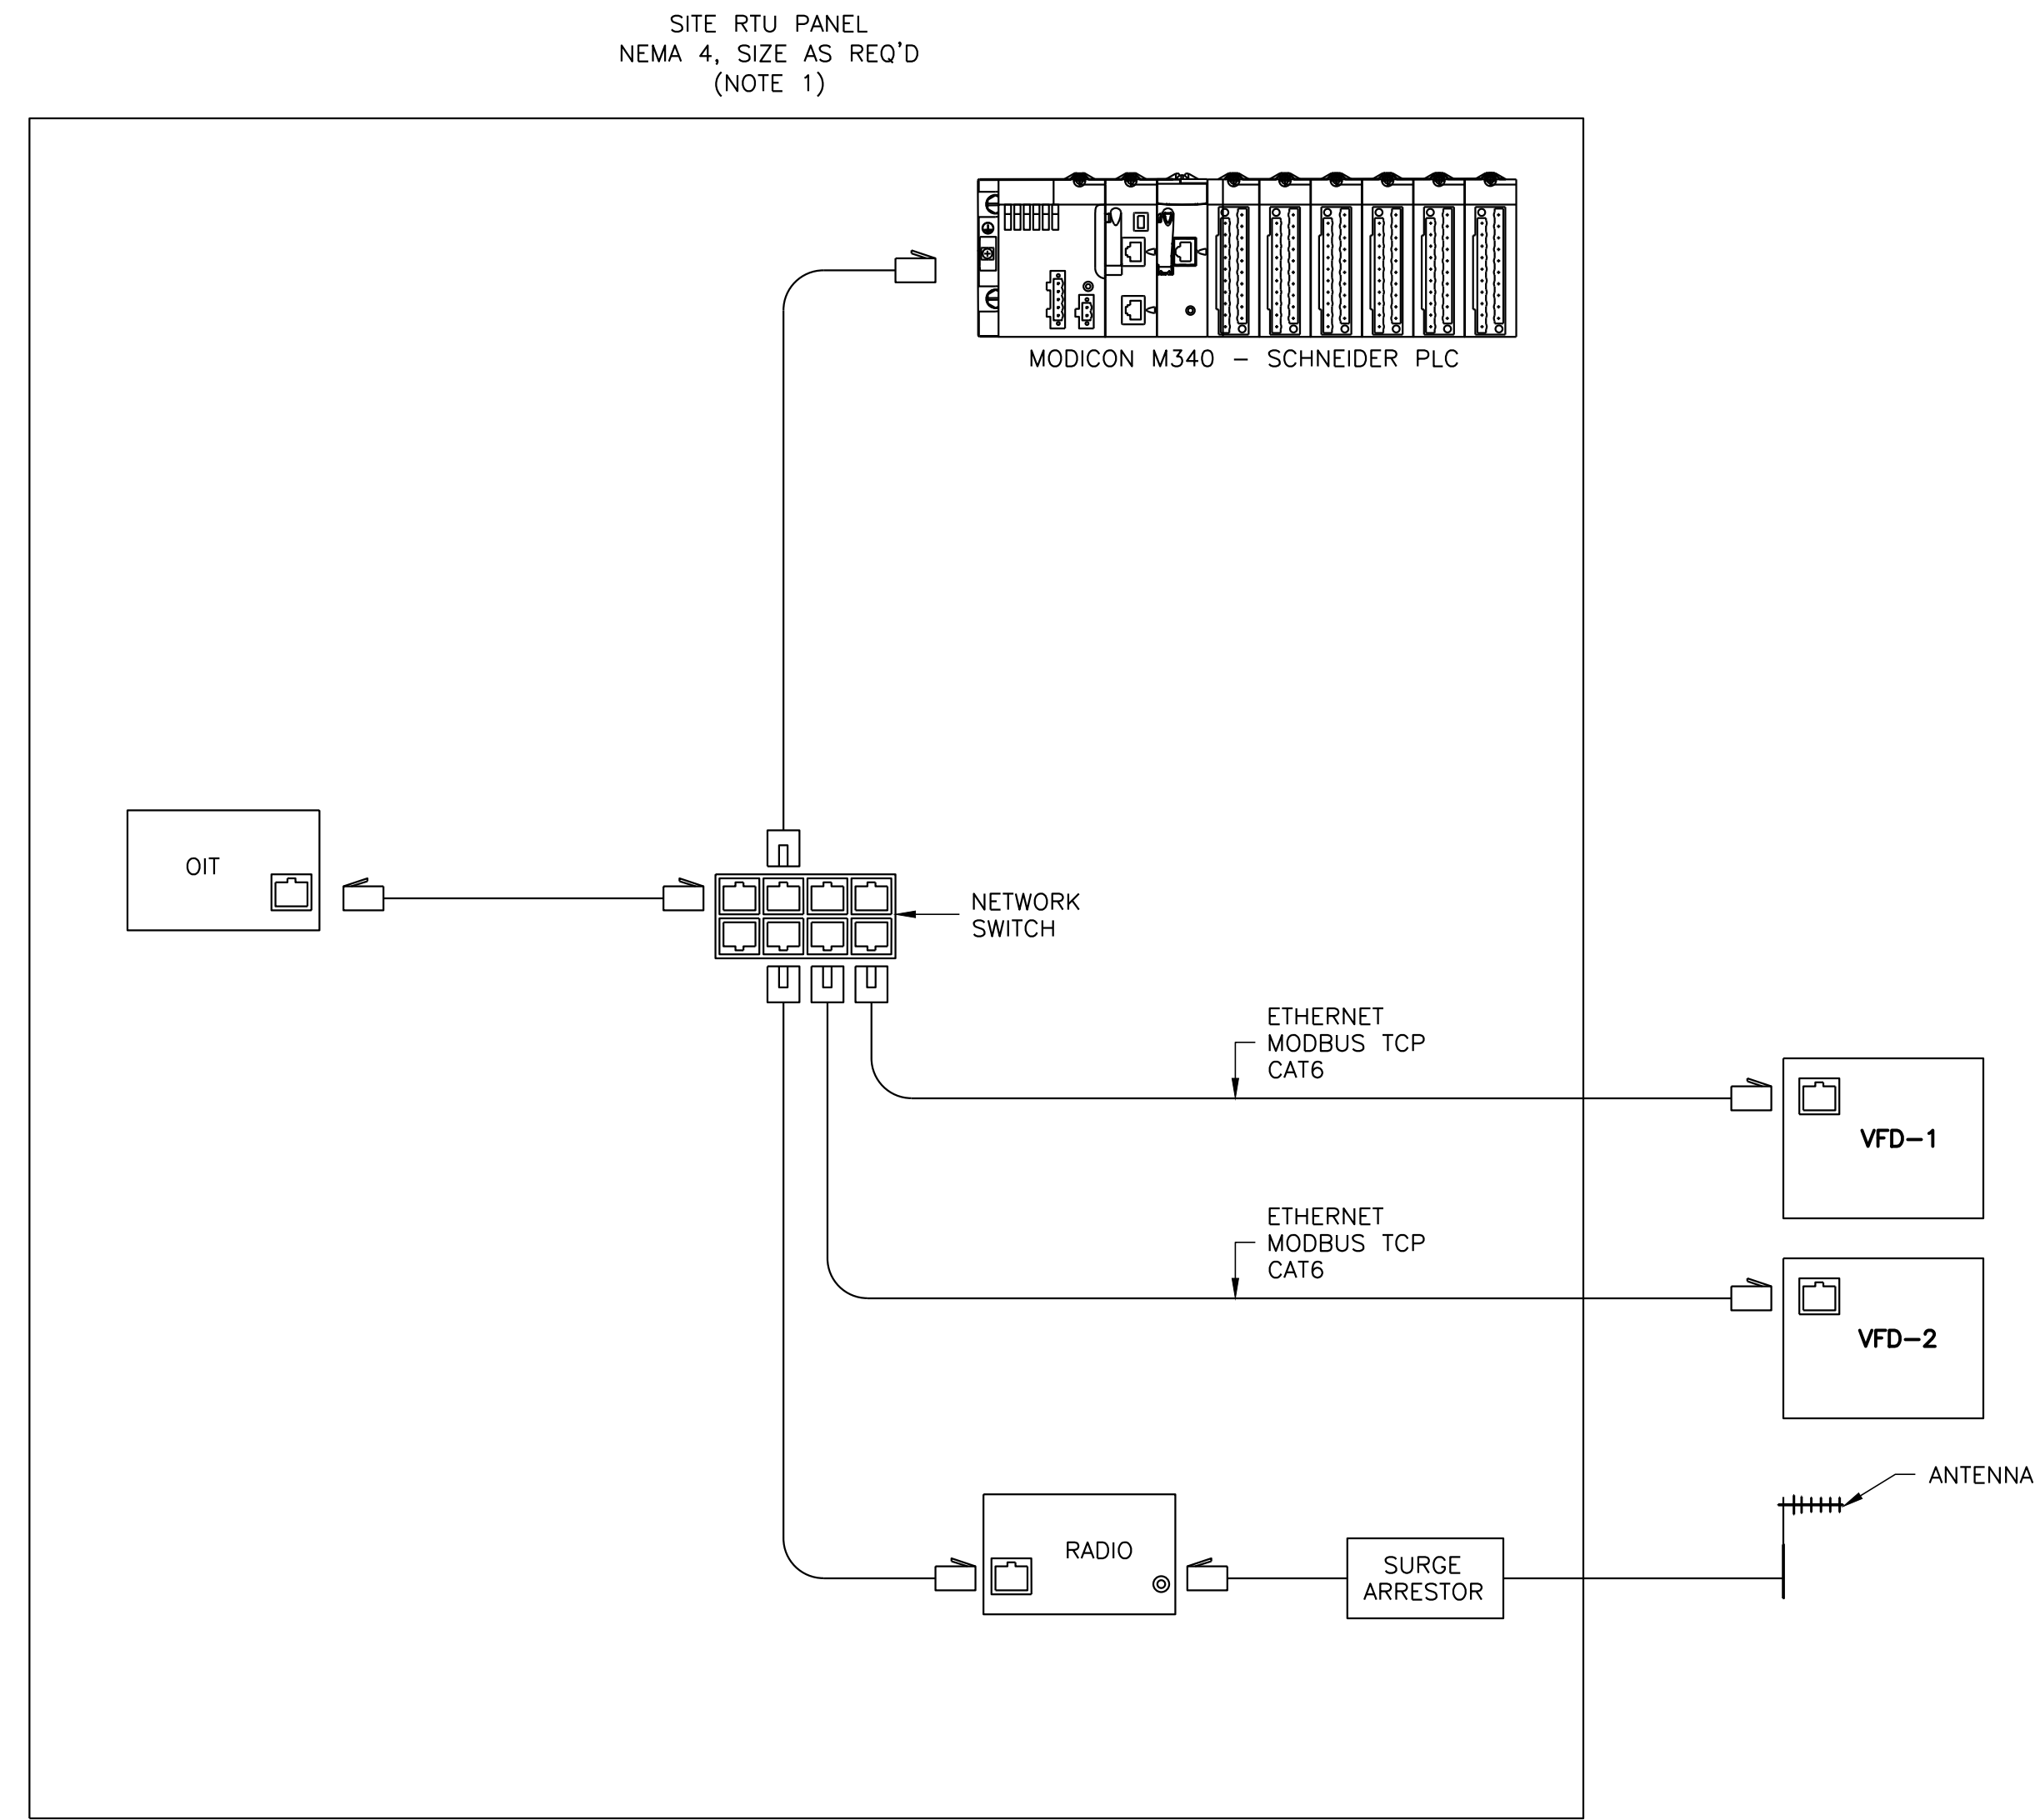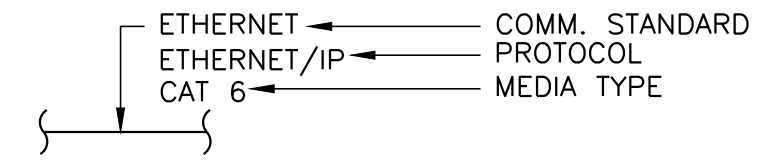

A SYSTEM COMMUNICATION DIAGRAM  
~ NETWORK

NAVAJO TRIBAL UTILITY AUTHORITY  
 SAWMILL LIFT STATION DESIGN ADDITION  
 RTU POWER DISTRIBUTION SCHEMATIC


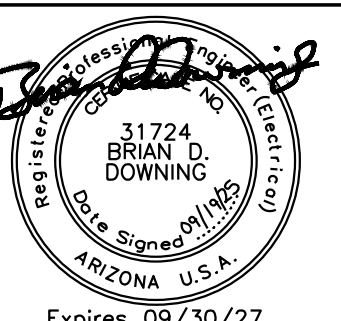


Drawn by:	ML
Design by:	CAR
Approved by:	BDD
Date:	09/19/25
Project No.:	2496
Sheet No.:	E-06

**NOTES:**

1. REFERENCE E-03 FOR MASTER CIRCUIT SCHEDULE
2. CONTRACTOR SHALL UTILIZE NTUA STANDARD PUMP STATION PLC CONTROL PANEL DESIGN AS A TEMPLATE TO DEVELOP DESIGN FOR NEW RTU CABINET. ENSURE RTU IS EQUIPPED WITH ANALOG OUTPUT CARD.

**LEGEND:**

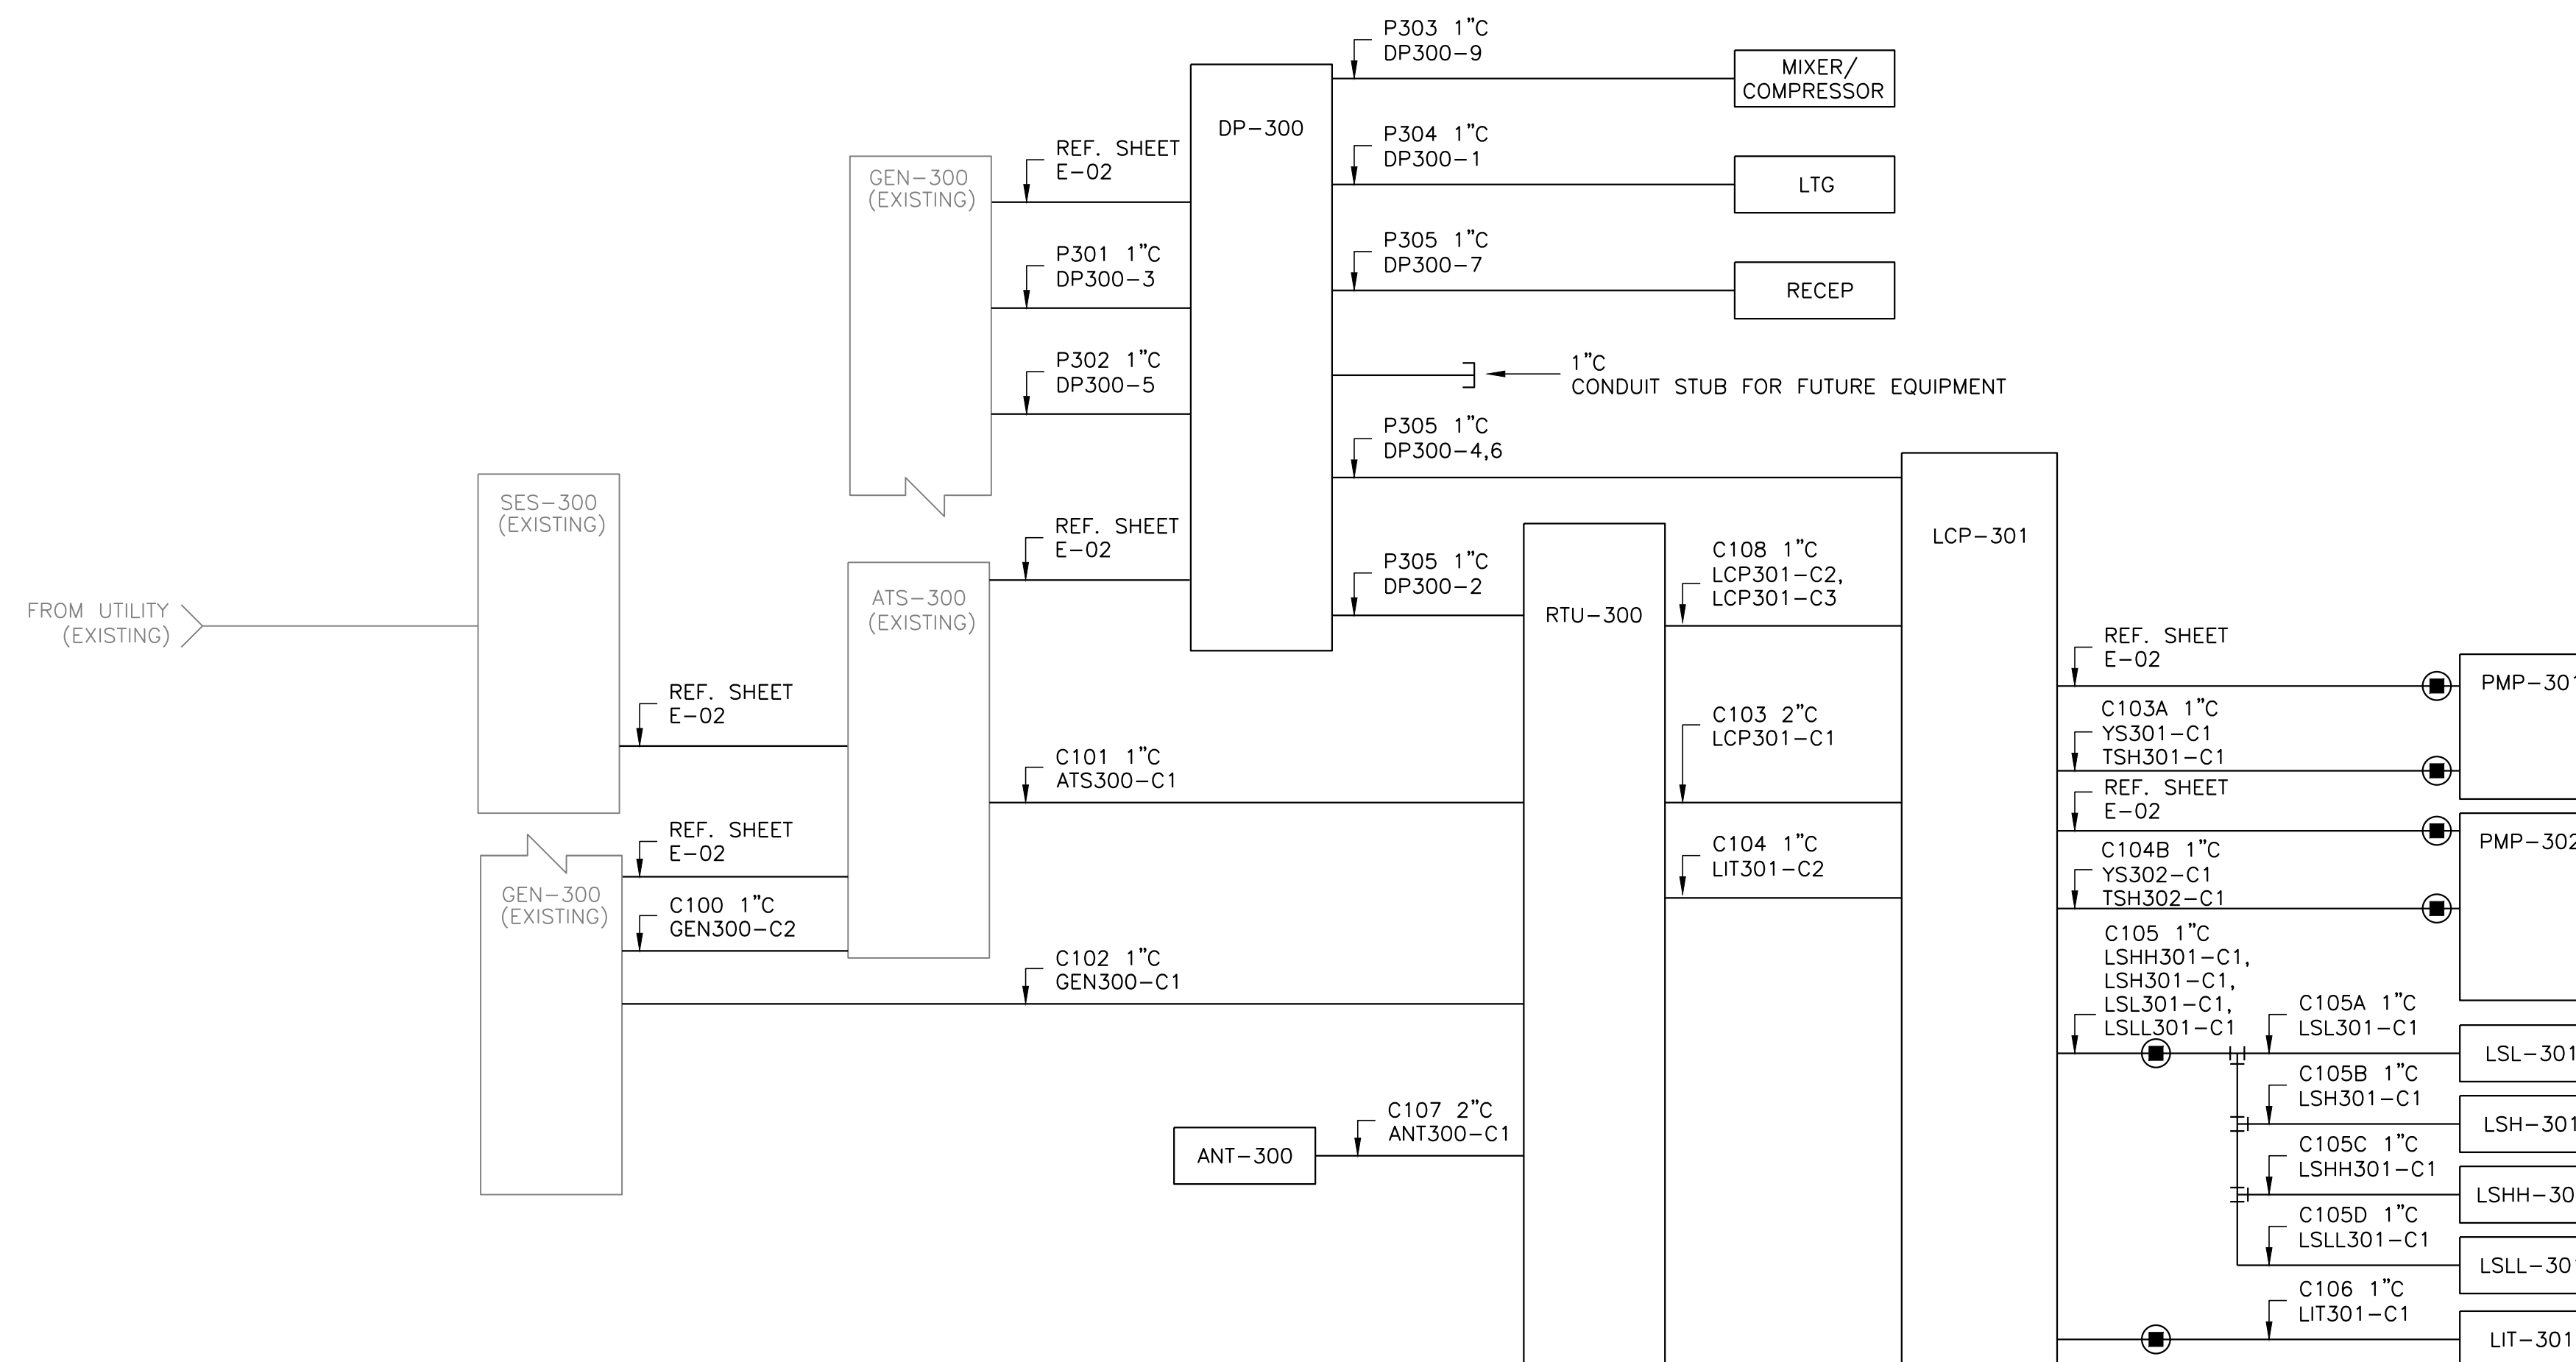


**A** CONNECTION DIAGRAM

NAVAJO TRIBAL UTILITY AUTHORITY  
SAWMI LIFT STATION DESIGN ADDITION

CONDUIT BLOCK DIAGRAM

No.	Revision	Note	Date	Drawn	Check

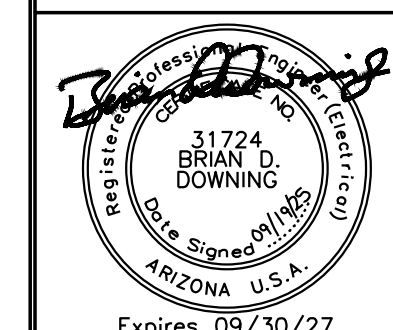

Drawn by: ML

Design by: CAR

Approved by: BDD

Date: 09/19/25

Project No.: 2496

Sheet No.: E-07



ISA INSTRUMENT IDENTIFICATION TABLE

Table with columns: FIRST LETTERS, SUCCEEDING LETTERS, MEASURED OR INITIATING VARIABLE, MODIFIER, READOUT OR PASSIVE FUNCTION, OUTPUT FUNCTION, MODIFIER. Lists ISA symbols like A (ANALYZER), B (BURNER), etc.

P&ID ABBREVIATIONS

Table of P&ID abbreviations including A (AMPERE), KW (KILOWATT), PRES (PRESSURE), and many others.

TAG NUMBERS AND DESIGNATIONS

Diagram showing tag number components: FIRST LETTER, SUCCEEDING LETTER(S), LOOP DESIGNATION NUMBER. Includes a diagram of a loop with LSL and XXX.

LINE SYMBOLS

Diagram showing various line symbols: MAJOR PROCESS PIPING OR FLOW CHANNEL, EXISTING PROCESS PIPING, FUTURE PIPING AND EQUIPMENT, etc.

Check, Drawn, Date, Revision, Note table with columns for tracking design changes.

NAVAJO TRIBAL UTILITY AUTHORITY  
SAWMILL LIFT STATION DESIGN ADDITION  
P&ID NOTES, SYMBOLS, AND LEGEND

P&ID VALVE SYMBOLS

Diagram showing various valve symbols: GATE OR GENERIC VALVE, 3-WAY VALVE, 4-WAY VALVE, etc.

P&ID EQUIPMENT AND PROCESS SYMBOLS

Diagram showing various equipment symbols: METERING PUMP WITH MANUAL STROKE CONTROL, ROTARY LUBE PUMP, SUBMERSIBLE MIXER, etc.

SENSING, INDICATION, AND CONTROL SYMBOLS

Diagram showing various sensing and control symbols: ULTRASONIC LEVEL TRANSDUCER, LE, LS, BEACON, etc.

P&ID INTERFACE SYMBOLS

Diagram showing various interface symbols: PILOT LIGHT, FIELD DEVICE, PANEL DEVICE, etc.

11:52am  
X:\2400's\N4966 NTA\_Sawmill Lift Station Design Additions\100 - E&I Design\CAD Files\02496.25\_01.dwg



Drawn by: ML  
Design by: GAR  
Approved by: BDD  
Date: 09/19/25  
Project No. 2496  
Sheet No. 1-01

